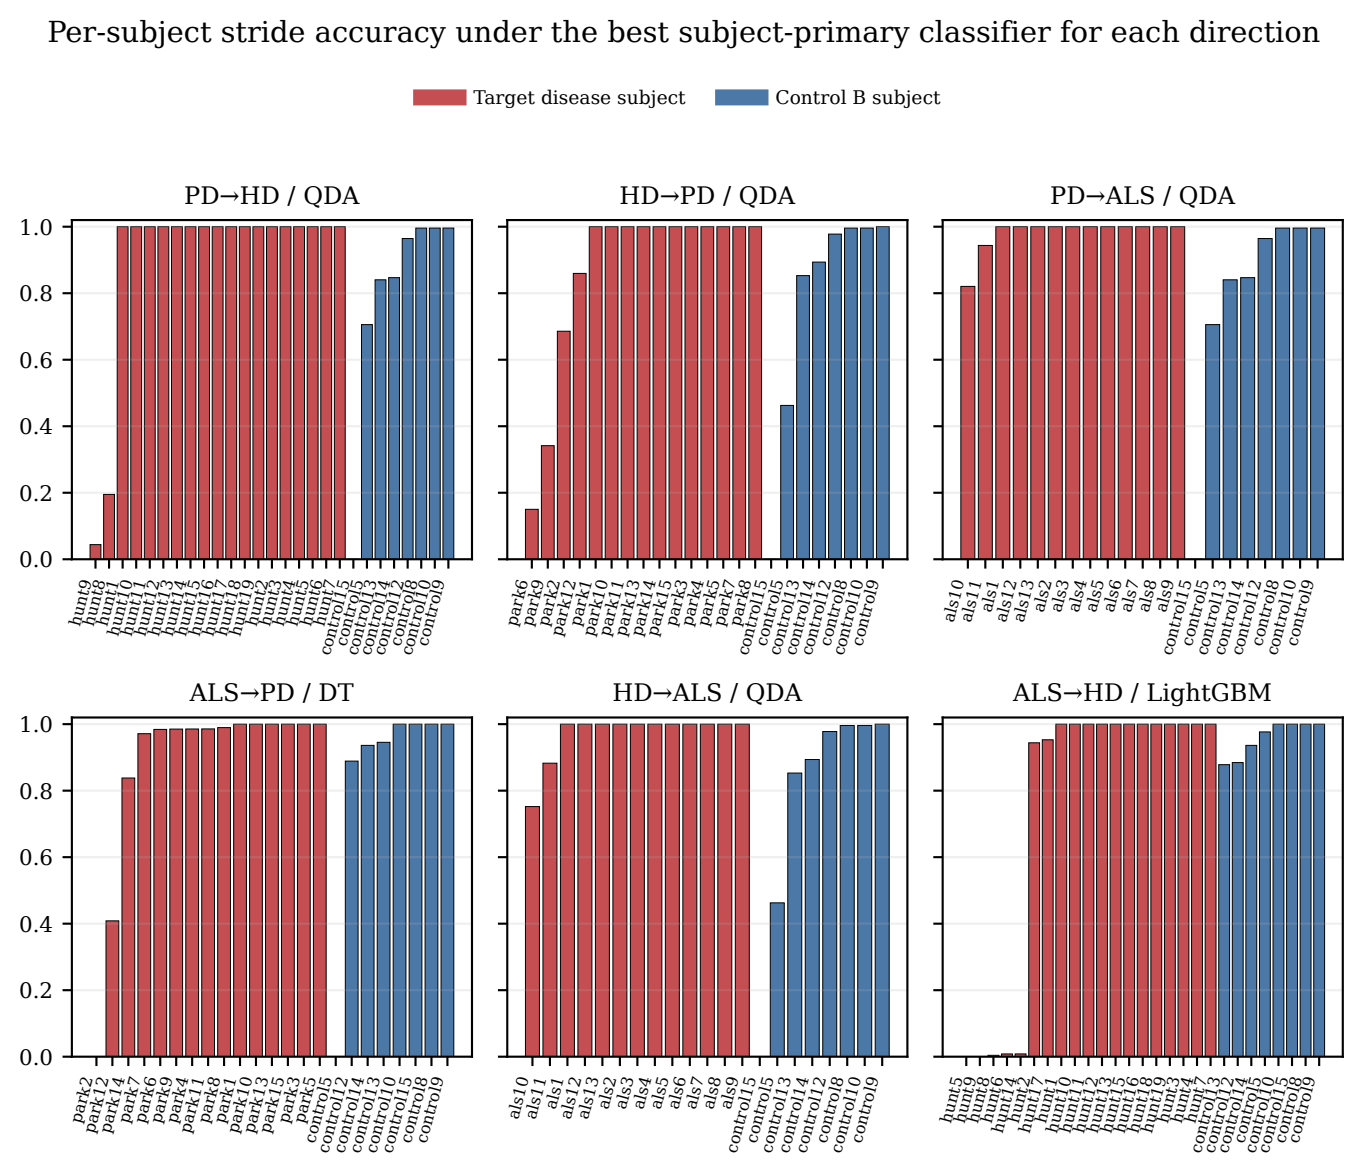

Per-subject stride accuracy under the best subject-primary classifier for each direction
Target disease subject
Control B subject
PD→HD / QDA
HD→PD / QDA
PD→ALS / QDA
ALS→PD / DT
HD→ALS / QDA
ALS→HD / LightGBM
0.0
0.2
0.4
0.6
0.8
1.0