


Aim: Unsymmetrical fault analysis

Simulink Model:

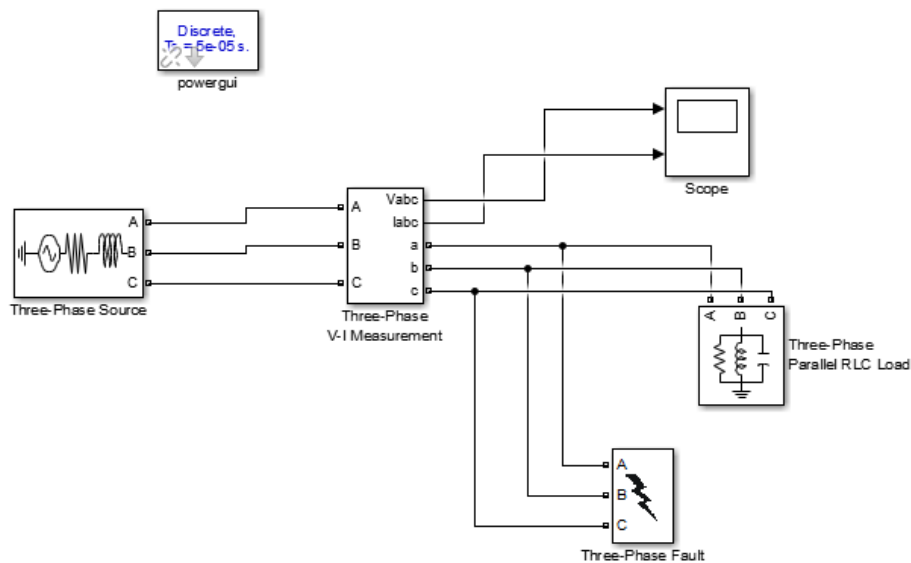

Block Parameters: Three-Phase Fault

Three-Phase Fault (mask) (link)

Implements a fault (short-circuit) between any phase and the ground. When the external switching time mode is selected, a Simulink logical signal is used to control the fault operation.

Parameters

Initial status: 0

Fault between:

☒ Phase A ☒ Phase B ☒ Phase C ☒ Ground

Switching times (s): 1/60 5/60 ☐ External

Fault resistance Ron (Ohm): 0.1

Ground resistance Rg (Ohm): 0.001


Snubber resistance Rs (Ohm): 1e6

Snubber capacitance Cs (F): inf

Measurements: Fault voltages and currents

OK Cancel Help Apply

Output waveform (without fault):

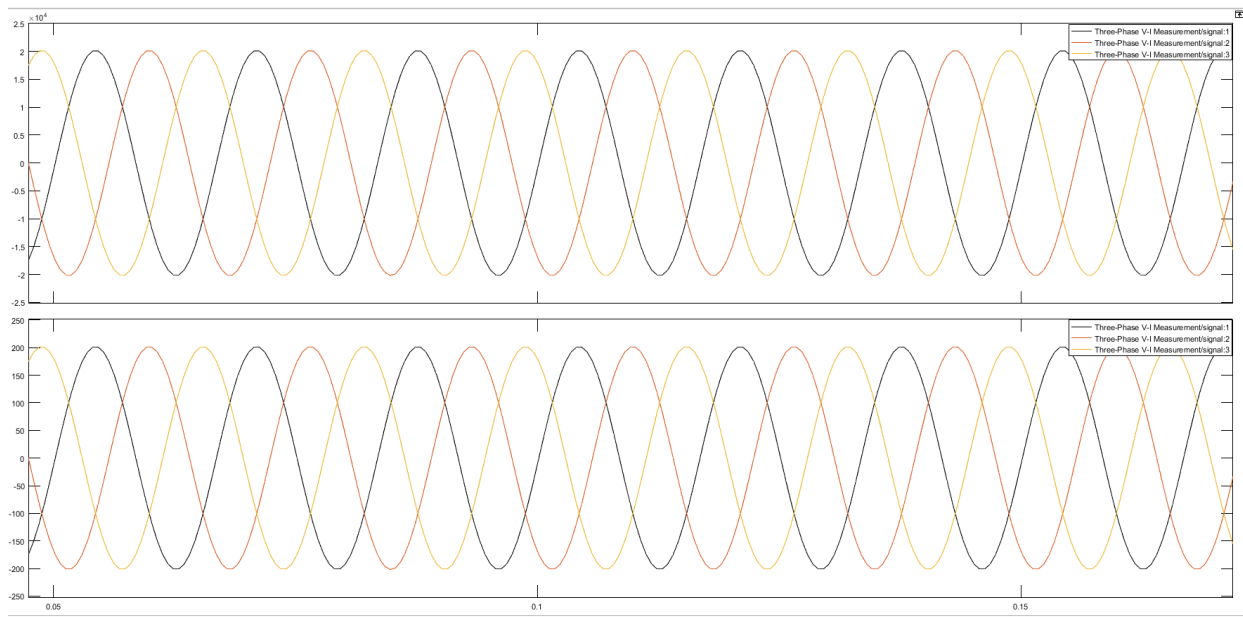

Output Waveform (with fault):

