


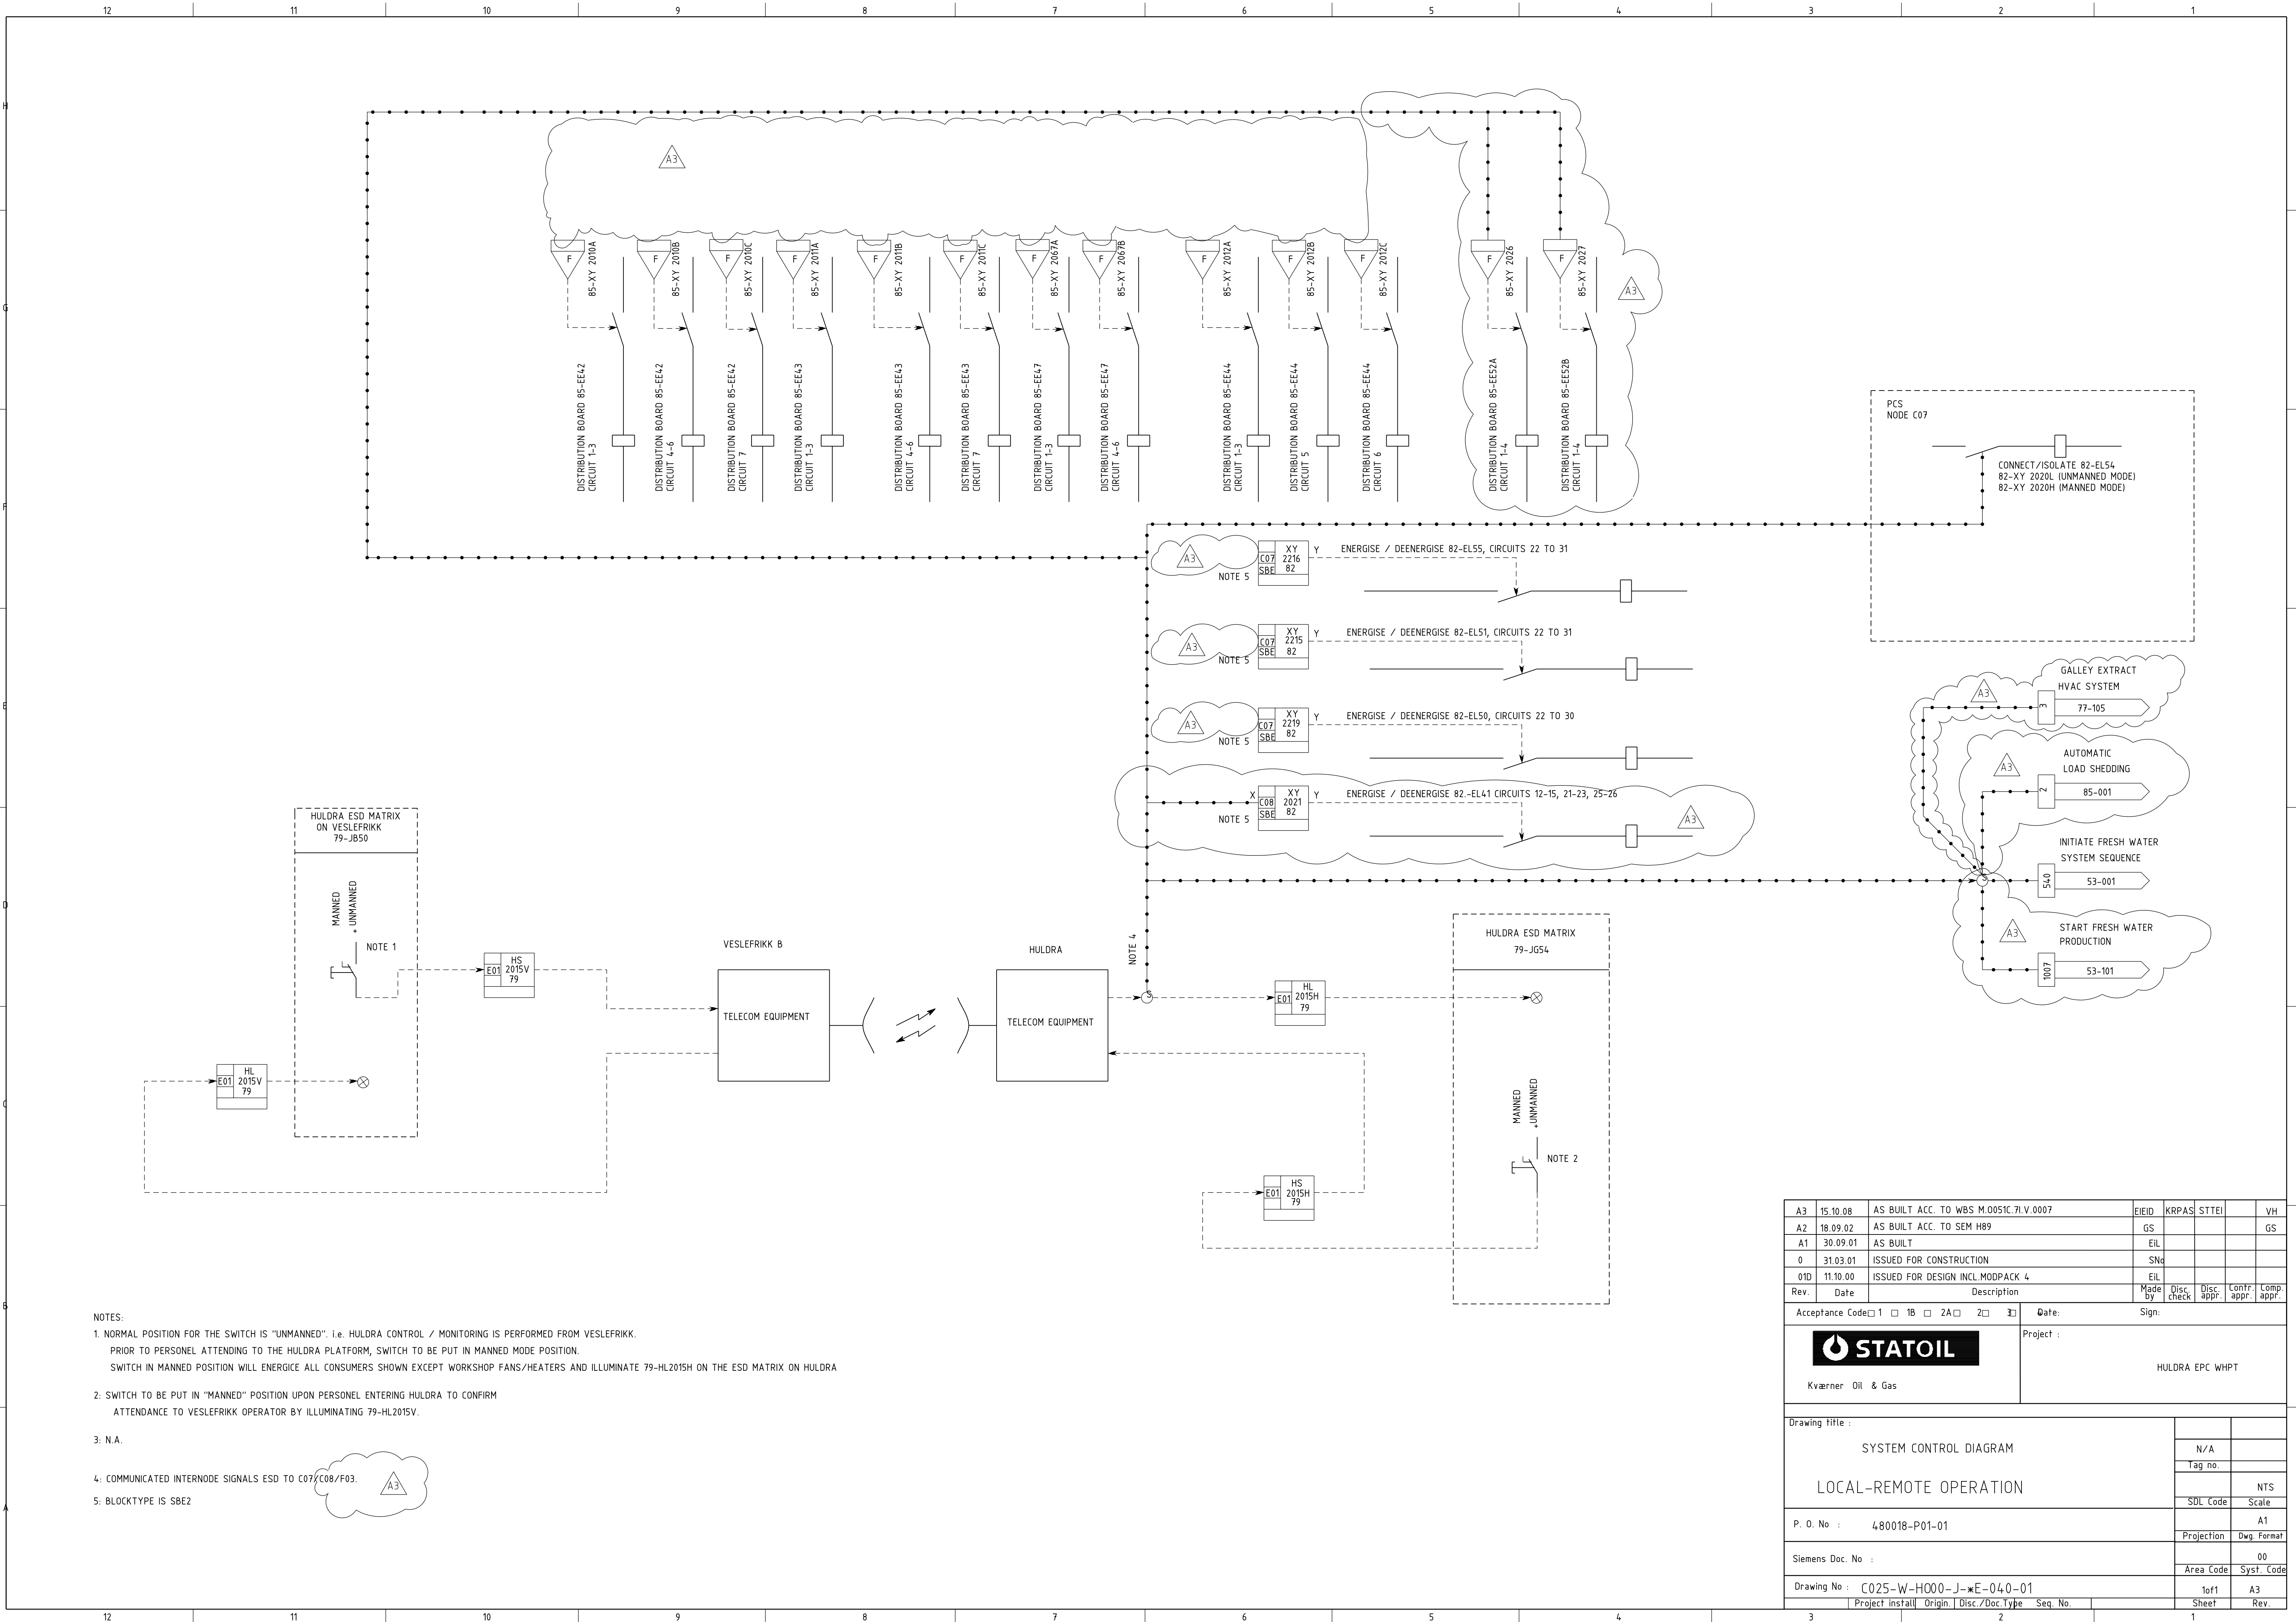

- NOTES:
1. NORMAL POSITION FOR THE SWITCH IS "UNMANNED". i.e. HULDRA CONTROL / MONITORING IS PERFORMED FROM VESLEFRIKK.
PRIOR TO PERSONEL ATTENDING TO THE HULDRA PLATFORM, SWITCH TO BE PUT IN MANNED MODE POSITION.
SWITCH IN MANNED POSITION WILL ENERGISE ALL CONSUMERS SHOWN EXCEPT WORKSHOP FANS/HEATERS AND ILLUMINATE 79-HL2015H ON THE ESD MATRIX ON HULDRA
2. SWITCH TO BE PUT IN "MANNED" POSITION UPON PERSONEL ENTERING HULDRA TO CONFIRM ATTENDANCE TO VESLEFRIKK OPERATOR BY ILLUMINATING 79-HL2015V.
3. N.A.
4. COMMUNICATED INTERNODE SIGNALS ESD TO C07/C08/F03.
5. BLOCKTYPE IS SBE2

A3	15.10.08	AS BUILT ACC. TO WBS M.0051C.71.V.0007	EIED	KRPAS	STTEI	VH
A2	18.09.02	AS BUILT ACC. TO SEM H89	GS			GS
A1	30.09.01	AS BUILT	EIL			
0	31.03.01	ISSUED FOR CONSTRUCTION	SNd			
010	11.10.00	ISSUED FOR DESIGN INCL MODPACK 4	EIL			
Rev.	Date	Description	Made by	Disc. check	Disc. appr.	Contr. appr.
Acceptance Code ☐ 1 ☐ 1B ☐ 2A ☐ 2C ☒ 3			Date: _____ Sign: _____			
 Kværner Oil & Gas			Project : _____ <			