


Thorax

Balanced Accuracy in sample

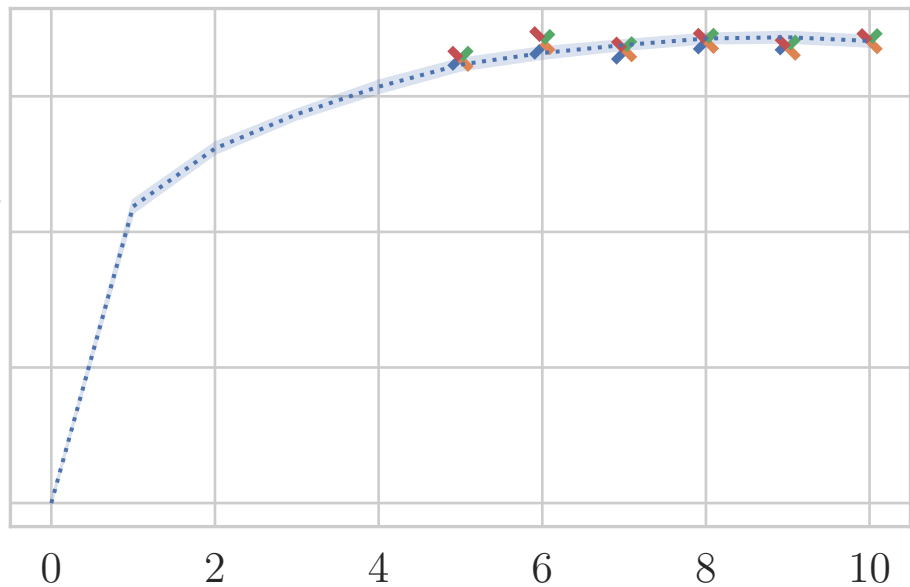

0.8

0.7

0.6

0.5

Balanced Accuracy out of sample

