

NEW CONSTRUCTION

924,NE 4 COURT HALLANDALE BEACH FLORIDA

GENERAL NOTES:

1. GENERAL NOTES APPLY TO ALL DRAWINGS
2. DO NOT SCALE DRAWINGS. ANY DIMENSIONAL INFORMATION REQUIRED WHICH IS NOT INDICATED ON DRAWING DIMENSION STRINGS SHALL BE OBTAINED FROM THE ARCHITECT.
3. DIMENSIONS SHOWN ARE FINISH SURFACE OF EXISTING CONSTRUCTION, UNLESS NOTED OTHERWISE .
4. CONTRACTOR SHALL VERIFY ALL EXISTING DIMENSIONS AND CONDITIONS (I.E EXISTING MATERIALS, FRAMING MEMBER SIZES AND LOCATIONS, METHODS OF CONSTRUCTION). IF DISCREPANCIES ARE FOUND, NOTIFY ARCHITECT BEFORE PROCEEDING WITH WORK.
5. CONTRACTOR SHALL MAINTAIN THE IMMEDIATE CONSTRUCTION SITE IN A SECURE, CLEAN AND SAFE MANNER.
6. PROTECTION : CONTRACTORS SHALL BE SOLELY RESPONSIBLE FOR TAKING ALL STEPS NECESSARY TO PROTECT THE PUBLIC FROM INJURY AND ADJACENT PROPERTY DAMAGES DURING CONSTRUCTION AS REQUIRED BY LOCAL CODES.

PROJECT:	NEW CONSTRUCTION
ADDRESS:	924,NE 4 COURT HALLANDALE BEACH FLORIDA

SCOPE OF WORK:

1. ELECTRICAL
2. PLUMBING
3. MECHANICAL

APPLICABLE CODES:

1. 2018 International Building Code with local amendments.
2. 2018 International Existing Building Code.
3. 2018 International Energy Conservation Code.
4. 2017 ANSI A-117.1 Accessible & Useable Building & facilities.
5. 2018 International Plumbing Code with local amendments.
6. 2018 International Mechanical Code with local amendments.
7. 2018 International Fuel Gas Code with local amendments.
8. 2017 National Electric Code.
9. 2018 International Fire Code with local amendments.

INDEX TO DRAWINGS

SHEET NUMBER	SHEET NAME
STRUCTURE	
ST-01	FOUNDATION PLAN
ST-02	ROOF FRAMING PLAN
ELECTRICAL	
EL-00	COVER SHEET
EL-01	NOTES
EL-02	LIGHTING LAYOUT PLAN
EL-03	POWER LAYOUT PLAN
EL-04	PANEL SCHEDULE & SINGLE LINE DIAGRAM
PLUMBING	
PL-01	NOTES
PL-02	DRAINAGE LAYOUT PLAN
PL-03	WATER SUPPLY LAYOUT PLAN
PL-04	RISER DIAGRAM
PL-04a	ISOMETRIC VIEW
PL-05	DETAILS
MECHANICAL	
ME-01	NOTES
ME-02	HVAC LAYOUT PLAN
ME-03	DETAILS
ME-04	SCHEDULE & LOAD

OWNER SIGNATURE

REVISION STATUS			
Rev	DATE	DESCRIPTION	DRAWN BY
00	21-07-2023	ISSUED FOR APPROVAL	A.S
01			
02			
03			
04			

CLIENT/CONSULTANT APPROVAL STATUS	
APPROVED	(A)
APPROVED WITH NOTES	(B)
RESUBMIT	(C)
DISAPPROVED	(D)

OWNER:

JONATHAN BOKOBZA

ADDRESS:

924,NE 4 COURT HALLANDALE
BEACH FLORIDA

DESIGN CONSULTANT:

DRAWING STATUS:

DESIGN DRAWING

DISCIPLINE:

ELECTRICAL


PROJECT TITLE:

HOME DESIGN

DRAWING TITLE:



COVER SHEET

DRAWN BY:	CHECKED BY:	DATE:
A.S	S.A	21 JUL 2023
JOB NO	SHT NO	SCALE:
632-004	EL-00	NTS @A3

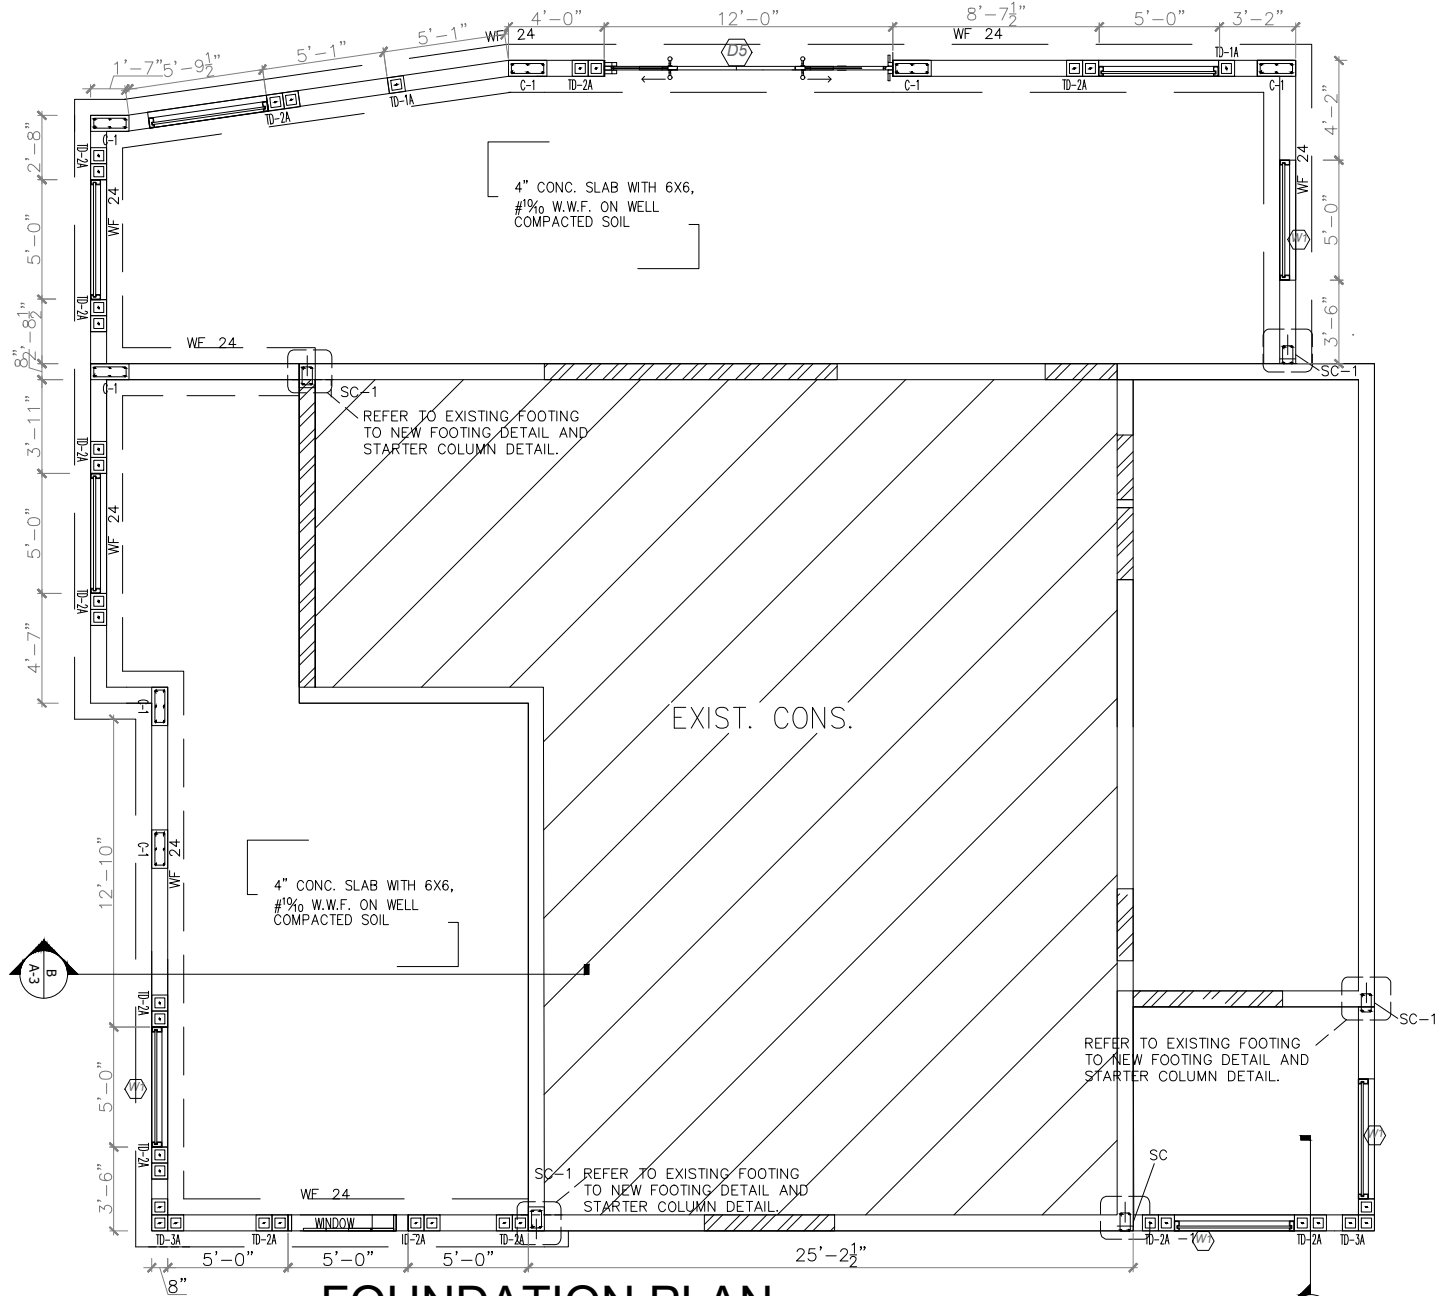


FOUNDATION PLAN

SCALE: 1/8"=1'-0"

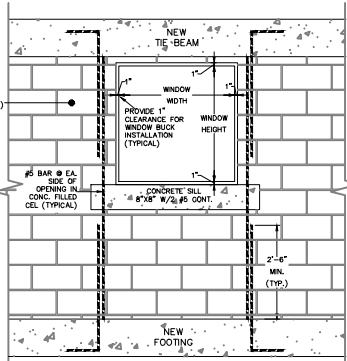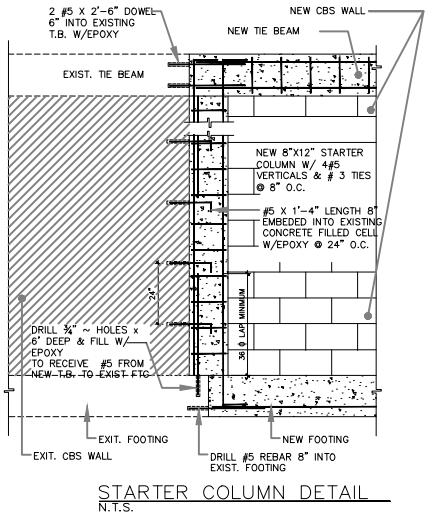

WINDOW ROUGH OPENING
IN NEW WALL DETAIL

SCALE: 1/8"=1'-0"

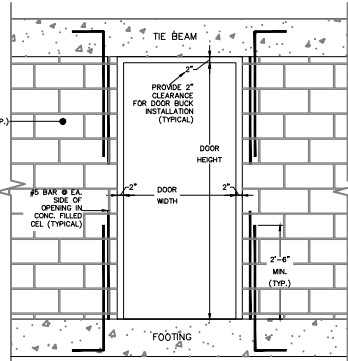

DOOR ROUGH OPENING
IN NEW WALL DETAIL

SCALE: 1/8"=1'-0"

TERMITE PROTECTION: FBC 2017

THE BUILDING MUST HAVE A PRE-CONSTRUCTION TREATMENT FOR PROTECTION AGAINST SUBTERRANEAN TERMITES. A CERTIFICATE OF COMPLIANCE SHALL BE ISSUED TO THE BUILDING DEPARTMENT BY THE LICENSED PEST CONTROL COMPANY WHICH CONTAINS THE FOLLOWING STATEMENT:
"THE BUILDING HAS RECEIVED A COMPLETE TREATMENT FOR THE PREVENTION OF SUBTERRANEAN TERMITES, TREATMENT IN ACCORDANCE WITH RULES AND LAWS ESTABLISHED BY THE FLORIDA DEPT. OF AGRICULTURE AND CONSUMER SERVICES"

STRUCTURAL NOTES

I.- CODES

- 1.- FLORIDA BUILDING CODE, 2017 EDITION.
- 2.- AMERICAN INSTITUTE OF STEEL CONSTRUCTIONS "SPECIFICATIONS FOR STRUCTURAL STEEL BUILDING - ALLOWABLE STRESS DESIGN AND PLASTIC DESIGN", LATEST EDITION.
- 3.- AMERICAN CONCRETE INSTITUTE "BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE" ACI 318-14.
- 4.- AMERICAN FOREST AND PAPER ASSOCIATIONS "NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION", 2015 EDITION ("NDS").
- 5.- AMERICAN CONCRETE INSTITUTE "BUILDING CODE REQUIREMENTS FOR MASONRY STRUCTURE" ACI 530.1-13/ACSE 5-11.
- 6.- ALL CONSTRUCTION SHALL COMPLY WITH ACI-301.
- 7.- ALL REINFORCED STEEL SHALL BE DETAILED TO COMPLY WITH ACI-(315).
- 8.- ALL STEEL PLACING SHOP DRAWING SHALL BE PREPARED IN ACCORDANCE WITH ACI-(315).
- 9.- WIND DESIGN ASCE 7-10

II. MATERIALS

UNLESS OTHERWISE SHOWN OR NOTED ON DRAWINGS.

- 1.- STRUCTURAL STEEL: ASTM A 36.
- 2.- ANCHOR BOLTS: U.O.N. ASTM A 307.
- 3.- CAST-IN-PLACE CONCRETE: 3 KSI NORMAL WT.
- 4.- REINFORCEMENT: 3 KSI NORMAL WT.
- 5.- DEFORMED BARS: ASTM A615, GRADE 60.
- 6.- WELDED WIRE FABRIC: ASTM A185, GRADE 60.
- 7.- BOLTING MATERIALS: ASTM A325 OR A490.
- 8.- FRAMING LUMBER: DOUGLAS FIR OR SOUTHERN YELLOW PINE No.2, 19% MAX. MOISTURE CONTENT, (C= 1200 PSI MINIMUM, NOMINAL SIZE DRESSED S4S).

III.- GENERAL

- 1.- NOTE, TYPICAL DETAILS AND SCHEDULES APPLY TO ALL STRUCTURAL WORK UNLESS OTHERWISE NOTED FOR CONDITIONS NOT SPECIFICALLY SHOWN. PROVIDE DETAILS OF SIMILAR NATURE. VERIFY APPLICABILITY BY SUBMITTING SHOP DRAWING FOR REVIEW.
- 2.- STRUCTURAL DRAWING SHALL BE USED IN CONJUNCTION WITH THE SPECIFICATIONS, ARCHITECTURAL AND MECHANICALS DRAWINGS. IF THERE IS A DISCREPANCY BETWEEN DRAWINGS IT IS THE CONTRACTOR'S RESPONSIBILITY TO NOTIFY THE ENGINEER PRIOR TO FORMING WORK.
- 3.- DO NOT SCALE DRAWINGS TO OBTAIN DIMENSIONAL INFORMATION.
- 4.- SEE ARCHITECTURAL DRAWINGS AND SPECIFICATIONS FOR WATERPROOFING AND FIRE PROOFING DETAILS AND REQUIREMENTS.
- 5.- AT ALL TIMES THE CONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR THE CONDITIONS OF THE JOB SITE INCLUDING SAFETY PERSON AND PROPERTY. THE ARCHITECTS OR ENGINEER'S PRESENCE OR REVIEW OF WORK DOES NOT INCLUDE THE ADEQUACY OF THE CONTRACTOR'S MEANS OR METHODS OF CONSTRUCTIONS. DRAWING HAVE BEEN PREPARED BASED ON AVAILABLE KNOWLEDGE OF EXISTING.
- 6.- CONDITIONS IF, DURING EXCAVATION OR CONSTRUCTION ACTUAL ARE DISCOVERED TO DIFFER FROM THOSE INDICATED ON DRAWINGS, ENGINEER SHALL BE NOTIFIED.

IV.- CONCRETE NOTES

- 1.- REINFORCING STEEL SHALL HAVE A MINIMUM CLEAR COVER AS FOLLOWS, U.O.N. IN DRAWINGS.
CONCRETE POURED AGAINST EARTH 3"
CONCRETE EXPOSED TO EARTH OR WEATHER: 1-1/2"
..... 5" OR SMALLER 1-1/2"
..... 6" OR LARGER 2"
- 2.- CONCRETE NOT EXPOSED TO WEATHER OR IN CONTACT W/ GROUND:
COLUMNS (TIES AND MAIN REINFORCING) 1-1/2"
SLABS, WALLS, JOINTS, "I" OR SMALLER 3/4"
BEAMS (STIRRUPS AND MAIN REINF.) 1-1/2"

CLEAR COVER SHALL BE CLEARLY SHOWN ON ALL REBAR DETAIL DRAWINGS.

- 2.- ALL REINFORCEMENT SHALL BE SECURELY HELD IN POSITION WHILE PLACING CONCRETE IF NECESSARY, ADDITIONAL BARS SHALL BE PROVIDED BY THE CONTRACTOR TO FURNISH SUPPORT.
- 3.- THE CONTRACTOR SHALL VERIFY THE DIMENSIONS AND LOCATIONS OF ALL OPENINGS, PIPES SLEEVES, ETC. . . AS REQUIRES BY ALL TRADES, BEFORE THE CONCRETE IS POURED. THE CONTRACTOR SHALL CONSULT THE ARCHITECTURAL, MECHANICAL, AND ELECTRICAL DRAWINGS, AS WELL AS THE STRUCTURAL DRAWING FOR THE LOCATION, NUMBER AND SIZE OF ALL OPENINGS, SLEEVES, ETC. . . HOWEVER, OPENINGS NOT SHOWN ON THE STRUCTURAL DRAWINGS SHALL BE INSTALLED ONLY AFTER APPROVAL BY THE STRUCTURAL ENGINEER IS OBTAINED.
- 4.- LOCATION OFF ALL CONSTRUCTIONS JOINTS NOT SHOWN IN DRAWINGS SHALL BE SUBMITTED TO ENGINEER FOR APPROVAL PRIOR TO DETAILING OF REINFORCING. ALL CONSTRUCTION JOINTS TO BE CLEARLY SHOWN IN REBAR DETAIL DRAWINGS. ENGINEER MAY REQUIRE ADDITIONAL REINFORCING AT CONSTRUCTION JOINTS.
- 5.- CONCRETE FINISH FOR SLAB ON GROUND SHALL BE "LIGHT BROOM FINISH". CONCRETE FINISH FOR BEAMS AND COLUMNS SHALL BE "SMOOTH FORM FINISH, ACI 301-99 (10 . 2 . 2).

V.- MASONRY NOTES

- 1.- HOLLOW CONCRETE MASONRY SHOWN ON THESE DRAWINGS SHALL BE ASTM C90, ON GRADE N, TYPE I, NORMAL WEIGHT (m= 1500 P.S.I.
- 2.- MORTAR SHALL CONFORM TO ASTM C270, TYPE "M" OR "S" FOR ABOVE GRADE, TYPE "M" FOR BELOW GRADE, (m= 2000 P.S.I.
- 3.- GROUT FOR FILLED CELLS SHALL CONFORM TO ASTM C476 (m=3000 P.S.I. STRENGTH AT 28 DAYS. CELLS SHALL BE GROUTED IN INCREMENTS NOT EXCEEDING 4 FEET VERTICALLY AND A SLUMP OF 9" - 1".
- 4.- VERTICAL REINFORCING SHALL BE ASTM A615, GRADE 60 DEFORMED BARS MINIMUM LAP SPLICES SHALL BE 48 BARS DIA. AS FOLLOWS:
"3 BARS 1'-6"
"4 BARS 2'-0"
"6 BARS 2'-6"
"6 BARS 3'-0"
- 5.- HORIZONTAL REINFORCING SHALL BE No.3 GAGE, LADDER TYPE FOR REINFORCED MASONRY AND TRUSS TYPE FOR ALL OTHERS, AND SHALL BE PLACED EVERY OTHER COURSE U.O.N.
- 6.- ALL BLOCK SHALL BE PLACED IN RUNNING BOND.

VI.- WOOD NOTES

- 1.- ALL WOOD IN CONTACT W/ CONCRETE, MASONRY OR LATH SHALL BE PRESSURE TREATED AS PER "AMERICAN WOOD-PRESERVES ASSOCIATION"
- 2.- STRUCTURAL LUMBER SHALL HAVE A MINIMUM ALLOWABLE BENDING STRESS OF F_b=1200 P.S.I. FRAMING LUMBER SHALL BE SOUTHERN YELLOW PINE No.2, NOMINAL SIZE DRESSED S4S OR APPROVAL EQUAL LUMBER SHALL BE FREE OF WARP THAT CAN NOT BE CORRECTED BY BRIDGING AND NAILING.

EPOXY AND STRUCTURAL ADHESIVES SPECIFICATIONS AND INSTALLATION INSTRUCTIONS

ALL DOWELING OF REINFORCING STEEL TO MASONRY OR CONCRETE SHALL USE "SIMPSON STRONG-TIE" STRUCTURAL ADHESIVES. EPOXY-TIE ET TWO COMPONENT 100% SOLID EPOXY BASED ADHESIVE SHALL BE ACCEPTABLE. ET MEETS THE ASTM C-881-90 SPECIFICATIONS FOR TYPE I, II, IV AND V GRADE 3, CLASS B, AND C. THE MIXING RATIO SHALL BE 1:1. SURFACES TO RECEIVE EPOXY MUST BE CLEAN DRY. EPOXY SHOULD NOT BE INSTALLED IN OR THROUGH STANDING WATER. THE BASE MATERIAL TEMPERATURE MUST BE 40° F OR ABOVE AT THE TIME OF INSTALLATION. FOR BEST RESULTS, MATERIAL SHOULD BE 70° F - 80° F AT THE TIME OF APPLICATION. MIXED MATERIAL IN NOZZLE WILL HARDEN IN 7-10 MINUTES AT A TEMPERATURE OF 40° F OR ABOVE. INSTALLATION (AS PER SCCO REPORT #94145 SUBMITTED FOR EVALUATION BY MANUFACTURER SIMPSON STRONG TIE).
1. INSTALL PRE-CUT REINFORCING BAR IN PRE DRILLED HOLE IN CONCRETE THAT HAS BEEN CLEANED WITH COMPRESSED AIR.
2. HOLE DIAMETER SHALL BE AS FOLLOWS: #4 = 5/8" #5 = 3/4"
3. INJECT MIXED ADHESIVE INTO THE HOLE AND FILL IT TO APPROX. ONE-HALF FULL.
4. INSTALL STEEL REINFORCING BAR, FREE OF OIL, SCALE AND RUST, PUSHED UNTIL THE BOTTOM OF THE HOLE IS REACHED. TWIST CLOCKWISE TO ENSURE COVERAGE OF BAR SURFACE WITH ADHESIVE.
5. LEVEL ADHESIVE WITH SURFACE AFTER THE INSERTION OF ROD.

SOIL PREPARATION:

THE AREA UNDER FOOTING, FOUNDATIONS AND CONCRETE SLAB ON GRADE SHALL HAVE ALL VEGETATION, STUMPS, ROOTS AND FOREIGN MATERIALS REMOVED PRIOR TO THEIR CONSTRUCTION. ALL MATERIAL SHALL BE FREE OF VEGETATION AND FOREIGN MATERIAL PER FLORIDA BUILDING CODE 2017

SOIL COMPACTION:

SOIL SHALL BE COMPACTED TO MINIMUM OF 95 PERCENT OF MODIFIED PROCTOR IN A ACCORDANCE WITH A.S.T.M. D-1557 AND COMPACTED AND TESTED IN LIFTS NOT TO EXCEED 12 INCHES.

SOIL STATEMENT


INSPECTION ON THE SITE, INDICATES UNDISTURBED SAND WITH A BEARING VALUE OF 2,000 P.S.F. SHOULD OTHER CONDITIONS OR MATERIALS BE ENCOUNTERED, THE ENGINEER SHALL BE NOTIFIED BEFORE PROCEEDING WITH THE WORK. THE ENGINEER HAS TO SUBMIT A SIGN AND SEAL LETTER ATTESTING THAT THE SITE HAS BEEN OBSERVED, AND THE FOUNDATION CONDITIONS ARE SIMILAR TO THOSE UPON WHICH THE DESIGN IS BASED. THE ENGINEER MUST SUBMIT TO THE MAH DADE COUNTY BUILDING INSPECTOR A LETTER REFLECTING THAT THE FILL SUPPORTING SLAB ON GRADE, HAS BEEN COMPACTED TO A MIN. OF 95% DENSITY.

COLUMN SCHEDULE

MARK	(W"xH")	REINFORCEMENT
SC-1	(8"x12")	(4) #5 VERT, #3 STIRRUP @ 8" O.C.
C-1	(8"x19")	(6) #6 VERT, #3 STIRRUP @ 8" O.C.
TD-1A		(1) #5 VERT ON CONC FILL CEL. @ #8" O.C.
TD-2A		(2) #5 VERT ON CONC FILL CEL.
TD-3A		(3) #5 VERT ON CONC FILL CEL.
TD-4A		(4) #5 VERT ON CONC FILL CEL.

FOUNDATION SCHEDULE

MARK	(W"xH")	REINFORCEMENT
WF-24	(12"x24")	CONTINUES FTG W/3 #5 CONT., #5 TRANS. @ 14

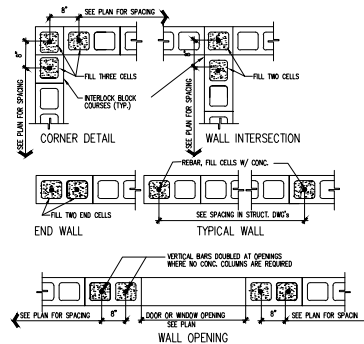

NOTES

- 1) PROVIDE #8 GA. LADDER TYPE HORIZONTAL REIN. AT 16" O.C. MAX. LAP AT WALL INTERSECTION WITH "T" AND "L" CORNER SECTIONS.
- 2) 8" CONC. MASONRY BLOCK WALLS W/ REINFORCING AS PER STRUCT. DWGS.
- 3) FOR ADDITIONAL APPLICABLE REINFORCED MASONRY WALLS SEE SHEET.
- 4) LEADING: LOAD BEARING REINFORCED MASONRY BLOCK WALL.

TYPICAL REINFORCED MASONRY DETAILS

N.T.S.

OWNER SIGNATURE

REVISION STATUS

Rev	DATE	DESCRIPTION	DRAWN BY
00	21-07-2023	ISSUED FOR APPROVAL	
01			
02			
03			
04			

CLIENT/CONSULTANT APPROVAL STATUS

APPROVED	(A)
APPROVED WITH NOTES	(B)
RESUBMIT	(C)
DISAPPROVED	(D)

OWNER:

JONATHAN BOKOBZA

ADDRESS:

924,NE 4 COURT HALLANDALE
BEACH FLORIDA

DESIGN CONSULTANT:

DRAWING STATUS:

DESIGN DRAWING

DISCIPLINE:

STRUCTURE


PROJECT TITLE:

HOME DESIGN

DRAWING TITLE:

FOUNDATION PLAN

DRAWN BY:	CHECKED BY:	DATE:
		21 JUL 2023
JOB NO	SHT NO	SCALE:
632-004	ST-01	1/8"=1'-0" @A3

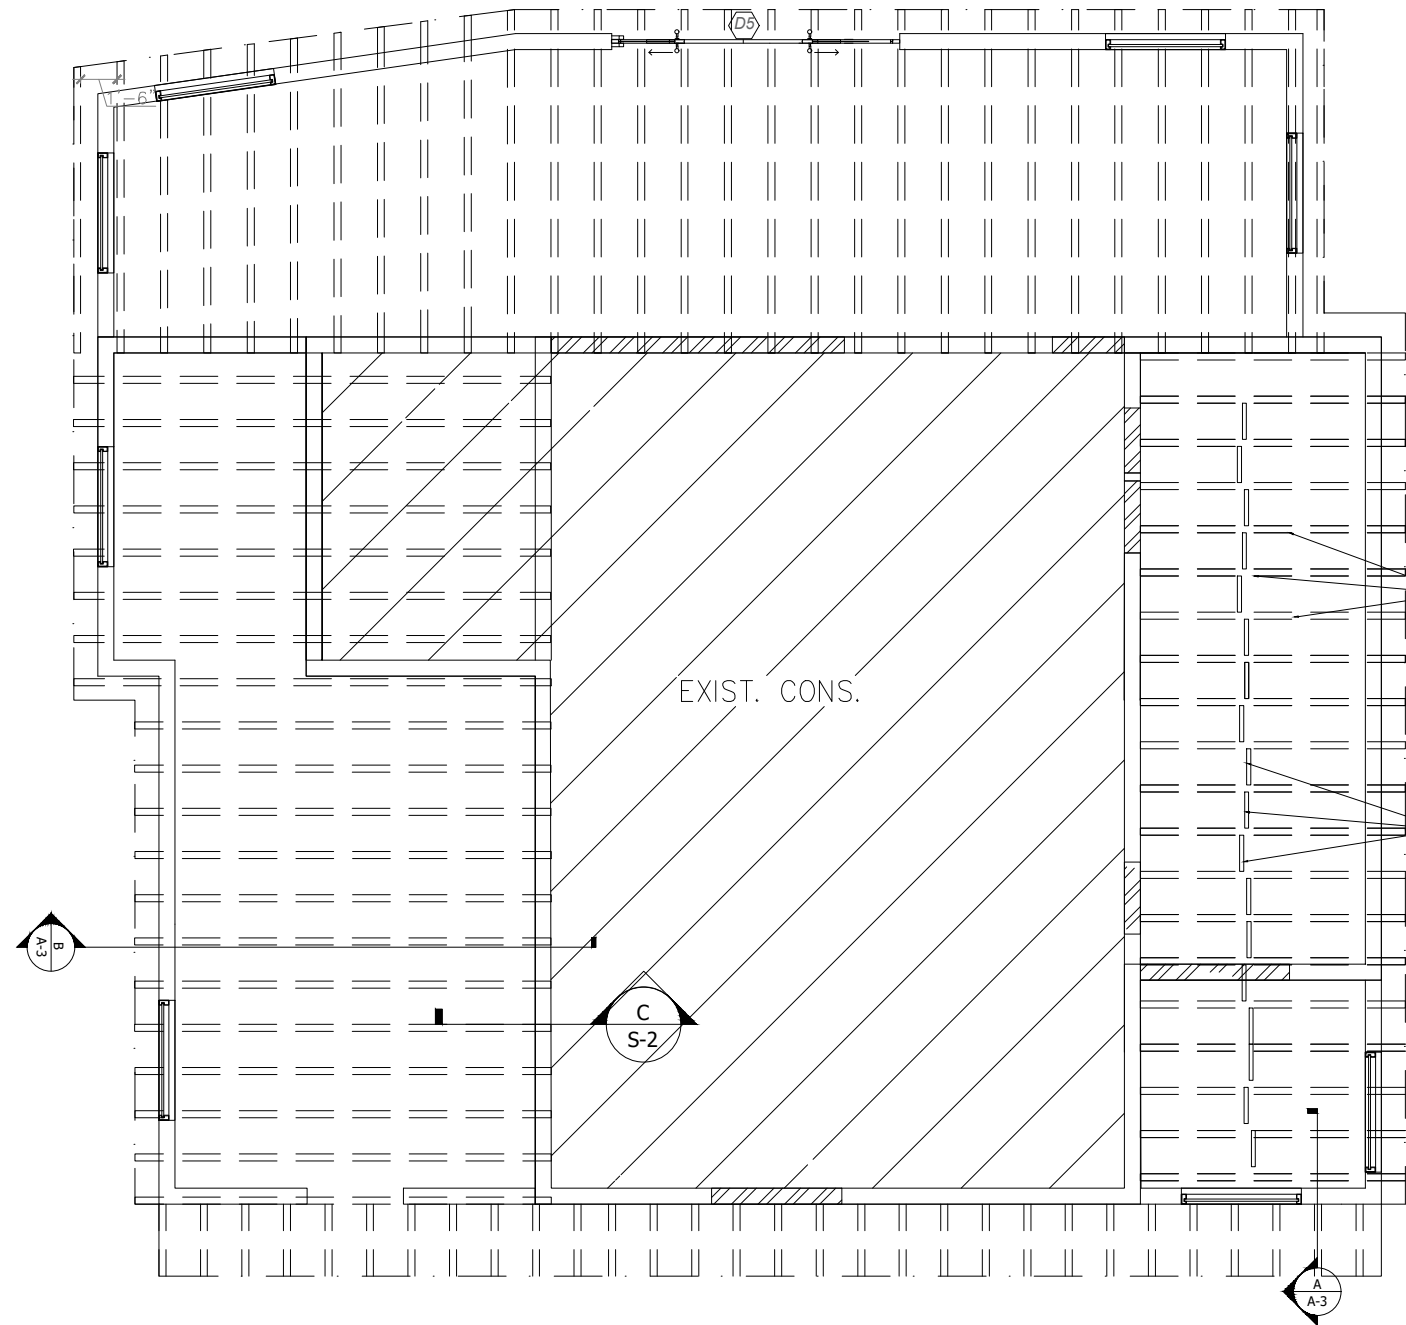

ROOF FRAMING PLAN
SCALE: 1/8"=1'-0"

2" x 6" LUMBER at 12" c/c

2X6 WD BLOCKING
W/ 2-16d NAILS
@ EACH JOIST (TYP)

5/8" CDX PLYWOOD SHEATHING W/ 8d RING SHANK NAILS @ 6" O.C. @ PANEL EDGE, 6" O.C.

1-90# MINERAL SURFACE HOT MOPPED TO 1-30# FELT TIN-TAGGED TO 5/8" PLYWOOD SHEATHING
SPACING OF TIN-TAG FASTENERS ALONG THE LAP OF SHEETS, AND BOTH WAYS IN THE FIELD
BETWEEN LAPS, SHALL BE 6" O.C. IN DIRECTION OF ROLL, 12" O.C. ACROSS WIDTH OF ROLL AND 30#
FELT ANCHORED TO THE PLYWOOD SHEATHING WITH GALVANIZED, DIAMOND POINTS, 1-1/4"X. 120"Ø.

5/8" CDX PLYWOOD SHEATHING NAILED W/8d RING
SHANK NAILS @ 6" O.C. AT INTERIOR AND @ 4" O.C. AT
EXTEND PLYWOOD
SHEET T.C. COVERED W/2-PLY FIBERGLASS HOT SHEATHING TO
MOPPED AND TOPPED W/ALUMINUM COATING.

PROVIDE FLASHING
@ ROOFS
INTERSECTION.

2"X6" WOOD blocking

2"X6" WOOD JOIST
@ 12" O.C. (TYP.)

2"X4" WOOD
2 - 16d @ EA. TRUSS
WEDGE NAILED W/

NEW PRE-FAB. ROOF TRUSSES @
24" BY ROOFING CONTRACTOR.

CONN ①

NEW TB, SEE SCHEDULE

REFER TO SECTION A & B IN
SHEET A-3 FOR FINISHING.

NEW CBS WALL. SEE SHEET S-1.

C SECTION
S-2 SCALE: 1/2" = 1'-0"

OWNER SIGNATURE

REVISION STATUS			
Rev	DATE	DESCRIPTION	DRAWN BY
00	21-07-2023	ISSUED FOR APPROVAL	
01			
02			
03			
04			

CLIENT/CONSULTANT APPROVAL STATUS	
APPROVED	(A)
APPROVED WITH NOTES	(B)
RESUBMIT	(C)
DISAPPROVED	(D)

OWNER:

JONATHAN BOKOBZA

ADDRESS:

924, NE 4 COURT HALLANDALE
BEACH FLORIDA

DESIGN CONSULTANT:

DRAWING STATUS:

DESIGN DRAWING

DISCIPLINE:

STRUCTURE


PROJECT TITLE:

HOME DESIGN

DRAWING TITLE:

ROOF FRAMING PLAN

DRAWN BY:	CHECKED BY:	DATE:
		21 JUL 2023
JOB NO:	SHT NO:	SCALE:
632-004	ST-02	1/8"=1'-0" @A3

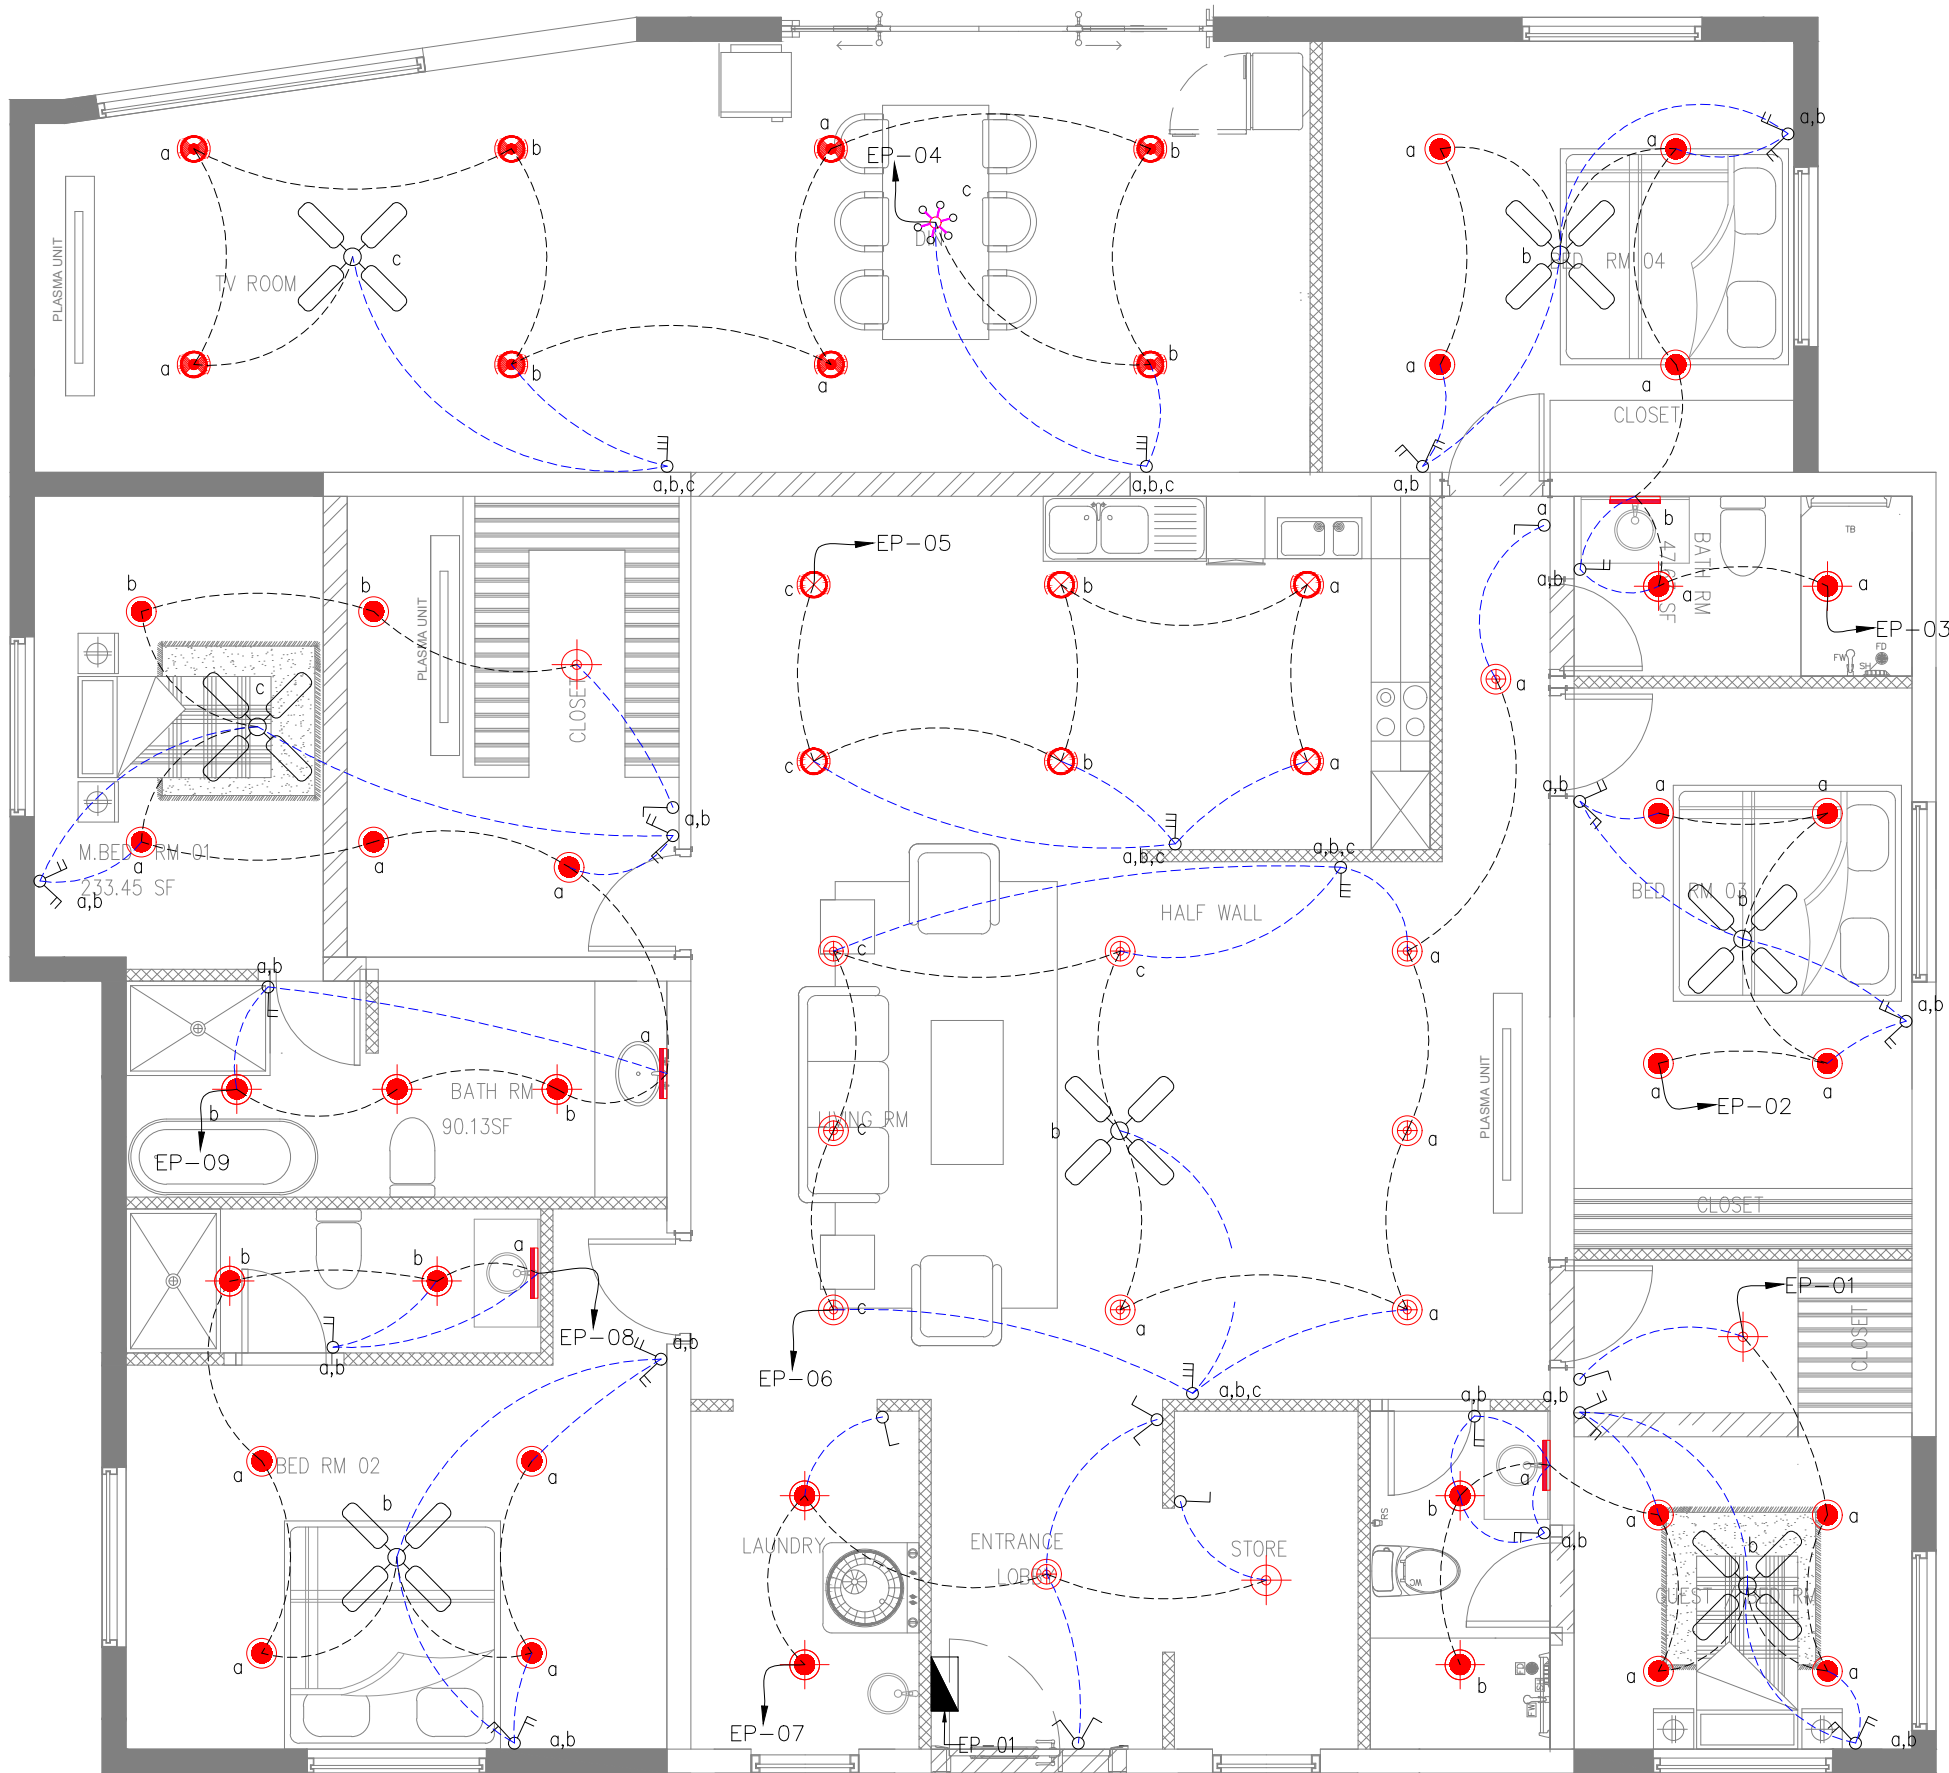

GENERAL ELECTRICAL NOTES
1- ELECTRICAL CONTRACTOR TO VERIFY ALL EXISTING SITE CONDITIONS & MAKE ANY NECESSARY ADJUSTMENTS.
2- SMALLEST WIRE & SIZE TO BE 14-2
3- ALL WORK SHALL COMPLY WITH THE NATIONAL ELECTRIC CODE & ANY OTHER APPLICABLE REGULATIONS OR CODES, AT THE SITE.
4- CONTRACTOR TO LOCATE PHONE, CABLE, ETC. AS PER OWNER'S SPECIFICATIONS.

LEGEND NOTES:
T VERIFY ALL MOUNTING HEIGHTS OF WALL MOUNTED LIGHT FIXTURES
Φ TYPICAL MOUNTING HEIGHTS FOR OUTLETS - CENTERLINE 16" AFF (EXCEPT WHERE NOTED OTHERWISE)
\$ MAXIMUM HEIGHT FOR ALL SWITCHES IS 48" AFF
\$ ROCKER STYLE SWITCHES
\$ ALL SWITCHES /OUTLETS /COVER PLATES- WHITE FINISH
F VENT FANS SIZED FOR ROOM VOLUME
F FAN SOUND LEVEL NOT TO EXCEED 1.0 SONES

: LEGEND :	
SYMBOL	DESCRIPTION
	CEILING FAN. TYPE WILL BE DEFINED AS PER CLIENT REQUIREMENT.
	18W SURFACE TYPE DOWN LIGHT WITH SPUN ALUMINUM BODY REFLECTOR, GLASS DIFFUSER & COMPACT FLU. LAMP IN BED ROOMS,
	15W SURFACE MOUNTED LIGHT IN KITCHEN
	18W RECESS TYPE DOWN LIGHT WITH SPUN ALUMINUM BODY REFLECTOR, GLASS DIFFUSER & COMPACT FLU. LAMP IN CLOSETS
	20W RECESS TYPE DOWN LIGHT WITH SPUN ALUMINUM BODY REFLECTOR, GLASS DIFFUSER & COMPACT FLU. LAMP IN BATHROOMS & LAUNDRY AREA
	MIRROR LIGHT 1X18W FLUORESCENT LIGHT
	15W SURFACE MOUNTED LIGHT IN LIVING AREA
	15W SURFACE MOUNTED LIGHT IN DINING AREA
	CHANDELIER IN DINING AREA
	ONE WAY ONE GANG SWITCH
	ONE WAY TWO GANG SWITCH
	ONE WAY THREE GANG SWITCH
	TWO WAY ONE GANG SWITCH
	TWO WAY TWO GANG SWITCH
	TWO WAY THREE GANG SWITCH
	SPIN ELECTRICAL PANEL, TYPE INDICATED.

OWNER SIGNATURE

REVISION STATUS			
Rev	DATE	DESCRIPTION	DRAWN BY
00	21-07-2023	ISSUED FOR APPROVAL	
01			
02			
03			
04			

CLIENT/CONSULTANT APPROVAL STATUS	
APPROVED	(A)
APPROVED WITH NOTES	(B)
RESUBMIT	(C)
DISAPPROVED	(D)

OWNER:

JONATHAN BOKOBZA

ADDRESS:

924,NE 4 COURT HALLANDALE BEACH FLORIDA

DESIGN CONSULTANT:

DRAWING STATUS:
DESIGN DRAWING


DISCIPLINE:
ELECTRICAL

PROJECT TITLE:
HOME DESIGN

DRAWING TITLE:
LIGHTING LAYOUT PLAN

DRAWN BY:	CHECKED BY:	DATE:
JOB NO:	SHT NO:	SCALE:
632-004	EL-02	3/16"=1'-0" @A3

EL
02
SCALE
LIGHTING LAYOUT PLAN
3/16"=1'-0"

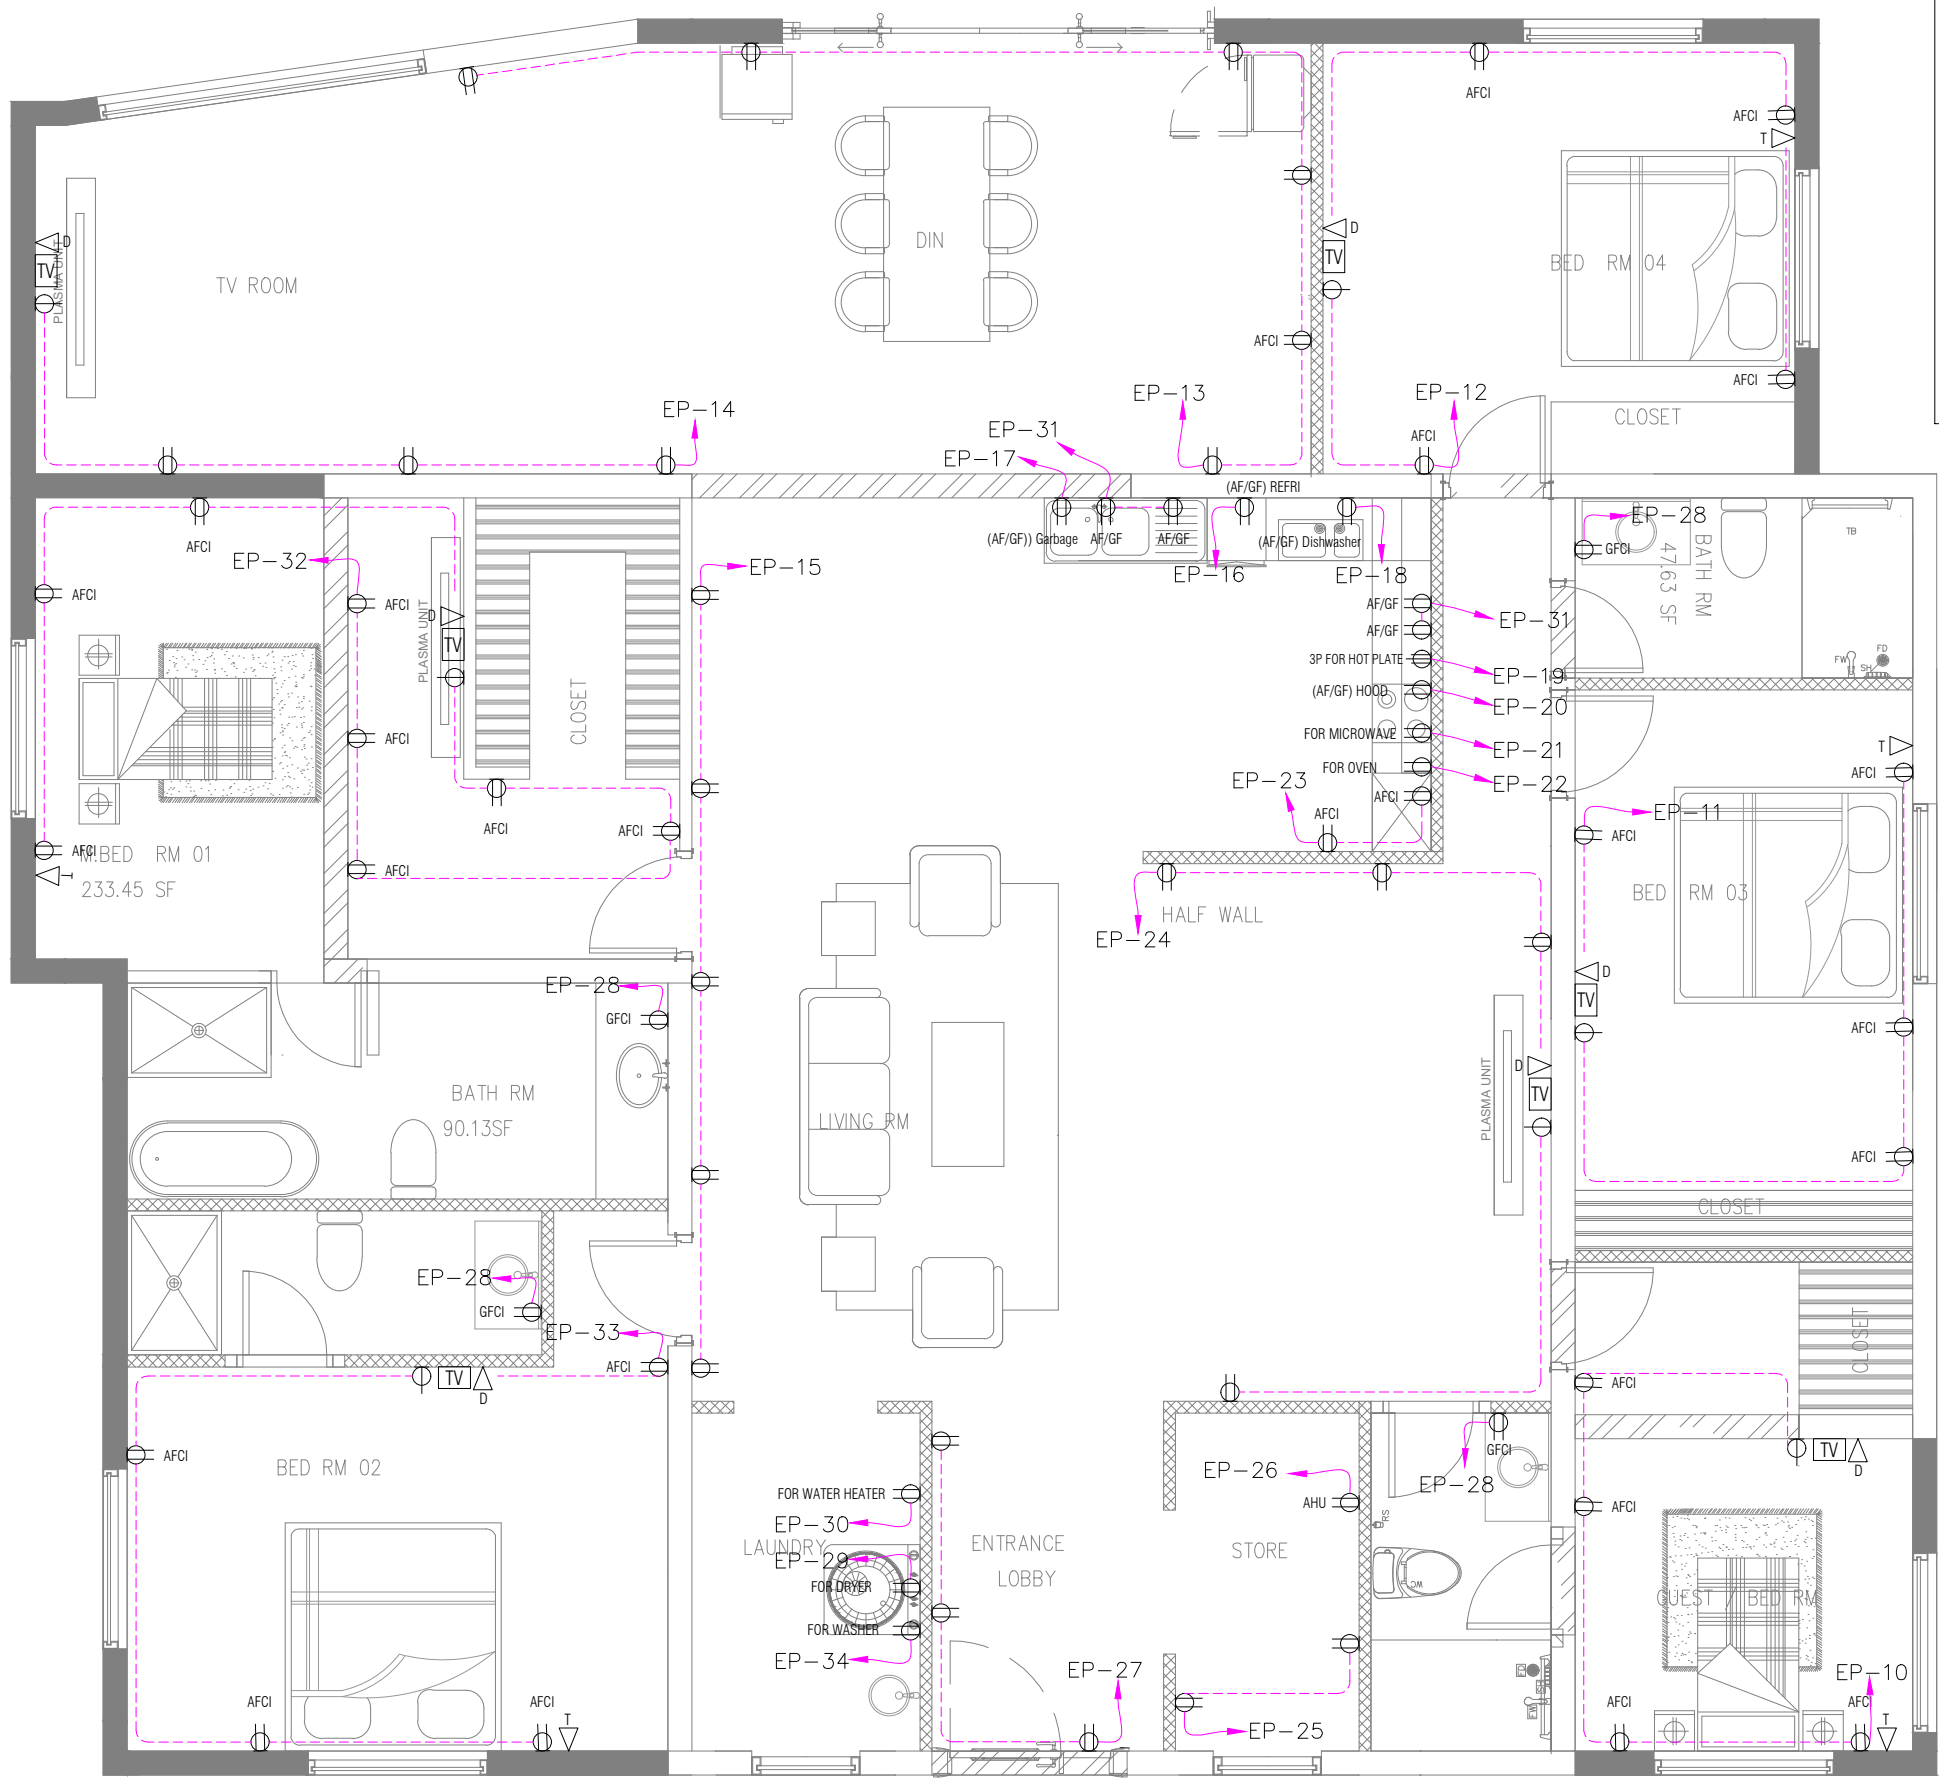

GENERAL ELECTRICAL NOTES
1- ELECTRICAL CONTRACTOR TO VERIFY ALL EXISTING SITE CONDITIONS & MAKE ANY NECESSARY ADJUSTMENTS.
2- SMALLEST WIRE & SIZE TO BE 14-2
3- ALL WORK SHALL COMPLY WITH THE NATIONAL ELECTRIC CODE & ANY OTHER APPLICABLE REGULATIONS OR CODES, AT THE SITE.
4- CONTRACTOR TO LOCATE PHONE, CABLE, ETC. AS PER OWNER'S SPECIFICATIONS.

LEGEND NOTES:
T VERIFY ALL MOUNTING HEIGHTS OF WALL MOUNTED LIGHT FIXTURES
Φ TYPICAL MOUNTING HEIGHTS FOR OUTLETS - CENTERLINE 16" AFF (EXCEPT WHERE NOTED OTHERWISE)
\$ MAXIMUM HEIGHT FOR ALL SWITCHES IS 48" AFF
ALL SWITCHES /OUTLETS /COVER PLATES- WHITE FINISH
V VENT FANS SIZED FOR ROOM VOLUME
FAN SOUND LEVEL NOT TO EXCEED 1.0 SONES

: LEGEND :	
SYMBOL	DESCRIPTION
⬇	SINGLE SOCKET OUTLET, 13A, 230V, GROUNDING TYPE. MOUNT AT 42" A.F.F. UNLESS NOTED OTHERWISE.
⬇	DUPLEX SOCKET OUTLET, 13A, 230V, GROUNDING TYPE. MOUNT AT 18" A.F.F. UNLESS NOTED OTHERWISE.
⬇	GFCI DUPLEX SOCKET OUTLET, WEATHER PROOF, 13A, 230V, GROUNDING TYPE. MOUNT AT 42" A.F.F. UNLESS NOTED OTHERWISE.
⬇	AFCI DUPLEX SOCKET OUTLET, 13A, 230V.
⬇	POINT FOR KITCHEN HOT PLATE, 32A, GROUNDING TYPE. MOUNT AT 42" A.F.F. UNLESS NOTED OTHERWISE.
TV	TV SOCKET HEIGHT AS PER LCD ON LOCATION
▽	TELECOMMUNICATION OUTLET. PROVIDE SINGLE GANG JUNCTION BOX WITH PLASTER RING. STUB UP 1" E.C. WITH PULL STRING INTO ACCESSIBLE CEILING SPACE. MOUNT AT 18" A.F.F. UNLESS NOTED OTHERWISE.
▽	DATA OUTLET. PROVIDE SINGLE GANG JUNCTION BOX WITH PLASTER RING. STUB UP 1" E.C. WITH PULL STRING INTO ACCESSIBLE CEILING SPACE. MOUNT AT 18" A.F.F. UNLESS NOTED OTHERWISE.
EP	ELECTRICAL PANEL

OWNER SIGNATURE

REVISION STATUS			
Rev	DATE	DESCRIPTION	DRAWN BY
00	21-07-2023	ISSUED FOR APPROVAL	
01			
02			
03			
04			

CLIENT/CONSULTANT APPROVAL STATUS	
APPROVED	(A)
APPROVED WITH NOTES	(B)
RESUBMIT	(C)
DISAPPROVED	(D)

OWNER:

JONATHAN BOKOBZA
ADDRESS:

924,NE 4 COURT HALLANDALE
BEACH FLORIDA

DESIGN CONSULTANT:

DRAWING STATUS:
DESIGN DRAWING

DISCIPLINE:
ELECTRICAL

PROJECT TITLE:
HOME DESIGN

DRAWING TITLE:
POWER LAYOUT PLAN

DRAWN BY:	CHECKED BY:	DATE:
JOB NO:	SHT NO:	SCALE:
632-004	EL-03	3/16"=1'-0" @A3

EL
03
SCALE
POWER LAYOUT PLAN
3/16"=1'-0"

GENERAL PLUMBING NOTES:

1. LOCATION AND SIZES OF ALL EXISTING SERVICES ARE APPROXIMATE. VERIFY ALL UTILITIES PRIOR TO COMMENCING WORK.
2. FOR EXACT LOCATION OF PLUMBING FIXTURES, DRAINS AND EQUIPMENT SEE ARCHITECTURAL DRAWINGS.
3. ALL DOMESTIC WATER AND VENT PIPING SHOWN TO BE RUN ABOVE CEILING UNLESS OTHERWISE NOTED.
4. ALL SANITARY PIPING SHOWN TO BE RUN BELOW FLOOR UNLESS OTHERWISE NOTED.
5. ENTIRE INSTALLATION INCLUDING MATERIALS, EQUIPMENT AND WORKMANSHIP SHALL CONFIRM WITH ALL APPLICABLE LAWS, CODES AND REGULATIONS OF MUNICIPAL, STATE AND FEDERAL AUTHORITIES, ALSO THE PLUMBING CODE 2004, INTERNATIONAL BUILDING CODE 2009, AND OTHER REGULATORY BODIES HAVING JURISDICTION OVER THE CLASS OF WORK.
6. THE CONTRACTOR SHALL MAKE TESTS FOR ACCEPTANCE AND APPROVAL AS REQUIRED BY THE CODE. REQUIRED TESTS SHALL BE PERFORMED IN THE PRESENCE OF OWNER’S REPRESENTATIVE UNLESS WAIVED IN WRITING.
7. THE CONTRACTOR SHALL FIELD COORDINATE THE WORK WITH THAT OF ALL OTHER TRADES.
8. ALL DOMESTIC WATER PIPING SHALL BE INSULATED AS REQUIRED.
9. DOMESTIC WATER PIPING MATERIAL: ASTM B88 TYPE L OR M COPPER TUBE WITH WROUGHT OR CAST COPPER FITTINGS AND LEAD–FREE SOLDERED JOINTS. INSTALL DOMESTIC WATER PIPING LEVEL WITHOUT PITCH AND PLUMB.
- DRAIN, WASTE, STORM, AND VENT PIPING MATERIAL: FOR BELOW GROUND SOIL, WASTE AND BENT PIPING SHOULD BE SERVICE WEIGHT HUB AND SPIGOT CAST IRON CONFORMING TO ASTM A74, WITH LEAD AND OAKUM JOINTS AS ALLOWED BY PLUMBING CODE; FOR ABOVE GROUND SOIL, WASTE AND VENT PIPING SHOULD BE HUBLESS CAST–IRON.
10. ANY ITEM OF MATERIALS NOT INDICATED ON THE DRAWINGS OR NOT SPECIFIED AND WHICH ARE REQUIRED FOR THE COMPLETE INSTALLATION OF ANY PART OF THE WORK DESCRIBED, SHALL BE FURNISHED AS CODE REQUIRED.
11. INSTALL CLEANOUT AT OR NEAR THE BOTTOM OF SANITARY/WASTE STACK.
12. PROVIDE PROPER ACCESS PANELS AS SPECIFIED IN WALLS AND CEILINGS FOR ANY EQUIPMENT, DEVICES, VALVES, SHOCK ABSORBERS, TRAP PRIMERS, CLEANOUTS ETC. REQUIRING ACCESS.

PLUMBING FIXTURE AND FAUCETS REFERENCED STANDARDS		
MARK	DESCRIPTION	STANDARD
WC–1	WATER CLOSET	WATER CLOSETS SHALL CONFIRM TO THE WATER CONSUMPTION REQUIREMENTS OF SECTION 604.4 AND SHALL CONFIRM TO ANSI Z124.4. ASME A112.19.2M, CSA B45.1, CSA B45.4 OR CSA B45.5. WATER CLOSETS SHALL CONFIRM TO THE HYDRAULIC PERFORMANCE REQUIREMENTS OF ASME A112.19.19.9M, CSA B45.1, CSA B45.4 OR CSA B45.5. ELECTRO HYDRAULIC WATER CLOSETS SHALL COMPLY WITH ASME A112.19.13.
L–1	LAVATORY	LAVATORIES SHALL CONFIRM TO ANSI Z124.3. ASME A112.19.1M, ASME A112.19.2M, ASME A112.19.3M, ASME A112.19.4M, ASME A112.19.9M, CSA B45.2, CSA B45.3, CSA B45.4, ROUP WASH UP EQUIPMENT SHALL CONFIRM TO THE REQUIREMENTS OF SECTION 402. EVERY 20 INCHES (608MM) OF RIM SPACE SHALL BE CONSIDERED AS ONE LAVATORY.
KS–1	KITCHEN SINK	SINKS SHALL CONFIRM TO ANSI Z124.6, ASME A112.19.1M, ASME A112.19.2M, ASME A112.19.3M, ASME A112.19.4M, ASME A112.19.9M, CSA B45.1, CSA B45.2, CSA B45.3, OR CSA B45.4,
	FAUCETS AND FIXTURE FITTINGS	FAUCETS AND FIXTURE FITTINGS SHALL CONFORM TO ASME A112.18.1 OR CSA B125. FAUCETS AND FIXTURE FITTINGS THAT SUPPLY DRINKING WATER FOR HUMAN INGESTION SHALL CONFORM TO THE REQUIREMENTS OF NSF 61, SECTION 9. FLEXIBLE WATER CONNECTORS EXPOSED TO CONTINUOUS PRESSURE SHALL CONFORM TO THE REQUIREMENTS OF SECTION 605.6 HAND HELD SHOWERS SHALL CONFORM TO ASSE 1014 OR CSA B125. SHOWER AND TUB SHOWER COMBINATION VALVES SHALL BE BALANCED PRESSURE, THERMOSTATIC OR COMBINATION BALANCED PRESSURE/THERMOSTATIC VALVES THAT CONFORM TO THE REQUIREMENTS OF ASSE 1016 OR CSA B125, MULTIPLE (GANG) SHOWERS SUPPLIED WITH A SINGLE TEMPERED WATER SUPPLY PIPE SHALL HAVE THE WATER SUPPLY FOR SUCH SHOWERS CONTROLLED BY A MASTER THERMOSTATIC MIXING VALVE COMPLYING WITH ASSE 1017. SHOWER AND TUB SHOWER COMBINATION VALVES AND MASTER THERMOSTATIC MIXING VALVES REQUIRED BY THIS SECTION SHALL BE EQUIPPED WITH A MEANS TO LIMIT THE MAXIMUM SETTING OF THE VALVE TO 120°F (49°C), WHICH SHALL BE FIELD ADJUSTED IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. FAUCETS AND FIXTURE FITTINGS WITH HOSE CONNECTED OUTLETS SHALL CONFORM TO ASME A112.18.3M. TEMPERATURE ACTUATED, FLOW REDUCTION DEVICES. WHERE INSTALLED FOR INDIVIDUAL FIXTURE FITTINGS, SHALL CONFORM TO ASSE 1062. SUCH VALVES SHALL NOT BE USED ALONE AS A SUBSTITUTE FOR THE BALANCED PRESSURE. THERMOSTATIC OR COMBINATION SHOWER VALVES REQUIRED IN SECTION 424.3

PLUMBING NOTES:

1. ALL DIMENSIONS ARE IN INCHES UNLESS OTHERWISE NOTED.

2. ALL PLUMBING INSTALLATIONS SHALL CONFIRM WITH THE REQUIREMENTS OF MANUFACTURER RECOMMENDATION AND OR UNIFORM PLUMBING CODE (UPC).

3. ALL PLUMBING MATERIALS SHALL BE AS SPECIFIED IN THE CONTRACT SPECS AND BOQ.

4. ALL PIPE SIZES SHOWN ARE NOMINAL DIAMETER IN INCHES. UNLESS OTHERWISE MENTIONED.

5. INSTALLER SHOULD NOT SCALE THE DRAWING.

6. ALL PIPE PENETRATIONS IN WALL & SLABS SHALL BE THROUGH PIPE SLEEVES.

7. IF ANY ERROR OR OMISSION IS FOUND IN DRAWING THIS OFFICE MAY BE CONSULTED FOR RECTIFICATION.

TABLE 604.4 MAXIMUM FLOW RATES AND CONSUMPTION FOR PLUMBING FIXTURES AND FIXTURE FITTINGS	
PLUMBING FIXTURE	MAXIMUM FLOW RATE
R FIXTURE FITTING	OR QUANTITY b
LAVATORY, PRIVATE	1.5 gpm at 60 psi
SINK FAUCET	1.5 gpm at 60 psi
WATER CLOSET	1.28 GALLONS PER FLUSHING CYCLE
FOR SI:	
1 GALLON = 3.785 L, 1 GALLON PER MINUTE = 3.785 L/M, 1 POUND PER SQUARE INCH = 6.895 KPA.	
A. A HAND HELD SHOWER SPRAY IS A SHOWER HEAD.	
B. CONSUMPTION TOLERANCES SHALL BE DETERMINED FROM REFERENCED STANDARDS.	
C. WATER FACTOR IN GALLONS PER CYCLE CUBIC FOOT	
ALL PLUMBING FIXTURES SHALL CONTRIBUTE TO A LEEDS SOLUTION AND SHALL MEET EPA CRITERIA AND BEEN CONSIDERED AS WATER EFFICIENT PRODUCTS AS STIPULATED BY THE LEEDS TA 2009 REFERENCE GUIDE (20% REDUCTION REQUIRED).	
2010 F.B.C PLUMBING AS PER SECTION 604.9 A WATER HAMMER ARRESTOR SHALL BE INSTALLED WHERE QUICK CLOSING VALVES ARE UTILIZED. WATER HAMMER ARRESTORS SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATIONS. WATER HAMMER ARRESTORS SHALL CONFORM TO ASSE 1010.	

OWNER SIGNATURE

REVISION STATUS

Rev	DATE	DESCRIPTION	DRAWN BY
00	21-07-2023	ISSUED FOR APPROVAL	
01			
02			
03			
04			

CLIENT/CONSULTANT APPROVAL STATUS

APPROVED	(A)
APPROVED WITH NOTES	(B)
RESUBMIT	(C)
DISAPPROVED	(D)

OWNER:

JONATHAN BOKOBZA

ADDRESS:

924,NE 4 COURT HALLANDALE BEACH FLORIDA

DESIGN CONSULTANT:

DRAWING STATUS:

DESIGN DRAWING

DISCIPLINE:

PLUMBING


PROJECT TITLE:

HOME DESIGN

DRAWING TITLE:

NOTES

DRAWN BY:	CHECKED BY:	DATE:
		21 JUL 2023
JOB NO	SHT NO	SCALE:
632-004	PL-01	NTS @A3

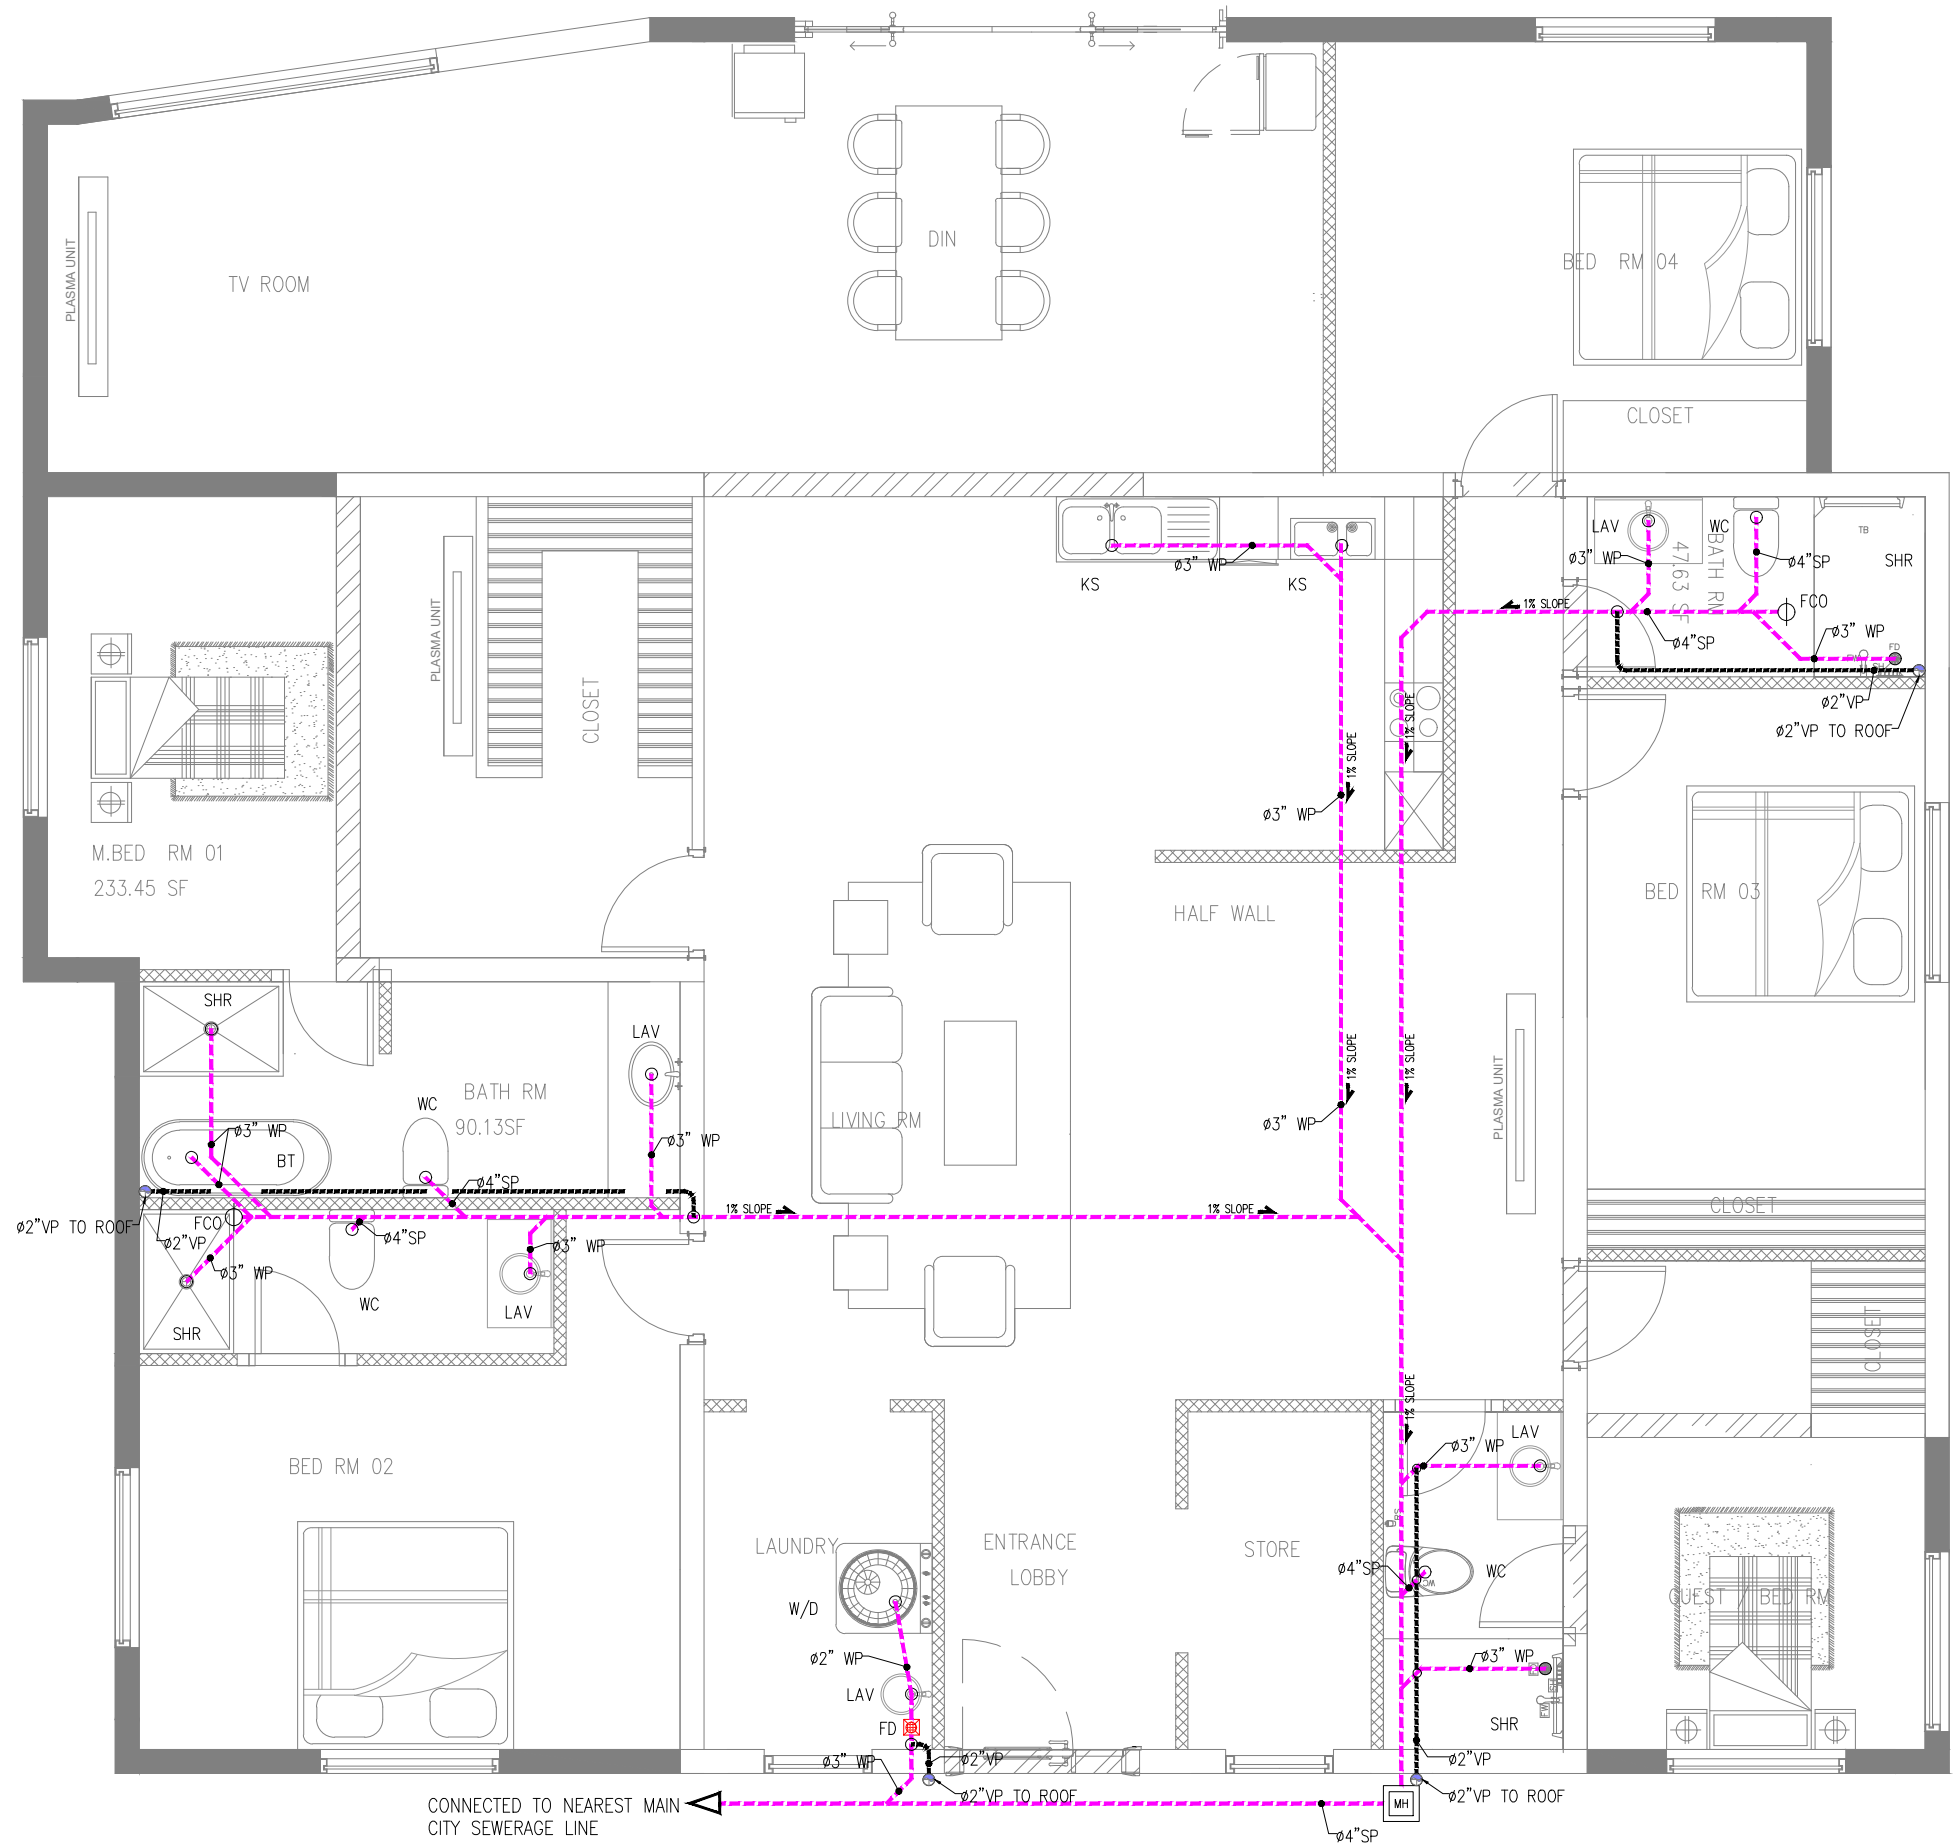

PL 02 **DRAINAGE LAYOUT PLAN**
SCALE 3/16" = 1'-0"

PLUMBING LEGEND:	
SYMBOL	DESCRIPTION
	HWS - HOT WATER SUPPLY
	CWS - COLD WATER SUPPLY
	VP-VENT PIPE
	SP-SOIL PIPE
	WP-WASTE PIPE
	SHUT OFF VALVE
	GATE VALVE
WH	WATER HEATER
GT	GREASE TRAP
WC	WATER CLOSET
KS	KITCHEN SINK
AS	ABLUTION SPRAY
FCO	FLOOR CLEANOUT
FD	FLOOR DRAIN
LAV	LAVATORY

OWNER SIGNATURE

REVISION STATUS			
Rev	DATE	DESCRIPTION	DRAWN BY
00	21-07-2023	ISSUED FOR APPROVAL	
01			
02			
03			
04			

CLIENT/CONSULTANT APPROVAL STATUS	
APPROVED	(A)
APPROVED WITH NOTES	(B)
RESUBMIT	(C)
DISAPPROVED	(D)

OWNER: JONATHAN BOKOBZA

ADDRESS: 924, NE 4 COURT HALLANDALE BEACH FLORIDA

DESIGN CONSULTANT:


DRAWING STATUS: DESIGN DRAWING

DISCIPLINE: PLUMBING

PROJECT TITLE: HOME DESIGN

DRAWING TITLE: FIRST FLOOR DRAINAGE PLAN

DRAWN BY:	CHECKED BY:	DATE:
JOB NO:	SHT NO:	SCALE:
632-004	PL-02	3/16"=1'-0" @A3

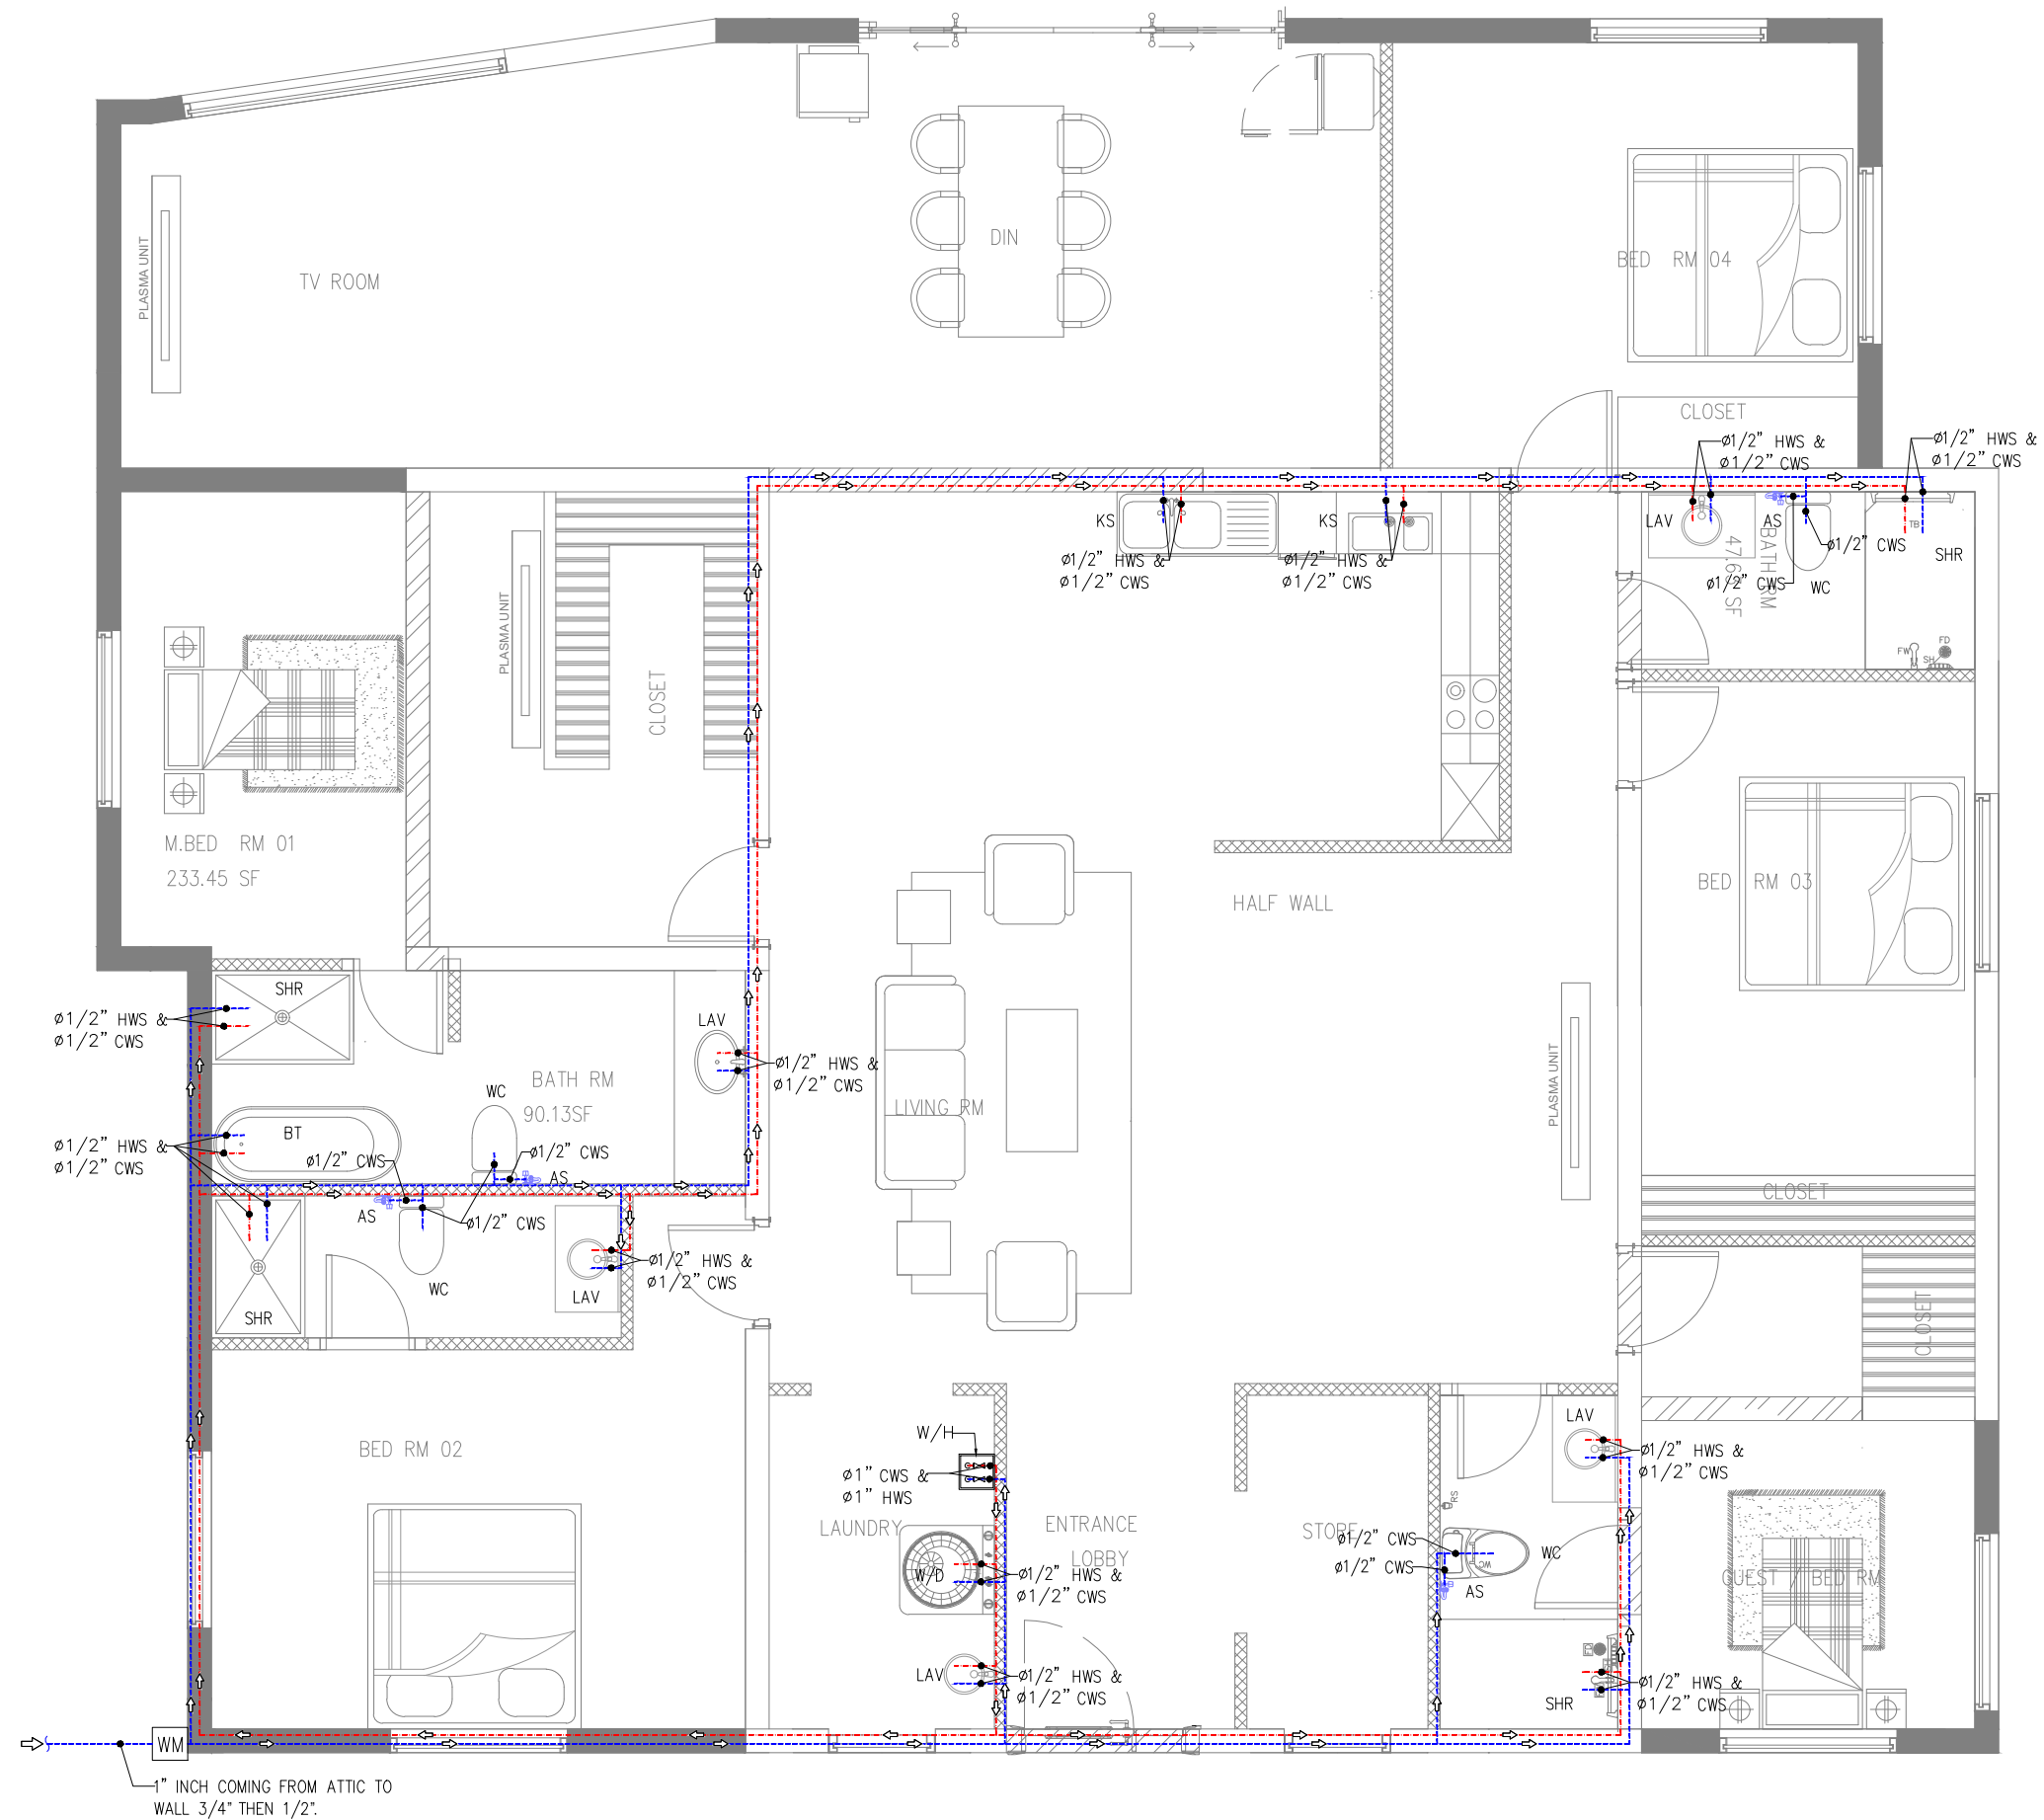

PL 03 WATER SUPPLY LAYOUT PLAN
SCALE 3/16"=1'-0"

PLUMBING LEGEND:	
SYMBOL	DESCRIPTION
---	HWS - HOT WATER SUPPLY
---	CWS - COLD WATER SUPPLY
---	VP-VENT PIPE
---	SP-SOIL PIPE
---	WP-WASTE PIPE
 	SHUT OFF VALVE
+	GATE VALVE
WH	WATER HEATER
GT	GREASE TRAP
WC	WATER CLOSET
KS	KITCHEN SINK
AS	ABLUTION SPRAY
FCO	FLOOR CLEANOUT
FD	FLOOR DRAIN
LAV	LAVATORY

OWNER SIGNATURE

REVISION STATUS			
Rev	DATE	DESCRIPTION	DRAWN BY
00	21-07-2023	ISSUED FOR APPROVAL	
01			
02			
03			
04			

CLIENT/CONSULTANT APPROVAL STATUS	
APPROVED	(A)
APPROVED WITH NOTES	(B)
RESUBMIT	(C)
DISAPPROVED	(D)

OWNER:

JONATHAN BOKOBZA

ADDRESS:

924,NE 4 COURT HALLANDALE
BEACH FLORIDA

DESIGN CONSULTANT:

DRAWING STATUS:

DESIGN DRAWING

DISCIPLINE:

PLUMBING


PROJECT TITLE:

HOME DESIGN


DRAWING TITLE:

FIRST FLOOR
WATER SUPPLY PLAN

DRAWN BY:	CHECKED BY:	DATE:
		21 JUL 2023
JOB NO	SHT NO	SCALE:
632-004	PL-03	3/16"=1'-0" @A3

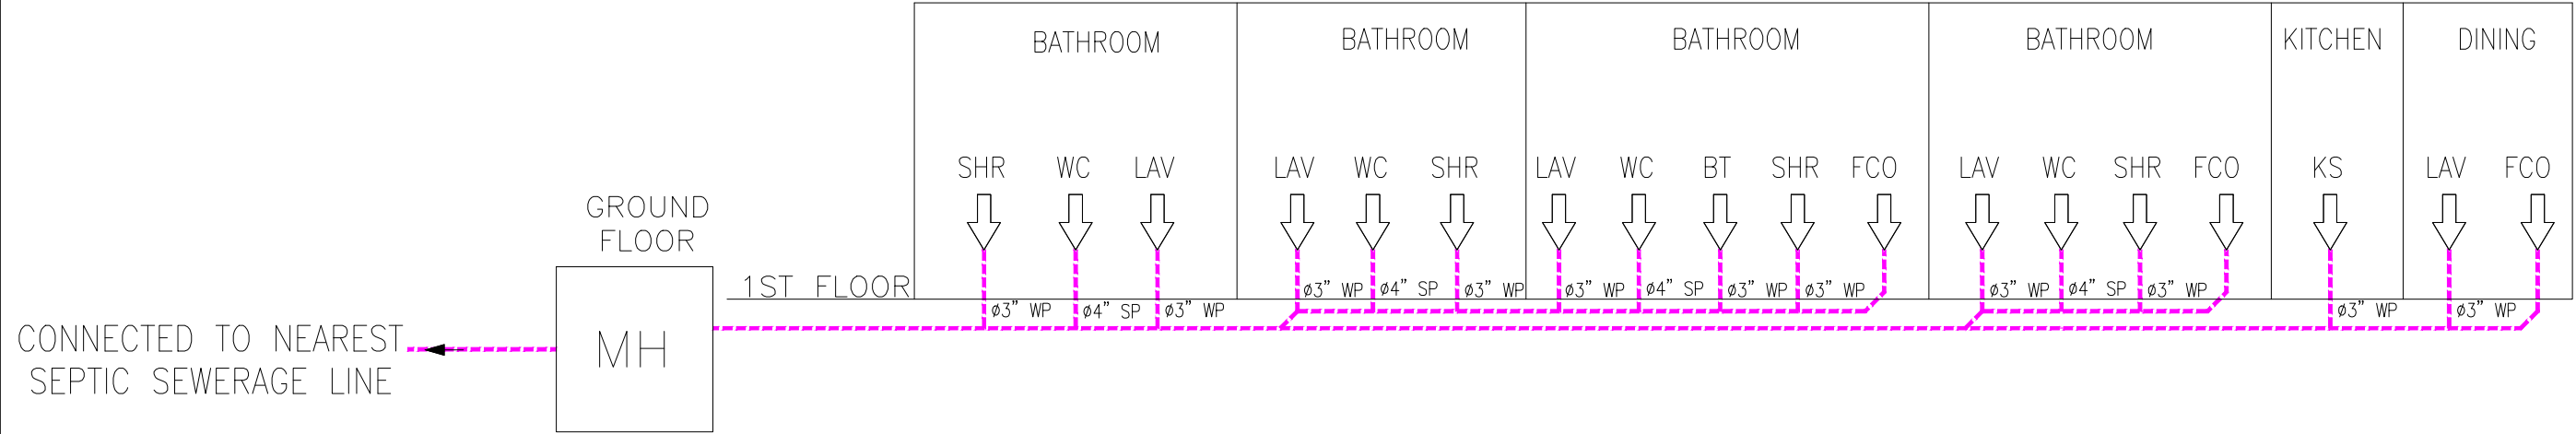

PL 04 DRAINAGE SYSTEM RISER DIAGRAM SCALE NTS

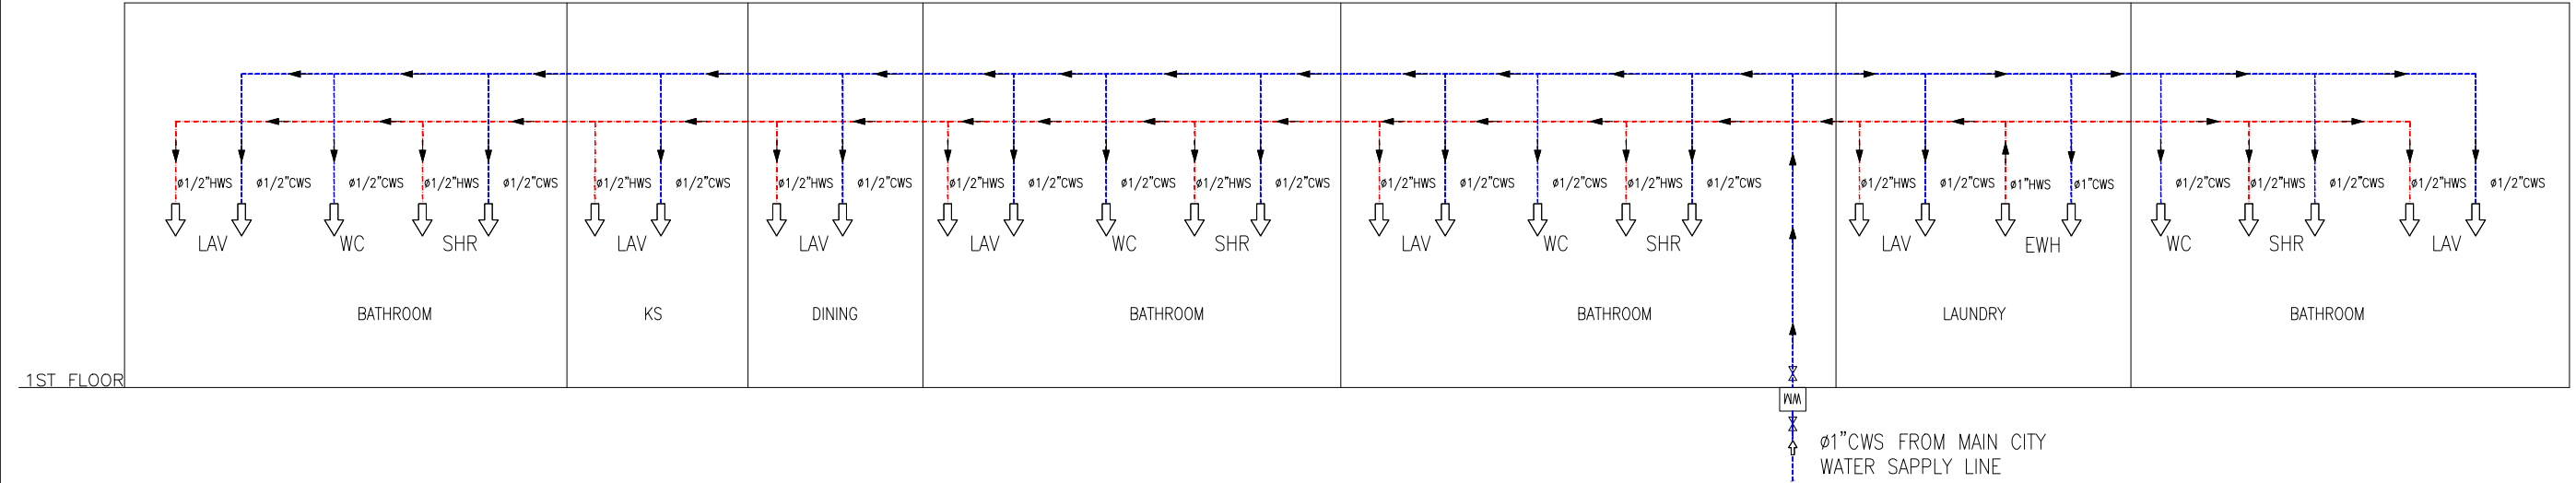

PL 04 WATER SUPPLY SYSTEM RISER DIAGRAM SCALE NTS

OWNER SIGNATURE

REVISION STATUS			
Rev	DATE	DESCRIPTION	DRAWN BY
00	21-07-2023	ISSUED FOR APPROVAL	
01			
02			
03			
04			

CLIENT/CONSULTANT APPROVAL STATUS	
APPROVED	(A)
APPROVED WITH NOTES	(B)
RESUBMIT	(C)
DISAPPROVED	(D)

OWNER: JONATHAN BOKOBZA

ADDRESS: 924, NE 4 COURT HALLANDALE BEACH FLORIDA

DESIGN CONSULTANT:


DRAWING STATUS: DESIGN DRAWING

DISCIPLINE: PLUMBING


PROJECT TITLE: HOME DESIGN

DRAWING TITLE: RISER DIAGRAM

DRAWN BY:	CHECKED BY:	DATE: 21 JUL 2023
JOB NO: 632-004	SHT NO: PL-04	SCALE: NTS @A3

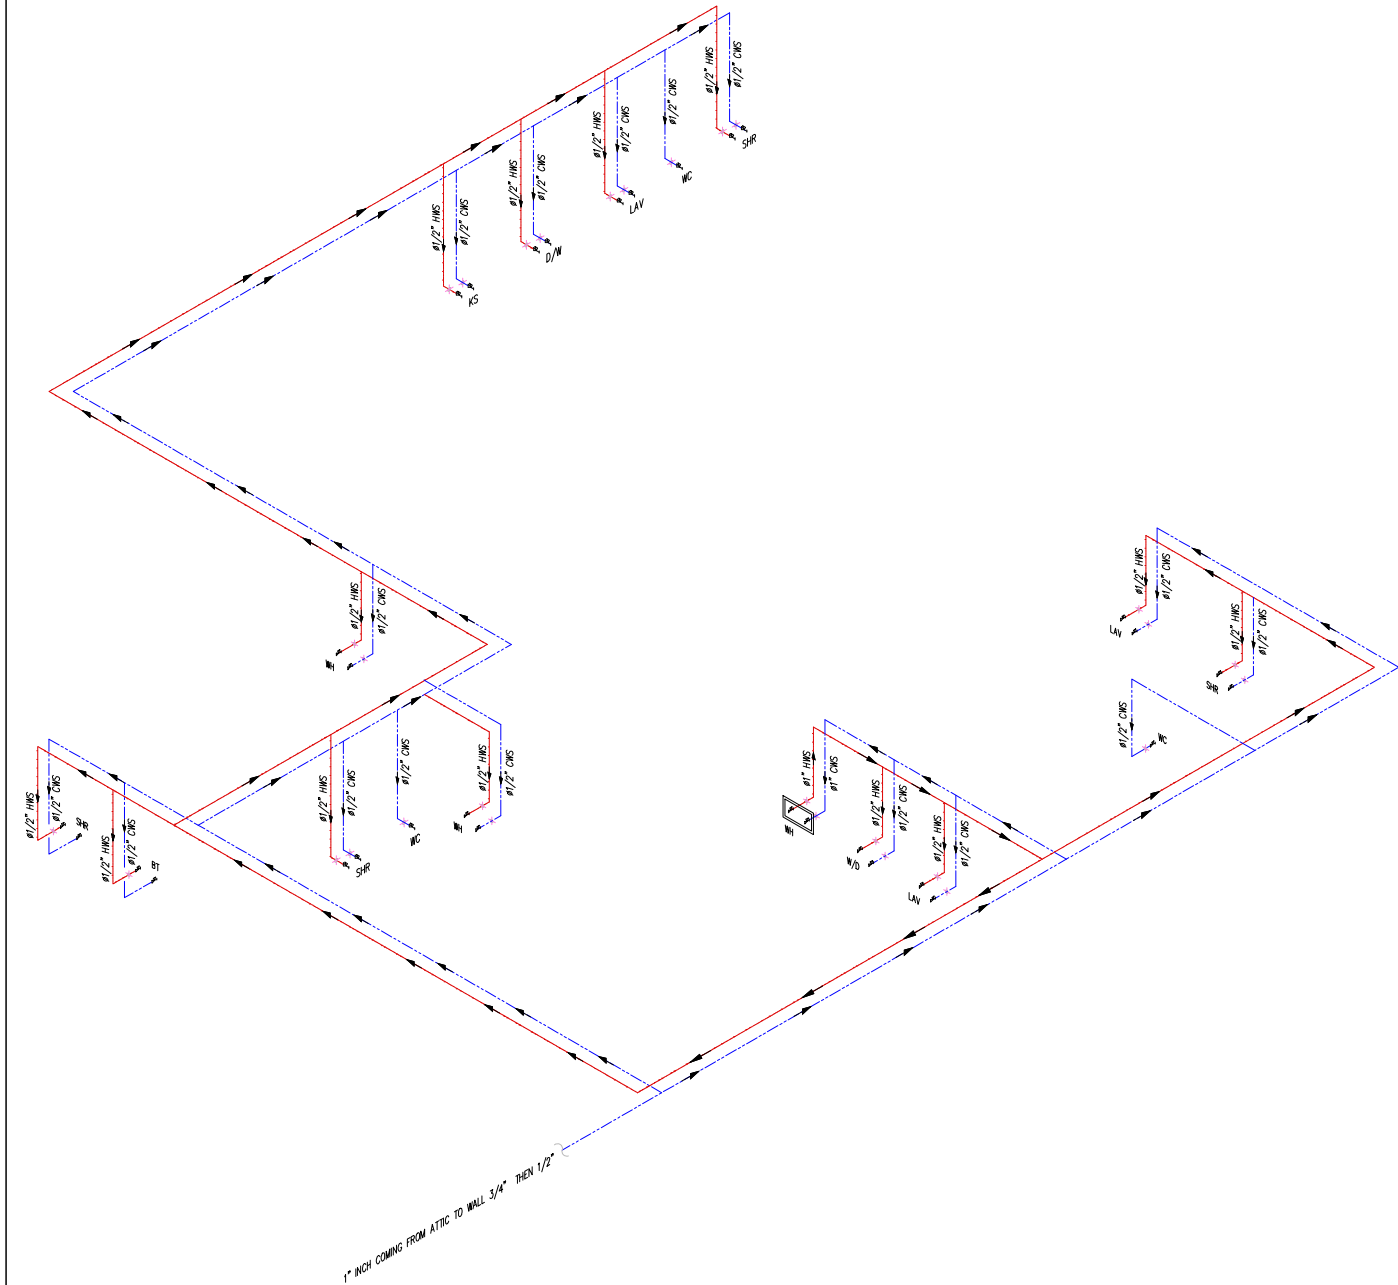

PL 04 WATER SUPPLY ISOMETRIC VIEW SCALE NTS

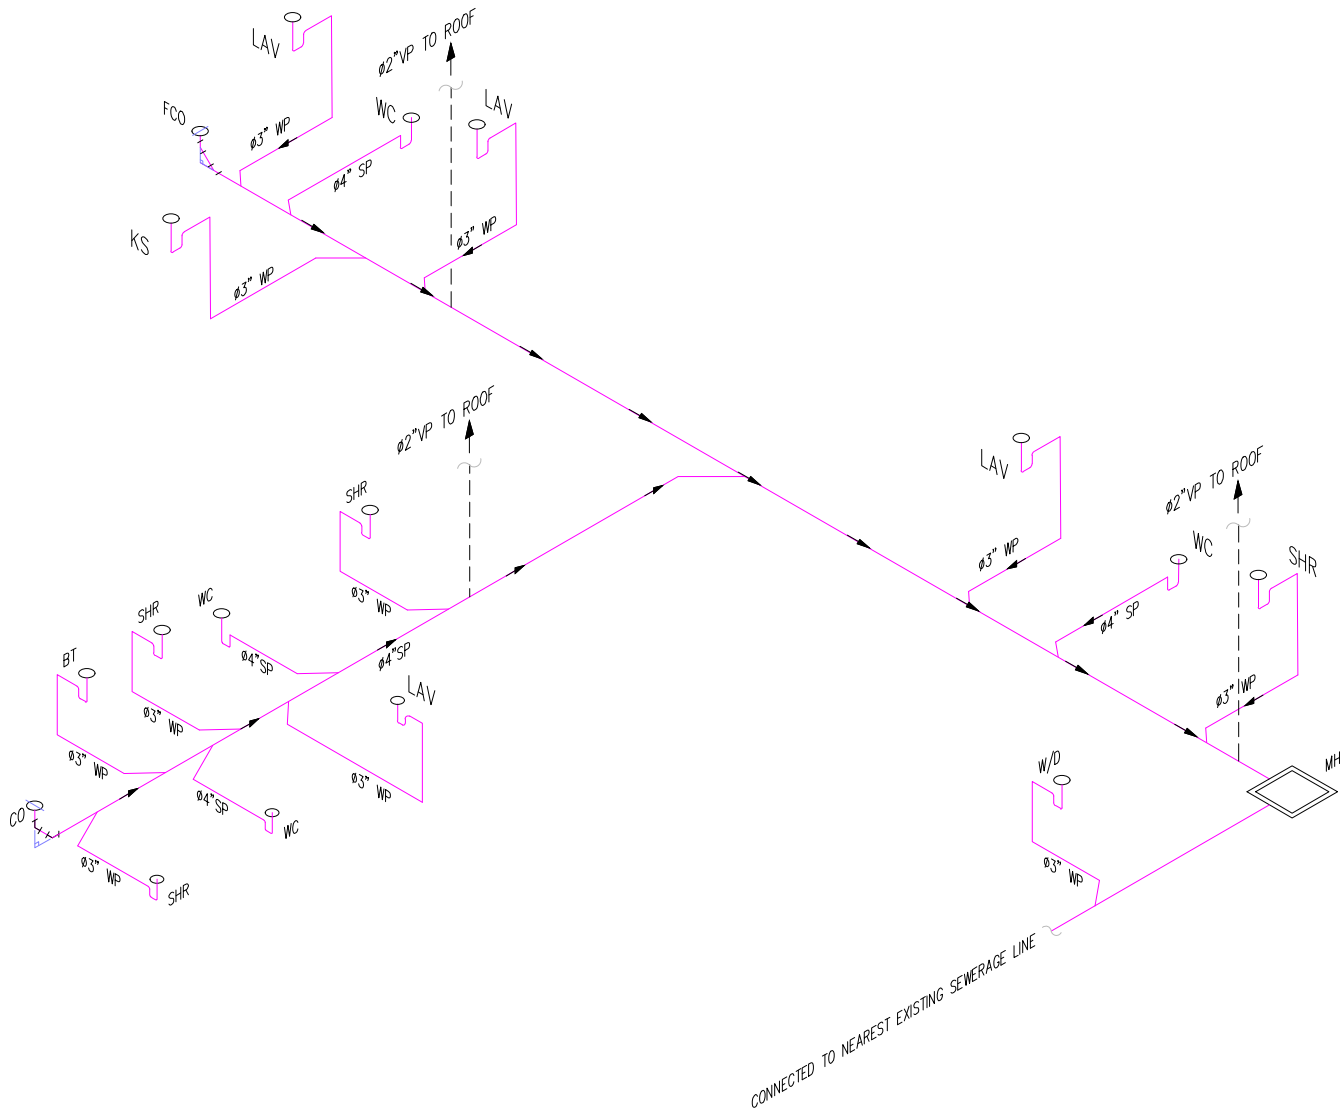

PL 04 SEWER ISOMETRIC VIEW SCALE NTS

OWNER SIGNATURE

REVISION STATUS			
Rev	DATE	DESCRIPTION	DRAWN BY
00	21-07-2023	ISSUED FOR APPROVAL	
01			
02			
03			
04			

CLIENT/CONSULTANT APPROVAL STATUS	
APPROVED	(A)
APPROVED WITH NOTES	(B)
RESUBMIT	(C)
DISAPPROVED	(D)

OWNER:

JONATHAN BOKOBZA

ADDRESS:

924,NE 4 COURT HALLANDALE
BEACH FLORIDA

DESIGN CONSULTANT:










DRAWING STATUS:
DESIGN DRAWING

DISCIPLINE:
PLUMBING

PROJECT TITLE:
HOME DESIGN

DRAWING TITLE:
ISOMETRIC VIEW

DRAWN BY:	CHECKED BY:	DATE:
JOB NO	SHT NO	SCALE:
632-004	PL-04a	NTS @A3

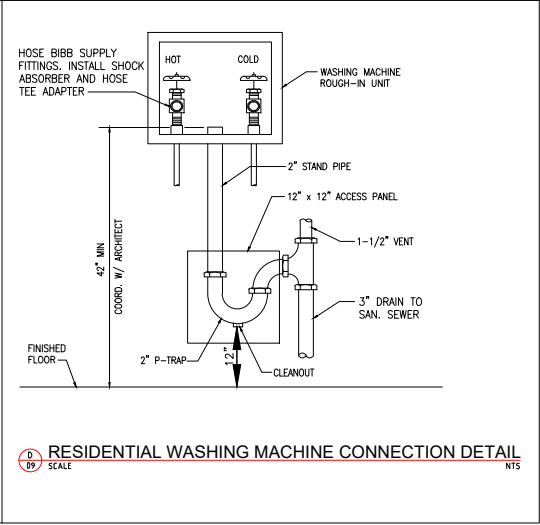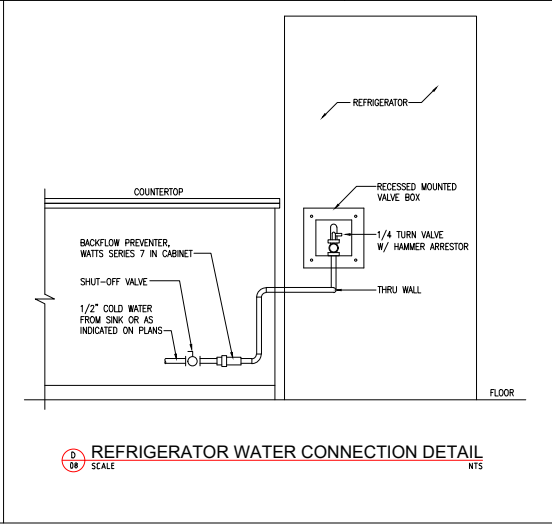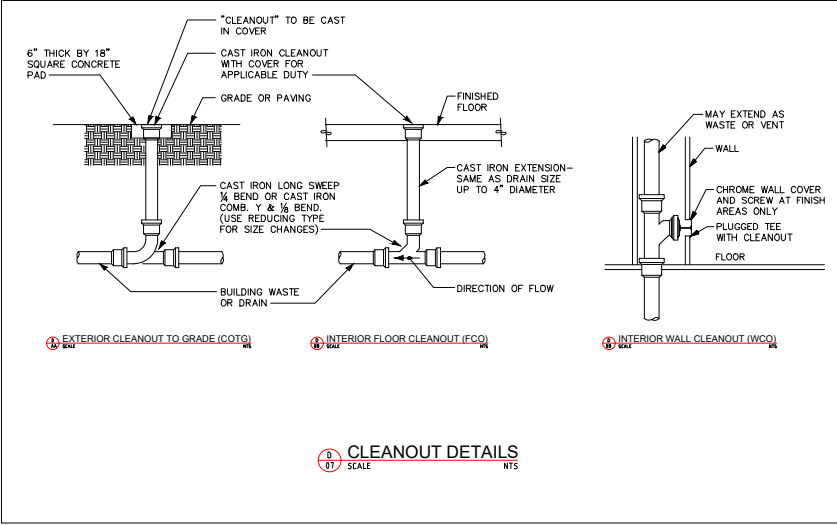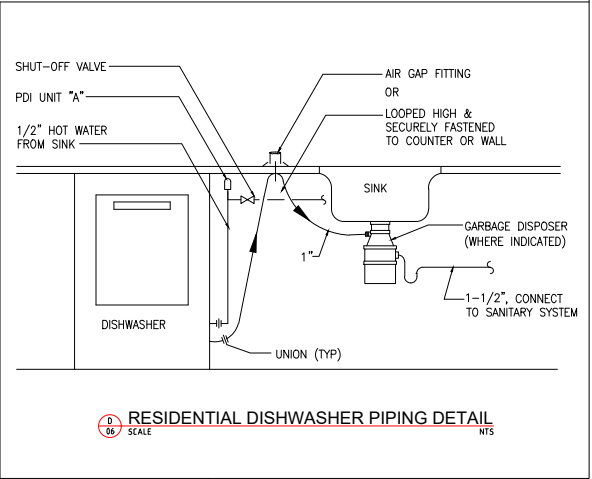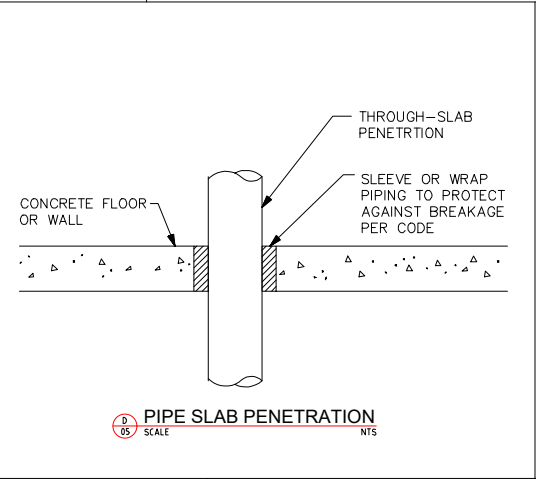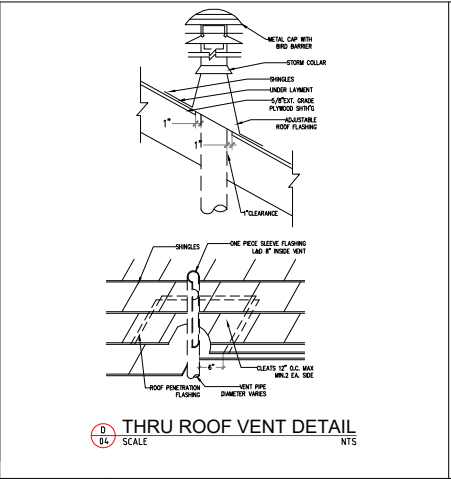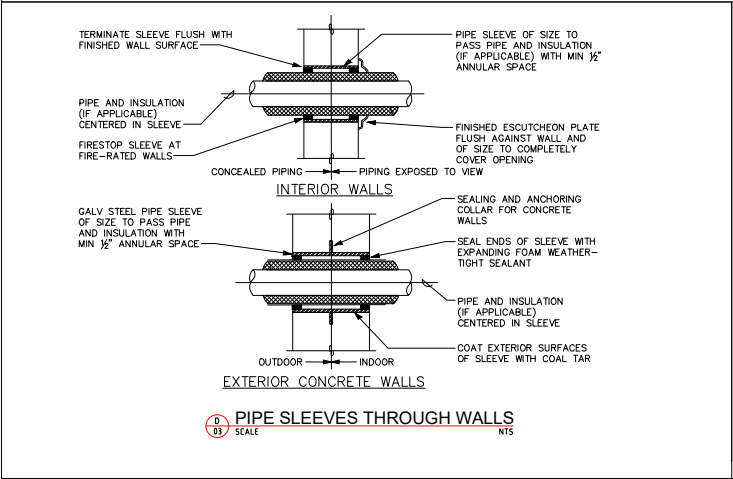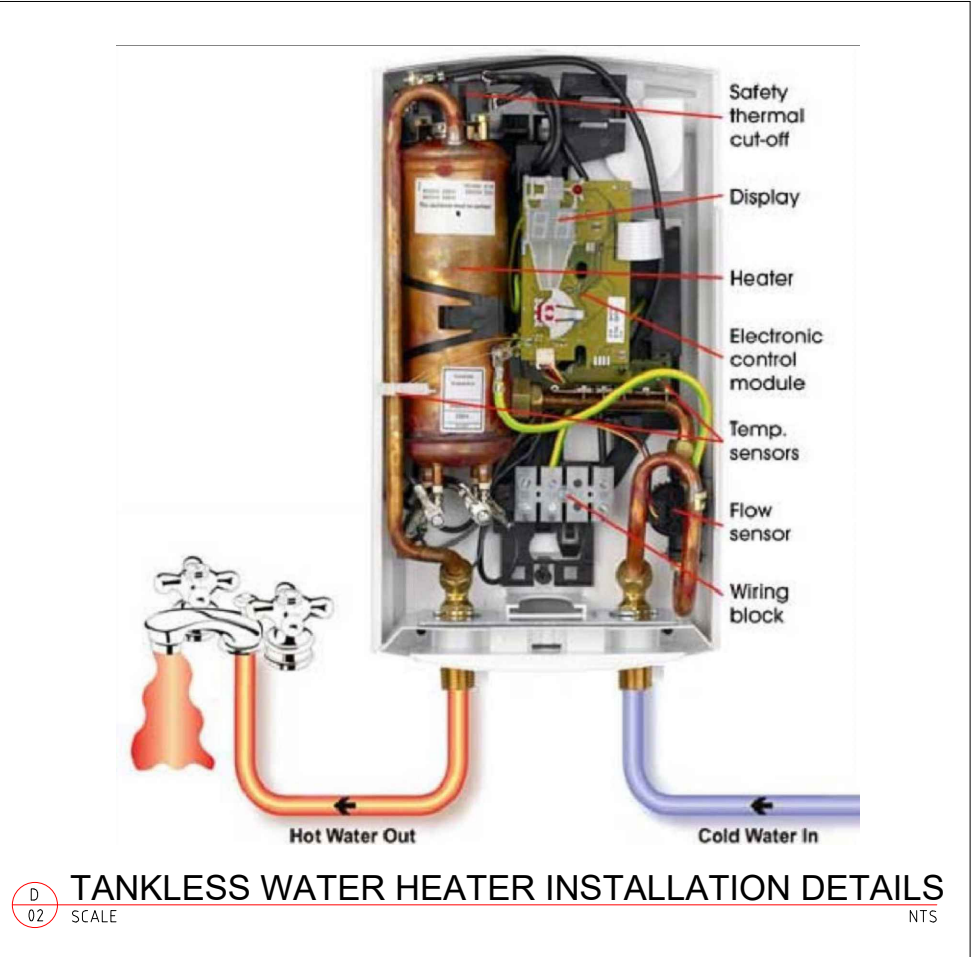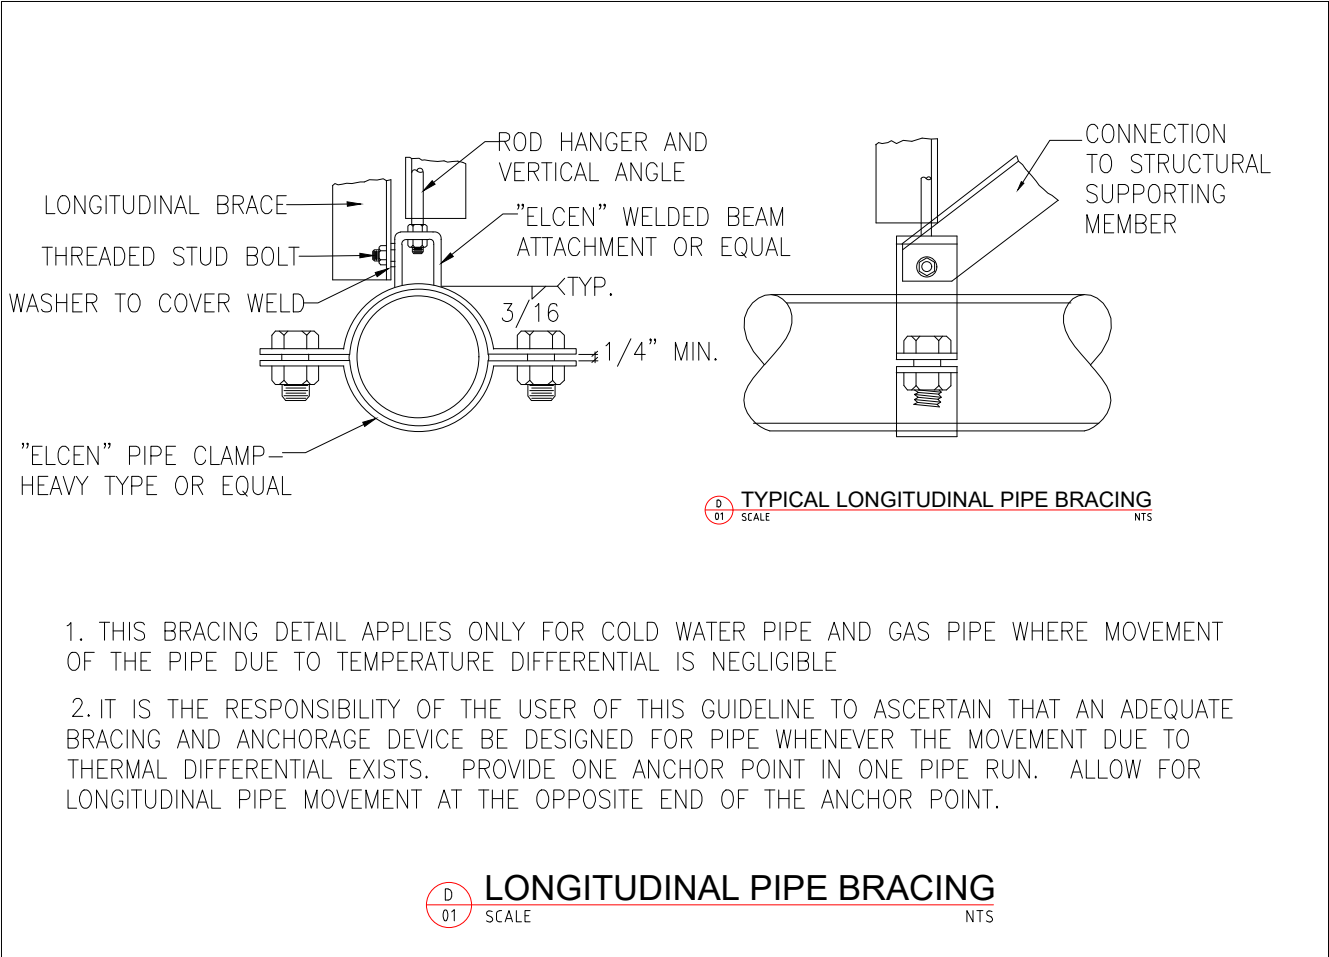

OWNER SIGNATURE

REVISION STATUS			
Rev	DATE	DESCRIPTION	DRAWN BY
00	21-07-2023	ISSUED FOR APPROVAL	
01			
02			
03			
04			

CLIENT/CONSULTANT APPROVAL STATUS	
APPROVED	(A)
APPROVED WITH NOTES	(B)
RESUBMIT	(C)
DISAPPROVED	(D)

OWNER:

JONATHAN BOKOBZA

ADDRESS:

924,NE 4 COURT HALLANDALE BEACH FLORIDA

DESIGN CONSULTANT:

DRAWING STATUS:
DESIGN DRAWING

DISCIPLINE:
PLUMBING

PROJECT TITLE:
HOME DESIGN

DRAWING TITLE:
DETAILS

DRAWN BY:	CHECKED BY:	DATE:
		21 JUL 2023
JOB NO:	SHT NO:	SCALE:
632-004	PL-05	NTS @A3

MECHANICAL LEGEND

SYMBOL	ABBREV.	DESCRIPTION	SYMBOL	ABBREV.	DESCRIPTION
		COORDINATE WITH ELECTRICAL			LINED DUCTWORK (OR PLENUM)
	CD	CONDENSATE DRAIN (A.C)			DUCT RISE IN DIRECTION OF FLOW
	D	DRAIN			DUCT DROP IN DIRECTION OF FLOW
	RD	REFRIGERANT DISCHARGE			ROUND DUCT UP
	RL	REFRIGERANT LIQUID			ROUND DUCT DOWN
	RS	REFRIGERANT SUCTION			SUPPLY DUCT UP
		PIPE DOWN			SUPPLY DUCT DOWN
		PIPE UP		RA/OA	RETURN AIR DUCT/OUTSIDE AIR DUCT UP
		PIPE RISE (OR DN. FOR DROP)			RETURN AIR DUCT/OUTSIDE AIR DUCT DOWN
		DIRECTION OF FLOW IN PIPE			EXHAUST AIR DUCT UP
	AV	AIR VENT (VALVE)			EXHAUST AIR DUCT DOWN
	CHV	CHECK VALVE			DUCT TRANSITION
	CV (2W)	CONTROL VALVE (2-WAY)		CD	CEILING DIFFUSER
	CV (3W)	CONTROL VALVE (3-WAY)		RR	RETURN REGISTER
	FCD	AUTOMATIC FLOW CONTROL DEVICE		ER	EXHAUST REGISTER
	SOV	SHUT OFF VALVE		T'STAT	THERMOSTAT OR TEMPERATURE SENSOR (NUMBER INDICATES EQUIPMENTOR ZONE SERVED)
	BV	GLOBE/BALL/BUTTERFLY VALVE		H'STAT	HUMIDISTAT
	FEV	COMBINATION BALANCING & SHUT-OFF VALVE			CARBON DIOXIDE SENSOR
	STR.	FLOW ELEMENT VENTURI		CFM	CUBIC FEET PER MINUTE
		VALVE ON RISE OR DROP			SYMBOL, SEE EQUIPMENT SCHEDULE
	CL	STRAINER			
	DN.	CAPPED LINE			
	UP	DOWN OR DROP			
	RV	RISE OR RISER			
	PG	PRESSURE RELIEF VALVE			
	R.	PRESSURE GAUGE WITH BALL VALVE			
	R.	ECCENTRIC REDUCER			
	FC	CONCENTRIC REDUCER			
	PA	FLEXIBLE CONNECTION (PIPE)			
	U	PIPE ANCHOR			
	TV	UNION			
		DUCTWORK (1ST NUMBER INDICATES WIDTH SHOWN), NET INSIDE DIMENSION			
	MVD	SQUARE ELBOW WITH TURNING VANES			
	MOD	RADIUS ELBOW			
	BDD	MANUAL VOLUME DAMPER			
	FD	MOTOR OPERATED DAMPER			
	SD	BACKDRAFT DAMPER			
	SFD	FIRE DAMPER			
	FLEX	DUCT MOUNTED SMOKE DETECTOR			
	FLEX	AUTOMATIC SMOKE AND FIRE DAMPER			
	FLEX	FLEXIBLE CONNECTION (DUCTWORK)			
	FLEX	FLEXIBLE CONNECTION OR SEISMIC JOINT			

HVAC ABBREVIATIONS

A	AMPERES	HZ	FREQUENCY
AC	AIR CONDITIONING	IN	INCH OR INCHES
AD	ACCESS DOOR	KW	KILOWATT
AFF	ABOVE FINISHED FLOOR	LG	LENGTH
AL	ACOUSTICAL LINING	LAT	LEAVING AIR TEMPERATURE
BHP	BRAKE HORSEPOWER	LBS	POUNDS
BTU	BRITISH THERMAL UNIT	LDB	LEAVING DRY BULB TEMPERATURE
BTUH	BTU PER HOUR	LIN FT	LINEAR FEET
CD	CEILING DIFFUSER	LWB	LEAVING WET BULB TEMPERATURE
CFM	CUBIC FEET PER MINUTE	MAX	MAXIMUM
CG	CEILING GRILLE	MBH	THOUSAND BTU PER HOUR
CLG	CEILING	MHP	MOTOR HORSEPOWER
COMPR	COMPRESSOR	MIN	MINIMUM
CR	CEILING REGISTER	NIC	NOT IN CONTRACT
DB	DRY BULB	NO.	NUMBER
DIAM	DIAMETER	NTS	NOT TO SCALE
DN	DOWN	RA	RETURN AIR
DWG	DRAWING	RM	ROOM
DX	DIRECT EXPANSION	RPM	REVOLUTIONS PER MINUTE
EAT	ENTERING AIR TEMPERATURE	SP	STATIC PRESSURE
EDB	ENTERING DRY BULB TEMPERATURE	SPEC	SPECIFICATION
EF	EXHAUST FAN	TEMP	TEMPERATURE
EWB	ENTERING WET BULB	TG	TOP GRILLE
EWT	ENTERING WATER TEMPERATURE	TV	TURNING VANES
*F	DEGREES FAHRENHEIT	TYP	TYPICAL
FC	FLEXIBLE CONNECTION	W	WIDTH
FD	FIRE DAMPER	W/	WITH
FIN FL	FINISHED FLOOR	W/O	WITHOUT
FLA	FULL LOAD AMPERES	WB	WET BULB
FPM	FEET PER MINUTE	WMS	WIRE MESH SCREEN
FT	FEET	SG	SUPPLY GRILLE
HD	HEAD	RG	RETURN GRILLE
HR	HOOR	SP	SMOKE PURGE
MAU	MAKE UP AIR UNIT		

OWNER SIGNATURE

REVISION STATUS

Rev	DATE	DESCRIPTION	DRAWN BY
00	21-07-2023	ISSUED FOR APPROVAL	
01			
02			
03			
04			

CLIENT/CONSULTANT APPROVAL STATUS

APPROVED	(A)
APPROVED WITH NOTES	(B)
RESUBMIT	(C)
DISAPPROVED	(D)

OWNER:

JONATHAN BOKOBZA

ADDRESS:

924,NE 4 COURT HALLANDALE
BEACH FLORIDA

DESIGN CONSULTANT:

DRAWING STATUS:

DESIGN DRAWING

DISCIPLINE:

MECHANICAL


PROJECT TITLE:

HOME DESIGN

DRAWING TITLE:

NOTES

DRAWN BY:	CHECKED BY:	DATE: 21 JUL 2023
JOB NO 632-004	SHT NO ME-01	SCALE: NTS @A3

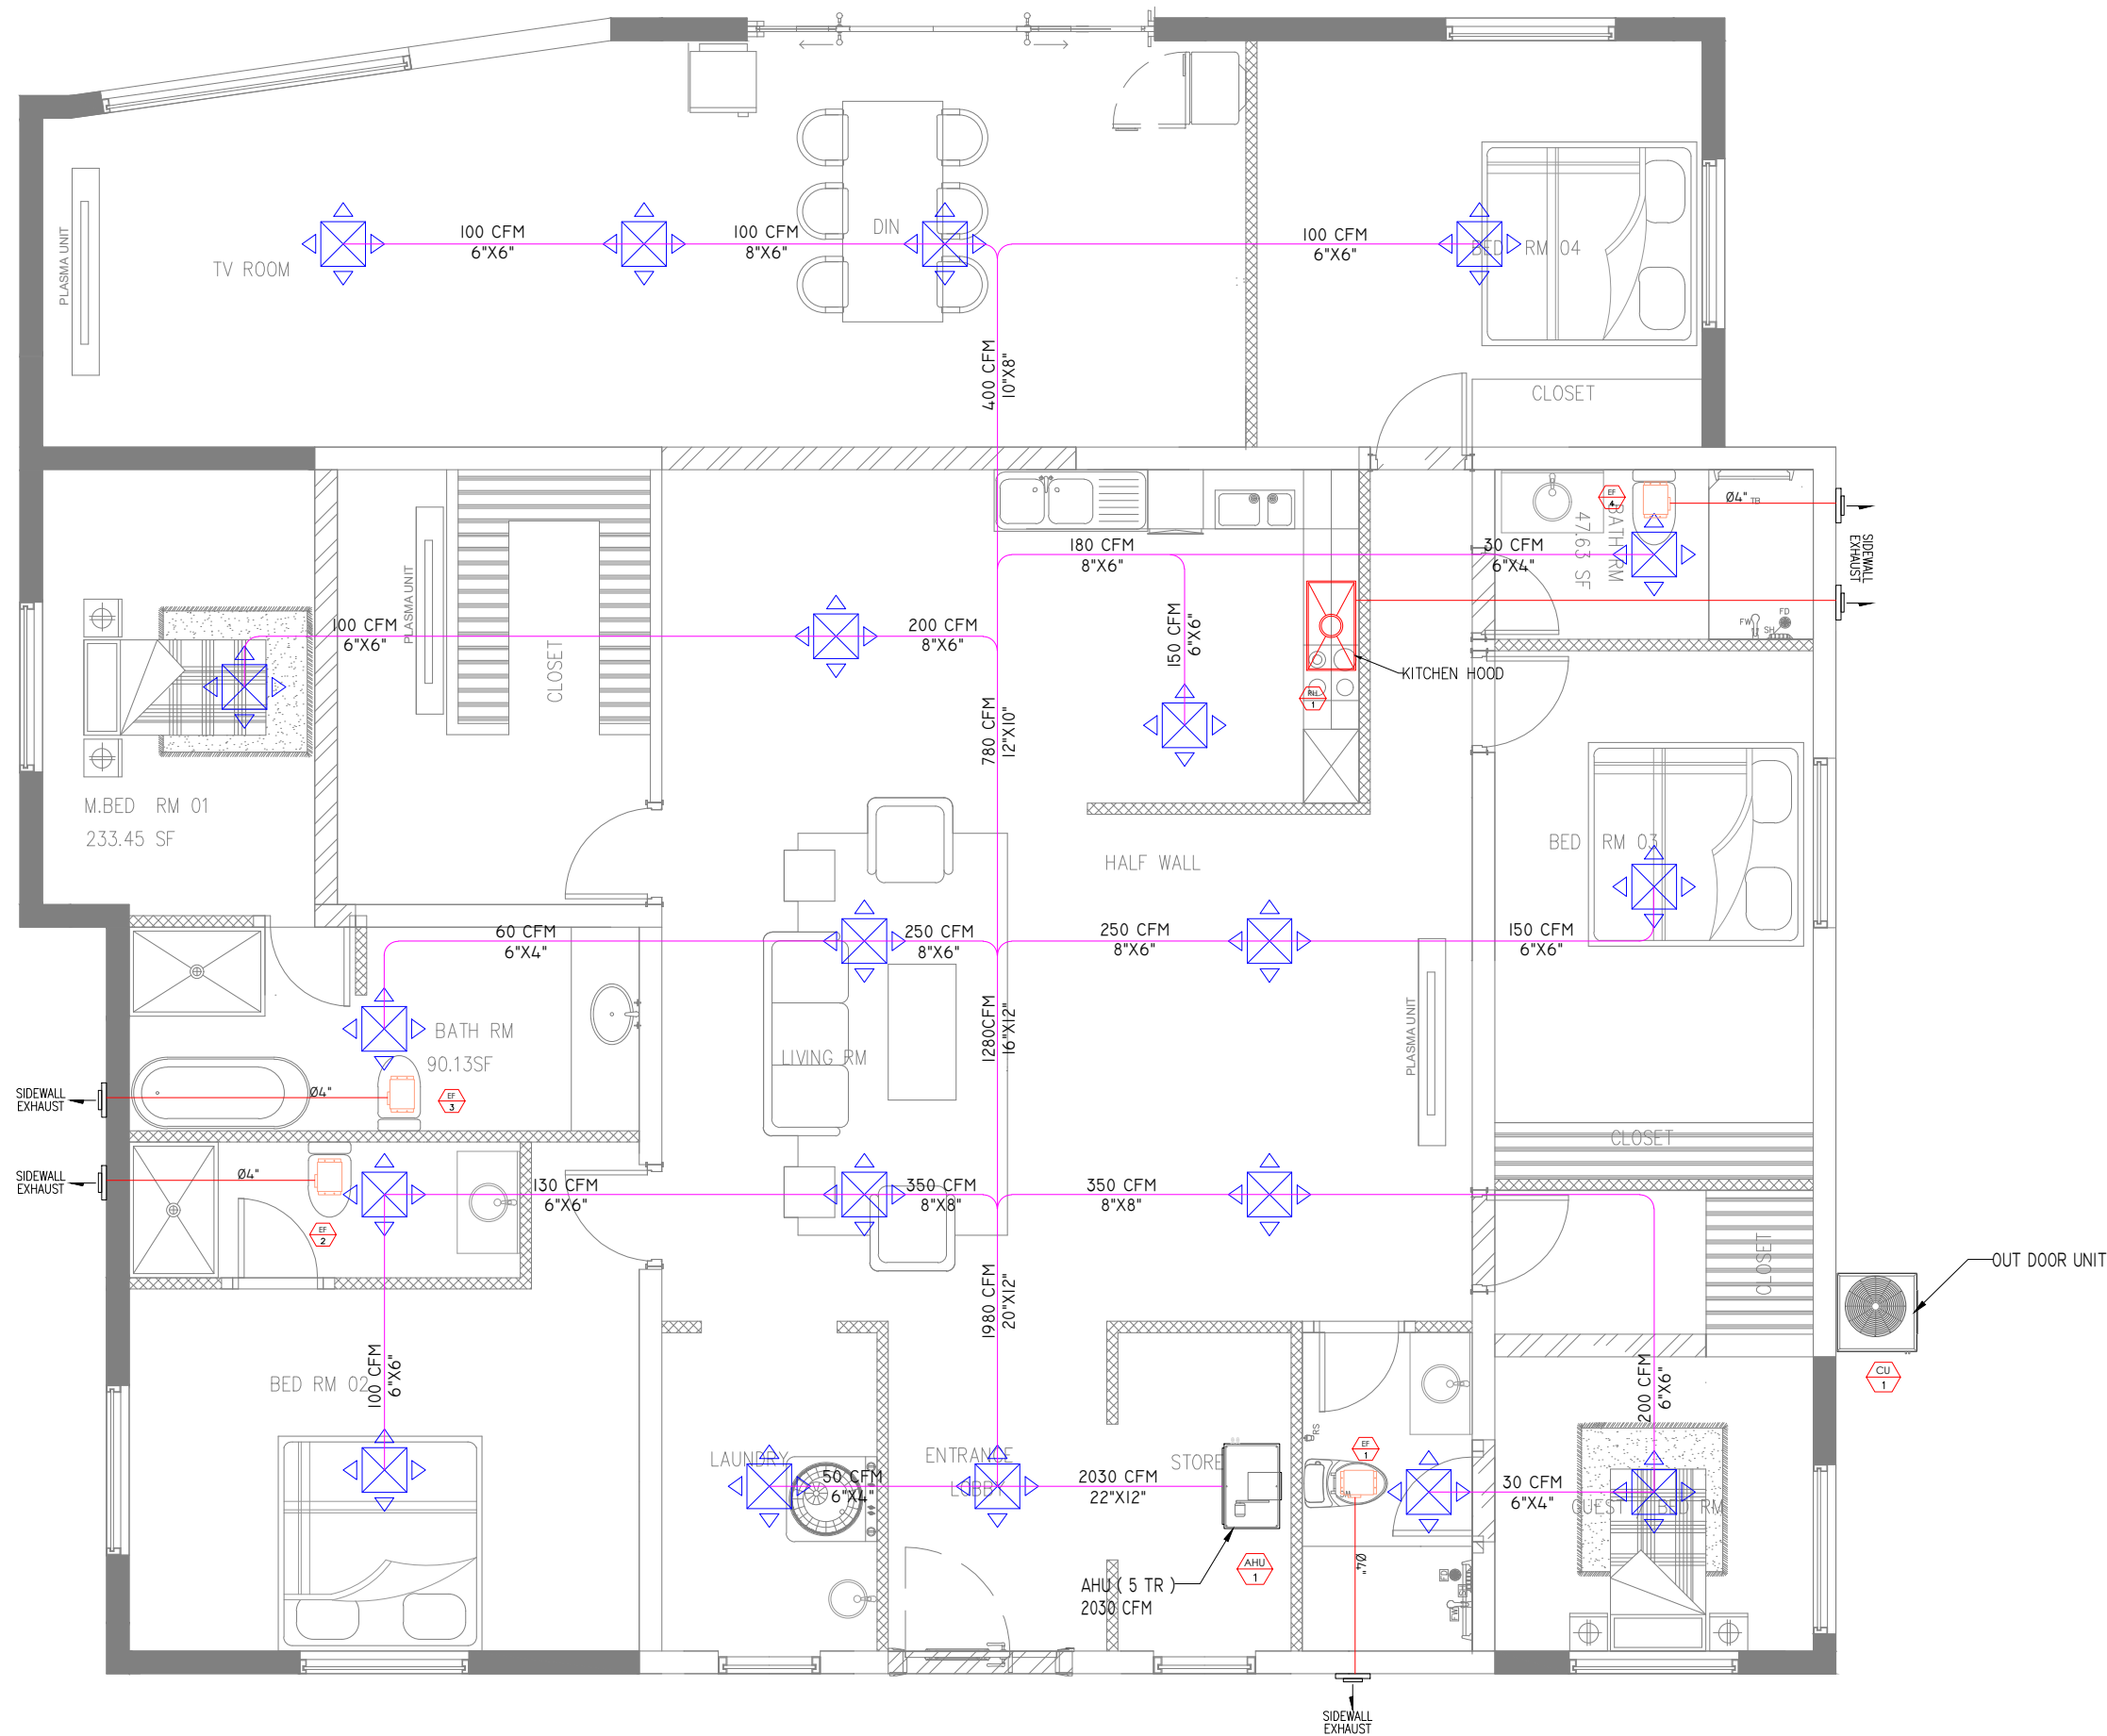

ME 02 HVAC LAYOUT PLAN
SCALE 3/16" = 1'-0"

DRAWING LEGEND	
SYMBOL	DESCRIPTION
	OUTDOOR AIR CONDENSING UNIT
	AHU-VERTICAL AIR HANDLER UNIT
	AIR SUPPLY DUCT. SIZE IS SHOWN ON PLAN
	EXHAUST AIR DUCT. SIZE IS SHOWN ON PLAN
	SUPPLY AIR DIFFUSER ON CEILING FOR BASEMENT
	EXHAUST FAN
	WALL EXHAUST GRILL

OWNER SIGNATURE

REVISION STATUS			
Rev	DATE	DESCRIPTION	DRAWN BY
00	21-07-2023	ISSUED FOR APPROVAL	
01			
02			
03			
04			

CLIENT/CONSULTANT APPROVAL STATUS	
APPROVED	(A)
APPROVED WITH NOTES	(B)
RESUBMIT	(C)
DISAPPROVED	(D)

OWNER:

JONATHAN BOKOBZA

ADDRESS:

924,NE 4 COURT HALLANDALE
BEACH FLORIDA

DESIGN CONSULTANT:


DRAWING STATUS:
DESIGN DRAWING

DISCIPLINE:
MECHANICAL










PROJECT TITLE:
HOME DESIGN

DRAWING TITLE:
HVAC LAYOUT PLAN

DRAWN BY:	CHECKED BY:	DATE:
JOB NO:	SHT NO:	SCALE:
632-004	ME-02	21 JUL 2023 3/16"=1'-0" @A3

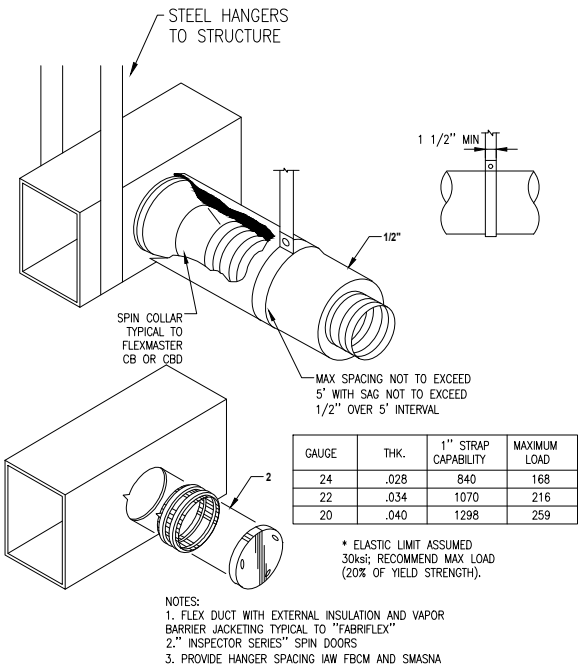

0 01 SCALE SUPPORT REQUIREMENTS FOR DUCT NTS

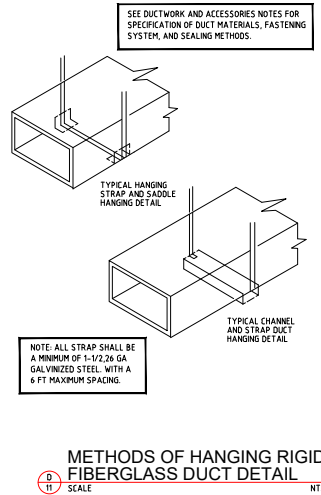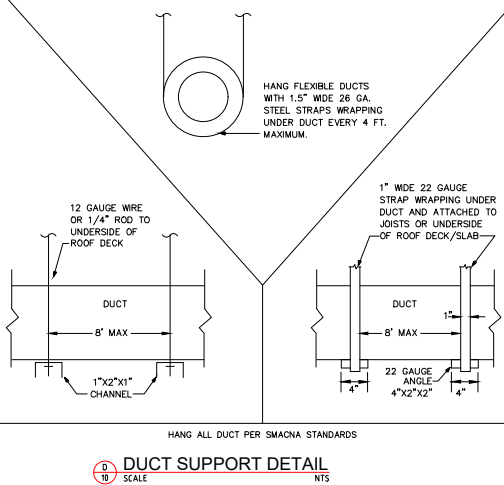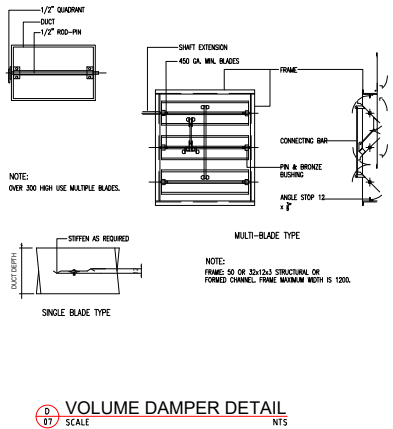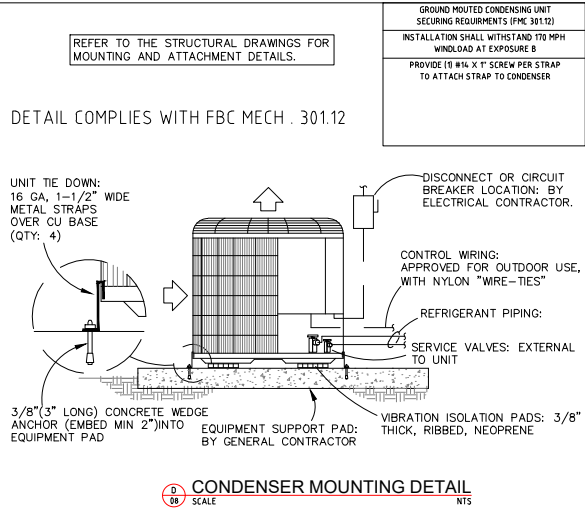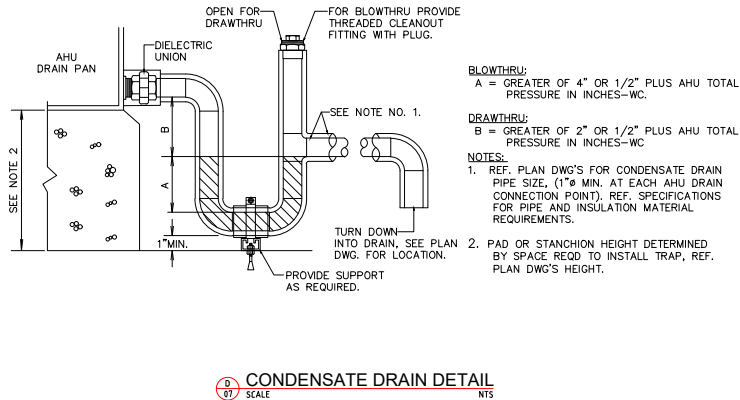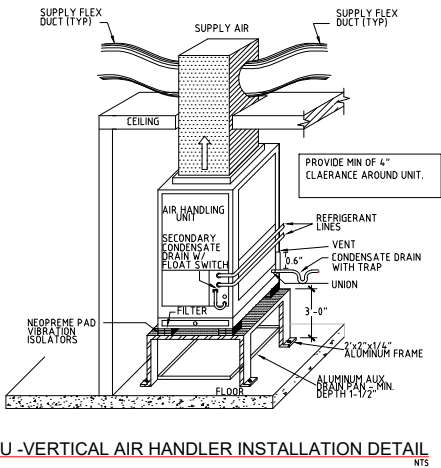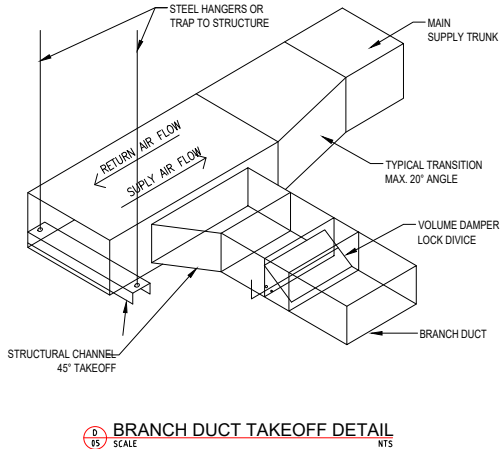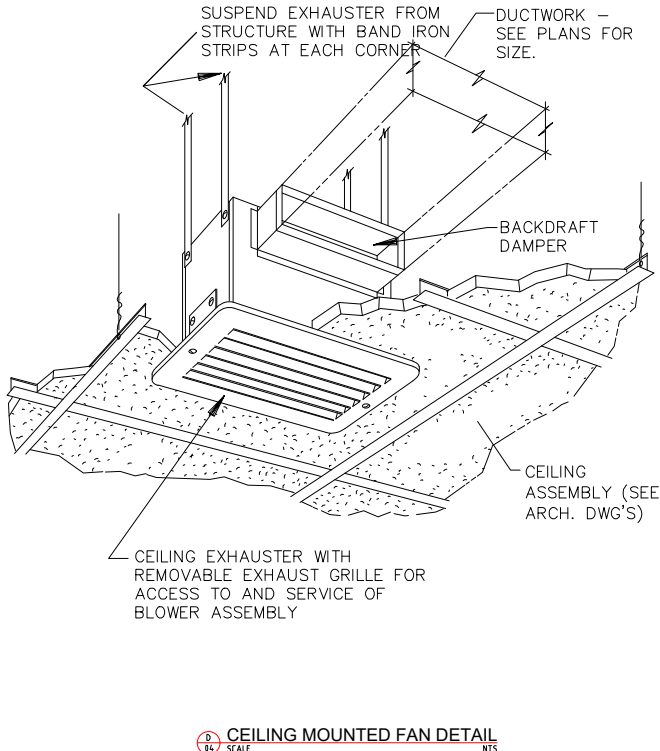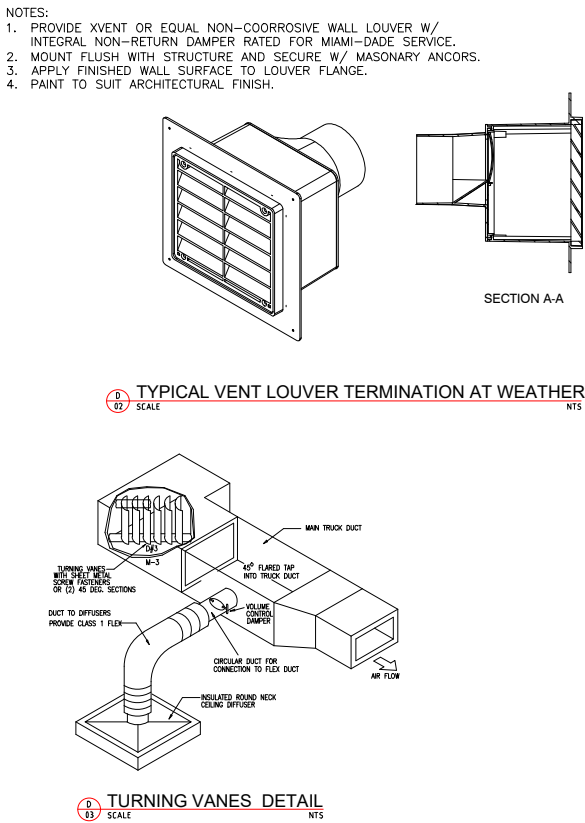

OWNER SIGNATURE

REVISION STATUS			
Rev	DATE	DESCRIPTION	DRAWN BY
00	21-07-2023	ISSUED FOR APPROVAL	
01			
02			
03			
04			

CLIENT/CONSULTANT APPROVAL STATUS	
APPROVED	(A)
APPROVED WITH NOTES	(B)
RESUBMIT	(C)
DISAPPROVED	(D)

OWNER:

JONATHAN BOKOBZA

ADDRESS:

924,NE 4 COURT HALLANDALE
BEACH FLORIDA

DESIGN CONSULTANT:

DRAWING STATUS:
DESIGN DRAWING

DISCIPLINE:
MECHANICAL

PROJECT TITLE:
HOME DESIGN

DRAWING TITLE:
DETAILS

DRAWN BY:	CHECKED BY:	DATE:
JOB NO	SHT NO	SCALE:
632-004	ME-03	NTS @A3

AUH-1 SCHEDULE													
MARK	QTY	LOCATION	MANUFACTURER AND MODEL	BTU OUTPUT	SUPPLY CFM	ESP (IN. W.G)	FUEL	Dimensions L x W x H	Gas Connection Size in	ELECTRICAL V/Ph/Hz	MCA	MAX FUSE SIZE	WEIGHT
AHU1	1	AS SHOWN	AS PER SUPPLIER	60,000	2030	0.7	NAT GAS	-	1/2	115/1/60	7.2	15 amp	-
OUTDOOR CONDENSING UNIT													
MARK	QTY	LOCATION	MANUFACTURER	TON	COOLING CAPACITY BTU/H	AMBIENT TEMP	FLA	CIRCUT BREAKER MAX AMPS	LIQUID LINE SUCTION LINE	REF	ELECTRICAL	WEIGHT	DIMENSIONS
CU1	1	RD	AS PER SUPPLIER	5.0	48,000	95F	0.5	30	3⁄8" / 7⁄8"	R410a	208-1-60	165 LBS	----
EXHAUST FAN SCHEDULE													
MARK	QTY	LOCATION	MANUFACTURER AND MODEL	TYPE	CFM	E.S.P. (IN. W.G.)	MOTOR DATA			SONES	OPTIONS -ACCESSORIES	WEIGHT	
							WATTS	SPEED	ELECTRICAL				
EF1	4	GF UTILITY RM	AIR KING AK50 OR EQUAL	CEILING MOUNTED	50	0.25	1500	1	120-1-60	1.5	BACK DRAFT DAMPER CONTROLLED BY SWITCH	10	
RH1	1	KITCHEN	APPROVED EQUAL	CEILING MOUNTED	350	0.25	2000	1	120-1-60	--	BACK DRAFT DAMPER CONTROLLED BY SWITCH	--	

NOTES:
VERIFY WITH ARCHITECT/OWNER FOR EXACT MODEL NUMBER BEFORE ROUGH-IN
ALL EXHAUST FANS TO BE ENERGY STAR CERTIFIED

MECHANICAL LOAD						
NO#	LOCATION	MANUFACTURER	AREA SQFT	CFM	TR	BTU
1	BR #2	AS PER SUPPLIER	225	130	0.3	3900
2	LAUNDRY	AS PER SUPPLIER	60	50	0.1	1200
3	ENTRANCE	AS PER SUPPLIER	62	100	0.25	3000
4	BATH & GUEST	AS PER SUPPLIER	180	230	0.5	6900
5	BATH & BR #3	AS PER SUPPLIER	180	180	0.3	3900
6	BR #4	AS PER SUPPLIER	156	150	0.25	4500
7	TV&DINING	AS PER SUPPLIER	400	300	0.3	9000
8	MASTER BR	AS PER SUPPLIER	320	150	0.3	3900
9	KITCHEN & HALL	AS PER SUPPLIER	598	840	2.1	26700
TOTAL			2181	2030	5.0	60,000

OWNER SIGNATURE

REVISION STATUS			
Rev	DATE	DESCRIPTION	DRAWN BY
00	21-07-2023	ISSUED FOR APPROVAL	
01			
02			
03			
04			
CLIENT/CONSULTANT APPROVAL STATUS			
APPROVED			(A)
APPROVED WITH NOTES			(B)
RESUBMIT			(C)
DISAPPROVED			(D)
OWNER:			
JONATHAN BOKOBZA			
ADDRESS:			
924,NE 4 COURT HALLANDALE BEACH FLORIDA			
DESIGN CONSULTANT:			
DRAWING STATUS:			
DESIGN DRAWING			
DISCIPLINE:			
MECHANICAL			
PROJECT TITLE:			
HOME DESIGN			
DRAWING TITLE:			
SCHEDULE & LOAD			
DRAWN BY:		CHECKED BY:	DATE:
			21 JUL 2023
JOB NO	SHT NO	SCALE:	
632-004	ME-04	NTS @A3	