

8. EXIT LIGHTING AND EMERGENCY LIGHTING

- 8.1 PROVIDE NEW LUMACELL LDE SERIES SLIM EDGE-LIT EXIT SIGNS (GREEN COLOR WITH PICTOGRAM POINTING IN DIRECTION OF EXIT), EMERGENCY REMOTE HEADS AND CONNECT TO EMERGENCY LIGHTING CIRCUIT. EMERGENCY EXIT SIGNS TO BE AC POWERED WITH TWO-WIRE UNIVERSAL INPUT 120-347 VAC.
- 8.2 EMERGENCY LIGHT LAMPS SHALL BE 4 WATTS LED MINIMUM IF NOT SPECIFIED ON DRAWINGS. PACKS SHALL BE LUMACELL GRANDE SERIES C/W BUILT-IN TEST SWITCH, GEL BATTERIES (144W) AND LIGHT INDICATORS FOR CHARGE CONDITION. PLUG IN UNITS ARE NOT ACCEPTABLE AND UNITS SHALL BE CONNECTED DIRECTLY THROUGH JUNCTION BOX.
- 8.3 CHECK CIRCUIT LOADING OF ALL LIGHTING CIRCUITS AND EXIT LIGHTING CIRCUITS PRIOR TO CONNECTION. PROVIDE NEW CIRCUITS IF REQUIRED.

9. FIRE ALARM SYSTEM

- 9.1 SUPPLY AND INSTALL A CLOSED CIRCUIT, SUPERVISED, ADDRESSABLE, SINGLE STAGE, LOW VOLTAGE (24volt AD/DC). NON CODED, ZONED AND FULLY ANNUNCIATED (FULLY SUPERVISED ANNUNCIATOR) FIRE ALARM SYSTEM AS RECOGNIZED BY THE CANADIAN STANDARD ASSOCIATION (CSA) AND THE UNDERWRITERS LABORATORIES OF CANADA (ULC)
- 9.2 PROVIDE ALL MATERIALS AND COMPONENTS REQUIRED AND APPROVED BY THE GOVERNING CODES AND AUTHORITIES HAVING JURISDICTION FOR FIRE ALARM SYSTEMS. ALL DEVICES USED FOR THE DETECTION AND INITIATION OF ALARM CIRCUITS ARE TO BE OF THE RESETTING TYPE AND OF THE HIGHEST COMMERCIAL GRADE AVAILABLE FOR THE PURPOSE.
- 9.3 THE INSTALLATION OF THIS SYSTEM IS TO SATISFY THE MINIMUM STANDARDS AS DICTATED BY CAN/ULC-S524 LATEST EDITION AND THESE SPECIFICATIONS.
- 9.4 PROVIDE TESTING AND VERIFICATION OF THE COMPLETED AND FULLY OPERATION SYSTEM. THE VERIFICATION OF THIS SYSTEM IS TO SATISFY THE MINIMUM STANDARDS AS DICTATED BY ULC (CAN/ULC-S537 LATEST EDITION) AND THESE SPECIFICATIONS. TEST COMPLETE SYSTEM WITH EQUIPMENT MANUFACTURER PRIOR TO ENGINEER'S VERIFICATION.
- 9.5 THE VERIFICATION IS TO BE RECORDED AND UNDERTAKEN BE AN APPROVED FIRE ALARM TESTING ORGANIZATION. ALL INSTALLATION AND TESTING PROCEDURES ARE TO MEET WITH AND SATISFY THE AUTHORITIES HAVING JURISDICTION.
- 9.6 PRIOR TO THE ENGINEER WITNESSING THE VERIFICATION, THE SYSTEM IS TO BE 100% COMPLETE & IN OPERATION CONDITION.
- 9.7 ALL THE AUDIBLE EVACUATION DEVICES FOR THIS SYSTEM ARE TO BE SUPERVISED AND SYNCHRONIZED, ELECTRICALLY OPERATED TEMPORAL PATTERNED, FIRE ALARM HORNS TO BE COMPLETE WITH STROBES. MOUNTING OF THESE DEVICES ARE TO BE SURFACE AND THEY ARE TO BE MOUNTED IN AN AREA WHERE THERE WILL BE NO PHYSICAL OBSTRUCTION FOR A MINIMUM RADIUS OF AT LEAST 39 INCHES. STROBES TO BE RATED AT 75 CANDELA.
- 9.8 PROVIDE DETAILED MANUFACTURERS SHOP DRAWINGS OF ALL COMPONENTS TO USED. MANUFACTURER TO SUBMIT THIER RISER DIAGRAM FOR THIER SYSTE. ( SEE SECTION 5).
- 9.9 PROVIDE A 4 PAIR TELEPHONE CABLE FROM THE FIRE ALARM CONTROL PANEL TO THE MAIN TELEPHONE TERMINAL BOARD TO CONNECT TO THE AUTO DIALER. CONTROL PANEL TO REGISTER ITS OWN ALARM AND TROUBLE SIGNAL TO BE TRANSMITTED BY THE AUTO DIALER. DIALER, CONNECTIONS ETC., BY THIS CONTRACTOR.
- 9.10 INDICATE ON 'AS-BUILT' DRAWINGS LOCATION OF THE ISOLATION MODULES.
- 9.11 ALL INIATING DEVICE LOOPS TO BE CLASS-A.
- 9.12 CONTROL PANEL c/w FOUR SIGNAL CIRCUIT (NAC'S) AND FOUR DATA LOOPS. DATA LOOPS. 1) PARKADE, 2) MAIN FLOOR, 3)SECOND FLOOR, 4)ELEVATOR PENTHOUSE.
- 9.13 CONTRACTOR TO CONFIRM MAXIMUM DRAW (Ma RMS) FOR ALL AUDIBLE/VISUAL DEVICES HE PROPOSED TO USE IN THIS BUILDING. ENSURE THAT CIRCUIT LOADING WILL NOT EXCEED 80%. ADD ADDITIONAL CIRCUITS IF REQUIRED.
- 9.14 SYSTEM COMPONENTS TO BE THE FOLLOWING:

.1 FIRE ALARM CONTROL PANEL

.2 HORN/STROBE

.3 PULL STATION

.4 CONTROL MODULE

.5 MONITOR MODULE

.6 STROBE


.7 SMOKE DETECTOR

.8 ISOLATION MODULE

.9 AUTO DIALER
- 9.15 CONTACT THE ENGINEER FOR HIS COSTS ONLY, FOR THE VERIFICATION OF THE FIRE ALARM SYSTEM AND ISSUING OF THE VERIFICATION CERTIFICATE.

10. COMMUNICATION

COMMUNICATION SPECIFICATIONS BY AV/IT CONSULTANT.




PROJECT NAME.

RESTROOMS  
ASANA PARTNERS

DESIGN  
CONSULTANT.

TSABA CORP  
NADIF BRACEY  
254 CHAPMAN RD,  
STE 208 #13130  
NEWARK, DELAWARE  
19702  
EMAIL:  
INFO@TS9DESIGNS.COM



SITE LOCATION.

1000 MAXWELL LANE  
HOBOKEN, NJ 07030

DISCIPLINE.

GENERALS NOTES

| No. | Description | Date |
|-----|-------------|------|
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |



Date2-11-2023



Drawn byMJS

Checked byFA


E1-1

Scale1"=1'-0"




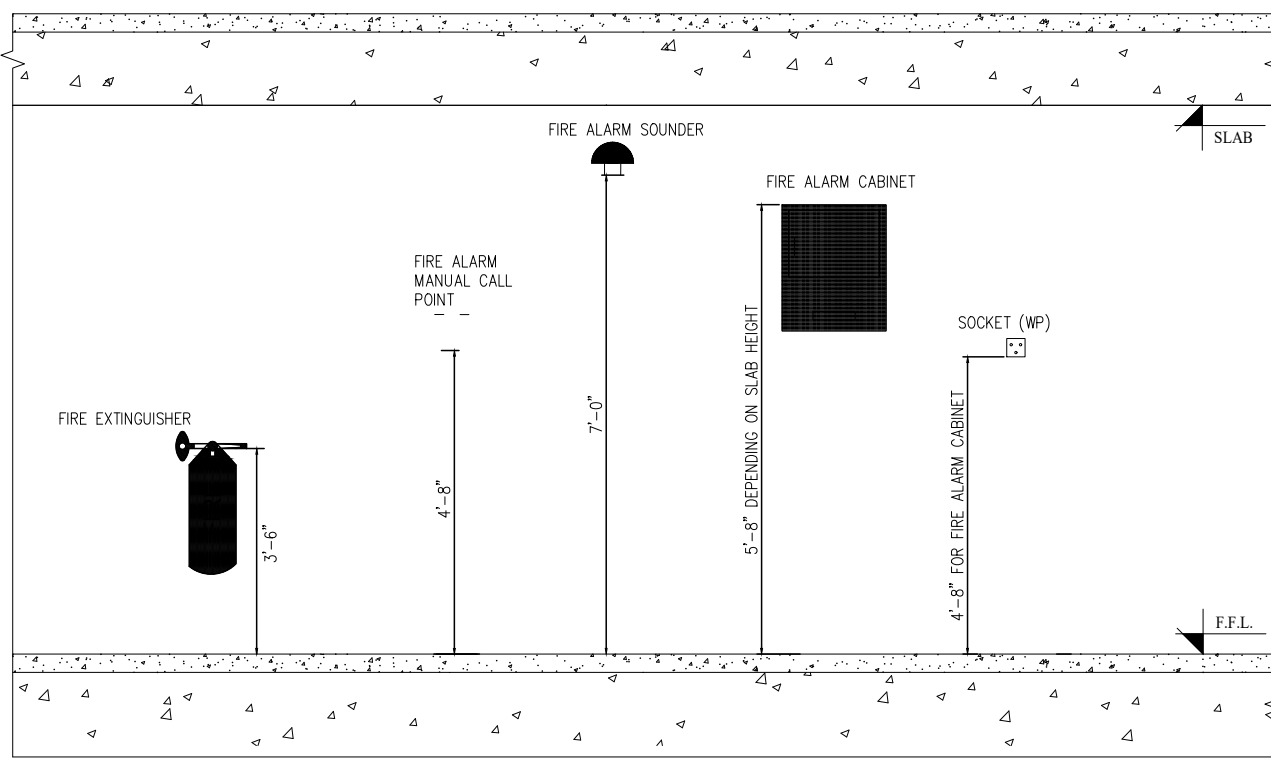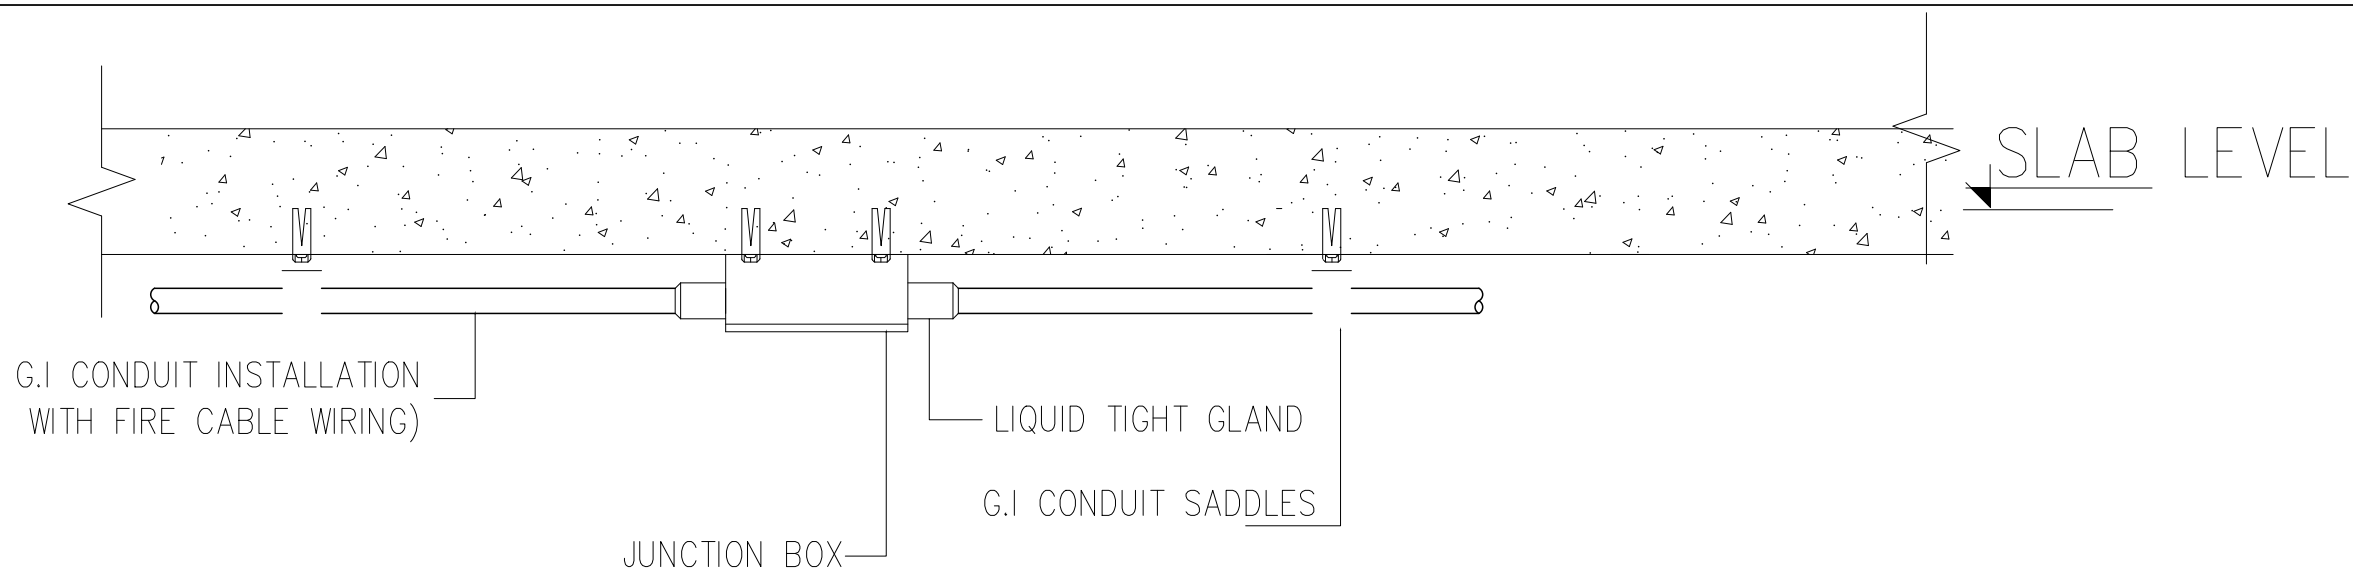

10 EL STANDARD MOUNTING HEIGHT OF FIRE ALARM ACCESSORIES SCALE : N.T.S

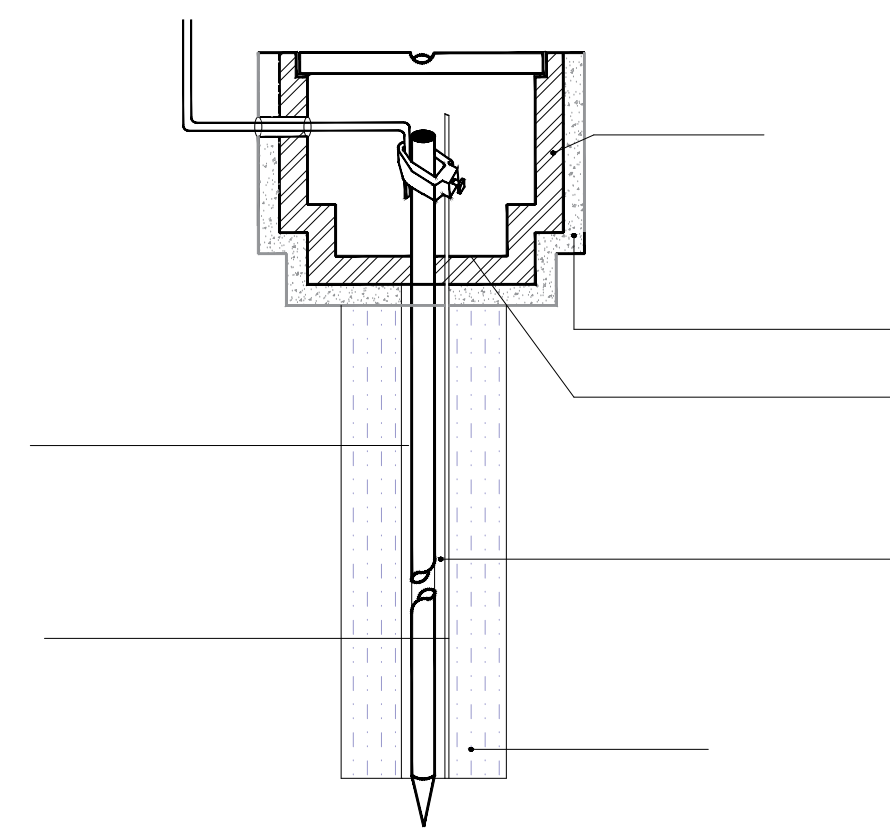

TYPICAL DETAIL OF ROD EARTHING

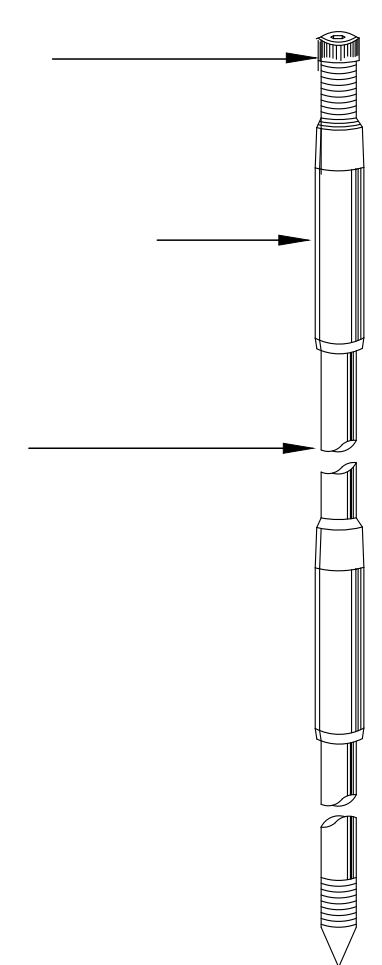

TYPICAL DETAIL OF COPPER ROD

PROJECT NAME.

RESTROOMS  
ASANA PARTNERS

DESIGN  
CONSULTANT.

TSABA CORP  
NADIF BRACEY  
254 CHAPMAN RD,  
STE 208 #13130  
NEWARK, DELAWARE  
19702  
EMAIL:  
INFO@TS9DESIGNS.COM

SITE LOCATION.

1000 MAXWELL LANE  
HOBOKEN, NJ 07030

DISCIPLINE.

TYPICAL DETAILS

| No. | Description | Date |
|-----|-------------|------|
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |

STATE OF NEW JERSEY

MOHAMED SAID MINHOUD

No. GE059074

REGISTERED PROFESSIONAL ENGINEER

Date2-11-2023


Drawn byMJS

Checked byFA

Scale1"=1'-0"

E1-2



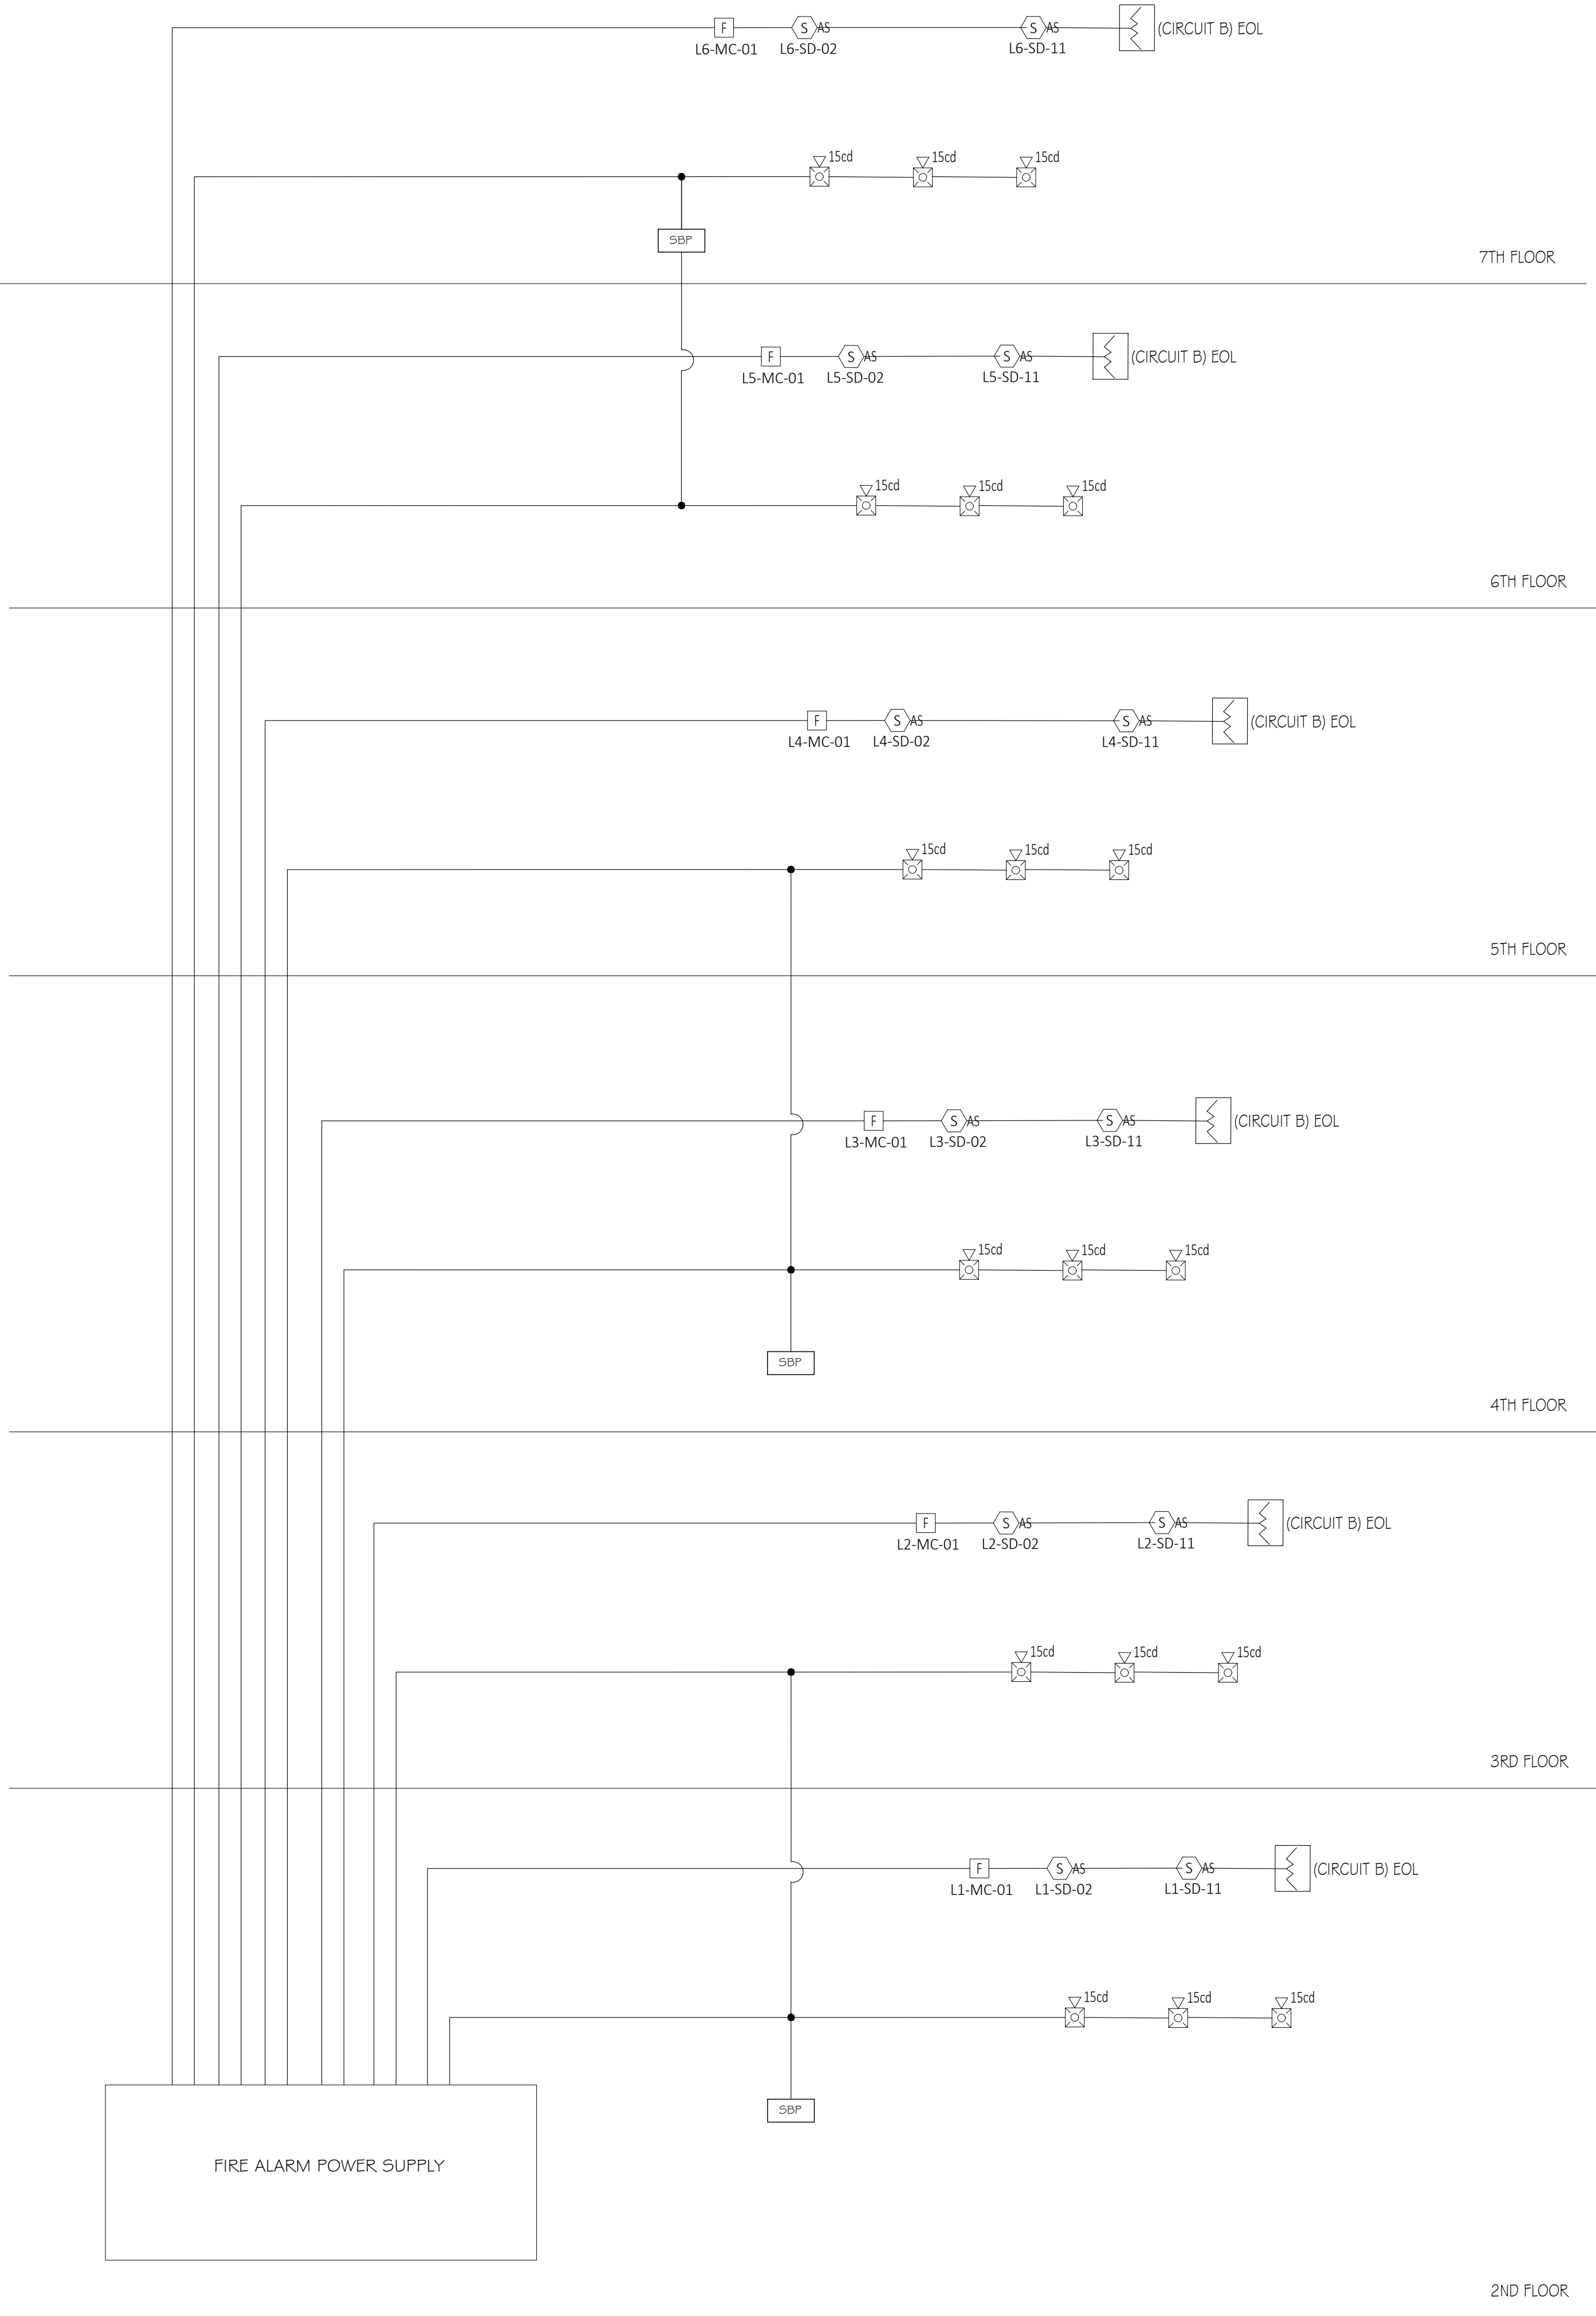

PROJECT NAME.

RESTROOMS  
ASANA PARTNERS

DESIGN  
CONSULTANT.

TSABA CORP  
NADIF BRACEY  
254 CHAPMAN RD,  
STE 208 #13130  
NEWARK, DELAWARE  
19702  
EMAIL:  
INFO@TS9DESIGNS.COM

SITE LOCATION.

1000 MAXWELL LANE  
HOBOKEN, NJ 07030

DISCIPLINE.

POWER SUPPLY

| No. | Description | Date |
|-----|-------------|------|
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |

STATE OF NEW JERSEY

No.

GE059074

PROFESSIONAL ENGINEER

MOHAMED SAID MINOUI

Date

2-11-2023

Drawn by

MJS

Checked by


FA

Scale

$\frac{1}{8}"=1'-0"$

E1-3



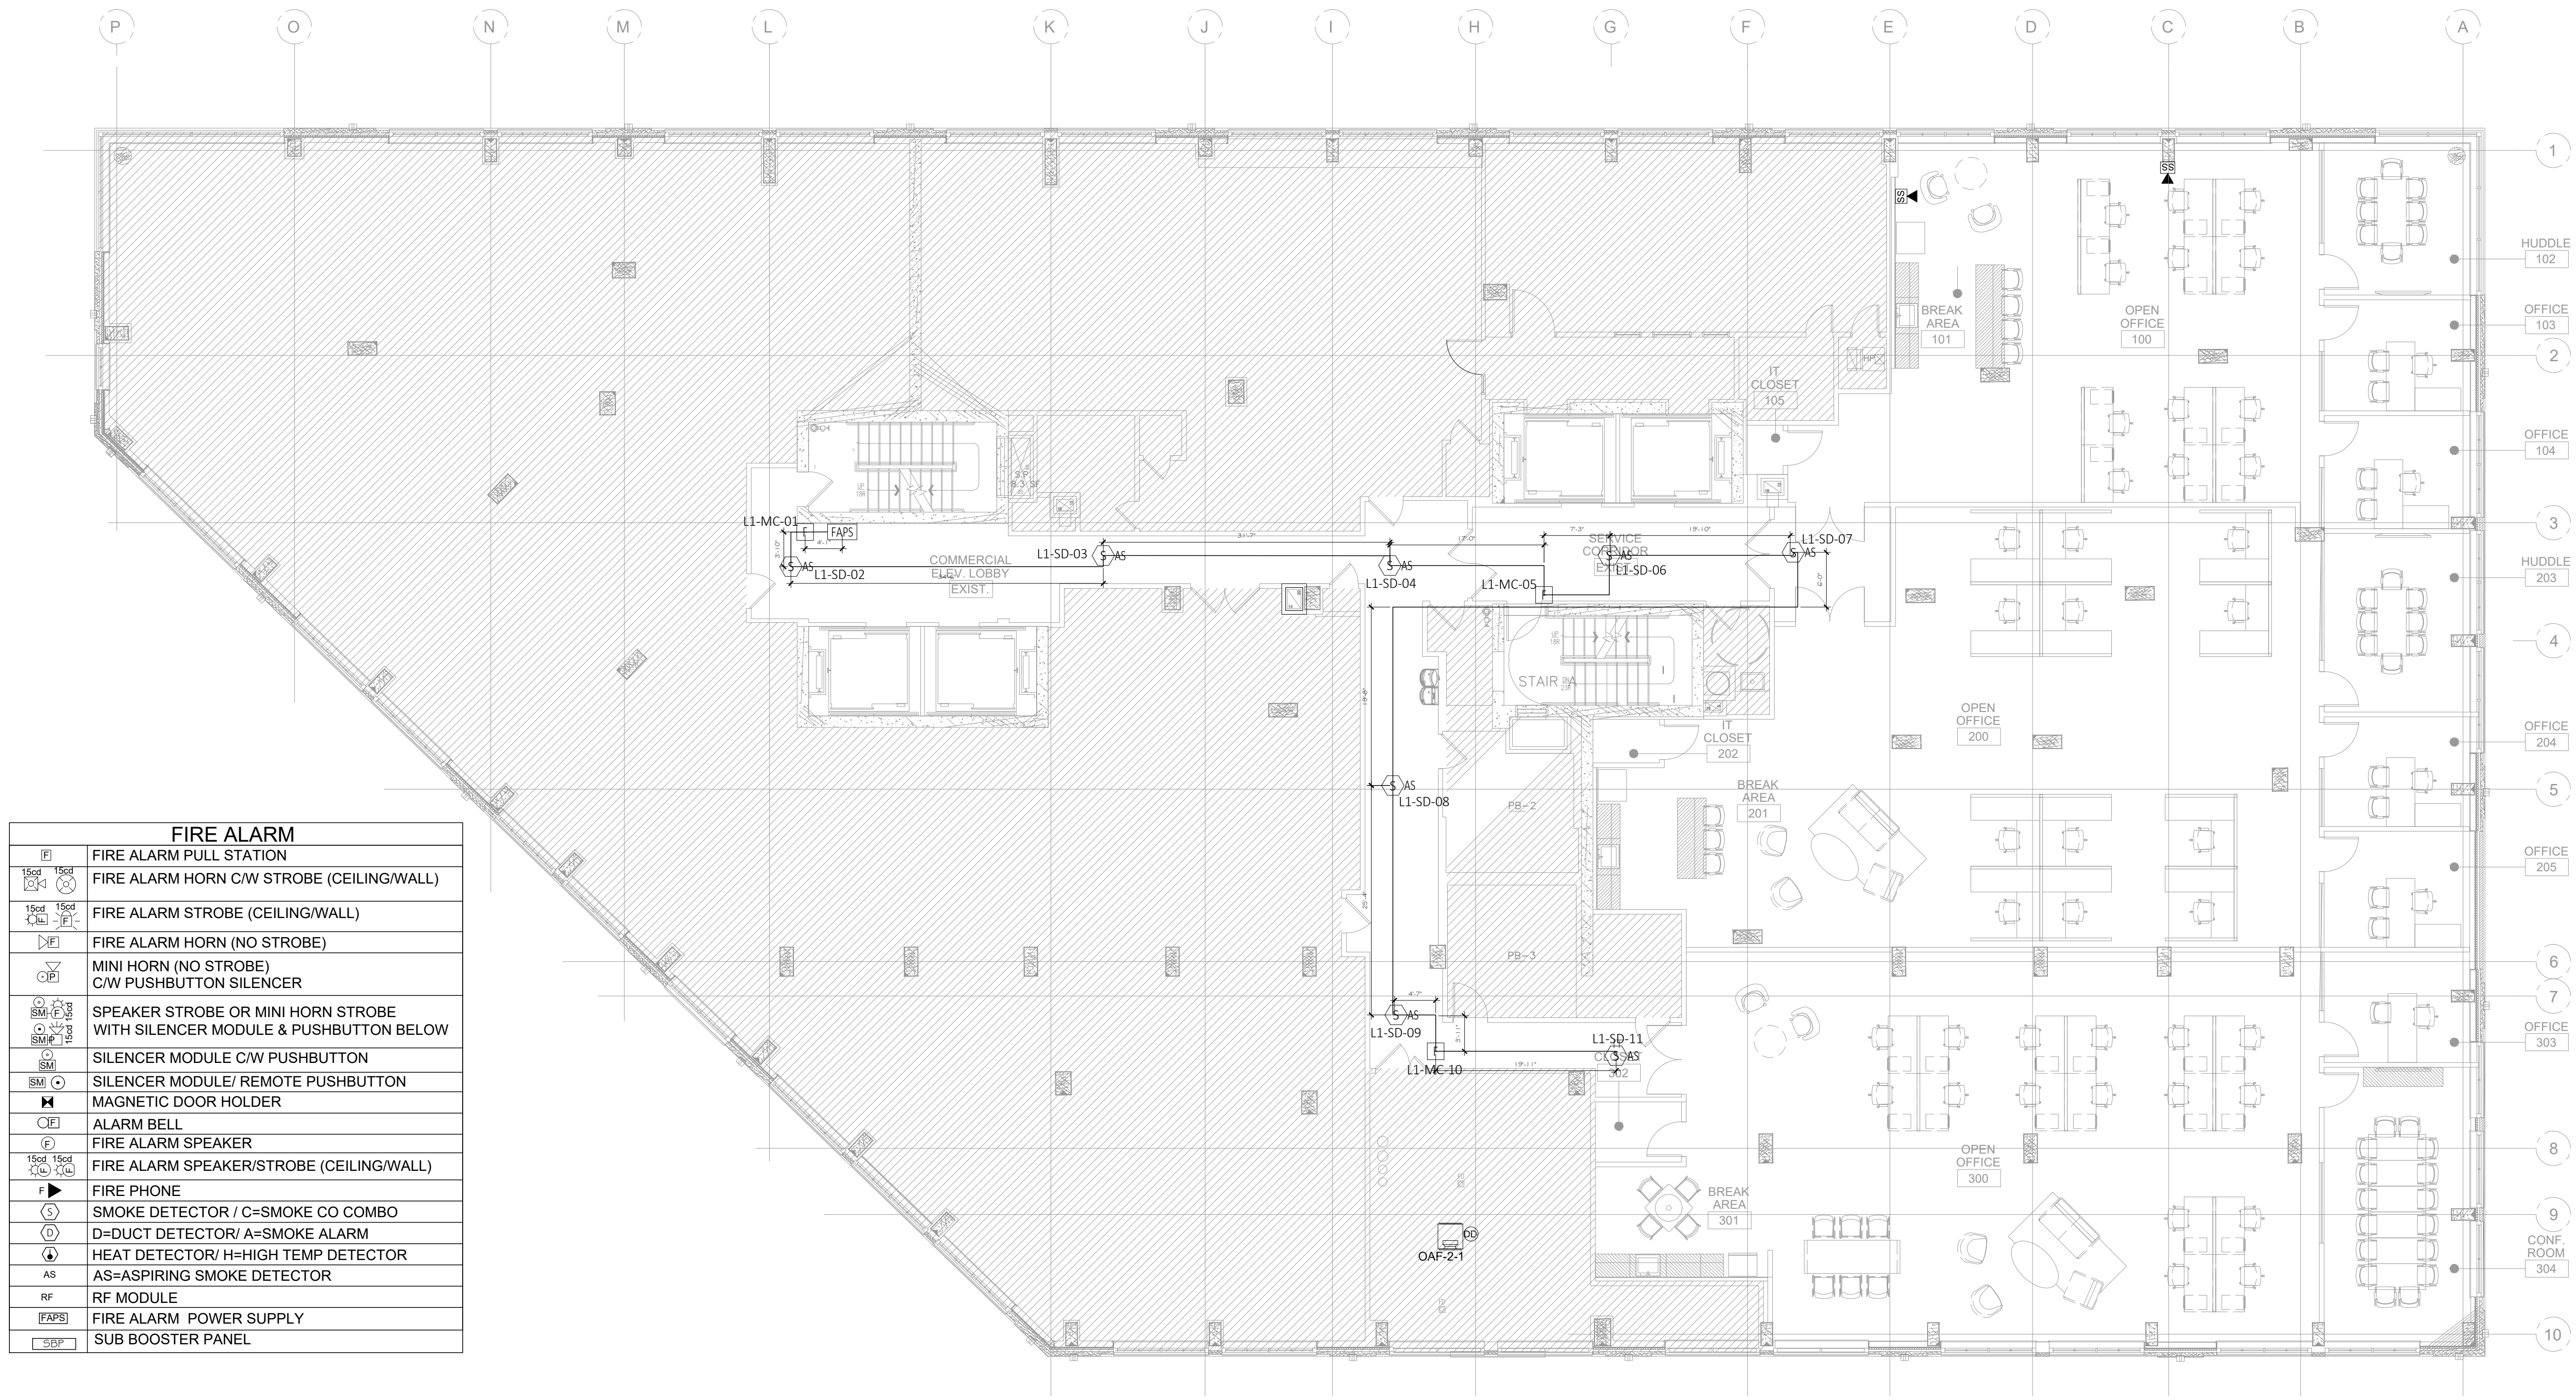

FIRE ALARM 2ND FLOOR PLAN  
SCALE: 3/8" = 1'-0"  
GROUND LEVEL

PROJECT NAME.

RESTROOMS  
ASANA PARTNERS

DESIGN  
CONSULTANT.

TSABA CORP  
NADIF BRACEY  
254 CHAPMAN RD,  
STE 208 #13130  
NEWARK, DELAWARE  
19702  
EMAIL:  
INFO@TS9DESIGNS.COM


SITE LOCATION.

1000 MAXWELL LANE  
HOBOKEN, NJ 07030

DISCIPLINE.

ELECTRICAL  
FIRE ALARM

| No. | Description | Date |
|-----|-------------|------|
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |

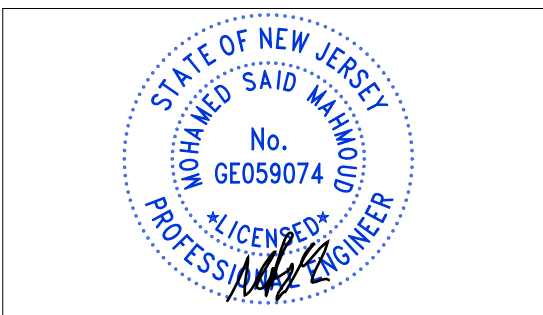


Date 2-11-2023  
Drawn by MJS  
Checked by FA

E1-4

Scale 1/8" = 1'-0"



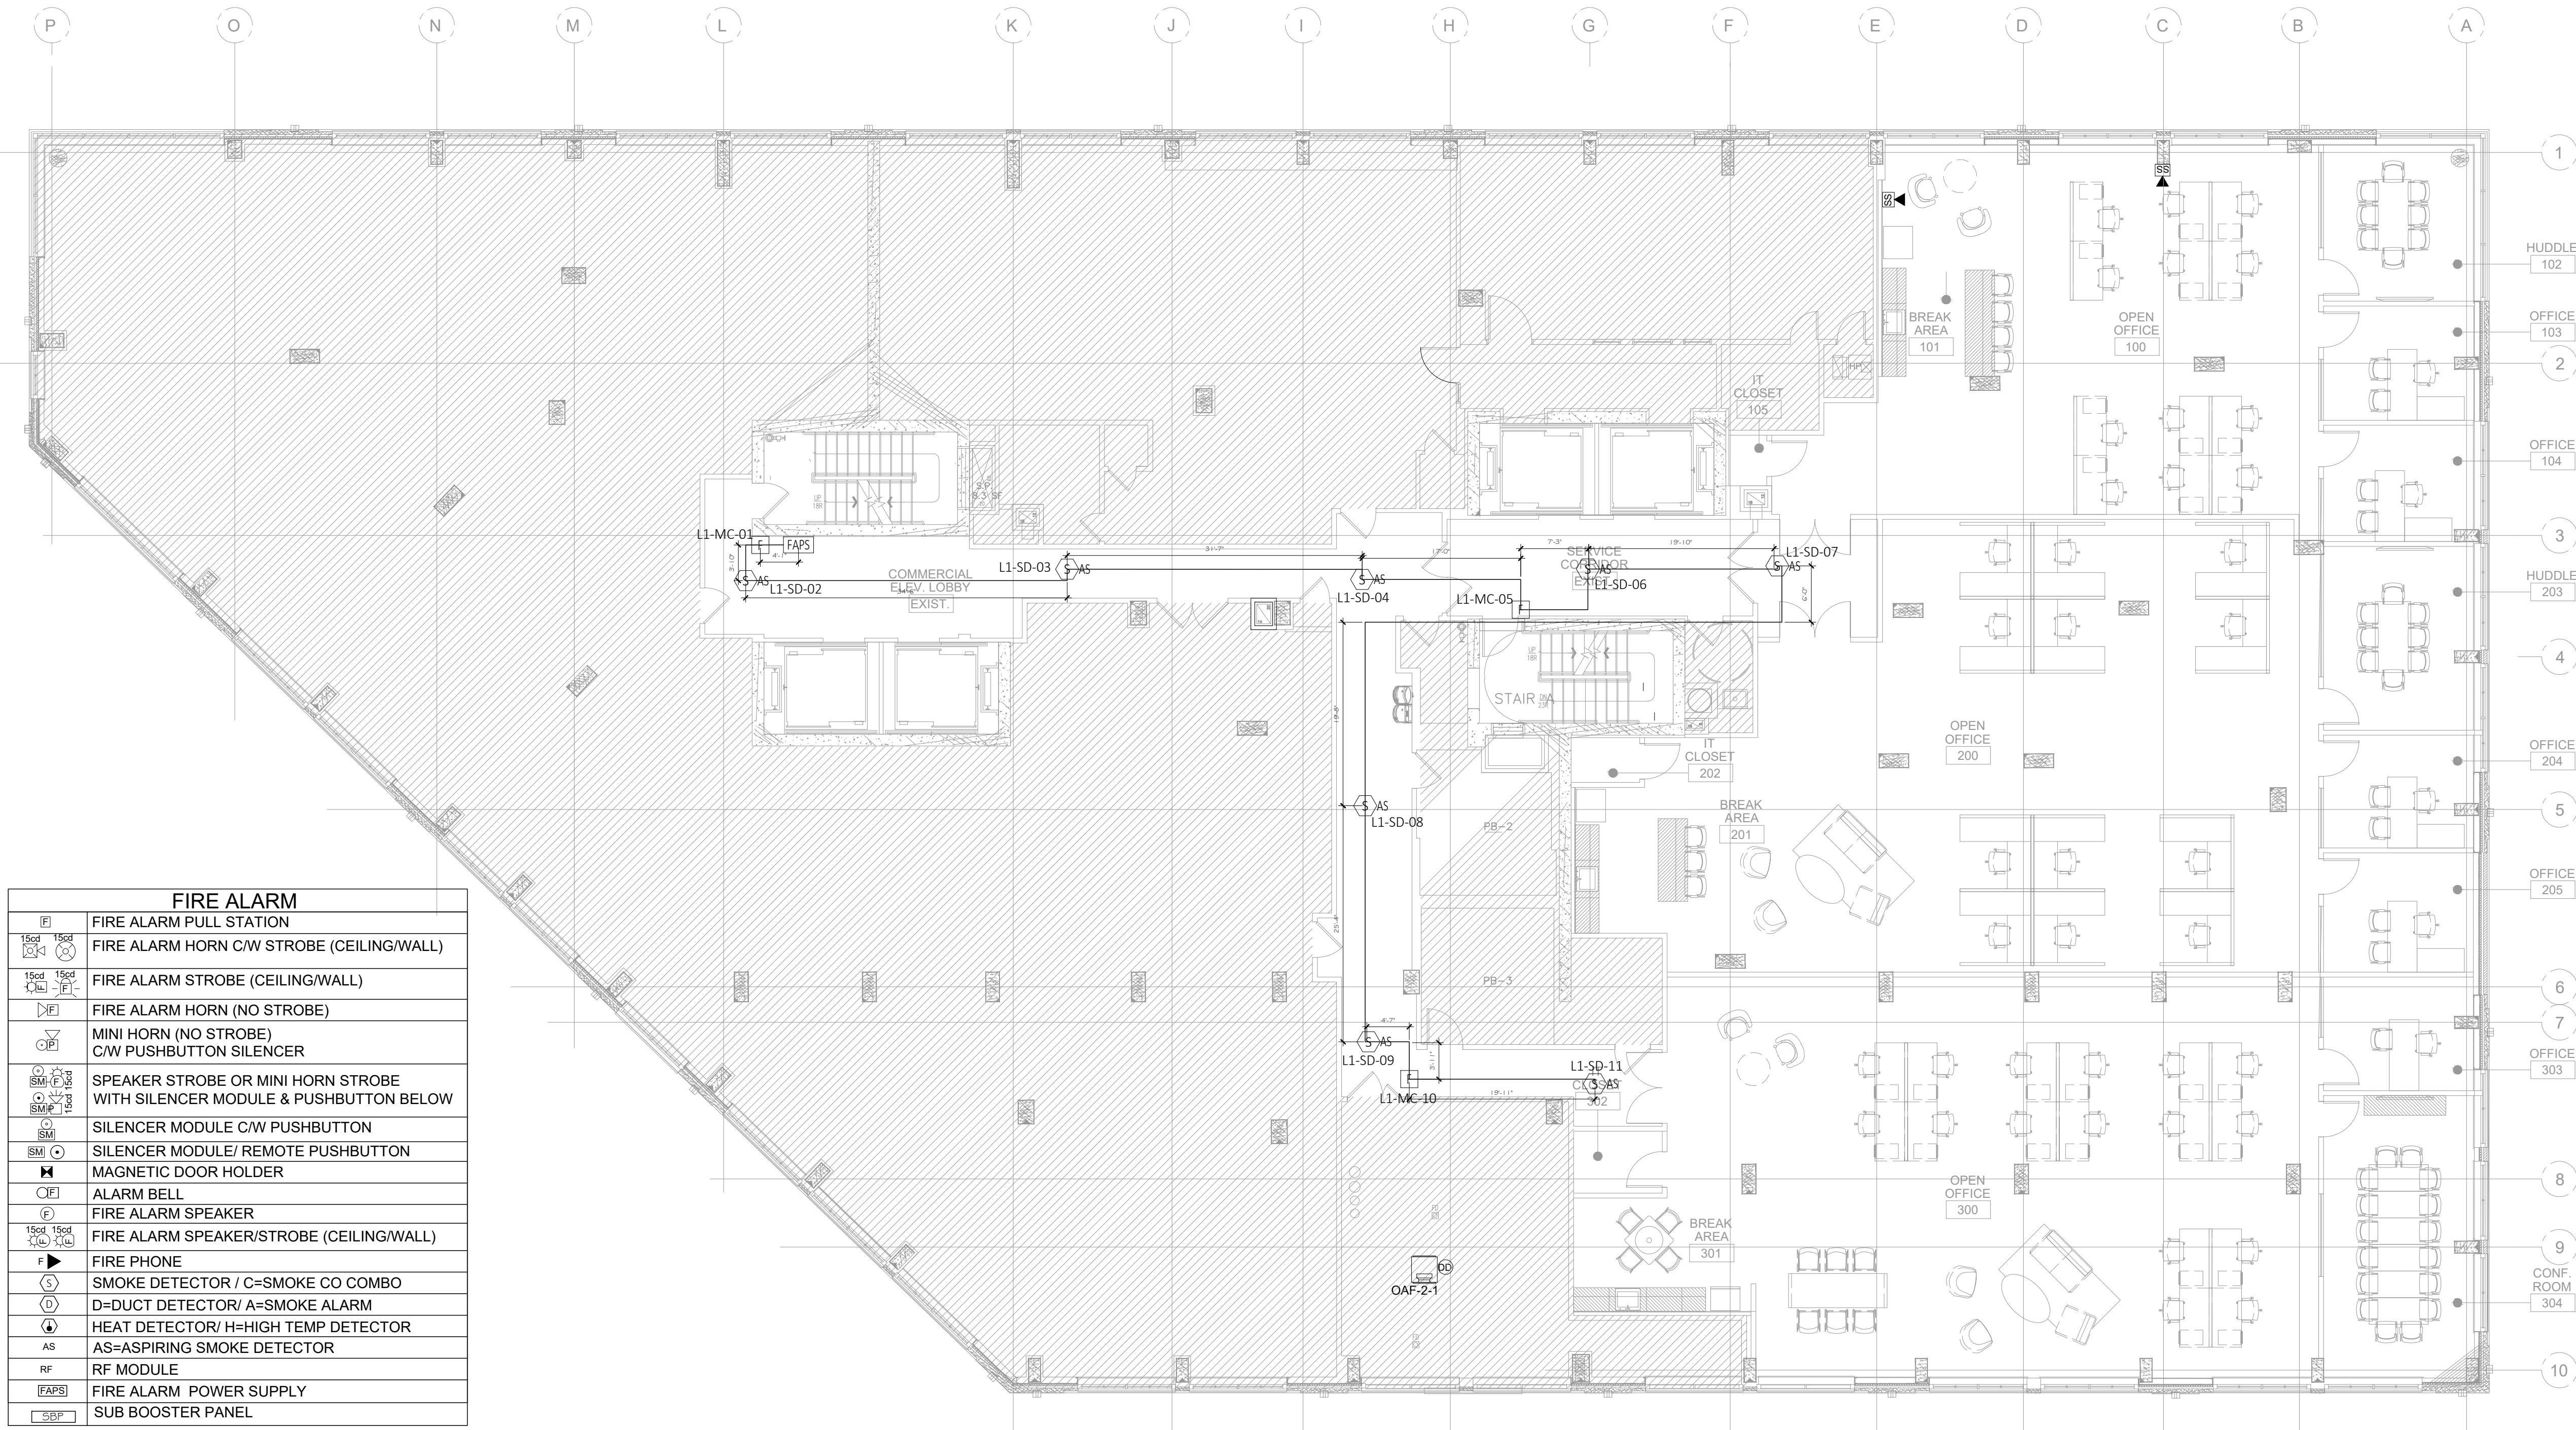

1 FIRE ALARM 2ND FLOOR PLAN  
SCALE: 3/8" = 1'-0" GROUND LEVEL

PROJECT NAME.

RESTROOMS  
ASANA PARTNERS

DESIGN  
CONSULTANT.

TSABA CORP  
NADIF BRACEY  
254 CHAPMAN RD,  
STE 208 #13130  
NEWARK, DELAWARE  
19702  
EMAIL:  
INFO@TS9DESIGNS.COM

SITE LOCATION.

1000 MAXWELL LANE  
HOBOKEN, NJ 07030

DISCIPLINE.

ELECTRICAL  
FIRE ALARM

| No. | Description | Date |
|-----|-------------|------|
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |

STATE OF NEW JERSEY  
MOHAMED SAID MINOUBI  
No.  
GE059074  
LICENSED PROFESSIONAL ENGINEER


Date2-11-2023  
Drawn byMJS  
Checked byFA

E1-5

Scale1/8"=1'-0"



| FIRE ALARM                                                                          |                                                                            |
|-------------------------------------------------------------------------------------|----------------------------------------------------------------------------|
|    | FIRE ALARM PULL STATION                                                    |
|    | FIRE ALARM HORN C/W STROBE (CEILING/WALL)                                  |
|    | FIRE ALARM STROBE (CEILING/WALL)                                           |
|    | FIRE ALARM HORN (NO STROBE)                                                |
|    | MINI HORN (NO STROBE)                                                      |
|    | C/W PUSHBUTTON SILENCER                                                    |
|    | SPEAKER STROBE OR MINI HORN STROBE WITH SILENCER MODULE & PUSHBUTTON BELOW |
|    | SILENCER MODULE C/W PUSHBUTTON                                             |
|    | SILENCER MODULE/ REMOTE PUSHBUTTON                                         |
|    | MAGNETIC DOOR HOLDER                                                       |
|   | ALARM BELL                                                                 |
|  | FIRE ALARM SPEAKER                                                         |
|  | FIRE ALARM SPEAKER/STROBE (CEILING/WALL)                                   |
|  | FIRE PHONE                                                                 |
|  | SMOKE DETECTOR / C=SMOKE CO COMBO                                          |
|  | D=DUCT DETECTOR/ A=SMOKE ALARM                                             |
|  | HEAT DETECTOR/ H=HIGH TEMP DETECTOR                                        |
|  | AS=ASPIRING SMOKE DETECTOR                                                 |
|  | RF MODULE                                                                  |
|  | FIRE ALARM POWER SUPPLY                                                    |
|  | SUB BOOSTER PANEL                                                          |

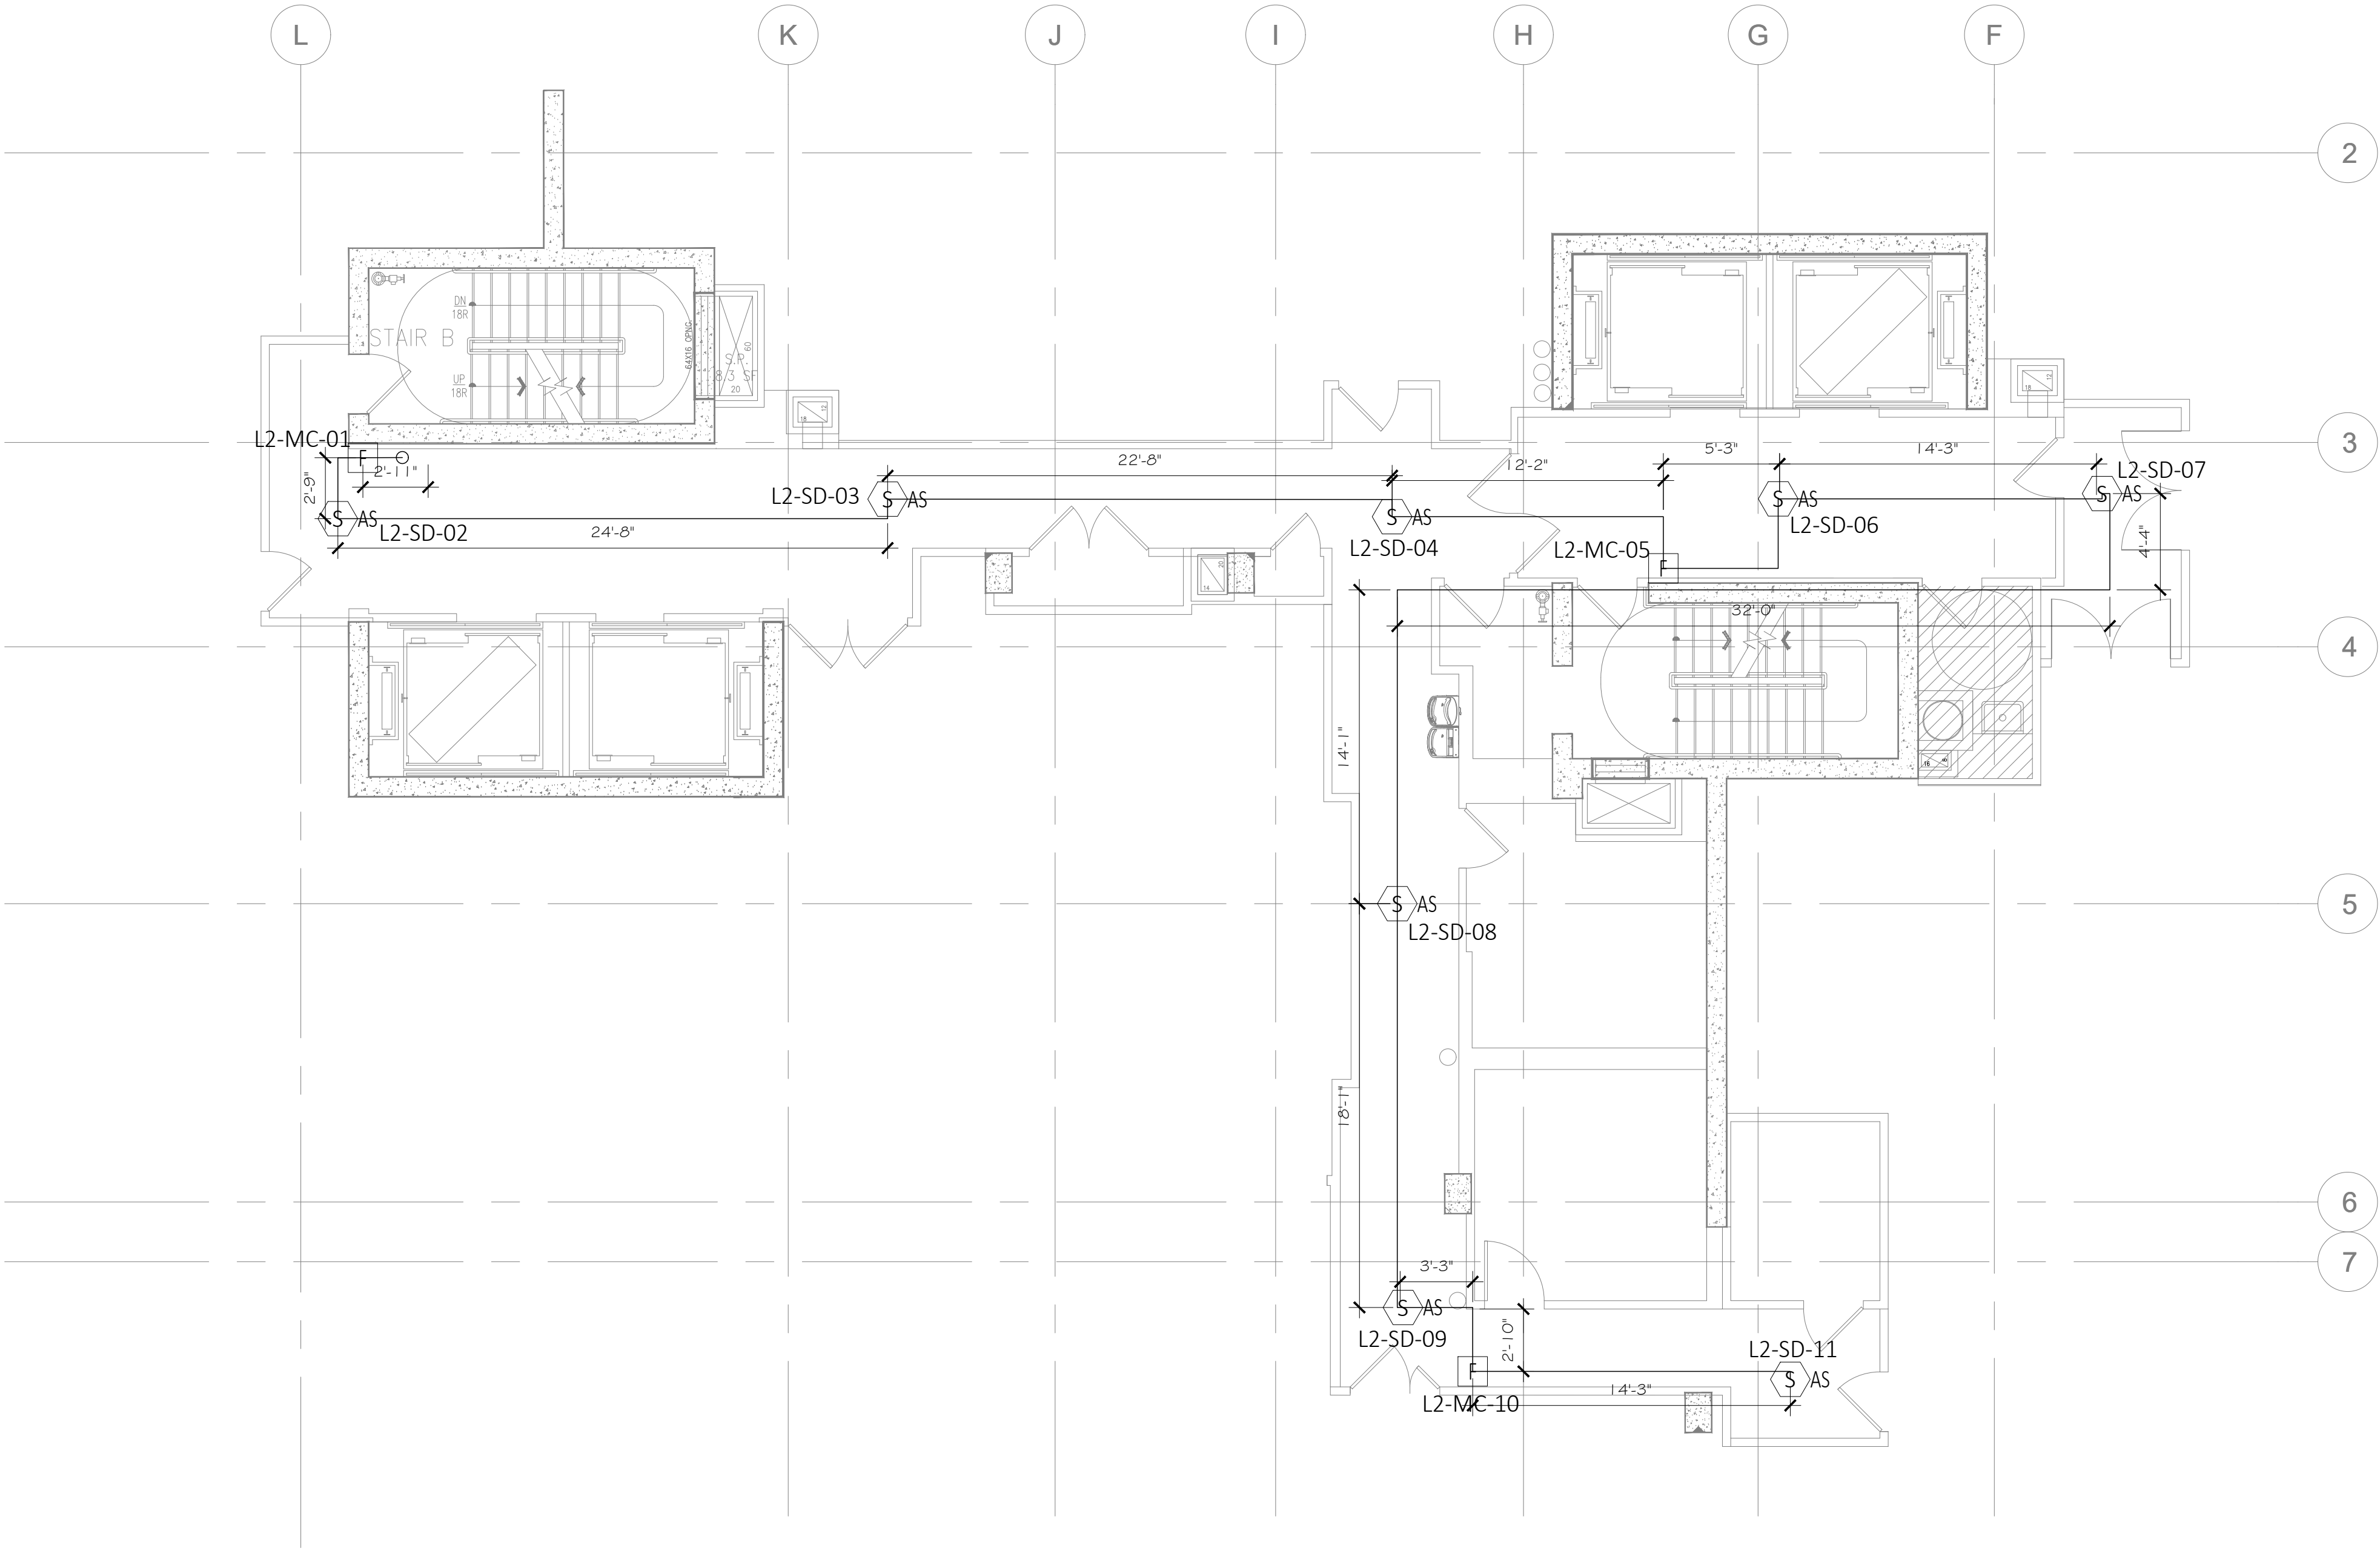

I  
A-2.0  
FIRE ALARM 3RD FLOOR PLAN  
SCALE: 3/16" = 1'-0"  
GROUND LEVEL

PROJECT NAME.

RESTROOMS  
ASANA PARTNERS

DESIGN  
CONSULTANT.

TSABA CORP  
NADIF BRACEY  
254 CHAPMAN RD,  
STE 208 #13130  
NEWARK, DELAWARE  
19702  
EMAIL:  
INFO@TS9DESIGNS.COM

SITE LOCATION.

1000 MAXWELL LANE  
HOBOKEN, NJ 07030

DISCIPLINE.

ELECTRICAL  
FIRE ALARM


| No. | Description | Date |
|-----|-------------|------|
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |



Date 2-11-2023  
Drawn by MJS  
Checked by FA  
**E1-6**  
Scale 1/8"=1'-0"



| FIRE ALARM                                                                          |                                                                            |
|-------------------------------------------------------------------------------------|----------------------------------------------------------------------------|
|    | FIRE ALARM PULL STATION                                                    |
|    | FIRE ALARM HORN C/W STROBE (CEILING/WALL)                                  |
|    | FIRE ALARM STROBE (CEILING/WALL)                                           |
|    | FIRE ALARM HORN (NO STROBE)                                                |
|    | MINI HORN (NO STROBE)                                                      |
|    | C/W PUSHBUTTON SILENCER                                                    |
|    | SPEAKER STROBE OR MINI HORN STROBE WITH SILENCER MODULE & PUSHBUTTON BELOW |
|    | SILENCER MODULE C/W PUSHBUTTON                                             |
|    | SILENCER MODULE/ REMOTE PUSHBUTTON                                         |
|    | MAGNETIC DOOR HOLDER                                                       |
|   | ALARM BELL                                                                 |
|  | FIRE ALARM SPEAKER                                                         |
|  | FIRE ALARM SPEAKER/STROBE (CEILING/WALL)                                   |
|  | FIRE PHONE                                                                 |
|  | SMOKE DETECTOR / C=SMOKE CO COMBO                                          |
|  | D=DUCT DETECTOR/ A=SMOKE ALARM                                             |
|  | HEAT DETECTOR/ H=HIGH TEMP DETECTOR                                        |
|  | AS=ASPIRING SMOKE DETECTOR                                                 |
|  | RF MODULE                                                                  |
|  | FIRE ALARM POWER SUPPLY                                                    |
|  | SUB BOOSTER PANEL                                                          |

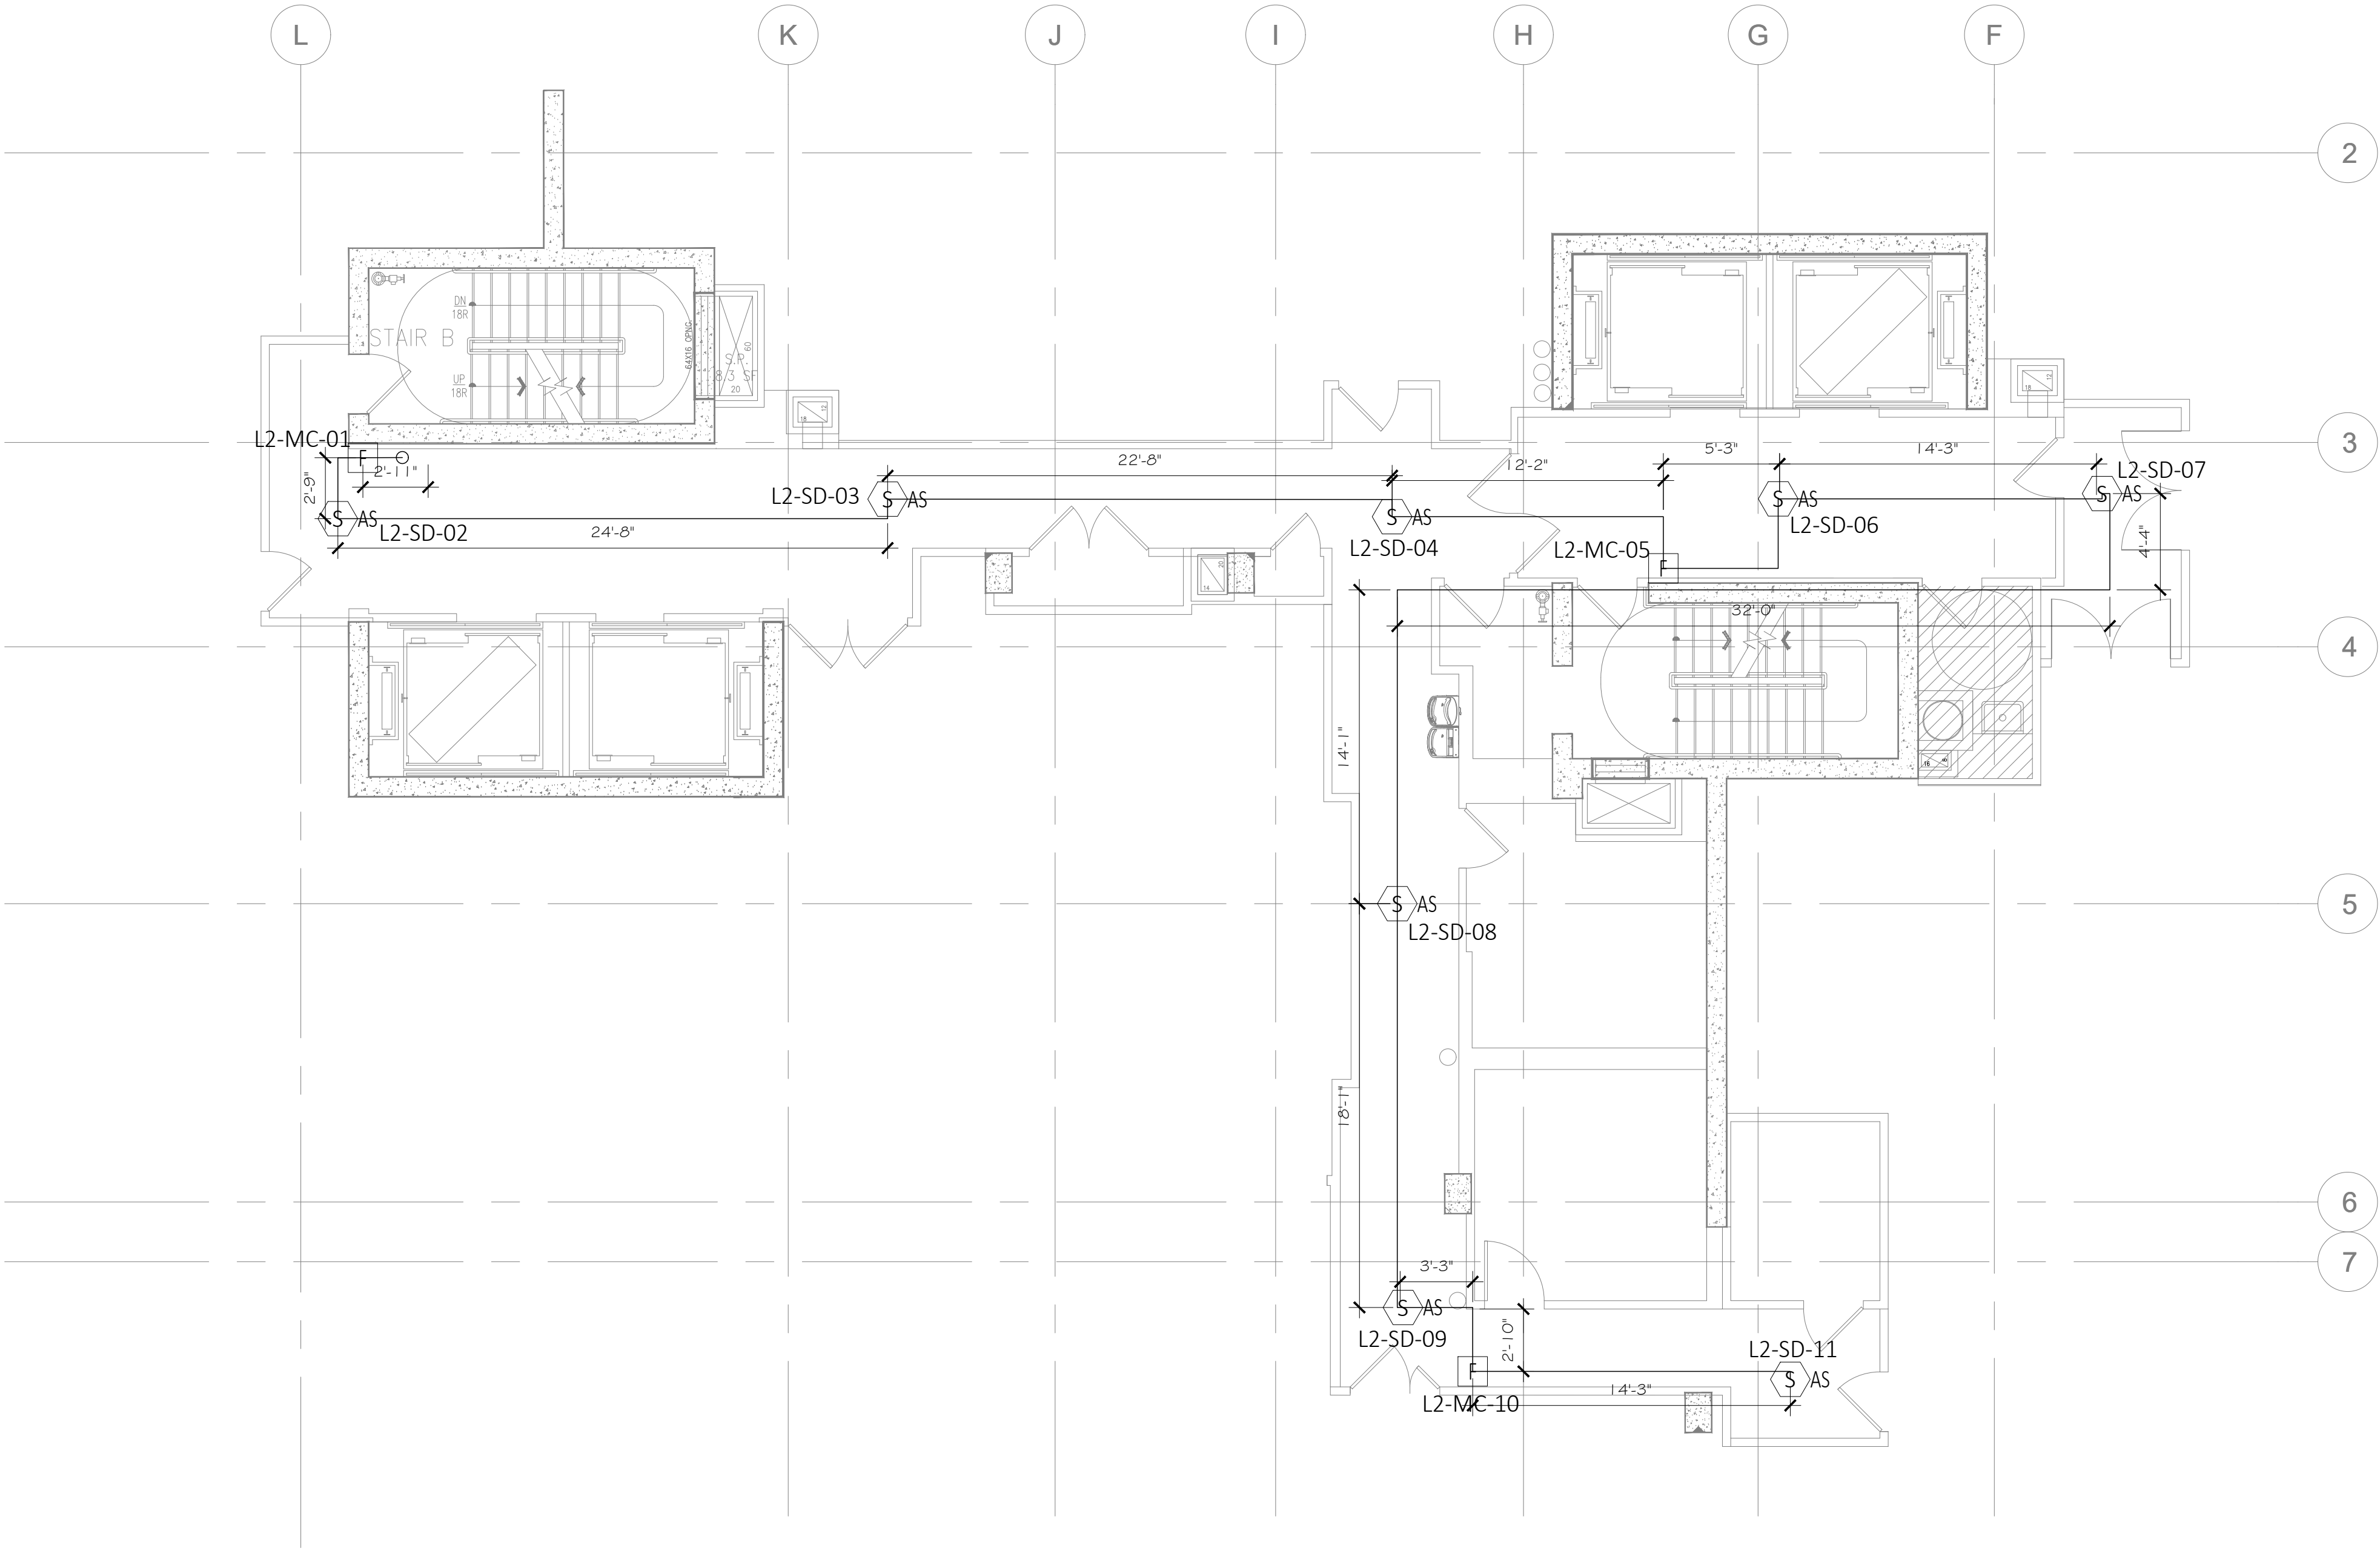

I  
A-2.0  
FIRE ALARM 3RD FLOOR PLAN  
SCALE: 3/8" = 1'-0" GROUND LEVEL

PROJECT NAME.

RESTROOMS  
ASANA PARTNERS

DESIGN  
CONSULTANT.

TSABA CORP  
NADIF BRACEY  
254 CHAPMAN RD,  
STE 208 #13130  
NEWARK, DELAWARE  
19702  
EMAIL:  
INFO@TS9DESIGNS.COM

SITE LOCATION.

1000 MAXWELL LANE  
HOBOKEN, NJ 07030

DISCIPLINE.

ELECTRICAL  
FIRE ALARM

| No. | Description | Date |
|-----|-------------|------|
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |

STATE OF NEW JERSEY  
MOHAMED SAID MINOUD  
No.  
GE059074  
LICENSED PROFESSIONAL ENGINEER




















Date2-11-2023  
Drawn byMJS  
Checked byFA

E1-7

Scale1"=1'-0"



| FIRE ALARM                                                                          |                                                                            |
|-------------------------------------------------------------------------------------|----------------------------------------------------------------------------|
|    | FIRE ALARM PULL STATION                                                    |
|    | FIRE ALARM HORN C/W STROBE (CEILING/WALL)                                  |
|    | FIRE ALARM STROBE (CEILING/WALL)                                           |
|   | FIRE ALARM HORN (NO STROBE)                                                |
|  | MINI HORN (NO STROBE)                                                      |
|  | C/W PUSHBUTTON SILENCER                                                    |
|  | SPEAKER STROBE OR MINI HORN STROBE WITH SILENCER MODULE & PUSHBUTTON BELOW |
|  | SILENCER MODULE C/W PUSHBUTTON                                             |
|  | SILENCER MODULE/ REMOTE PUSHBUTTON                                         |
|  | MAGNETIC DOOR HOLDER                                                       |
|  | ALARM BELL                                                                 |
|  | FIRE ALARM SPEAKER                                                         |
|  | FIRE ALARM SPEAKER/STROBE (CEILING/WALL)                                   |
|  | FIRE PHONE                                                                 |
|  | SMOKE DETECTOR / C=SMOKE CO COMBO                                          |
|  | D=DUCT DETECTOR/ A=SMOKE ALARM                                             |
|  | HEAT DETECTOR/ H=HIGH TEMP DETECTOR                                        |
|  | AS=ASPIRING SMOKE DETECTOR                                                 |
|  | RF MODULE                                                                  |
|  | FIRE ALARM POWER SUPPLY                                                    |
|  | SUB BOOSTER PANEL                                                          |

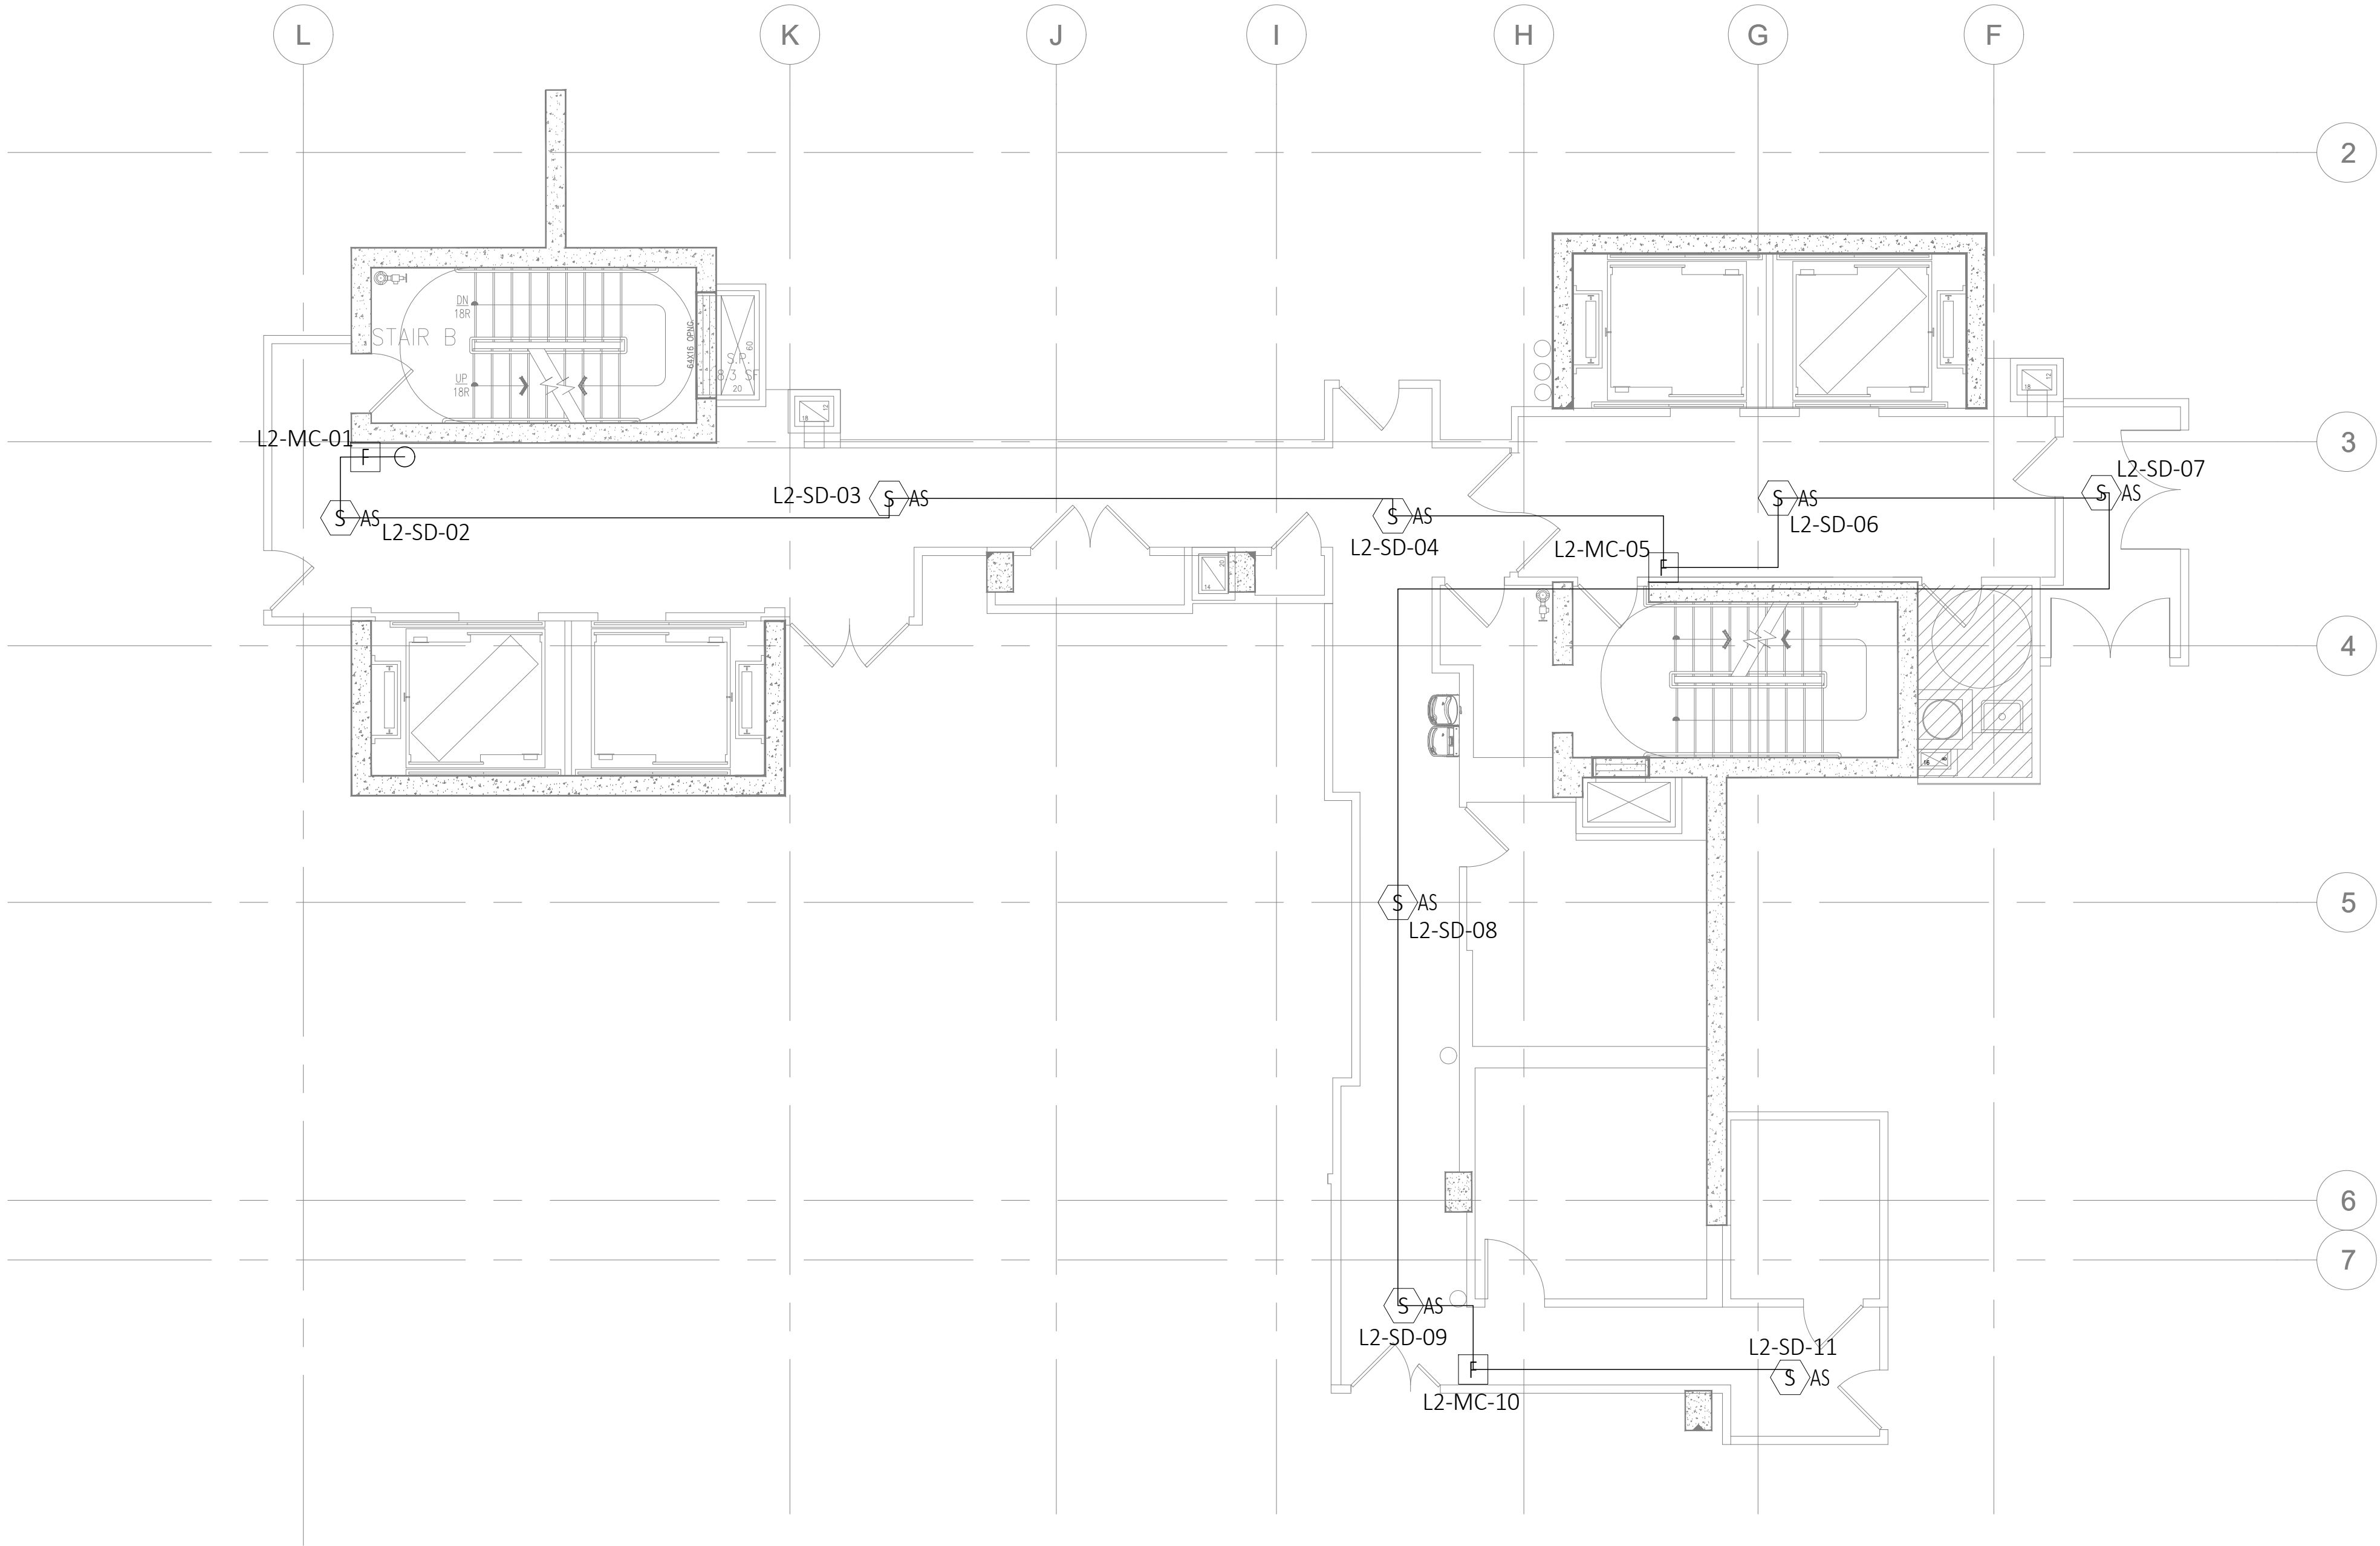

I  
A-2.0

FIRE ALARM 3RD FLOOR PLAN

SCALE: 3/16" = 1'-0"

GROUND LEVEL

PROJECT NAME.

RESTROOMS  
ASANA PARTNERS

DESIGN  
CONSULTANT.

TSABA CORP  
NADIF BRACEY  
254 CHAPMAN RD,  
STE 208 #13130  
NEWARK, DELAWARE  
19702  
EMAIL:  
INFO@TS9DESIGNS.COM

SITE LOCATION.

1000 MAXWELL LANE  
HOBOKEN, NJ 07030

DISCIPLINE.


ELECTRICAL  
FIRE ALARM

| No. | Description | Date |
|-----|-------------|------|
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |

|                                                                                       |            |
|---------------------------------------------------------------------------------------|------------|
|  |            |
| Date                                                                                  | 2-11-2023  |
| Drawn by                                                                              | MJS        |
| Checked by                                                                            | FA         |
| <b>E1-8</b>                                                                           |            |
| Scale                                                                                 | 1/8"=1'-0" |



| FIRE ALARM                                                                          |                                                                               |
|-------------------------------------------------------------------------------------|-------------------------------------------------------------------------------|
|    | FIRE ALARM PULL STATION                                                       |
|    | FIRE ALARM HORN C/W STROBE (CEILING/WALL)                                     |
|    | FIRE ALARM STROBE (CEILING/WALL)                                              |
|    | FIRE ALARM HORN (NO STROBE)                                                   |
|    | MINI HORN (NO STROBE)<br>C/W PUSHBUTTON SILENCER                              |
|    | SPEAKER STROBE OR MINI HORN STROBE<br>WITH SILENCER MODULE & PUSHBUTTON BELOW |
|    | SILENCER MODULE C/W PUSHBUTTON                                                |
|   | SILENCER MODULE/ REMOTE PUSHBUTTON                                            |
|  | MAGNETIC DOOR HOLDER                                                          |
|  | ALARM BELL                                                                    |
|  | FIRE ALARM SPEAKER                                                            |
|  | FIRE ALARM SPEAKER/STROBE (CEILING/WALL)                                      |
|  | FIRE PHONE                                                                    |
|  | SMOKE DETECTOR / C=SMOKE CO COMBO                                             |
|  | D=DUCT DETECTOR/ A=SMOKE ALARM                                                |
|  | HEAT DETECTOR/ H=HIGH TEMP DETECTOR                                           |
|  | AS=ASPIRING SMOKE DETECTOR                                                    |
|  | RF MODULE                                                                     |
|  | FIRE ALARM POWER SUPPLY                                                       |
|  | SUB BOOSTER PANEL                                                             |

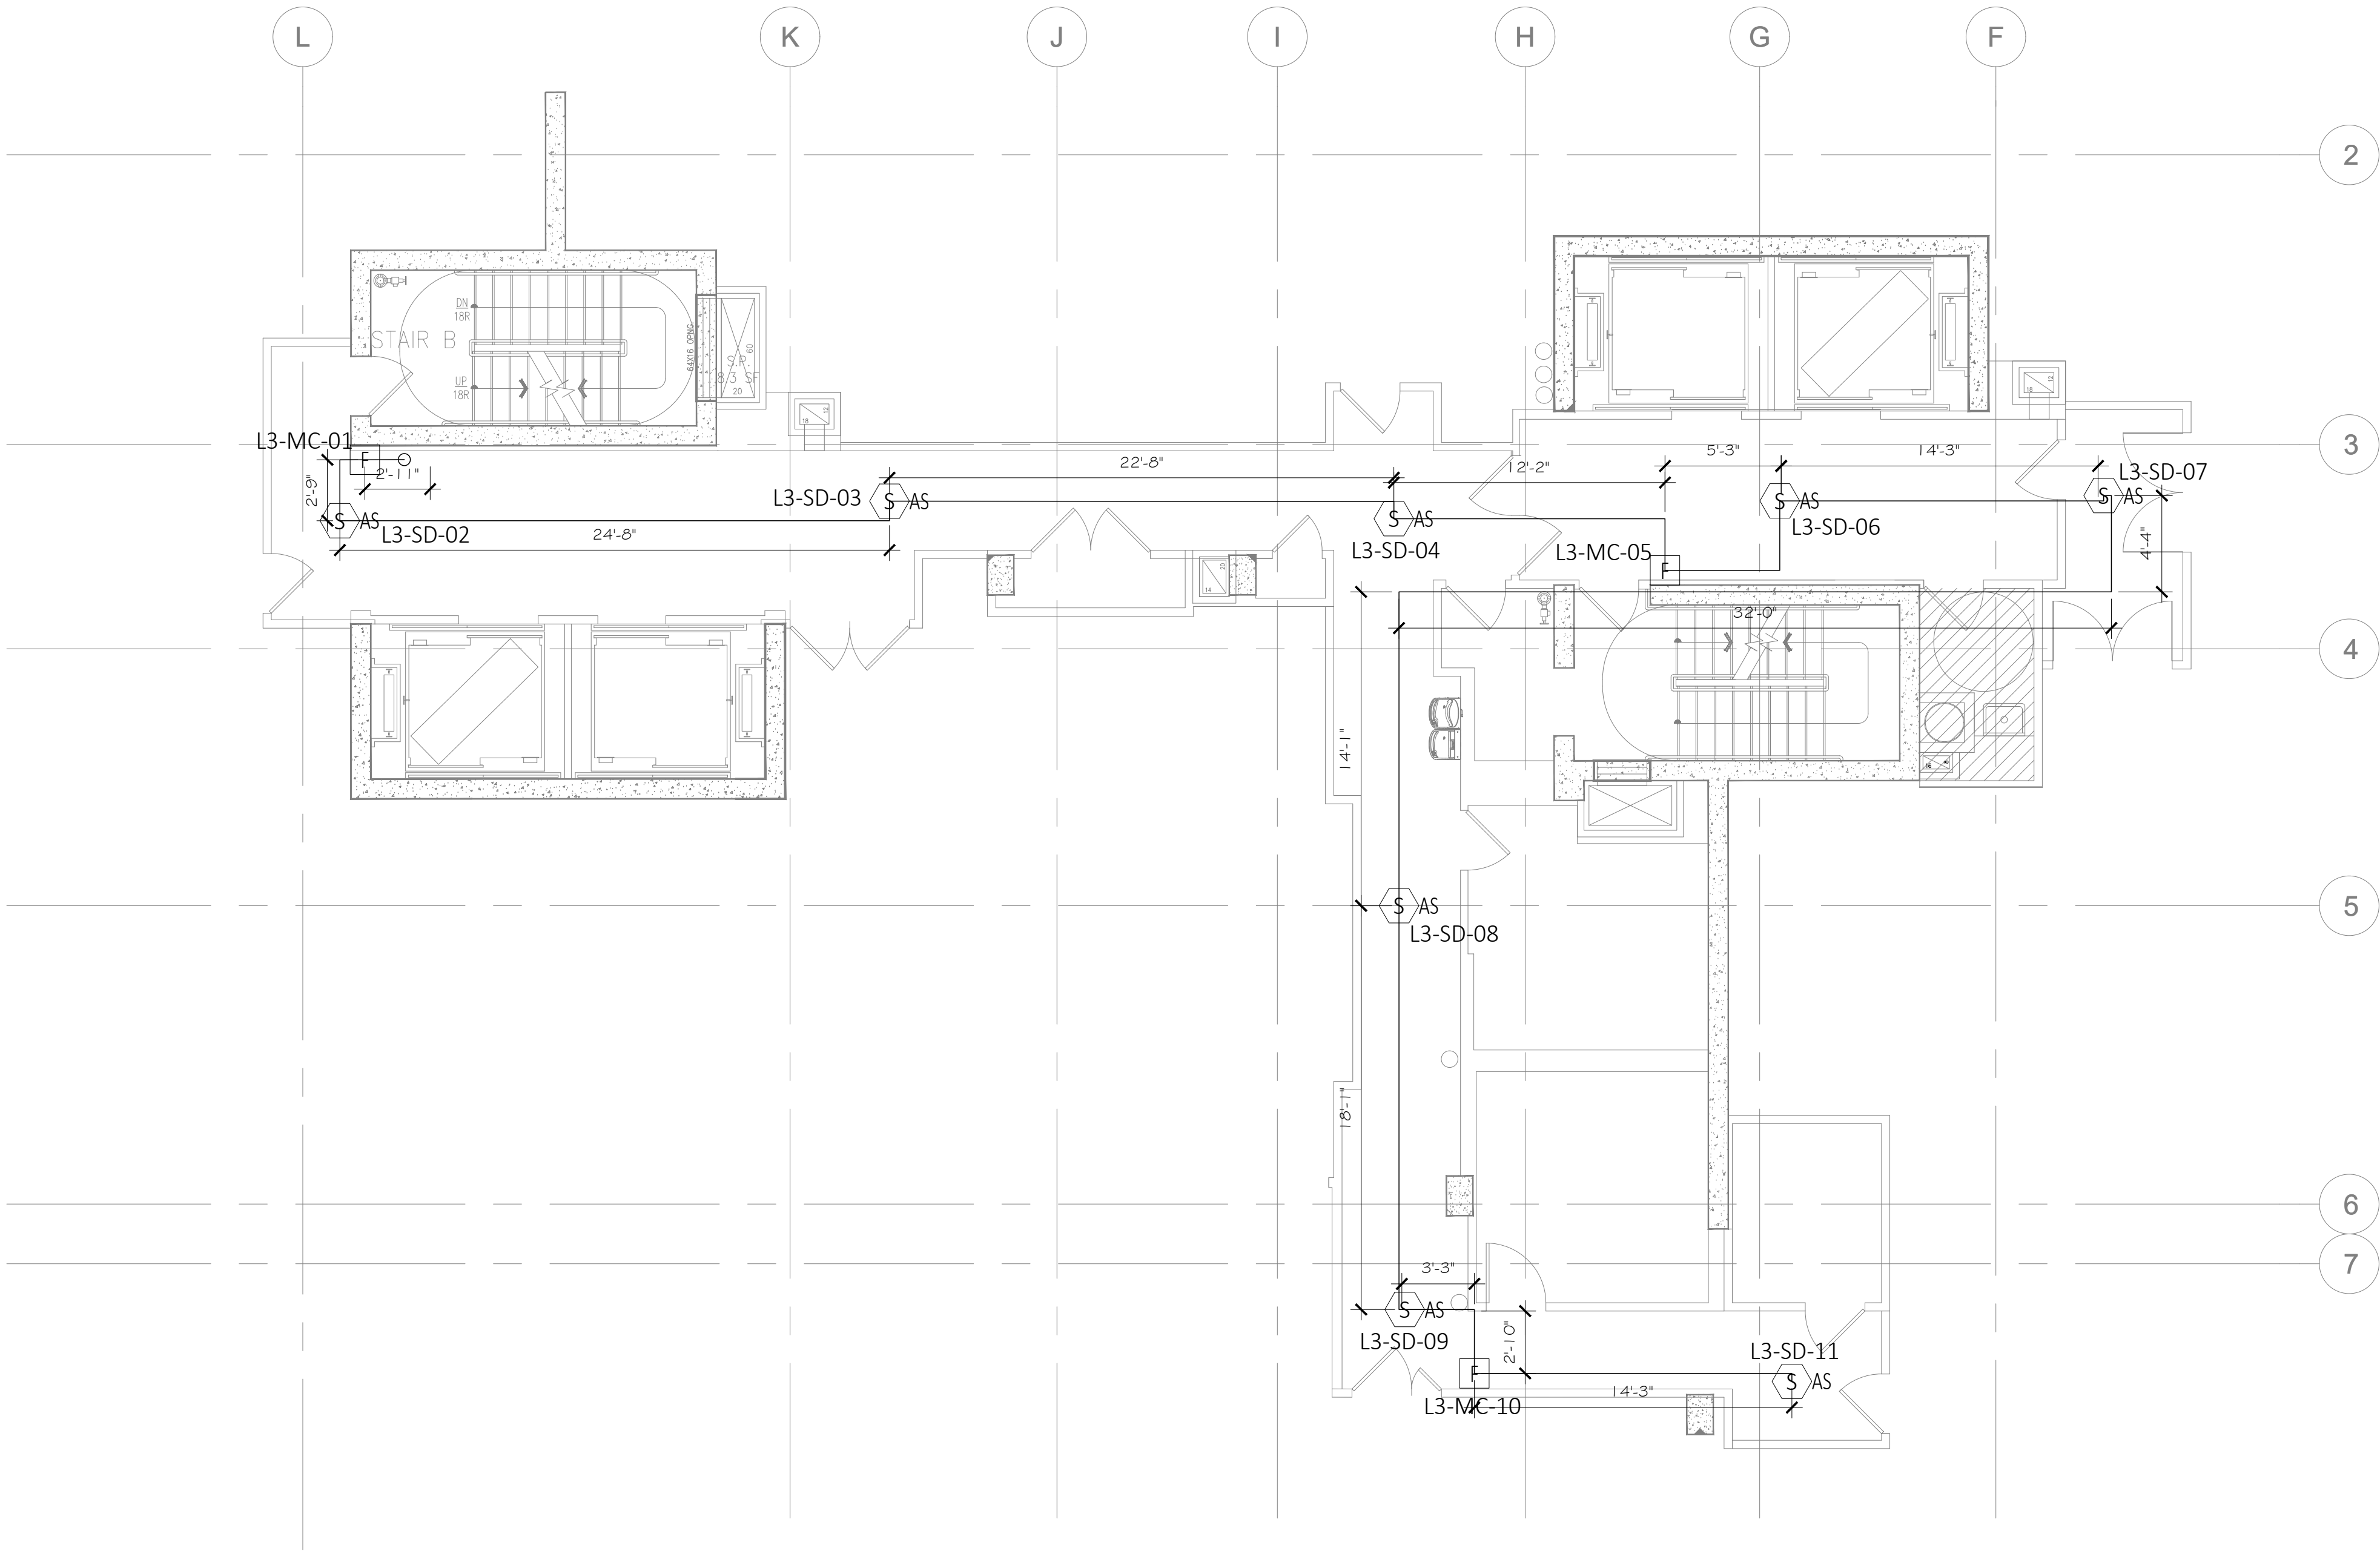

1  
A-2.0

FIRE ALARM 4TH FLOOR PLAN

SCALE: 3/16" = 1'-0"

GROUND LEVEL

PROJECT NAME.

RESTROOMS  
ASANA PARTNERS

DESIGN  
CONSULTANT.

TSABA CORP  
NADIF BRACEY  
254 CHAPMAN RD,  
STE 208 #13130  
NEWARK, DELAWARE  
19702  
EMAIL:  
INFO@TS9DESIGNS.COM


SITE LOCATION.

1000 MAXWELL LANE  
HOBOKEN, NJ 07030

DISCIPLINE.

ELECTRICAL  
FIRE ALARM

| No. | Description | Date |
|-----|-------------|------|
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |

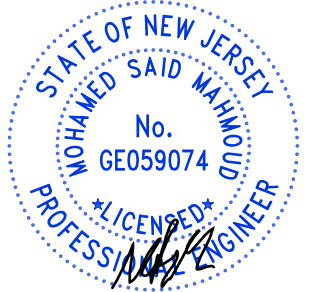


Date 2-11-2023  
Drawn by MJS  
Checked by FA

**E1-9**

Scale 1/8"=1'-0"



| FIRE ALARM                                                                          |                                                                            |
|-------------------------------------------------------------------------------------|----------------------------------------------------------------------------|
|    | FIRE ALARM PULL STATION                                                    |
|    | FIRE ALARM HORN C/W STROBE (CEILING/WALL)                                  |
|    | FIRE ALARM STROBE (CEILING/WALL)                                           |
|    | FIRE ALARM HORN (NO STROBE)                                                |
|   | MINI HORN (NO STROBE)                                                      |
|  | C/W PUSHBUTTON SILENCER                                                    |
|  | SPEAKER STROBE OR MINI HORN STROBE WITH SILENCER MODULE & PUSHBUTTON BELOW |
|  | SILENCER MODULE C/W PUSHBUTTON                                             |
|  | SILENCER MODULE/ REMOTE PUSHBUTTON                                         |
|  | MAGNETIC DOOR HOLDER                                                       |
|  | ALARM BELL                                                                 |
|  | FIRE ALARM SPEAKER                                                         |
|  | FIRE ALARM SPEAKER/STROBE (CEILING/WALL)                                   |
|  | FIRE PHONE                                                                 |
|  | SMOKE DETECTOR / C=SMOKE CO COMBO                                          |
|  | D=DUCT DETECTOR/ A=SMOKE ALARM                                             |
|  | HEAT DETECTOR/ H=HIGH TEMP DETECTOR                                        |
|  | AS=ASPIRING SMOKE DETECTOR                                                 |
|  | RF MODULE                                                                  |
|  | FIRE ALARM POWER SUPPLY                                                    |
|  | SUB BOOSTER PANEL                                                          |

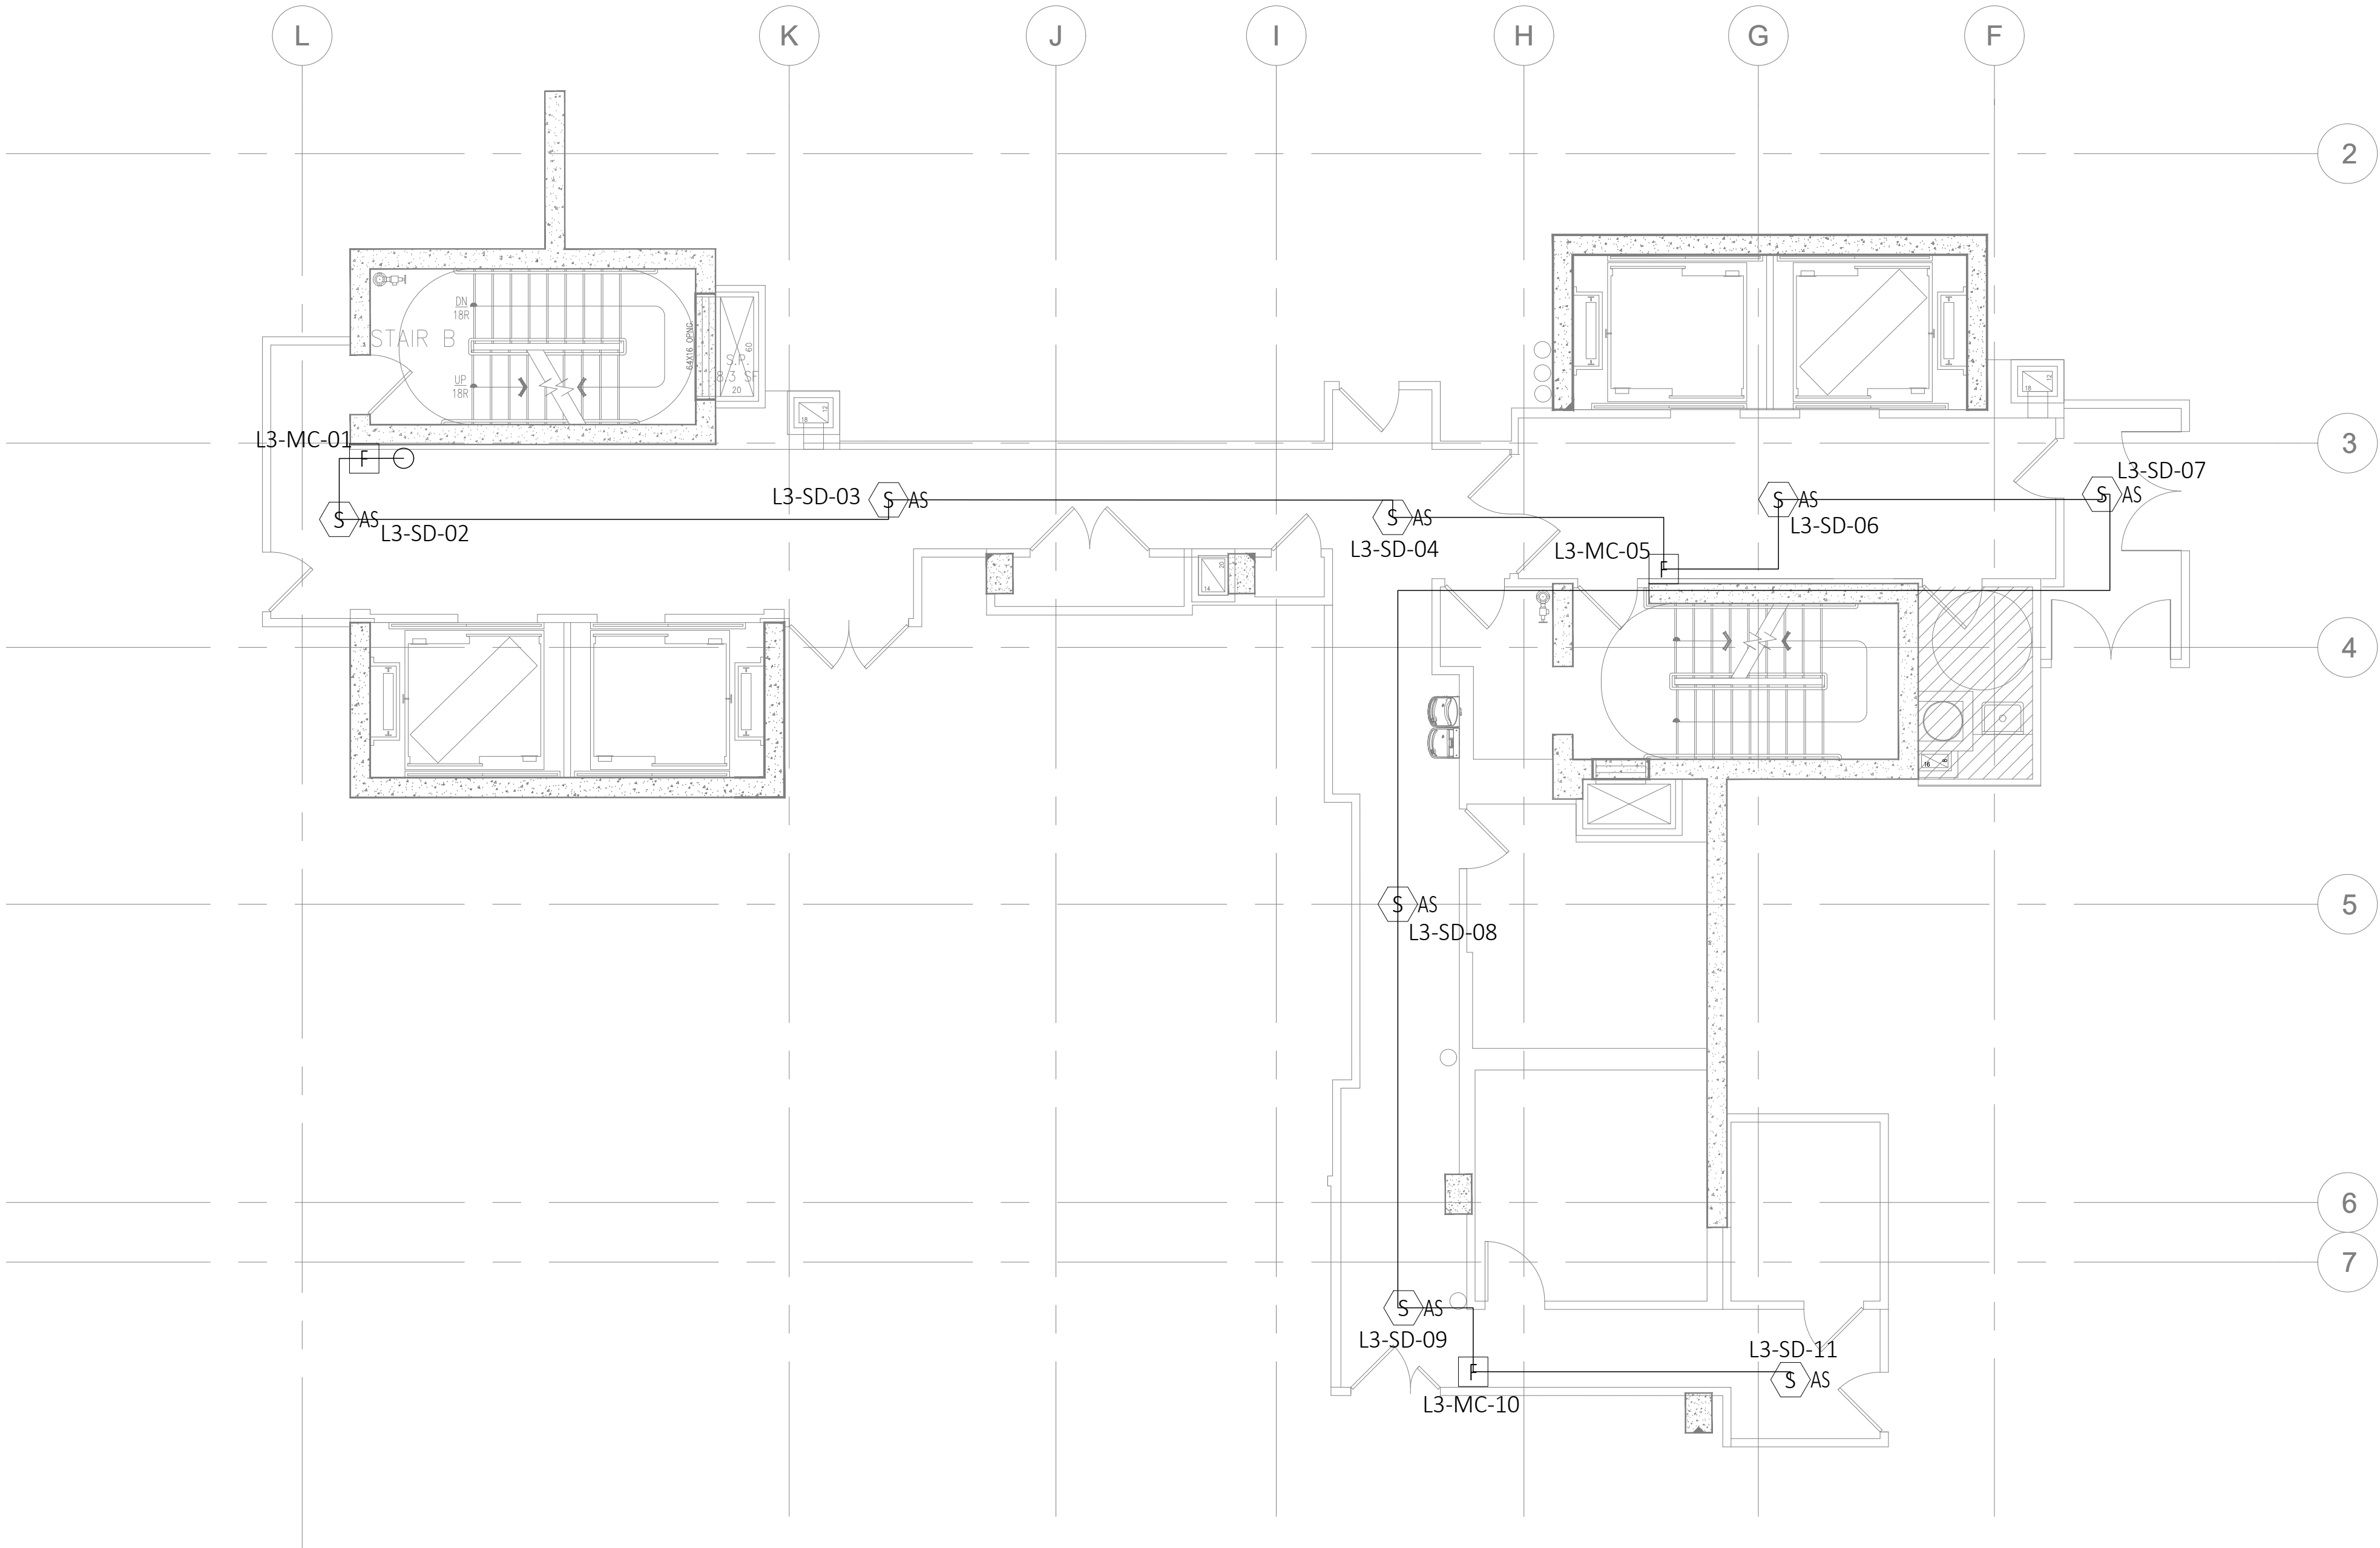

1  
A-2.0

FIRE ALARM 4TH FLOOR PLAN

SCALE: 3/16" = 1'-0"

GROUND LEVEL

PROJECT NAME.

RESTROOMS  
ASANA PARTNERS

DESIGN  
CONSULTANT.

TSABA CORP  
NADIF BRACEY  
254 CHAPMAN RD,  
STE 208 #13130  
NEWARK, DELAWARE  
19702  
EMAIL:  
INFO@TS9DESIGNS.COM

SITE LOCATION.

1000 MAXWELL LANE  
HOBOKEN, NJ 07030

DISCIPLINE.


ELECTRICAL  
FIRE ALARM

| No. | Description | Date |
|-----|-------------|------|
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |

|                                                                                       |            |
|---------------------------------------------------------------------------------------|------------|
|  |            |
| Date                                                                                  | 2-11-2023  |
| Drawn by                                                                              | MJS        |
| Checked by                                                                            | FA         |
| <b>E1-10</b>                                                                          |            |
| Scale                                                                                 | 1/8"=1'-0" |



| FIRE ALARM                                                                          |                                                                               |
|-------------------------------------------------------------------------------------|-------------------------------------------------------------------------------|
|    | FIRE ALARM PULL STATION                                                       |
|    | FIRE ALARM HORN C/W STROBE (CEILING/WALL)                                     |
|    | FIRE ALARM STROBE (CEILING/WALL)                                              |
|    | FIRE ALARM HORN (NO STROBE)                                                   |
|    | MINI HORN (NO STROBE)<br>C/W PUSHBUTTON SILENCER                              |
|    | SPEAKER STROBE OR MINI HORN STROBE<br>WITH SILENCER MODULE & PUSHBUTTON BELOW |
|    | SILENCER MODULE C/W PUSHBUTTON                                                |
|    | SILENCER MODULE/ REMOTE PUSHBUTTON                                            |
|   | MAGNETIC DOOR HOLDER                                                          |
|  | ALARM BELL                                                                    |
|  | FIRE ALARM SPEAKER                                                            |
|  | FIRE ALARM SPEAKER/STROBE (CEILING/WALL)                                      |
|  | FIRE PHONE                                                                    |
|  | SMOKE DETECTOR / C=SMOKE CO COMBO                                             |
|  | D=DUCT DETECTOR/ A=SMOKE ALARM                                                |
|  | HEAT DETECTOR/ H=HIGH TEMP DETECTOR                                           |
|  | AS=ASPIRING SMOKE DETECTOR                                                    |
|  | RF MODULE                                                                     |
|  | FIRE ALARM POWER SUPPLY                                                       |
|  | SUB BOOSTER PANEL                                                             |

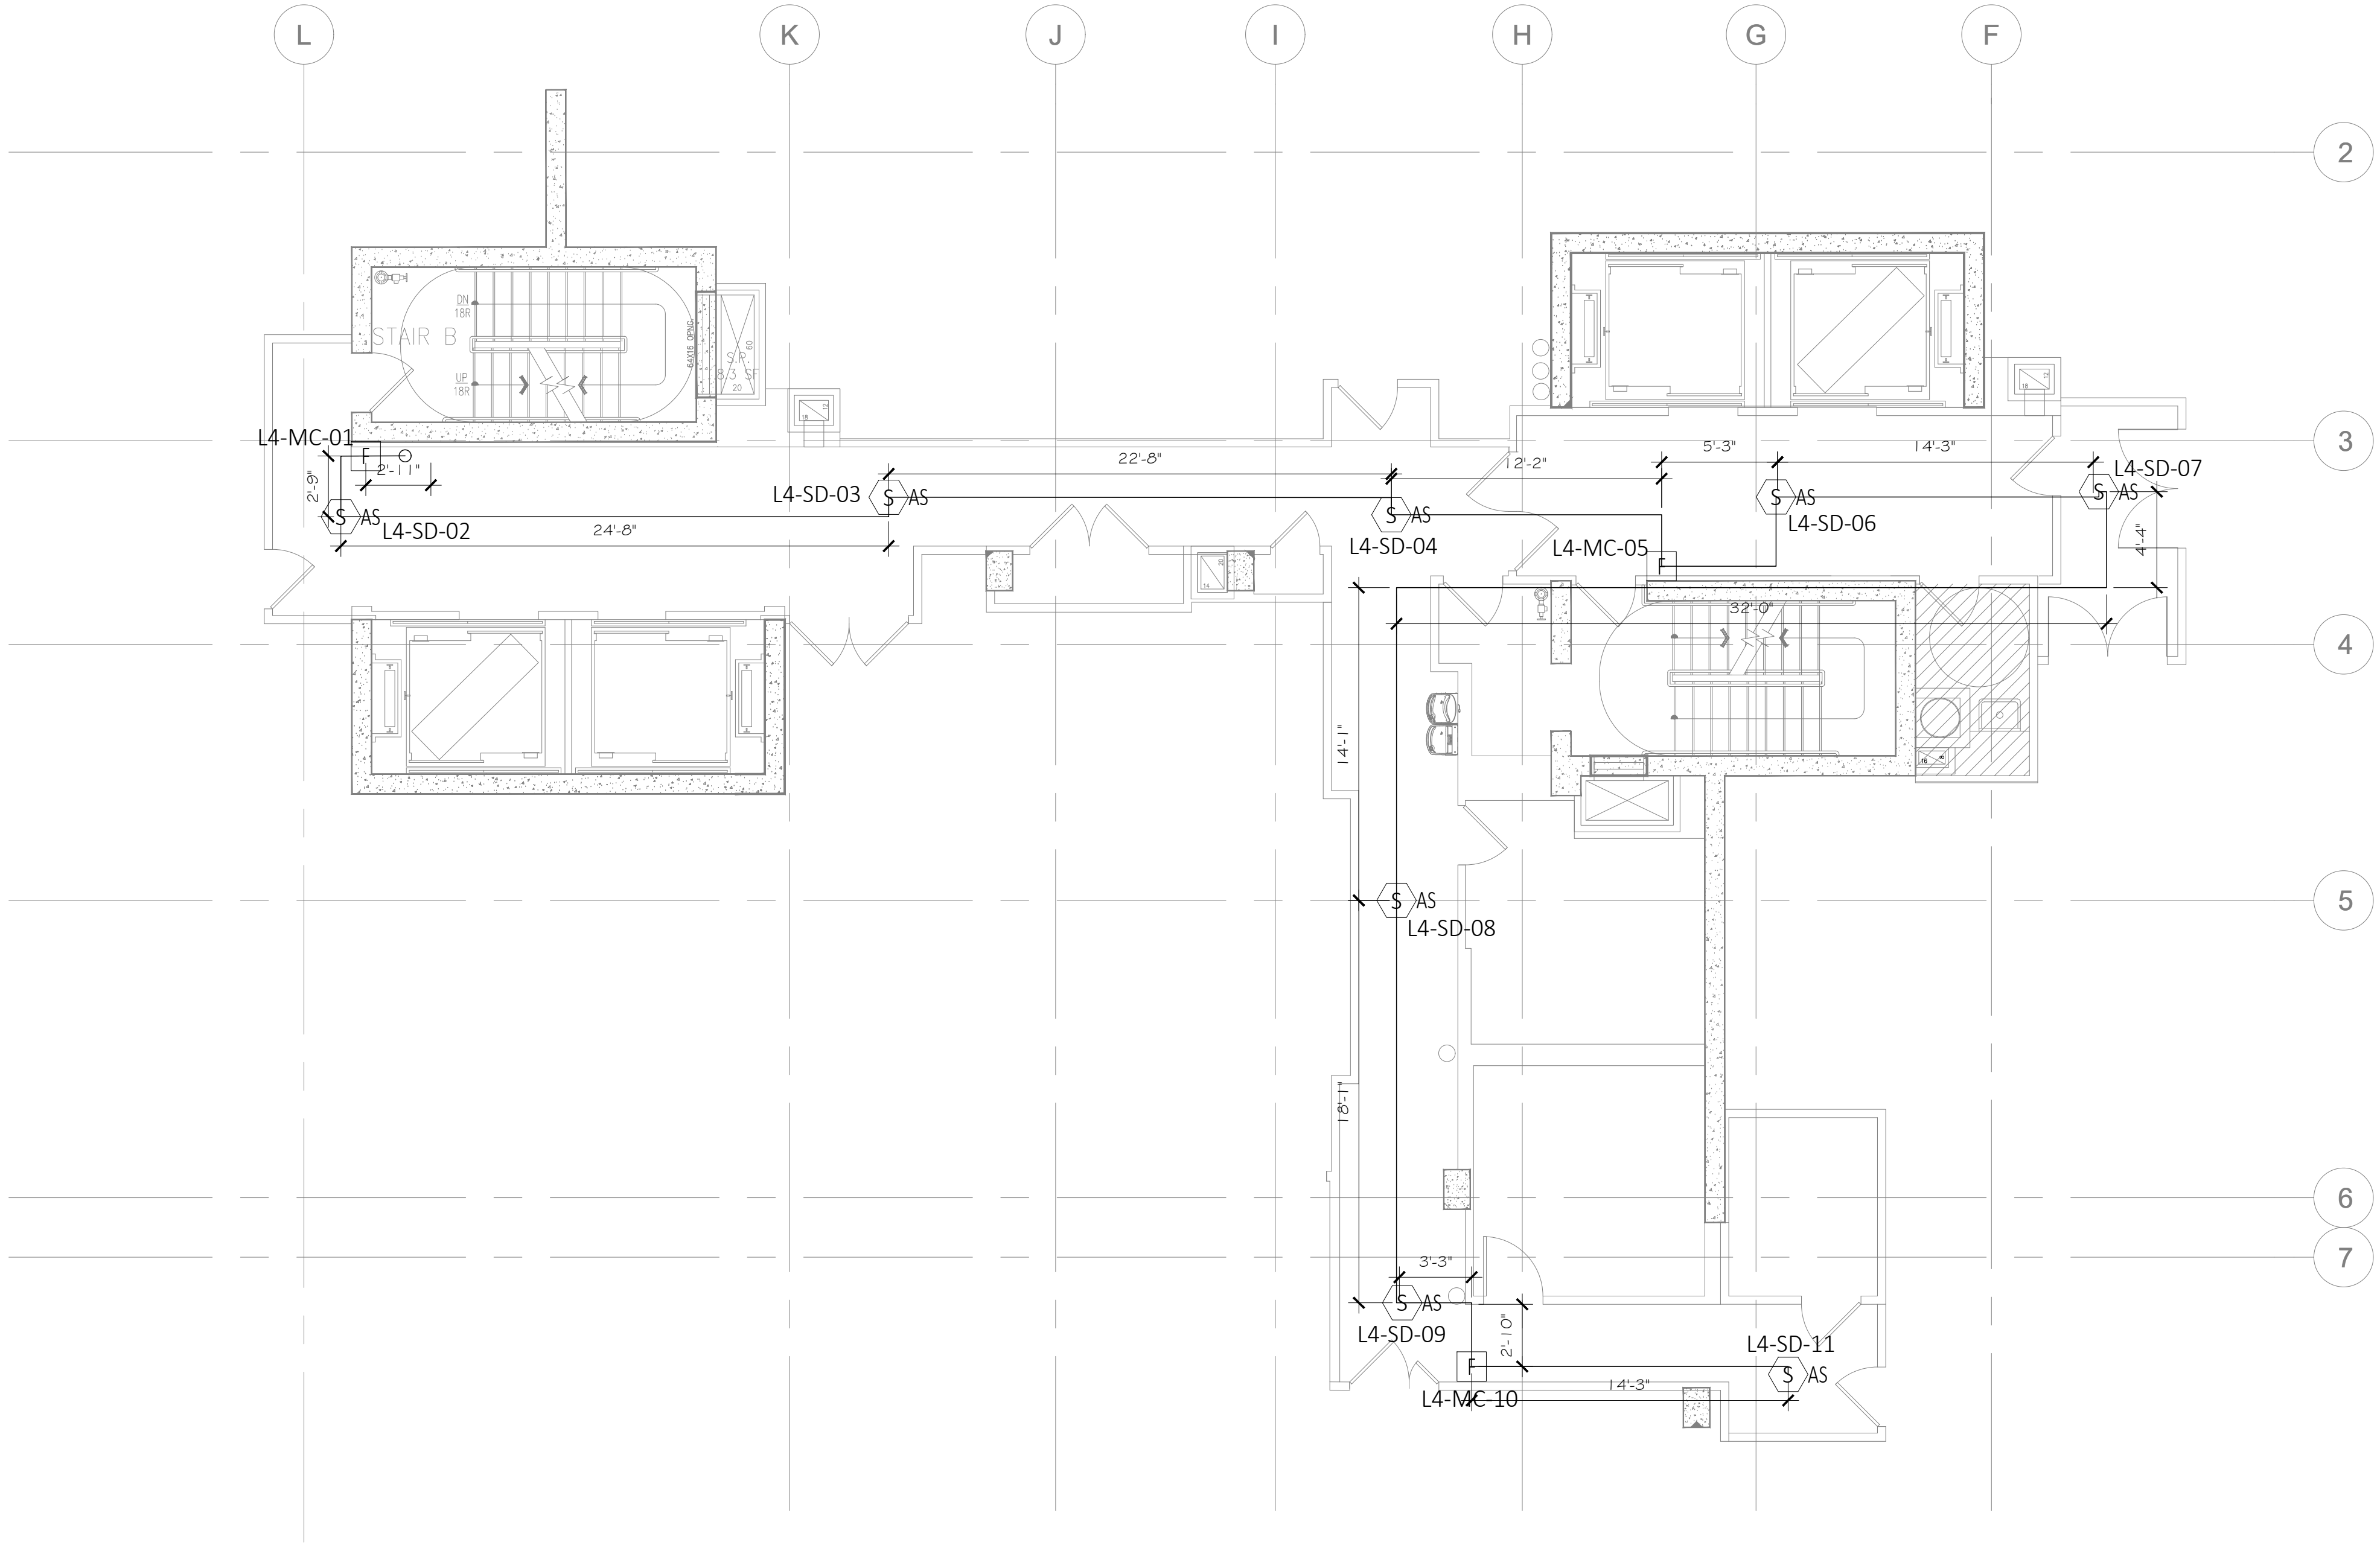

I  
A-2.0  
FIRE ALARM 5TH FLOOR PLAN  
SCALE: 3/16" = 1'-0" GROUND LEVEL

PROJECT NAME.

RESTROOMS  
ASANA PARTNERS

DESIGN  
CONSULTANT.

TSABA CORP  
NADIF BRACEY  
254 CHAPMAN RD,  
STE 208 #13130  
NEWARK, DELAWARE  
19702  
EMAIL:  
INFO@TS9DESIGNS.COM

SITE LOCATION.


1000 MAXWELL LANE  
HOBOKEN, NJ 07030

DISCIPLINE.

ELECTRICAL  
FIRE ALARM

| No. | Description | Date |
|-----|-------------|------|
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |

STATE OF NEW JERSEY  
MOHAMED SAID MINOUD  
No.  
GE059074  
LICENSED PROFESSIONAL ENGINEER




Date2-11-2023  
Drawn byMJS  
Checked byFA

E1-11

Scale1/8"=1'-0"



| FIRE ALARM                                                                          |                                                                            |
|-------------------------------------------------------------------------------------|----------------------------------------------------------------------------|
|    | FIRE ALARM PULL STATION                                                    |
|    | FIRE ALARM HORN C/W STROBE (CEILING/WALL)                                  |
|    | FIRE ALARM STROBE (CEILING/WALL)                                           |
|    | FIRE ALARM HORN (NO STROBE)                                                |
|    | MINI HORN (NO STROBE)                                                      |
|    | C/W PUSHBUTTON SILENCER                                                    |
|    | SPEAKER STROBE OR MINI HORN STROBE WITH SILENCER MODULE & PUSHBUTTON BELOW |
|   | SILENCER MODULE C/W PUSHBUTTON                                             |
|  | SILENCER MODULE/ REMOTE PUSHBUTTON                                         |
|  | MAGNETIC DOOR HOLDER                                                       |
|  | ALARM BELL                                                                 |
|  | FIRE ALARM SPEAKER                                                         |
|  | FIRE ALARM SPEAKER/STROBE (CEILING/WALL)                                   |
|  | FIRE PHONE                                                                 |
|  | SMOKE DETECTOR / C=SMOKE CO COMBO                                          |
|  | D=DUCT DETECTOR/ A=SMOKE ALARM                                             |
|  | HEAT DETECTOR/ H=HIGH TEMP DETECTOR                                        |
|  | AS=ASPIRING SMOKE DETECTOR                                                 |
|  | RF MODULE                                                                  |
|  | FIRE ALARM POWER SUPPLY                                                    |
|  | SUB BOOSTER PANEL                                                          |

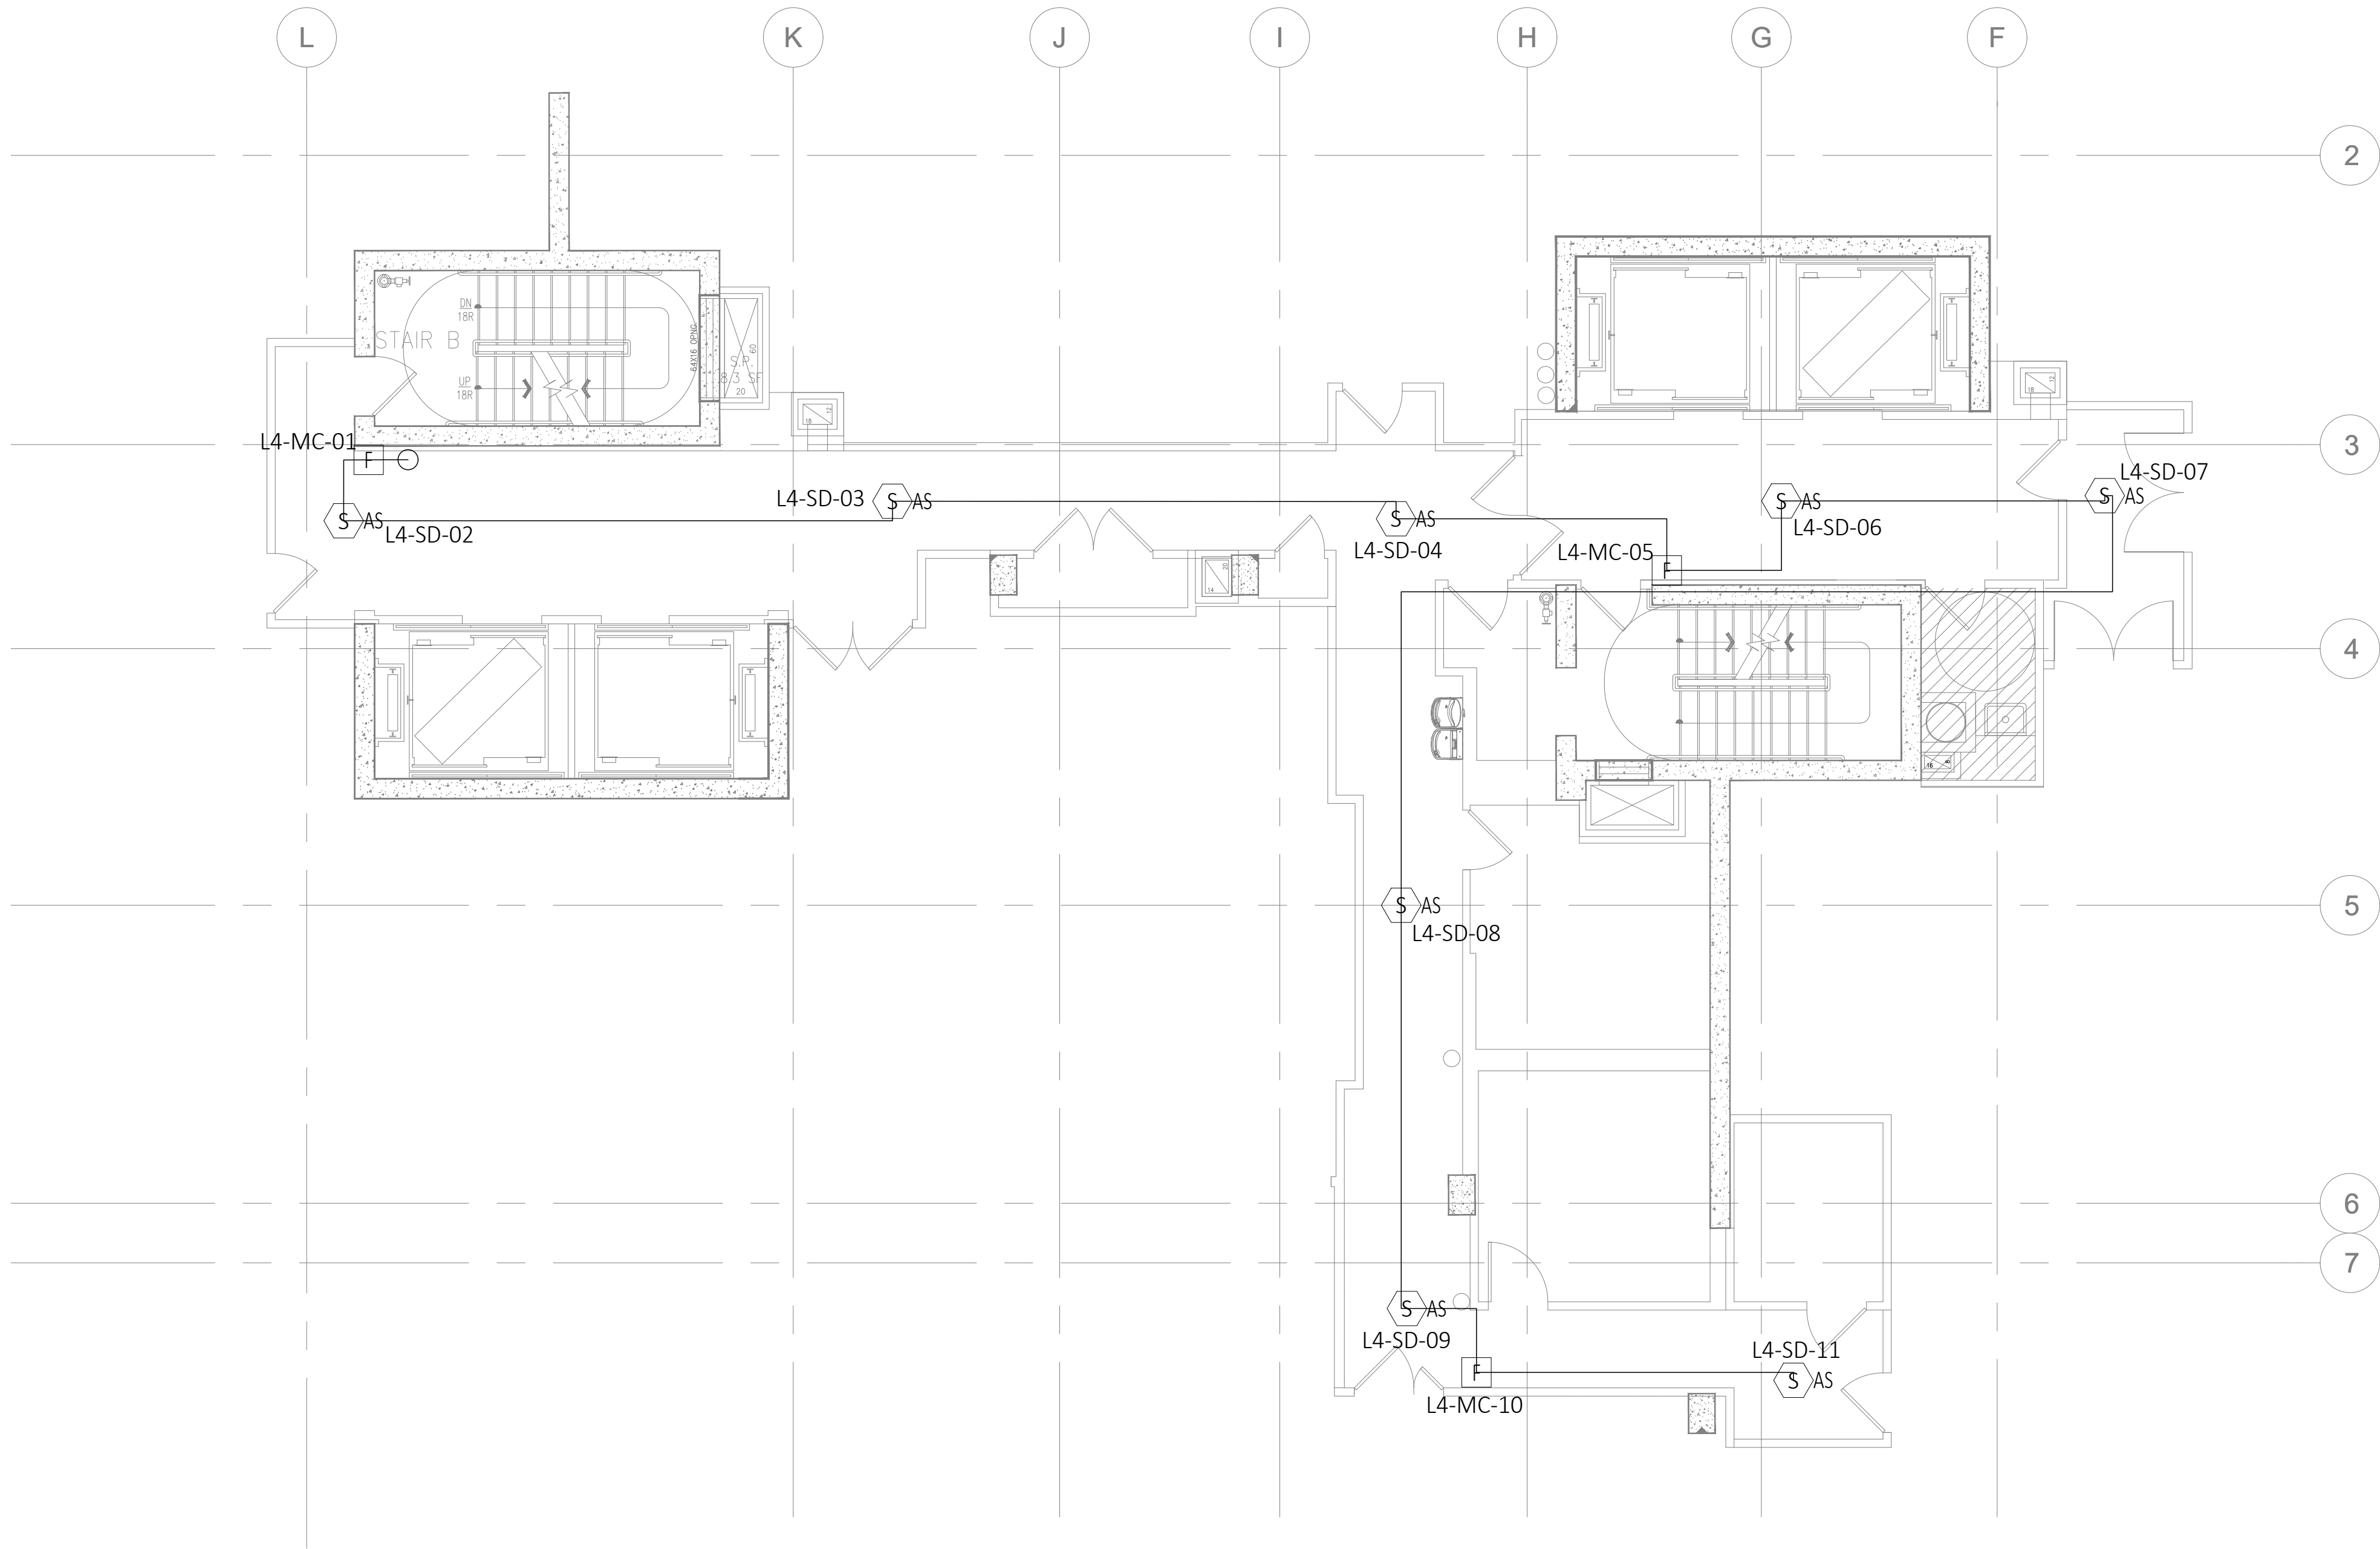

I  
A-2.0  
FIRE ALARM 5TH FLOOR PLAN  
SCALE: 3/16" = 1'-0"  
GROUND LEVEL

PROJECT NAME.

RESTROOMS  
ASANA PARTNERS

DESIGN  
CONSULTANT.

TSABA CORP  
NADIF BRACEY  
254 CHAPMAN RD,  
STE 208 #13130  
NEWARK, DELAWARE  
19702  
EMAIL:  
INFO@TS9DESIGNS.COM

SITE LOCATION.

1000 MAXWELL LANE  
HOBOKEN, NJ 07030

DISCIPLINE.

ELECTRICAL  
FIRE ALARM

| No. | Description | Date |
|-----|-------------|------|
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |






















Date: 2-11-2023  
Drawn by: MJS  
Checked by: FA

**E1-12**

Scale: 1/8"=1'-0"



| FIRE ALARM                                                                          |                                                                            |
|-------------------------------------------------------------------------------------|----------------------------------------------------------------------------|
|    | FIRE ALARM PULL STATION                                                    |
|    | FIRE ALARM HORN C/W STROBE (CEILING/WALL)                                  |
|    | FIRE ALARM STROBE (CEILING/WALL)                                           |
|    | FIRE ALARM HORN (NO STROBE)                                                |
|    | MINI HORN (NO STROBE)                                                      |
|   | C/W PUSHBUTTON SILENCER                                                    |
|  | SPEAKER STROBE OR MINI HORN STROBE WITH SILENCER MODULE & PUSHBUTTON BELOW |
|  | SILENCER MODULE C/W PUSHBUTTON                                             |
|  | SILENCER MODULE/ REMOTE PUSHBUTTON                                         |
|  | MAGNETIC DOOR HOLDER                                                       |
|  | ALARM BELL                                                                 |
|  | FIRE ALARM SPEAKER                                                         |
|  | FIRE ALARM SPEAKER/STROBE (CEILING/WALL)                                   |
|  | FIRE PHONE                                                                 |
|  | SMOKE DETECTOR / C=SMOKE CO COMBO                                          |
|  | D=DUCT DETECTOR/ A=SMOKE ALARM                                             |
|  | HEAT DETECTOR/ H=HIGH TEMP DETECTOR                                        |
|  | AS=ASPIRING SMOKE DETECTOR                                                 |
|  | RF MODULE                                                                  |
|  | FIRE ALARM POWER SUPPLY                                                    |
|  | SUB BOOSTER PANEL                                                          |

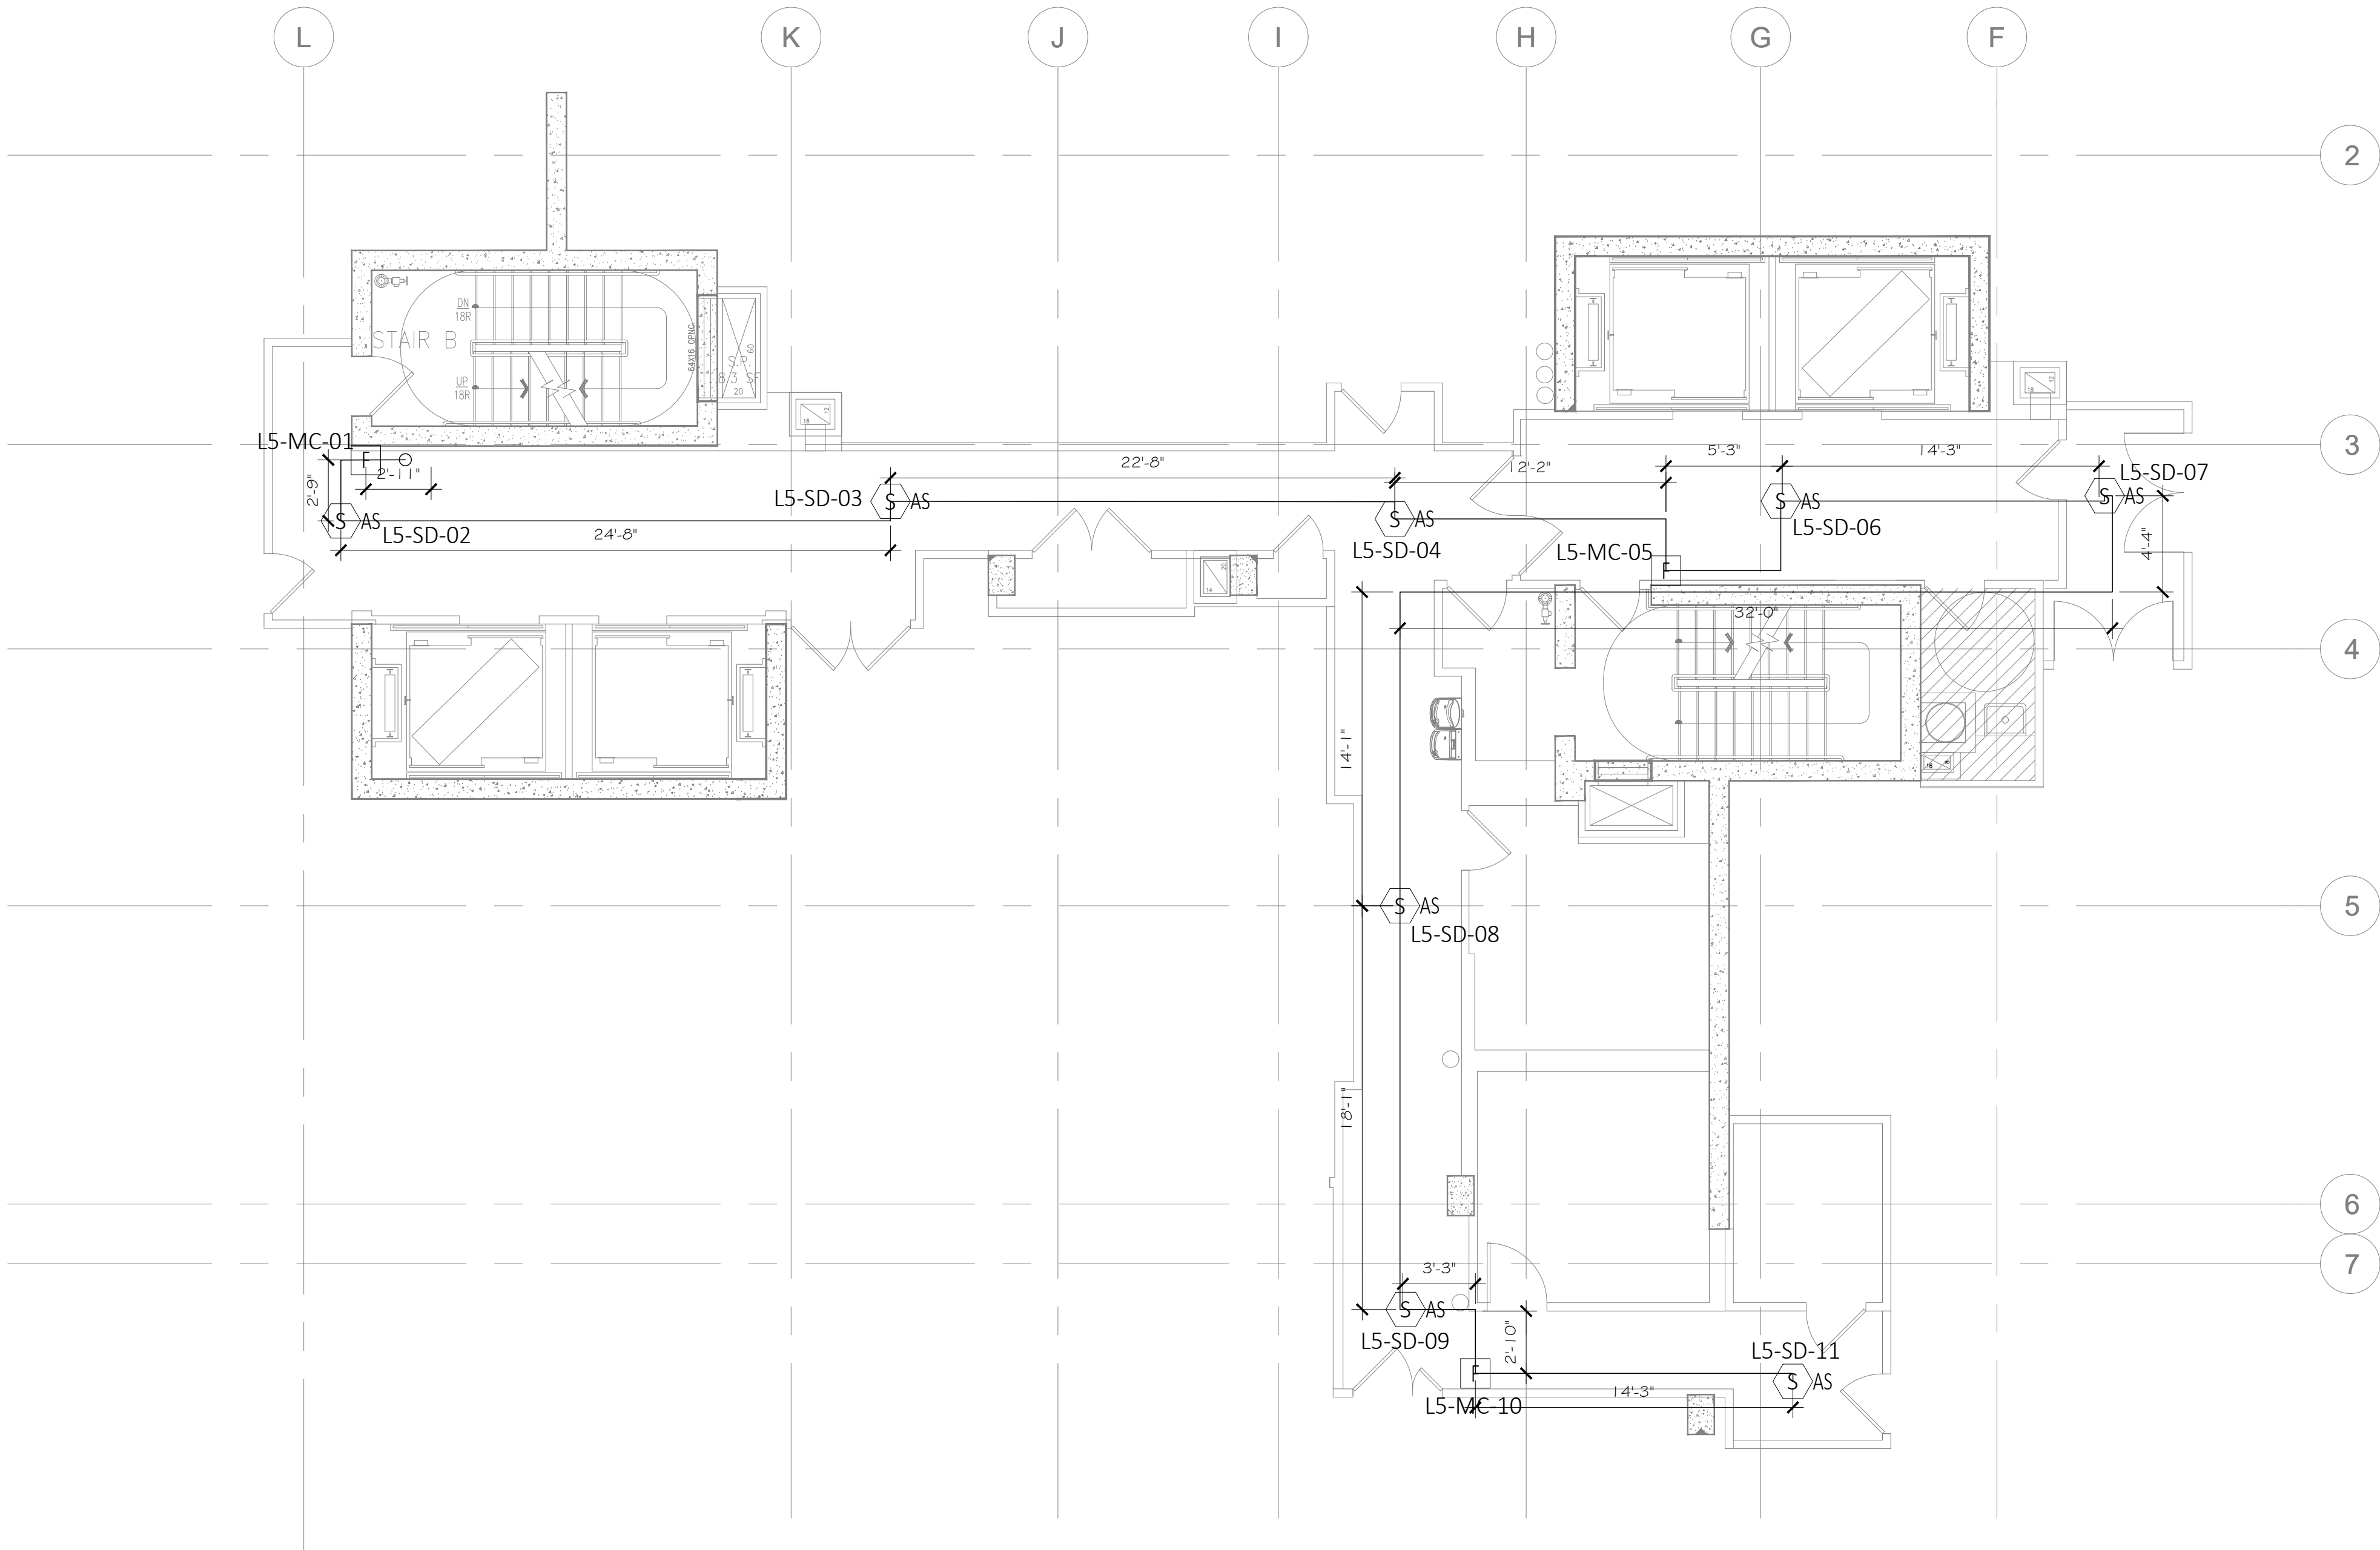

1  
A-2.0  
FIRE ALARM 6TH FLOOR PLAN  
SCALE: 3/16" = 1'-0"  
GROUND LEVEL

PROJECT NAME.

RESTROOMS  
ASANA PARTNERS

DESIGN  
CONSULTANT.

TSABA CORP  
NADIF BRACEY  
254 CHAPMAN RD,  
STE 208 #13130  
NEWARK, DELAWARE  
19702  
EMAIL:  
INFO@TS9DESIGNS.COM

SITE LOCATION.

1000 MAXWELL LANE  
HOBOKEN, NJ 07030

DISCIPLINE.

ELECTRICAL  
FIRE ALARM

| No. | Description | Date |
|-----|-------------|------|
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |

STATE OF NEW JERSEY  
MOHAMED SAID MINOUI  
No.  
GE059074  
LICENSED PROFESSIONAL ENGINEER






















Date2-11-2023  
Drawn byMJS  
Checked byFA

E1-13

Scale1/8"=1'-0"



| FIRE ALARM                                                                          |                                                                               |
|-------------------------------------------------------------------------------------|-------------------------------------------------------------------------------|
|    | FIRE ALARM PULL STATION                                                       |
|    | FIRE ALARM HORN C/W STROBE (CEILING/WALL)                                     |
|    | FIRE ALARM STROBE (CEILING/WALL)                                              |
|    | FIRE ALARM HORN (NO STROBE)                                                   |
|   | MINI HORN (NO STROBE)<br>C/W PUSHBUTTON SILENCER                              |
|  | SPEAKER STROBE OR MINI HORN STROBE<br>WITH SILENCER MODULE & PUSHBUTTON BELOW |
|  | SILENCER MODULE C/W PUSHBUTTON                                                |
|  | SILENCER MODULE/ REMOTE PUSHBUTTON                                            |
|  | MAGNETIC DOOR HOLDER                                                          |
|  | ALARM BELL                                                                    |
|  | FIRE ALARM SPEAKER                                                            |
|  | FIRE ALARM SPEAKER/STROBE (CEILING/WALL)                                      |
|  | FIRE PHONE                                                                    |
|  | SMOKE DETECTOR / C=SMOKE CO COMBO                                             |
|  | D=DUCT DETECTOR/ A=SMOKE ALARM                                                |
|  | HEAT DETECTOR/ H=HIGH TEMP DETECTOR                                           |
|  | AS=ASPIRING SMOKE DETECTOR                                                    |
|  | RF MODULE                                                                     |
|  | FIRE ALARM POWER SUPPLY                                                       |
|  | SUB BOOSTER PANEL                                                             |

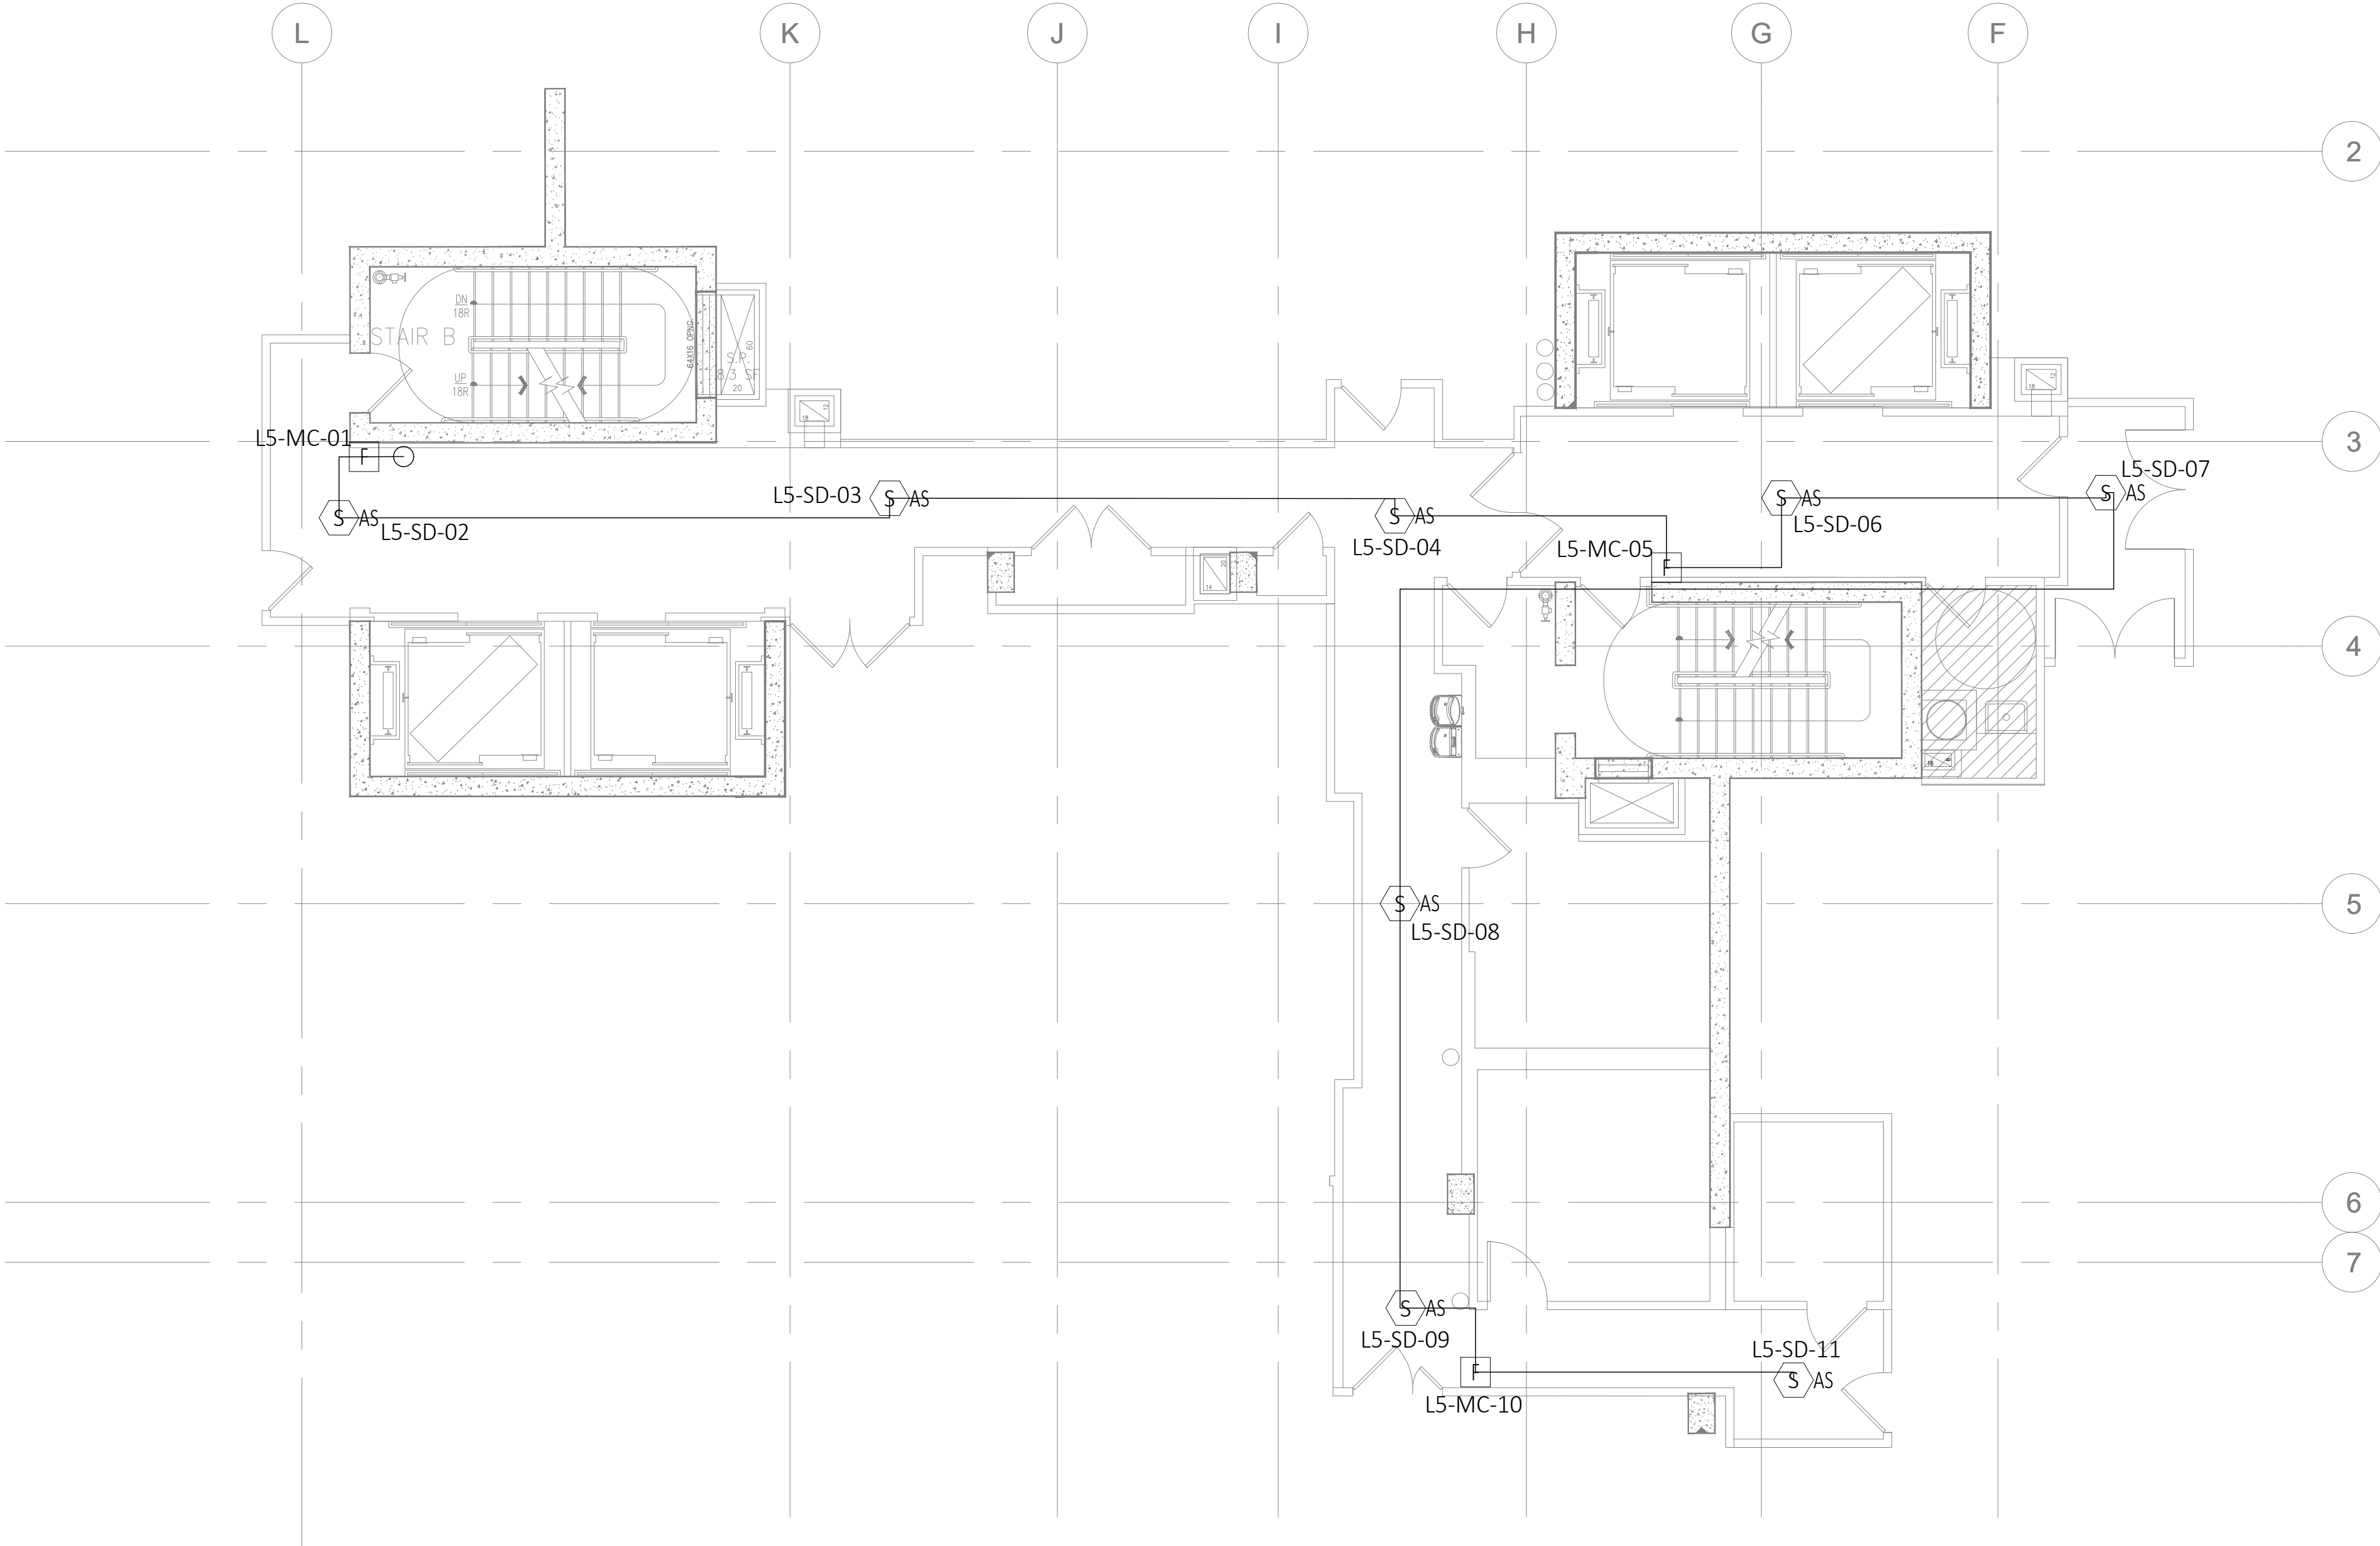

1  
A-2.0 FIRE ALARM 6TH FLOOR PLAN  
SCALE: 3/16" = 1'-0" GROUND LEVEL

PROJECT NAME.

RESTROOMS  
ASANA PARTNERS

DESIGN  
CONSULTANT.

TSABA CORP  
NADIF BRACEY  
254 CHAPMAN RD,  
STE 208 #13130  
NEWARK, DELAWARE  
19702  
EMAIL:  
INFO@TS9DESIGNS.COM


SITE LOCATION.

1000 MAXWELL LANE  
HOBOKEN, NJ 07030

DISCIPLINE.


ELECTRICAL  
FIRE ALARM

| No. | Description | Date |
|-----|-------------|------|
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |

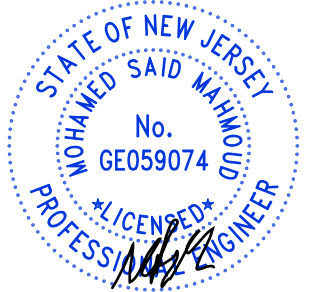

Date 2-11-2023  
Drawn by MJS  
Checked by FA  
**E1-14**  
Scale 1/8"=1'-0"



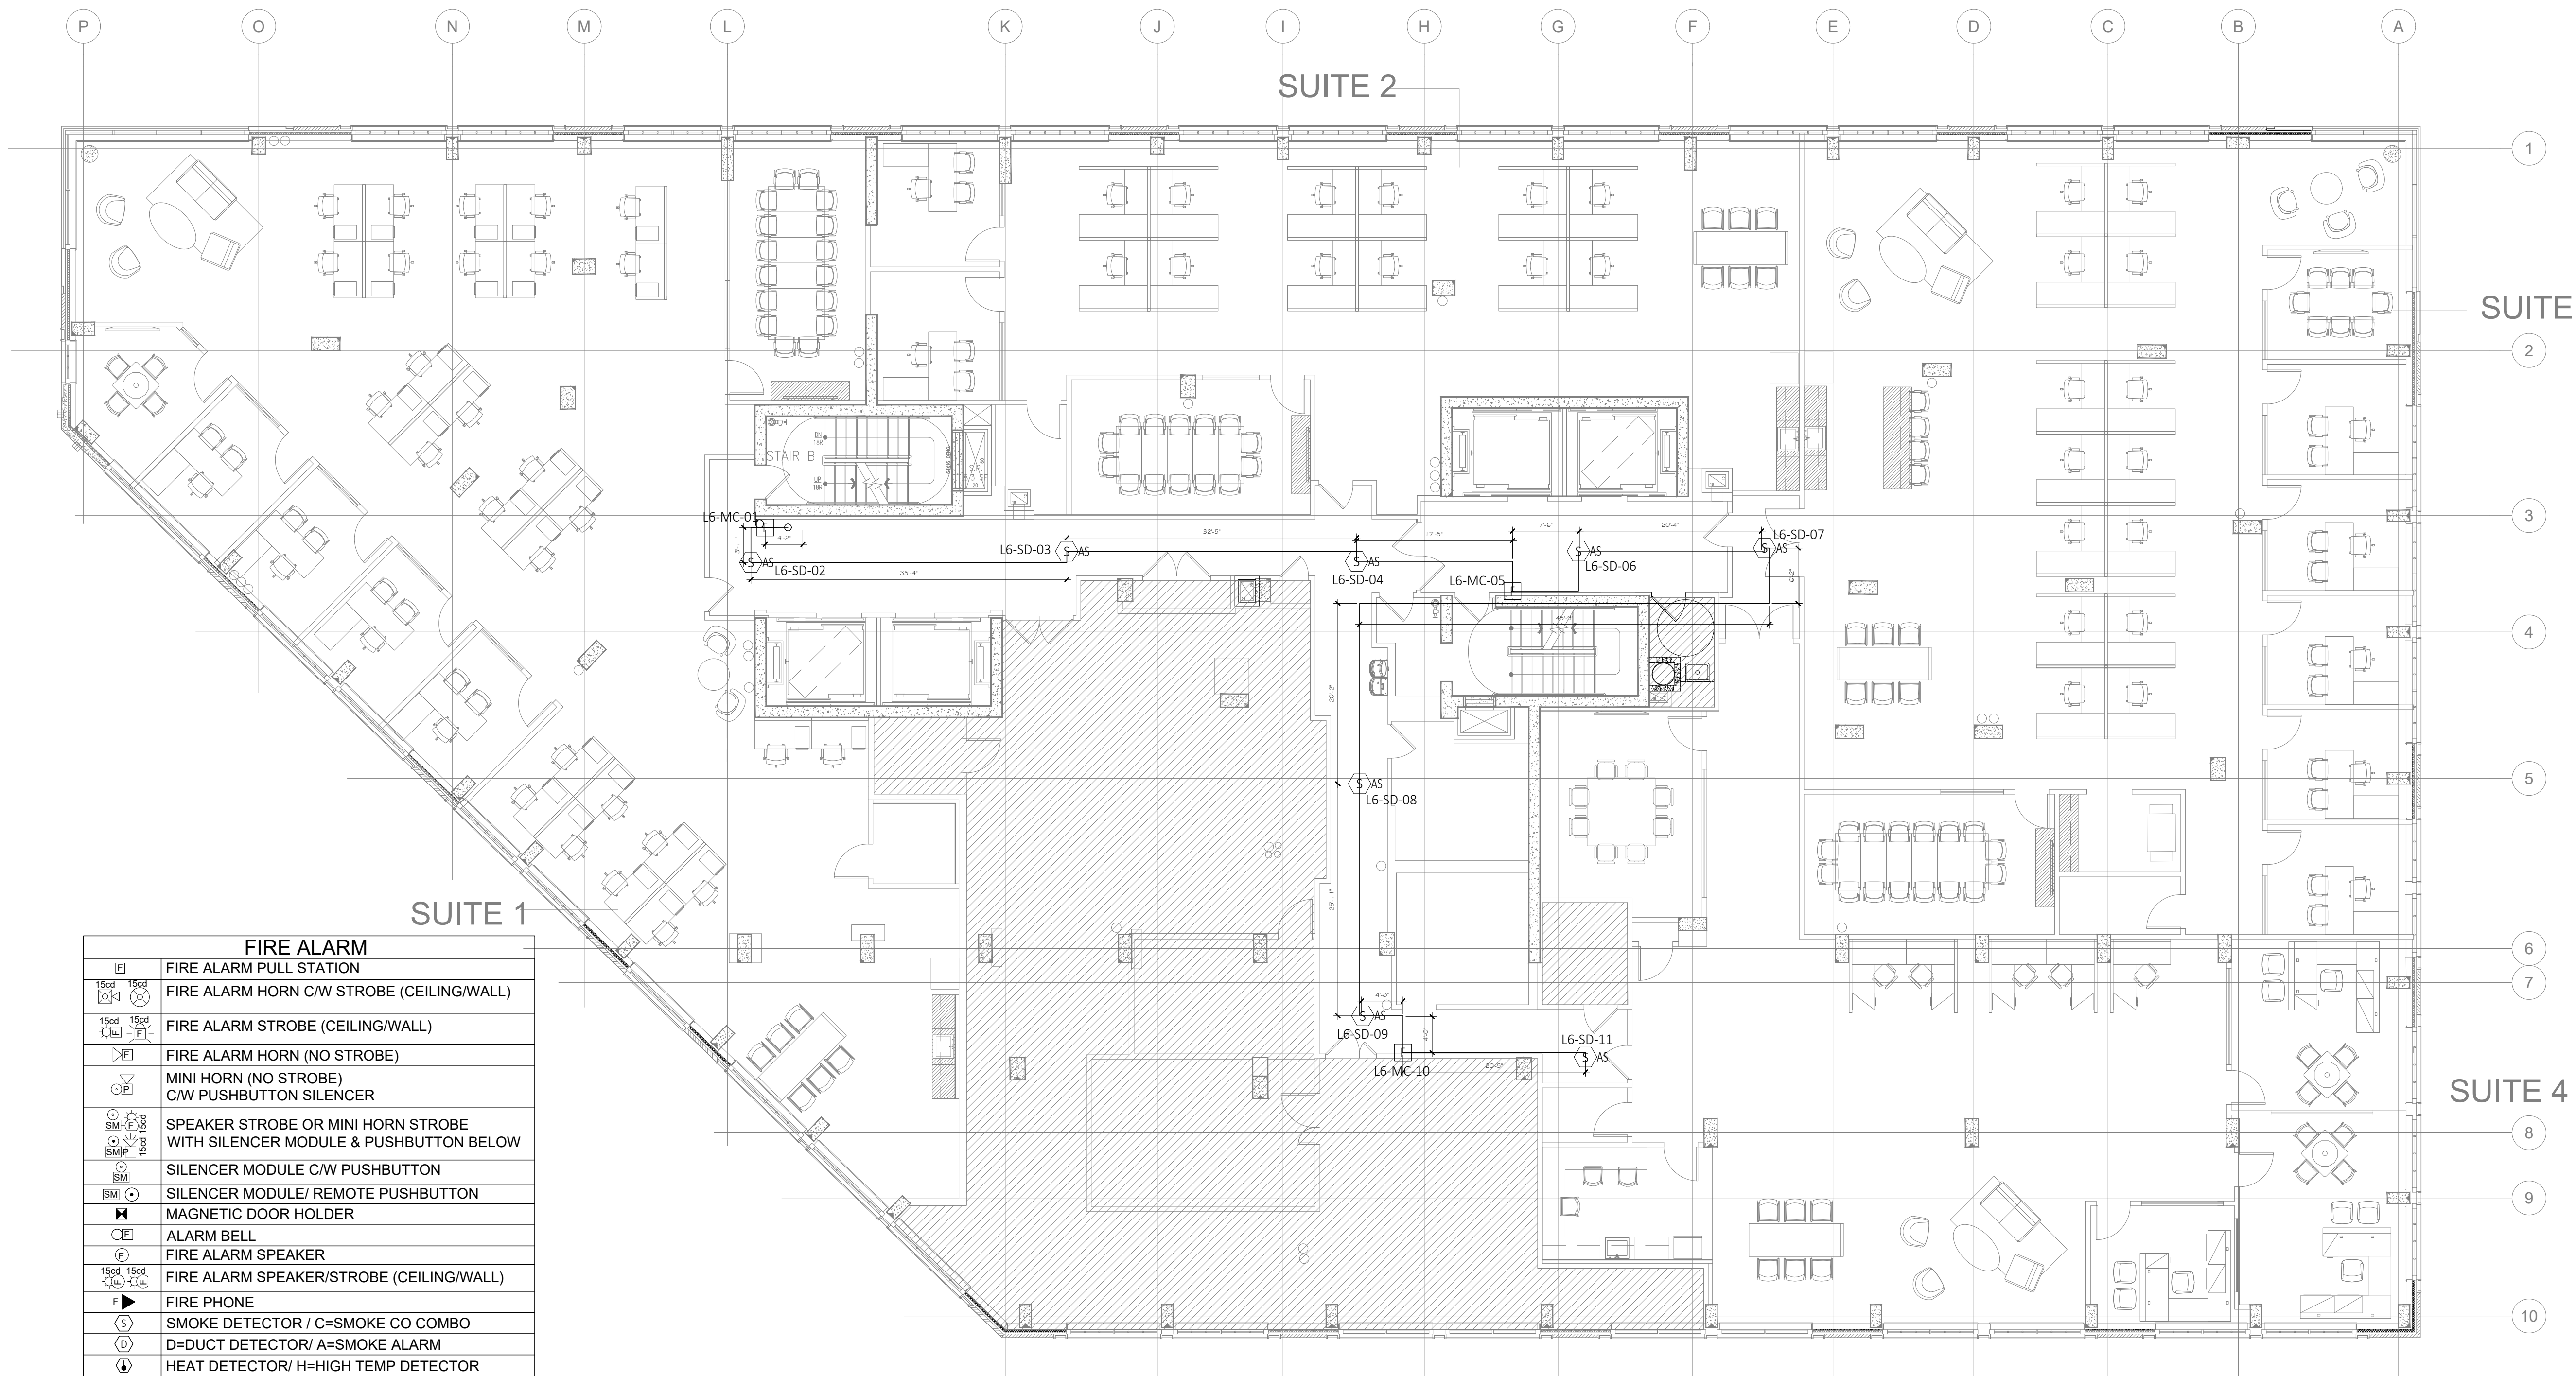

| FIRE ALARM |                                                                            |
|------------|----------------------------------------------------------------------------|
|            | FIRE ALARM PULL STATION                                                    |
|            | FIRE ALARM HORN C/W STROBE (CEILING/WALL)                                  |
|            | FIRE ALARM STROBE (CEILING/WALL)                                           |
|            | FIRE ALARM HORN (NO STROBE)                                                |
|            | MINI HORN (NO STROBE)                                                      |
|            | SPEAKER STROBE OR MINI HORN STROBE WITH SILENCER MODULE & PUSHBUTTON BELOW |
|            | SILENCER MODULE C/W PUSHBUTTON                                             |
|            | SILENCER MODULE/ REMOTE PUSHBUTTON                                         |
|            | MAGNETIC DOOR HOLDER                                                       |
|            | ALARM BELL                                                                 |
|            | FIRE ALARM SPEAKER                                                         |
|            | FIRE ALARM SPEAKER/STROBE (CEILING/WALL)                                   |
|            | FIRE PHONE                                                                 |
|            | SMOKE DETECTOR / C=SMOKE CO COMBO                                          |
|            | D=DUCT DETECTOR/ A=SMOKE ALARM                                             |
|            | HEAT DETECTOR/ H=HIGH TEMP DETECTOR                                        |
|            | AS=ASPIRING SMOKE DETECTOR                                                 |
|            | RF MODULE                                                                  |
|            | FIRE ALARM POWER SUPPLY                                                    |
|            | SUB BOOSTER PANEL                                                          |

1 FIRE ALARM 7TH FLOOR PLAN  
A-2.0 SCALE: 3/8" = 1'-0" GROUND LEVEL

PROJECT NAME.

RESTROOMS  
ASANA PARTNERS

DESIGN  
CONSULTANT.

TSABA CORP  
NADIF BRACEY  
254 CHAPMAN RD,  
STE 208 #13130  
NEWARK, DELAWARE  
19702  
EMAIL:  
INFO@TS9DESIGNS.COM

SITE LOCATION.

1000 MAXWELL LANE  
HOBOKEN, NJ 07030

DISCIPLINE.

ELECTRICAL  
FIRE ALARM

| No. | Description | Date |
|-----|-------------|------|
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |

Date: 2-11-2023  
Drawn by: MJS  
Checked by: FA

**E1-15**

Scale: 1/8" = 1'-0"






E1-16

Scale  $\frac{1}{16}"=1'$



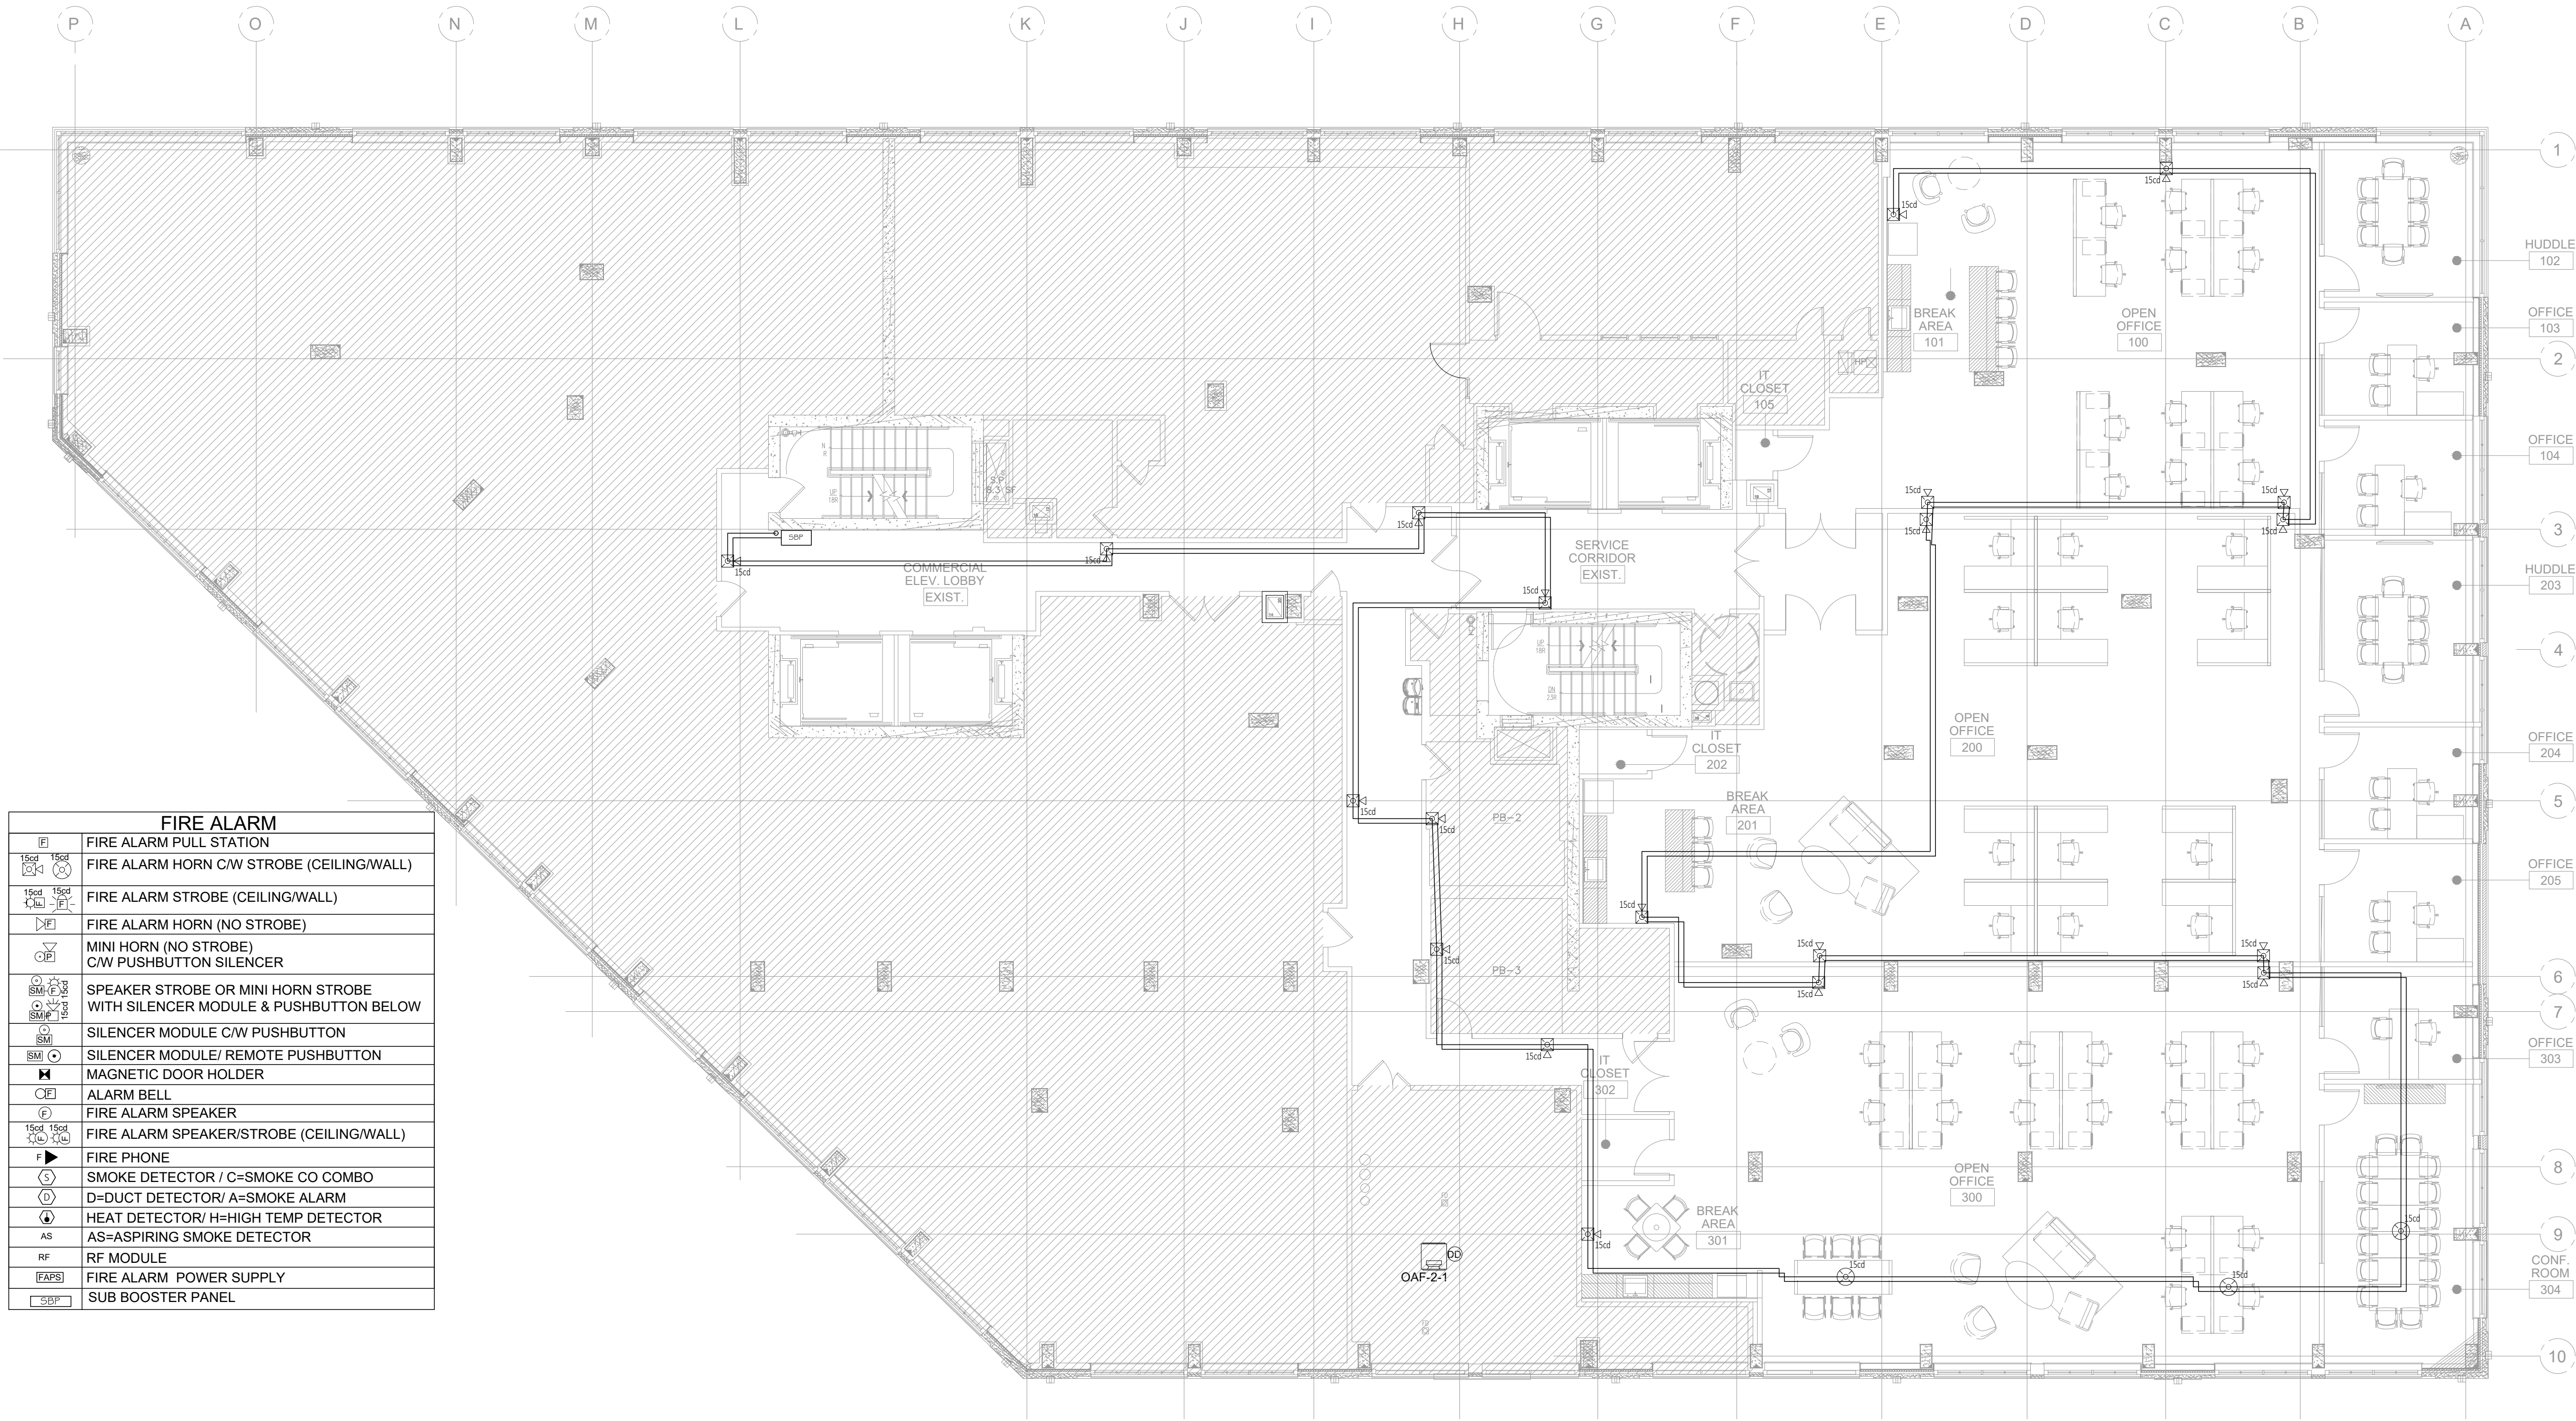

| FIRE ALARM |                                                                               |
|------------|-------------------------------------------------------------------------------|
|            | FIRE ALARM PULL STATION                                                       |
|            | FIRE ALARM HORN C/W STROBE (CEILING/WALL)                                     |
|            | FIRE ALARM STROBE (CEILING/WALL)                                              |
|            | FIRE ALARM HORN (NO STROBE)                                                   |
|            | MINI HORN (NO STROBE)<br>C/W PUSHBUTTON SILENCER                              |
|            | SPEAKER STROBE OR MINI HORN STROBE<br>WITH SILENCER MODULE & PUSHBUTTON BELOW |
|            | SILENCER MODULE C/W PUSHBUTTON                                                |
|            | SILENCER MODULE/ REMOTE PUSHBUTTON                                            |
|            | MAGNETIC DOOR HOLDER                                                          |
|            | ALARM BELL                                                                    |
|            | FIRE ALARM SPEAKER                                                            |
|            | FIRE ALARM SPEAKER/STROBE (CEILING/WALL)                                      |
|            | FIRE PHONE                                                                    |
|            | SMOKE DETECTOR / C=SMOKE CO COMBO                                             |
|            | D=DUCT DETECTOR/ A=SMOKE ALARM                                                |
|            | HEAT DETECTOR/ H=HIGH TEMP DETECTOR                                           |
|            | AS=ASPIRING SMOKE DETECTOR                                                    |
|            | RF MODULE                                                                     |
|            | FIRE ALARM POWER SUPPLY                                                       |
|            | SUB BOOSTER PANEL                                                             |

1 FIRE ALARM 2ND FLOOR PLAN  
A-2.0 SCALE: 3/4" = 1'-0" GROUND LEVEL

PROJECT NAME.

RESTROOMS  
ASANA PARTNERS

DESIGN  
CONSULTANT.

TSABA CORP  
NADIF BRACEY  
254 CHAPMAN RD,  
STE 208 #13130  
NEWARK, DELAWARE  
19702  
EMAIL:  
INFO@TS9DESIGNS.COM

SITE LOCATION.

1000 MAXWELL LANE  
HOBOKEN, NJ 07030

DISCIPLINE.

ELECTRICAL  
FIRE ALARM

| No. | Description | Date |
|-----|-------------|------|
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |


STATE OF NEW JERSEY  
MOHAMED SAID MINOUBI  
No.  
GE059074  
LICENSED PROFESSIONAL ENGINEER

Date2-11-2023  
Drawn byMJS  
Checked byFA

E1-17

Scale1/16"=1'-0"



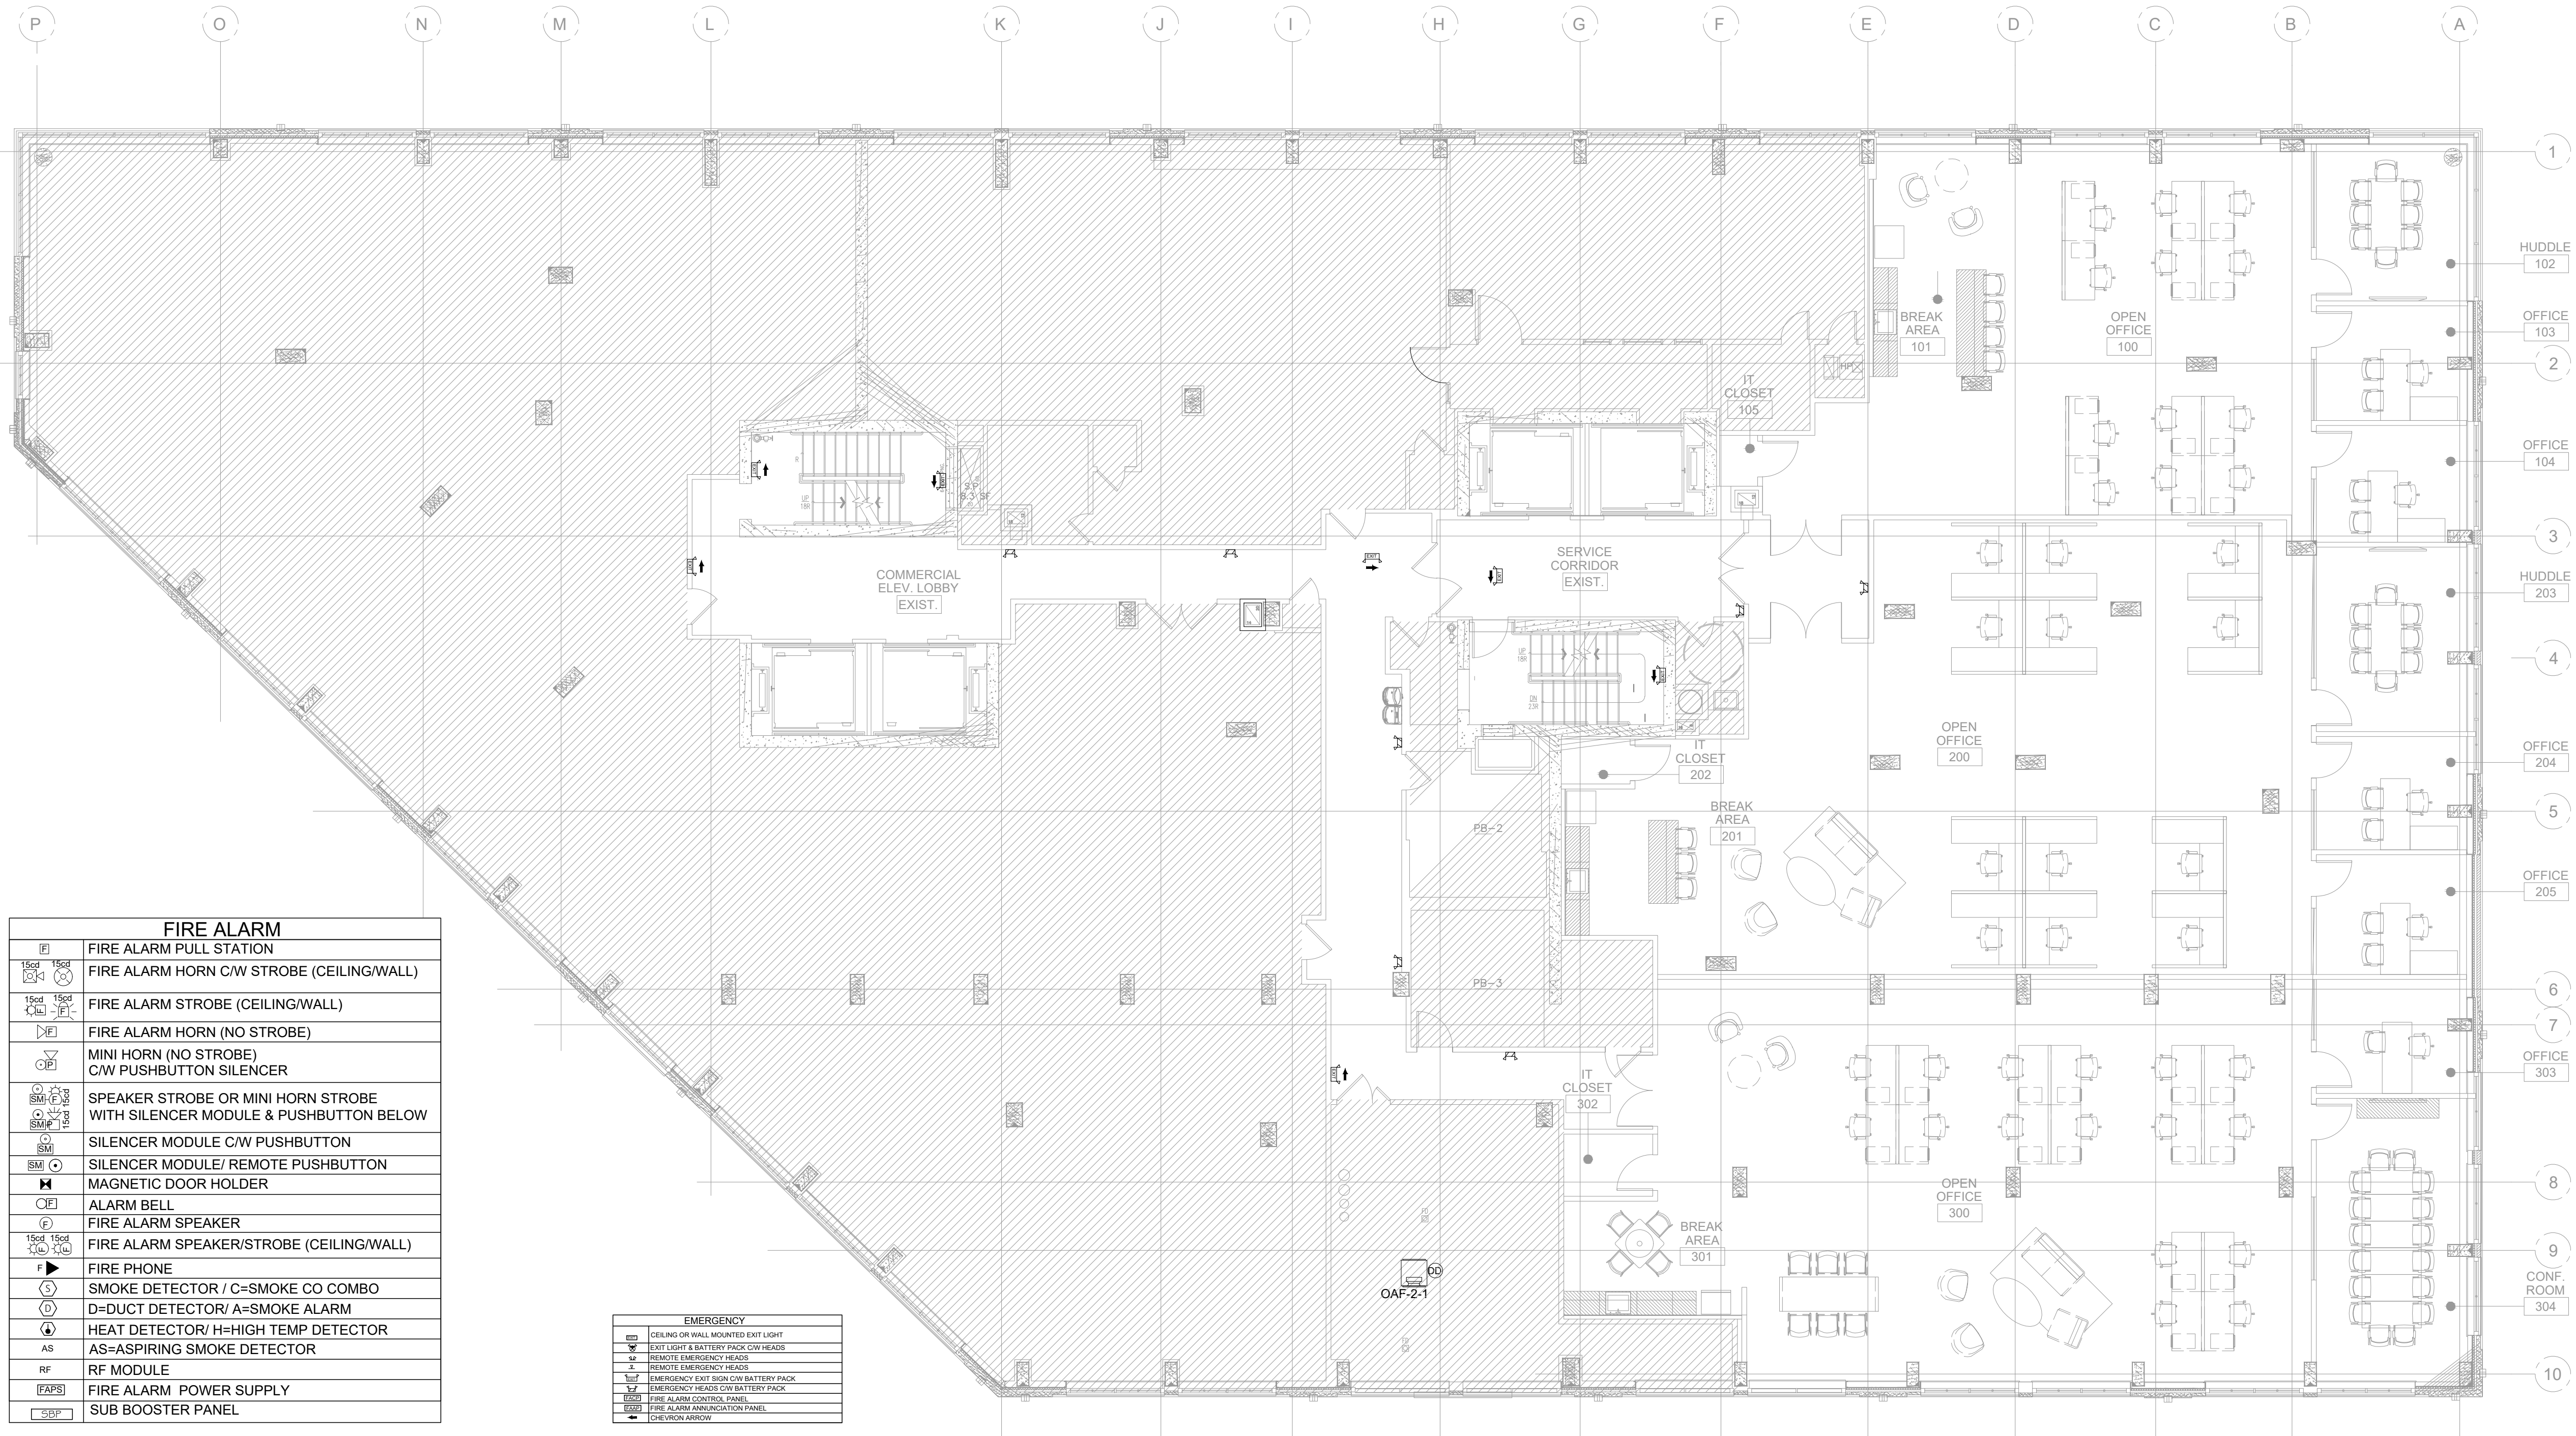

| FIRE ALARM |                                           |
|------------|-------------------------------------------|
|            | FIRE ALARM PULL STATION                   |
|            | FIRE ALARM HORN C/W STROBE (CEILING/WALL) |
|            | FIRE ALARM STROBE (CEILING/WALL)          |
|            | FIRE ALARM HORN (NO STROBE)               |
|            | MINI HORN (NO STROBE)                     |
|            | C/W PUSHBUTTON SILENCER                   |
|            | SPEAKER STROBE OR MINI HORN STROBE        |
|            | WITH SILENCER MODULE & PUSHBUTTON BELOW   |
|            | SILENCER MODULE C/W PUSHBUTTON            |
|            | SILENCER MODULE/ REMOTE PUSHBUTTON        |
|            | MAGNETIC DOOR HOLDER                      |
|            | ALARM BELL                                |
|            | FIRE ALARM SPEAKER                        |
|            | FIRE ALARM SPEAKER/STROBE (CEILING/WALL)  |
|            | FIRE PHONE                                |
|            | SMOKE DETECTOR / C=SMOKE CO COMBO         |
|            | D=DUCT DETECTOR/ A=SMOKE ALARM            |
|            | HEAT DETECTOR/ H=HIGH TEMP DETECTOR       |
|            | AS=ASPIRING SMOKE DETECTOR                |
|            | RF MODULE                                 |
|            | FIRE ALARM POWER SUPPLY                   |
|            | SUB BOOSTER PANEL                         |

| EMERGENCY |                                      |
|-----------|--------------------------------------|
|           | CEILING OR WALL MOUNTED EXIT LIGHT   |
|           | EXIT LIGHT & BATTERY PACK C/W HEADS  |
|           | REMOTE EMERGENCY HEADS               |
|           | REMOTE EMERGENCY HEADS               |
|           | EMERGENCY EXIT SIGN C/W BATTERY PACK |
|           | EMERGENCY HEADS C/W BATTERY PACK     |
|           | FIRE ALARM CONTROL PANEL             |
|           | FIRE ALARM ANNUNCIATION PANEL        |
|           | CHEVON ARROW                         |

EMERTGENCY LIGHTING 2ND FLOOR PLAN  
SCALE: 3/8" = 1'-0"  
GROUND LEVEL

PROJECT NAME.

RESTROOMS  
ASANA PARTNERS

DESIGN  
CONSULTANT.

TSABA CORP  
NADIF BRACEY  
254 CHAPMAN RD,  
STE 208 #13130  
NEWARK, DELAWARE  
19702  
EMAIL:  
INFO@TS9DESIGNS.COM

SITE LOCATION.

1000 MAXWELL LANE  
HOBOKEN, NJ 07030

DISCIPLINE.

ELECTRICAL  
FIRE ALARM

| No. | Description | Date |
|-----|-------------|------|
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |




|            |           |
|------------|-----------|
| Date       | 2-11-2023 |
| Drawn by   | MJS       |
| Checked by | FA        |

E1-18

Scale 1/8"=1'-0"



| FIRE ALARM                                                                          |                                                                               |
|-------------------------------------------------------------------------------------|-------------------------------------------------------------------------------|
|    | FIRE ALARM PULL STATION                                                       |
|    | FIRE ALARM HORN C/W STROBE (CEILING/WALL)                                     |
|    | FIRE ALARM STROBE (CEILING/WALL)                                              |
|    | FIRE ALARM HORN (NO STROBE)                                                   |
|    | MINI HORN (NO STROBE)<br>C/W PUSHBUTTON SILENCER                              |
|    | SPEAKER STROBE OR MINI HORN STROBE<br>WITH SILENCER MODULE & PUSHBUTTON BELOW |
|   | SILENCER MODULE C/W PUSHBUTTON                                                |
|  | SILENCER MODULE/ REMOTE PUSHBUTTON                                            |
|  | MAGNETIC DOOR HOLDER                                                          |
|  | ALARM BELL                                                                    |
|  | FIRE ALARM SPEAKER                                                            |
|  | FIRE ALARM SPEAKER/STROBE (CEILING/WALL)                                      |
|  | FIRE PHONE                                                                    |
|  | SMOKE DETECTOR / C=SMOKE CO COMBO                                             |
|  | D=DUCT DETECTOR/A=SMOKE ALARM                                                 |
|  | HEAT DETECTOR/H=HIGH TEMP DETECTOR                                            |
| AS                                                                                  | AS=ASPIRING SMOKE DETECTOR                                                    |
| RF                                                                                  | RF MODULE                                                                     |
|  | FIRE ALARM POWER SUPPLY                                                       |
|  | SUB BOOSTER PANEL                                                             |

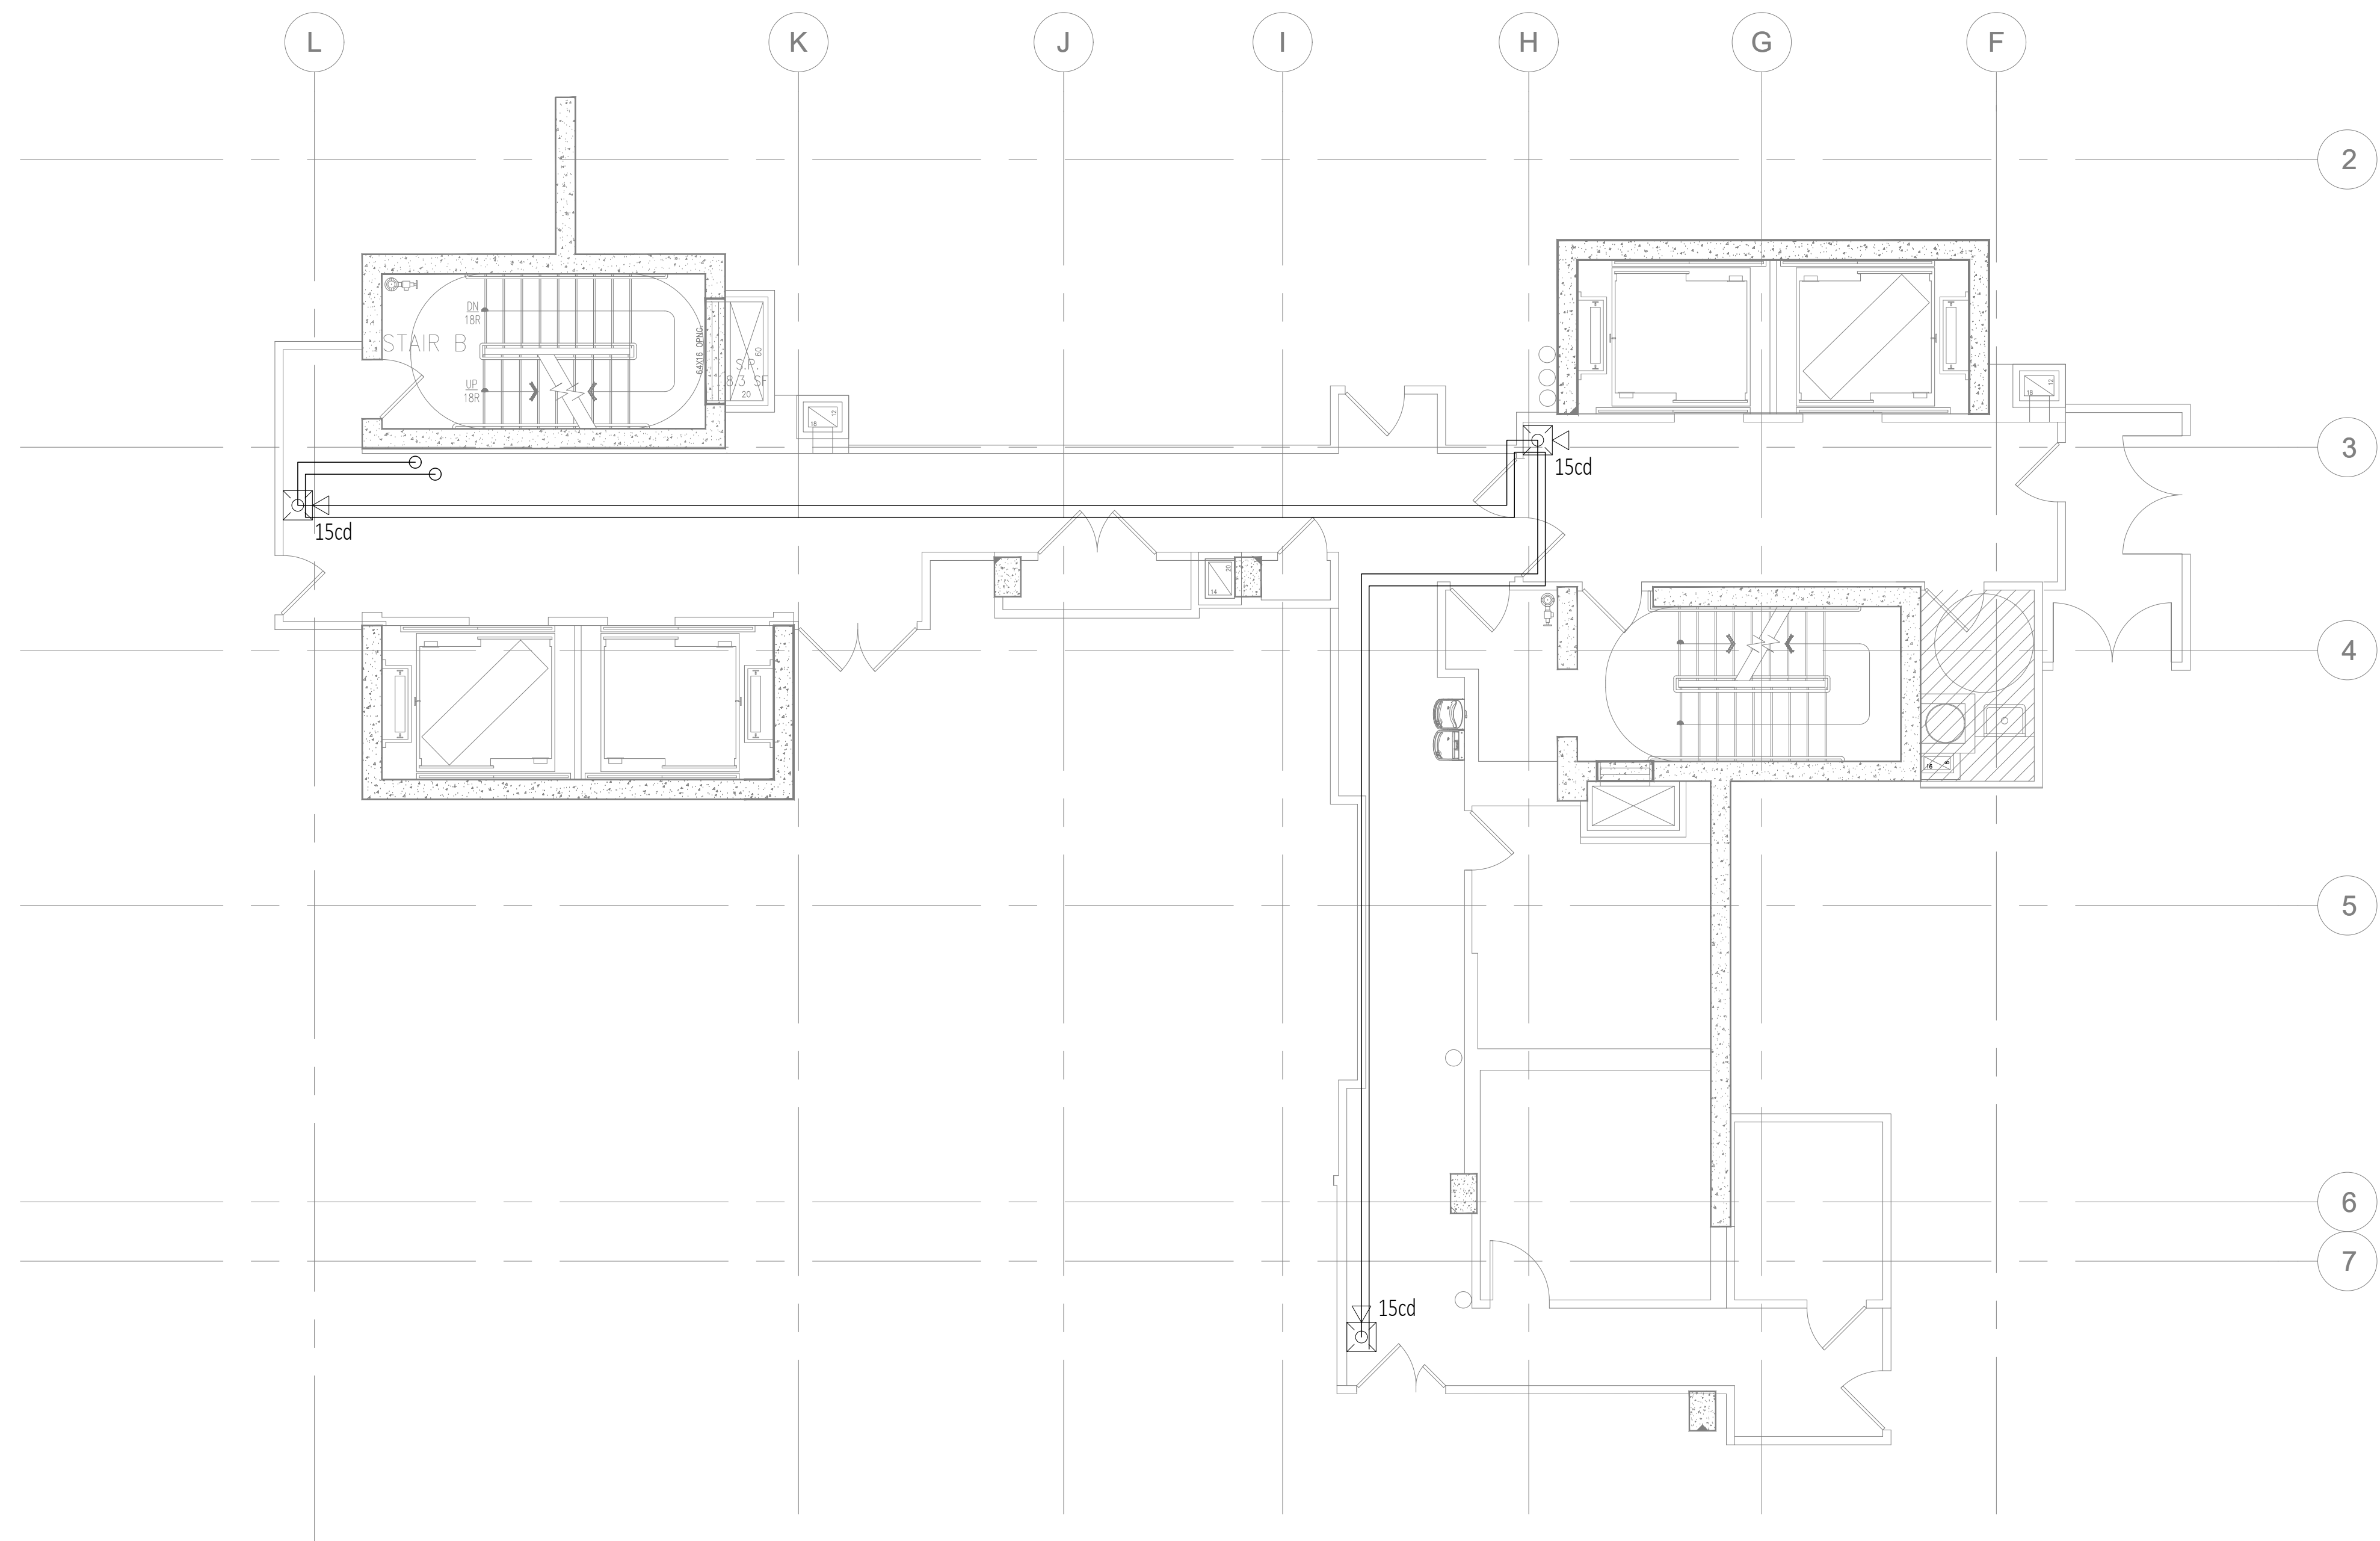

I  
A-2.0

# FIRE ALARM 3RD FLOOR PLAN

SCALE:  $\frac{3}{16}" = 1'-0"$

GROUND LEVEL

PROJECT NAME.

RESTROOMS  
ASANA PARTNERS


DESIGN  
CONSULTANT.

TSABA CORP  
NADIF BRACEY  
254 CHAPMAN RD,  
STE 208 #13130  
NEWARK, DELAWARE  
19702  
EMAIL:  
INFO@TS9DESIGNS.COM

SITE LOCATION.

1000 MAXWELL LANE  
HOBOKEN, NJ 07030

DISCIPLINE.










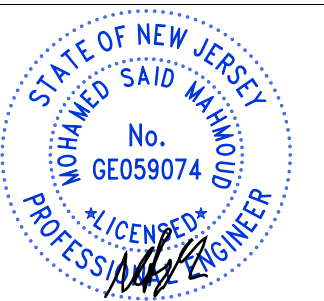
ELECTRICAL  
FIRE ALARM[illegible]

|            |           |
|------------|-----------|
| Date       | 2-11-2023 |
| Drawn by   | MJS       |
| Checked by | FA        |


E1-19

|       |                        |
|-------|------------------------|
| Scale | $\frac{1}{8}" = 1'-0"$ |
|-------|------------------------|



| FIRE ALARM                                                                          |                                                                            |
|-------------------------------------------------------------------------------------|----------------------------------------------------------------------------|
|    | FIRE ALARM PULL STATION                                                    |
|    | FIRE ALARM HORN C/W STROBE (CEILING/WALL)                                  |
|    | FIRE ALARM STROBE (CEILING/WALL)                                           |
|   | FIRE ALARM HORN (NO STROBE)                                                |
|  | MINI HORN (NO STROBE)                                                      |
|  | C/W PUSHBUTTON SILENCER                                                    |
|  | SPEAKER STROBE OR MINI HORN STROBE WITH SILENCER MODULE & PUSHBUTTON BELOW |
|  | SILENCER MODULE C/W PUSHBUTTON                                             |
|  | SILENCER MODULE/REMOTE PUSHBUTTON                                          |
|  | MAGNETIC DOOR HOLDER                                                       |
|  | ALARM BELL                                                                 |
|  | FIRE ALARM SPEAKER                                                         |
|  | FIRE ALARM SPEAKER/STROBE (CEILING/WALL)                                   |
|  | FIRE PHONE                                                                 |
|  | SMOKE DETECTOR / C=SMOKE CO COMBO                                          |
|  | D=DUCT DETECTOR/ A=SMOKE ALARM                                             |
|  | HEAT DETECTOR/ H=HIGH TEMP DETECTOR                                        |
|  | AS=ASPIRING SMOKE DETECTOR                                                 |
|  | RF MODULE                                                                  |
|  | FIRE ALARM POWER SUPPLY                                                    |
|  | SUB BOOSTER PANEL                                                          |

| EMERGENCY                                                                           |                                      |
|-------------------------------------------------------------------------------------|--------------------------------------|
|  | CEILING OR WALL MOUNTED EXIT LIGHT   |
|  | EXIT LIGHT & BATTERY PACK C/W HEADS  |
|  | REMOTE EMERGENCY HEADS               |
|  | REMOTE EMERGENCY HEADS               |
|  | EMERGENCY EXIT SIGN C/W BATTERY PACK |
|  | EMERGENCY HEADS C/W BATTERY PACK     |
|  | FIRE ALARM CONTROL PANEL             |
|  | FIRE ALARM ANNUNCIATION PANEL        |
|  | CHEVRON ARROW                        |

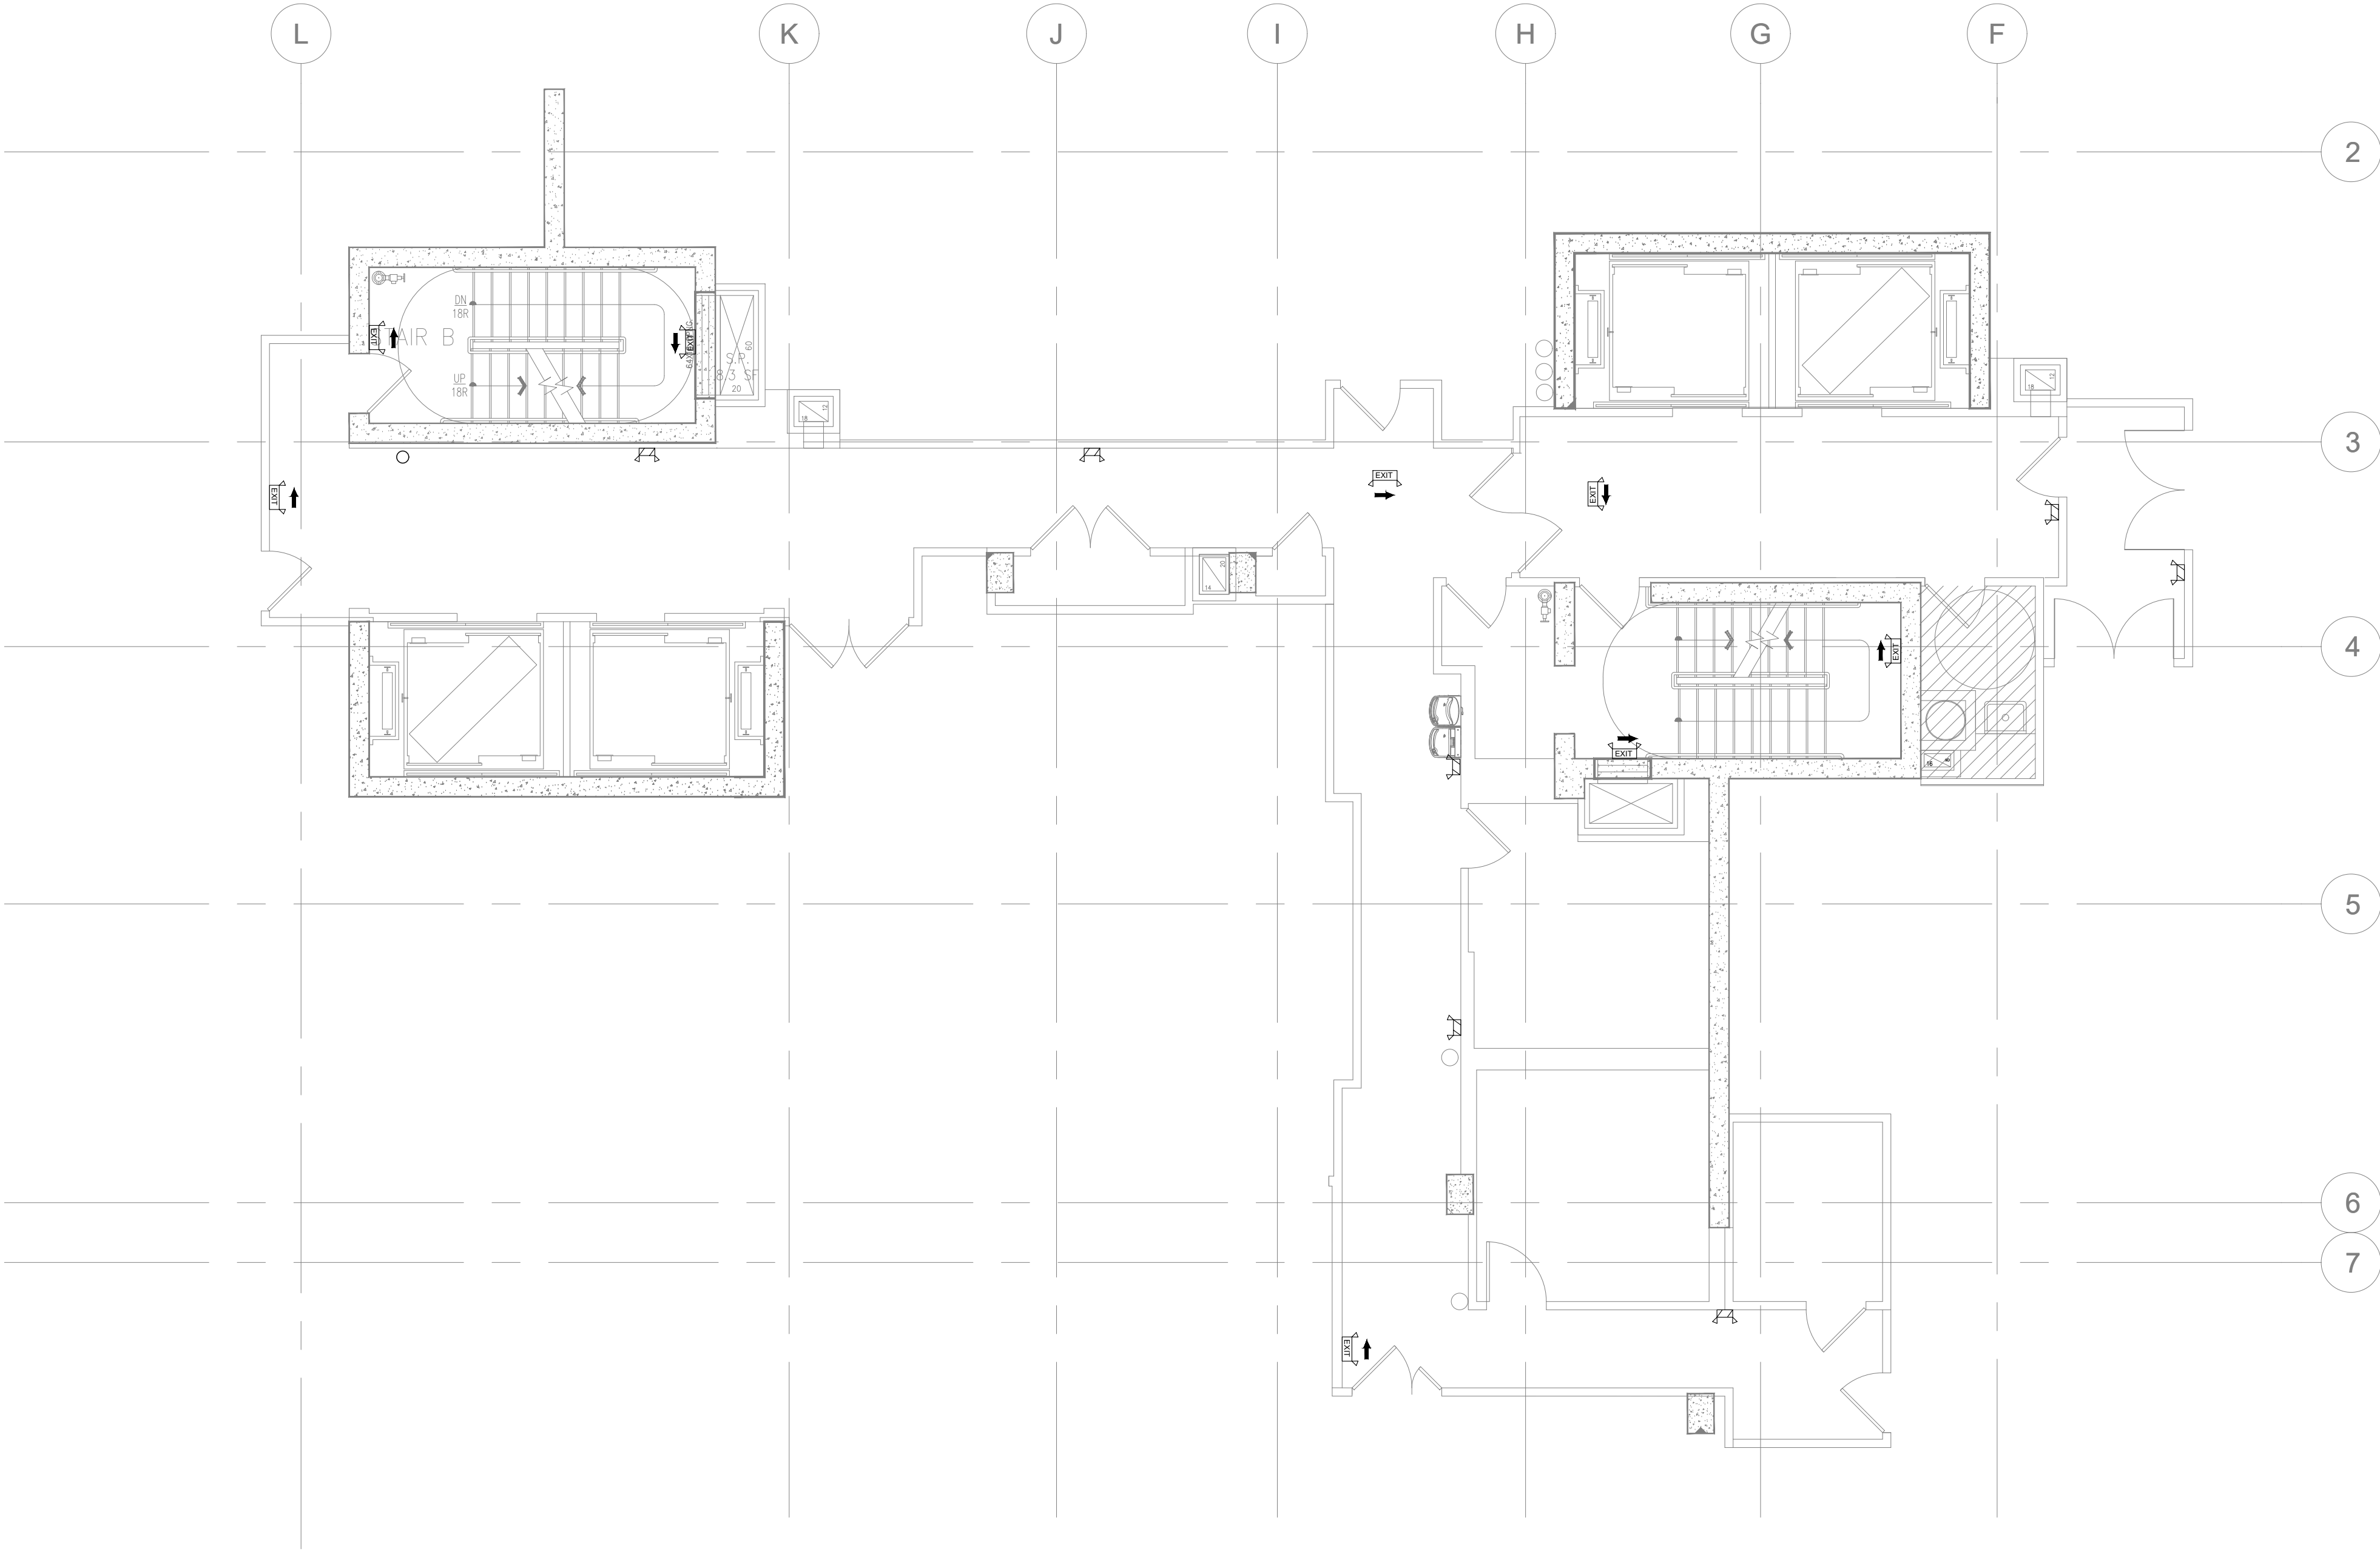

I  
A-2.0  
EMERTGENCY LIGHTING 3RD FLOOR PLAN  
SCALE: 3/16" = 1'-0"  
GROUND LEVEL

PROJECT NAME.

RESTROOMS  
ASANA PARTNERS

DESIGN  
CONSULTANT.

TSABA CORP  
NADIF BRACEY  
254 CHAPMAN RD,  
STE 208 #13130  
NEWARK, DELAWARE  
19702  
EMAIL:  
INFO@TS9DESIGNS.COM

SITE LOCATION.

1000 MAXWELL LANE  
HOBOKEN, NJ 07030

DISCIPLINE.

ELECTRICAL  
FIRE ALARM

| No. | Description | Date |
|-----|-------------|------|
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |

STATE OF NEW JERSEY  
MOHAMED SAID MINOUI  
No.  
GE059074  
LICENSED PROFESSIONAL ENGINEER



Date2-11-2023

Drawn byMJS


Checked byFA

E1-20

Scale1/8"=1'-0"



| FIRE ALARM                                                                          |                                                                               |
|-------------------------------------------------------------------------------------|-------------------------------------------------------------------------------|
|    | FIRE ALARM PULL STATION                                                       |
|    | FIRE ALARM HORN C/W STROBE (CEILING/WALL)                                     |
|    | FIRE ALARM STROBE (CEILING/WALL)                                              |
|    | FIRE ALARM HORN (NO STROBE)                                                   |
|   | MINI HORN (NO STROBE)<br>C/W PUSHBUTTON SILENCER                              |
|  | SPEAKER STROBE OR MINI HORN STROBE<br>WITH SILENCER MODULE & PUSHBUTTON BELOW |
|  | SILENCER MODULE C/W PUSHBUTTON                                                |
|  | SILENCER MODULE/ REMOTE PUSHBUTTON                                            |
|  | MAGNETIC DOOR HOLDER                                                          |
|  | ALARM BELL                                                                    |
|  | FIRE ALARM SPEAKER                                                            |
|  | FIRE ALARM SPEAKER/STROBE (CEILING/WALL)                                      |
|  | FIRE PHONE                                                                    |
|  | SMOKE DETECTOR / C=SMOKE CO COMBO                                             |
|  | D=DUCT DETECTOR/ A=SMOKE ALARM                                                |
|  | HEAT DETECTOR/ H=HIGH TEMP DETECTOR                                           |
|  | AS=ASPIRING SMOKE DETECTOR                                                    |
|  | RF MODULE                                                                     |
|  | FIRE ALARM POWER SUPPLY                                                       |
|  | SUB BOOSTER PANEL                                                             |

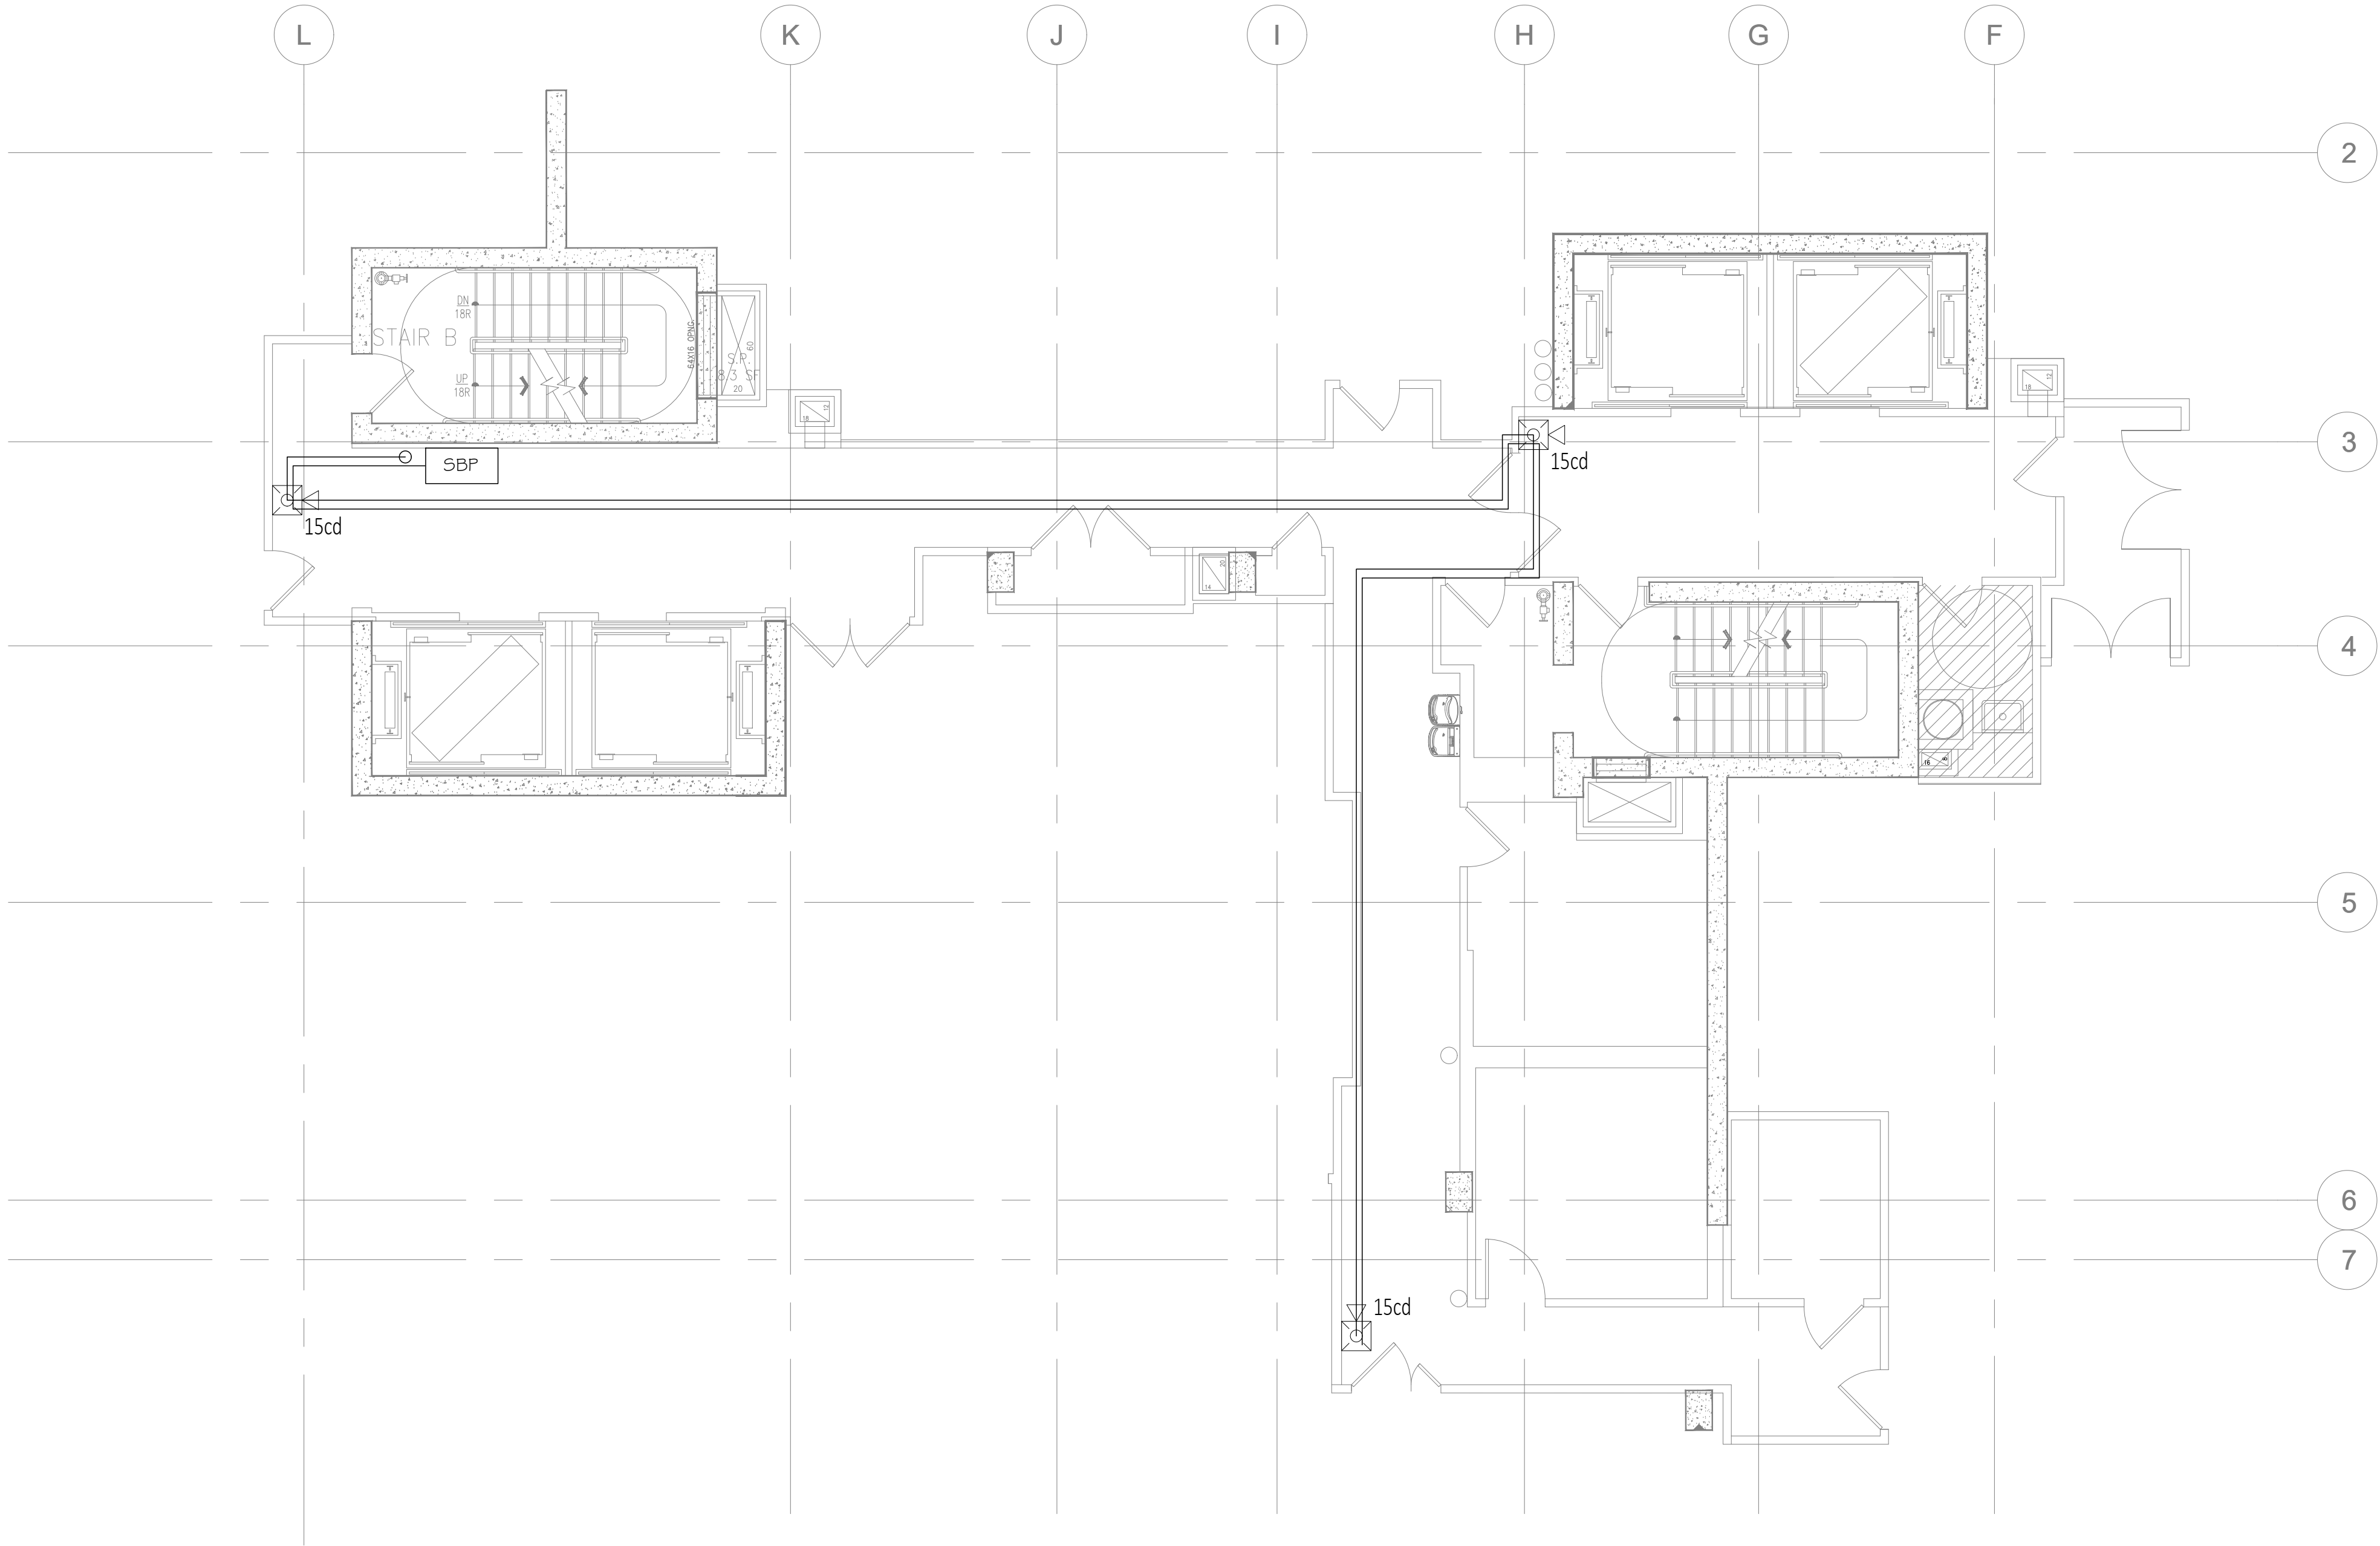

I  
A-2.0

## FIRE ALARM 4TH FLOOR PLAN

SCALE: 3/16" = 1'-0"

GROUND LEVEL

PROJECT NAME.

RESTROOMS  
ASANA PARTNERS

DESIGN  
CONSULTANT.

TSABA CORP  
NADIF BRACEY  
254 CHAPMAN RD,  
STE 208 #13130  
NEWARK, DELAWARE  
19702  
EMAIL:  
INFO@TS9DESIGNS.COM

SITE LOCATION.

1000 MAXWELL LANE  
HOBOKEN, NJ 07030

DISCIPLINE.

ELECTRICAL  
FIRE ALARM


| No. | Description | Date |
|-----|-------------|------|
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |

|                                                                                       |            |
|---------------------------------------------------------------------------------------|------------|
|  |            |
| Date                                                                                  | 2-11-2023  |
| Drawn by                                                                              | MJS        |
| Checked by                                                                            | FA         |
| <b>E1-21</b>                                                                          |            |
| Scale                                                                                 | 1/8"=1'-0" |



| FIRE ALARM                                                                          |                                                                            |
|-------------------------------------------------------------------------------------|----------------------------------------------------------------------------|
|    | FIRE ALARM PULL STATION                                                    |
|    | FIRE ALARM HORN C/W STROBE (CEILING/WALL)                                  |
|    | FIRE ALARM STROBE (CEILING/WALL)                                           |
|    | FIRE ALARM HORN (NO STROBE)                                                |
|    | MINI HORN (NO STROBE)                                                      |
|    | C/W PUSHBUTTON SILENCER                                                    |
|   | SPEAKER STROBE OR MINI HORN STROBE WITH SILENCER MODULE & PUSHBUTTON BELOW |
|  | SILENCER MODULE C/W PUSHBUTTON                                             |
|  | SILENCER MODULE/ REMOTE PUSHBUTTON                                         |
|  | MAGNETIC DOOR HOLDER                                                       |
|  | ALARM BELL                                                                 |
|  | FIRE ALARM SPEAKER                                                         |
|  | FIRE ALARM SPEAKER/STROBE (CEILING/WALL)                                   |
|  | FIRE PHONE                                                                 |
|  | SMOKE DETECTOR / C=SMOKE CO COMBO                                          |
|  | D=DUCT DETECTOR/ A=SMOKE ALARM                                             |
|  | HEAT DETECTOR/ H=HIGH TEMP DETECTOR                                        |
|  | AS=ASPIRING SMOKE DETECTOR                                                 |
|  | RF MODULE                                                                  |
|  | FIRE ALARM POWER SUPPLY                                                    |
|  | SUB BOOSTER PANEL                                                          |

| EMERGENCY                                                                           |                                      |
|-------------------------------------------------------------------------------------|--------------------------------------|
|  | CEILING OR WALL MOUNTED EXIT LIGHT   |
|  | EXIT LIGHT & BATTERY PACK C/W HEADS  |
|  | REMOTE EMERGENCY HEADS               |
|  | REMOTE EMERGENCY HEADS               |
|  | EMERGENCY EXIT SIGN C/W BATTERY PACK |
|  | EMERGENCY HEADS C/W BATTERY PACK     |
|  | FIRE ALARM CONTROL PANEL             |
|  | FIRE ALARM ANNUNCIATION PANEL        |
|  | CHEVRON ARROW                        |

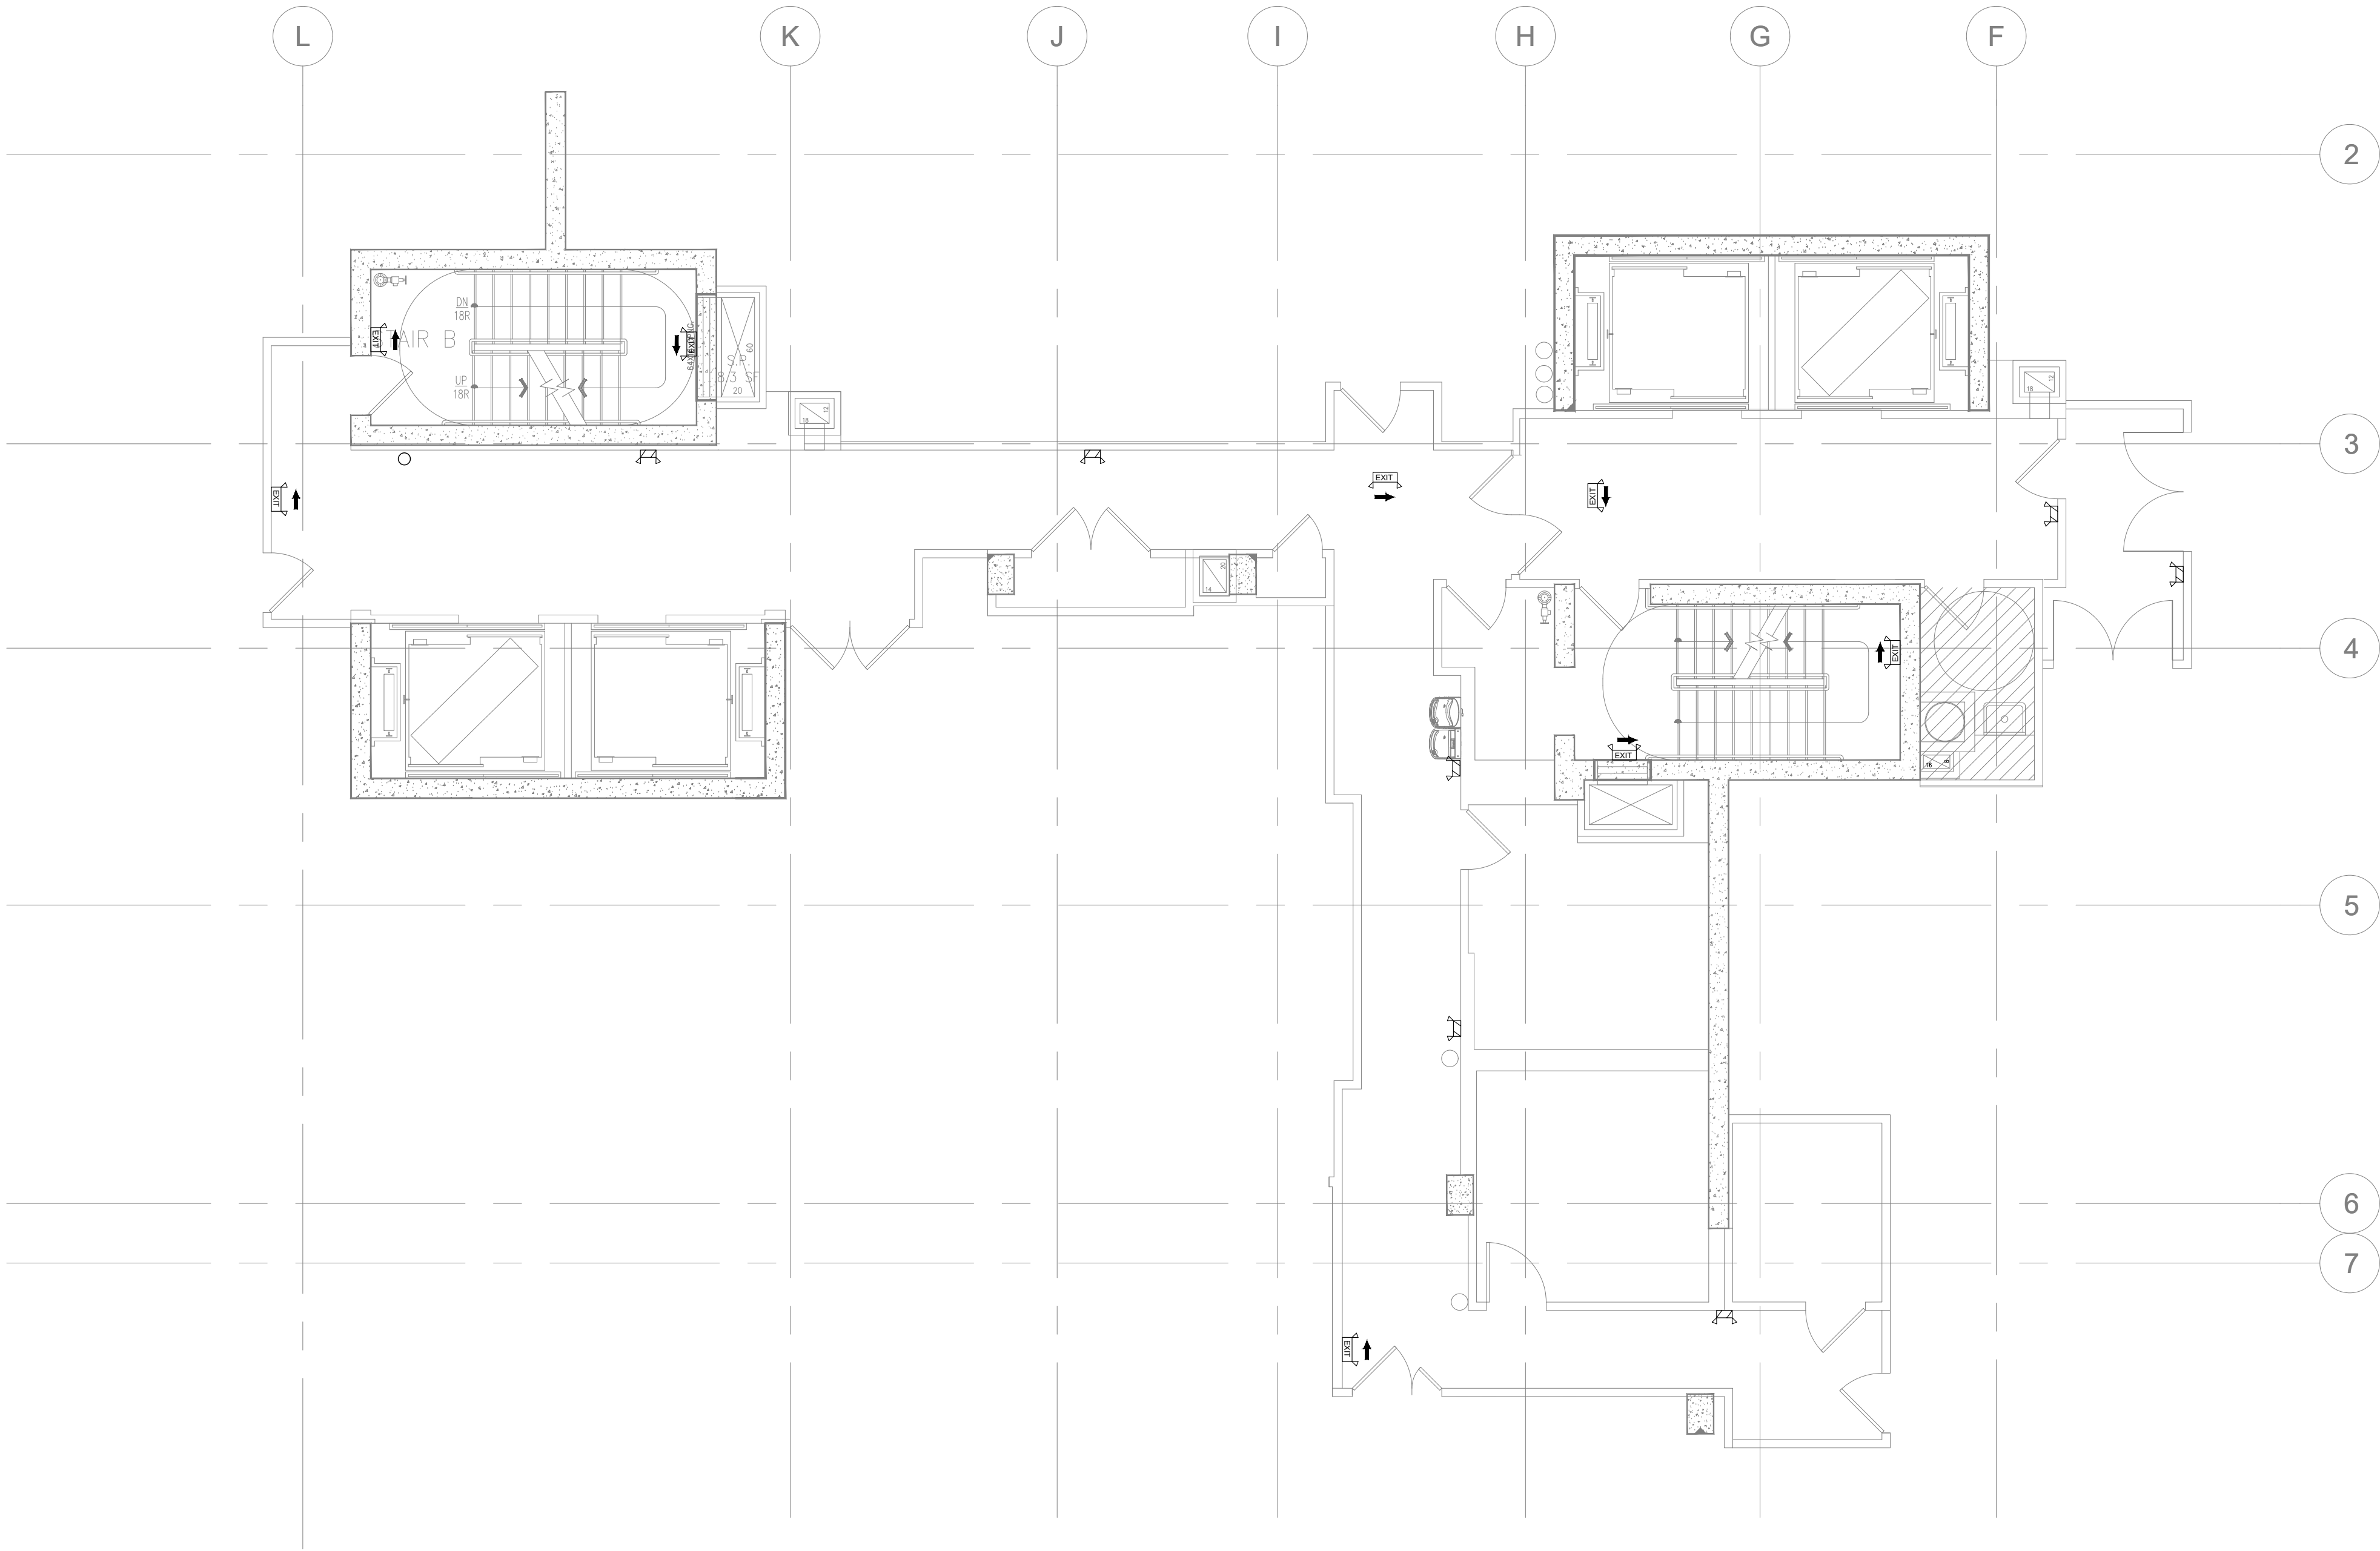

1  
A-2.0

EMERTGENCY LIGHTING 4TH FLOOR PLAN

SCALE: 3/16" = 1'-0"

GROUND LEVEL

PROJECT NAME.

RESTROOMS  
ASANA PARTNERS

DESIGN  
CONSULTANT.

TSABA CORP  
NADIF BRACEY  
254 CHAPMAN RD,  
STE 208 #13130  
NEWARK, DELAWARE  
19702  
EMAIL:  
INFO@TS9DESIGNS.COM

SITE LOCATION.

1000 MAXWELL LANE  
HOBOKEN, NJ 07030

DISCIPLINE.

ELECTRICAL  
FIRE ALARM

| No. | Description | Date |
|-----|-------------|------|
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |



Date 2-11-2023  
Drawn by MJS  
Checked by FA

**E1-22**

Scale 1/8"=1'-0"



Architectural floor plan of the first floor of a building. The plan is overlaid with a grid labeled L through F horizontally and 2 through 7 vertically. Key features include:

- STAIR B:** Located in the top left corner, showing a staircase with 'UP' and 'DOWN' directions.
- Rooms and Corridors:** Various rooms and corridors are shown, including a large open area in the center and several smaller rooms.
- Structural Elements:** Walls, doors, windows, and structural columns are indicated.
- Labels:** Three '15cd' labels are present, indicating specific structural or construction details.


GROUND LEVEL

|            |                          |
|------------|--------------------------|
| Date       | 2-11-2023                |
| Drawn by   | MJS                      |
| Checked by | FA                       |
| E1-23      |                          |
| Scale      | $\frac{1}{8}'' = 1'-0''$ |



| FIRE ALARM                                                                          |                                                                            |
|-------------------------------------------------------------------------------------|----------------------------------------------------------------------------|
|    | FIRE ALARM PULL STATION                                                    |
|    | FIRE ALARM HORN C/W STROBE (CEILING/WALL)                                  |
|    | FIRE ALARM STROBE (CEILING/WALL)                                           |
|    | FIRE ALARM HORN (NO STROBE)                                                |
|   | MINI HORN (NO STROBE)                                                      |
|  | C/W PUSHBUTTON SILENCER                                                    |
|  | SPEAKER STROBE OR MINI HORN STROBE WITH SILENCER MODULE & PUSHBUTTON BELOW |
|  | SILENCER MODULE C/W PUSHBUTTON                                             |
|  | SILENCER MODULE/ REMOTE PUSHBUTTON                                         |
|  | MAGNETIC DOOR HOLDER                                                       |
|  | ALARM BELL                                                                 |
|  | FIRE ALARM SPEAKER                                                         |
|  | FIRE ALARM SPEAKER/STROBE (CEILING/WALL)                                   |
|  | FIRE PHONE                                                                 |
|  | SMOKE DETECTOR / C=SMOKE CO COMBO                                          |
|  | D=DUCT DETECTOR/ A=SMOKE ALARM                                             |
|  | HEAT DETECTOR/ H=HIGH TEMP DETECTOR                                        |
|  | AS=ASPIRING SMOKE DETECTOR                                                 |
|  | RF MODULE                                                                  |
|  | FIRE ALARM POWER SUPPLY                                                    |
|  | SUB BOOSTER PANEL                                                          |

| EMERGENCY                                                                           |                                      |
|-------------------------------------------------------------------------------------|--------------------------------------|
|  | CEILING OR WALL MOUNTED EXIT LIGHT   |
|  | EXIT LIGHT & BATTERY PACK C/W HEADS  |
|  | REMOTE EMERGENCY HEADS               |
|  | REMOTE EMERGENCY HEADS               |
|  | EMERGENCY EXIT SIGN C/W BATTERY PACK |
|  | EMERGENCY HEADS C/W BATTERY PACK     |
|  | FIRE ALARM CONTROL PANEL             |
|  | FIRE ALARM ANNUNCIATION PANEL        |
|  | CHEVRON ARROW                        |

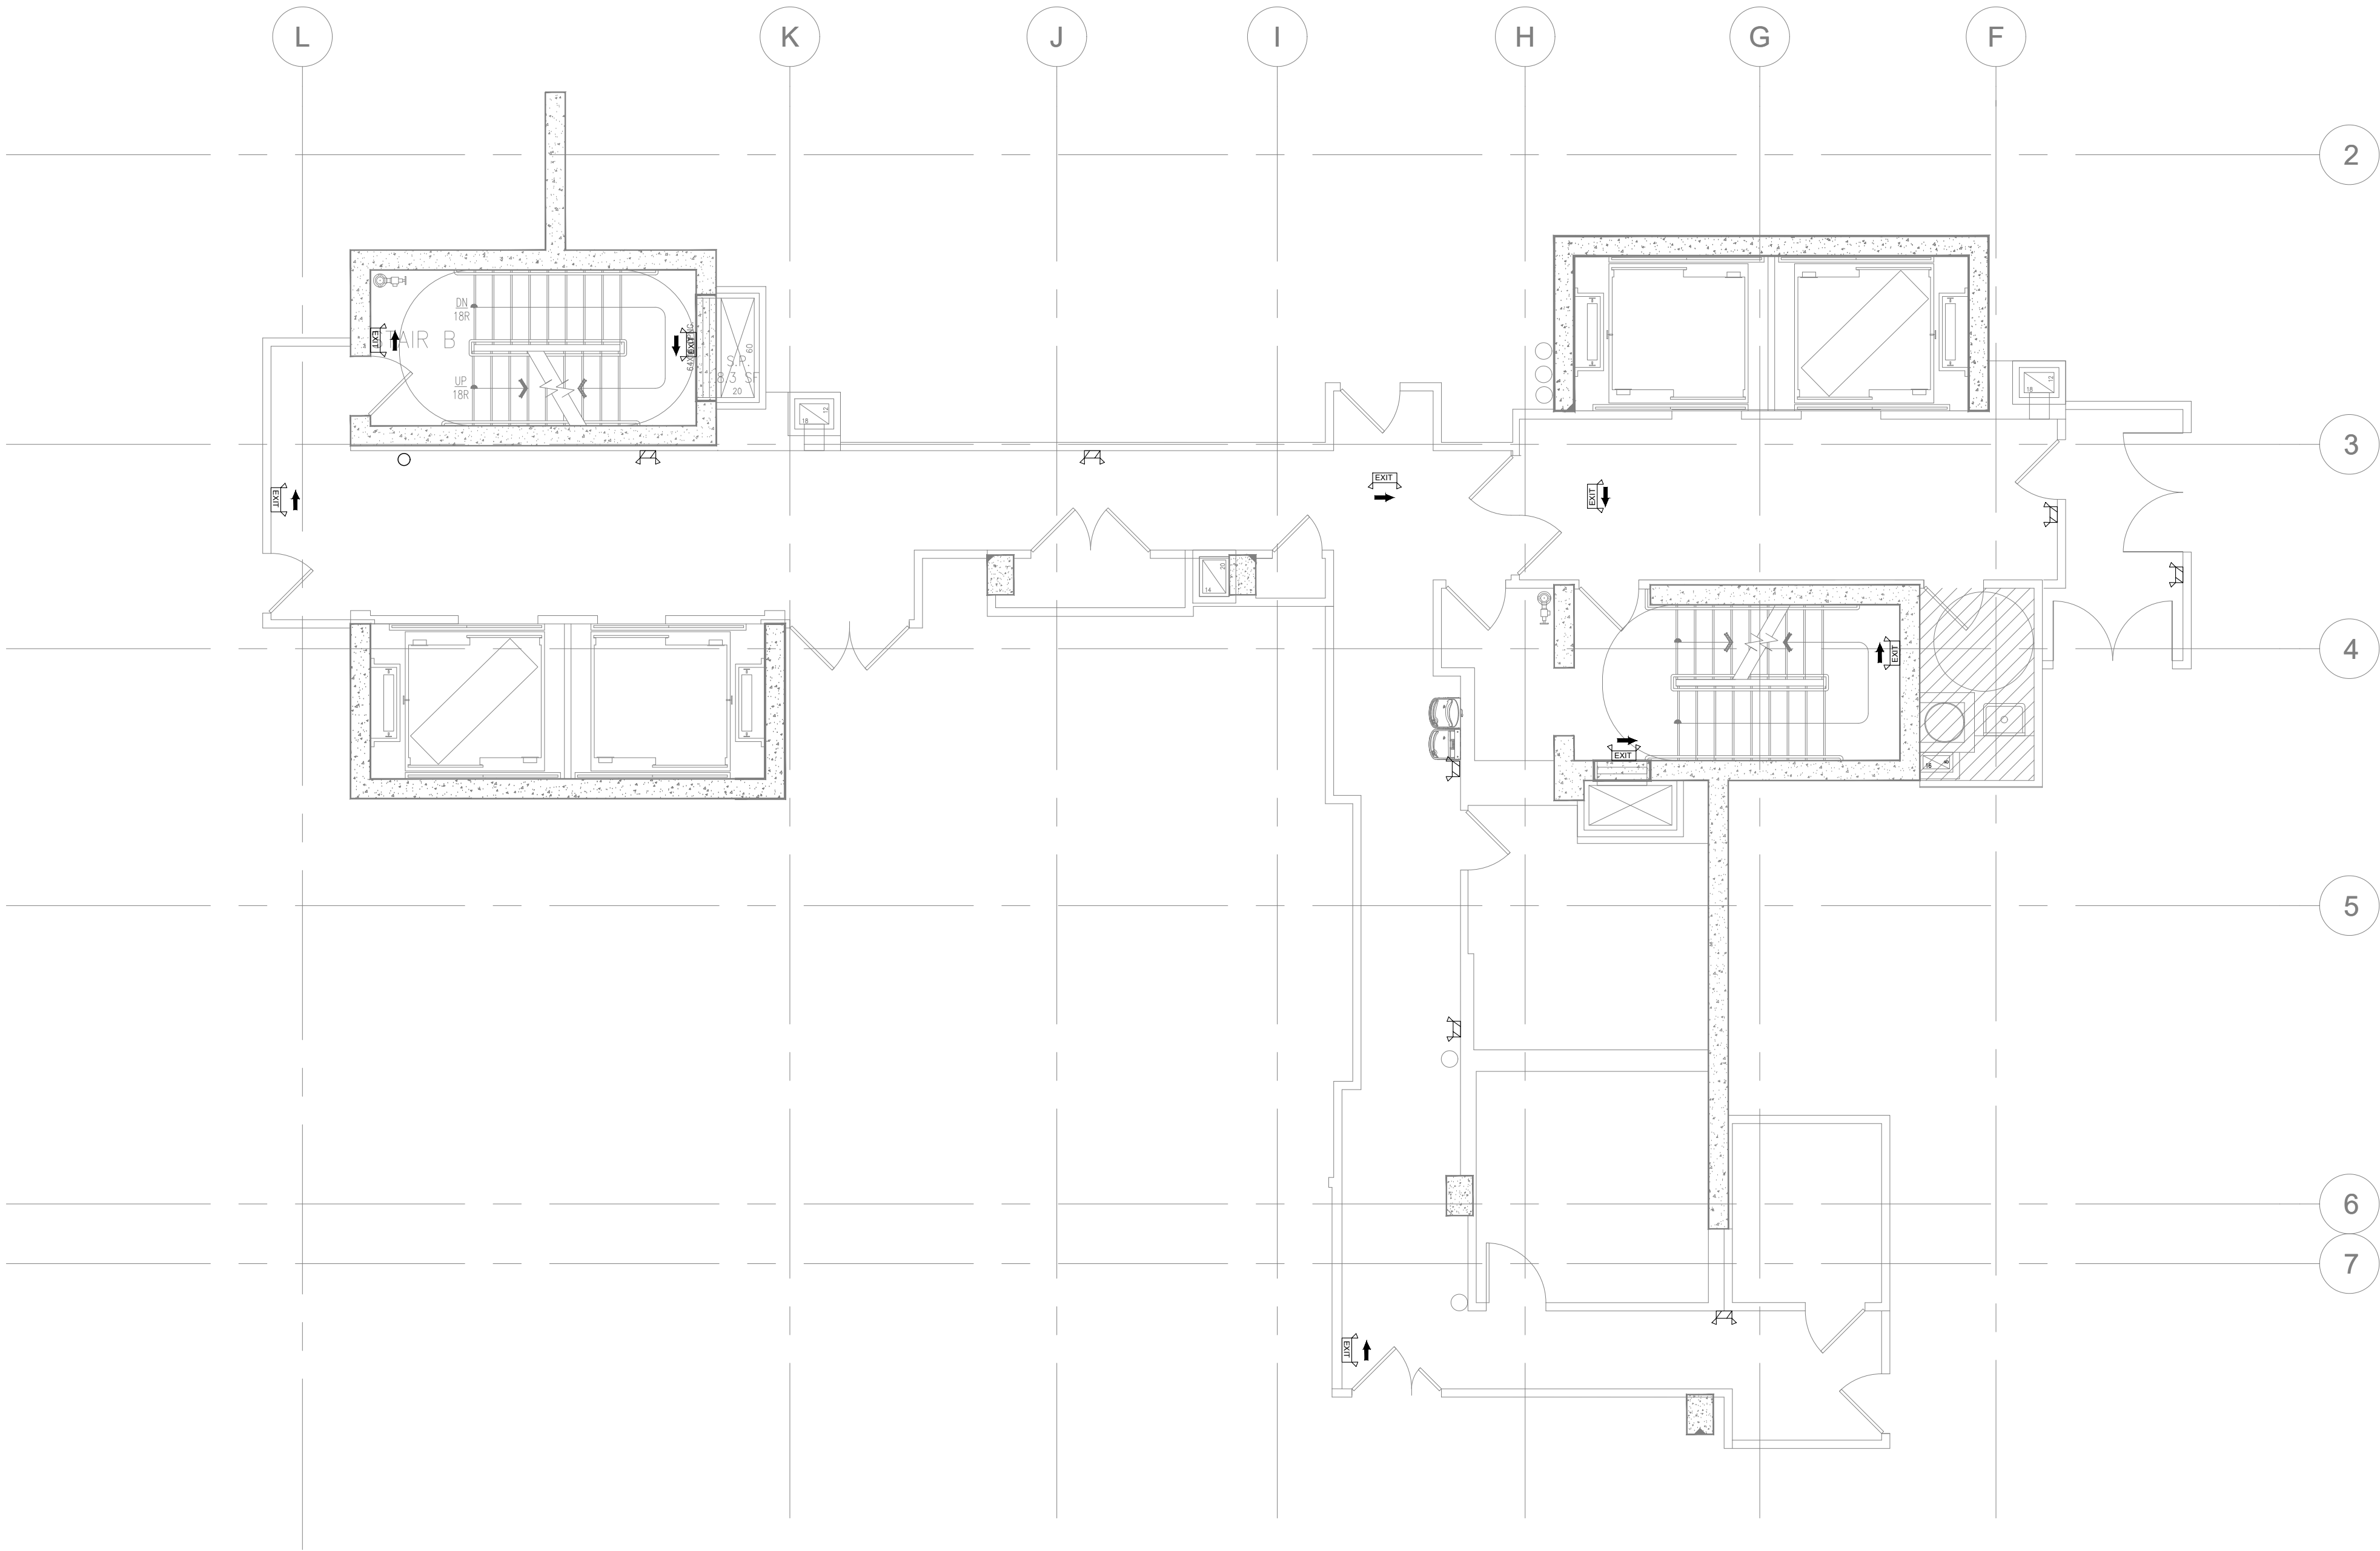

1  
A-2.0

EMERTGENCY LIGHTING 5TH FLOOR PLAN

SCALE: 3/16" = 1'-0" GROUND LEVEL

PROJECT NAME.

RESTROOMS  
ASANA PARTNERS

DESIGN  
CONSULTANT.

TSABA CORP  
NADIF BRACEY  
254 CHAPMAN RD,  
STE 208 #13130  
NEWARK, DELAWARE  
19702  
EMAIL:  
INFO@TS9DESIGNS.COM

SITE LOCATION.

1000 MAXWELL LANE  
HOBOKEN, NJ 07030

DISCIPLINE.

ELECTRICAL  
FIRE ALARM

| No. | Description | Date |
|-----|-------------|------|
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |



STATE OF NEW JERSEY  
MOHAMED SAID MHAMED  
No. GE059074  
LICENSED PROFESSIONAL ENGINEER

|            |            |
|------------|------------|
| Date       | 2-11-2023  |
| Drawn by   | MJS        |
| Checked by | FA         |
| E1-24      |            |
| Scale      | 1/8"=1'-0" |






[illegible]


GROUND LEVEL

|            |                          |
|------------|--------------------------|
| Date       | 2-11-2023                |
| Drawn by   | MJS                      |
| Checked by | FA                       |
| E1-25      |                          |
| Scale      | $\frac{1}{8}'' = 1'-0''$ |



| FIRE ALARM                                                                          |                                                                            |
|-------------------------------------------------------------------------------------|----------------------------------------------------------------------------|
|    | FIRE ALARM PULL STATION                                                    |
|    | FIRE ALARM HORN C/W STROBE (CEILING/WALL)                                  |
|    | FIRE ALARM STROBE (CEILING/WALL)                                           |
|    | FIRE ALARM HORN (NO STROBE)                                                |
|    | MINI HORN (NO STROBE)                                                      |
|    | C/W PUSHBUTTON SILENCER                                                    |
|   | SPEAKER STROBE OR MINI HORN STROBE WITH SILENCER MODULE & PUSHBUTTON BELOW |
|  | SILENCER MODULE C/W PUSHBUTTON                                             |
|  | SILENCER MODULE/ REMOTE PUSHBUTTON                                         |
|  | MAGNETIC DOOR HOLDER                                                       |
|  | ALARM BELL                                                                 |
|  | FIRE ALARM SPEAKER                                                         |
|  | FIRE ALARM SPEAKER/STROBE (CEILING/WALL)                                   |
|  | FIRE PHONE                                                                 |
|  | SMOKE DETECTOR / C=SMOKE CO COMBO                                          |
|  | D=DUCT DETECTOR/ A=SMOKE ALARM                                             |
|  | HEAT DETECTOR/ H=HIGH TEMP DETECTOR                                        |
|  | AS=ASPIRING SMOKE DETECTOR                                                 |
|  | RF MODULE                                                                  |
|  | FIRE ALARM POWER SUPPLY                                                    |
|  | SUB BOOSTER PANEL                                                          |

| EMERGENCY                                                                           |                                      |
|-------------------------------------------------------------------------------------|--------------------------------------|
|  | CEILING OR WALL MOUNTED EXIT LIGHT   |
|  | EXIT LIGHT & BATTERY PACK C/W HEADS  |
|  | REMOTE EMERGENCY HEADS               |
|  | REMOTE EMERGENCY HEADS               |
|  | EMERGENCY EXIT SIGN C/W BATTERY PACK |
|  | EMERGENCY HEADS C/W BATTERY PACK     |
|  | FIRE ALARM CONTROL PANEL             |
|  | FIRE ALARM ANNUNCIATION PANEL        |
|  | CHEVRON ARROW                        |

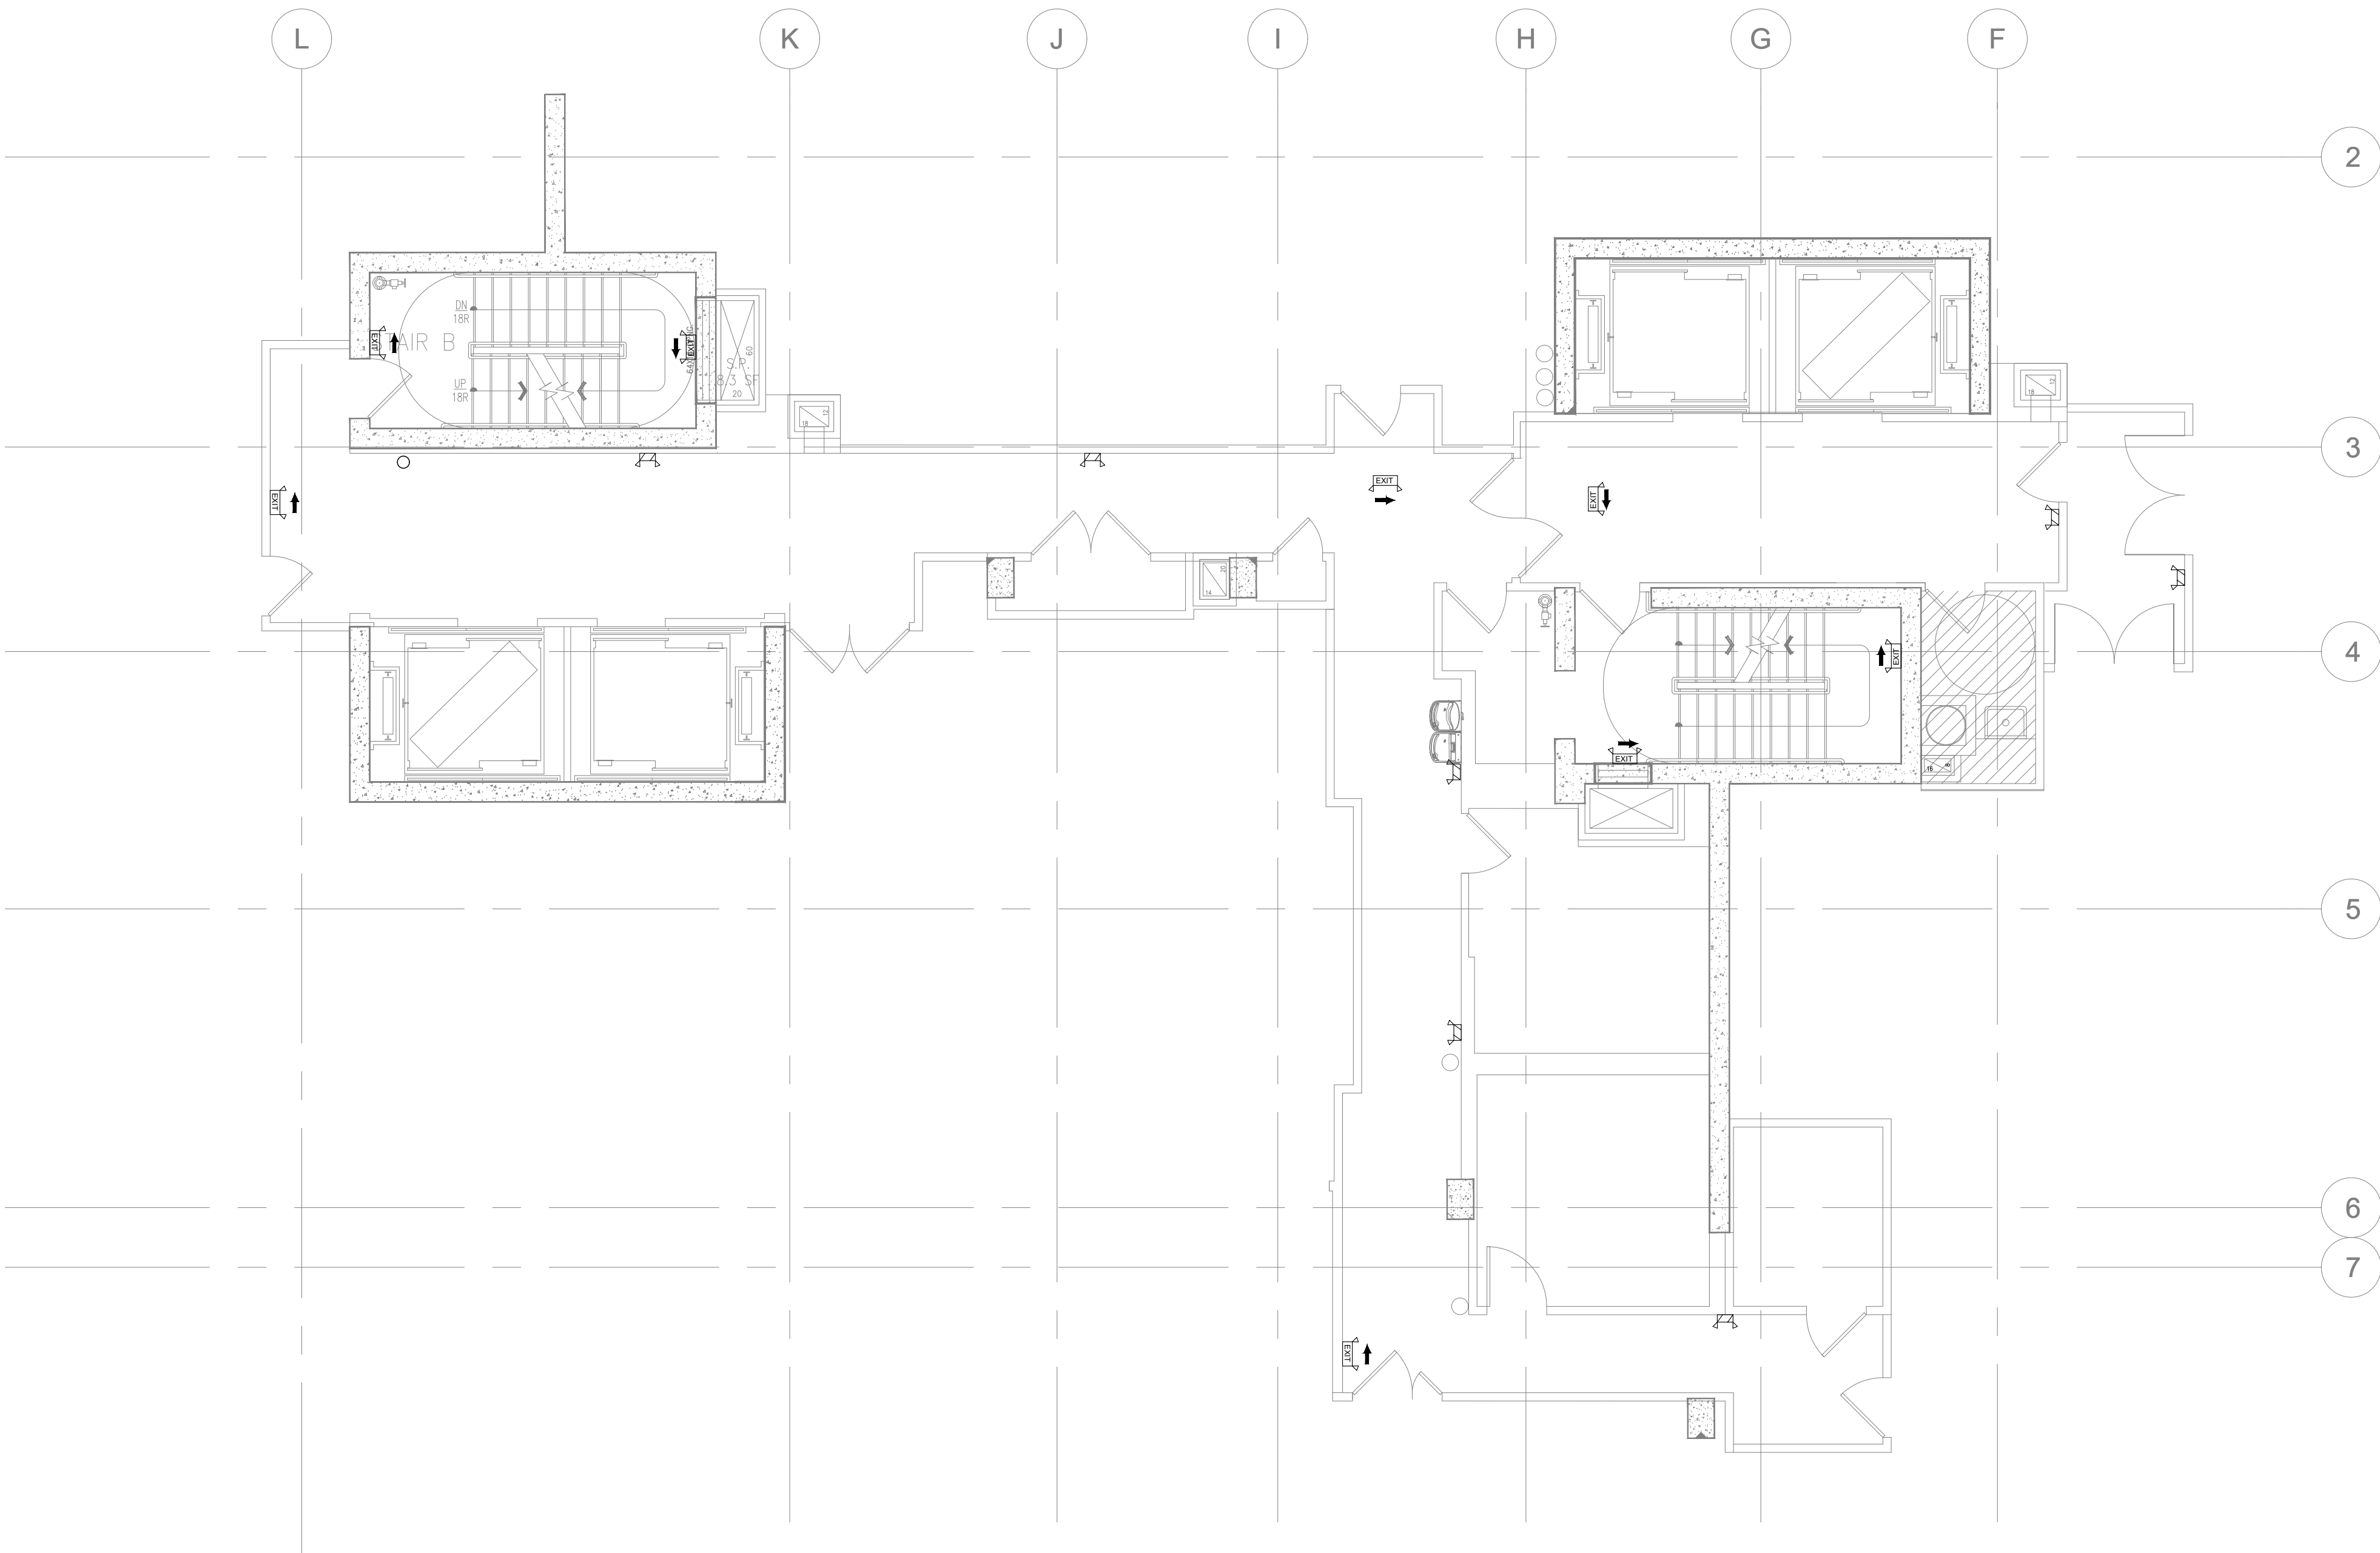

1  
A-2.0

# EMERTGENCY LIGHTING 6TH FLOOR PLAN

SCALE: 3/16" = 1'-0"

GROUND LEVEL

PROJECT NAME.

RESTROOMS  
ASANA PARTNERS

DESIGN  
CONSULTANT.

TSABA CORP  
NADIF BRACEY  
254 CHAPMAN RD,  
STE 208 #13130  
NEWARK, DELAWARE  
19702  
EMAIL:  
INFO@TS9DESIGNS.COM

SITE LOCATION.

1000 MAXWELL LANE  
HOBOKEN, NJ 07030

DISCIPLINE.

ELECTRICAL  
FIRE ALARM

| No. | Description | Date |
|-----|-------------|------|
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |


STATE OF NEW JERSEY  
MOHAMED SAID MINOUI  
No.  
GE059074  
LICENSED PROFESSIONAL ENGINEER



Date2-11-2023  
Drawn byMJS  
Checked byFA

E1-26  
Scale1/8"=1'-0"



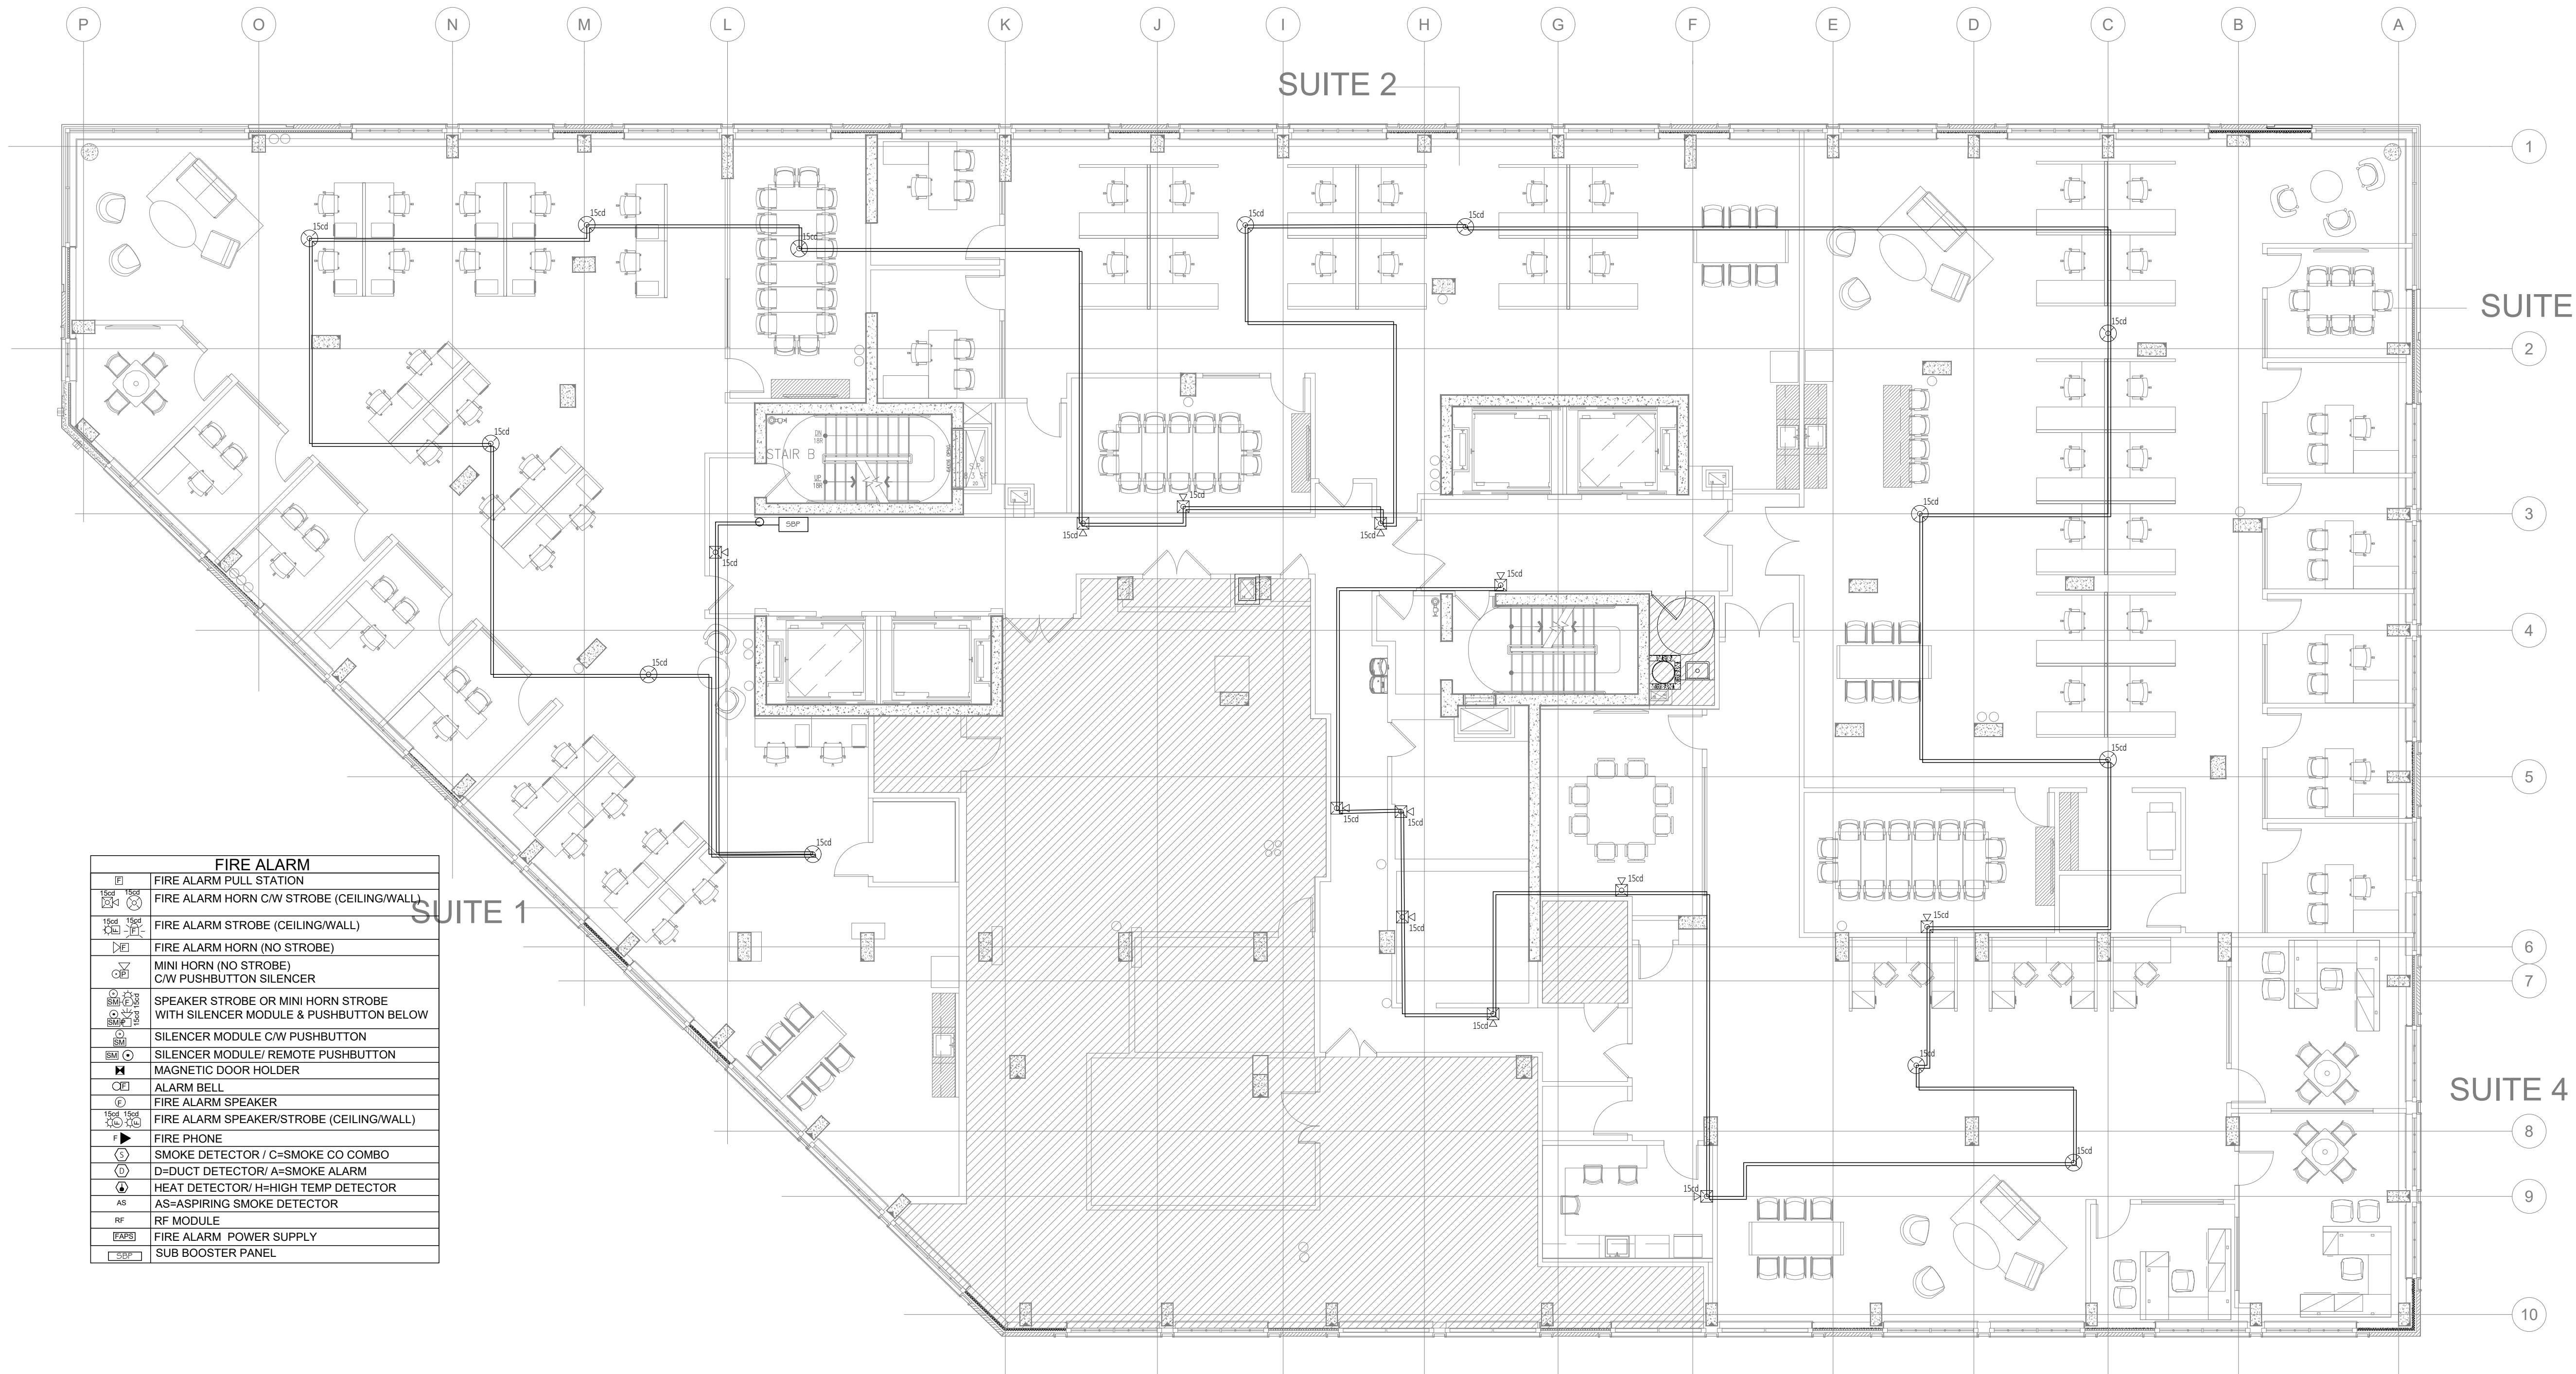

| FIRE ALARM |                                                                            |
|------------|----------------------------------------------------------------------------|
|            | FIRE ALARM PULL STATION                                                    |
|            | FIRE ALARM HORN C/W STROBE (CEILING/WALL)                                  |
|            | FIRE ALARM STROBE (CEILING/WALL)                                           |
|            | FIRE ALARM HORN (NO STROBE)                                                |
|            | MINI HORN (NO STROBE)                                                      |
|            | C/W PUSHBUTTON SILENCER                                                    |
|            | SPEAKER STROBE OR MINI HORN STROBE WITH SILENCER MODULE & PUSHBUTTON BELOW |
|            | SILENCER MODULE C/W PUSHBUTTON                                             |
|            | SILENCER MODULE/ REMOTE PUSHBUTTON                                         |
|            | MAGNETIC DOOR HOLDER                                                       |
|            | ALARM BELL                                                                 |
|            | FIRE ALARM SPEAKER                                                         |
|            | FIRE ALARM SPEAKER/STROBE (CEILING/WALL)                                   |
|            | FIRE PHONE                                                                 |
|            | SMOKE DETECTOR / C=SMOKE CO COMBO                                          |
|            | D=DUCT DETECTOR/ A=SMOKE ALARM                                             |
|            | HEAT DETECTOR/ H=HIGH TEMP DETECTOR                                        |
|            | AS=ASPIRING SMOKE DETECTOR                                                 |
|            | RF MODULE                                                                  |
|            | FIRE ALARM POWER SUPPLY                                                    |
|            | SUB BOOSTER PANEL                                                          |

FIRE ALARM 7TH FLOOR PLAN  
SCALE: 3/8" = 1'-0"  
GROUND LEVEL

PROJECT NAME.

RESTROOMS  
ASANA PARTNERS

DESIGN  
CONSULTANT.

TSABA CORP  
NADIF BRACEY  
254 CHAPMAN RD,  
STE 208 #13130  
NEWARK, DELAWARE  
19702  
EMAIL:  
INFO@TS9DESIGNS.COM

SITE LOCATION.

1000 MAXWELL LANE  
HOBOKEN, NJ 07030

DISCIPLINE.

ELECTRICAL  
FIRE ALARM


| No. | Description | Date |
|-----|-------------|------|
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |

Date 2-11-2023  
Drawn by MJS  
Checked by FA

E1-27

Scale 1/16"=1'-0"



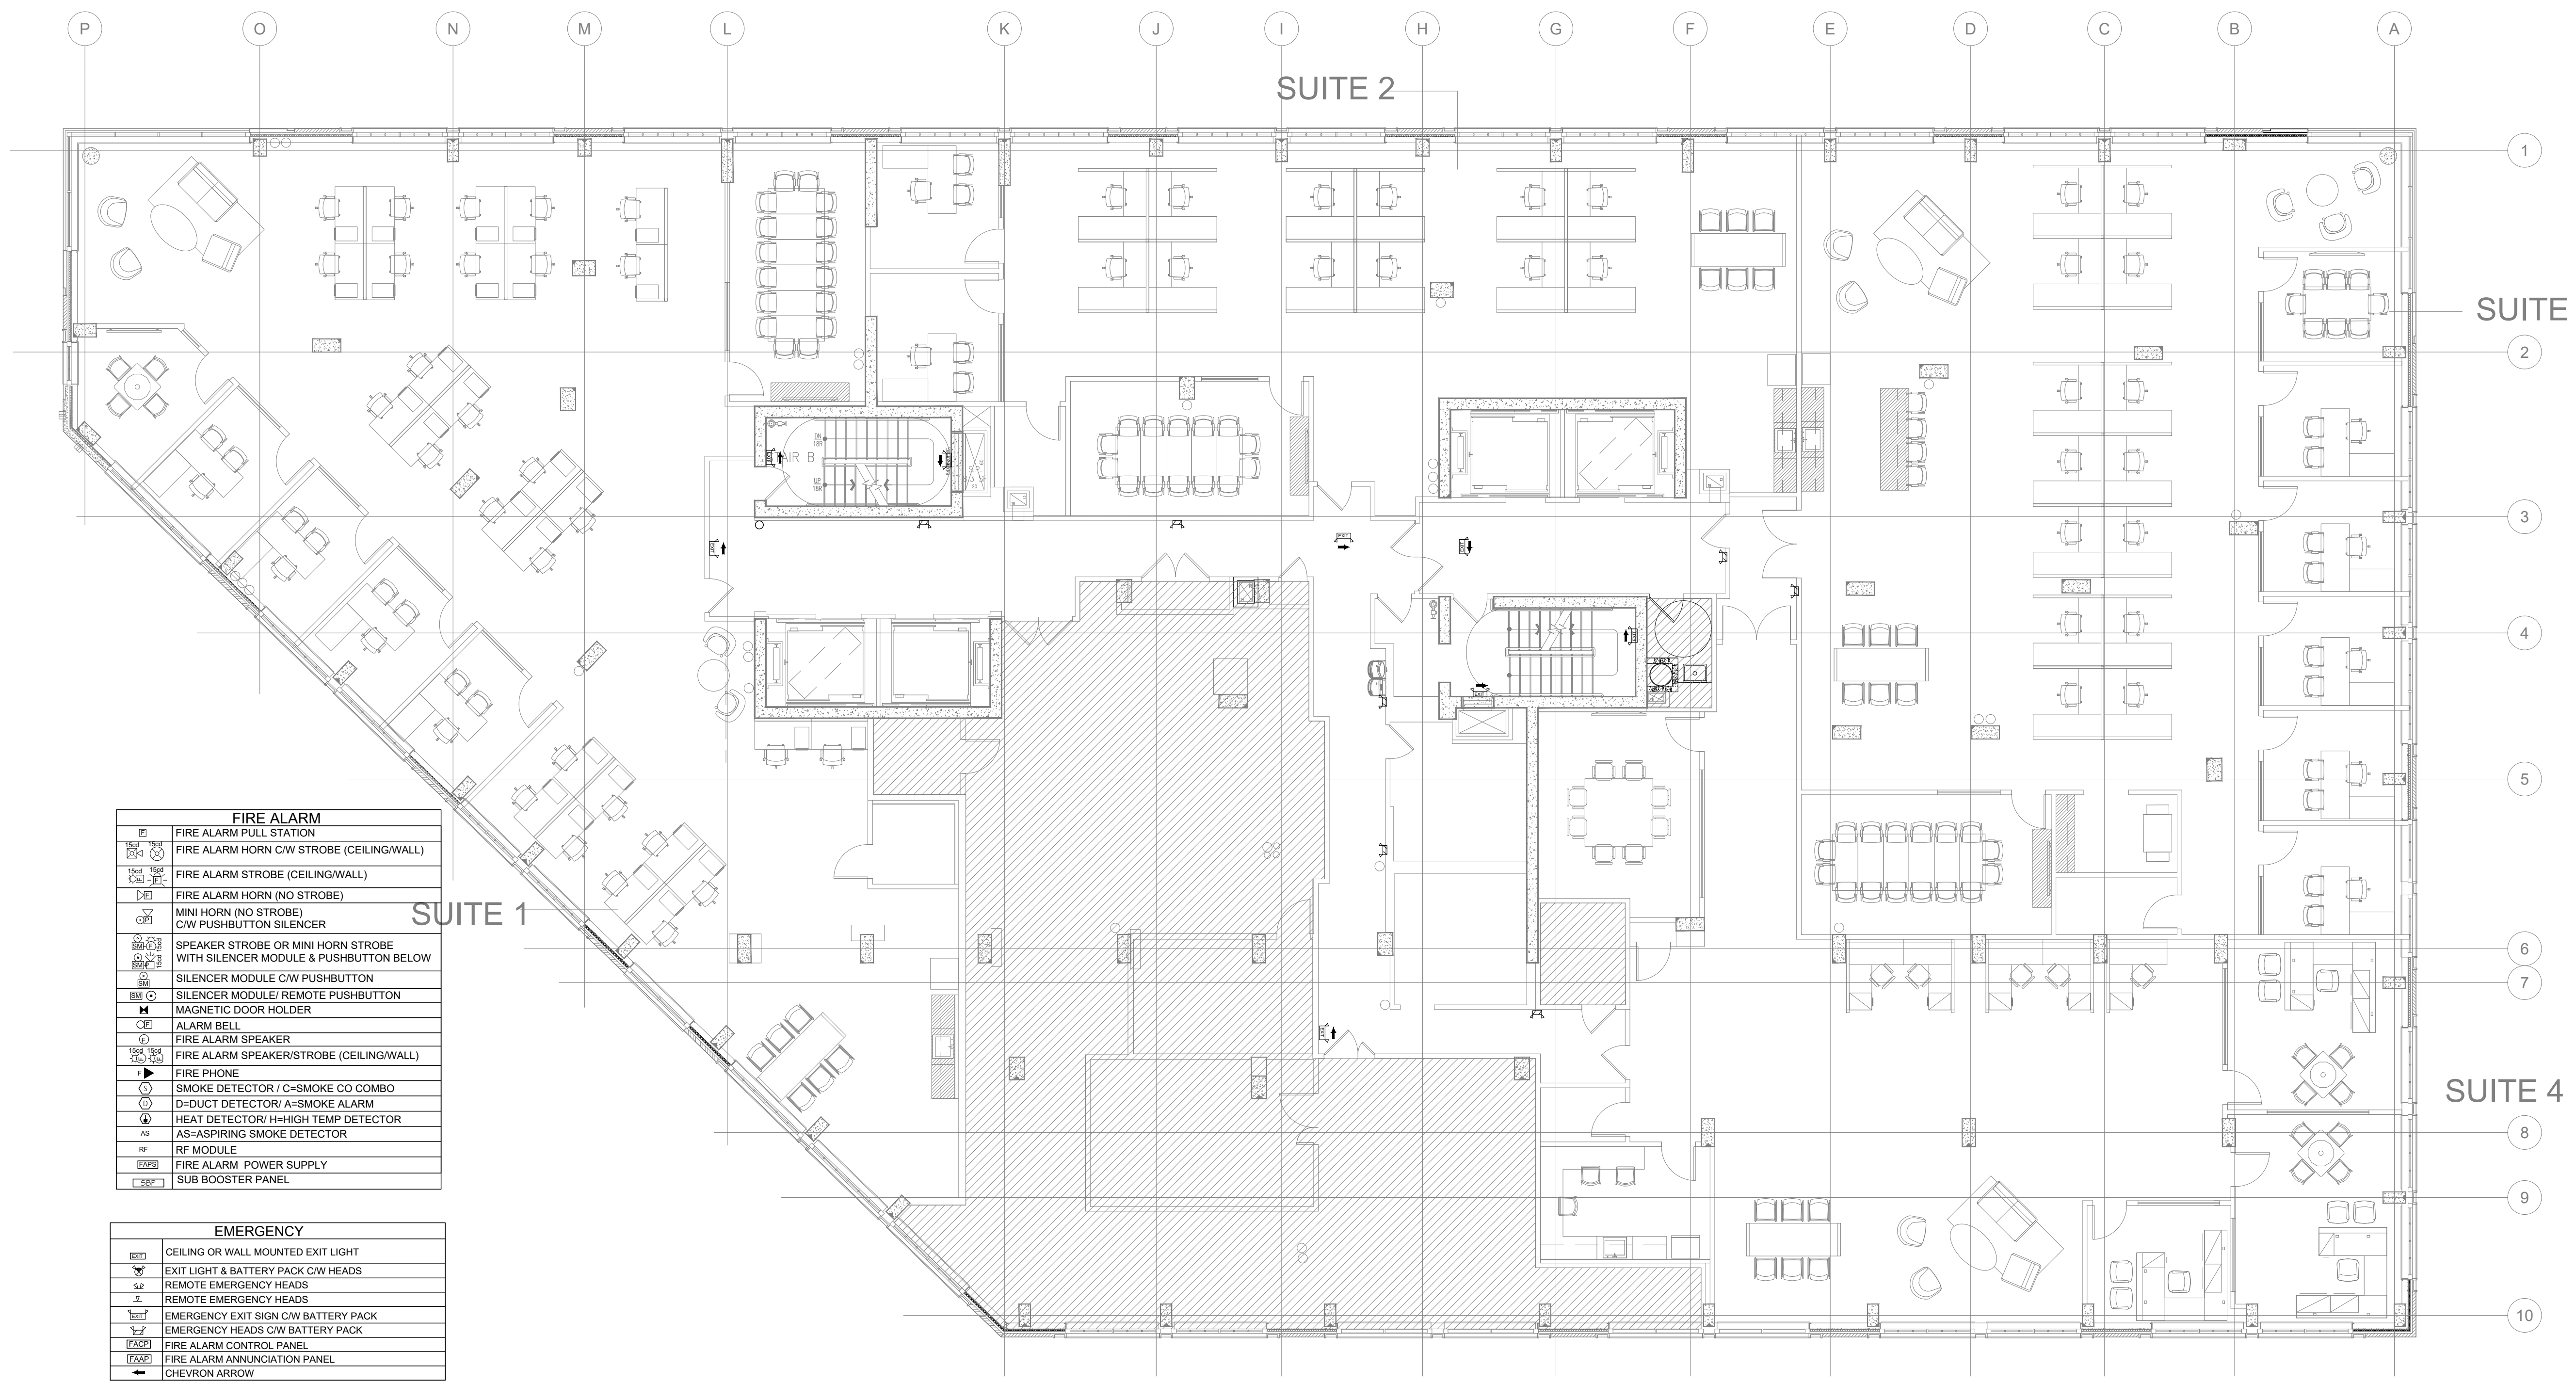

| FIRE ALARM |                                                                            |
|------------|----------------------------------------------------------------------------|
|            | FIRE ALARM PULL STATION                                                    |
|            | FIRE ALARM HORN C/W STROBE (CEILING/WALL)                                  |
|            | FIRE ALARM STROBE (CEILING/WALL)                                           |
|            | FIRE ALARM HORN (NO STROBE)                                                |
|            | MINI HORN (NO STROBE)                                                      |
|            | C/W PUSHBUTTON SILENCER                                                    |
|            | SPEAKER STROBE OR MINI HORN STROBE WITH SILENCER MODULE & PUSHBUTTON BELOW |
|            | SILENCER MODULE C/W PUSHBUTTON                                             |
|            | SILENCER MODULE/ REMOTE PUSHBUTTON                                         |
|            | MAGNETIC DOOR HOLDER                                                       |
|            | ALARM BELL                                                                 |
|            | FIRE ALARM SPEAKER                                                         |
|            | FIRE ALARM SPEAKER/STROBE (CEILING/WALL)                                   |
|            | FIRE PHONE                                                                 |
|            | SMOKE DETECTOR / C=SMOKE CO COMBO                                          |
|            | D=DUCT DETECTOR/ A=SMOKE ALARM                                             |
|            | HEAT DETECTOR/ H=HIGH TEMP DETECTOR                                        |
|            | AS=ASPIRING SMOKE DETECTOR                                                 |
|            | RF MODULE                                                                  |
|            | FIRE ALARM POWER SUPPLY                                                    |
|            | SUB BOOSTER PANEL                                                          |

| EMERGENCY |                                      |
|-----------|--------------------------------------|
|           | CEILING OR WALL MOUNTED EXIT LIGHT   |
|           | EXIT LIGHT & BATTERY PACK C/W HEADS  |
|           | REMOTE EMERGENCY HEADS               |
|           | REMOTE EMERGENCY HEADS               |
|           | EMERGENCY EXIT SIGN C/W BATTERY PACK |
|           | EMERGENCY HEADS C/W BATTERY PACK     |
|           | FIRE ALARM CONTROL PANEL             |
|           | FIRE ALARM ANNUNCIATION PANEL        |
|           | CHEVRON ARROW                        |

1  
A-2.0  
EMERTGENCY LIGHTING 7TH FLOOR PLAN  
SCALE: 3/4" = 1'-0"  
GROUND LEVEL

PROJECT NAME.

RESTROOMS  
ASANA PARTNERS

DESIGN  
CONSULTANT.

TSABA CORP  
NADIF BRACEY  
254 CHAPMAN RD,  
STE 208 #13130  
NEWARK, DELAWARE  
19702  
EMAIL:  
INFO@TS9DESIGNS.COM


SITE LOCATION.

1000 MAXWELL LANE  
HOBOKEN, NJ 07030

DISCIPLINE.

ELECTRICAL  
FIRE ALARM

| No. | Description | Date |
|-----|-------------|------|
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |

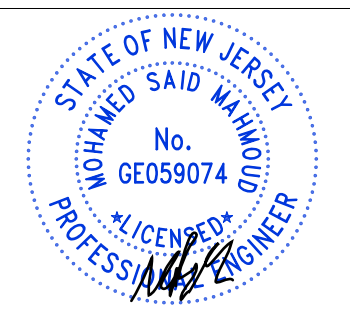

|            |           |
|------------|-----------|
| Date       | 2-11-2023 |
| Drawn by   | MJS       |
| Checked by | FA        |

E1-28

|       |            |
|-------|------------|
| Scale | 1/8"=1'-0" |
|-------|------------|



| LOOP 1 voltage drops                        |          |                                    |                              |                  |                            |                   |                         |
|---------------------------------------------|----------|------------------------------------|------------------------------|------------------|----------------------------|-------------------|-------------------------|
| #12 fire cable per feet resistance 0.002ohm |          |                                    |                              |                  |                            |                   |                         |
| Sr/No                                       | Item     | Length of wire(ft) from last point | Length of wire(ft) from FACP | Resistance (ohm) | Current (340uA) per device | Voltage drop (mV) | Voltage at sensor (24V) |
| 1                                           | L1-MC-01 | 5                                  | 5                            | 0.01             | 0.00442                    | 0.0442            | 23.9999558              |
| 2                                           | L1-SD-02 | 10                                 | 15                           | 0.03             | 0.00408                    | 0.1224            | 23.9998334              |
| 3                                           | L1-SD-03 | 25                                 | 40                           | 0.08             | 0.00408                    | 0.3264            | 23.999507               |
| 4                                           | L1-SD-04 | 23                                 | 63                           | 0.126            | 0.00374                    | 0.47124           | 23.99903576             |
| 5                                           | L1-MC-05 | 18                                 | 81                           | 0.162            | 0.00374                    | 0.60588           | 23.99842988             |
| 6                                           | L1-SD-06 | 14                                 | 95                           | 0.19             | 0.00374                    | 0.7106            | 23.99771928             |
| 7                                           | L1-SD-07 | 15                                 | 110                          | 0.22             | 0.00374                    | 0.8228            | 23.99689648             |
| 8                                           | L1-SD-08 | 50                                 | 160                          | 0.32             | 0.00374                    | 1.1968            | 23.99569968             |
| 9                                           | L1-SD-09 | 19                                 | 179                          | 0.358            | 0.00374                    | 1.33892           | 23.99436076             |
| 10                                          | L1-MC-10 | 12                                 | 191                          | 0.382            | 0.00374                    | 1.42868           | 23.99293208             |
| 11                                          | L1-SD-11 | 20                                 | 211                          | 0.422            | 0.00374                    | 1.57828           | 23.9913538              |

| LOOP 2 voltage drops                        |          |                                    |                              |                  |                            |                   |                         |
|---------------------------------------------|----------|------------------------------------|------------------------------|------------------|----------------------------|-------------------|-------------------------|
| #12 fire cable per feet resistance 0.002ohm |          |                                    |                              |                  |                            |                   |                         |
| Sr/No                                       | Item     | Length of wire(ft) from last point | Length of wire(ft) from FACP | Resistance (ohm) | Current (340uA) per device | Voltage drop (mV) | Voltage at sensor (24V) |
| 1                                           | L2-MC-01 | 15                                 | 15                           | 0.03             | 0.00442                    | 0.1326            | 23.9998674              |
| 2                                           | L2-SD-02 | 10                                 | 25                           | 0.05             | 0.00408                    | 0.204             | 23.9996634              |
| 3                                           | L2-SD-03 | 25                                 | 50                           | 0.1              | 0.00408                    | 0.408             | 23.9992554              |
| 4                                           | L2-SD-04 | 23                                 | 73                           | 0.146            | 0.00374                    | 0.54604           | 23.99870936             |
| 5                                           | L2-MC-05 | 18                                 | 91                           | 0.182            | 0.00374                    | 0.68068           | 23.99802868             |
| 6                                           | L2-SD-06 | 14                                 | 105                          | 0.21             | 0.00374                    | 0.7854            | 23.99724328             |
| 7                                           | L2-SD-07 | 15                                 | 120                          | 0.24             | 0.00374                    | 0.8976            | 23.99634568             |
| 8                                           | L2-SD-08 | 50                                 | 170                          | 0.34             | 0.00374                    | 1.2716            | 23.99507408             |
| 9                                           | L2-SD-09 | 19                                 | 189                          | 0.378            | 0.00374                    | 1.41372           | 23.99366036             |
| 10                                          | L2-MC-10 | 12                                 | 201                          | 0.402            | 0.00374                    | 1.50348           | 23.99215688             |
| 11                                          | L2-SD-11 | 20                                 | 221                          | 0.442            | 0.00374                    | 1.65308           | 23.9905038              |

PROJECT NAME.

RESTROOMS  
ASANA PARTNERS

DESIGN  
CONSULTANT.

TSABA CORP  
NADIF BRACEY  
254 CHAPMAN RD,  
STE 208 #13130  
NEWARK, DELAWARE  
19702  
EMAIL:  
INFO@TS9DESIGNS.COM

SITE LOCATION.

1000 MAXWELL LANE  
HOBOKEN, NJ 07030

DISCIPLINE.

ELECTRICAL  
VOLTAGE DROPS

| No. | Description | Date |
|-----|-------------|------|
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |

STATE OF NEW JERSEY

MOHAMED SAID MINOUI

No.

GE059074

PROFESSIONAL ENGINEER

Date

2-11-2023

Drawn by

MJS

Checked by

FA

E1-29

Scale

$\frac{1}{16}"=1'-0"$



| LOOP 3 voltage drops                        |          |                                    |                              |                  |                            |                   |                         |
|---------------------------------------------|----------|------------------------------------|------------------------------|------------------|----------------------------|-------------------|-------------------------|
| #12 fire cable per feet resistance 0.002ohm |          |                                    |                              |                  |                            |                   |                         |
| Sr/No                                       | Item     | Length of wire(ft) from last point | Length of wire(ft) from FACP | Resistance (ohm) | Current (340uA) per device | Voltage drop (mV) | Voltage at sensor (24V) |
| 1                                           | L3-MC-01 | 26                                 | 26                           | 0.052            | 0.00442                    | 0.22984           | 23.99977016             |
| 2                                           | L3-SD-02 | 10                                 | 36                           | 0.072            | 0.00408                    | 0.29376           | 23.9994764              |
| 3                                           | L3-SD-03 | 25                                 | 61                           | 0.122            | 0.00408                    | 0.49776           | 23.99897864             |
| 4                                           | L3-SD-04 | 23                                 | 84                           | 0.168            | 0.00374                    | 0.62832           | 23.99835032             |
| 5                                           | L3-MC-05 | 18                                 | 102                          | 0.204            | 0.00374                    | 0.76296           | 23.99758736             |
| 6                                           | L3-SD-06 | 14                                 | 116                          | 0.232            | 0.00374                    | 0.86768           | 23.99671968             |
| 7                                           | L3-SD-07 | 15                                 | 131                          | 0.262            | 0.00374                    | 0.97988           | 23.9957398              |
| 8                                           | L3-SD-08 | 50                                 | 181                          | 0.362            | 0.00374                    | 1.35388           | 23.99438592             |
| 9                                           | L3-SD-09 | 19                                 | 200                          | 0.4              | 0.00374                    | 1.496             | 23.99288992             |
| 10                                          | L3-MC-10 | 12                                 | 212                          | 0.424            | 0.00374                    | 1.58576           | 23.99130416             |
| 11                                          | L3-SD-11 | 20                                 | 232                          | 0.464            | 0.00374                    | 1.73536           | 23.9895688              |

| LOOP 4 voltage drops                        |          |                                    |                              |                  |                            |                   |                         |
|---------------------------------------------|----------|------------------------------------|------------------------------|------------------|----------------------------|-------------------|-------------------------|
| #12 fire cable per feet resistance 0.002ohm |          |                                    |                              |                  |                            |                   |                         |
| Sr/No                                       | Item     | Length of wire(ft) from last point | Length of wire(ft) from FACP | Resistance (ohm) | Current (340uA) per device | Voltage drop (mV) | Voltage at sensor (24V) |
| 1                                           | L4-MC-01 | 35                                 | 35                           | 0.07             | 0.00442                    | 0.3094            | 23.9996906              |
| 2                                           | L4-SD-02 | 10                                 | 45                           | 0.09             | 0.00408                    | 0.3672            | 23.9993234              |
| 3                                           | L4-SD-03 | 25                                 | 70                           | 0.14             | 0.00408                    | 0.5712            | 23.9987522              |
| 4                                           | L4-SD-04 | 23                                 | 93                           | 0.186            | 0.00374                    | 0.69564           | 23.99805656             |
| 5                                           | L4-MC-05 | 18                                 | 111                          | 0.222            | 0.00374                    | 0.83028           | 23.99722628             |
| 6                                           | L4-SD-06 | 14                                 | 125                          | 0.25             | 0.00374                    | 0.935             | 23.99629128             |
| 7                                           | L4-SD-07 | 15                                 | 140                          | 0.28             | 0.00374                    | 1.0472            | 23.99524408             |
| 8                                           | L4-SD-08 | 50                                 | 190                          | 0.38             | 0.00374                    | 1.4212            | 23.99382288             |
| 9                                           | L4-SD-09 | 19                                 | 209                          | 0.418            | 0.00374                    | 1.56332           | 23.99225956             |
| 10                                          | L4-MC-10 | 12                                 | 221                          | 0.442            | 0.00374                    | 1.65308           | 23.99060648             |
| 11                                          | L4-SD-11 | 20                                 | 241                          | 0.482            | 0.00374                    | 1.80268           | 23.9888038              |

PROJECT NAME.

RESTROOMS  
ASANA PARTNERS

DESIGN  
CONSULTANT.

TSABA CORP  
NADIF BRACEY  
254 CHAPMAN RD,  
STE 208 #13130  
NEWARK, DELAWARE  
19702  
EMAIL:  
INFO@TS9DESIGNS.COM

SITE LOCATION.

1000 MAXWELL LANE  
HOBOKEN, NJ 07030

DISCIPLINE.

ELECTRICAL  
VOLTAGE DROPS

| No. | Description | Date |
|-----|-------------|------|
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |

STATE OF NEW JERSEY

MOHAMED SAID MINOUBI

No.

GE059074

PROFESSIONAL ENGINEER

Date

2-11-2023

Drawn by

MJS

Checked by

FA

Scale

1/8"=1'-0"

16

E1-30



| LOOP 5 voltage drops                        |          |                                    |                              |                  |                            |                   |                         |
|---------------------------------------------|----------|------------------------------------|------------------------------|------------------|----------------------------|-------------------|-------------------------|
| #12 fire cable per feet resistance 0.002ohm |          |                                    |                              |                  |                            |                   |                         |
| Sr/No                                       | Item     | Length of wire(ft) from last point | Length of wire(ft) from FACP | Resistance (ohm) | Current (340uA) per device | Voltage drop (mV) | Voltage at sensor (24V) |
| 1                                           | L5-MC-01 | 45                                 | 45                           | 0.09             | 0.00442                    | 0.3978            | 23.9996022              |
| 2                                           | L5-SD-02 | 10                                 | 55                           | 0.11             | 0.00408                    | 0.4488            | 23.9991534              |
| 3                                           | L5-SD-03 | 25                                 | 80                           | 0.16             | 0.00408                    | 0.6528            | 23.9985006              |
| 4                                           | L5-SD-04 | 23                                 | 103                          | 0.206            | 0.00374                    | 0.77044           | 23.99773016             |
| 5                                           | L5-MC-05 | 18                                 | 121                          | 0.242            | 0.00374                    | 0.90508           | 23.99682508             |
| 6                                           | L5-SD-06 | 14                                 | 135                          | 0.27             | 0.00374                    | 1.0098            | 23.99581528             |
| 7                                           | L5-SD-07 | 15                                 | 150                          | 0.3              | 0.00374                    | 1.122             | 23.99469328             |
| 8                                           | L5-SD-08 | 50                                 | 200                          | 0.4              | 0.00374                    | 1.496             | 23.99319728             |
| 9                                           | L5-SD-09 | 19                                 | 219                          | 0.438            | 0.00374                    | 1.63812           | 23.99155916             |
| 10                                          | L5-MC-10 | 12                                 | 231                          | 0.462            | 0.00374                    | 1.72788           | 23.98983128             |
| 11                                          | L5-SD-11 | 20                                 | 251                          | 0.502            | 0.00374                    | 1.87748           | 23.9879538              |

| LOOP 6 voltage drops                        |          |                                    |                              |                  |                            |                   |                         |
|---------------------------------------------|----------|------------------------------------|------------------------------|------------------|----------------------------|-------------------|-------------------------|
| #12 fire cable per feet resistance 0.002ohm |          |                                    |                              |                  |                            |                   |                         |
| Sr/No                                       | Item     | Length of wire(ft) from last point | Length of wire(ft) from FACP | Resistance (ohm) | Current (340uA) per device | Voltage drop (mV) | Voltage at sensor (24V) |
| 1                                           | L6-MC-01 | 5                                  | 5                            | 0.01             | 0.00442                    | 0.0442            | 23.9999558              |
| 2                                           | L6-SD-02 | 10                                 | 15                           | 0.03             | 0.00408                    | 0.1224            | 23.9998334              |
| 3                                           | L6-SD-03 | 25                                 | 40                           | 0.08             | 0.00408                    | 0.3264            | 23.999507               |
| 4                                           | L6-SD-04 | 23                                 | 63                           | 0.126            | 0.00374                    | 0.47124           | 23.99903576             |
| 5                                           | L6-MC-05 | 18                                 | 81                           | 0.162            | 0.00374                    | 0.60588           | 23.99842988             |
| 6                                           | L6-SD-06 | 14                                 | 95                           | 0.19             | 0.00374                    | 0.7106            | 23.99771928             |
| 7                                           | L6-SD-07 | 15                                 | 110                          | 0.22             | 0.00374                    | 0.8228            | 23.99689648             |
| 8                                           | L6-SD-08 | 50                                 | 160                          | 0.32             | 0.00374                    | 1.1968            | 23.99569968             |
| 9                                           | L6-SD-09 | 19                                 | 179                          | 0.358            | 0.00374                    | 1.33892           | 23.99436076             |
| 10                                          | L6-MC-10 | 12                                 | 191                          | 0.382            | 0.00374                    | 1.42868           | 23.99293208             |
| 11                                          | L6-SD-11 | 20                                 | 211                          | 0.422            | 0.00374                    | 1.57828           | 23.9913538              |

PROJECT NAME.

RESTROOMS  
ASANA PARTNERS

DESIGN  
CONSULTANT.

TSABA CORP  
NADIF BRACEY  
254 CHAPMAN RD,  
STE 208 #13130  
NEWARK, DELAWARE  
19702  
EMAIL:  
INFO@TS9DESIGNS.COM

SITE LOCATION.

1000 MAXWELL LANE  
HOBOKEN, NJ 07030

DISCIPLINE.

ELECTRICAL  
VOLTAGE DROPS

| No. | Description | Date |
|-----|-------------|------|
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |











|            |            |
|------------|------------|
| Date       | 2-11-2023  |
| Drawn by   | MJS        |
| Checked by | FA         |
| E1-31      |            |
| Scale      | 1/8"=1'-0" |



FIRE ALARM MATRIX

| ALARM/DEVICE                                 | ASSOCIATED INDIVIDUAL HVAC SHUTDOWN | CLOSE AFFECTED AREA FIRE SMOKE DAMPER | ALARM SIGNAL BASE BLDG FACP AND NETWORK ANNUNCIATOR | ALARM SIGNAL TO SECURITY PANEL DEVICE | ALARM SIGNAL TO NOTIFICATION APPLIANCE | TROUBLE SIGNAL TO BMS SYSTEM BUILDING FACP | SUPERVISORY SIGNAL TO BASE BUILDING FACP | ACTIVATE YELLOW STROBE TO BASE FACP | RELEASE DOOR HOLDER | LIGHT LED ON GRAPHIC ANNUNCIATOR | ACTIVATES FIRE ALARM TONE AND STROBE LIGHTS ON THE FLOOR WHERE THE ALARM WAS INITIATED AND ON ONE FLOOR ABOVE |
|----------------------------------------------|-------------------------------------|---------------------------------------|-----------------------------------------------------|---------------------------------------|----------------------------------------|--------------------------------------------|------------------------------------------|-------------------------------------|---------------------|----------------------------------|---------------------------------------------------------------------------------------------------------------|
| RESPONSE/ACTION                              |                                     |                                       |                                                     |                                       |                                        |                                            |                                          |                                     |                     |                                  |                                                                                                               |
| BASE BUILDING MANUAL PULL STATION ACTIVATION |                                     |                                       |                                                     |                                       |                                        |                                            |                                          |                                     |                     |                                  |                                                                                                               |
| BASE BUILDING SYSTEM TROUBLE SIGNAL          |                                     |                                       |                                                     |                                       |                                        |                                            |                                          |                                     |                     |                                  |                                                                                                               |
| ALL OTHER SMOKE DETECTOR                     |                                     |                                       |                                                     |                                       |                                        |                                            |                                          |                                     |                     |                                  |                                                                                                               |
| BASE BUILDING FACP ALARM                     |                                     |                                       |                                                     |                                       |                                        |                                            |                                          |                                     |                     |                                  |                                                                                                               |
| BASE BUILDING FACP TROUBLE                   |                                     |                                       |                                                     |                                       |                                        |                                            |                                          |                                     |                     |                                  |                                                                                                               |
| BASE BUILDING FACP SUPERVISORY               |                                     |                                       |                                                     |                                       |                                        |                                            |                                          |                                     |                     |                                  |                                                                                                               |

| FIRE ALARM                                                                          |                                                                            |
|-------------------------------------------------------------------------------------|----------------------------------------------------------------------------|
|  | FIRE ALARM PULL STATION                                                    |
|  | FIRE ALARM HORN C/W STROBE (CEILING/WALL)                                  |
|  | FIRE ALARM STROBE (CEILING/WALL)                                           |
|  | FIRE ALARM HORN (NO STROBE)                                                |
|  | MINI HORN (NO STROBE) C/W PUSHBUTTON SILENCER                              |
|  | SPEAKER STROBE OR MINI HORN STROBE WITH SILENCER MODULE & PUSHBUTTON BELOW |
|  | SILENCER MODULE C/W PUSHBUTTON                                             |
|  | SILENCER MODULE/ REMOTE PUSHBUTTON                                         |
|  | MAGNETIC DOOR HOLDER                                                       |
|  | ALARM BELL                                                                 |
|  | FIRE ALARM SPEAKER                                                         |
|  | FIRE ALARM SPEAKER/STROBE (CEILING/WALL)                                   |
|  | FIRE PHONE                                                                 |
|  | SMOKE DETECTOR / C=SMOKE CO COMBO                                          |
|  | D=DUCT DETECTOR/ A=SMOKE ALARM                                             |
|  | HEAT DETECTOR/ H=HIGH TEMP DETECTOR                                        |
|  | AS=ASPIRING SMOKE DETECTOR                                                 |
|  | RF MODULE                                                                  |
|  | FIRE ALARM POWER SUPPLY                                                    |
|  | SUB BOOSTER PANEL                                                          |

PROJECT NAME.

RESTROOMS  
ASANA PARTNERS

DESIGN  
CONSULTANT.

TSABA CORP  
NADIF BRACEY  
254 CHAPMAN RD,  
STE 208 #13130  
NEWARK, DELAWARE  
19702  
EMAIL:  
INFO@TS9DESIGNS.COM


SITE LOCATION.

1000 MAXWELL LANE  
HOBOKEN, NJ 07030

DISCIPLINE.

ELECTRICAL  
FIRE ALARM MATRIX

| No. | Description | Date |
|-----|-------------|------|
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |
|     |             |      |

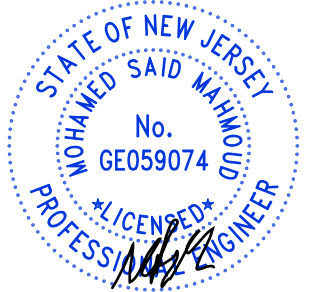

STATE OF NEW JERSEY  
MOHAMED SAID MHAMED  
No. GE059074  
LICENSED PROFESSIONAL ENGINEER

Date 2-11-2023

Drawn by MJS

Checked by FA

E1-32

Scale 1/16"=1'-0"