

NEW CONSTRUCTION


140 SADDLE RIDGE ROAD

GENERAL NOTES:

- 1. GENERAL NOTES APPLY TO ALL DRAWINGS
- 2. DO NOT SCALE DRAWINGS. ANY DIMENSIONAL INFORMATION REQUIRED WHICH IS NOT INDICATED ON DRAWING DIMENSION STRINGS SHALL BE OBTAINED FROM THE ARCHITECT.
- 3. DIMENSIONS SHOWN ARE FINISH SURFACE OF EXISTING CONSTRUCTION, UNLESS NOTED OTHERWISE .
- 4. CONTRACTOR SHALL VERIFY ALL EXISTING DIMENSIONS AND CONDITIONS (I.E EXISTING MATERIALS, FRAMING MEMBER SIZES AND LOCATIONS, METHODS OF CONSTRUCTION). IF DISCREPANCIES ARE FOUND, NOTIFY ARCHITECT BEFORE PROCEEDING WITH WORK.
- 5. CONTRACTOR SHALL MAINTAIN THE IMMEDIATE CONSTRUCTION SITE IN A SECURE, CLEAN AND SAFE MANNER.
- 6. PROTECTION : CONTRACTORS SHALL BE SOLELY RESPONSIBLE FOR TAKING ALL STEPS NECESSARY TO PROTECT THE PUBLIC FROM INJURY AND ADJACENT PROPERTY DAMAGES DURING CONSTRUCTION AS REQUIRED BY LOCAL CODES.

SCOPE OF WORK:

- 1. ELECTRICAL
- 2. PLUMBING
- 3. MECHANICAL



INDEX TO DRAWINGS

SHEET NUMBER	SHEET NAME	SHEET NUMBER	SHEET NAME
ARCHITECTURE		MECHANICAL	
AR-01	COVER SHEET	ME-01	NOTES
AR-02	FLOOR PLAN	ME-02	FIRST FLOOR HVAC PLAN
		ME-03	DETAILS
ELECTRICAL			
EL-01	NOTES		
EL-02	FIRST FLOOR LIGHTING PLAN		
EL-03	FIRST FLOOR POWER PLAN		
EL-04	PANEL SCHEDULE & SINGLE LINE DIAGRAM		
PLUMBING			
PL-01	NOTES		
PL-02	FIRST FLOOR DRAINAGE PLAN		
PL-03	FIRST FLOOR WATER SUPPLY PLAN		
PL-04	RISER DIAGRAM		
PL-05	DETAILS		

APPLICABLE CODES:

- 1. 2022 International Building Code with local amendments.
- 2. 2022 International Existing Building Code.
- 3. 2022 International Energy Conservation Code.
- 4. 2022 ANSI A-117.1 Accessible & Useable Building & facilities.
- 5. 2022 International Plumbing Code with local amendments.
- 6. 2022 International Mechanical Code with local amendments.
- 7. 2022 International Fuel Gas Code with local amendments.
- 8. 2022 National Electric Code.
- 9. 2022 International Fire Code with local amendments.

OWNER SIGNATURE

REVISION STATUS			
Rev	DATE	DESCRIPTION	DRAWN BY
001	07-2023	ISSUED FOR APPROVAL	A.S
01			
02			
03			
04			

CLIENT/CONSULTANT APPROVAL STATUS	
APPROVED	(A)
APPROVED WITH NOTES	(B)
RESUBMIT	(C)
DISAPPROVED	(D)

OWNER:

ADDRESS:

140 Saddle Ridge Road

DESIGN CONSULTANT:
TSABA CORP
NADIF BRACEY
254 CHAPMAN RD, STE 208 #13130
NEWARK, DELAWARE 19702
EMAIL:TS9DESIGNS@GMAIL.COM


DRAWING STATUS:
DESIGN DRAWING

DISCIPLINE:
ELECTRICAL

PROJECT TITLE:
PHYSICAL THERAPY - FEILD HOUSE

DRAWING TITLE:
COVER SHEET

DRAWN BY: A.S	CHECKED BY: N.B	DATE: 20 JUL 2023
JOB NO 632-003	SHT NO AR-01	SCALE: NTS @A3

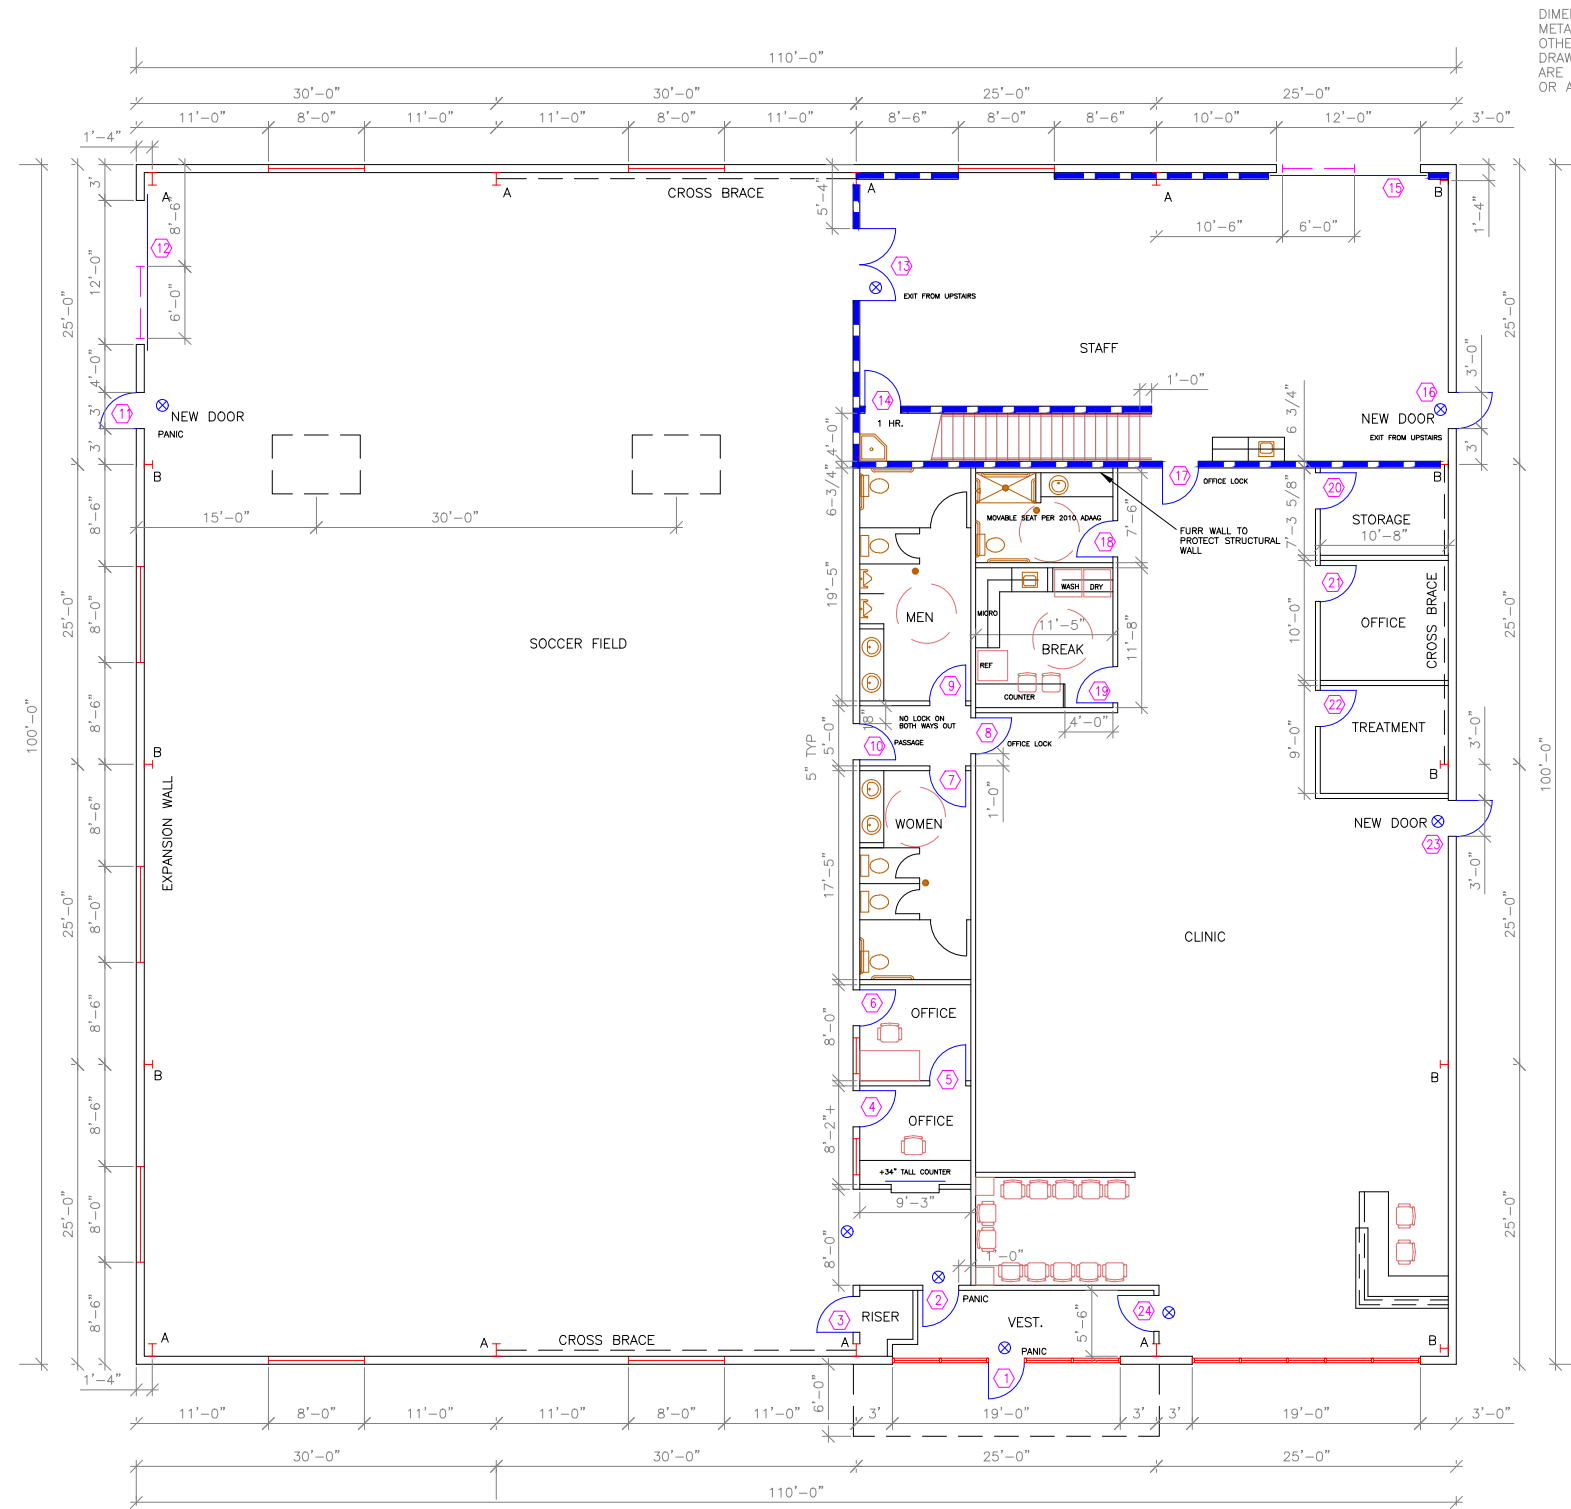

AR 02 SCALE 1/16"=1'-0"


FIRST FLOOR PLAN

WALL TYPES

===== METAL BUILDING SYSTEM WITH THERMAL BREAK.
R-21 BATT INSUL. WITH INTERIOR VAPOR BARRIER
RATED FOR EXPOSED APPLICATION
ALTERNATE: FOAM INSULATION WITH APPROVED FLAME COVERING
PROVIDE 2' HT. R-10 FOUNDATION INSULATION BELOW SLAB.
PROVIDE R-3 THERMO-BREAK BETWEEN SLAB/FND.

===== 3-5/8" METAL STUDS WITH 5/8" 'X' GYP. BD. ON EACH SIDE
2x4 STUDS ARE ALLOWED. 6" OR 2x6 STUDS AT PLUMBING.
===== 2x6 STUDS @ 16" O.C. WHERE SHOWN.


DIMENSIONS ARE TO MATCH
METAL BUILDING AB1 AND
OTHER METAL BUILDING
DRAWINGS. OTHER DIMENSIONS
ARE TO FACE OF GYP. BD
OR ARE CENTERED ON GRID.

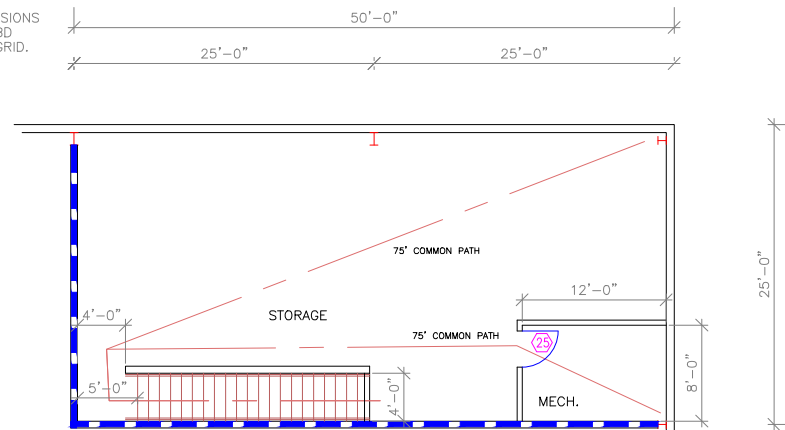

AR 02 SCALE 1/16"=1'-0"

SECOND FLOOR PLAN

125 PSF FLOOR LIVE LOAD MIN.
USE 20" BCI 90 2.0 UPSTAIRS - 12'-0" FLOOR TO FLOOR MAX.
AT 12" O.C. OR OTHER
APPROVED SYSTEM. BEAR
ON 2X6 STUDS AT 16" O.C.
ON 3 SIDES WITH 7/16"
SHEATHING. FLOOR SHEATHING
3/4" T&G MIN.

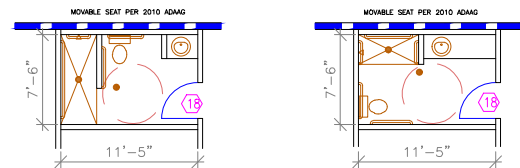

TWO SHOWER OPTIONS



OWNER SIGNATURE

REVISION STATUS			
Rev	DATE	DESCRIPTION	DRAWN BY
00	07-2023	ISSUED FOR APPROVAL	A.S
01			
02			
03			
04			

CLIENT/CONSULTANT APPROVAL STATUS	
APPROVED	(A)
APPROVED WITH NOTES	(B)
RESUBMIT	(C)
DISAPPROVED	(D)

OWNER:

ADDRESS:

140 Saddle Ridge Road

DESIGN CONSULTANT:
TSABA CORP
NADIF BRACEY
254 CHAPMAN RD, STE 208 #13130
NEWARK, DELAWARE 19702
EMAIL:TS9DESIGNS@GMAIL.COM


DRAWING STATUS:
DESIGN DRAWING

DISCIPLINE: ARCHITECTURE

PROJECT TITLE:
PHYSICAL THERAPY - FEILD HOUSE

DRAWING TITLE:
FLOOR PLANS

DRAWN BY: A.S	CHECKED BY: N.B	DATE: 20 JUL 2023
JOB NO 632-003	SHT NO AR-02	SCALE: 1/16"=1'-0" @A3

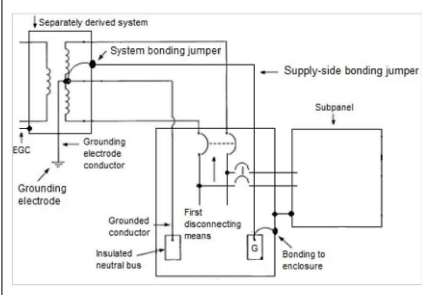


: LIGHTING FIXTURE SCHEDULE :				
SYMBOL	MODEL	MANUFACTURER	ORDERED FROM	DESCRIPTION
	40W FLUSH MOUNT	SSL/PHILIPS/LIGHTOLIER	DAL	40W FLUSH MOUNT LIGHT
	15W SURFACE MOUNTED	SSL/PHILIPS/LIGHTOLIER	DAL	15W SURFACE MOUNTED LIGHT IN KITCHEN
	18W RECESS TYPE DOWN	SSL/PHILIPS/LIGHTOLIER	DAL	18W RECESS TYPE DOWN LIGHT WITH SPUN ALUMINUM BODY REFLECTOR, GLASS DIFFUSER & COMPACT FLU. LAMP IN CLOSETS
	20W RECESS TYPE DOWN	SSL/PHILIPS/LIGHTOLIER	DAL	20W RECESS TYPE DOWN LIGHT WITH SPUN ALUMINUM BODY REFLECTOR, GLASS DIFFUSER & COMPACT FLU. LAMP IN BATHROOMS & LAUNDRY AREA
	FLUSH MOUNT	SSL/PHILIPS/LIGHTOLIER	DAL	FLUSH MOUNT LIGHT IN EACH BATHROOM ABOVE THE MIRROR.
	15W SURFACE MOUNTED	SSL/PHILIPS/LIGHTOLIER	DAL	15W SURFACE MOUNTED LIGHT IN STORAGE
	2X4 TROFFER LED	SSL/PHILIPS/LIGHTOLIER	DAL	2X4 TROFFER LED LIGHTS 60,000 LUMENS
	EMERGENCY	SSL/PHILIPS/LIGHTOLIER	DAL	40W EMERGENCY LIGHTS
	PACK LIGHTS	RUGGEDGRADE	DAL	120 WATT WALL PACK LIGHTS
	WALL MOUNTED	SSL/PHILIPS/LIGHTOLIER	DAL	OUTDOOR WALL MOUNTED HIGH THROW LIGHTS

: ELECTRICAL LOAD CALCULATION :	
11000 SQFT @ 3W EA	33000 W
LIGHTING	2240 W
RECEPTACLE	19200 W
(HOT PLATE)	400 W
GARBAGE (AF/GF)	1000 W
REFRIGERATOR (AF/GF)	1000 W
AIR HANDLER BREAKER 2500X3	7500 W
BUG LIGHTS	600 W
A/C	5000 W
MICROWAVE (AF/GF)	2500 W
DISHWASHER	1000 W
HOT WATER TANK	4500 W
RECEPTACLE +BUG LIGHTS	2200 W
TOTAL WATTAGES	80140 W
BALANCE @ 40% OF TIME	32056
10,000 @ 100% OF TIME	10000 W
TOTAL WATTAGES	42056 W
TOTAL WATTAGES DIVIDED BY 240:	175.3 A
USE	200 AMP SERVICE


GENERAL ELECTRICAL NOTES
1- ELECTRICAL CONTRACTOR TO VERIFY ALL EXISTING SITE CONDITIONS & MAKE ANY NECESSARY ADJUSTMENTS.
2- SMALLEST WIRE & SIZE TO BE 14-2
3- ALL WORK SHALL COMPLY WITH THE NATIONAL ELECTRIC CODE & ANY OTHER APPLICABLE REGULATIONS OR CODES, AT THE SITE.
4- CONTRACTOR TO LOCATE PHONE, CABLE, ETC. AS PER OWNER'S SPECIFICATIONS.

LEGEND NOTES:
T VERIFY ALL MOUNTING HEIGHTS
OF WALL MOUNTED LIGHT FIXTURES
Φ TYPICAL MOUNTING HEIGHTS FOR OUTLETS - CENTERLINE 16" AFF (EXCEPT WHERE NOTED OTHERWISE)
\$ MAXIMUM HEIGHT FOR ALL SWITCHES IS 48" AFF
ROCKER STYLE SWITCHES
ALL SWITCHES /OUTLETS /COVER PLATES- WHITE FINISH
V VENT FANS SIZED FOR ROOM VOLUME
FAN SOUND LEVEL NOT TO EXCEED 1.0 SONES

: LEGEND :	
SYMBOL	DESCRIPTION
	40W FLUSH MOUNT LIGHT
	15W SURFACE MOUNTED LIGHT IN KITCHEN
	18W RECESS TYPE DOWN LIGHT WITH SPUN ALUMINUM BODY REFLECTOR, GLASS DIFFUSER & COMPACT FLU. LAMP IN CLOSETS
	20W RECESS TYPE DOWN LIGHT WITH SPUN ALUMINUM BODY REFLECTOR, GLASS DIFFUSER & COMPACT FLU. LAMP IN BATHROOMS & LAUNDRY AREA
	FLUSH MOUNT LIGHT IN EACH BATHROOM ABOVE THE MIRROR.
	15W SURFACE MOUNTED LIGHT IN STORAGE
	2X4 TROFFER LED LIGHTS 60,000 LUMENS
	40W EMERGENCY LIGHTS
	120 WATT WALL PACK LIGHTS
	OUTDOOR WALL MOUNTED HIGH THROW LIGHTS
	ONE WAY ONE GANG SWITCH
	ONE WAY TWO GANG SWITCH
	ONE WAY THREE GANG SWITCH
	TWO WAY ONE GANG SWITCH
	TWO WAY TWO GANG SWITCH
	SPAN ELECTRICAL PANEL, TYPE INDICATED.

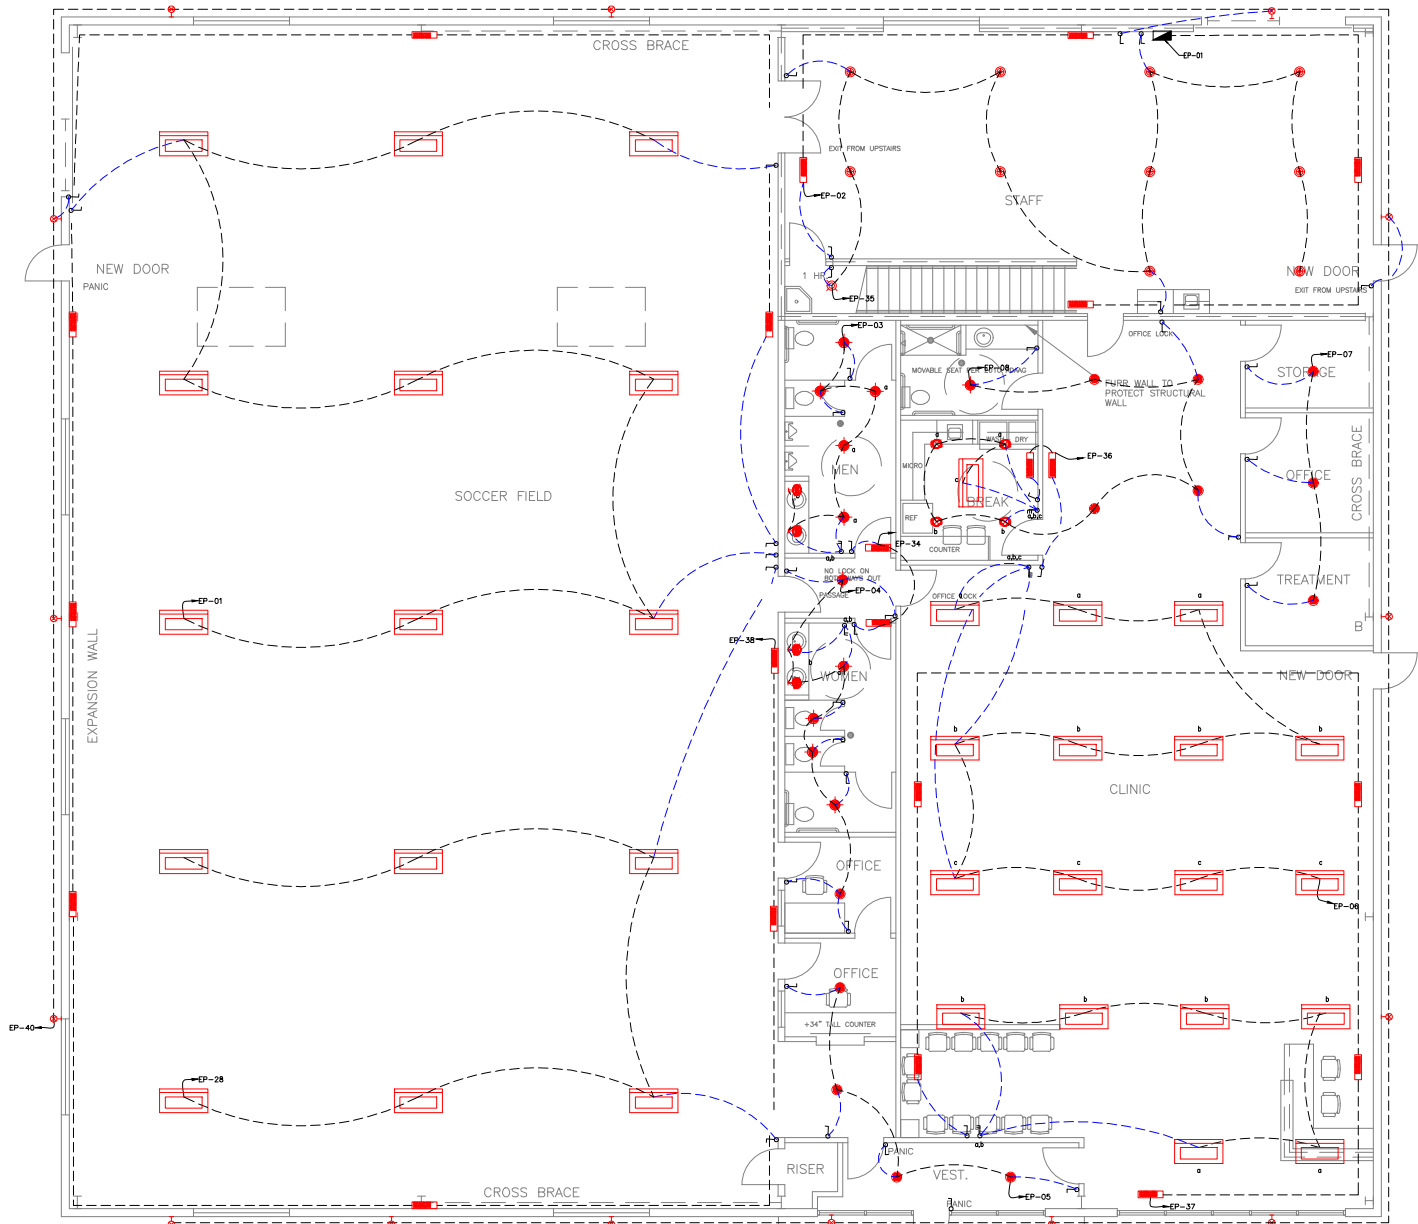

EL 02 SCALE 1/16"=1'-0" FIRST FLOOR LIGHTING PLAN

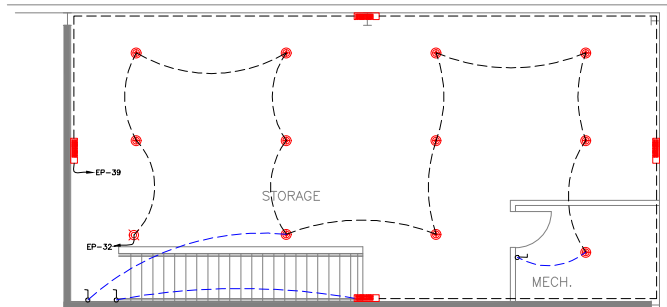

EL 02 SCALE 1/16"=1'-0" SECOND FLOOR LIGHTING PLAN

OWNER SIGNATURE

REVISION STATUS			
Rev	DATE	DESCRIPTION	DRAWN BY
00	07-2023	ISSUED FOR APPROVAL	A.S
01			
02			
03			
04			

CLIENT/CONSULTANT APPROVAL STATUS	
APPROVED	(A)
APPROVED WITH NOTES	(B)
RESUBMIT	(C)
DISAPPROVED	(D)

OWNER:
ADDRESS:

140 Saddle Ridge Road
DESIGN CONSULTANT:
TSABA CORP
NADIF BRACEY
254 CHAPMAN RD, STE 208 #13130
NEWARK, DELAWARE 19702
EMAIL:TS9DESIGNS@GMAIL.COM

DRAWING STATUS:
DESIGN DRAWING

DISCIPLINE:
ELECTRICAL

PROJECT TITLE:
PHYSICAL THERAPY - FEILD HOUSE

DRAWING TITLE:
LIGHTING FLOOR PLANS

DRAWN BY: A.S	CHECKED BY: N.B	DATE: 20 JUL 2023
JOB NO 632-003	SHT NO EL-02	SCALE: 1/16"=1'-0" @A3



GENERAL ELECTRICAL NOTES

- 1- ELECTRICAL CONTRACTOR TO VERIFY ALL EXISTING SITE CONDITIONS & MAKE ANY NECESSARY ADJUSTMENTS.
2- SMALLEST WIRE & SIZE TO BE 14-2
3- ALL WORK SHALL COMPLY WITH THE NATIONAL ELECTRIC CODE & ANY OTHER APPLICABLE REGULATIONS OR CODES, AT THE SITE.
4- CONTRACTOR TO LOCATE PHONE, CABLE, ETC. AS PER OWNER'S SPECIFICATIONS.

LEGEND NOTES:

VERIFY ALL MOUNTING HEIGHTS
OF WALL MOUNTED LIGHT FIXTURES

TYPICAL MOUNTING HEIGHTS FOR
OUTLETS - CENTERLINE 16" AFF
(EXCEPT WHERE NOTED OTHERWISE)

MAXIMUM HEIGHT FOR ALL SWITCHES IS 48" AFF
ROCKER STYLE SWITCHES
ALL SWITCHES /OUTLETS /COVER PLATES- WHITE FINISH

VENT FANS SIZED FOR ROOM VOLUME
FAN SOUND LEVEL NOT TO EXCEED 1.0 SONES

: LEGEND :

SYMBOL	DESCRIPTION
⌀	SINGLE SOCKET OUTLET, 13A, 230V, GROUNDING TYPE, MOUNT AT 42" A.F.F. UNLESS NOTED OTHERWISE.
⌀	DUPLEX SOCKET OUTLET, 13A, 230V, GROUNDING TYPE, MOUNT AT 18" A.F.F. UNLESS NOTED OTHERWISE.
GFI ⌀	GFI DUPLEX SOCKET OUTLET, WEATHER PROOF, 13A, 230V, GROUNDING TYPE, MOUNT AT 42" A.F.F. UNLESS NOTED OTHERWISE.
⌀	POINT FOR KITCHEN HOT PLATE, 32A, GROUNDING TYPE, MOUNT AT 42" A.F.F. UNLESS NOTED OTHERWISE.
TV	TV SOCKET HEIGHT AS PER LCD ON LOCATION
T ▽	TELECOMMUNICATION OUTLET, PROVIDE SINGLE GANG JUNCTION BOX WITH PLASTER RING, STUB UP 1" E.C WITH PULL STRING INTO ACCESSIBLE CEILING SPACE, MOUNT AT 18" A.F.F. UNLESS NOTED OTHERWISE.
D ▽	DATA OUTLET, PROVIDE SINGLE GANG JUNCTION BOX WITH PLASTER RING, STUB UP 1" E.C WITH PULL STRING INTO ACCESSIBLE CEILING SPACE, MOUNT AT 18" A.F.F. UNLESS NOTED OTHERWISE.

EP ELECTRICAL PANEL

OWNER SIGNATURE

REVISION STATUS

Rev	DATE	DESCRIPTION	DRAWN BY
00	07-2023	ISSUED FOR APPROVAL	A.S
01			
02			
03			
04			

CLIENT/CONSULTANT APPROVAL STATUS

APPROVED	(A)
APPROVED WITH NOTES	(B)
RESUBMIT	(C)
DISAPPROVED	(D)

OWNER:

ADDRESS:

140 Saddle Ridge Road

DESIGN CONSULTANT:

TSABA CORP
NADIF BRACEY
254 CHAPMAN RD, STE 208 #13130
NEWARK, DELAWARE 19702
EMAIL:TS9DESIGNS@GMAIL.COM

DRAWING STATUS:

DESIGN DRAWING

DISCIPLINE:

ELECTRICAL


PROJECT TITLE:

PHYSICAL THERAPY - FEILD HOUSE


DRAWING TITLE:

POWER FLOOR PLANS


DRAWN BY: A.S	CHECKED BY: N.B	DATE: 20 JUL 2023
JOB NO 632-003	SHT NO EL-03	SCALE: 1/16"=1'-0" @A3

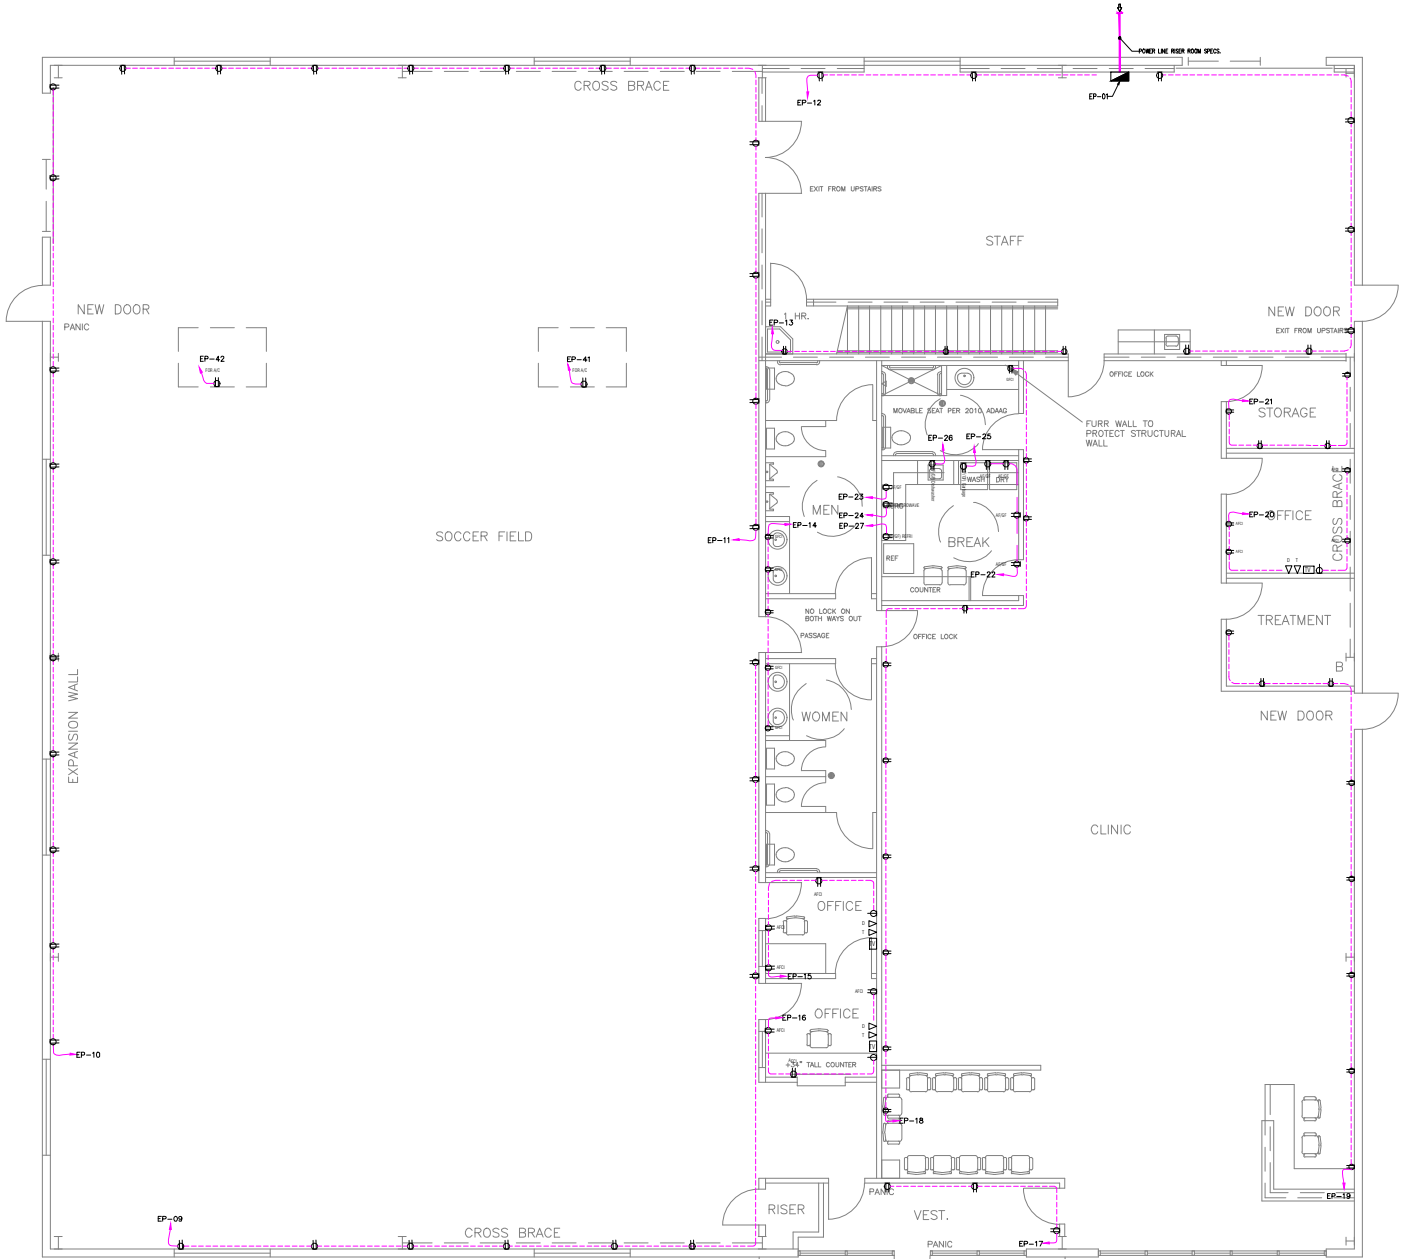

EL 03 SCALE 1/16"=1'-0"

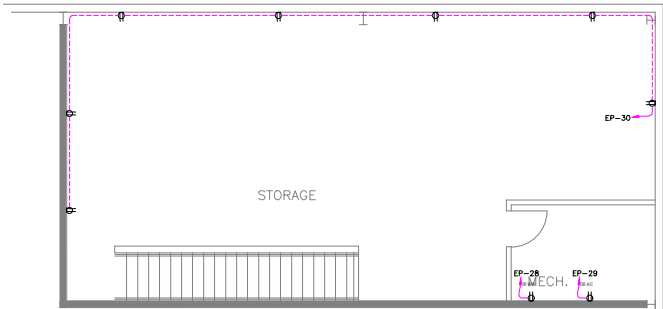

EL 03 SCALE 1/16"=1'-0"



PANEL BOARD SCHEDULE																			
PANEL TAG:		EP-01				MAINS: 200AT/250AF, 110/120V, 3P, 60HZ										NEUTRAL : YES			
LOCATION:		FLOOR PLAN				MOUNTING: SURFACE MOUNTED										GROUND: YES			
ENCLOSURE:		IP42				VOLTAGE 110/120V, 3P, 4W													
FEEDER ENTRANCE:		TOP																	
LOAD SERVED	WIRE & CONDUIT SIZE (INCH)	LOAD (VA)			C B	P O L E	C K T N O.	R	Y	B	C K T N O.	P O L E	C B	LOAD (VA)			WIRE & CONDUIT SIZE (INCH)	LOAD SERVED	
		ØA	ØB	ØC										ØA	ØB	ØC			
LIGHTING	#14 ROMEX	900.00			20	1P	1				2	1P	20	240.00			#14 ROMEX	LIGHTING	
LIGHTING	#14 ROMEX		160.00		20	1P	3				4	1P	20		180.00		#14 ROMEX	LIGHTING	
LIGHTING	#14 ROMEX			240.00	20	1P	5				6	1P	20			240.00	#14 ROMEX	LIGHTING	
LIGHTING	#14 ROMEX	120.00			20	1P	7				8	1P	20	160.00			#14 ROMEX	LIGHTING	
RECEPTACLE	#12 ROMEX		2200.00		20	1P	9				10	1P	20		2200.00		#12 ROMEX	RECEPTACLE	
RECEPTACLE	#12 ROMEX			2000.00	20	1P	11				12	1P	20			1400.00	#12 ROMEX	RECEPTACLE	
RECEPTACLE(GFCI)	#12 ROMEX	1200.00			20	1P	13				14	1P	20	1000.00			#12 ROMEX	RECEPTACLE(GFCI)	
RECEPTACLE(AFCI)	#12 ROMEX		1000.00		20	1P	15				16	1P	20		800.00		#12 ROMEX	RECEPTACLE(AFCI)	
RECEPTACLE	#12 ROMEX			800.00	20	1P	17				18	1P	20			2200.00	#12 ROMEX	RECEPTACLE	
RECEPTACLE	#12 ROMEX	1800.00			20	1P	19				20	1P	20	1000.00			#12 ROMEX	RECEPTACLE(AFCI)	
RECEPTACLE	#12 ROMEX		800.00		20	1P	21				22	1P	20		800.00		#12 ROMEX	RECEPTACLE (AF/GF)	
RECEPTACLE(HOT PLATE)	2#6 ROMEX-1#10ROM-3/4" C			400.00	50	2P	23				24	1P	20			600.00	#12 ROMEX-1/2" C	MICROWAVE (AF/GF)	
GARBAGE (AF/GF)	#12 ROMEX-1/2" C	1000.00			20	1P	25				26	1P	15	1000.00			#12 ROMEX-1/2" C	DISHWASHER (AF/GF)	
REFRIGERATOR (AF/GF)	#12 ROMEX-1/2" C		1500.00		20	1P	27				28	1P	50		2500.00		2#6 ROMEX-1#10ROM-3/4" C	Hot water tank	
Air Handler breaker	2#8 ROMEX-1#10ROM-3/4" C			2500.00	60	1P	29				30	1P	50			1400.00	#12 ROMEX	RECEPTACLE	
Air Handler breaker	2#8 ROMEX-1#10ROM-3/4" C	2500.00			60	1P	31				32	1P	20	240.00			#14 ROMEX	LIGHTING	
Air Handler breaker	2#8 ROMEX-1#10ROM-3/4" C		2500.00		60	1P	33				34	1P	20		80.00		#14 ROMEX	BUG LIGHTS	
BUG LIGHTS	#12 ROMEX			160.00	20	1P	35				36	1P	20			80.00	#12 ROMEX	BUG LIGHTS	
BUG LIGHTS	#12 ROMEX	200.00			20	1P	37				38	1P	20	320.00			#12 ROMEX	BUG LIGHTS	
BUG LIGHTS	#12 ROMEX		160.00		20	1P	39				40	1P	20		80.00		#12 ROMEX	LIGHTS	
A/C	2#8 ROMEX-1#10ROM-3/4" C			2500.00	20	1P	41				42	1P	20			2500.00	2#8 ROMEX-1#10ROM-3/4" C	A/C	
SPARE	#14 ROMEX				20	1P	43				44	1P	20				#14 ROMEX	SPARE	
SPARE	#14 ROMEX				20	1P	45				46	1P	20				#14 ROMEX	SPARE	
		7720.00	8320.00	8600.00										3960.00	6640.00	8420.00			
													</						

REVISION STATUS			
Rev	DATE	DESCRIPTION	DRAWN BY
000	07-2023	ISSUED FOR APPROVAL	A S
01			
02			
03			
04			

APPROVED	(A)
APPROVED WITH NOTES	(B)
RESUBMIT	(C)
DISAPPROVED	(D)

140 Saddle Ridge Road

DESIGN CONSULTANT:
TSABA CORP
NADIF BRACEY
254 CHAPMAN RD, STE 208 #13130
NEWARK, DELAWARE 19702
EMAIL:TS9DESIGNS@GMAIL.COM

DRAWING STATUS:

DESIGN DRAWING

DISCIPLINE: ELECTRICAL


PROJECT TITLE:

PHYSICAL THERAPY - FEILD HOUSE


DRAWING TITLE:

PANEL SCHEDULE &
SINGLE LINE DIAGRAM

<u>DRAWN BY:</u> A.S	<u>CHECKED BY:</u> N.B	<u>DATE:</u> 20 JUL. 2023
<u>JOB NO</u> 632-003	<u>SHT NO</u> EL-04	<u>SCALE:</u> NTS @A3

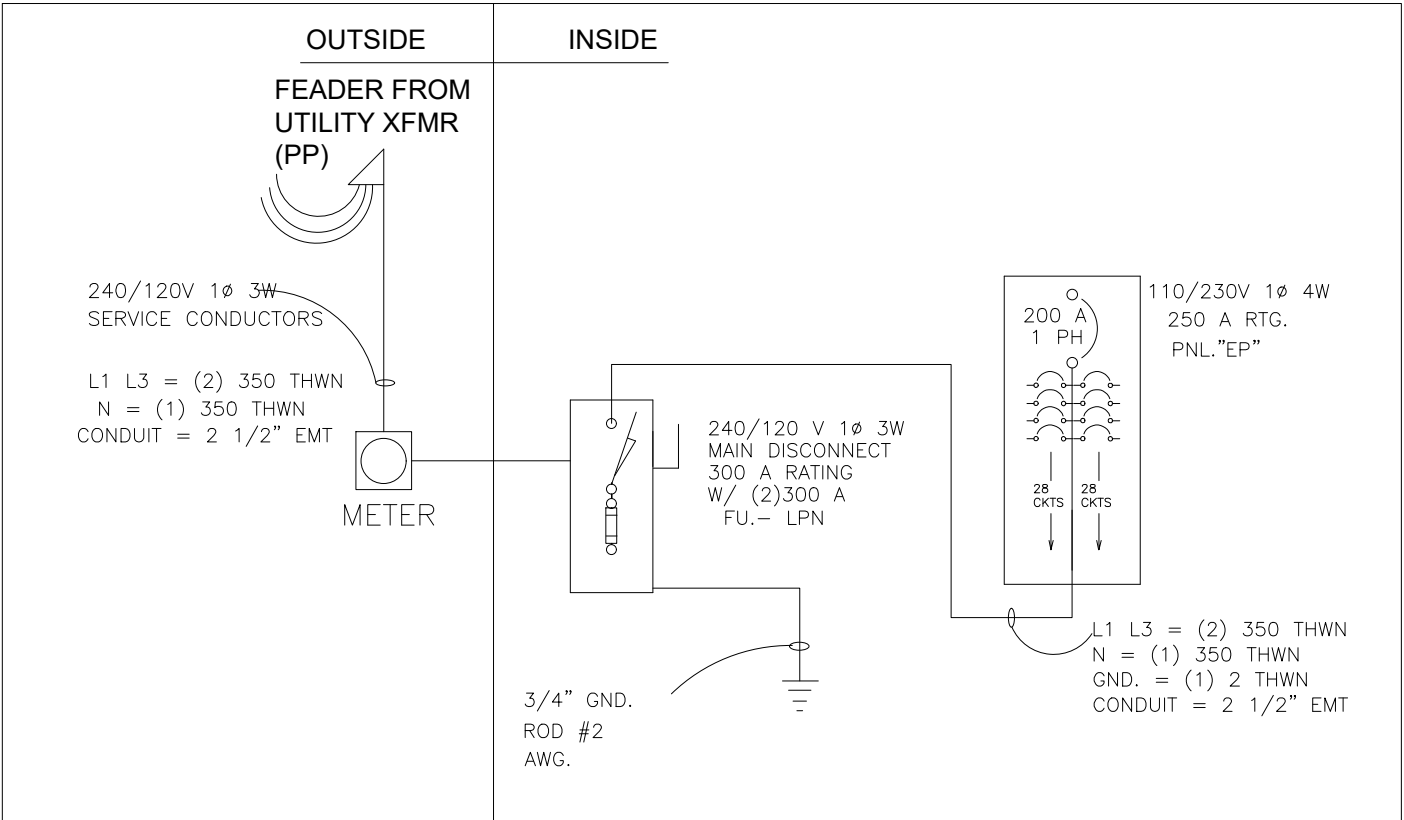

EL SINGLE LINE DIAGRAM
04 SCALE NTS



GENERAL PLUMBING NOTES:

1. LOCATION AND SIZES OF ALL EXISTING SERVICES ARE APPROXIMATE. VERIFY ALL UTILITIES PRIOR TO COMMENCING WORK.

2. FOR EXACT LOCATION OF PLUMBING FIXTURES, DRAINS AND EQUIPMENT SEE ARCHITECTURAL DRAWINGS.

3. ALL DOMESTIC WATER AND VENT PIPING SHOWN TO BE RUN ABOVE CEILING UNLESS OTHERWISE NOTED.

4. ALL SANITARY PIPING SHOWN TO BE RUN BELOW FLOOR UNLESS OTHERWISE NOTED.

5. ENTIRE INSTALLATION INCLUDING MATERIALS, EQUIPMENT AND WORKMANSHIP SHALL CONFIRM WITH ALL APPLICABLE LAWS, CODES AND REGULATIONS OF MUNICIPAL, STATE AND FEDERAL AUTHORITIES, ALSO THE PLUMBING CODE 2018 IPC, AND OTHER REGULATORY BODIES HAVING JURISDICTION OVER THE CLASS OF WORK.

6. THE CONTRACTOR SHALL MAKE TESTS FOR ACCEPTANCE AND APPROVAL AS REQUIRED BY THE CODE. REQUIRED TESTS SHALL BE PERFORMED IN THE PRESENCE OF OWNER’S REPRESENTATIVE UNLESS WAIVED IN WRITING.

7. THE CONTRACTOR SHALL FIELD COORDINATE THE WORK WITH THAT OF ALL OTHER TRADES.

8. ALL DOMESTIC WATER PIPING SHALL BE INSULATED AS REQUIRED.

9.THE PEXA PIPING SHALL CONFORM TO THE REQUIREMENTS OF ASTM F876–XX FOR CROSSLINKED POLYETHYLENE (PEXA) TUBING, WITH A MINIMUM PRESSURE RATING OF 200 PSI AT 73.4°F (23°C).

DRAIN, WASTE, STORM, AND VENT PIPING MATERIAL: FOR BELOW GROUND SOIL, WASTE AND BENT PIPING SHOULD BE SERVICE WEIGHT HUB AND SPIGOT CAST IRON CONFORMING TO ASTM A74, WITH LEAD AND OAKUM JOINTS AS ALLOWED BY PLUMBING CODE; FOR ABOVE GROUND SOIL, WASTE AND VENT PIPING SHOULD BE ABS OR PVC DEPENDING ON APPLICATION.

PVC DMV PIPING MAY ALSO BE USED FOR DRAINING APPLICATIONS. PVC DWV PIPE SHALL BE MADE FROM TYPE 1, GRADE 1, PVC COMPOUND AS SPECIFIED IN ASTM D1784. THE PVC DWV PIPE SHALL HAVE A NOMINAL INSIDE DIAMETER (ID) OF 4 INCHES (101.6 MM). THE PIPE SHALL CONFORM TO THE STANDARD DIMENSIONS FOR 4–INCH PVC DWV PIPE AS SPECIFIED IN ASTM D2665. EACH LENGTH OF PVC DWV PIPE SHALL BE CLEARLY MARKED WITH THE MANUFACTURER’S NAME OR TRADEMARK, PIPE SIZE, MATERIAL DESIGNATION (E.G., PVC), AND THE ASTM STANDARD DESIGNATION (E.G., ASTM D2665).

10. ANY ITEM OF MATERIALS NOT INDICATED ON THE DRAWINGS OR NOT SPECIFIED AND WHICH ARE REQUIRED FOR THE COMPLETE INSTALLATION OF ANY PART OF THE WORK DESCRIBED, SHALL BE FURNISHED AS CODE REQUIRED.

11. INSTALL CLEANOUT AT OR NEAR THE BOTTOM OF SANITARY/WASTE STACK.

12. PROVIDE PROPER ACCESS PANELS AS SPECIFIED IN WALLS AND CEILINGS FOR ANY EQUIPMENT, DEVICES, VALVES, SHOCK ABSORBERS, TRAP PRIMERS, CLEANOUTS ETC. REQUIRING ACCESS.

		PLUMBING FIXTURE AND FAUCETS REFERENCED STANDARDS
MARK	DESCRIPTION	STANDARD
WC-1	WATER CLOSET	WATER CLOSETS SHALL CONFIRM TO THE WATER CONSUMPTION REQUIREMENTS OF SECTION 604.4 AND SHALL CONFIRM TO ANSI Z124.4. ASME A112.19.2M, CSA B45.1, CSA B45.4 OR CSA B45.5. WATER CLOSETS SHALL CONFIRM TO THE HYDRAULIC PERFORMANCE REQUIREMENTS OF ASME A112.19.19.9M, CSA B45.1, CSA B45.4 OR CSA B45.5. ELECTRO HYDRAULIC WATER CLOSETS SHALL COMPLY WITH ASME A112.19.13.
L-1	LAVATORY	LAVATORIES SHALL CONFIRM TO ANSI Z124.3. ASME A112.19.1M, ASME A112.19.2M, ASME A112.19.3M, ASME A112.19.4M, ASME A112.19.9M, CSA B45.2, CSA B45.3, CSA B45.4, ROUP WASH UP EQUIPMENT SHALL CONFIRM TO THE REQUIREMENTS OF SECTION 402. EVERY 20 INCHES (608MM) OF RIM SPACE SHALL BE CONSIDERED AS ONE LAVATORY.
KS-1	KITCHEN SINK	SINKS SHALL CONFIRM TO ANSI Z124.6, ASME A112.19.1M, ASME A112.19.2M, ASME A112.19.3M, ASME A112.19.4M, ASME A112.19.9M, CSA B45.1, CSA B45.2, CSA B45.3, OR CSA B45.4,
	FAUCETS AND FIXTURE FITTINGS	FAUCETS AND FIXTURE FITTINGS SHALL CONFORM TO ASME A112.18.1 OR CSA B125. FAUCETS AND FIXTURE FITTINGS THAT SUPPLY DRINKING WATER FOR HUMAN INGESTION SHALL CONFORM TO THE REQUIREMENTS OF NSF 61, SECTION 9. FLEXIBLE WATER CONNECTORS EXPOSED TO CONTINUOUS PRESSURE SHALL CONFORM TO THE REQUIREMENTS OF SECTION 605.6 HAND HELD SHOWERS SHALL CONFORM TO ASSE 1014 OR CSA B125. SHOWER AND TUB SHOWER COMBINATION VALVES SHALL BE BALANCED PRESSURE, THERMOSTATIC OR COMBINATION BALANCED PRESSURE/THERMOSTATIC VALVES THAT CONFORM TO THE REQUIREMENTS OF ASSE 1016 OR CSA B125, MULTIPLE (GANG) SHOWERS SUPPLIED WITH A SINGLE TEMPERED WATER SUPPLY PIPE SHALL HAVE THE WATER SUPPLY FOR SUCH SHOWERS CONTROLLED BY A MASTER THERMOSTATIC MIXING VALVE COMPLYING WITH ASSE 1017. SHOWER AND TUB SHOWER COMBINATION VALVES AND MASTER THERMOSTATIC MIXING VALVES REQUIRED BY THIS SECTION SHALL BE EQUIPPED WITH A MEANS TO LIMIT THE MAXIMUM SETTING OF THE VALVE TO 120°F (49°C), WHICH SHALL BE FIELD ADJUSTED IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. FAUCETS AND FIXTURE FITTINGS WITH HOSE CONNECTED OUTLETS SHALL CONFORM TO ASME A112.18.3M. TEMPERATURE ACTUATED, FLOW REDUCTION DEVICES. WHERE INSTALLED FOR INDIVIDUAL FIXTURE FITTINGS, SHALL CONFORM TO ASSE 1062. SUCH VALVES SHALL NOT BE USED ALONE AS A SUBSTITUTE FOR THE BALANCED PRESSURE. THERMOSTATIC OR COMBINATION SHOWER VALVES REQUIRED IN SECTION 424.3 PEX PIPING MAY ALSO BE ALLOWED AND SHALL CONSIST OF CROSSLINKED POLYETHYLENE (PEXA) PIPE AND ASSOCIATED COMPONENTS, COMPLYING WITH THE SPECIFICATIONS DETAILED HEREIN.

PLUMBING NOTES:

1. ALL DIMENSIONS ARE IN INCHES UNLESS OTHERWISE NOTED.
2. ALL PLUMBING INSTALLATIONS SHALL CONFIRM WITH THE REQUIREMENTS OF MANUFACTURER RECOMMENDATION AND OR 2018 IPC.
3. ALL PLUMBING MATERIALS SHALL BE AS SPECIFIED IN THE CONTRACT SPECS AND BOQ.
4. ALL PIPE SIZES SHOWN ARE NOMINAL DIAMETER IN INCHES. UNLESS OTHERWISE MENTIONED.
5. INSTALLER SHOULD NOT SCALE THE DRAWING.
6. ALL PIPE PENETRATIONS IN WALL & SLABS SHALL BE THROUGH PIPE SLEEVES.
7. IF ANY ERROR OR OMISSION IS FOUND IN DRAWING THIS OFFICE MAY BE CONSULTED FOR RECTIFICATION.

TABLE 604.4 MAXIMUM FLOW RATES AND CONSUMPTION FOR PLUMBING FIXTURES AND FIXTURE FITTINGS	
PLUMBING FIXTURE R FIXTURE FITTING	MAXIMUM FLOW RATE OR QUANTITY b
LAVATORY, PRIVATE	1.5 gpm at 60 psi
SINK FAUCET	1.5 gpm at 60 psi
WATER CLOSET	1.28 GALLONS PER FLUSHING CYCLE
FOR SI: 1 GALLON = 3.785 L, 1 GALLON PER MINUTE = 3.785 L/M, 1 POUND PER SQUARE INCH = 6.895 KPA.	
A. A HAND HELD SHOWER SPRAY IS A SHOWER HEAD. B. CONSUMPTION TOLERANCES SHALL BE DETERMINED FROM REFERENCED STANDARDS. C. WATER FACTOR IN GALLONS PER CYCLE CUBIC FOOT ALL PLUMBING FIXTURES SHALL CONTRIBUTE TO A LEEDS SOLUTION AND SHALL MEET EPA CRITERIA AND BEEN CONSIDERED AS WATER EFFICIENT PRODUCTS AS STIPULATED BY THE LEEDS TA 2009 REFERENCE GUIDE (20% REDUCTION REQUIRED).	


OCCUPANT LOAD SHALL BE USED TO DETERMINE ALL FIXTURE COUNTS PER THE 2018 IPC TABLE 403.1 MINIMUM NUMBER OF REQUIRED PLUMBING FIXTURES ASSEMBLY – AUDITORIUMS WITHOUT PERMANENT SEATING, ART GALLERIES, EXHIBITION HALLS, MUSEUMS, LECTURE HALLS, LIBRARIES, ARCADES AND GYMNASIUMS (NOTE D)

607.2 HOT OR TEMPERED WATER SUPPLY TO FIXTURES. THE DEVELOPED LENGTH OF HOT OR TEMPERED WATER PIPING, FROM THE SOURCE OF HOT WATER TO THE FIXTURES THAT REQUIRE HOT OR TEMPERED WATER, SHALL NOT EXCEED 50 FEET (15 240 MM). RECIRCULATING SYSTEM PIPING AND HEAT–TRACED PIPING SHALL BE CONSIDERED TO BE SOURCES OF HOT OR TEMPERED WATER.

607.1.1 TEMPERATURE LIMITING MEANS. A THERMOSTAT CONTROL FOR A WATER HEATER SHALL NOT SERVE AS THE TEMPERATURE LIMITING MEANS FOR THE PURPOSES OF COMPLYING WITH THE REQUIREMENTS OF THIS CODE FOR MAXIMUM ALLOWABLE HOT OR TEMPERED WATER DELIVERY TEMPERATURE AT FIXTURES.

607.1.2 TEMPERED WATER TEMPERATURE CONTROL. TEMPERED WATER SHALL BE SUPPLIED THROUGH A WATER TEMPERATURE LIMITING DEVICE THAT CONFORMS TO ASSE 1070/ASME A112.1070/CSA B125.70 AND SHALL LIMIT THE TEMPERED WATER TO NOT GREATER THAN 110°F (43°C). THIS PROVISION SHALL NOT SUPERSEDE THE REQUIREMENT FOR PROTECTIVE SHOWER VALVES IN ACCORDANCE WITH SECTION 412.3.

607.3 THERMAL EXPANSION CONTROL. WHERE A STORAGE WATER HEATER IS SUPPLIED WITH COLD WATER THAT PASSES THROUGH A CHECK VALVE, PRESSURE REDUCING VALVE OR BACKFLOW PREVENTER, A THERMAL EXPANSION CONTROL DEVICE SHALL BE CONNECTED TO THE WATER HEATER COLD WATER SUPPLY PIPE AT A POINT THAT IS DOWNSTREAM OF ALL CHECK VALVES, PRESSURE REDUCING VALVES AND BACKFLOW PREVENTERS. THERMAL EXPANSION TANKS SHALL BE SIZED IN ACCORDANCE WITH THE TANK MANUFACTURER’S INSTRUCTIONS AND SHALL BE SIZED SUCH THAT THE PRESSURE IN THE WATER DISTRIBUTION SYSTEMSHALL NOT EXCEED THAT REQUIRED BY SECTION 604.8.



OWNER SIGNATURE

REVISION STATUS

Rev	DATE	DESCRIPTION	DRAWN BY
001	07-2023	ISSUED FOR APPROVAL	A.S
01			
02			
03			
04			

CLIENT/CONSULTANT APPROVAL STATUS

APPROVED	(A)
APPROVED WITH NOTES	(B)
RESUBMIT	(C)
DISAPPROVED	(D)

OWNER:

ADDRESS:

140 Saddle Ridge Road

DESIGN CONSULTANT:
TSABA CORP
NADIF BRACEY
254 CHAPMAN RD, STE 208 #13130
NEWARK, DELAWARE 19702
EMAIL:TS9DESIGNS@GMAIL.COM


DRAWING STATUS:
DESIGN DRAWING

DISCIPLINE:
PLUMBING


PROJECT TITLE:
PHYSICAL THERAPY - FEILD HOUSE

DRAWING TITLE:
NOTES


DRAWN BY: A.S	CHECKED BY: N.B	DATE: 20 JUL 2023
JOB NO 632-003	SHT NO PL-01	SCALE: NTS @A3

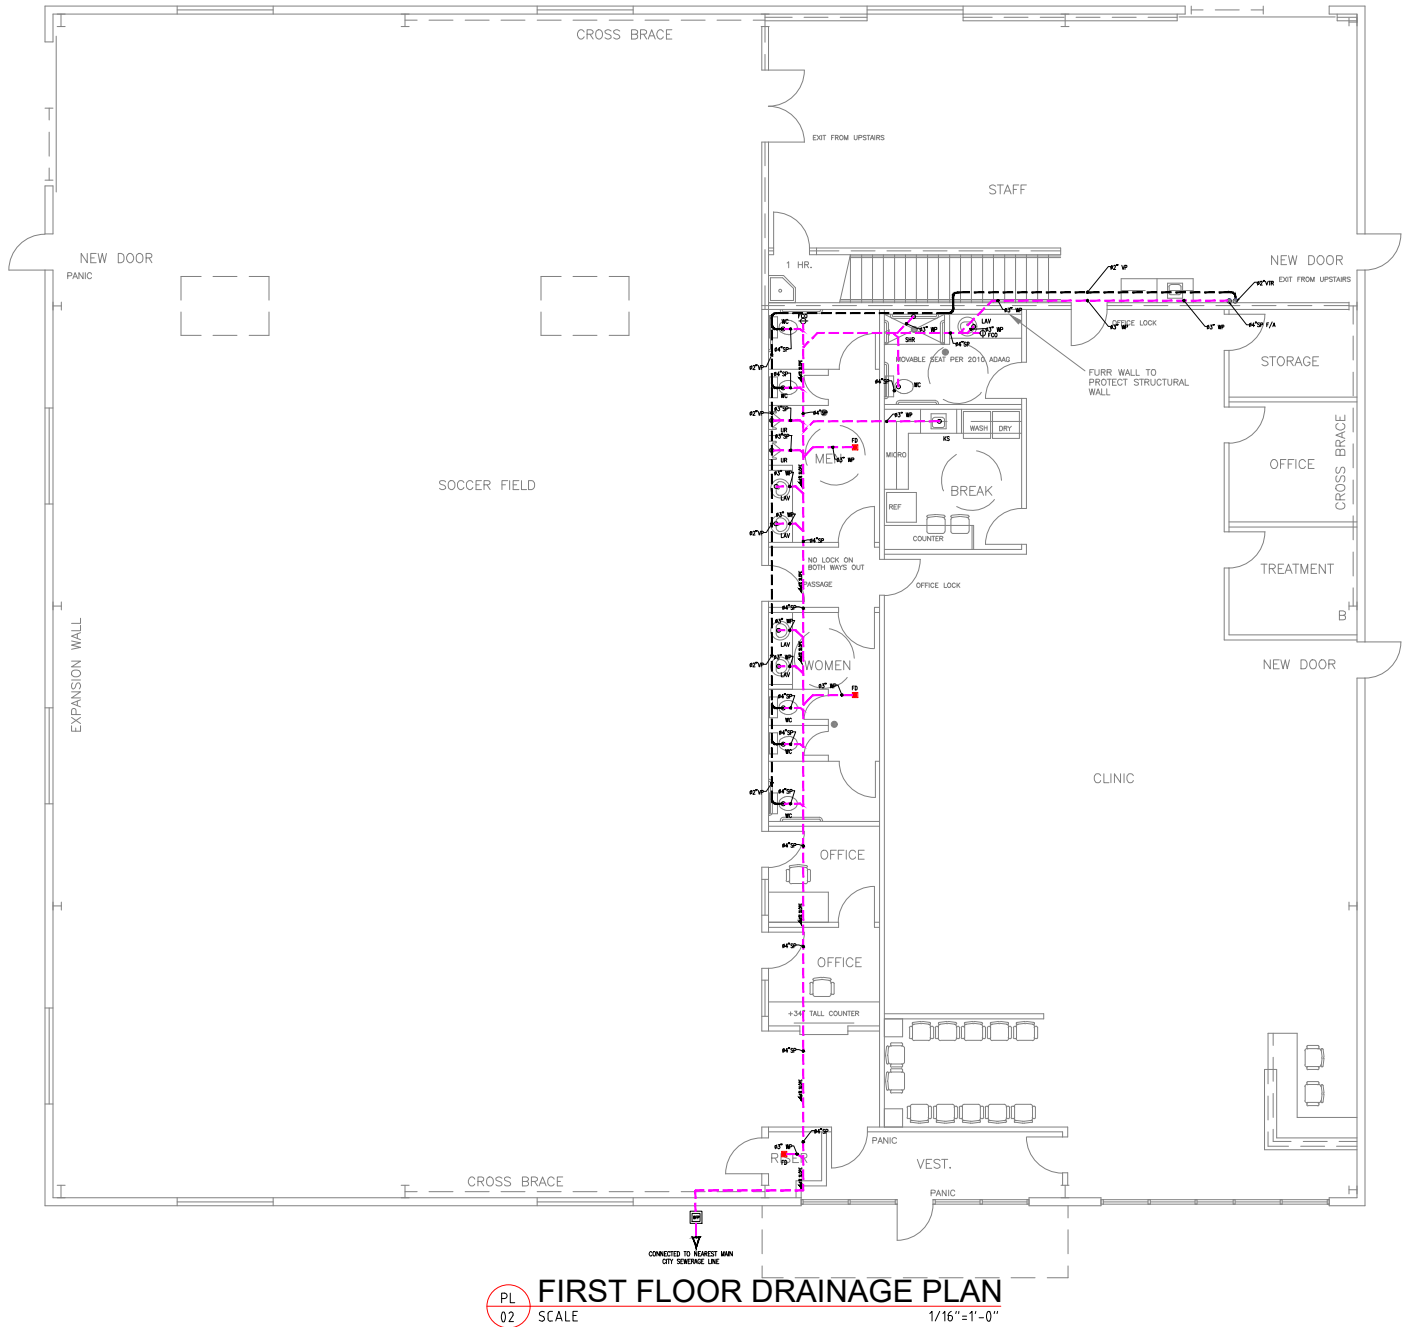

PL 02 SCALE 1/16"=1'-0"

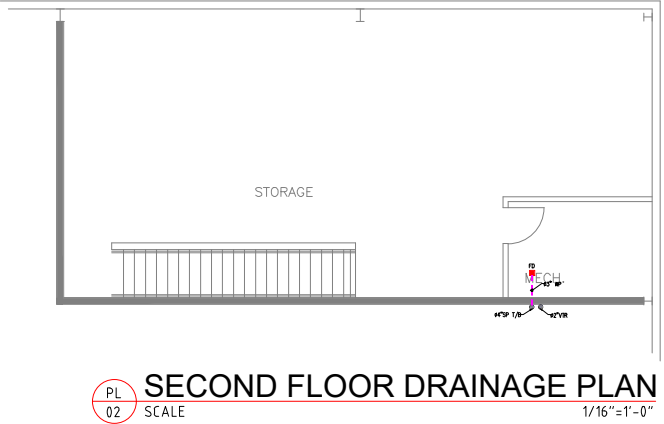

PL 02 SCALE 1/16"=1'-0"



PLUMBING LEGEND:	
SYMBOL	DESCRIPTION
	HWS - HOT WATER SUPPLY
	CWS - COLD WATER SUPPLY
	SP-SOIL PIPE
	WP-WASTE PIPE
	SHUT OFF VALVE
	GATE VALVE
WH	WATER HEATER
GT	GREASE TRAP
WC	WATER CLOSET
KS	KITCHEN SINK
AS	ABLUTION SPRAY
FCO	FLOOR CLEANOUT
FD	FLOOR DRAIN
LAV	LAVATORY

OWNER SIGNATURE

REVISION STATUS			
Rev	DATE	DESCRIPTION	DRAWN BY
00	07-2023	ISSUED FOR APPROVAL	A.S
01			
02			
03			
04			

CLIENT/CONSULTANT APPROVAL STATUS	
APPROVED	(A)
APPROVED WITH NOTES	(B)
RESUBMIT	(C)
DISAPPROVED	(D)

OWNER:

ADDRESS:

140 Saddle Ridge Road

DESIGN CONSULTANT:
TSABA CORP
NADIF BRACEY
254 CHAPMAN RD, STE 208 #13130
NEWARK, DELAWARE 19702
EMAIL:TS9DESIGNS@GMAIL.COM


DRAWING STATUS:
DESIGN DRAWING

DISCIPLINE: PLUMBING

PROJECT TITLE:
PHYSICAL THERAPY - FEILD HOUSE

DRAWING TITLE:
DRAINAGE FLOOR PLANS

DRAWN BY: A.S	CHECKED BY: N.B	DATE: 20 JUL 2023
JOB NO 632-003	SHT NO PL-02	SCALE: 1/16"=1'-0" @A3

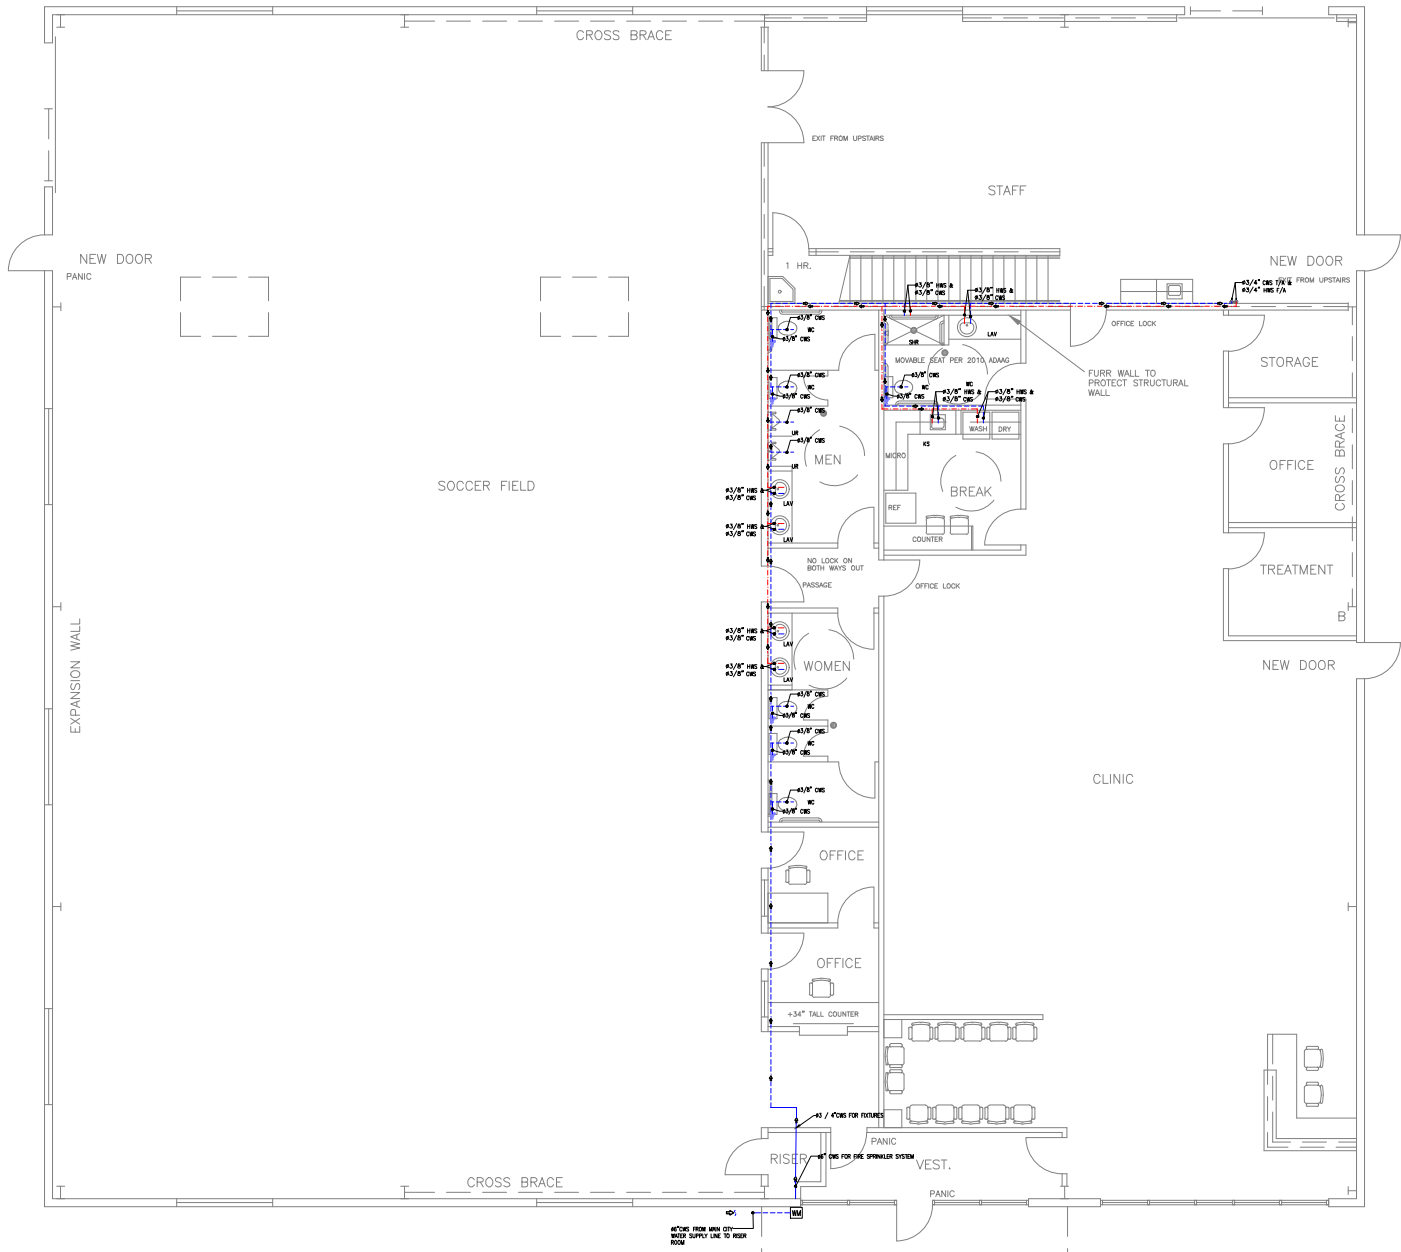

PL 03 FIRST FLOOR WATER SUPPLY PLAN
SCALE 1/16"=1'-0"



EL 02 SECOND FLOOR WATER SUPPLY PLAN
SCALE 1/16"=1'-0"

PLUMBING LEGEND:	
SYMBOL	DESCRIPTION
	HWS - HOT WATER SUPPLY
	CWS - COLD WATER SUPPLY
	SP-SOIL PIPE
	WP-WASTE PIPE
	SHUT OFF VALVE
	GATE VALVE
WH	WATER HEATER
GT	GREASE TRAP
WC	WATER CLOSET
KS	KITCHEN SINK
AS	ABLUTION SPRAY
FCO	FLOOR CLEANOUT
FD	FLOOR DRAIN
LAV	LAVATORY

OWNER SIGNATURE

REVISION STATUS			
Rev	DATE	DESCRIPTION	DRAWN BY
00	07-2023	ISSUED FOR APPROVAL	A.S
01			
02			
03			
04			

CLIENT/CONSULTANT APPROVAL STATUS	
APPROVED	(A)
APPROVED WITH NOTES	(B)
RESUBMIT	(C)
DISAPPROVED	(D)

OWNER:

ADDRESS:

140 Saddle Ridge Road

DESIGN CONSULTANT:
TSABA CORP
NADIF BRACEY
254 CHAPMAN RD, STE 208 #13130
NEWARK, DELAWARE 19702
EMAIL:TS9DESIGNS@GMAIL.COM

DRAWING STATUS:
DESIGN DRAWING

DISCIPLINE:
PLUMBING

PROJECT TITLE:
PHYSICAL THERAPY - FEILD HOUSE

DRAWING TITLE:
FIRST FLOOR
WATER SUPPLY PLAN


DRAWN BY: A.S	CHECKED BY: N.B	DATE: 20 JUL. 2023
JOB NO 632-003	SHT NO PL-03	SCALE: 1/16"=1'-0" @A3



Natural Gas Pipe Sizing Chart										
Length of Pipe in Feet	Size of Pipe in Inches									
	1/2"	3/4"	1"	1-1/4"	1-1/2"	2"	2-1/2"	3"	4"	
10	108	230	387	793	1237	2259	3640	6434	9521	
20	75	160	280	569	877	1610	2813	5226	8521	
30	61	129	224	471	719	1335	2165	4107	7893	
40	52	110	196	401	635	1143	1867	3258	6795	
50	46	98	177	364	580	1041	1680	2936	6142	
60	42	89	159	338	513	957	1559	2854	5847	
70	38	82	149	317	476	896	1447	2492	5250	
80	36	76	140	299	443	840	1353	2315	4900	
90	33	71	133	275	420	793	1288	2203	4667	
100	32	68	126	266	411	775	1246	2128	4518	
125	28	60	117	243	369	700	1143	1904	4065	
150	25	54	105	215	327	625	1008	1699	3645	
175	23	50	95	196	303	583	993	1554	3370	
200	22	47	84	182	280	541	877	1437	3160	
300	17	37	70	145	224	439	686	1139	2539	

Natural Gas flow is given in thousands of BTU/hr. - One cubic foot of LP gas = 1000 BTU
Nominal pressure at the burner for Natural Gas is 3.5" of water column. (Typical machine supply 5"-7")
Pipe length must include additional length for all fittings. Add approximately 5 feet of pipe per fitting
Natural Gas Example: A machine with a burner that requires 440,000 BTU would need a 1-1/4" pipe for a 20' long run.

GAS LEGEND:	
SYMBOL	DESCRIPTION
	GAS SUPPLY PIPE
	SHUT OFF VALVE
	GATE VALVE
	TEE WITH REDUCER
	GAS CAP



OWNER SIGNATURE

REVISION STATUS		
Rev	DATE	DESCRIPTION
00	07-2023	ISSUED FOR APPROVAL
01		
02		
03		
04		

CLIENT/CONSULTANT APPROVAL STATUS	
APPROVED	(A)
APPROVED WITH NOTES	(B)
RESUBMIT	(C)
DISAPPROVED	(D)

OWNER:

ADDRESS:
140 Saddle Ridge Road

DESIGN CONSULTANT:
TSABA CORP
NADIF BRACEY
254 CHAPMAN RD, STE 208 #13130
NEWARK, DELAWARE 19702
EMAIL:TS9DESIGNS@GMAIL.COM




DRAWING STATUS:
DESIGN DRAWING




DISCIPLINE:
PLUMBING

PROJECT TITLE:
PHYSICAL THERAPY - FEILD HOUSE

DRAWING TITLE:
GAS SUPPLY FLOOR PLANS

DRAWN BY: A.S	CHECKED BY: N.B	DATE: 20 JUL 2023
JOB NO 632-003	SHT NO PL-03a	SCALE: 1/16"=1'-0" @A3

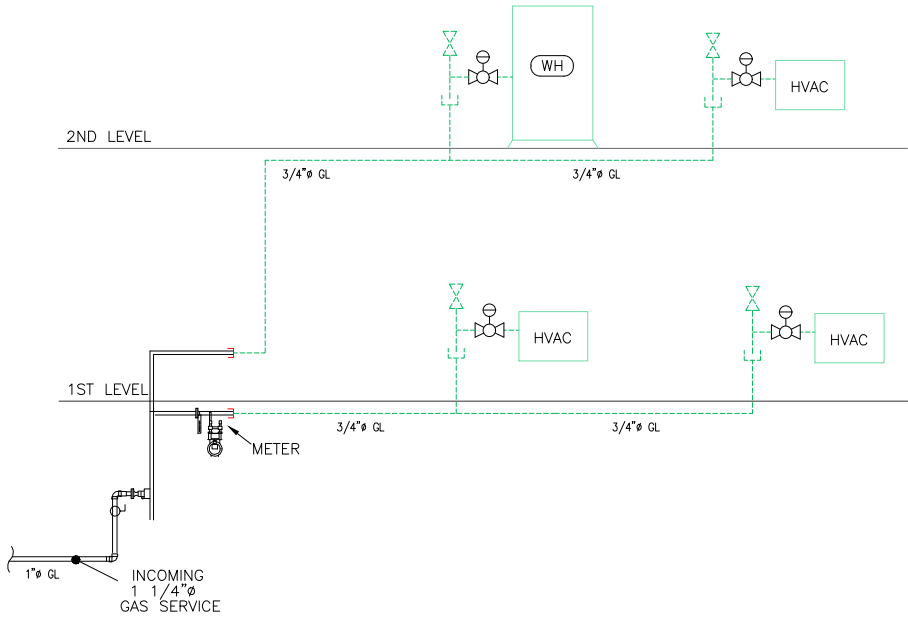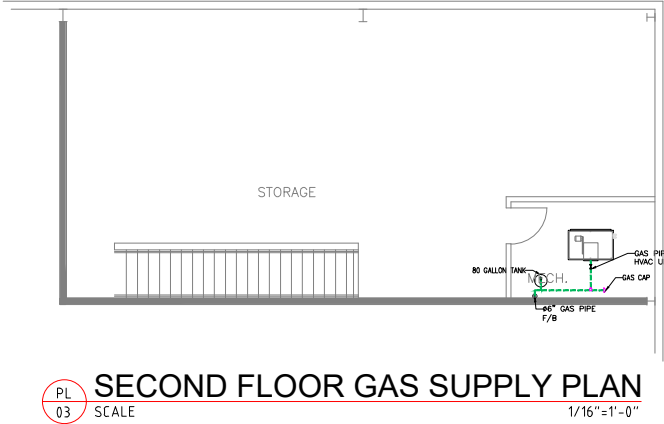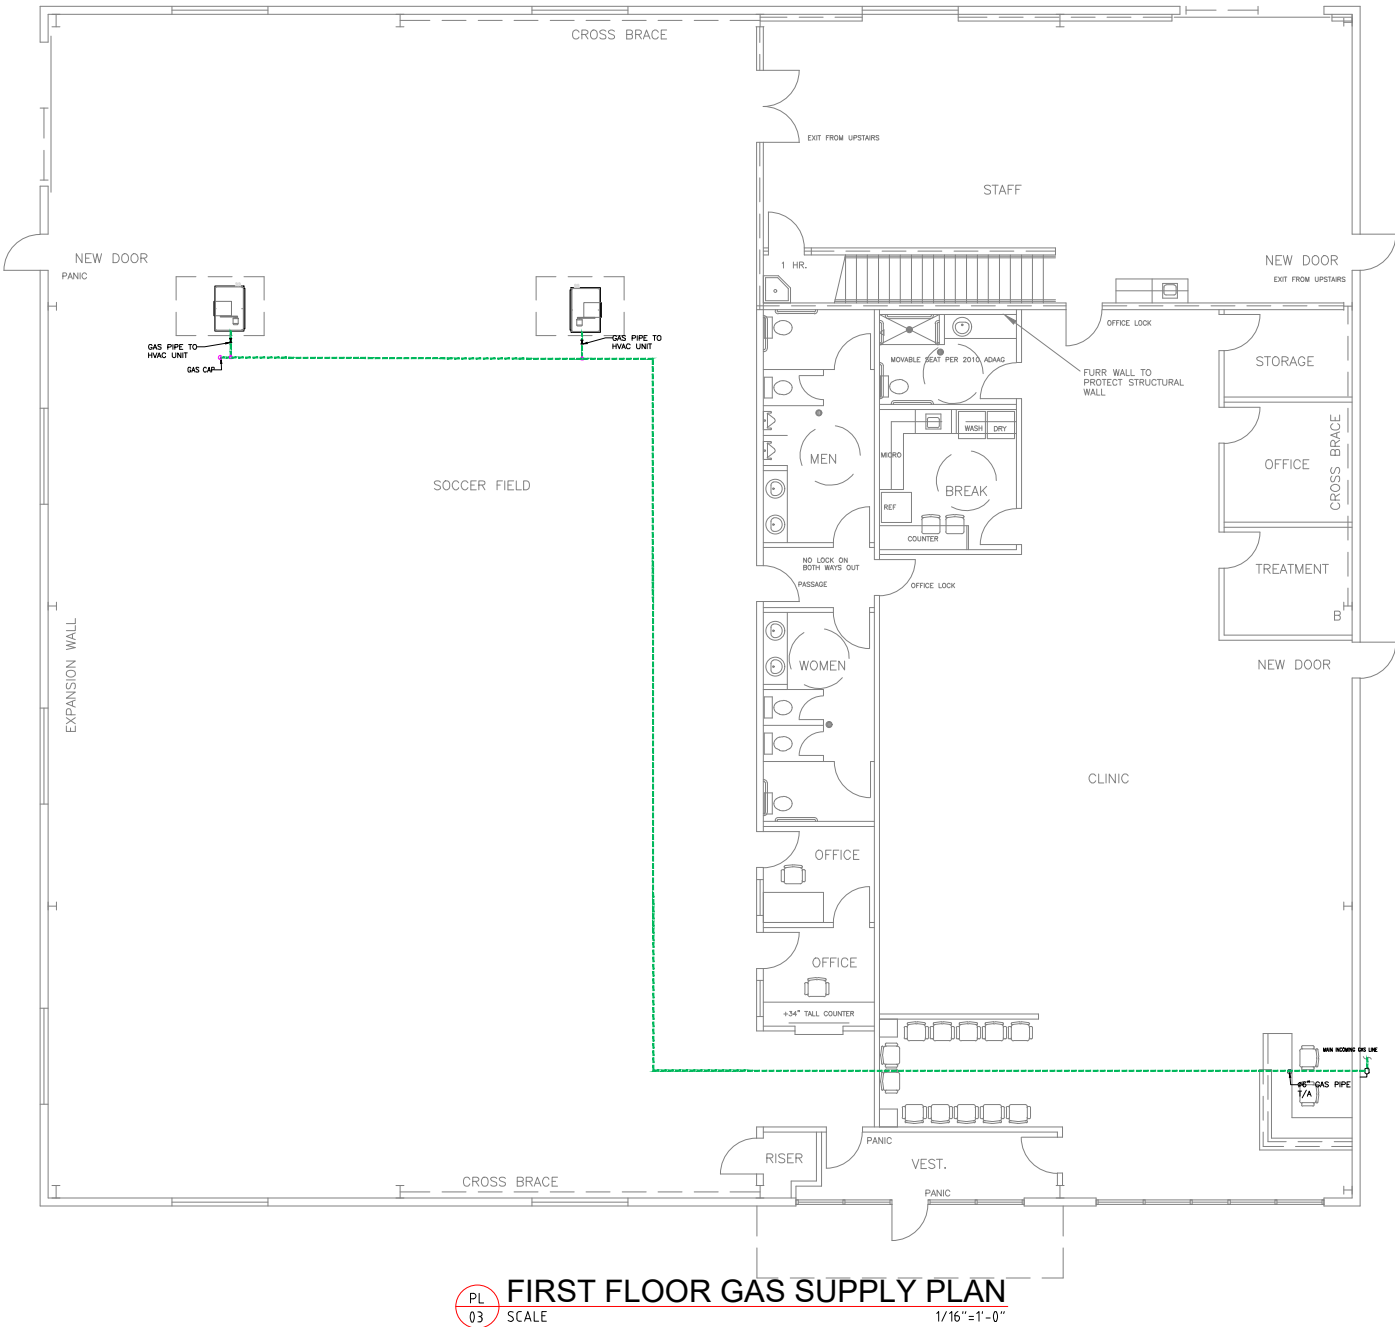

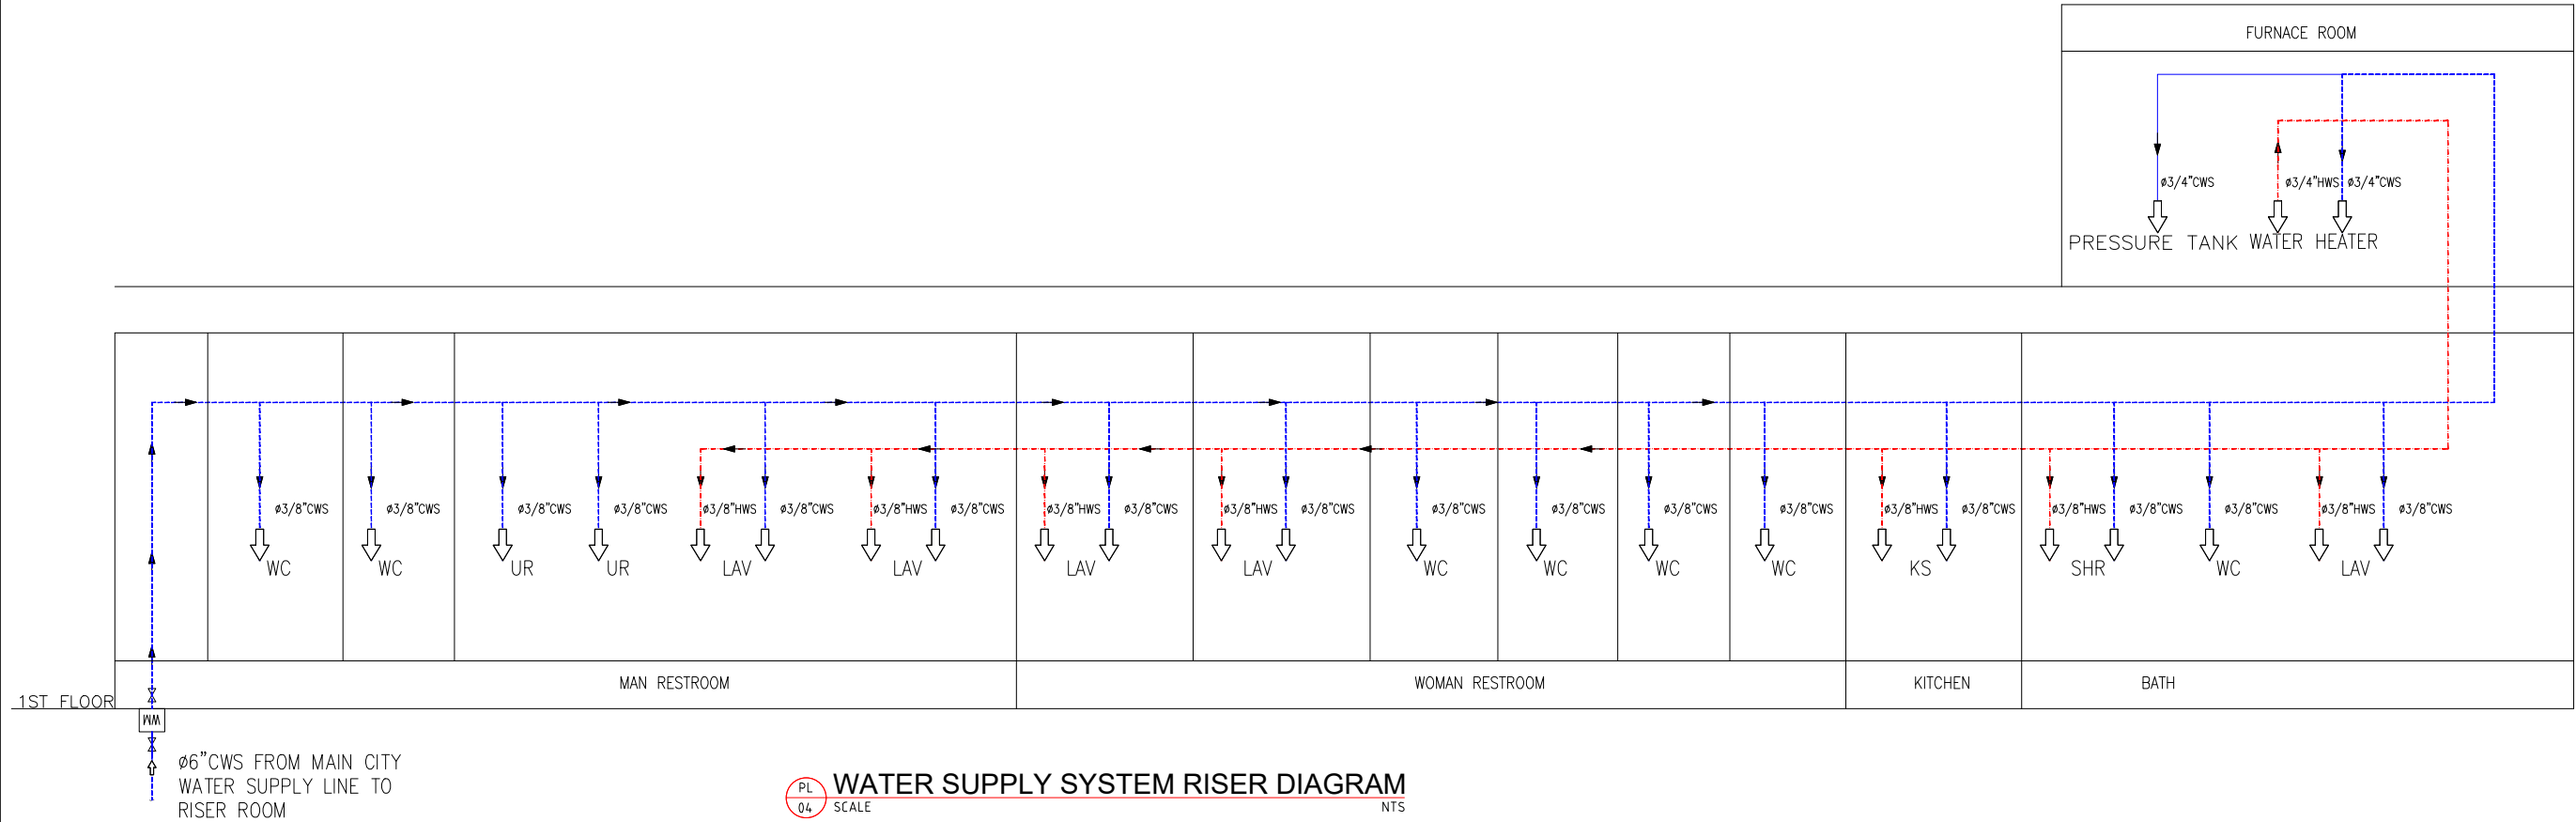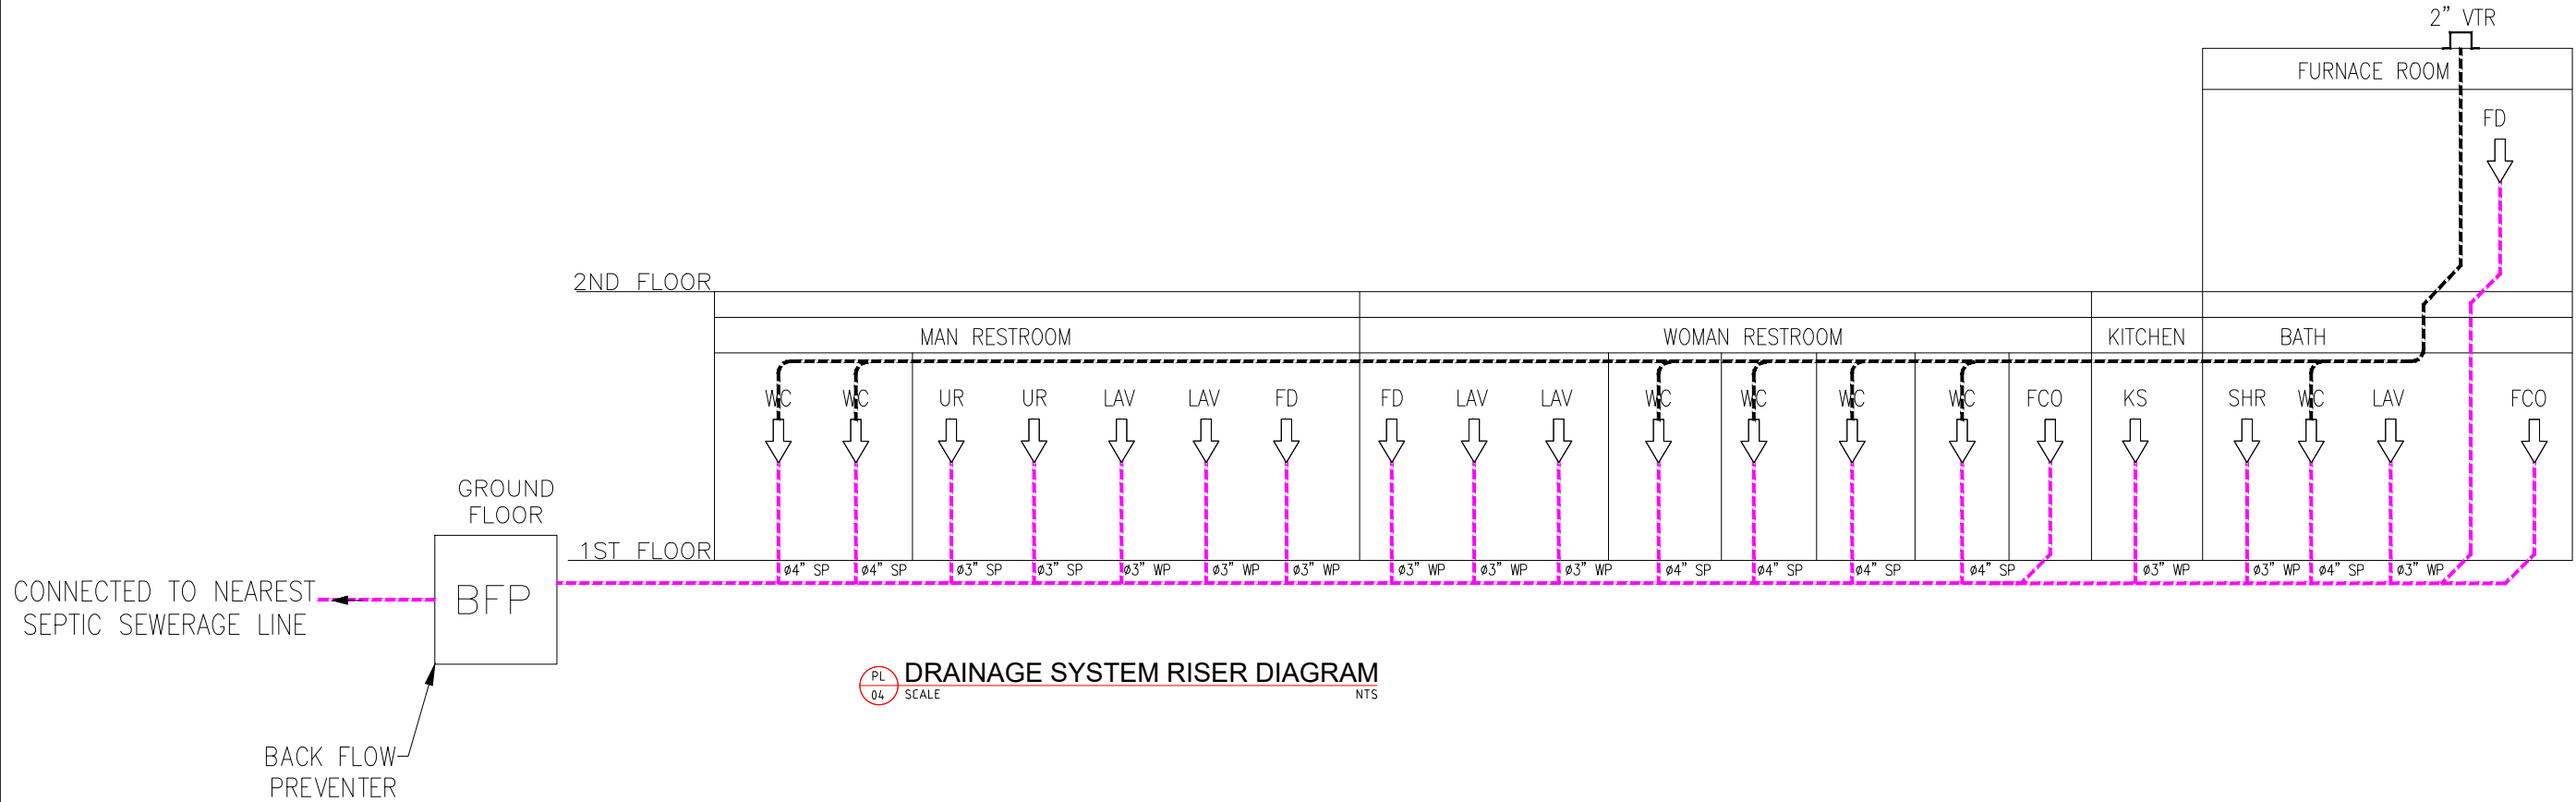

OWNER SIGNATURE

REVISION STATUS			
Rev	DATE	DESCRIPTION	DRAWN BY
00	07-2023	ISSUED FOR APPROVAL	A.S
01			
02			
03			
04			

CLIENT/CONSULTANT APPROVAL STATUS	
APPROVED	(A)
APPROVED WITH NOTES	(B)
RESUBMIT	(C)
DISAPPROVED	(D)

OWNER:

ADDRESS:

140 Saddle Ridge Road

DESIGN CONSULTANT:
TSABA CORP
NADIF BRACEY
254 CHAPMAN RD, STE 208 #13130
NEWARK, DELAWARE 19702
EMAIL:TS9DESIGNS@GMAIL.COM

DRAWING STATUS:
DESIGN DRAWING















DISCIPLINE:
PLUMBING

PROJECT TITLE:
PHYSICAL THERAPY - FEILD HOUSE

DRAWING TITLE:
RISER DIAGRAM

DRAWN BY: A.S	CHECKED BY: N.B	DATE: 20 JUL 2023
JOB NO 632-003	SHT NO PL-04	SCALE: NTS @A3

MECHANICAL LEGEND

SYMBOL	ABBREV.	DESCRIPTION	SYMBOL	ABBREV.	DESCRIPTION
		COORDINATE WITH ELECTRICAL			LINED DUCTWORK (OR PLENUM)
	CD	CONDENSATE DRAIN (A.C)			DUCT RISE IN DIRECTION OF FLOW
	D	DRAIN			DUCT DROP IN DIRECTION OF FLOW
	RD	REFRIGERANT DISCHARGE			ROUND DUCT UP
	RL	REFRIGERANT LIQUID			ROUND DUCT DOWN
	RS	REFRIGERANT SUCTION			SUPPLY DUCT UP
		PIPE DOWN			SUPPLY DUCT DOWN
		PIPE UP		RA/OA	RETURN AIR DUCT/OUTSIDE AIR DUCT UP
		PIPE RISE (OR DN. FOR DROP)			RETURN AIR DUCT/OUTSIDE AIR DUCT DOWN
		DIRECTION OF FLOW IN PIPE			EXHAUST AIR DUCT UP
	AV	AIR VENT (VALVE)			EXHAUST AIR DUCT DOWN
	CHV	CHECK VALVE			DUCT TRANSITION
	CV (2W)	CONTROL VALVE (2-WAY)		CD	CEILING DIFFUSER
	CV (3W)	CONTROL VALVE (3-WAY)		RR	RETURN REGISTER
	FCD	AUTOMATIC FLOW CONTROL DEVICE		ER	EXHAUST REGISTER
	SOV	SHUT OFF VALVE		T'STAT	THERMOSTAT OR TEMPERATURE SENSOR (NUMBER INDICATES EQUIPMENTOR ZONE SERVED)
		GLOBE/BALL/BUTTERFLY VALVE		H'STAT	HUMIDISTAT
	BV	COMBINATION BALANCING & SHUT-OFF VALVE			CARBON DIOXIDE SENSOR
	FEV	FLOW ELEMENT VENTURI		CFM	CUBIC FEET PER MINUTE
		VALVE ON RISE OR DROP			SYMBOL, SEE EQUIPMENT SCHEDULE
	STR.	STRAINER			
	CL	CAPPED LINE			
	DN.	DOWN OR DROP			
	UP	RISE OR RISER			
	RV	PRESSURE RELIEF VALVE			
	PG	PRESSURE GAUGE WITH BALL VALVE			
	R.	ECCENTRIC REDUCER			
	R.	CONCENTRIC REDUCER			
	FC	FLEXIBLE CONNECTION (PIPE)			
	PA	PIPE ANCHOR			
	U	UNION			
		DUCTWORK (1ST NUMBER INDICATES WIDTH SHOWN), NET INSIDE DIMENSION			
	TV	SQUARE ELBOW WITH TURNING VANES			
		RADIUS ELBOW			
	MVD	MANUAL VOLUME DAMPER			
	MOD	MOTOR OPERATED DAMPER			
	BDD	BACKDRAFT DAMPER			
	FD	FIRE DAMPER			
	SD	DUCT MOUNTED SMOKE DETECTOR			
	SFD	AUTOMATIC SMOKE AND FIRE DAMPER			
	FLEX	FLEXIBLE CONNECTION (DUCTWORK)			
	FLEX	FLEXIBLE CONNECTION OR SEISMIC JOINT			


HVAC ABBREVIATIONS

A	AMPERES	HZ	FREQUENCY
AC	AIR CONDITIONING	IN	INCH OR INCHES
AD	ACCESS DOOR	KW	KILOWATT
AFF	ABOVE FINISHED FLOOR	LG	LENGTH
AL	ACOUSTICAL LINING	LAT	LEAVING AIR TEMPERATURE
BHP	BRAKE HORSEPOWER	LBS	POUNDS
BTU	BRITISH THERMAL UNIT	LDB	LEAVING DRY BULB TEMPERATURE
BTUH	BTU PER HOUR	LIN FT	LINEAR FEET
CD	CEILING DIFFUSER	LWB	LEAVING WET BULB TEMPERATURE
CFM	CUBIC FEET PER MINUTE	MAX	MAXIMUM
CG	CEILING GRILLE	MBH	THOUSAND BTU PER HOUR
CLG	CEILING	MHP	MOTOR HORSEPOWER
COMPR	COMPRESSOR	MIN	MINIMUM
CR	CEILING REGISTER	NIC	NOT IN CONTRACT
DB	DRY BULB	NO.	NUMBER
DIAM	DIAMETER	NTS	NOT TO SCALE
DN	DOWN	RA	RETURN AIR
DWG	DRAWING	RM	ROOM
DX	DIRECT EXPANSION	RPM	REVOLUTIONS PER MINUTE
EAT	ENTERING AIR TEMPERATURE	SP	STATIC PRESSURE
EDB	ENTERING DRY BULB TEMPERATURE	SPEC	SPECIFICATION
EF	EXHAUST FAN	TEMP	TEMPERATURE
EWB	ENTERING WET BULB	TG	TOP GRILLE
EWT	ENTERING WATER TEMPERATURE	TV	TURNING VANES
F	DEGREES FAHRENHEIT	TYP	TYPICAL
FC	FLEXIBLE CONNECTION	W	WIDTH
FD	FIRE DAMPER	W/	WITH
FIN FL	FINISHED FLOOR	W/O	WITHOUT
FLA	FULL LOAD AMPERES	WB	WET BULB
FPM	FEET PER MINUTE	WMS	WIRE MESH SCREEN
FT	FEET	SG	SUPPLY GRILLE
HD	HEAD	RG	RETURN GRILLE
HR	HOUR	SP	SMOKE PURGE
MAU	MAKE UP AIR UNIT		

EXHAUST FAN SCHEDULE

MARK	QTY	LOCATION	MANUFACTURER AND MODEL	TYPE	CFM	E.S.P. (IN. W.G.)	MOTOR DATA			SONES	OPTIONS -ACCESSORIES	WEIGHT
							WATTS	SPEED	ELECTRICAL			
EF-1	6	GF UTILITY RM	AIR KING AK50 OR EQUAL	CEILING MOUNTED	50	0.25	1500	1	120-1-60	1.5	BACK DRAFT DAMPER CONTROLLED BY SWITCH	10

NOTES:
VERIFY WITH ARCHITECT/OWNER FOR EXACT MODEL NUMBER BEFORE ROUGH-IN
ALL EXHAUST FANS TO BE ENERGY STAR CERTIFIED



OWNER SIGNATURE

REVISION STATUS

Rev	DATE	DESCRIPTION	DRAWN BY
00	07-2023	ISSUED FOR APPROVAL	A.S
01			
02			
03			
04			

CLIENT/CONSULTANT APPROVAL STATUS

APPROVED	(A)
APPROVED WITH NOTES	(B)
RESUBMIT	(C)
DISAPPROVED	(D)

OWNER:

ADDRESS:

140 Saddle Ridge Road

DESIGN CONSULTANT:

TSABA CORP
NADIF BRACEY
254 CHAPMAN RD, STE 208 #13130
NEWARK, DELAWARE 19702
EMAIL:TS9DESIGNS@GMAIL.COM

DRAWING STATUS:

DESIGN DRAWING

DISCIPLINE:

MECHANICAL

PROJECT TITLE:

PHYSICAL THERAPY - FEILD HOUSE

DRAWING TITLE:

NOTES

DRAWN BY: A.S	CHECKED BY: N.B	DATE: 20 JUL 2023
JOB NO 632-003	SHT NO ME-01	SCALE: NTS @A3

OUTDOOR AIR REQUIREMENTS (AHU 01)

SPACE	NET AREA, S.F. (B)	Rp(C) *	Rz(D) *	SPACE DENSITY *	SPACE OCCUPANCY (F)	O.A. REQ. (C x F + B x D) **
BASEMENT	6000	5	0.06	6, PER	6	390
TOTAL						390
TOTAL OUTSIDE AIR PROVIDED ***						200
TOTAL AIR PROVIDED ****						2000

OUTDOOR AIR REQUIREMENTS (AHU 02)

SPACE	NET AREA, S.F. (B)	Rp(C) *	Rz(D) *	SPACE DENSITY *	SPACE OCCUPANCY (F)	O.A. REQ. (C x F + B x D) **
BASEMENT	6000	5	0.06	6, PER	6	390
TOTAL						390
TOTAL OUTSIDE AIR PROVIDED ***						200
TOTAL AIR PROVIDED ****						2000

OUTDOOR AIR REQUIREMENTS (AHU 03)

SPACE	NET AREA, S.F. (B)	Rp(C) *	Rz(D) *	SPACE DENSITY *	SPACE OCCUPANCY (F)	O.A. REQ. (C x F + B x D) **
BASEMENT	6270	5	0.06	10	10	426.2
TOTAL						426.2
TOTAL OUTSIDE AIR PROVIDED ***						200
TOTAL AIR PROVIDED ****						2000

Goodman 5 Ton 15.5 SEER Heat Pump System

Brand	Goodman	5 Ton
Nominal Capacity	Single	
Stages	15.5 SEER	
SEER Rating	11.5 EER	
EER Rating	60000 BTU	
Nominal Cooling Capacity (BTU)	60000 BTU	
Heating Capacity	55000 BTU	
Cooling Capacity	Goodman GSZ160601	
Heat Pump unit	Goodman AVPTC61D14	
Air Handler unit	Goodman HKSC20DB	
Heat Kit unit	Goodman 204121159	
AHRI	Multi-Position	
Configuration	1810 CFM	
Max Airflow	Heating and Cooling	
Operation		

Heat Pump Specifications

Product Line	GSZ16
Refrigerant	R-410a
Operation	Heating and Cooling
Installation Area	Outdoor
Stages	Single
Capacity	5 Ton
Cooling	BTU 60000
Cooling Capacity	60000 BTU
SEER Rating	16

Heat Pump Electrical Data



Voltage	208/230 Volts
Phase	1
Frequency	60 Hz
Minimum Circuitry Ampacity	37 Amps
Breaker Circuit Size (Recommended)	60 Amps

Heat Pump Dimensions

Suction Conn. Size	1 1/8 Inches
Liquid Conn. Size	3/8 Inches
Heat Pump Height	40 Inches
Heat Pump Width	35.5 Inches
Heat Pump Depth	35.5 Inches
Heat Pump Weight	
Product Weight	306 Pounds
Shipping Weight	326 Pounds

DRAWING LEGEND

SYMBOL	DESCRIPTION
	OUTDOOR AIR CONDENSING UNIT
	VERTICAL AIR HANDLER UNIT
	AIR SUPPLY DUCT. SIZE IS SHOWN ON PLAN
	AIR RETURN DUCT. SIZE IS SHOWN ON PLAN
	EXHAUST AIR DUCT. SIZE IS SHOWN ON PLAN
	SUPPLY AIR DIFFUSER ON CEILING FOR BASEMENT
	EXHAUST FAN
	WALL EXHAUST GRILL

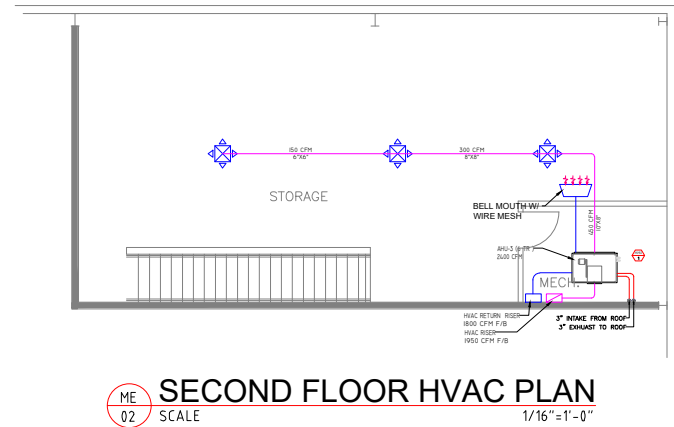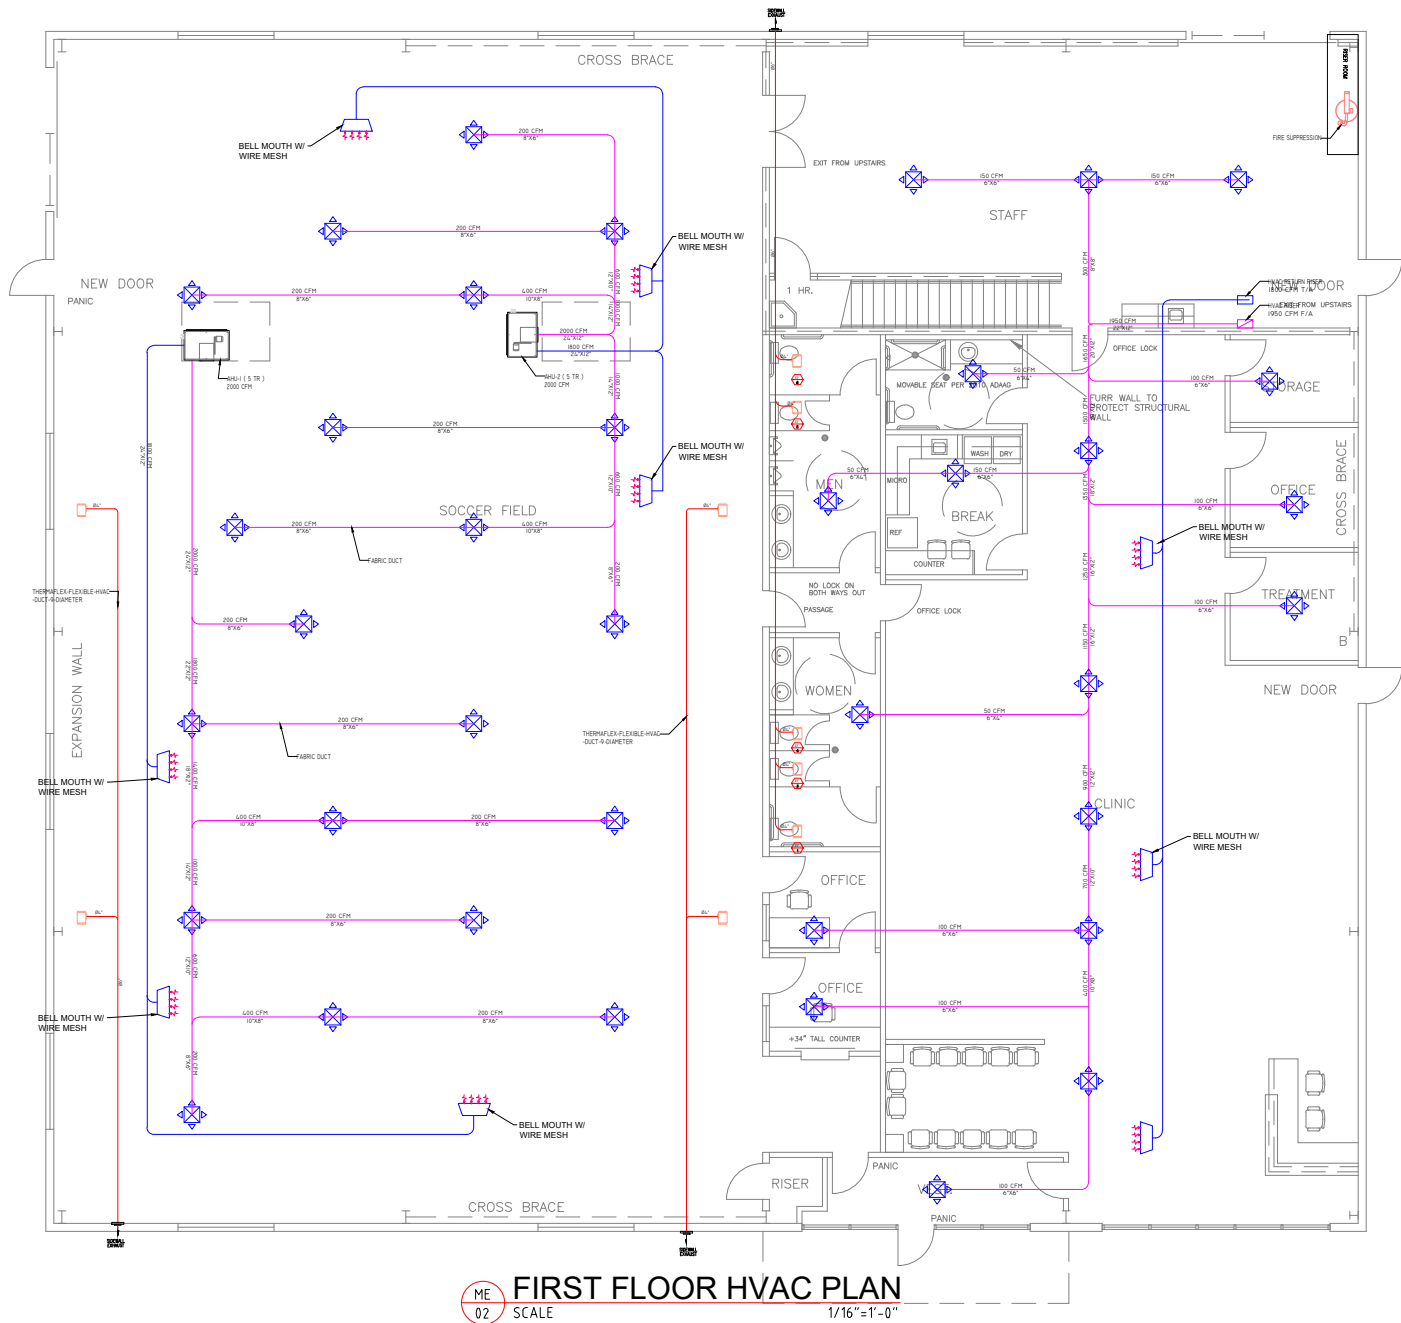

OWNER SIGNATURE

REVISION STATUS

Rev	DATE	DESCRIPTION	DRAWN BY
00	07-2023	ISSUED FOR APPROVAL	A.S
01			
02			
03			
04			

CLIENT/CONSULTANT APPROVAL STATUS

APPROVED	(A)
APPROVED WITH NOTES	(B)
RESUBMIT	(C)
DISAPPROVED	(D)

OWNER:

ADDRESS:

140 Saddle Ridge Road

DESIGN CONSULTANT:

TSABA CORP
NADIF BRACEY
254 CHAPMAN RD, STE 208 #13130
NEWARK, DELAWARE 19702
EMAIL:TS9DESIGNS@GMAIL.COM

DRAWING STATUS:

DESIGN DRAWING

DISCIPLINE:

MECHANICAL

PROJECT TITLE:

PHYSICAL THERAPY - FEILD HOUSE

DRAWING TITLE:

FIRST FLOOR HVAC PLAN

DRAWN BY: A.S	CHECKED BY: N.B	DATE: 20 JUL 2023
JOB NO 632-003	SHT NO ME-02	SCALE: 1/16"=1'-0" @A3



