



Nave 88 x 44 m, servicios al personal, recargas y sala técnica, con cada máquina, puesto, pulmón, mueble y artefacto a escala. Cotas en metros. Ejes 1 a 12 cada 8,00 m y A-B-C

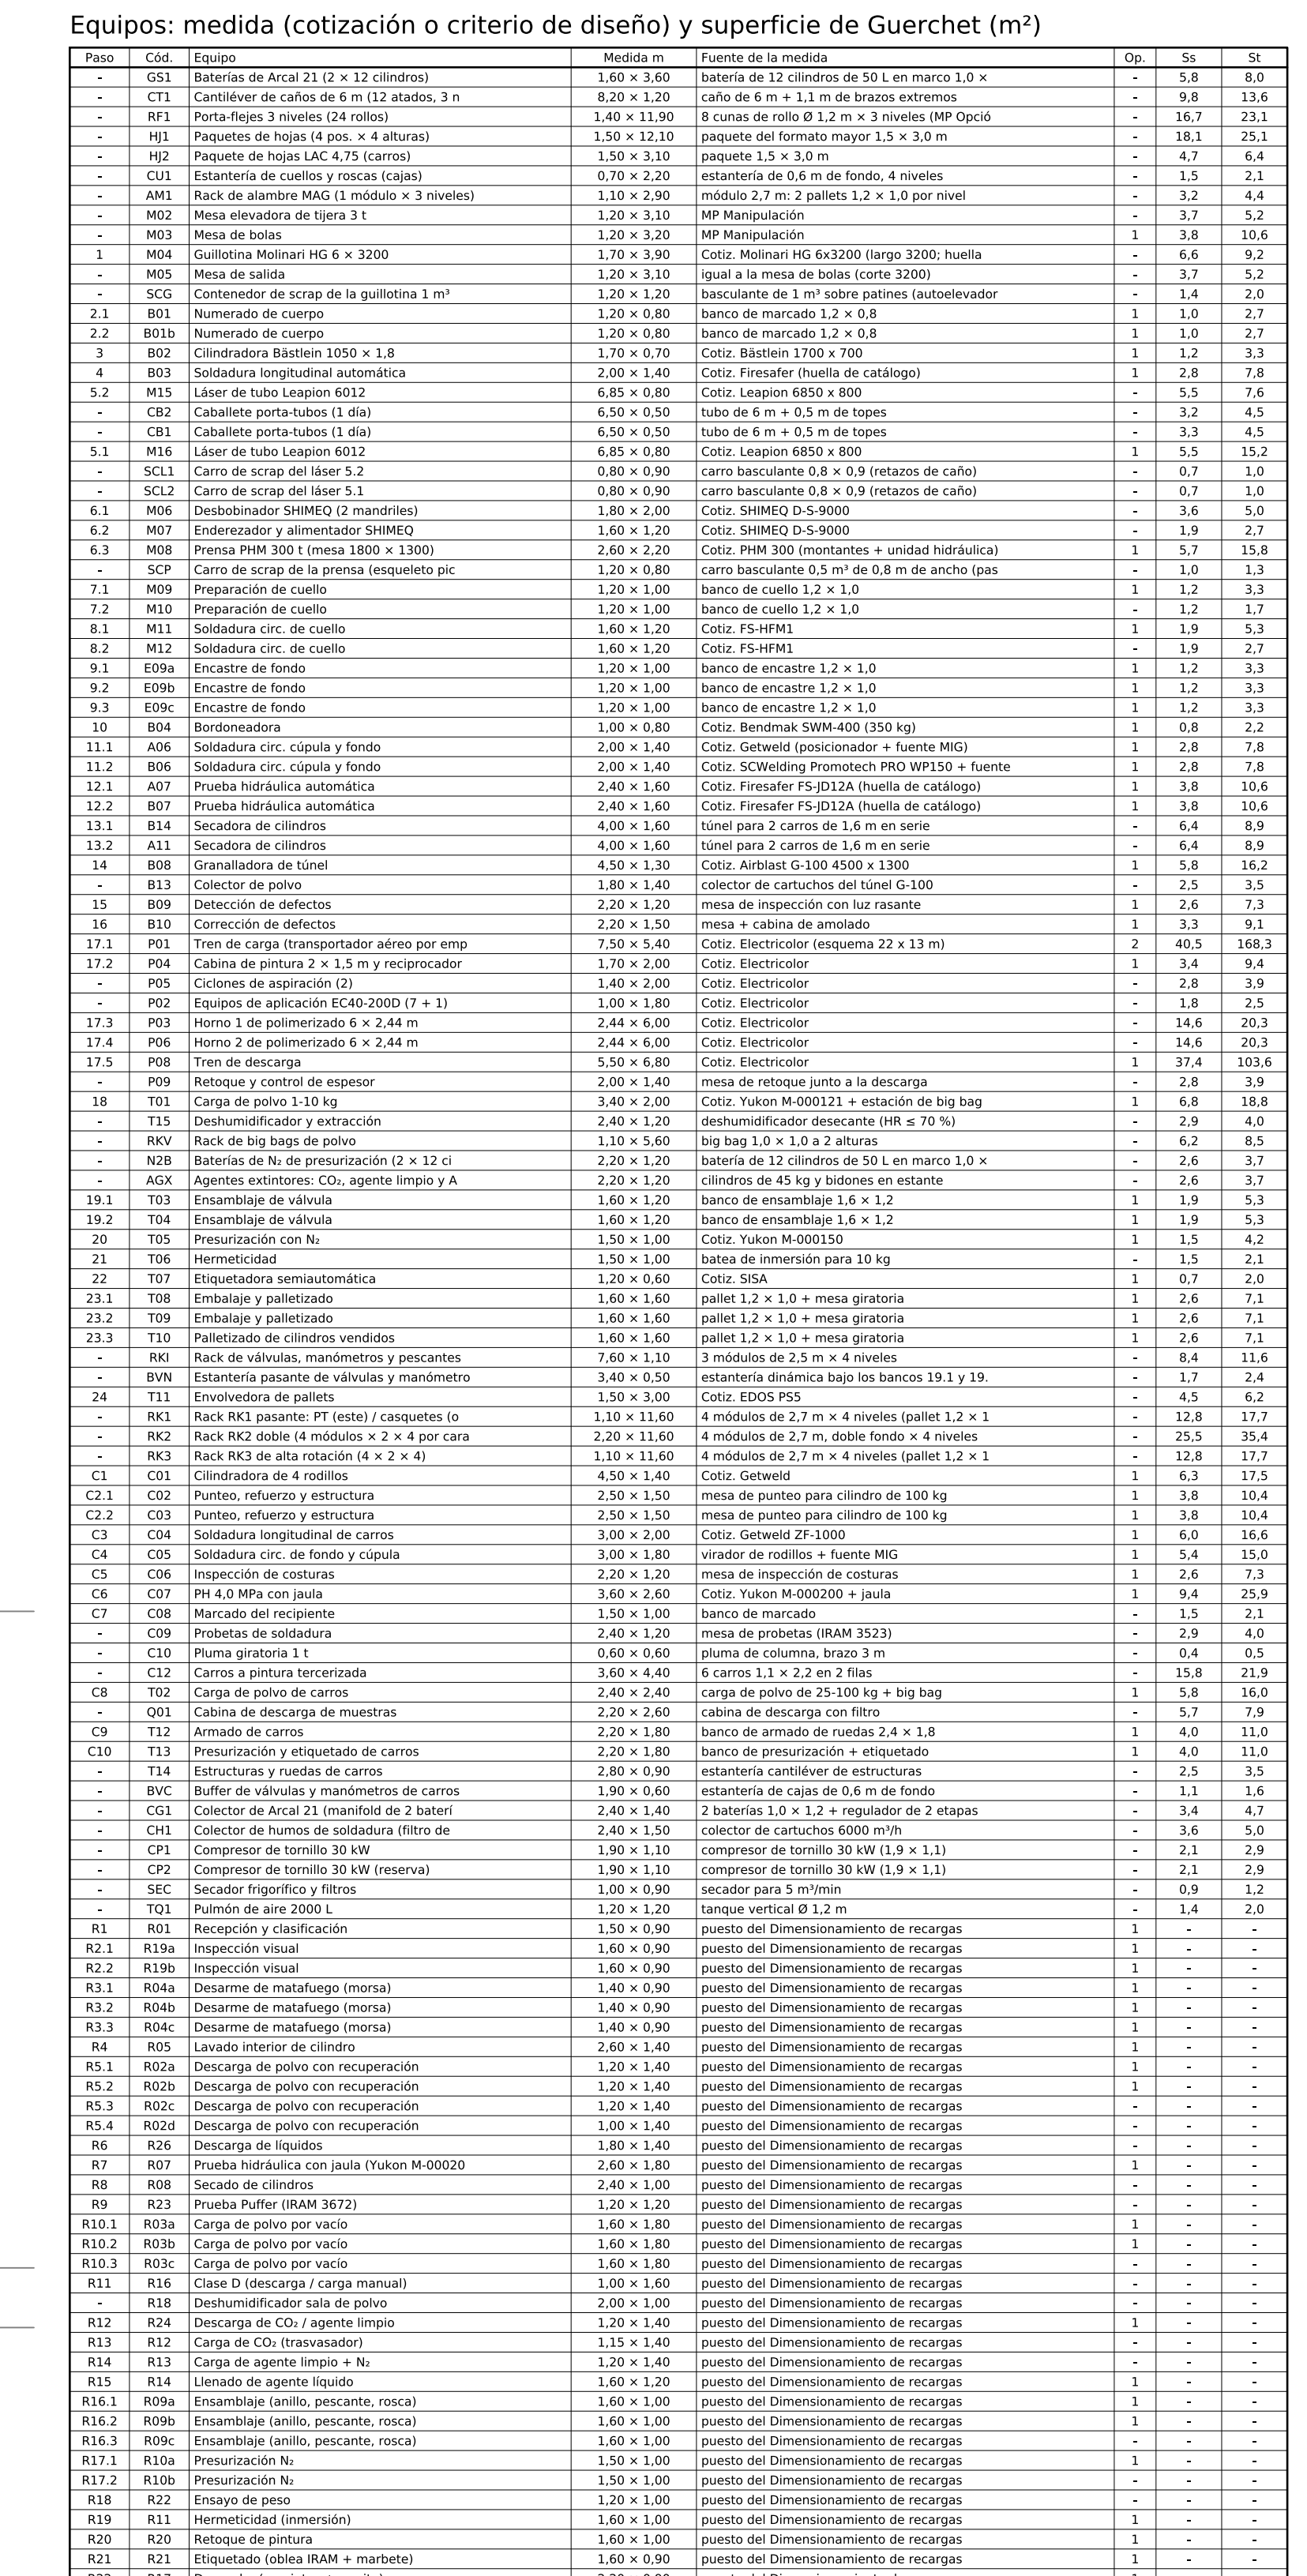

	4	5	7
BL	4	5	7
BLC	7	8	7
BLT	17	18	5
BLT	15	27	5
BLI	6	5	-1
BLT	18	18	8
BLD	12	18	8
BLD	17	100	113
BLD	8	11	7
BLI	49	122	74
BLD	56	100	63
BLI	88	120	84
BLD	67	128	83
BLD	78	77	62
BLD	122	77	72
BLD	352	194	48
BLD	42	118	77
BLT	27	28	1
BLI	118	175	83
BLD	19	68	83
BLI	19	95	54

donde en grande (M2, M3, A1-3, S-T) queda espacio liberado por las medidas reales de las cotizaciones, para debates (achicar la nave o reservar ampliación).

27 28 29

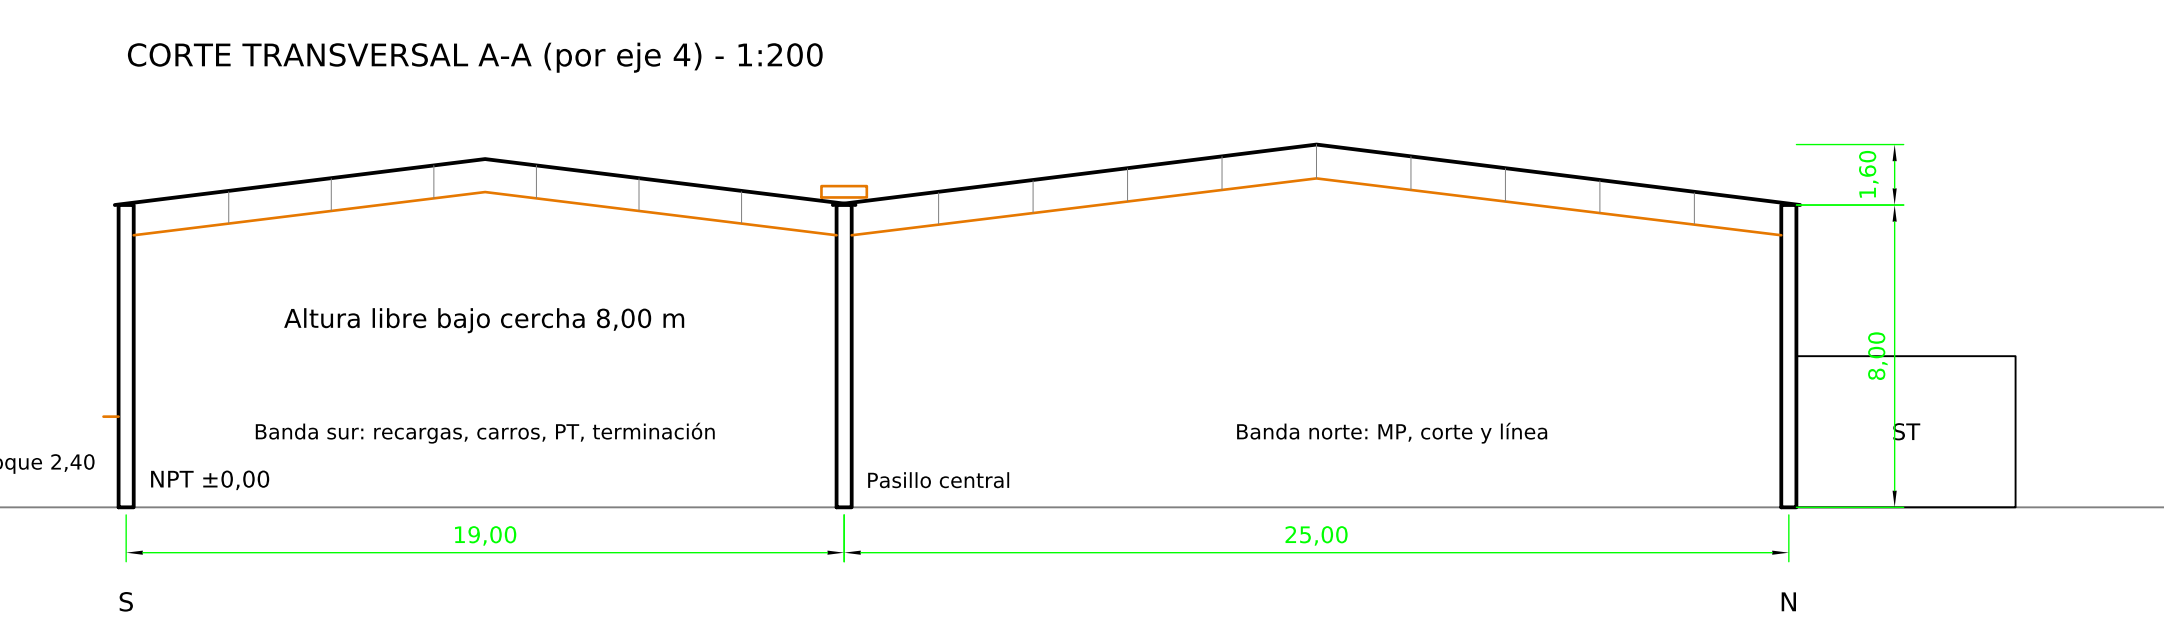

The timeline illustrates the sequence of events in the study. It begins with 'Baseline' (marked with a vertical line). This is followed by a period of '12 weeks' (indicated by a horizontal bar). At the end of this 12-week period, there is a vertical line labeled 'End of treatment'. Following this, there is a period of '12 weeks' (indicated by another horizontal bar). At the end of this second 12-week period, there is a vertical line labeled 'Follow-up'.