

PRECAST DRAWING COMPARISON REPORT

Complete Drawing vs Incomplete Drawing | Dimension Check

Project: Paisley Tower | Project No: P22-132 | Piece Mark: W10-78 | Stubbe's Precast

2 Drawings compared	13 Main items check kiye	12 Items mein difference mila	~31% Overall match
-------------------------------	------------------------------------	---	------------------------------

1. Ye Document Kis Bare Mein Hai?

Ye document ek precast concrete wall panel (Piece Mark W10-78, Paisley Tower project) ke do Tekla shop drawings ka comparison hai. Ek drawing complete hai (reference), aur doosri incomplete hai, jisme kuch dimensions aur components galat, missing ya galat jagah par hain.

Is document ke 5 parts hain:

- **Part 1** – Ye document kis bare mein hai (overview)
- **Part 2** – Engineers ko dimensions kis order (steps) mein chahiye
- **Part 3** – Dono drawings (Complete + Incomplete)
- **Part 4** – Dono drawings ke beech ke differences
- **Part 5** – Incomplete drawing kitne % complete drawing se match karti hai

1.1 Dono Drawings Ki Details

	Complete Drawing	Incomplete Drawing
Role	Reference drawing (sahi drawing)	Jise check / correct karna hai
Drawn by	P.K	Drawing mein likha nahi hai
Date	23.07.2026	15.09.2026
Engineer	H.R	Drawing mein likha nahi hai
Views	Top-in-Form view, saari dimensions aur hardware rows ke saath	Top-in-Form, View End 2 aur View A, lekin kai dimensions / components galat, missing ya galat position par

1.2 Project Ki Common Details

Project	Paisley Tower	28-day strength	40 MPa (incomplete drawing mein 0)
Project Code	PTR	Stripping strength	24 MPa (incomplete drawing mein 0)
Project No	P22-132	Panel weight	18317 LBS
Piece Mark	W10-78	Concrete volume	4.53 yd ³
Company	Stubbe's Precast	Min. cover / Class	25 mm / F2

1.3 Components Ko Simple Bhasha Mein Samjhein

Drawing ke Bill of Materials (BOM) mein ye components hain. Dono drawings mein BOM same hai.

Mark	Description	Qty	Simple matlab
P-205	12000 LB Forged Anchor	2	Lifter: concrete wall ko crane se uthane ke liye lagaya gaya special anchor
SP25-1067	SP25M x 1067 Williams Splice	5	Splicer: rebars ko aapas mein connect karne ke liye
SP30-1219	30M x 1219 Williams Splice	1	Splicer: rebars ko aapas mein connect karne ke liye
P-300	19Ø Insert (NC)	4	Bracing insert: precast wall mein brace / support ko connect karne ka fixing point (drawing mein hardware ke roop mein bhi aata hai)
P-616	13 x 203 x 203 Plate	2	Other hardware: wall mein lagne wali plate
GT76-254	76Ø x 254 mm G.Tube	1	Grout Tube: neeche (bottom side) ka component
GT100-686	100Ø x 686 Grout Tube	1	Grout Tube: neeche (bottom side) ka component
GT100-1219	100Ø x 1219 Grout Tube	6	Grout Tube: neeche (bottom side) ka component

2. Engineers Ko Dimensions Kis Order (Steps) Mein Chahiye

Engineers ko dimensions ek fixed order mein chahiye. Sabse pehle Lifters, uske baad baaki components, aur sabse last mein Overall. Neeche step-by-step order diya hai:


2.1 Dimension Ka Sahi Order

Step	Component	Matlab (simple bhasha mein)	Drawing mein example
1	Lifters	Concrete wall ko crane se uthane ke liye lagaya gaya special anchor.	P-205 (Forged Anchor)
2	Splicers	Rebars ko aapas mein connect karne ke liye.	SP25-1067, SP30-1219
3	Bracing Insert	Precast wall mein brace / support ko connect karne ke liye banaya gaya fixing point.	P-300 (Bracing Insert)
4	Hardware	Wall mein lagne wale alag-alag metal / embedded components.	P-300 (Hardware), GT tubes
5	Other Hardware	Baaki hardware jaise plates, etc.	P-616 (Plate)
6	Opening	Wall mein opening ka profile dimension.	Profile Opening
7	Overall	Poore panel ka overall dimension (sabse last mein).	Profile Overall

Yaad rakhne wali baat

Step 3 (Bracing Insert) aur Step 4 (Hardware) related hain, lekin drawing mein inhe mix nahi karna hai (complete drawing mein dono alag rows mein hain).


2.2 Arrow Aur Font Ka Standard

Arrow Length	Arrow Height	Font Size	Arrow Type
0.75 mm	1.00 mm	1.8 mm	 Closed triangle arrowhead + tip par vertical line (notes ka sketch)

3. Dono Drawings


3A. Complete Drawing (Reference)

File: P22-132_W10-78_-_1____1_.pdf | Drawn by P.K | Date 23.07.2026 | Saari dimensions aur hardware rows maujood hain.

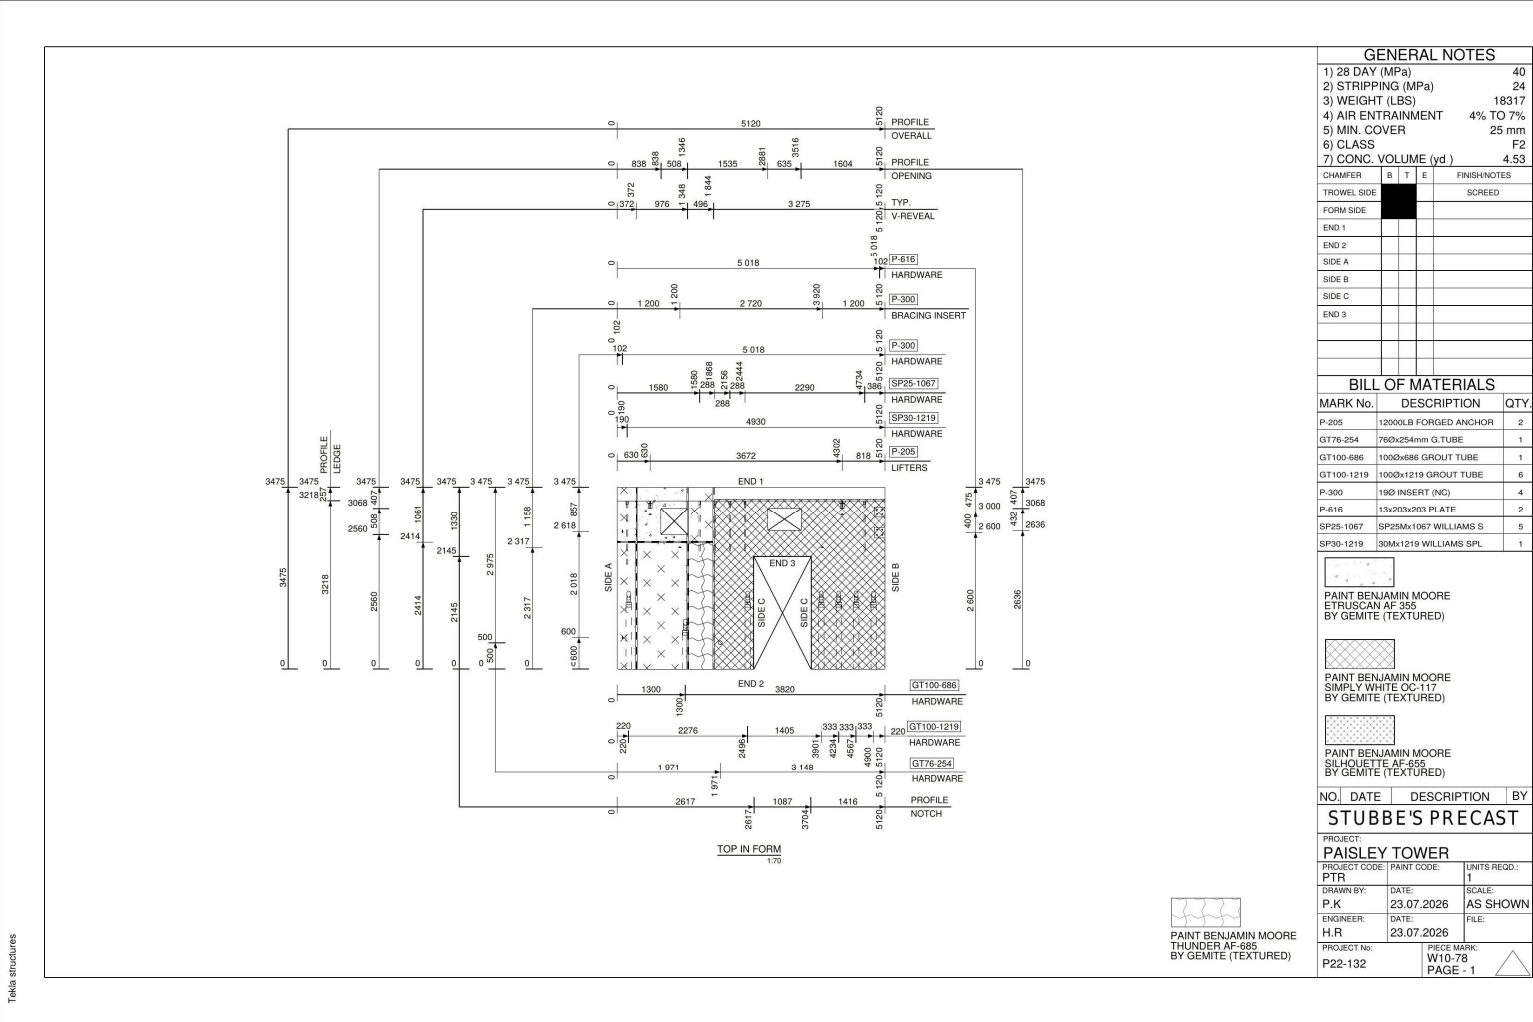

3B. Incomplete Drawing (Check Karni Hai)

File: W10-78_-_1.pdf | Date 15.09.2026 | Kuch dimensions / components galat, missing ya galat position par hain.

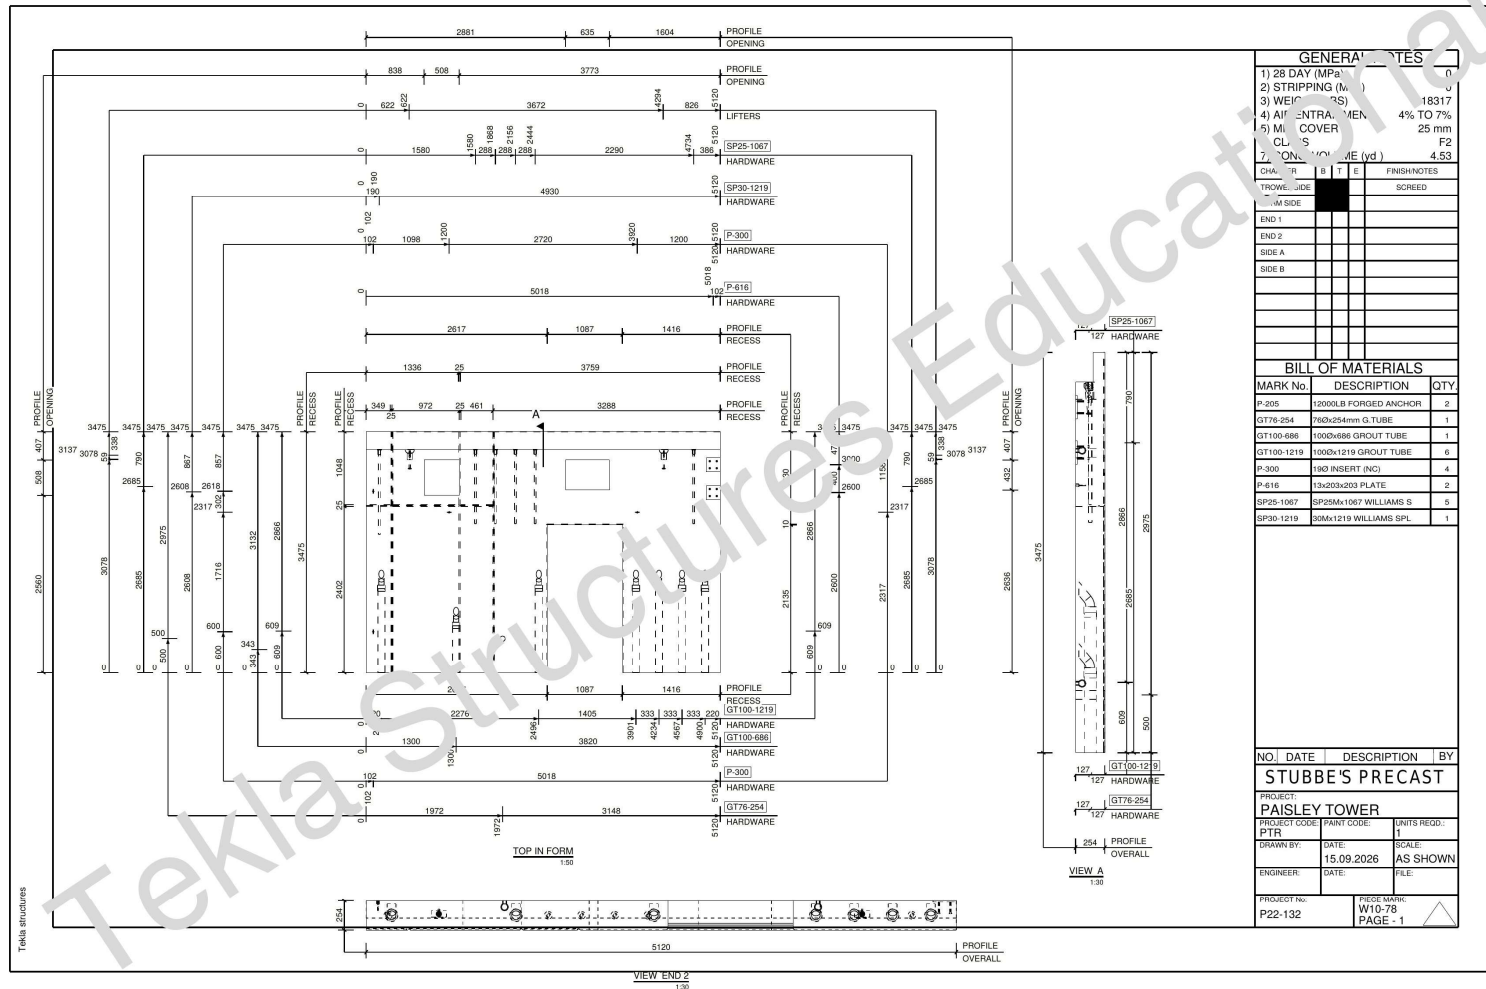

4. Dono Drawings Ke Beech Ke Differences

Neeche wale table mein incomplete drawing ki har galti (complete drawing ke comparison mein) ek jagah likhi hai. Order wahi hai jo Part 2 mein dimension steps ka hai (Lifters se Overall, phir niche ke components).

#	Component	Difference kya hai	Type
1	Lifters (P-205)	Drawing mein 6th number (position) par hai, lekin dimension galat hai.	Wrong Dimension
2	SP30-1219	Dimension sahi hai, lekin position galat hai.	Wrong Position
3	SP25-1067	Dimension sahi hai, lekin position galat hai. (Row number 7th se 8th change hua hai.)	Wrong Position
4	P-300	Hardware mein extra cuts hain. Bracing Insert aur Hardware dono mix ho gaye hain (alag-alag hone chahiye).	Extra / Mixed
5	P-616	Dimension sahi hai, lekin position galat hai.	Wrong Position
6	TYP. V-Reveal	Drawing mein nahi hai.	Not in Drawing
7	Profile Opening	Drawing mein dimension galat hai.	Wrong Dimension
8	Profile Overall	Drawing mein nahi hai.	Not in Drawing
9	GT100-686	Position 2nd hai aur dimension bhi sahi hai.	Correct
10	GT100-1219	Position galat hai (1st), dimension sahi hai.	Wrong Position
11	GT76-254	Position galat hai (5th) aur dimension bhi galat hai.	Wrong Dim + Position
12	Profile Notch	Drawing mein nahi hai.	Not in Drawing
13	Vertical Dimensions	Extra dimensions add ho gaye hain jo nahi hone chahiye.	Extra Dimension

Important Rule: Recess

Recess chahiye hi nahi hai, isliye vertical dimension mein Recess likhna nahi hai. Check karein ki drawing mein Recess na likha ho.

5. Kitne Percent Match Karti Hai?

Match % nikalne ke liye Part 4 ke 13 main items ko score diya gaya hai: sab kuch sahi = 1 point, ek cheez sahi aur ek galat (jaise dimension sahi par position galat) = 0.5 point, drawing mein nahi hai ya dono galat / extra = 0 point.

#	Component	Drawing mein hai?	Dimension	Position	Score
1	Lifters (P-205)	Haan	Galat	Sahi	0.5
2	SP30-1219	Haan	Sahi	Galat	0.5
3	SP25-1067	Haan	Sahi	Galat	0.5
4	P-300 (Bracing + Hardware)	Mixed	Galat (extra cuts)	Galat (mix)	0
5	P-616	Haan	Sahi	Galat	0.5
6	TYP. V-Reveal	Nahi	-	-	0
7	Profile Opening	Haan	Galat	Sahi	0.5
8	Profile Overall	Nahi	-	-	0
9	GT100-686	Haan	Sahi	Sahi	1
10	GT100-1219	Haan	Sahi	Galat	0.5
11	GT76-254	Haan	Galat	Galat	0
12	Profile Notch	Nahi	-	-	0
13	Vertical Dimensions	Extra	-	-	0
	TOTAL				4.0 / 13

Note: Jis point par notes mein galti nahi likhi gayi, use 'Sahi' maana gaya hai.

Final Result: 4.0 / 13 = 30.8%, yaani lagbhag 31% match

~31% Match

~69% Difference

Key Takeaways

13 main items mein se sirf 1 item (GT100-686) पूरी तरह sahi hai.

3 items drawing mein missing hain: TYP. V-Reveal, Profile Overall aur Profile Notch.

5 items ki position galat hai: SP30-1219, SP25-1067, P-616, GT100-1219 aur GT76-254.

3 items ka dimension galat hai: Lifters (P-205), Profile Opening aur GT76-254.

P-300 mein Bracing Insert aur Hardware mix ho gaye hain, aur vertical dimensions mein extra dimensions hain.