Full reused image test (5,450) | Precision–recall

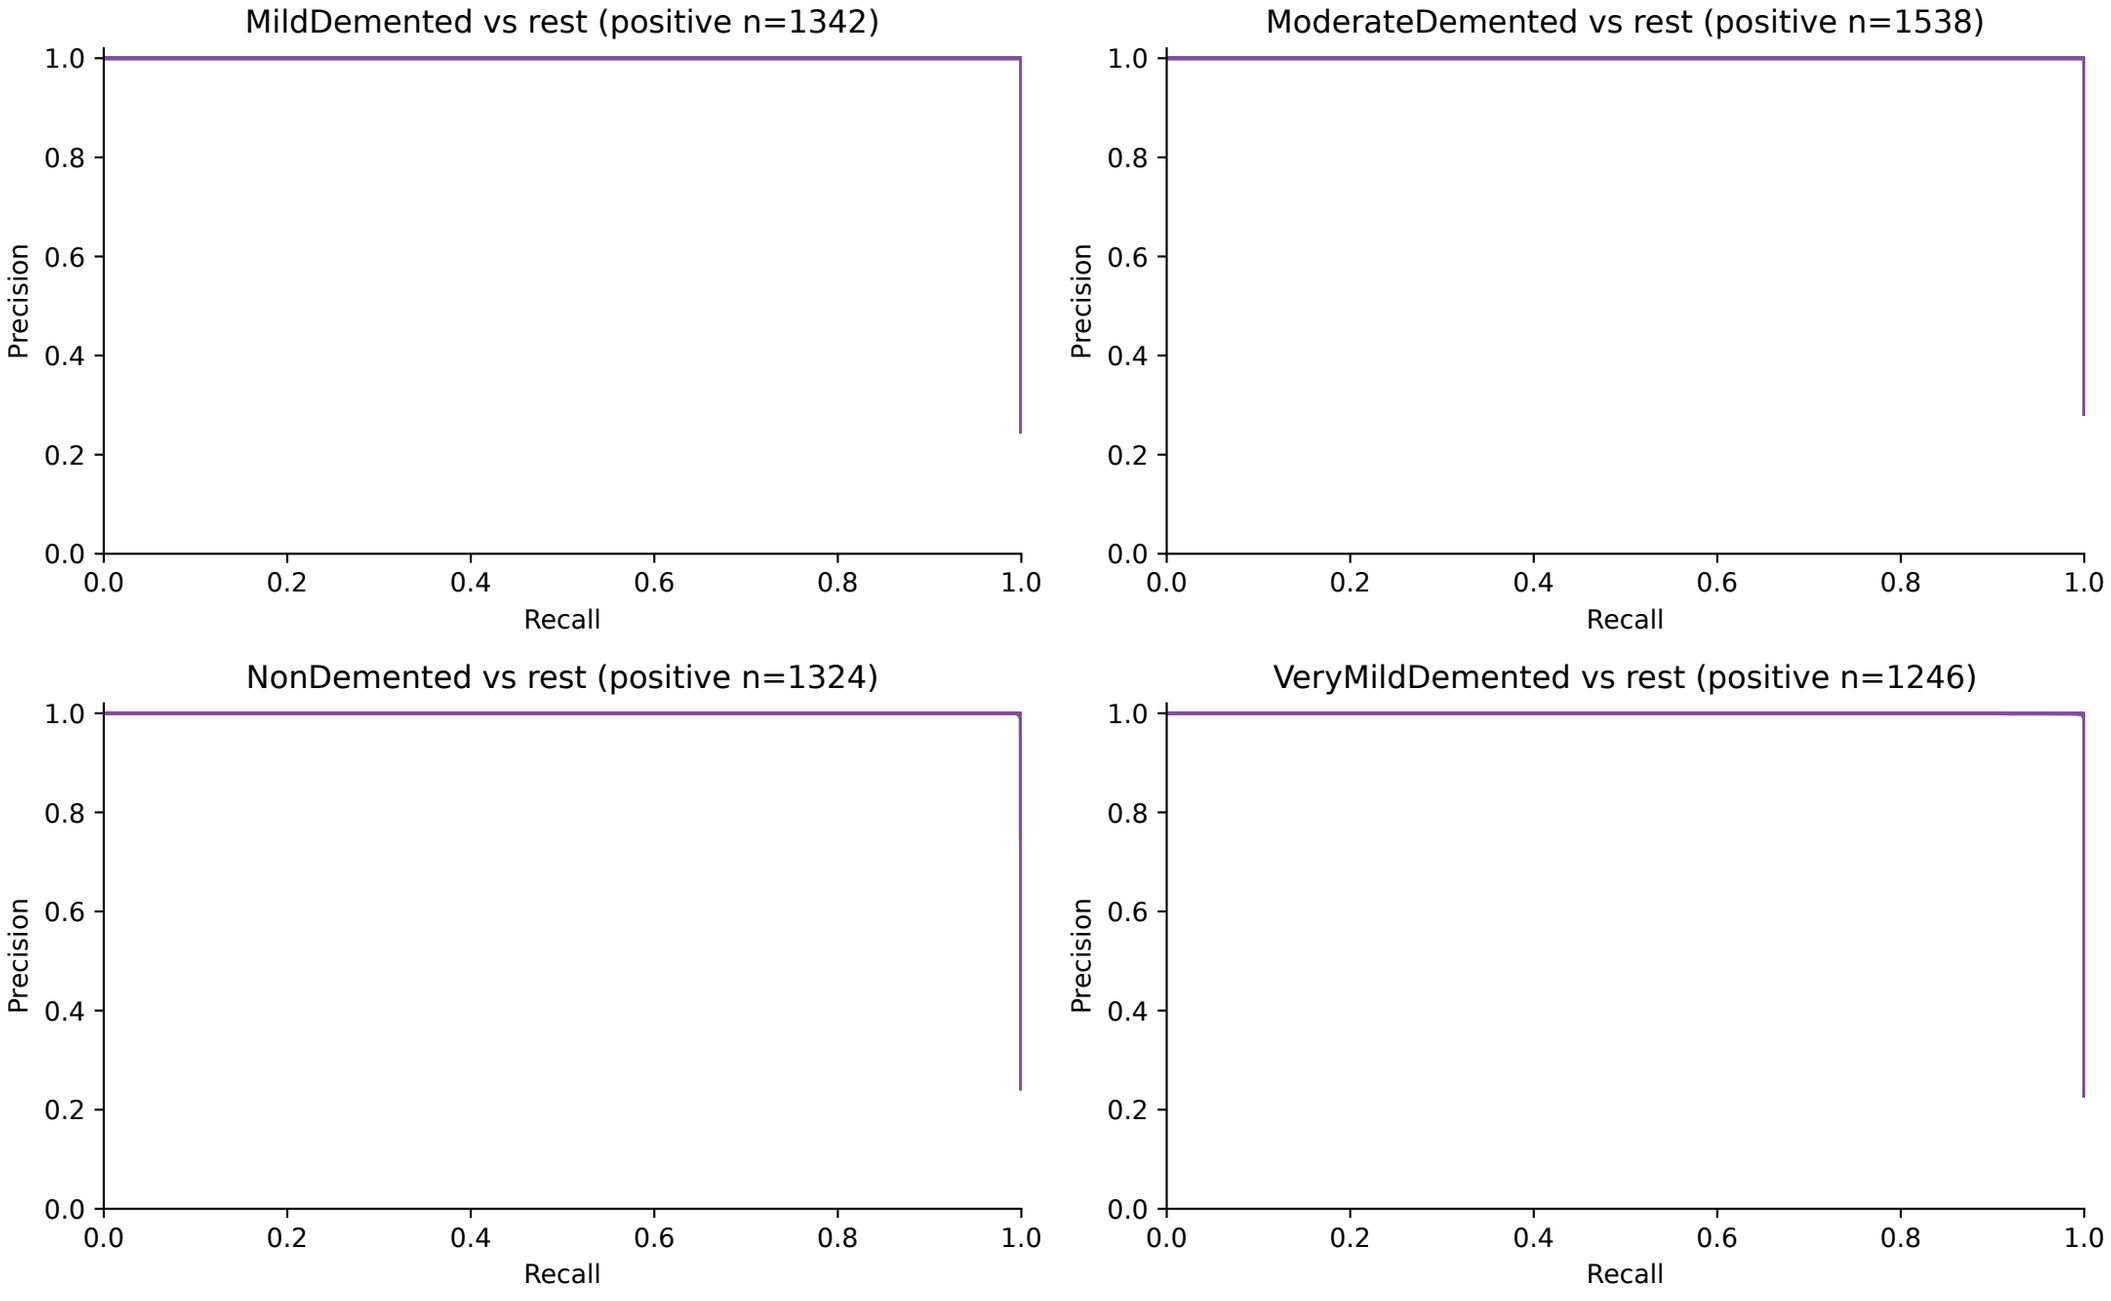

Post-hoc repeated image benchmarks; hash groups are not patients. No clinical or independent-test claim.