Formal selection policy

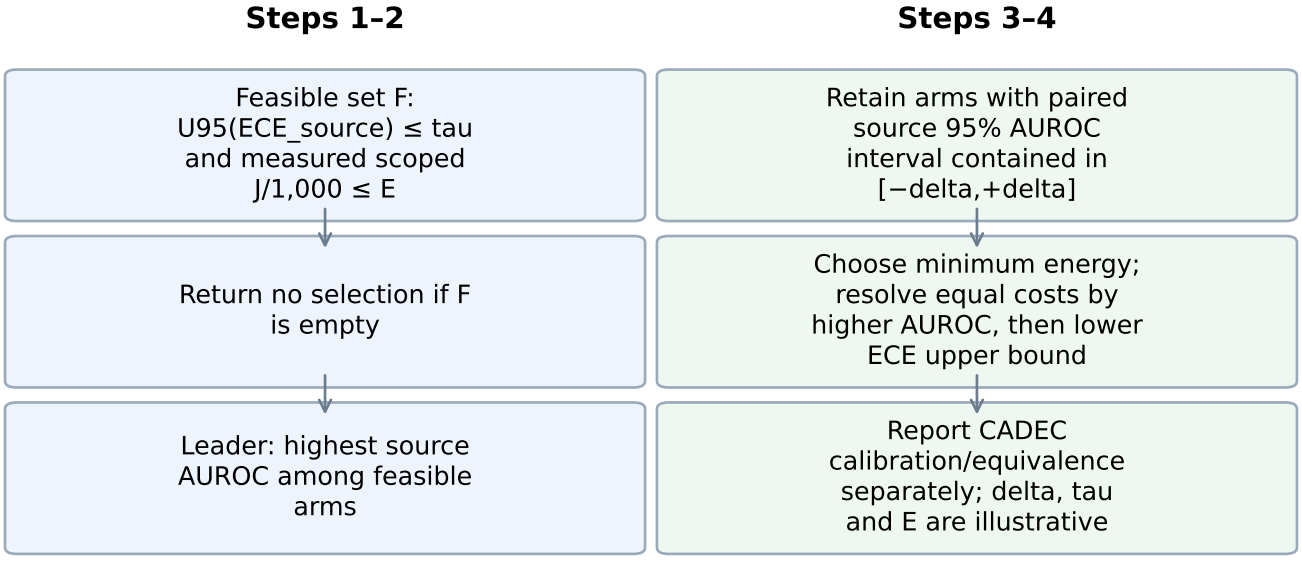

All recalibration variants are tested as distinct arms. Interval inclusion is conservative relative to conventional 90% CI TOST at alpha=0.05.