
Answers cover about 177 GW. Cooling, often undecided.

ERCOT sent its data center impact questions to 465 loads. In a preliminary summary to the utility commission on November 5th, cooling questions drew N/A answers at the highest rate.



All 245 Large Loads answered

Large Loads are 75 MW or greater and hold about 94% of the capacity requested. Among them, 33 projects ask for more than 1 GW each and represent 36% of capacity. One reel stands for one load, drawn to illustrate.

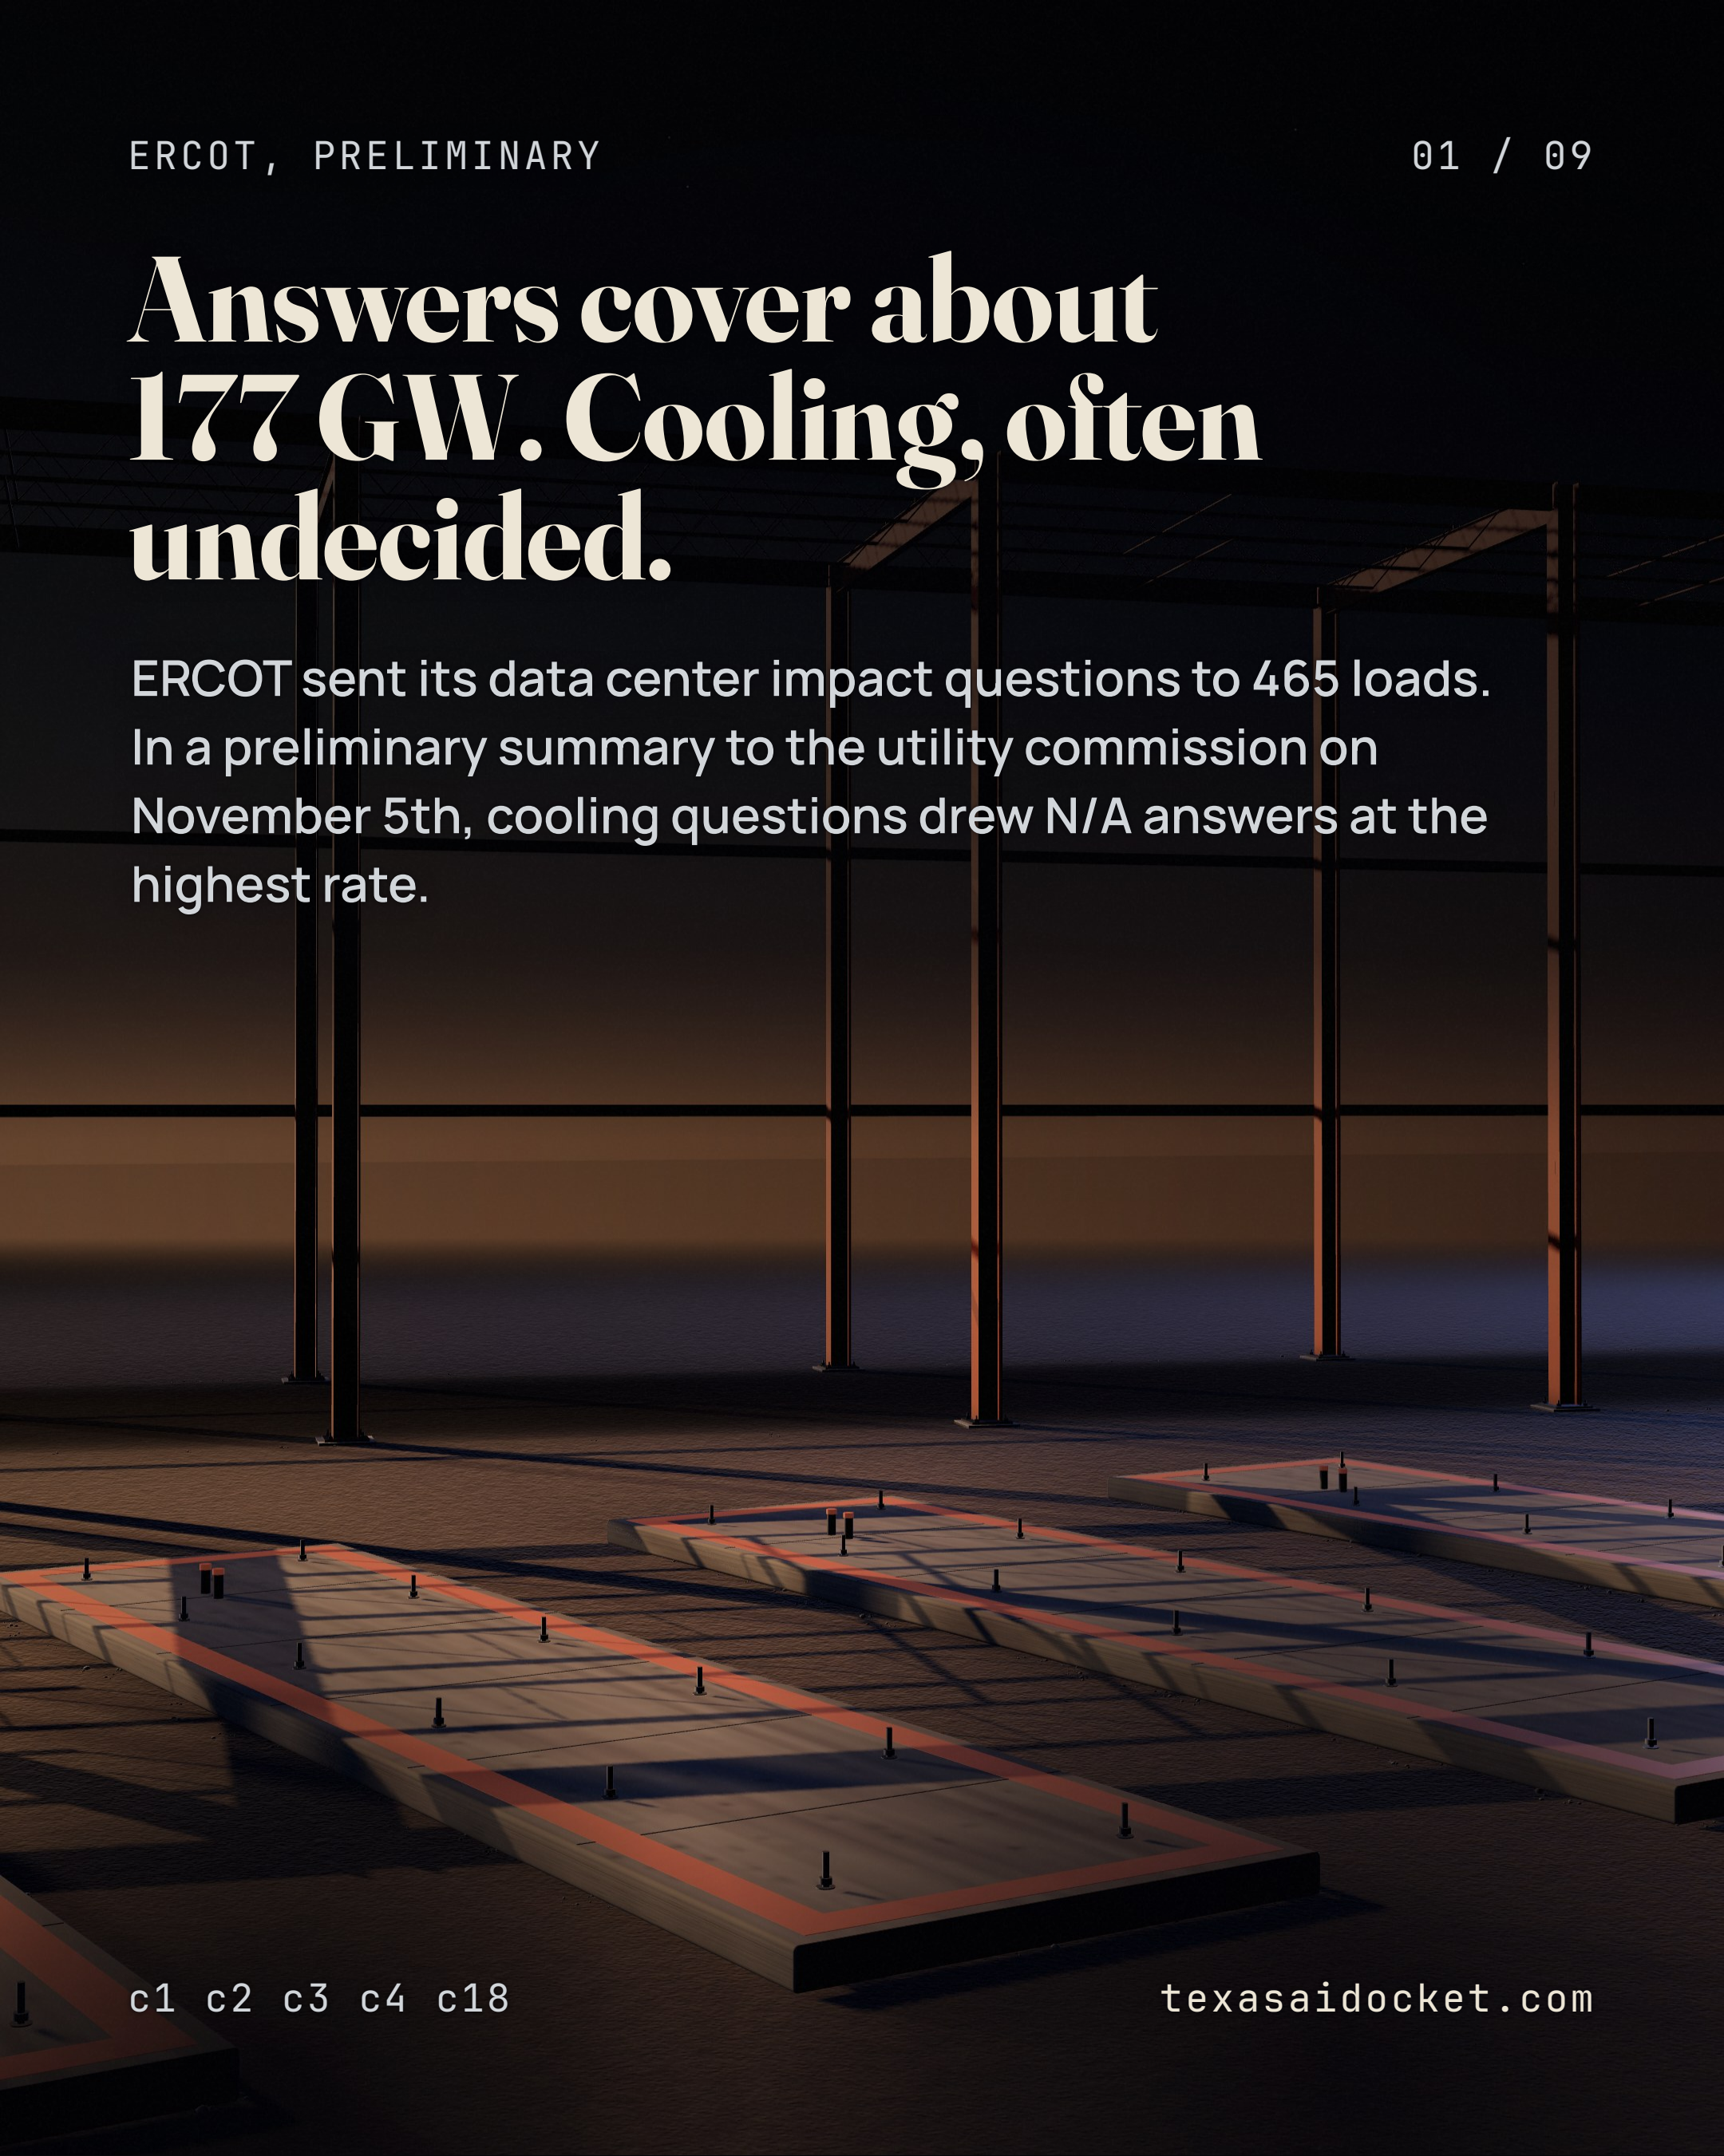


433 of 465 answered

The 433 that answered cover about 177 GW, about 97% of the capacity requested. 417 came in on time and 16 late, and 32 Medium Load responses had not arrived. One copper bar stands for one gigawatt, drawn to illustrate.




West Texas asked for 73 GW

Every ERCOT load zone has requests, and West Texas holds 41% of the capacity. Zone figures cover 429 loads and leave out NOIE zones. A load's actual zone is set at interconnection and may differ.

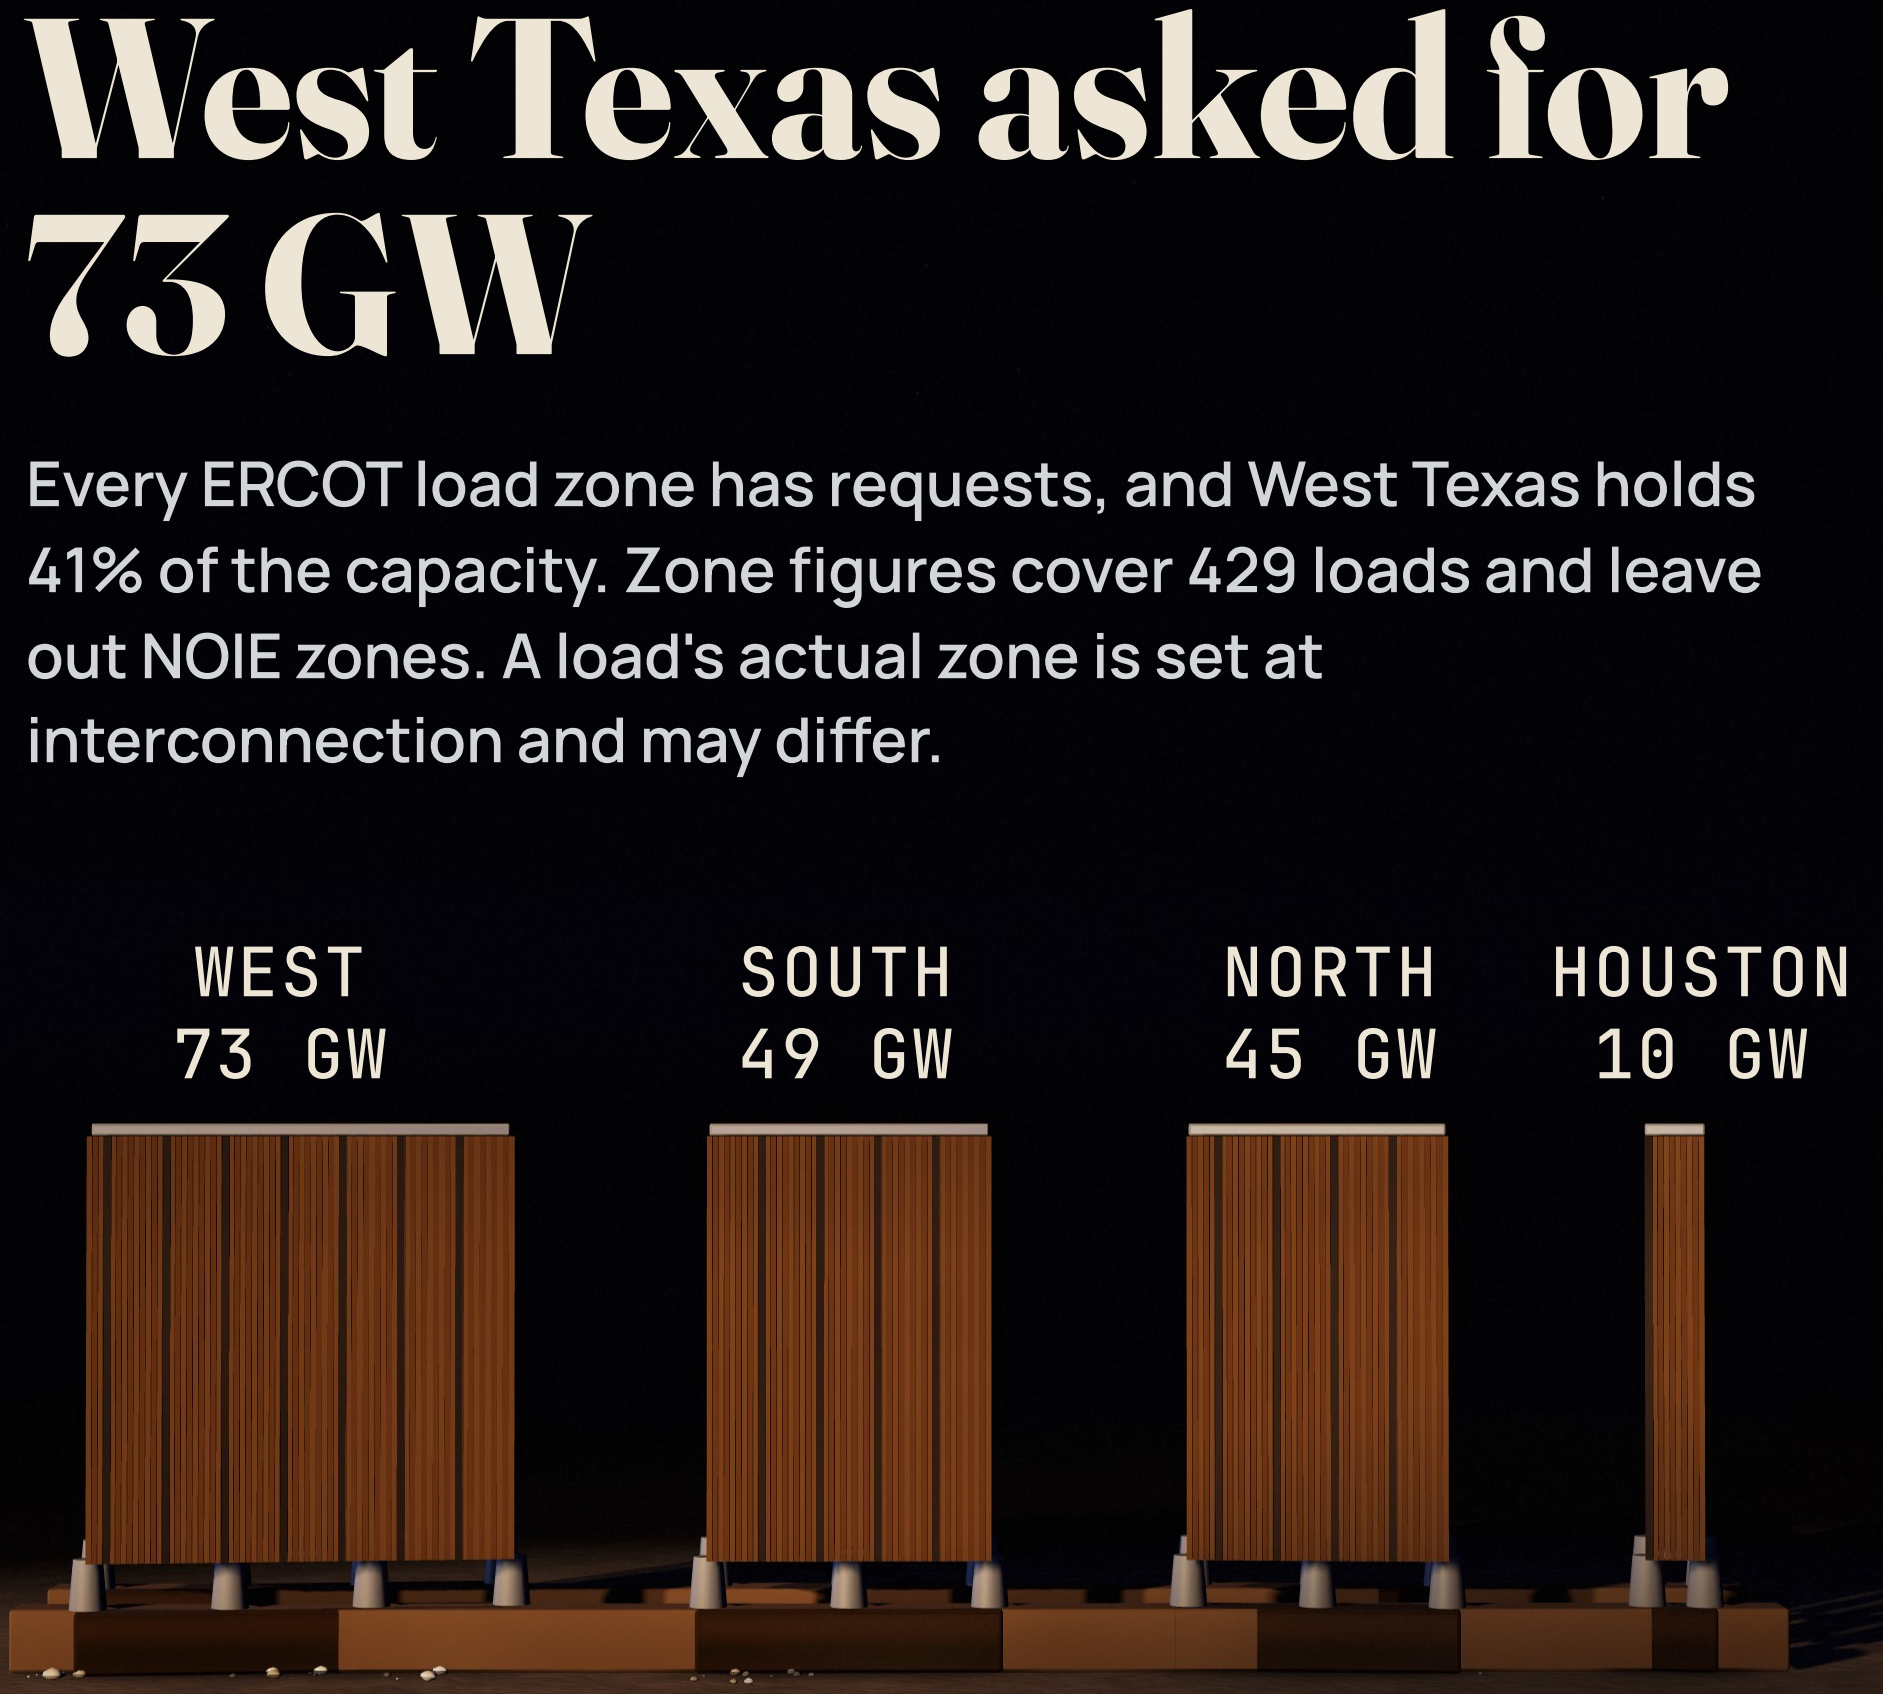


83% of the questions answered

Respondents answered 83% of nearly 67,000 questions. N/A ran about 16% for Large Loads and 19% for Medium Loads. The open stretch is the share left unanswered, drawn to illustrate.

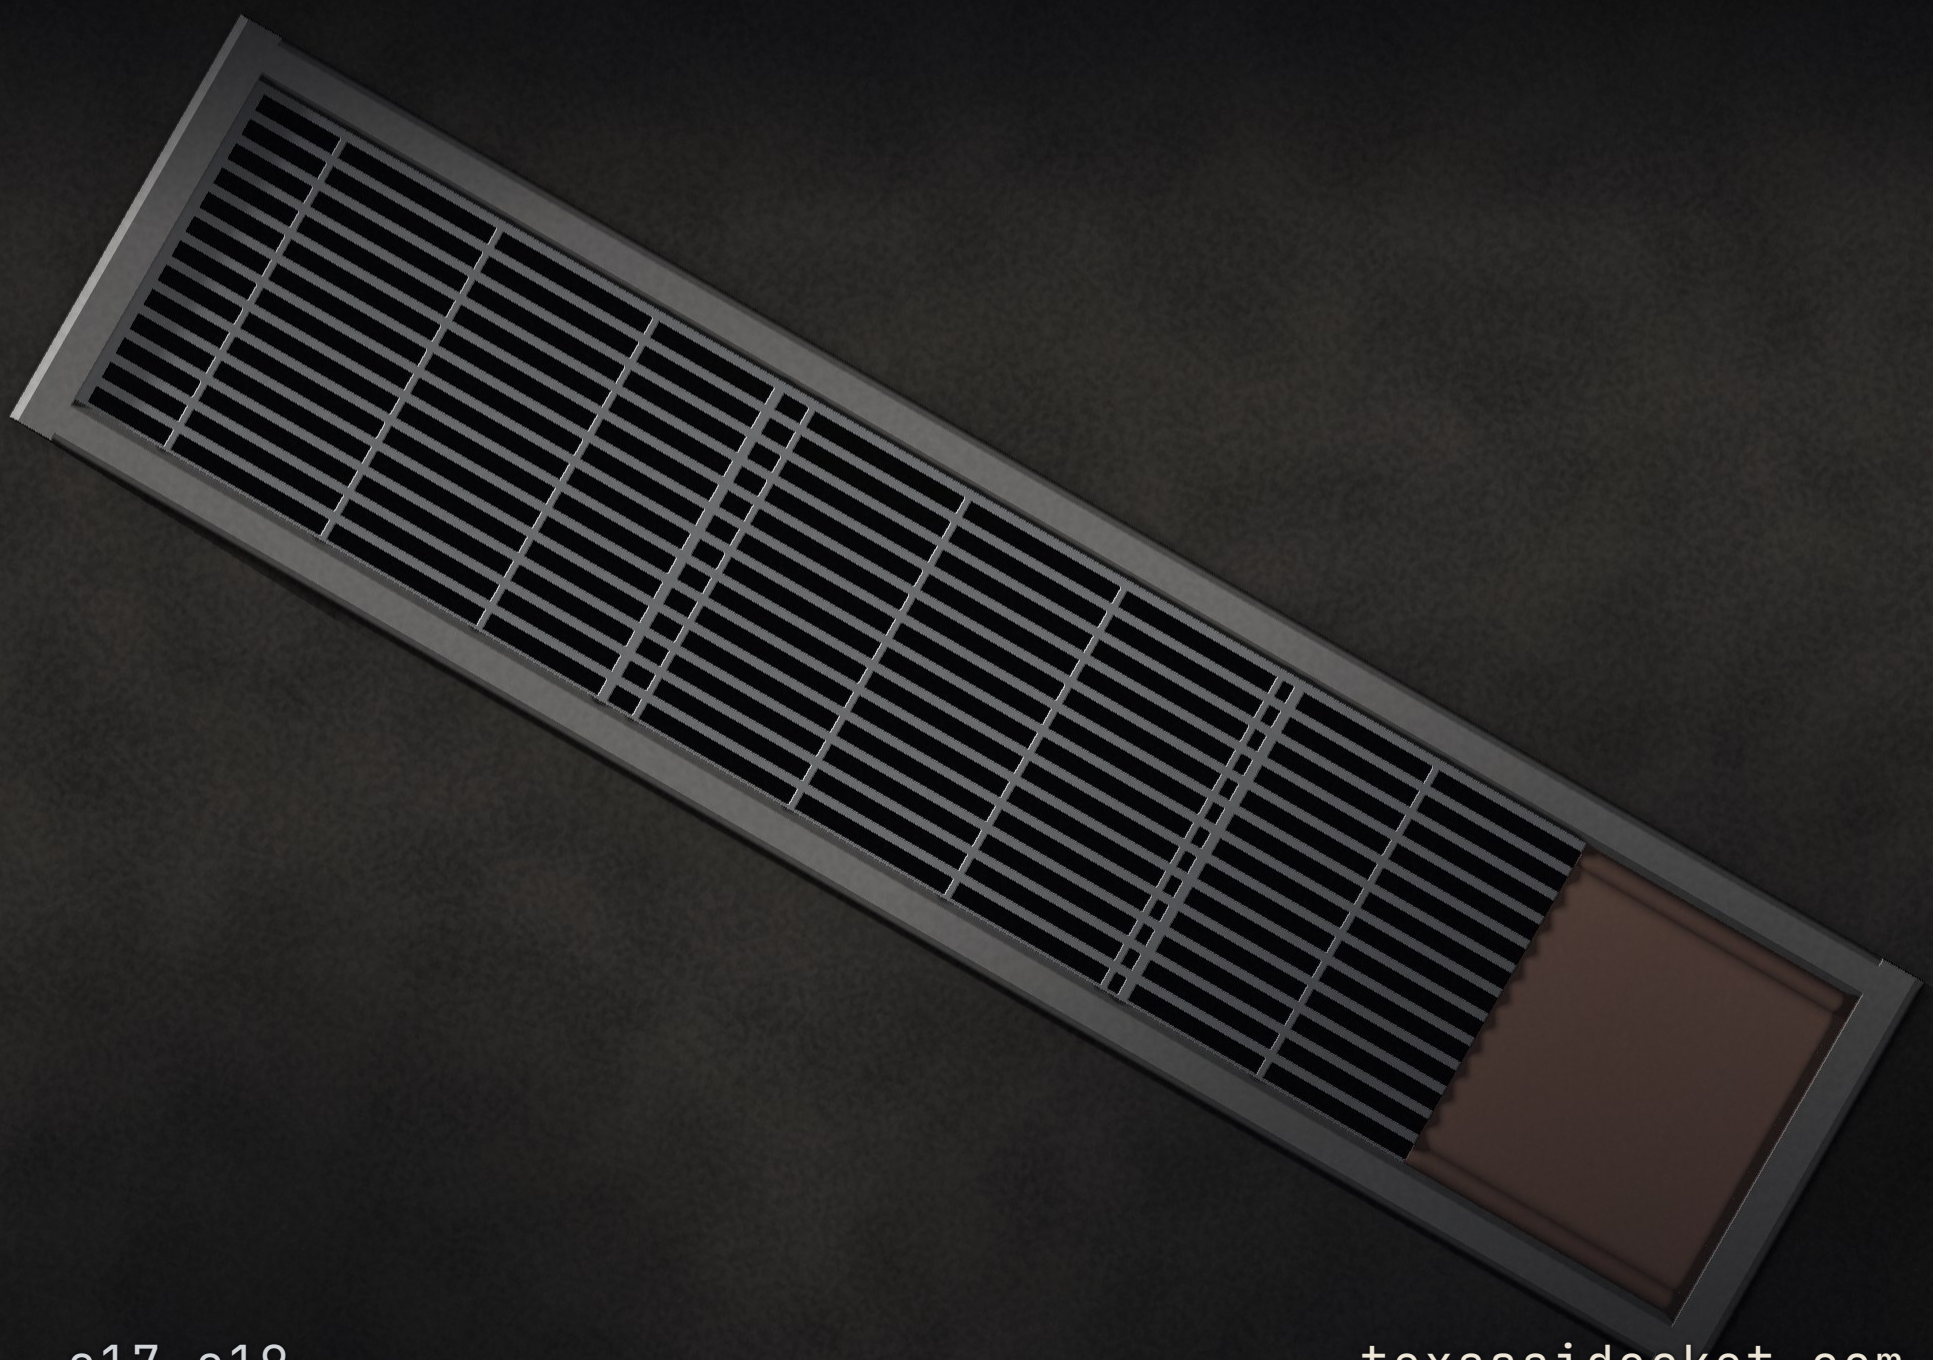


Cooling had the highest N/A rate

No category of questions drew N/A answers at a higher rate than cooling. Respondents indicated many projects had not determined their final cooling configuration.

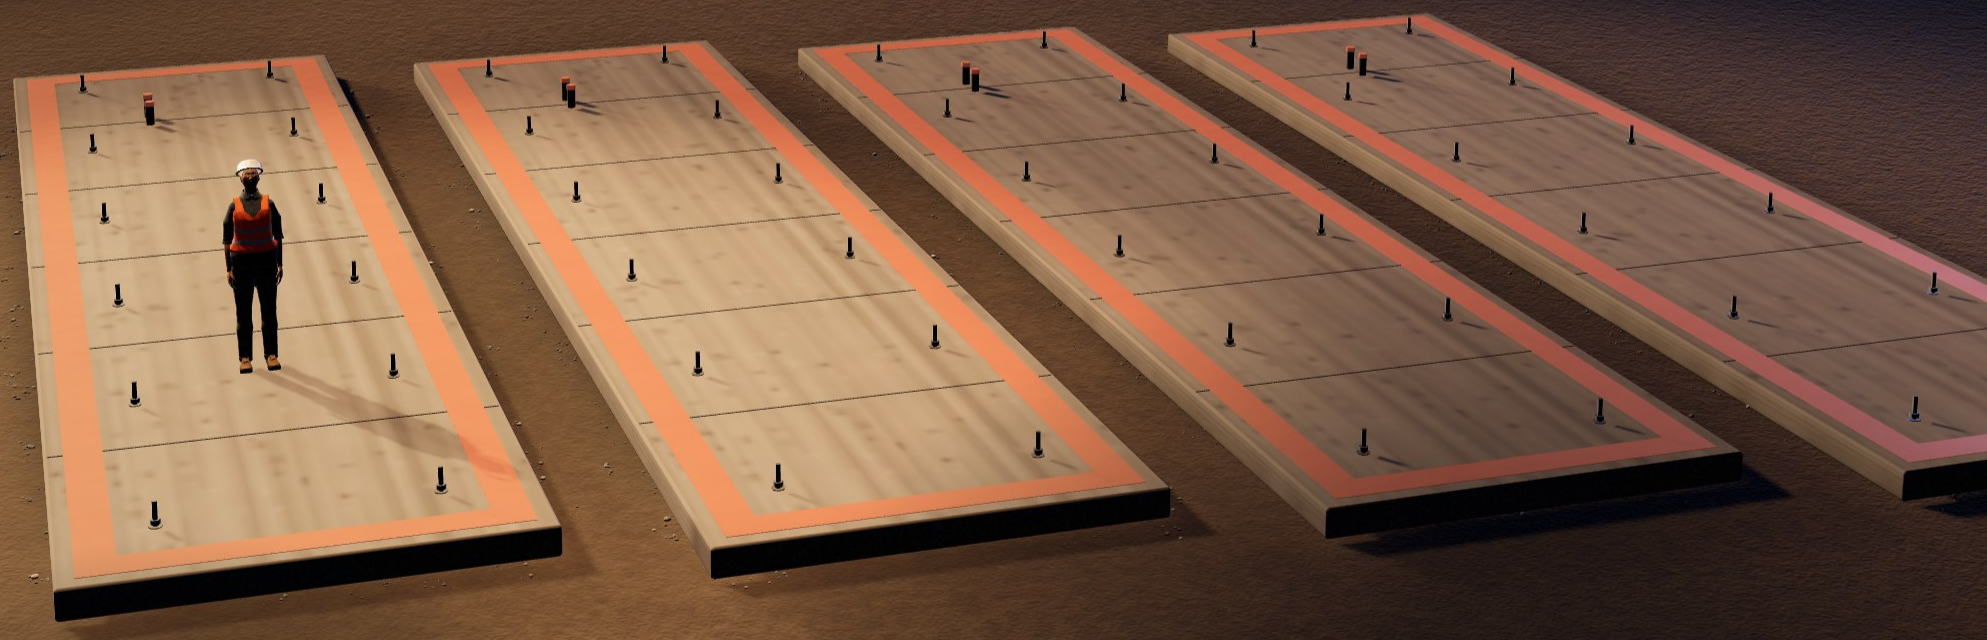

Later projects said N/A more often

Projects asking to energize in 2028 or later answered N/A 30% more often than those due sooner. The longer row of capped stubs stands for them, drawn to illustrate.

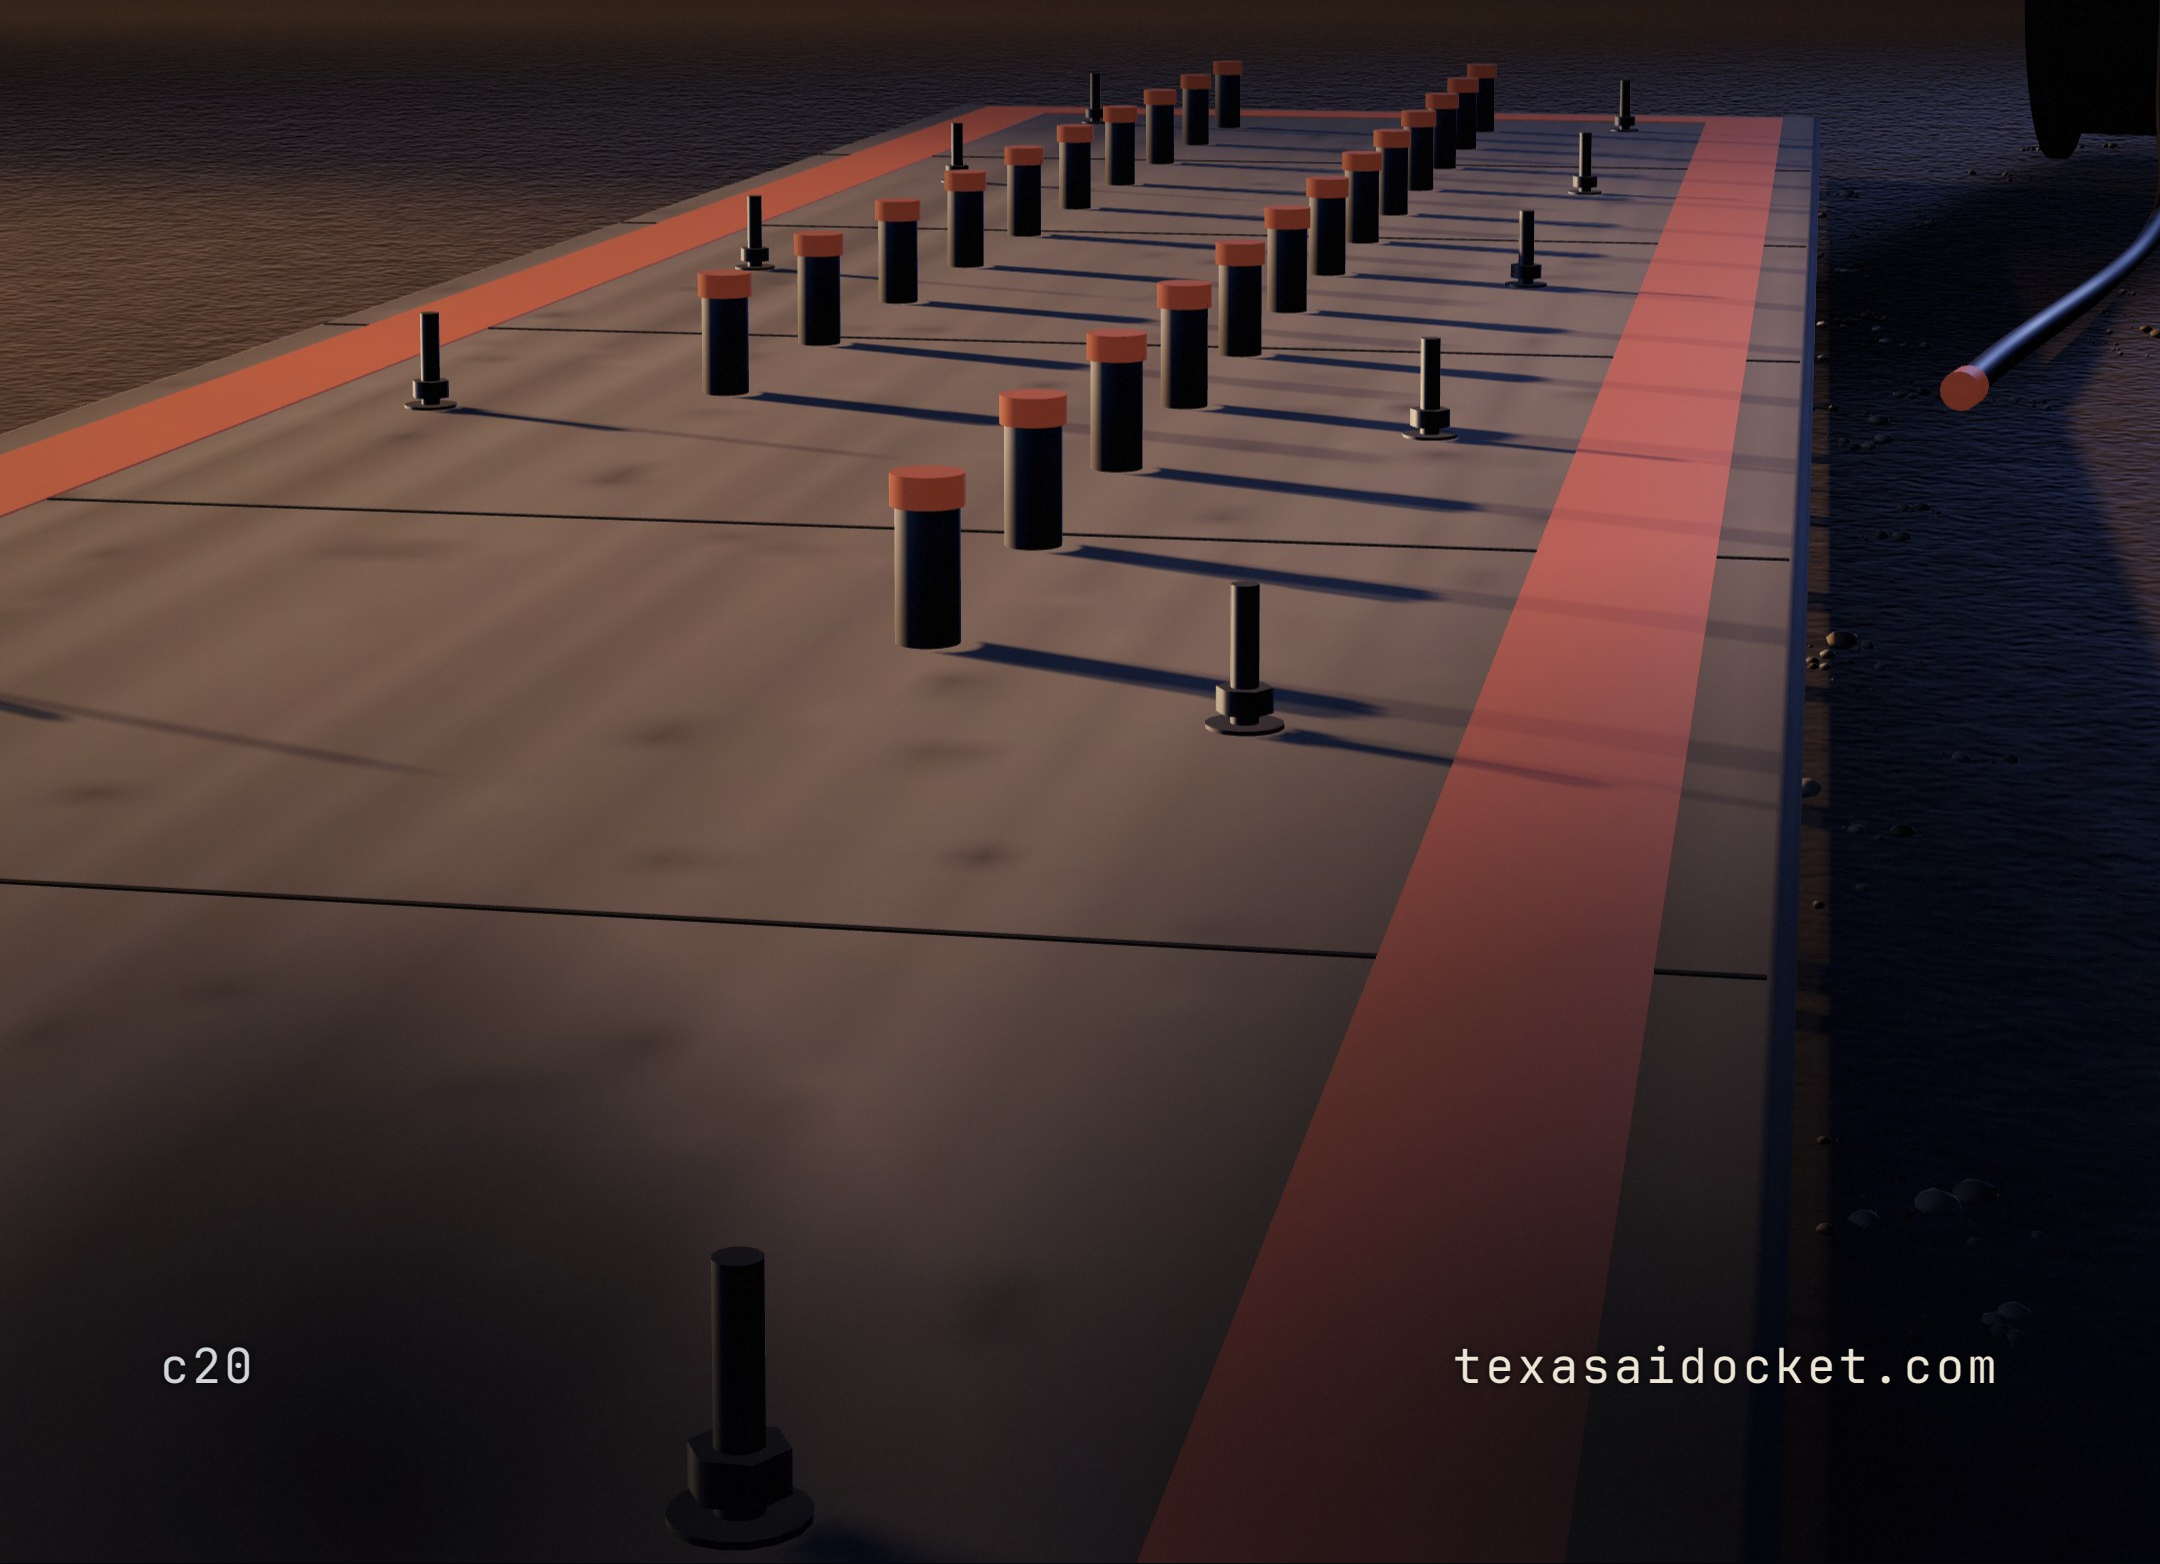

ERCOT expects to go back to 80% of developers

In a separate check of Batch Zero eligibility, ERCOT reviewed responses from 257 developers and expects to send 80% of them a second round, with a 5 business day deadline. Common issues so far include proving site control and confirming financial security posted.



Final report targeted for December 10th

ERCOT says detailed analysis is under way and targets a published final report on December 10th. The RFI figures are marked preliminary and subject to change.

