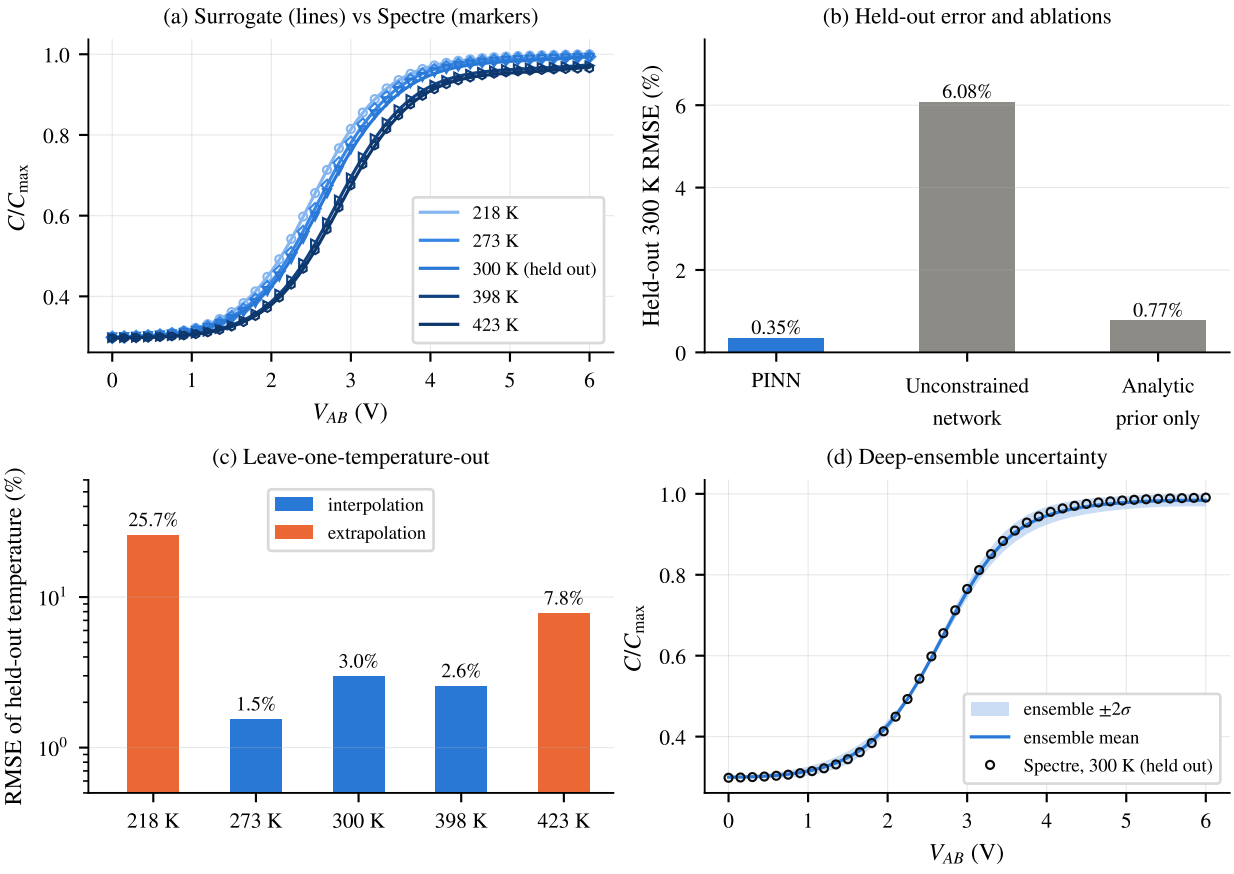
(a) Surrogate (lines) vs Spectre (markers)
C/C_{max}
V_{AB} (V)
218 K
273 K
300 K (held out)
398 K
423 K
(b) Held-out error and ablations
Held-out 300 K RMSE (%)
6.08%
0.35%
0.77%
PINN
Unconstrained network
Analytic prior only
(c) Leave-one-temperature-out
RMSE of held-out temperature (%)
interpolation
extrapolation
25.7%
1.5%
3.0%
2.6%
7.8%
218 K
273 K
300 K
398 K
423 K
(d) Deep-ensemble uncertainty
C/C_{max}
V_{AB} (V)
ensemble ±2σ
ensemble mean
Spectre, 300 K (held out)