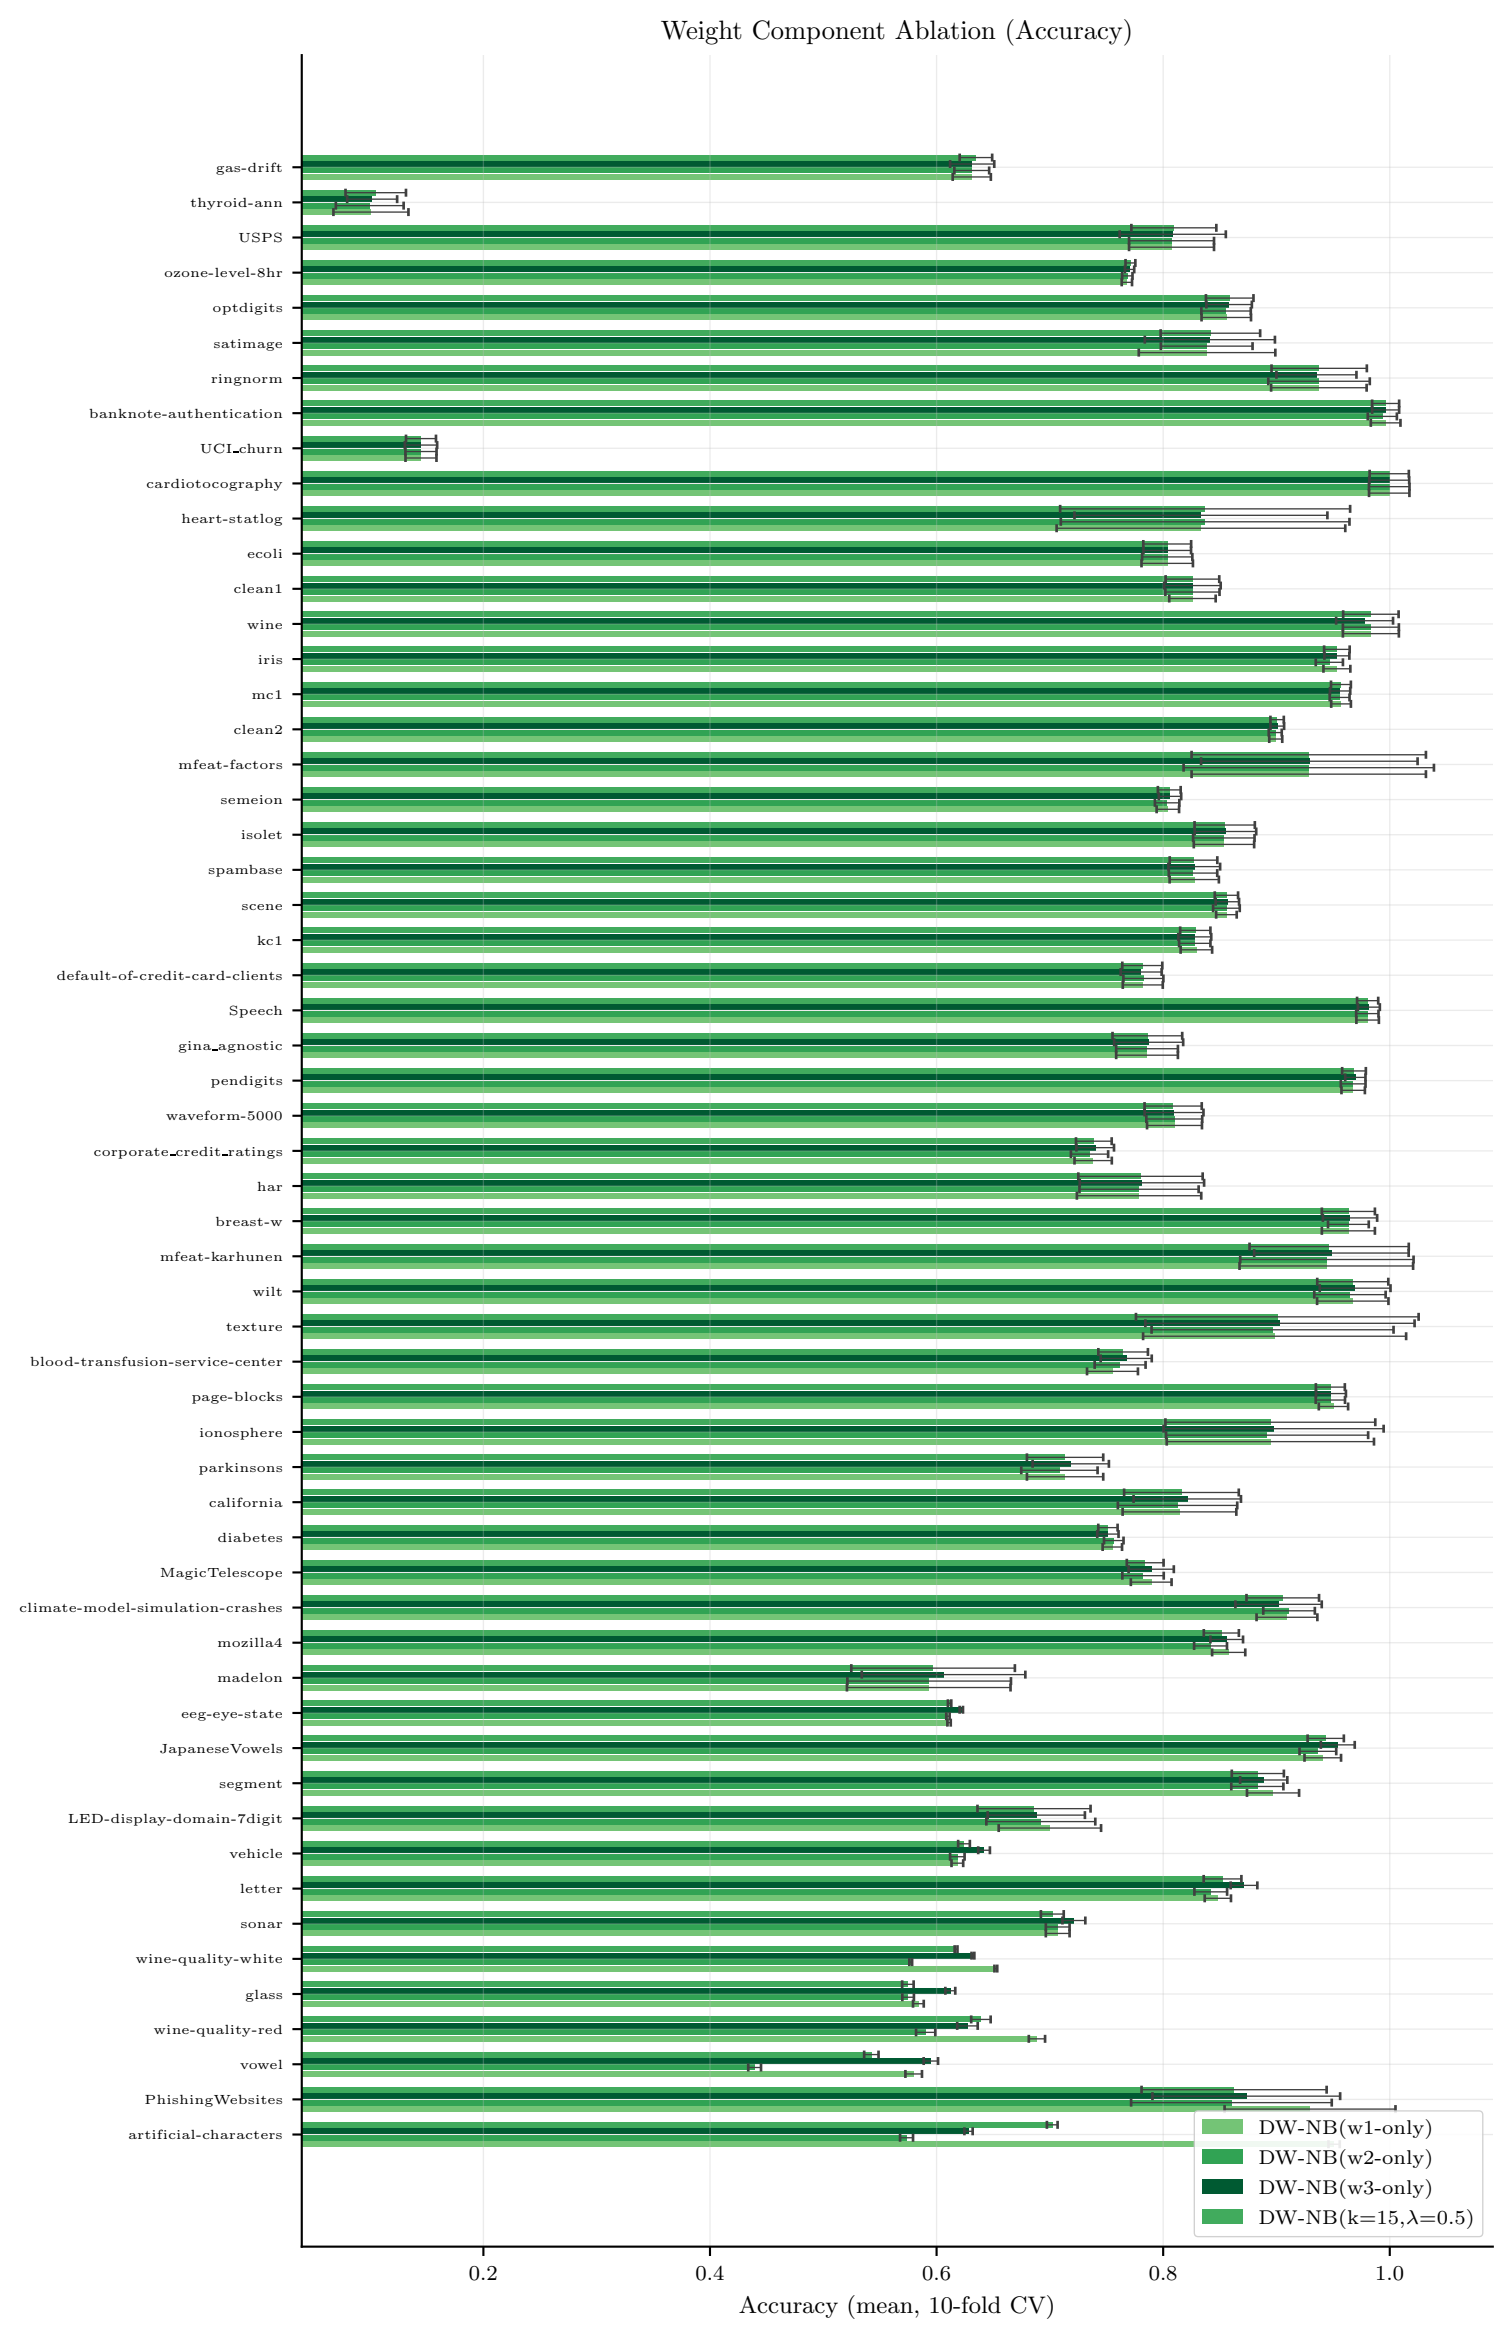
Weight Component Ablation (Accuracy)
gas-drift
thyroid-ann
USPS
ozone-level-8hr
optdigits
satimage
ringnorm
banknote-authentication
UCI_churn
cardiotocography
heart-statlog
ecoli
clean1
wine
iris
mc1
clean2
mfeat-factors
semeion
isolet
spambase
scene
kc1
default-of-credit-card-clients
Speech
gina_agnostic
pendigits
waveform-5000
corporate_credit_ratings
har
breast-w
mfeat-karhunen
wilt
texture
blood-transfusion-service-center
page-blocks
ionosphere
parkinsons
california
diabetes
MagicTelescope
climate-model-simulation-crashes
mozilla4
madelon
eeg-eye-state
JapaneseVowels
segment
LED-display-domain-7digit
vehicle
letter
sonar
wine-quality-white
glass
wine-quality-red
vowel
PhishingWebsites
artificial-characters
DW-NB(w1-only)
DW-NB(w2-only)
DW-NB(w3-only)
DW-NB(k=15,λ=0.5)
0.2
0.4
0.6
0.8
1.0
Accuracy (mean, 10-fold CV)