SYSTEM PARAMETERS		
SERVICE	SLOP	SEA WATER
DESIGN PRESSURE(Barg)	15.5	14
OPERATING PRESSURE(Barg)	11-14	12
DESIGN TEMPERATURE(℃)	60	50
OPERATING TEMPERATURE,(℃)	35	26

R03

44PE7003 INTERFACES			
TP	DESCRIPTION	CONNECTION TYPE / SIZE	MATERIAL
TP01	SUCTION	3" ANSI B16.5 150# RF	CS GALV.
TP02	DISCHARGE	3" ANSI B16.5 150# RF	CS GALV.
TP03	MOTIVE	2" ANSI B16.5 150# RF	CS GALV.


44PN7011A/B INTERFACES			
TP	DESCRIPTION	CONNECTION TYPE / SIZE	MATERIAL
TP01	DISCHARGE	4" 300# RF	AISI 316L
TP02	STRIPPING	1"	AISI 316L

EQUIP. TAG	44PN7011A/B
EQUIP. NAME	SLOP PUMP FOR DIRTY SLOP (P)
CAPACITY	40 m3/h
CONFIGURATION	2 x 100% R03
WORKING/DESIGN PRESSURE	11-14 / 14 BARG
WORKING/DESIGN TEMP.	30-40 / 60 ℃
DUTY POWER	38.2 kW

R03

EQUIP. TAG	44PE7003
EQUIP. NAME	SLOP STRIPPING EDUCTOR
CONFIGURATION	1 x 100%
SUCTION CAPACITY	12 m3/h @ 0.12 BARG
DISCHARGE CAPACITY	78 m3/h @ 5 BARG
MOTIVE WATER CAPACITY	66 m3/h @ 10 BARG

R03

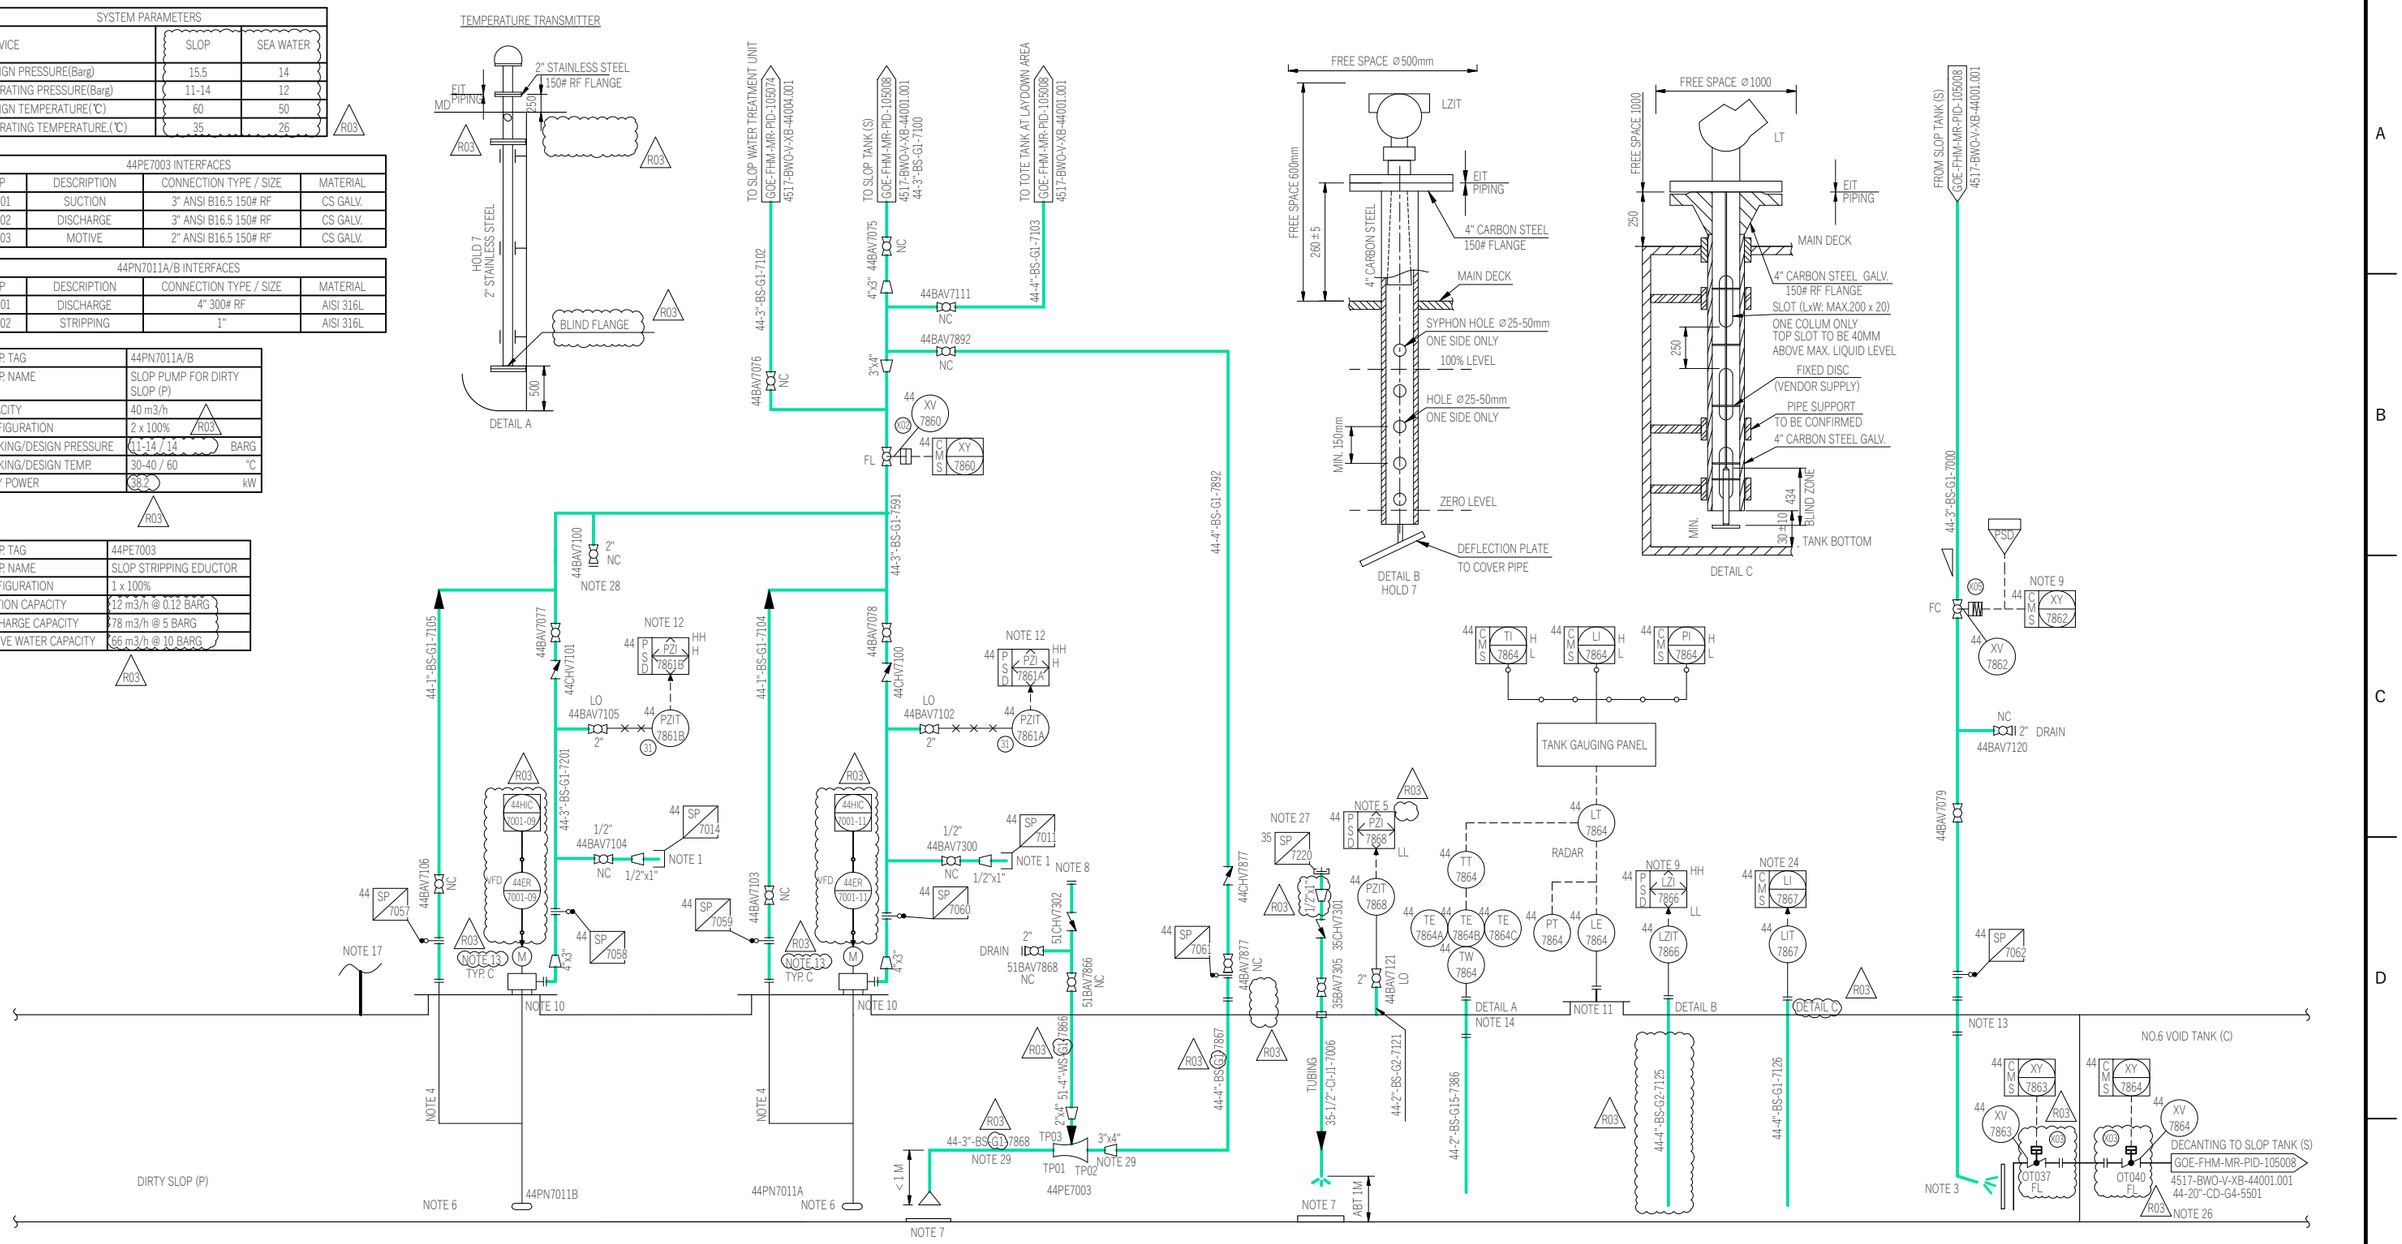

GENERAL NOTES:

1. FOR P&ID LEGEND SHEET SEE DRAWING: SC26-2A-GOE-FHM-MR-PID-105133 TO 105139 R03
2. FOR MARINE PIPING AND VALVE MATERIAL SPECIFICATION, SEE DOCUMENT: SC26-2A-GOE-FHM-EP-SPC-105001 (4517-BWO-L-SA-00002).
3. FOR CHANGES IN REV.03, PLEASE REFER TO ECN-00296. FOR CHANGES IN REV.02, PLEASE REFER TO ECN-00266. R03

NOTES:

1. NITROGEN INLET CONNECTION FOR STRIPPING OPERATION.
2. HV WILL BE CLOSED WHEN SLOP PUMP IS STOPPED.
3. THE PIPE END TO BE LOCATED 2M ABOVE TANK BOTTOM.
4. STRIPPING LINE SHALL BE USED AT THE END OF THE DISCHARGE PROCESS FOR REMOVAL OF THE REMAINING OIL IN THE VERTICAL STACK. THE PUMP SHALL BE OPERATED AT REDUCED HYDRAULIC OIL FLOW RATE, IF NECESSARY, THE PUMP DISCHARGE VALVE SHALL BE THROTTLED TO OPTIMIZE STRIPPING PROCESS.
5. TANK PRESSURE LL TO STOP THE PUMP IN-TANK.
6. PUMP SUCTION ELEVATION DEPENDS ON THE PUMP LOCATION.
7. DOUBLER PLATE.
8. CONNECTION FOR GENERAL SEA WATER SERVICE.
9. LALL TO SHUT PUMP 44PN7011A/B. LAHH TO CLOSE 44XV7862 AND PROVIDE ALARM.
10. MANUFACTURE'S DECK TRUNK.
11. GAUGE SOCKET. UTILISING EXISTING LT TRUNK
12. PSHH TO TRIP THE CORRESPONDING PUMP.
13. TANK INLET PIPE (BENEATH DECK PENETRATION) SHALL BE PROVIDED WITH VENT HOLES (25mm X 4EA) TO PREVENT SYPHON EFFECT. FOR SMALL BORE PIPE (4" AND BELOW) CAN HAVE TWO HOLES.
14. TEMPERATURE TO BE MONITORED AT THREE DIFFERENT ELEVATIONS.
15. DELETED.
16. DELETED.
17. FOR N2 SUPPLY & VENT, PVV BREATHING AND AERATION ARRANGEMENT, REFER TO P&ID SC26-2A-GOE-FHM-MR-PID-105061 (384-91-P-DWG-100_002), SC26-2A-GOE-FHM-MR-PID-105062 (384-91-P-DWG-100_003).
18. DELETED.
19. DELETED.
20. DELETED.
21. DELETED.
22. DELETED.
23. DELETED.
24. OIL-IN-WATER INTERFACE LEVEL TRANSMITTER.
25. OIL STRIPPING FROM BOTTOM OF SLOP TANK TO BE TRANSFERED TO TOTE TANK, WHICH WILL BE LOCATED AT LAYDOWN AREA NEAR AFT-STBD CRANE. FLEXIBLE HOSE TO BE CONNECTED BETWEEN THE PIPE AND TOTE TANK.
26. TO REUSE EXISTING PIPE AND VALVE ON SLOP DECANTING LINE. FOR PIPING LAYOUT, REFER TO 0384-KEP-L-XE-00018.001.
27. BIOCIDE INJECTION VIA ST.TODO COUPLING. R03
28. FLEXIBLE HOSE TO BE CONNECTED TO PUMP DRAIN HEADER FOR EMPTYING THE TANK.
29. 3 X DIA. OF STRAIGHT PIPE BEFORE BEND AT DISCHARGE SIDE AND 4 X DIA. OF STRAIGHT PIPE BEFORE BEND AT SUCTION SIDE.
30. TO BE MOUNTED AS CLOSE TO TANK AS POSSIBLE.
31. EXISTING ITEM ASSIGNED WITH NEW TAG.
32. PUMP HAS VFD BUT NO PROCESS CONTROLLER. THIS WILL REQUIRE A SOFTWARE HIC (HAND INDICATING CONTROLLER) IN THE CCR (CENTRAL CONTROL ROOM) TO ALLOW THE OPERATOR TO REGULATE THE PUMP SPEED. R03

HOLDS:

1. DELETED.
2. DELETED. R03
3. DELETED.
4. DELETED
5. DELETED.
6. DELETED.
7. INSTALLATION DETAIL TO BE CONFIRMED BY GOE AND VENDOR.

LEGENDS:

EXISTING PIPE

NEW PIPE

REV.	OTC REV.	REASON FOR USE	DATE	DRAWN	ISSUED	CHECKED	APPROVED
H	R03	APPROVED FOR CONSTRUCTION	08/04/26	ZYL	DWJ	DC	SJL
G	R02	APPROVED FOR CONSTRUCTION	17/09/25	ZYL	DWJ	DC	SJL
F	R01	APPROVED FOR CONSTRUCTION	29/04/25	ZYL	DWJ	DC	SJL
E	R00	APPROVED FOR CONSTRUCTION (1ST GOE ISSUE)	12/12/24	ZYL	DWJ	DC	SJL
D	R02	ISSUED FOR DESIGN / ISSUED FOR APPROVAL	09/04/24	LCE	CHS1	YOLE	HJM
C	R01	ISSUED FOR DESIGN / ISSUED FOR CONSTRUCTION	10/10/23	MEVA	OLLI	RAMA	HJM
B	R00	ISSUED FOR REVIEW	27/06/23	MEVA	OLLI	RAMA	HJM
A	-	INTER DISCIPLINE CHECK	08/06/23	SRNA	OLLI	RAMA	OLLI

DISCIPLINE:	SYSTEM NO:	AREA / MODULE:	IMO NO:	PROJECT NO:	SCALE:	SIZE:
MR	44	FHM	8706014	SC26-2A	N.T.S.	A3

SUPPLIER: OceanSTAR Elite — GOE GLOBAL OFFSHORE ENGINEERING

CLIENT: OTC OFFSHORE TECHNOLOGY CENTER

PROJECT: Sakarya Gas Field Dev't Phase-2a

TITLE: MARINE SYSTEM 44 - P&ID SLOP TANK (P) (SHEET 1)

OTC DOC. NO:	SC26-2A-GOE-FHM-MR-PID-105009	GOE REV. H	SHEET 1 of 2
LEG DOC. NO:	SC26-2A-BWO-FHM-MR-PID-105009	OTC REV. R03	
REF. DOC. NO:	4517-BWO-V-XB-44002.001		

This drawing contains proprietary information and may not be transferred, reproduced or used to construct any project other than it was issued for without the written consent of GOE or their Client.