


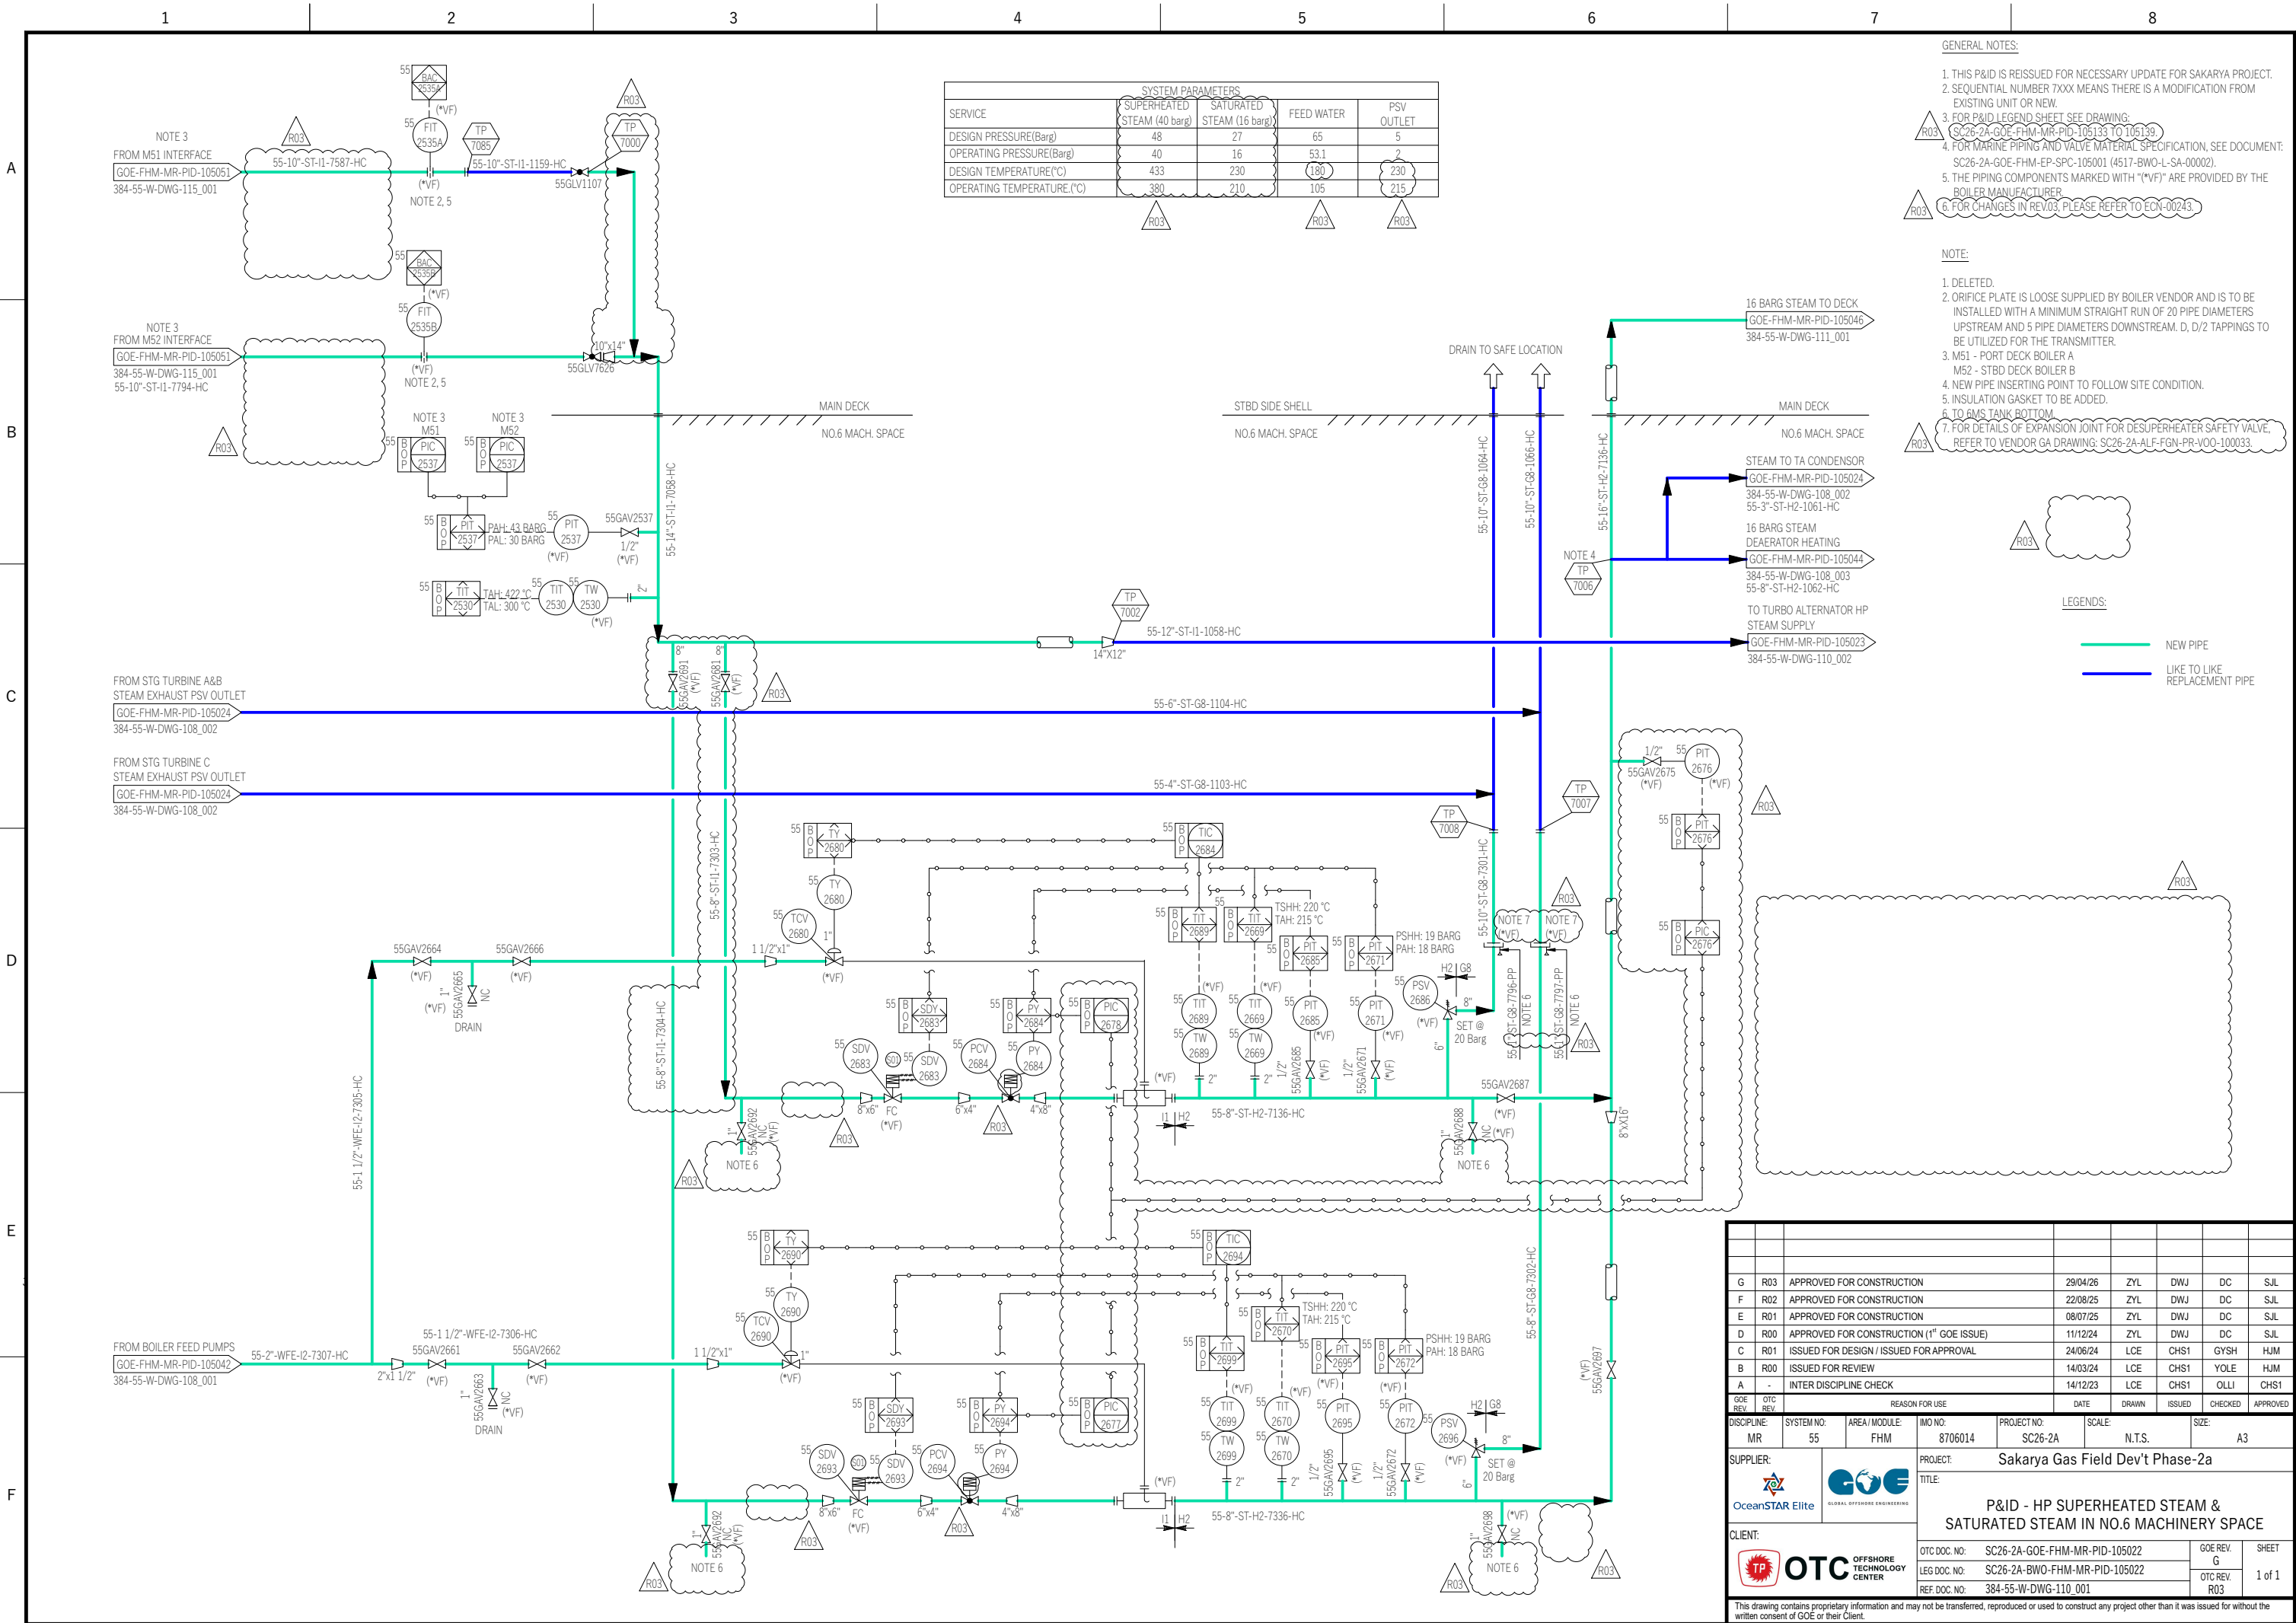

SYSTEM PARAMETERS				
SERVICE	SUPERHEATED STEAM (40 barg)	SATURATED STEAM (16 barg)	FEED WATER	PSV OUTLET
DESIGN PRESSURE(Barg)	48	27	65	5
OPERATING PRESSURE(Barg)	40	16	53.1	2
DESIGN TEMPERATURE(°C)	433	230	180	230
OPERATING TEMPERATURE(°C)	380	210	105	215

GENERAL NOTES:

- THIS P&ID IS REISSUED FOR NECESSARY UPDATE FOR SAKARYA PROJECT.
- SEQUENTIAL NUMBER 7XXX MEANS THERE IS A MODIFICATION FROM EXISTING UNIT OR NEW.
- FOR P&ID LEGEND SHEET SEE DRAWING: SC26-2A-GOE-FHM-MR-PID-105133 TO 105139.
- FOR MARINE PIPING AND VALVE MATERIAL SPECIFICATION, SEE DOCUMENT: SC26-2A-GOE-FHM-EP-SPC-105001 (4517-BWO-L-SA-00002).
- THE PIPING COMPONENTS MARKED WITH "(VF)" ARE PROVIDED BY THE BOILER MANUFACTURER.
- FOR CHANGES IN REV03, PLEASE REFER TO ECR-00243.

NOTE:

- DELETED.
- ORIFICE PLATE IS LOOSE SUPPLIED BY BOILER VENDOR AND IS TO BE INSTALLED WITH A MINIMUM STRAIGHT RUN OF 20 PIPE DIAMETERS UPSTREAM AND 5 PIPE DIAMETERS DOWNSTREAM. D, D/2 TAPPINGS TO BE UTILIZED FOR THE TRANSMITTER.
- M51 - PORT DECK BOILER A
M52 - STBD DECK BOILER B
- NEW PIPE INSERTING POINT TO FOLLOW SITE CONDITION.
- INSULATION GASKET TO BE ADDED.
- TO 6MS TANK BOTTOM.
- FOR DETAILS OF EXPANSION JOINT FOR DESUPERHEATER SAFETY VALVE, REFER TO VENDOR GA DRAWING: SC26-2A-ALF-FGN-PR-VOO-100033.

LEGENDS:

- NEW PIPE
- LIKE TO LIKE REPLACEMENT PIPE

G	R03	APPROVED FOR CONSTRUCTION		29/04/26	ZYL	DWJ	DC		SJL
F	R02	APPROVED FOR CONSTRUCTION		22/08/25	ZYL	DWJ	DC		SJL
E	R01	APPROVED FOR CONSTRUCTION		08/07/25	ZYL	DWJ	DC		SJL
D	R00	APPROVED FOR CONSTRUCTION (1 st GOE ISSUE)		11/12/24	ZYL	DWJ	DC		SJL
C	R01	ISSUED FOR DESIGN / ISSUED FOR APPROVAL		24/06/24	LCE	CHS1	GYSH		HJM
B	R00	ISSUED FOR REVIEW		14/03/24	LCE	CHS1	YOLE		HJM
A	-	INTER DISCIPLINE CHECK		14/12/23	LCE	CHS1	OLLI		CHS1
GOE REV	OTC REV	REASON FOR USE			DATE	DRAWN	ISSUED	CHECKED	APPROVED
DISCIPLINE: MR		SYSTEM NO: 55	AREA / MODULE: FHM	IMO NO: 8706014	PROJECT NO: SC26-2A	SCALE: N.T.S.	SIZE: A3		
SUPPLIER:  OceanSTAR Elite				PROJECT: Sakarya Gas Field Dev't Phase-2a					
				TITLE: P&ID - HP SUPERHEATED STEAM & SATURATED STEAM IN NO.6 MACHINERY SPACE					
CLIENT:  OTC OFFSHORE TECHNOLOGY CENTER				OTC DOC. NO: SC26-2A-GOE-FHM-MR-PID-105022			GOE REV: G		SHEET
				LEG DOC. NO: SC26-2A-BWO-FHM-MR-PID-105022			OTC REV: R03		1 of 1
				REF DOC. NO: 384-55-W-DWG-110_001					
This drawing contains proprietary information and may not be transferred, reproduced or used to construct any project other than it was issued for without the written consent of GOE or their Client.									

This drawing contains proprietary information and may not be transferred, reproduced or used to construct any project other than it was issued for without the written consent of GOE or their Client.