
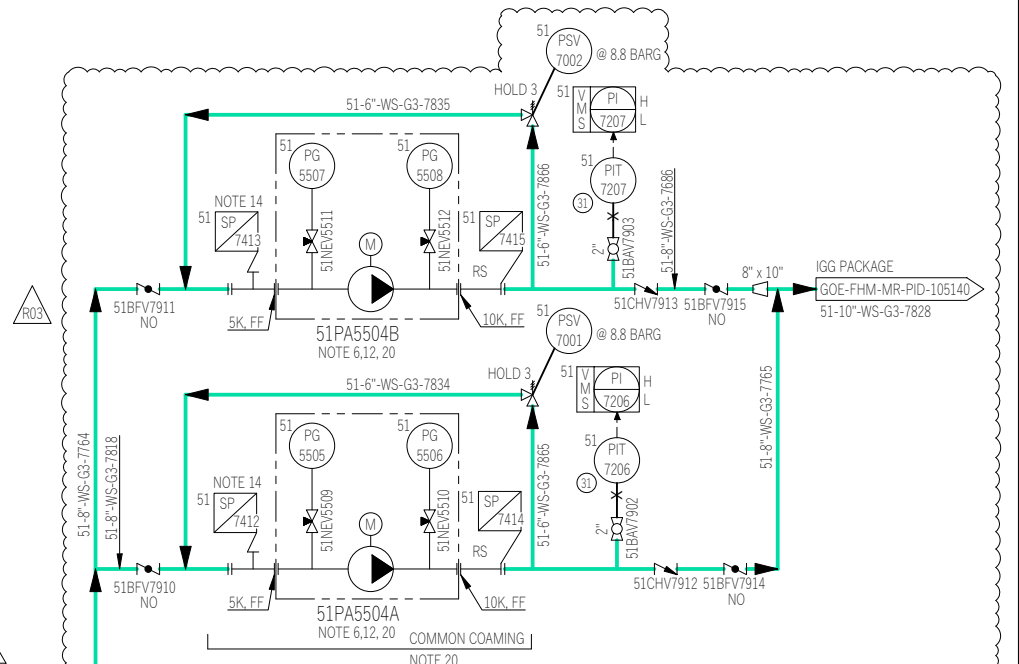
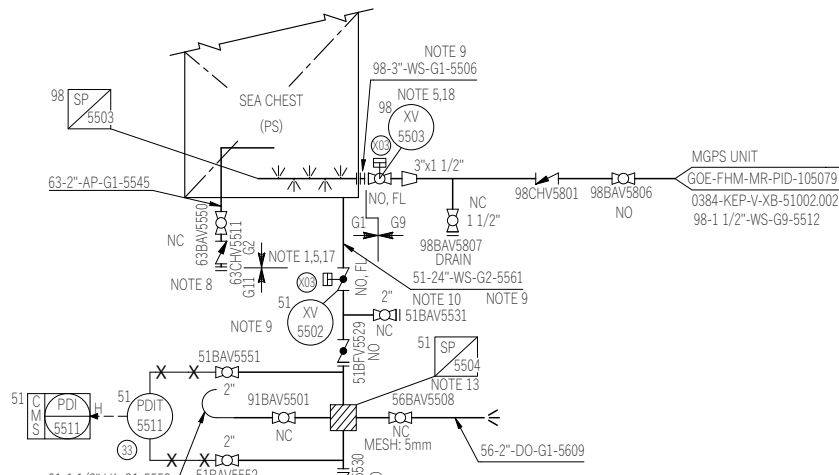


EQUIP. TAG	51PA5505A/B
EQUIP. NAME	SEA WATER COOLING PUMP A/B
CAPACITY	750 m3/h @ 25 m
CONFIGURATION	2 x 100%
DUTY POWER	75 kW
OPERATING(DESIGN) PRESSURE	4 (5) BARG
MOC	BRONZE

EQUIP. TAG	51PA7504A/B(NEW)
EQUIP. NAME	COOLING SEA WATER PUMP A/B FOR PRESSURE COOLER
CAPACITY	1200 m3/h @ 40 m
CONFIGURATION	2 x 100%
DUTY POWER	159 kW

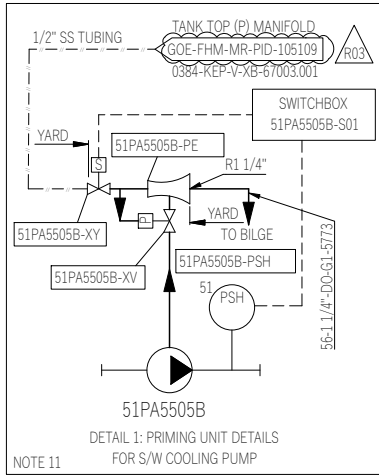

TO RO UNITS
GOE-FHM-MR-PID-105082
0384-KEP-V-XB-53004.001

TO JOCKEY PUMPS
GOE-FHM-MR-PID-105117
0384-KEP-V-XB-71002.001

TO CENTRAL FW. COOLERS
GOE-FHM-MR-PID-105081
0384-KEP-V-XB-53002.001

TO MGPS UNIT
GOE-FHM-MR-PID-105079
0384-KEP-V-XB-51002.002

TO PRESSURE COOLER (55HE7002)
GOE-FHM-MR-PID-105028
0384-KEP-V-XB-55001.002

- GENERAL NOTES:
- THIS P&ID IS REISSUED FOR NECESSARY UPDATE FOR SAKARYA PROJECT.
 - SEQUENTIAL NUMBER 7XXX MEANS THERE IS A MODIFICATION FROM EXISTING UNIT OR NEW.
 - FOR P&ID LEGEND SHEET SEE DRAWING SC26-2A-GOE-FHM-MR-PID-105133 TO 105139.
 - FOR MARINE PIPING AND VALVE MATERIAL SPECIFICATION, SEE DOCUMENT: SC26-2A-GOE-FHM-FP-SPC-105001 (4517-BWO-L-SA-00002).
 - FOR CHANGES IN REV.03, PLEASE REFER TO ECN-00304, ECN-00377.
 - FOR CHANGES IN REV.01, PLEASE REFER TO ECN-00084.

- NOTES:
- VALVE SHALL BE CERTIFIED AS PER DNVGL-OS-D101 CH.3 SEC.1 [TABLE 7], CERTIFICATION IN THIS REGARD IS TO BE MADE AVAILABLE TO THE ATTENDING SURVEYOR.
 - PUMP TO BE SELF PRIMING TYPE.
 - SDNR VALVE FOR EMERGENCY BILGE SUCTION SHALL HAVE EXTENDED SPINDLE ABOVE FLOOR.
 - DELETED.
 - VALVE TYPICAL DETAIL REFER TO P&ID SYMBOLS AND LEGEND.
 - PUMP MOTOR STARTER CONNECTION TYPICAL DETAIL REFER TO P&ID SYMBOLS AND LEGEND.
 - DELETED.
 - CONNECTION FOR AIR BLOWING OF SEA CHEST
 - REFER TO 0384-KEP-L-XS-00001.001 FOR SEA CHEST DISTANCE PIECE PENETRATION DETAILS.
 - CONNECTION FOR BOROSCOPE INSPECTION.
 - REFER TO VENDOR'S DRAWING 0384-SIL-V-SA-00001 FOR PRIMING UNIT DETAILS.
 - COUNTER FLANGES TO BE PROVIDED BY VENDOR.
 - FF FLANGE FACE FOR STRAINER.
 - EXTENDED SPINDLE IS REQUIRED UP TO 150MM BELOW TOP OF FLOOR GRATING.
 - STAND-BY PUMP SHALL START AT 55TH7610 FOR SIMULTANEOUS OPERATION.
 - THAT SHIPSIDE VALVES SHOULD BE OPERATED BOTH LOCALLY AND REMOTELY AND OPEN CLOSED STATUS SHALL BE AVAILABLE AT BOTH LOCAL AND REMOTE LOCATION.
 - FOR SHIPSIDE VALVES ON PLASTIC PIPING ADDITIONALLY NEED TO BE REMOTELY OPERATED OUTSIDE WATERTIGHT DECK.
 - COUNTER FLANGES TO BE PROVIDED BY PUMP VENDOR.
 - REFER TO DDS201 IN SC26-2A-GOE-FHM-MR-PID-105092 FOR COAMING SCUPPER DRAIN LINE.

- LEGENDS:
- EXISTING PIPE
- NEW PIPE
- HOLDS:
- DELETED.
 - DELETED.
 - PENDING VENDOR INFO.

51PA7504A/B INTERFACES		
TP	DESCRIPTION	CONNECTION TYPE / SIZE
X	PUMP INLET	14" ISO 7005-3 PN10
Y	PUMP OUTLET	12" ISO 7005-3 PN10

EQUIP. TAG	51PA5504A/B
EQUIP. NAME	IGG SEA WATER COOLING PUMP A/B
CAPACITY	200 m3/h @ 40 m
CONFIGURATION	2 x 50%
DUTY POWER	65 kW

SYSTEM PARAMETERS				
SERVICE	MGPS	SEAWATER COOLING	IGG SEAWATER COOLING	SERVICE AIR
DESIGN PRESSURE(Barg)	5	7	9	11.5
OPERATING PRESSURE(Barg)	3.5	6	6.4	10
DESIGN TEMPERATURE(°C)	50	40	40	50
OPERATING TEMPERATURE(°C)	25	35	35	AMB

G	R03	APPROVED FOR CONSTRUCTION		11/05/26	ZYL	DWJ	DC	SJL	
F	R02	APPROVED FOR CONSTRUCTION		11/08/25	ZYL	DWJ	DC	SJL	
E	R01	APPROVED FOR CONSTRUCTION		30/04/25	ZYL	DWJ	DC	SJL	
D	R00	APPROVED FOR CONSTRUCTION (1 st GOE ISSUE)		03/12/24	ZYL	DWJ	DC	SJL	
C	R01	ISSUED FOR DESIGN / ISSUED FOR APPROVAL		26/06/24	LCE	GYSH	CHS1	HJM	
B	R00	ISSUED FOR REVIEW		14/03/24	LCE	CHS1	YOLE	HJM	
A	-	INTER DISCIPLINE CHECK		12/01/24	LCE	QLLI	CHS1	CHS1	
GOE REV	OTC REV	REASON FOR USE			DATE	DRAWN	ISSUED	CHECKED	APPROVED
DISCIPLINE:	SYSTEM NO:	AREA / MODULE:	IMO NO:	PROJECT NO:	SCALE:	SIZE:			
MR	51	FHM	8706014	SC26-2A	N.T.S.	A3			
SUPPLIER:			PROJECT: Sakarya Gas Field Dev't Phase-2a						
 OceanSTAR Elite			TITLE:						
			P&ID - SEA WATER MAIN HEADER AND COOLING PUMPS IN ENGINE ROOM (SHEET 1)						
CLIENT:			OTC DOC. NO: SC26-2A-GOE-FHM-MR-PID-105030				GOE REV: G	SHEET	
 OTC OFFSHORE TECHNOLOGY CENTER			LEG DOC. NO: SC26-2A-BWO-FHM-MR-PID-105030				OTC REV: R03	1 of 1	
			REF DOC. NO: 0384-KEP-V-XB-51002.001						
This drawing contains proprietary information and may not be transferred, reproduced or used to construct any project other than it was issued for without the written consent of GOE or the Client.									