



55SK2800 INTERFACES		
TP	DESCRIPTION	CONNECTION TYPE / SIZE
TP01	BOILER (M51) SAMPLE IN	1/2" BULKHEAD UNION
TP02	BOILER (M52) SAMPLE IN	1/2" BULKHEAD UNION
TP03	FEED WATER SAMPLE IN	1/2" BULKHEAD UNION
TP04	STEAM TURBINE CONDENSATE RETURN SAMPLE IN	1/2" BULKHEAD UNION
TP05	COOLING WATER SUPPLY	1" ANSI 150# RF WN
TP06	COOLING WATER RETURN	1" ANSI 150# RF WN
TP07	DRAIN	1" ANSI 150# RF BF

55SK2899 INTERFACES			
TP	DESCRIPTION	CONNECTION TYPE / SIZE	MATERIAL
N1	BOILER WATER CHEMICAL DOSING TO M51 FEEDWATER	1/2" NPT	ANSI 316
N2	BOILER WATER CHEMICAL DOSING TO M52 FEEDWATER	1/2" NPT	ANSI 316
N3	FEEDWATER CHEMICAL DOSING NO.1 TO DEAREATOR	1/2" NPT	ANSI 316
N4	FEEDWATER CHEMICAL DOSING NO.2 TO DEAREATOR	1/2" NPT	ANSI 316
N8	DRIP PAN DRAIN	1" ANSI 150#	ANSI 316

GENERAL NOTES:

1. SEQUENTIAL NUMBER 7XXX MEANS THERE IS A MODIFICATION FROM EXISTING UNIT OR NEW.
2. FOR P&ID LEGEND SHEET SEE DRAWING:
SC26-2A-GOE-FGN-PE-PID-100018, SC26-2A-GOE-FGN-PE-PID-100021 TO 100031.
3. FOR MARINE PIPING AND VALVE MATERIAL SPECIFICATION, SEE DOCUMENT:
SC26-2A-GOE-FHM-EP-SPC-105001 (4517-BWO-L-SA-00002).

NOTES:

1. SKID DRAIN NOZZLE TO BE BLANKED OFF. DRAIN TO BE COLLECTED MANUALLY.

REFERENCES:

1. SC26-2A-ALF-FGN-PE-PID-100010 SWAS & TREATMENT UNIT.


HOLDS :

1. DELETED.
2. DELETED.
3. PROCESS DATA OF CHEMICAL DOSING LINES TO BE PROVIDED BY ALFA LAVAL.

LEGENDS:

 NEW PIPE

SYSTEM PARAMETERS						
SERVICE	SAMPLING OF GTG CONDENSATE RETURN LINE	SAMPLING OF FEED WATER	SAMPLING OF BOILER	FRESH WATER TO SWAS	FRESH WATER FROM SWAS	CHEMICAL DOSING
DESIGN PRESSURE(Barg)	11.0	65.0	48.0	15.0	15.0	HOLD 3
OPERATING PRESSURE(Barg)	10.0	53.1	40	11.5	11.5	HOLD 3
DESIGN TEMPERATURE(°C)	80.0	145.0	424.0	65.0	65.0	HOLD 3
OPERATING TEMPERATURE(°C)	60	105	231	34	55	HOLD 3

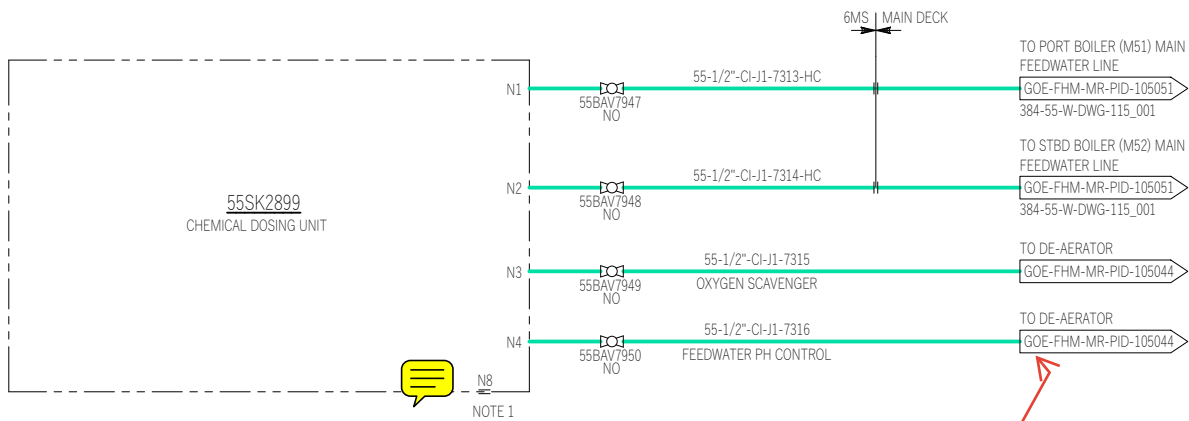

PID GOE-FHM-MR-PID-105044 is not in SDx.

D	R02	APPROVED FOR CONSTRUCTION			28/11/25	ZYL	DWJ	DC	SJL	
C	R01	ISSUED FOR APPROVAL			24/10/25	ZYL	DWJ	DC	SJL	
B	R00	ISSUED FOR REVIEW			23/08/25	ZYL	DWJ	DC	SJL	
A	-	INTER-DISCIPLINE CHECK			08/07/25	ZYL	DWJ	DC	SJL	
GOE REV.	OTC REV.	REASON FOR USE			DATE	DRAWN	ISSUED	CHECKED	APPROVED	
DISCIPLINE:		SYSTEM NO.:	AREA / MODULE:	IMO NO.:	PROJECT NO.:	SCALE:	SIZE:			
MR		55	FHM	8706014	SC26-2A	N.T.S.	A3			
SUPPLIER:			PROJECT: Sakarya Gas Field Dev't Phase-2a							
 OceanSTAR Elite			 GLOBAL OFFSHORE ENGINEERING		TITLE: P&ID - SWAS & TREATMENT UNIT					
CLIENT:										
 OTC				OFFSHORE TECHNOLOGY CENTER			OTC DOC. NO. SC26-2A-GOE-FHM-MR-PID-105129		GOE REV. D	SHEET 1 of 1
				LEG DOC. NO. -			OTC REV. R02			
				REF DOC. NO. -						
This drawing contains proprietary information and may not be transferred, reproduced or used to construct any project other than it was issued for without the written consent of GOE or their Client.										