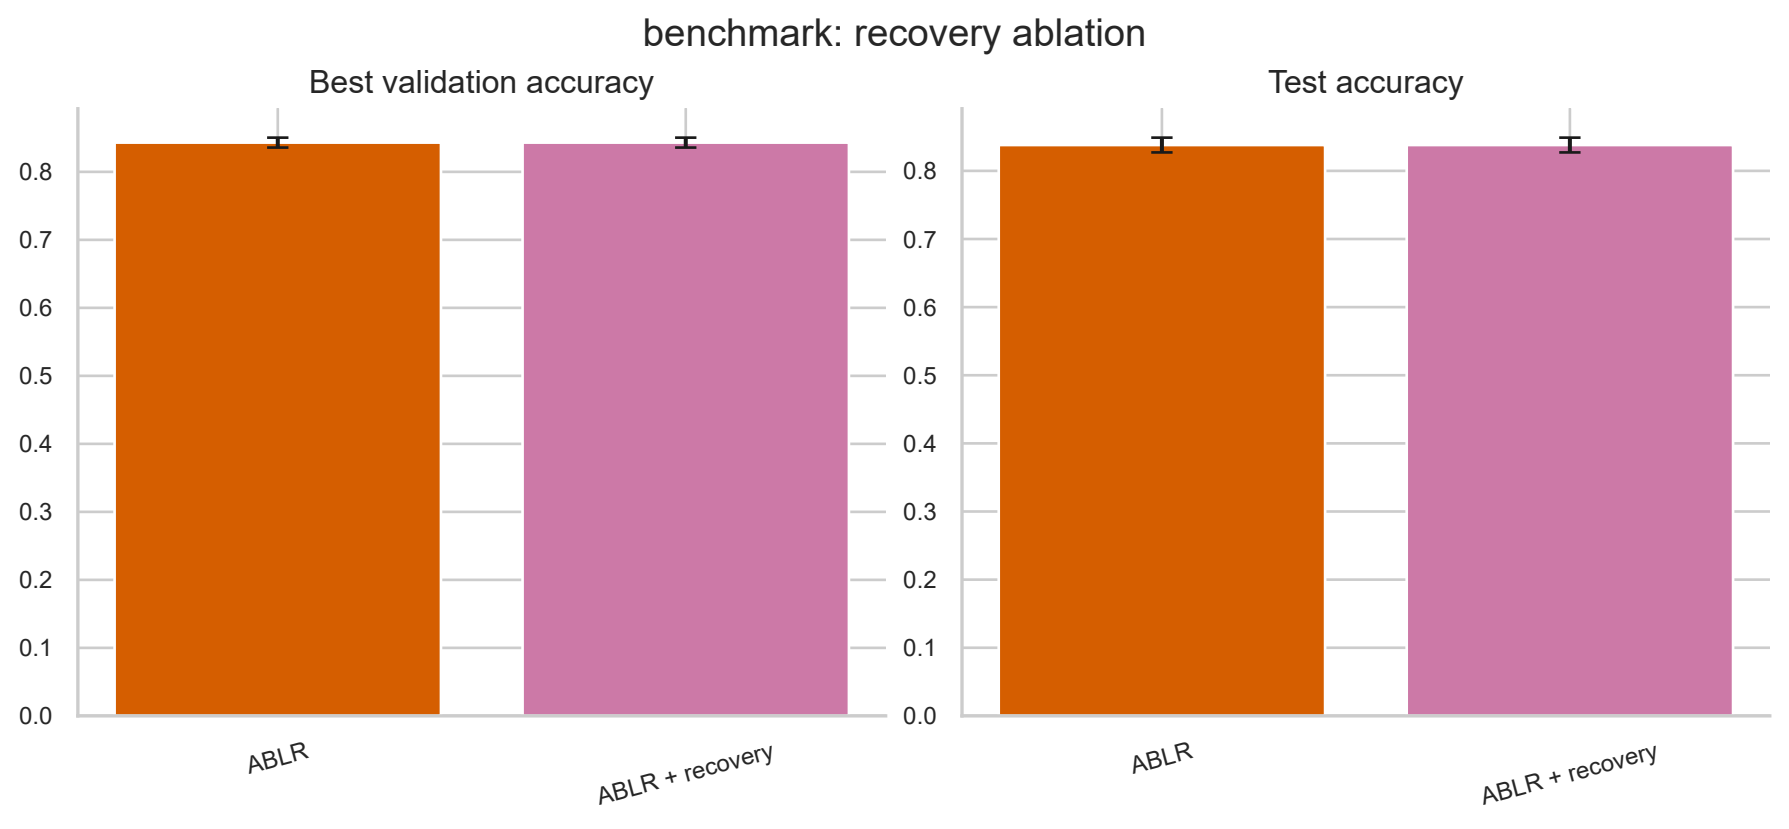
benchmark: recovery ablation
Best validation accuracy
Test accuracy
0.0
0.1
0.2
0.3
0.4
0.5
0.6
0.7
0.8
ABLR
ABLR + recovery
ABLR
ABLR + recovery