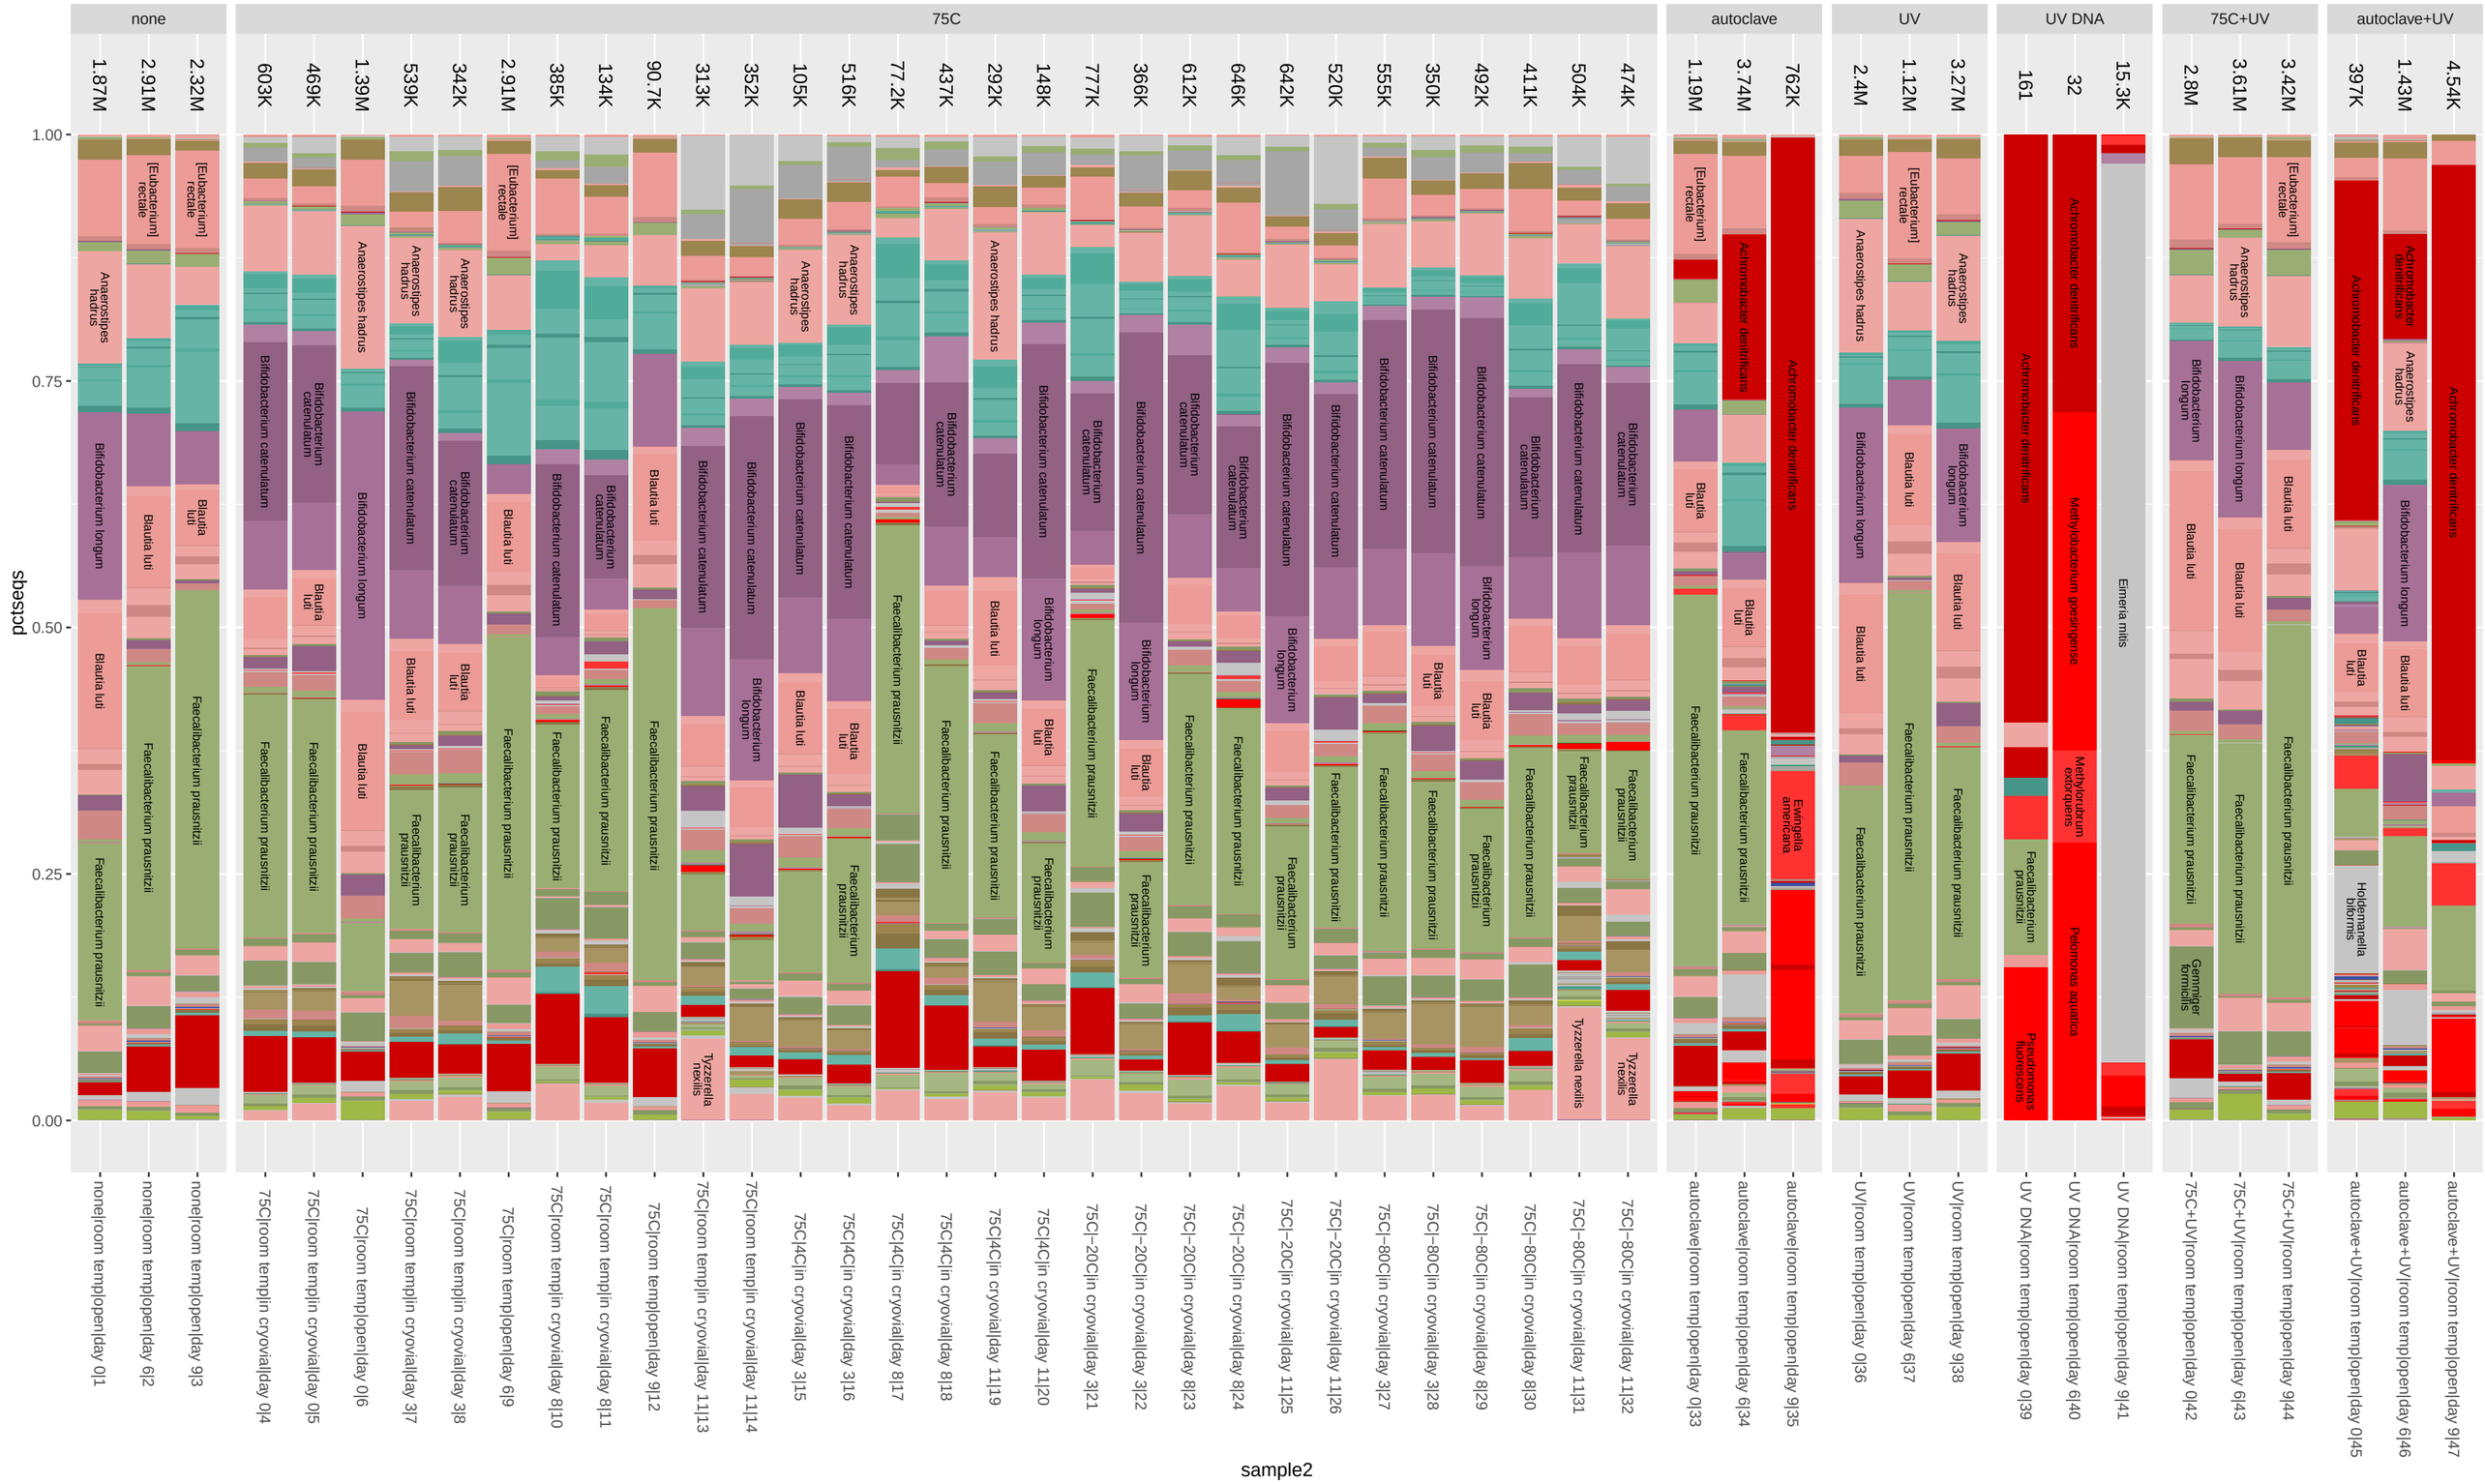
none
75C
autoclave
UV
UV DNA
75C+UV
autoclave+UV
pctseqs
1.00
0.75
0.50
0.25
0.00
1.87M
2.91M
2.32M
603K
469K
1.39M
539K
342K
2.91M
385K
134K
90.7K
313K
352K
105K
516K
77.2K
437K
292K
148K
777K
366K
612K
646K
642K
520K
555K
350K
492K
411K
504K
474K
1.19M
3.74M
762K
2.4M
1.12M
3.27M
161
32
15.3K
2.8M
3.61M
3.42M
397K
1.43M
4.54K
[Eubacterium] rectale
Anaerostipes hadrus
Bifidobacterium longum
Blautia luti
Faecalibacterium prausnitzii
Bifidobacterium catenulatum
Achromobacter denitrificans
Ewingella americana
Methylorubrum extorquens
Methylobacterium gossingense
Pelomonas aquatica
Pseudomonas fluorescens
Elmeria mitis
Gemmiger formicilis
Holdemanella biformis
Tyzzerella nexilis
none|room temp|open|day 0|1
none|room temp|open|day 6|2
none|room temp|open|day 9|3
75C|room temp|in cryovial|day 0|4
75C|room temp|open|day 0|6
75C|room temp|in cryovial|day 0|5
75C|room temp|open|day 6|9
75C|room temp|in cryovial|day 3|7
75C|room temp|in cryovial|day 3|8
75C|room temp|in cryovial|day 8|10
75C|room temp|in cryovial|day 8|11
75C|room temp|open|day 9|12
75C|room temp|in cryovial|day 11|13
75C|room temp|in cryovial|day 11|14
75C|4C|in cryovial|day 3|15
75C|4C|in cryovial|day 3|16
75C|4C|in cryovial|day 8|17
75C|4C|in cryovial|day 8|18
75C|4C|in cryovial|day 11|19
75C|4C|in cryovial|day 11|20
75C|4C|in cryovial|day 3|21
75C|−20C|in cryovial|day 3|22
75C|−20C|in cryovial|day 8|23
75C|−20C|in cryovial|day 8|24
75C|−20C|in cryovial|day 11|25
75C|−20C|in cryovial|day 11|26
75C|−80C|in cryovial|day 3|27
75C|−80C|in cryovial|day 3|28
75C|−80C|in cryovial|day 8|29
75C|−80C|in cryovial|day 8|30
75C|−80C|in cryovial|day 11|31
75C|−80C|in cryovial|day 11|32
autoclave|room temp|open|day 0|33
autoclave|room temp|open|day 6|34
autoclave|room temp|open|day 9|35
UV|room temp|open|day 0|36
UV|room temp|open|day 6|37
UV|room temp|open|day 9|38
UV DNA|room temp|open|day 0|39
UV DNA|room temp|open|day 6|40
UV DNA|room temp|open|day 9|41
75C+UV|room temp|open|day 0|42
75C+UV|room temp|open|day 6|43
75C+UV|room temp|open|day 9|44
autoclave+UV|room temp|open|day 0|45
autoclave+UV|room temp|open|day 6|46
autoclave+UV|room temp|open|day 9|47
sample2