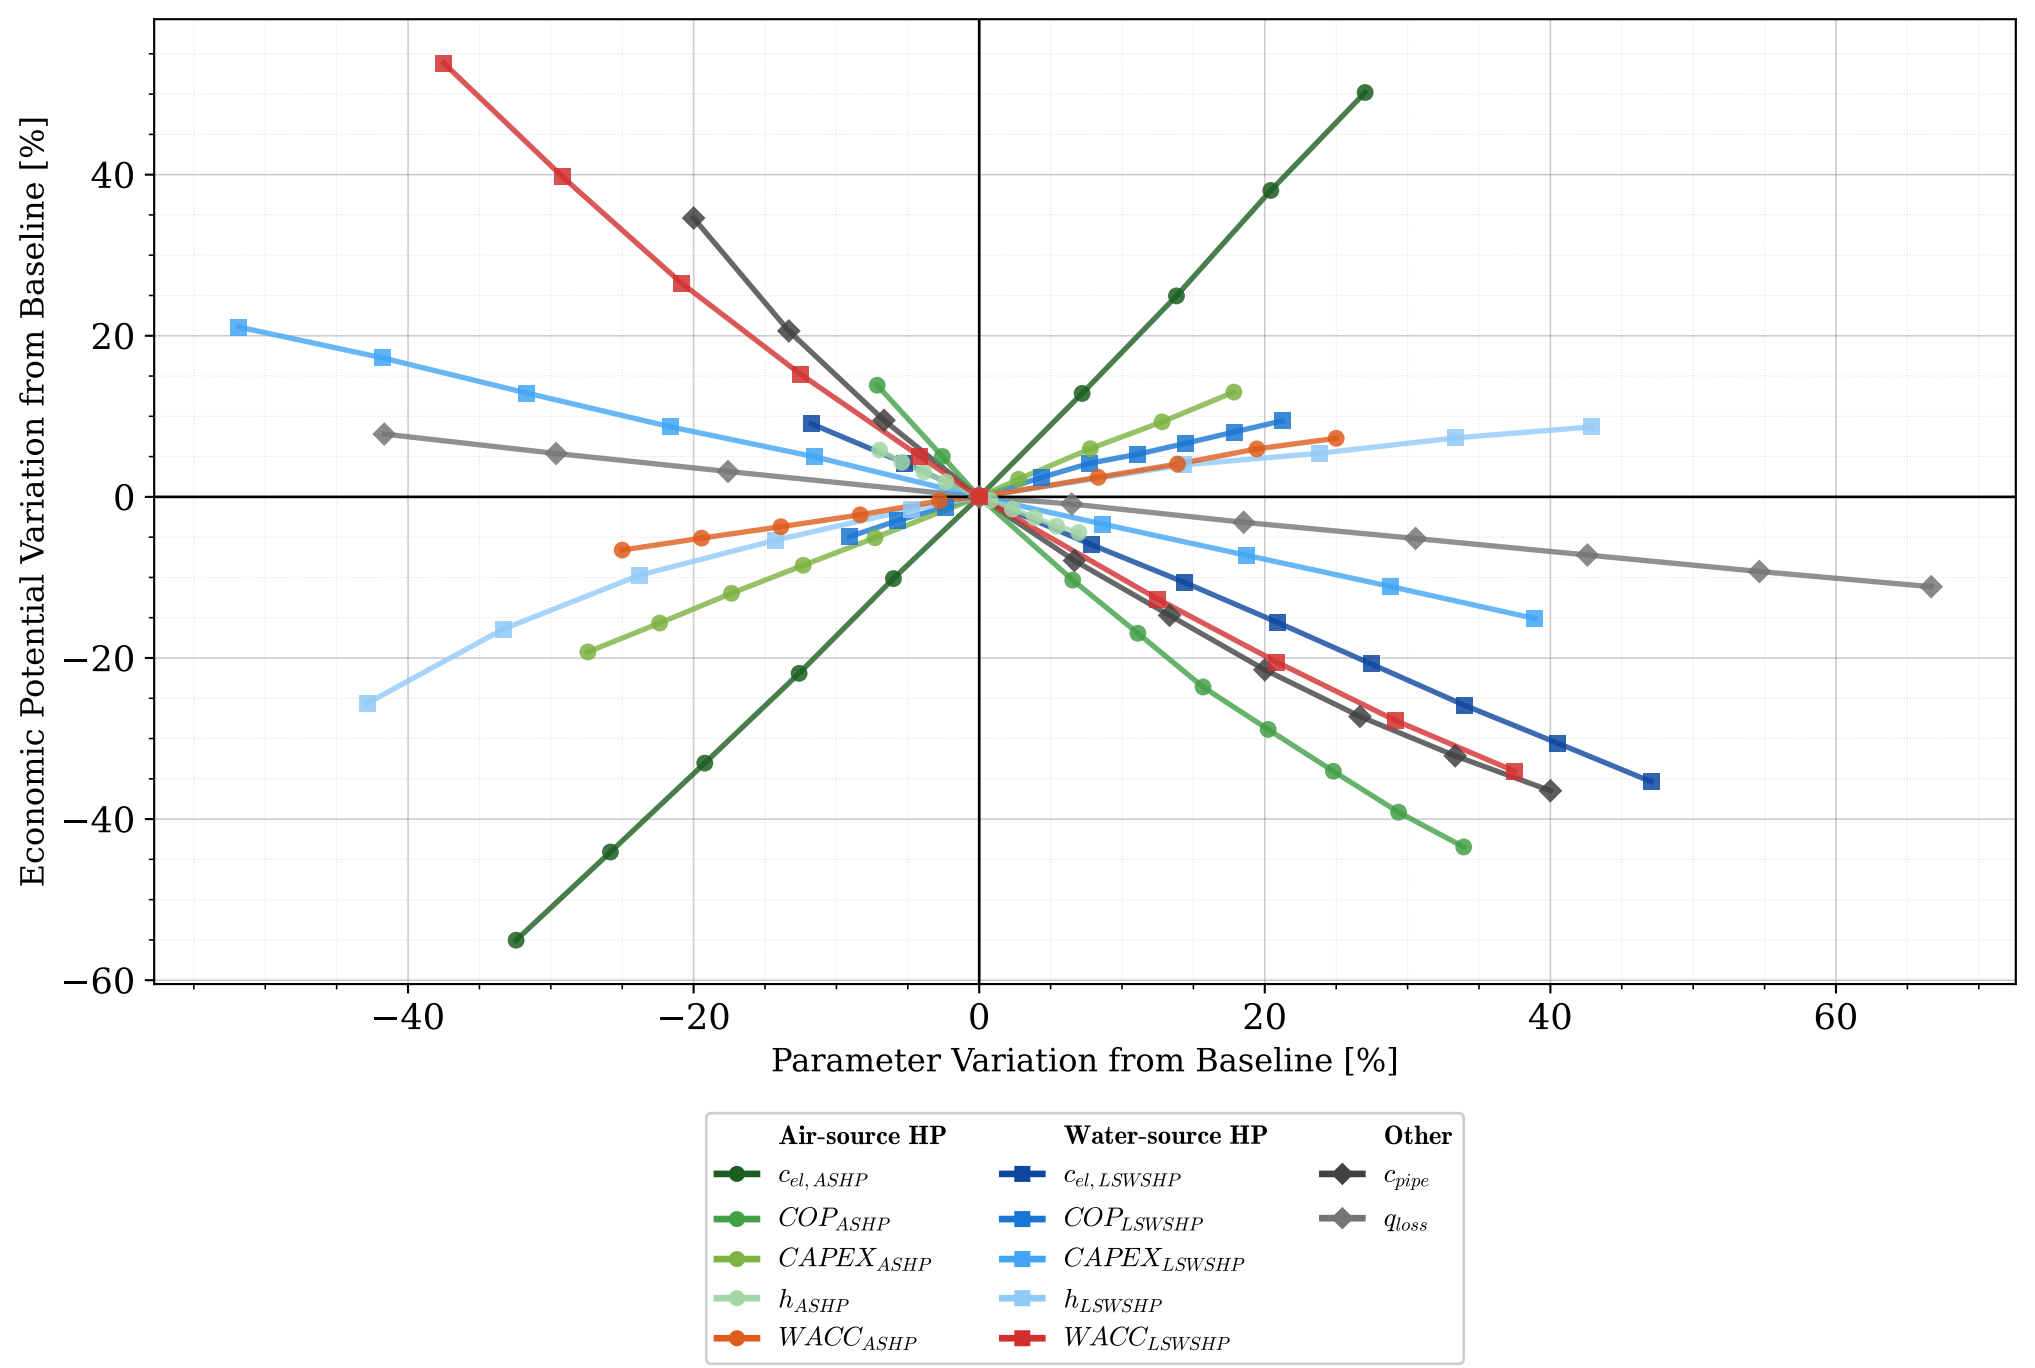
Economic Potential Variation from Baseline [%]
Parameter Variation from Baseline [%]
40
20
0
−20
−40
−60
−40
−20
0
20
40
60
Air-source HP
$c_{el,\,ASHP}$
COP_{ASHP}
$CAPEX_{ASHP}$
h_{ASHP}
$WACC_{ASHP}$
Water-source HP
$c_{el,\,LSWSHP}$
COP_{LSWSHP}
$CAPEX_{LSWSHP}$
h_{LSWSHP}
$WACC_{LSWSHP}$
Other
c_{pipe}
q_{loss}