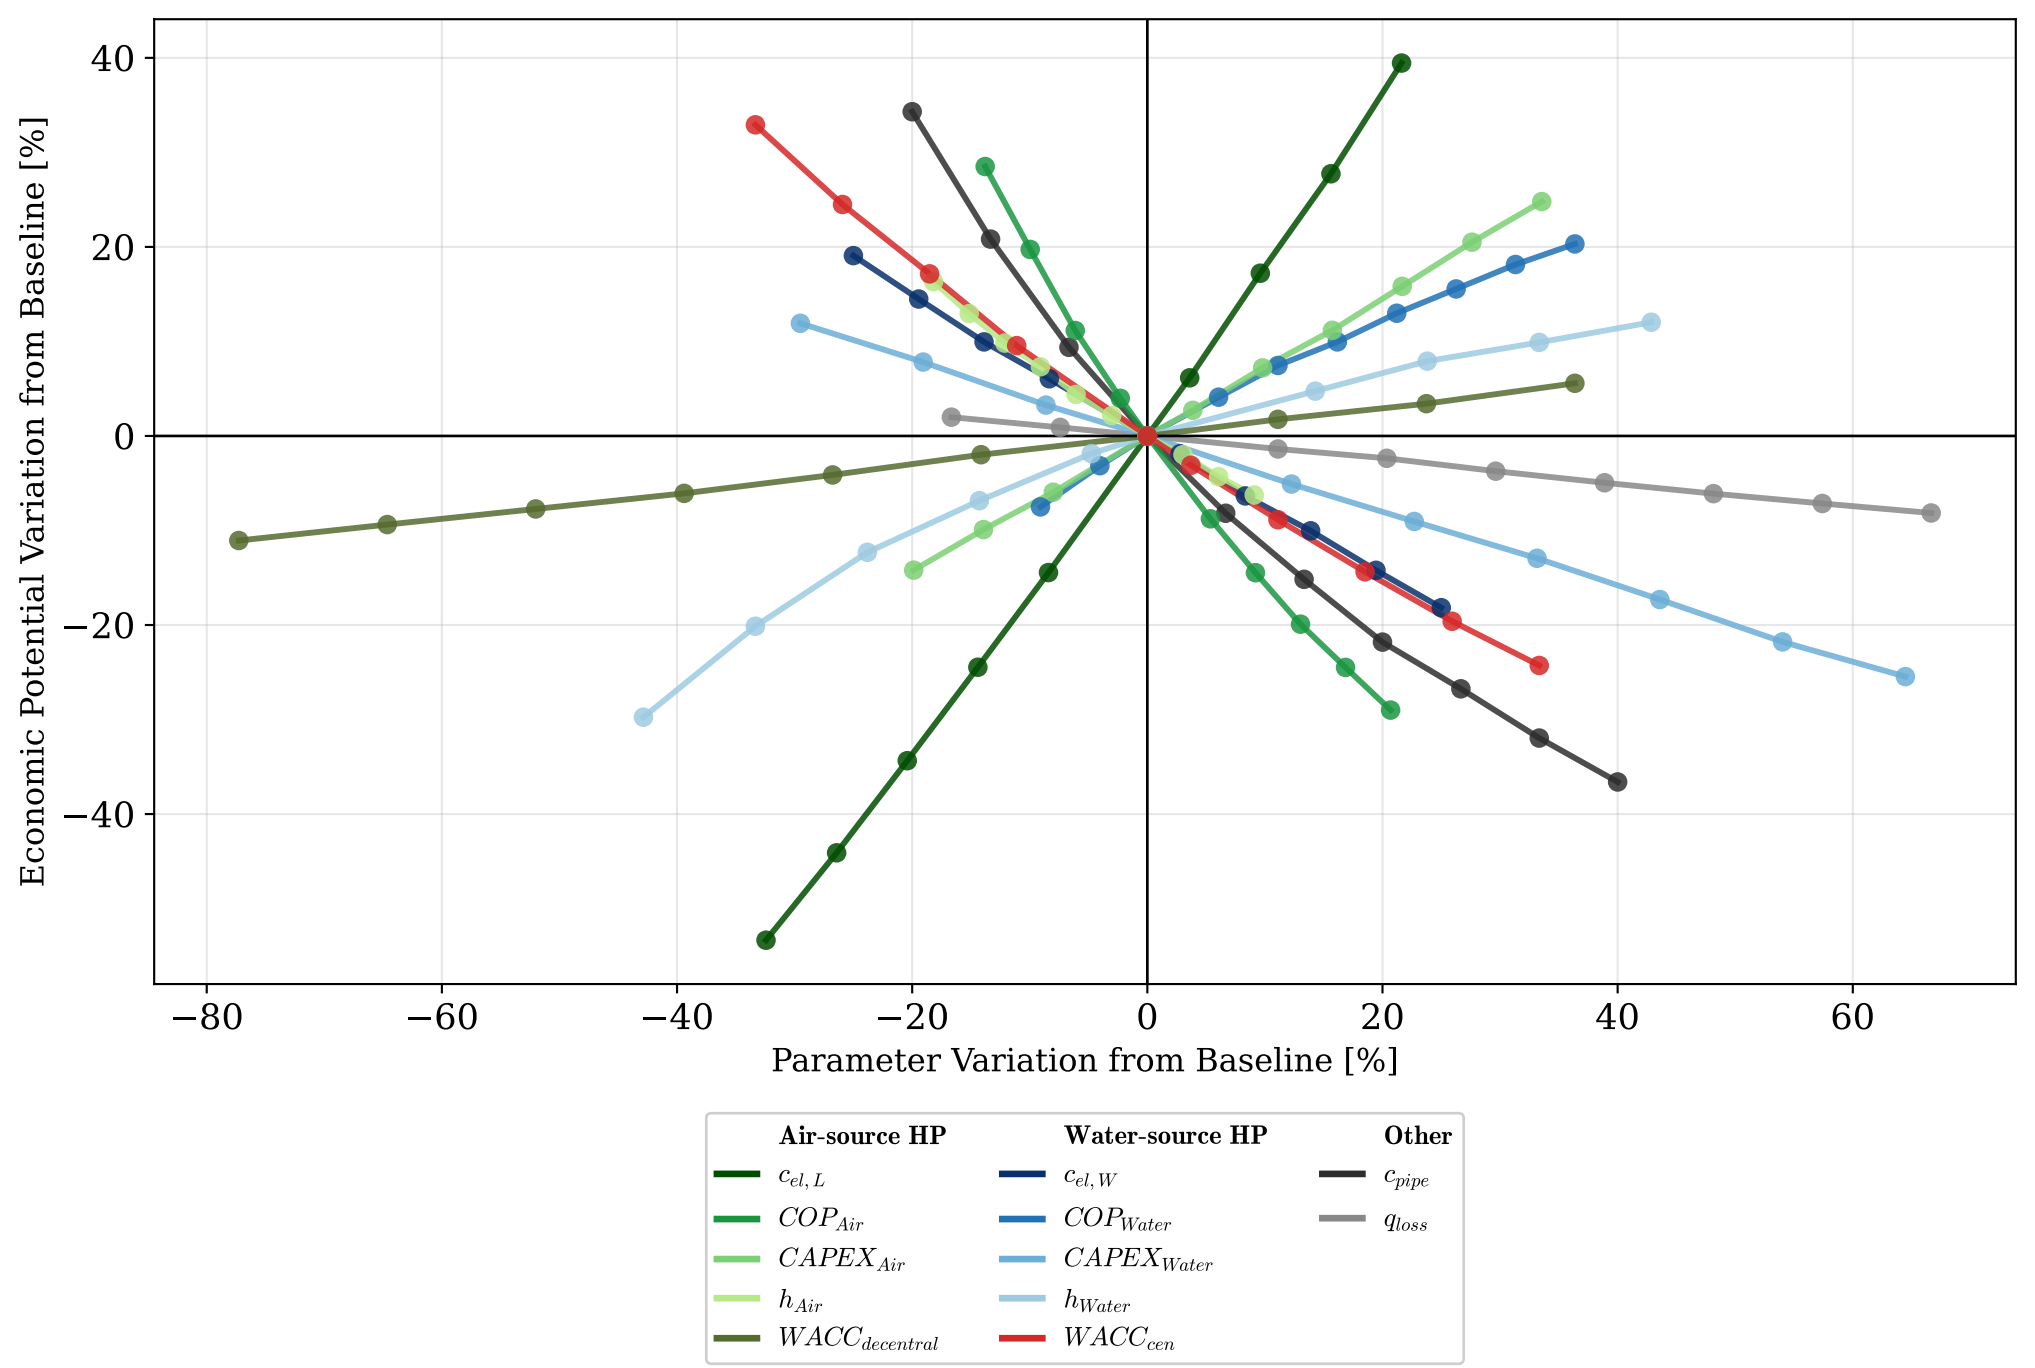
Economic Potential Variation from Baseline [%]
40
20
0
−20
−40
−80
−60
−40
−20
0
20
40
60
Parameter Variation from Baseline [%]
Air-source HP
$c_{el,L}$
COP_{Air}
$CAPEX_{Air}$
h_{Air}
$WACC_{decentral}$
Water-source HP
$c_{el,W}$
COP_{Water}
$CAPEX_{Water}$
h_{Water}
$WACC_{cen}$
Other
c_{pipe}
q_{loss}