



US0D1092396S

(12) **United States Design Patent**
Zhang

(10) **Patent No.:** **US D1,092,396 S**

(45) **Date of Patent:** **** Sep. 9, 2025**

(54) **OUTDOOR EMERGENCY POWER SUPPLY**

(71) Applicant: **Huatai Hengyue New Energy**
(Guangdong) Co., Ltd., Foshan (CN)

(72) Inventor: **Suoxin Zhang**, Hunchun (CN)

(73) Assignee: **Huatai Hengyue New Energy**
(Guangdong) Co., Ltd., Foshan (CN)

(**) Term: **15 Years**

(21) Appl. No.: **29/853,300**

(22) Filed: **Sep. 14, 2022**

(51) **LOC (15) Cl.** **13-02**

(52) **U.S. Cl.**
USPC **D13/110; D13/109**

(58) **Field of Classification Search**

USPC D13/101–108, 110, 112, 118, 119, 184,
D13/199

CPC H02J 7/00; H02J 7/02; H02J 7/0042; H02J
7/0044; H02J 7/0045; H02J 7/0013;
H01R 25/00; H01R 25/003; H01R 27/00;
H04B 1/3877; H01M 10/44; H01M 10/46

See application file for complete search history.

(56) **References Cited**

U.S. PATENT DOCUMENTS

D129,408	S	*	9/1941	Christie		D6/671.1
D341,961	S	*	12/1993	Howden		D14/308
D432,098	S	*	10/2000	Nelson		D13/184
D664,090	S	*	7/2012	Inskeep		D13/107
D687,774	S	*	8/2013	Moore		D13/109
D734,719	S	*	7/2015	Johnson		D13/110
D778,832	S	*	2/2017	Wang		D13/109

D811,325	S	*	2/2018	Inskeep		D15/9
D812,561	S	*	3/2018	Inskeep		D15/9
D934,170	S	*	10/2021	Shen		D13/109
D1,049,042	S	*	10/2024	Zhou		D13/110
D1,070,762	S	*	4/2025	Weng		D13/109
2009/0096336	A1	*	4/2009	Petrick		G11B 33/126 312/249.8
2016/0211687	A1	*	7/2016	Wang		H02J 7/0044

* cited by examiner

Primary Examiner — Lilyana Bekic

Assistant Examiner — Robin L Hammonds

(74) *Attorney, Agent, or Firm* — JEEN IP LAW, LLC

(57) **CLAIM**

The ornamental design for an outdoor emergency power supply, as shown and described.

DESCRIPTION

FIG. 1 is a front, top and right side perspective view of an outdoor emergency power supply, showing my new design; FIG. 2 is a rear, bottom and left side perspective view thereof;

FIG. 3 is a front view thereof;

FIG. 4 is a rear view thereof;

FIG. 5 is a left side view thereof;

FIG. 6 is a right side view thereof;


FIG. 7 is a top plan view thereof;

FIG. 8 is a bottom plan view thereof; and,

FIG. 9 is an enlarged view of portion 9 shown in FIG. 1.

The dash-dash broken lines in the drawings illustrate portions of the outdoor emergency power supply. The dot-dash broken lines in the drawings illustrate the boundaries of the enlarged views. None of these broken lines form part of the claimed design.

1 Claim, 9 Drawing Sheets

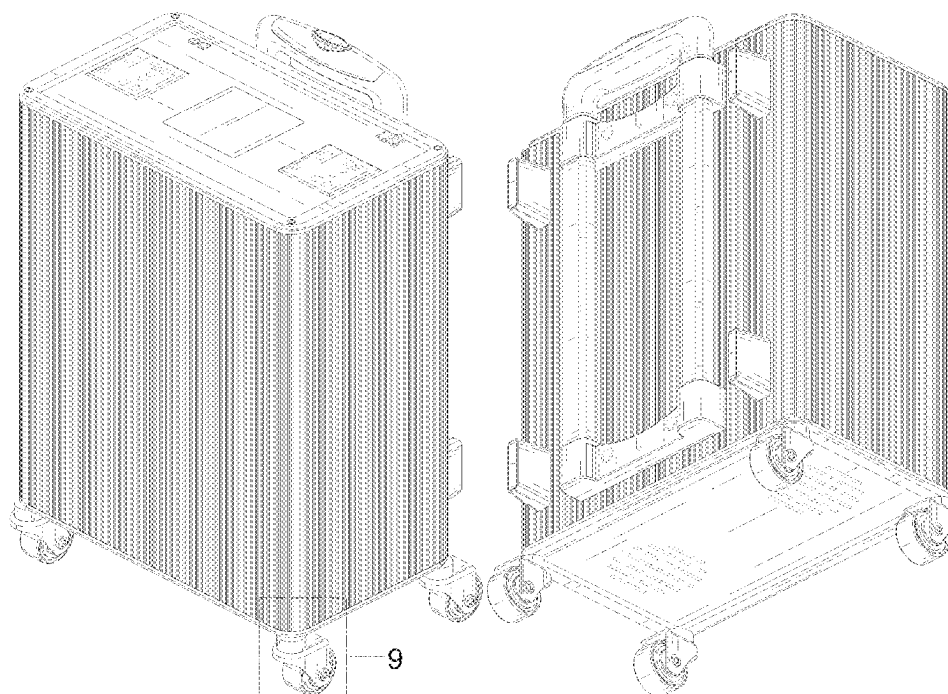

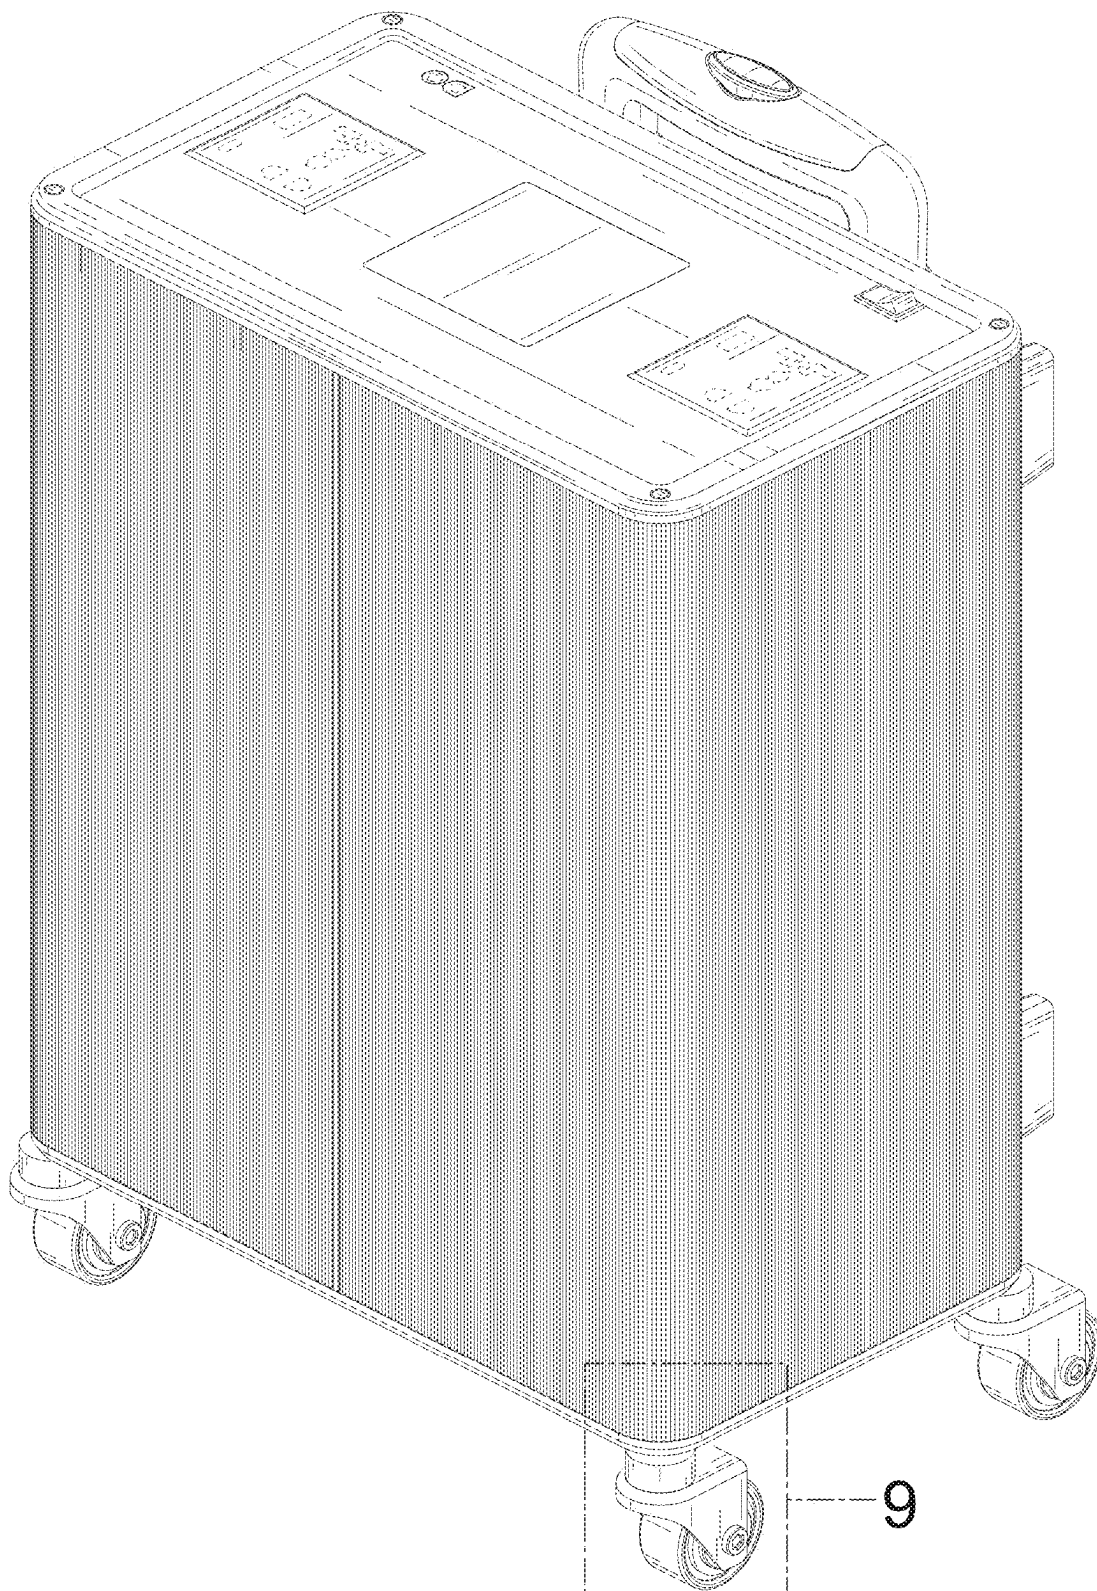


FIG. 1

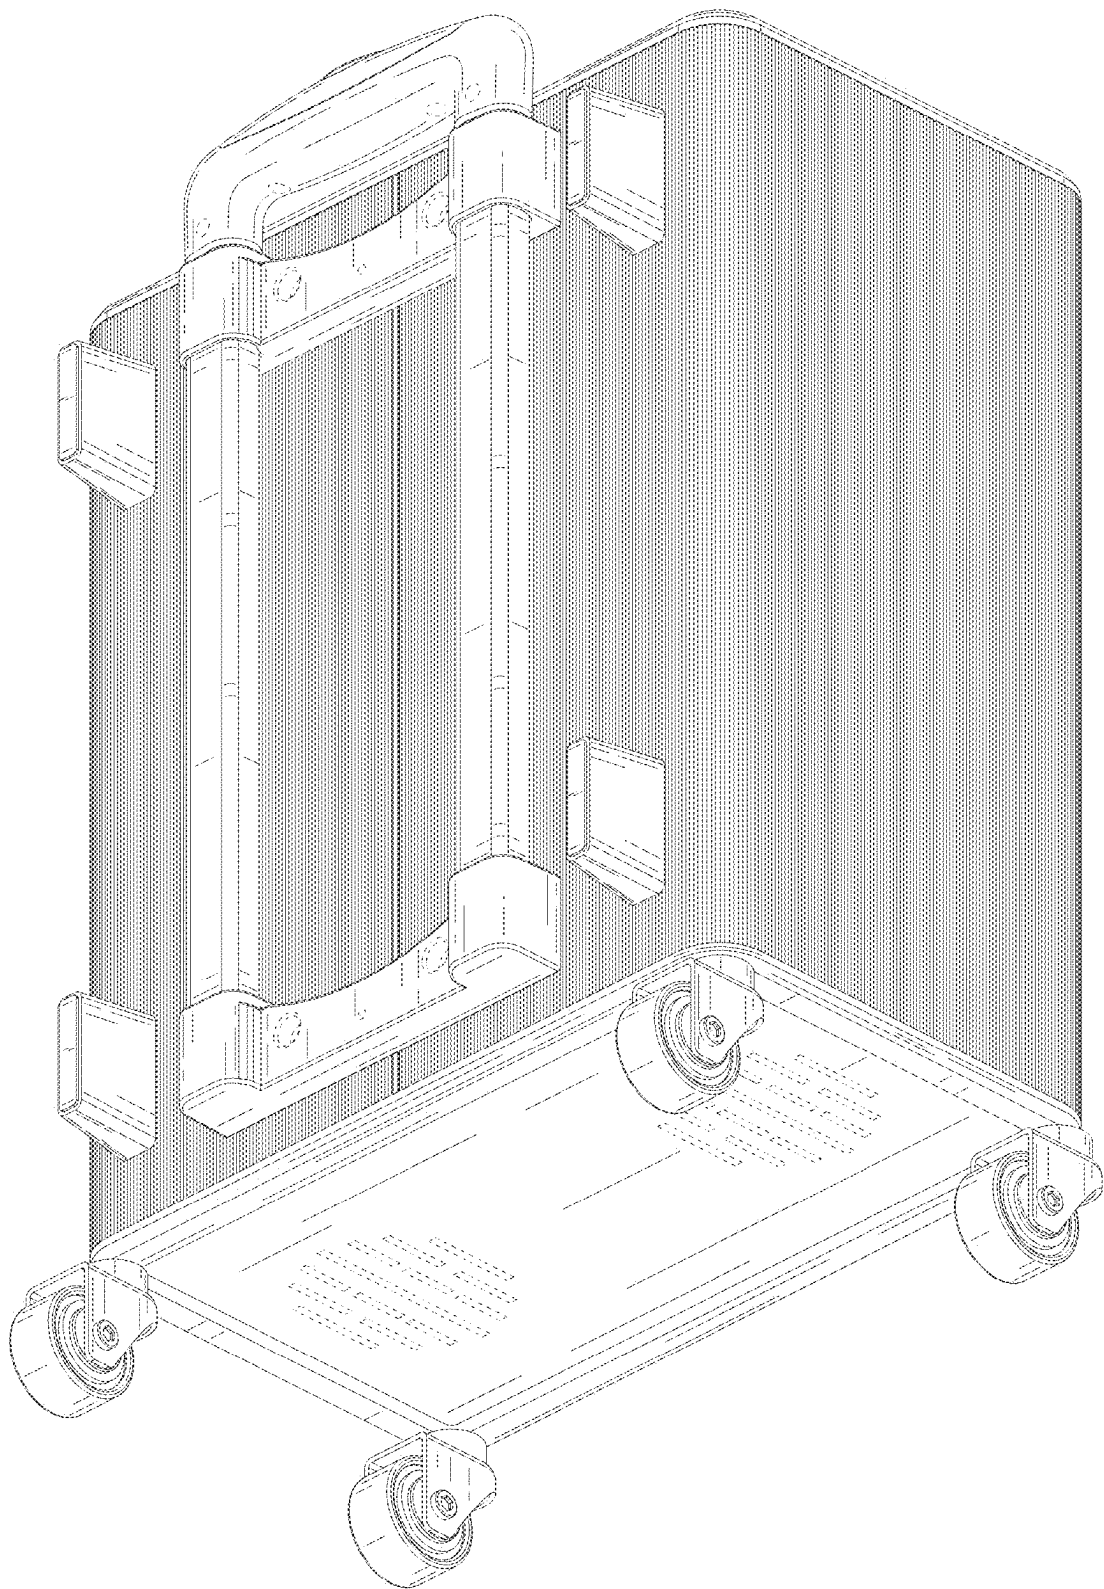


FIG. 2

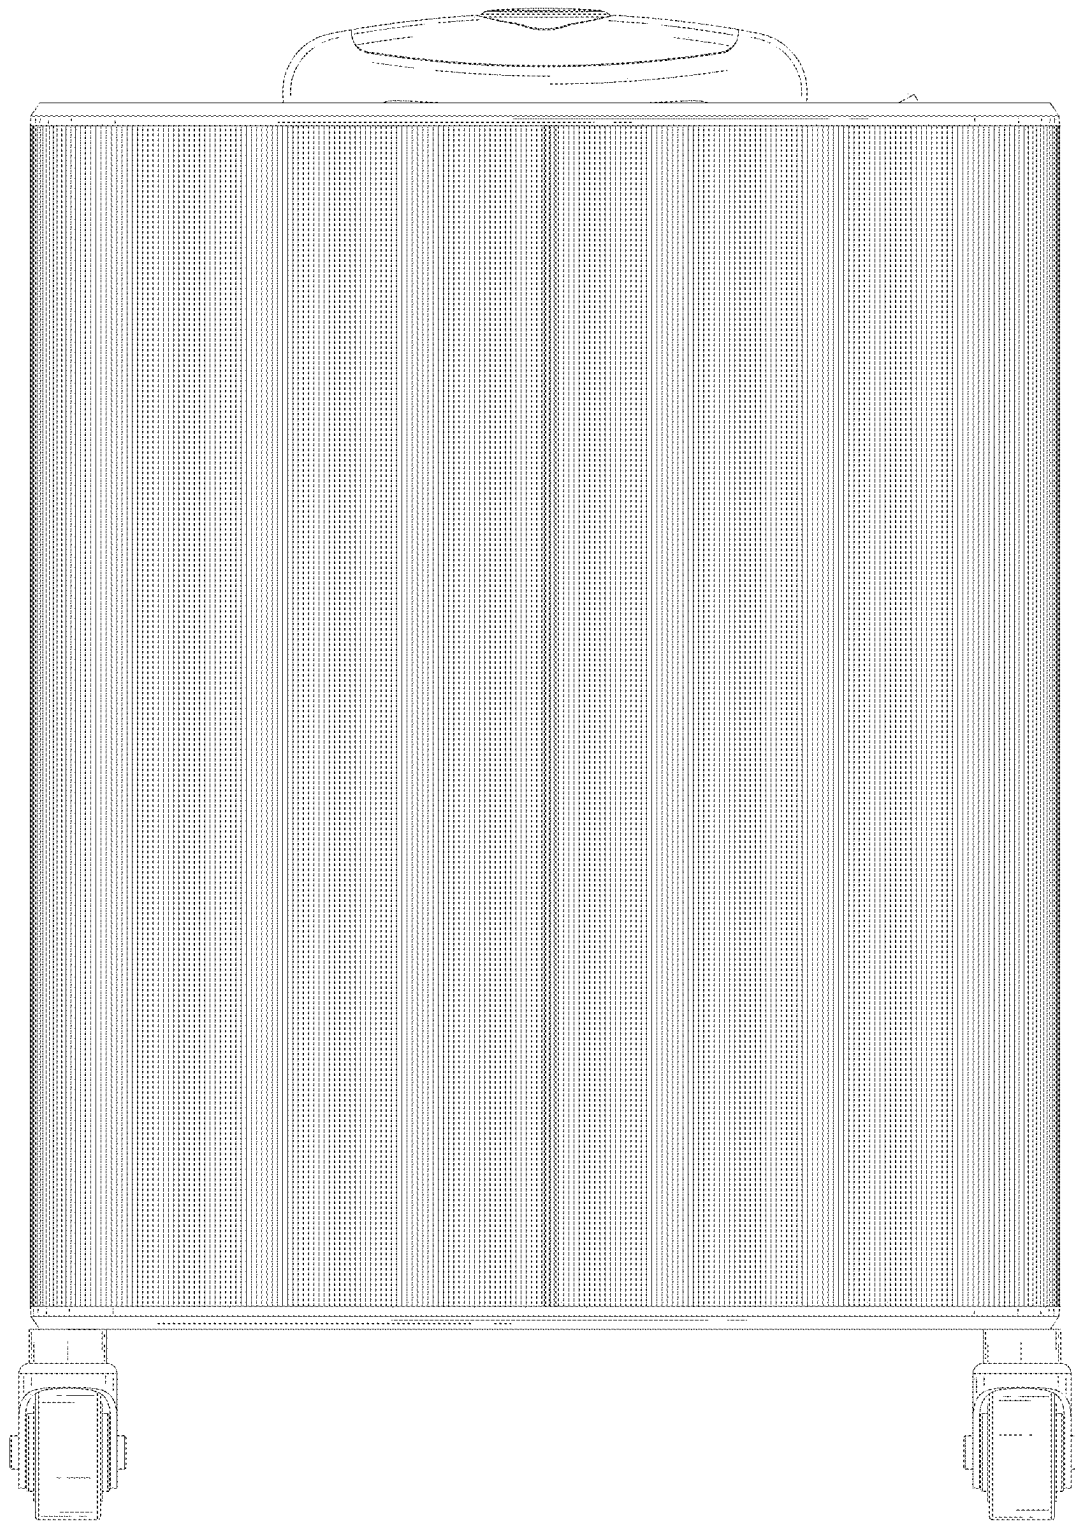


FIG. 3

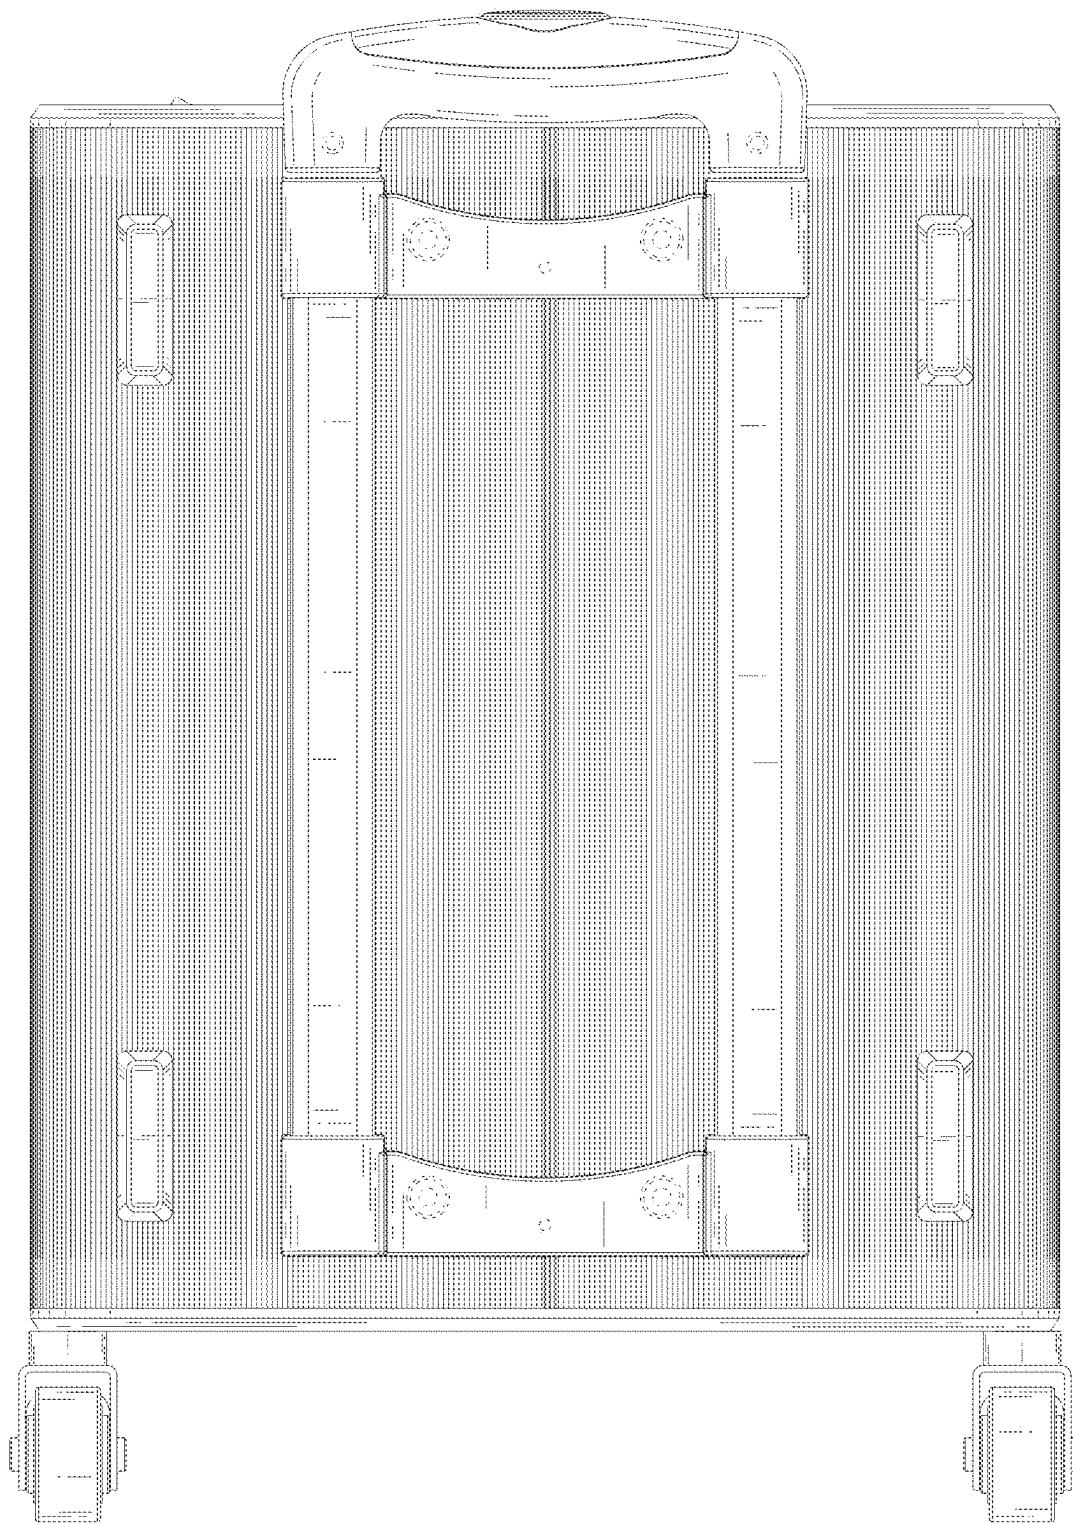


FIG. 4

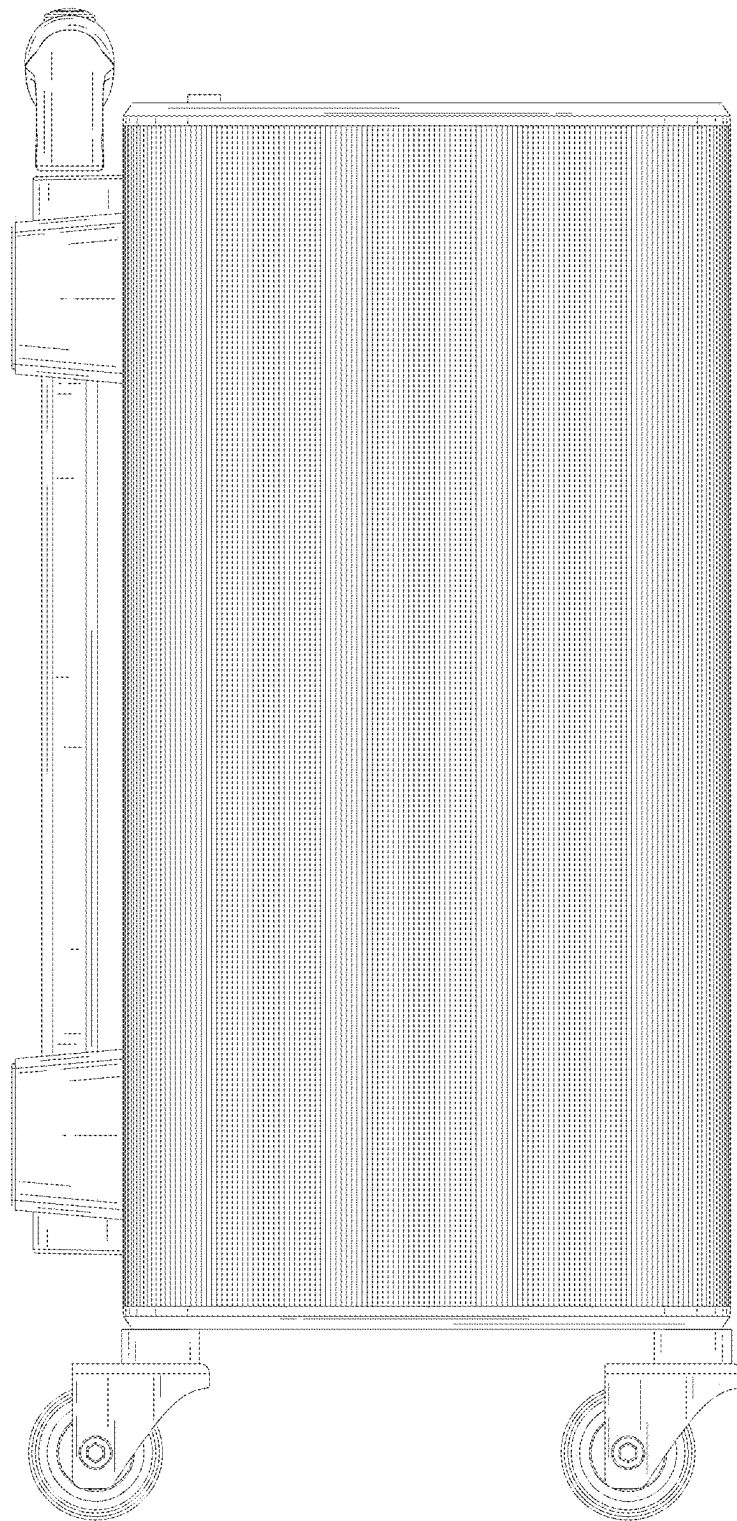


FIG. 5

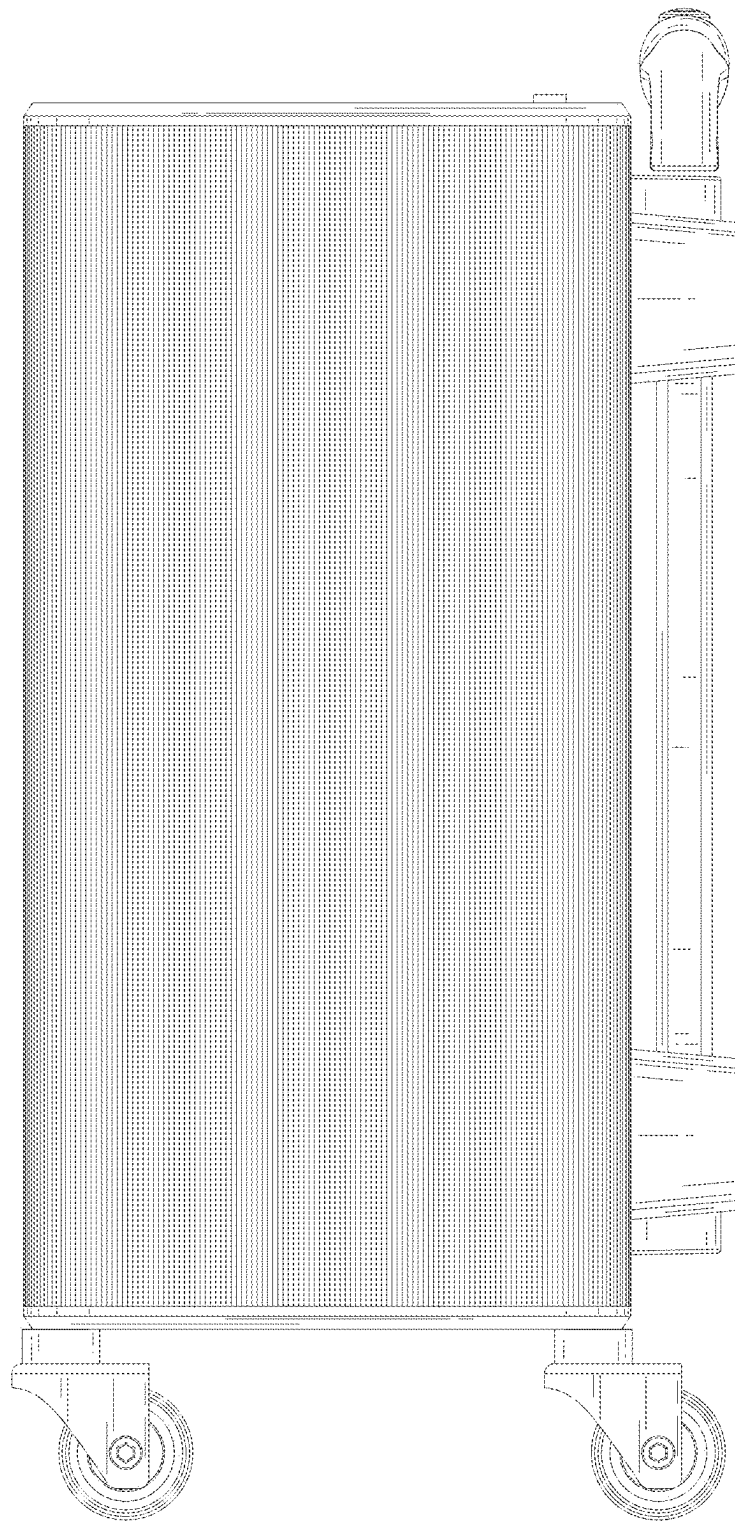


FIG. 6

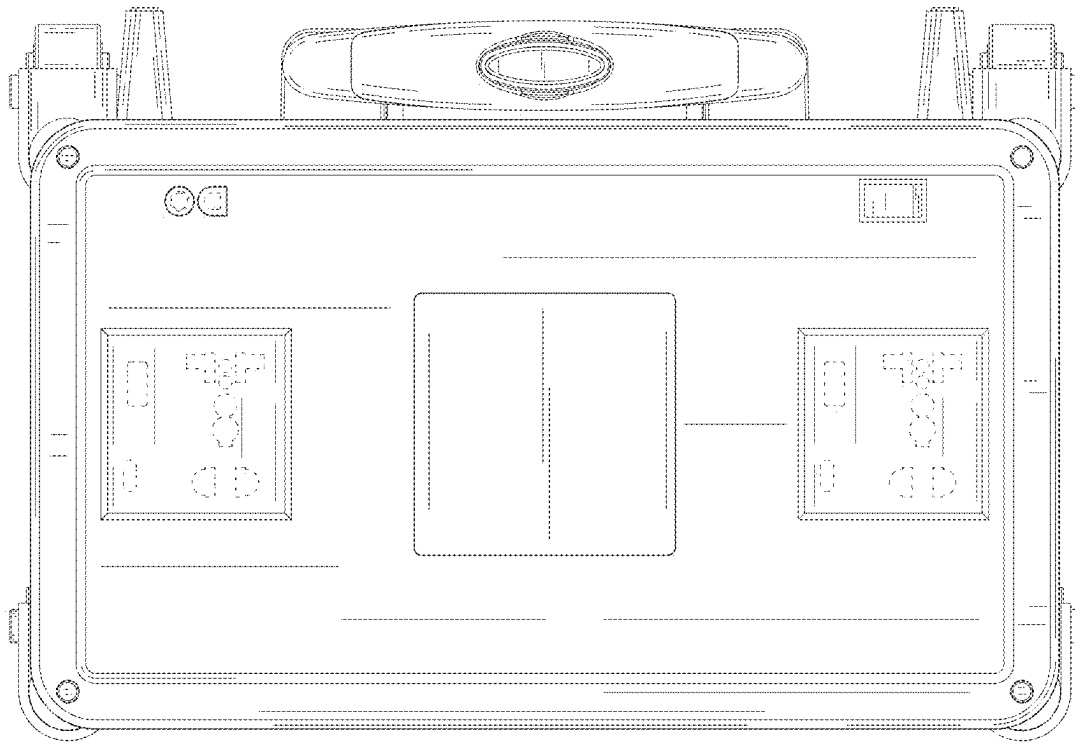


FIG. 7

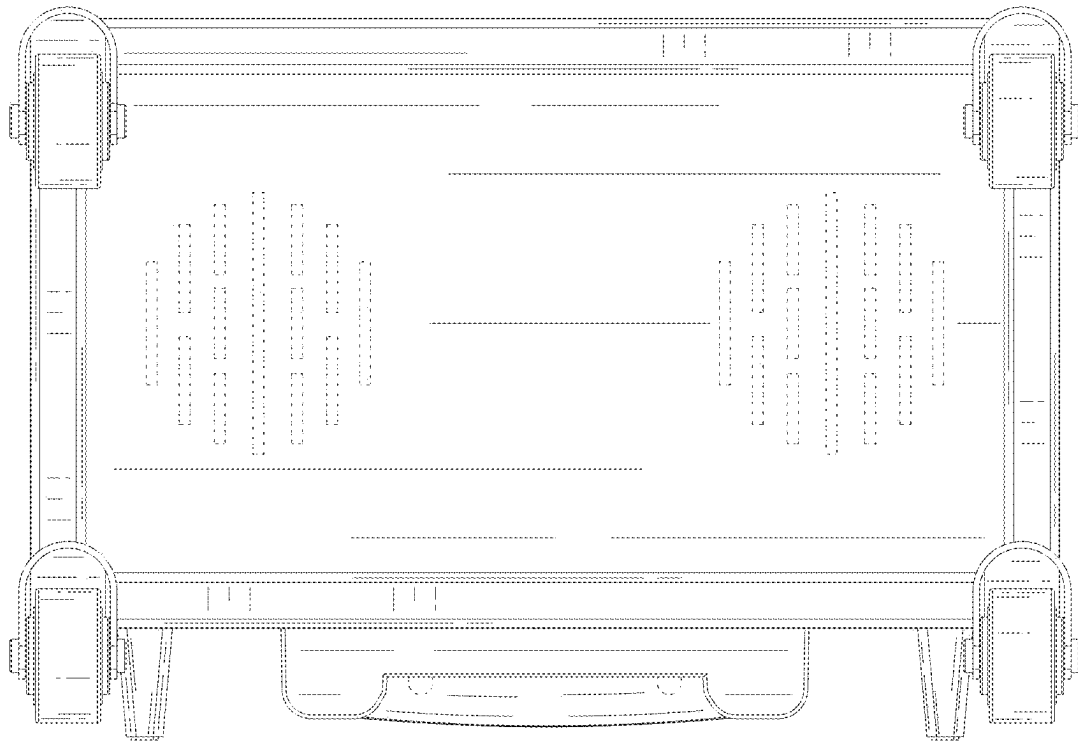


FIG. 8

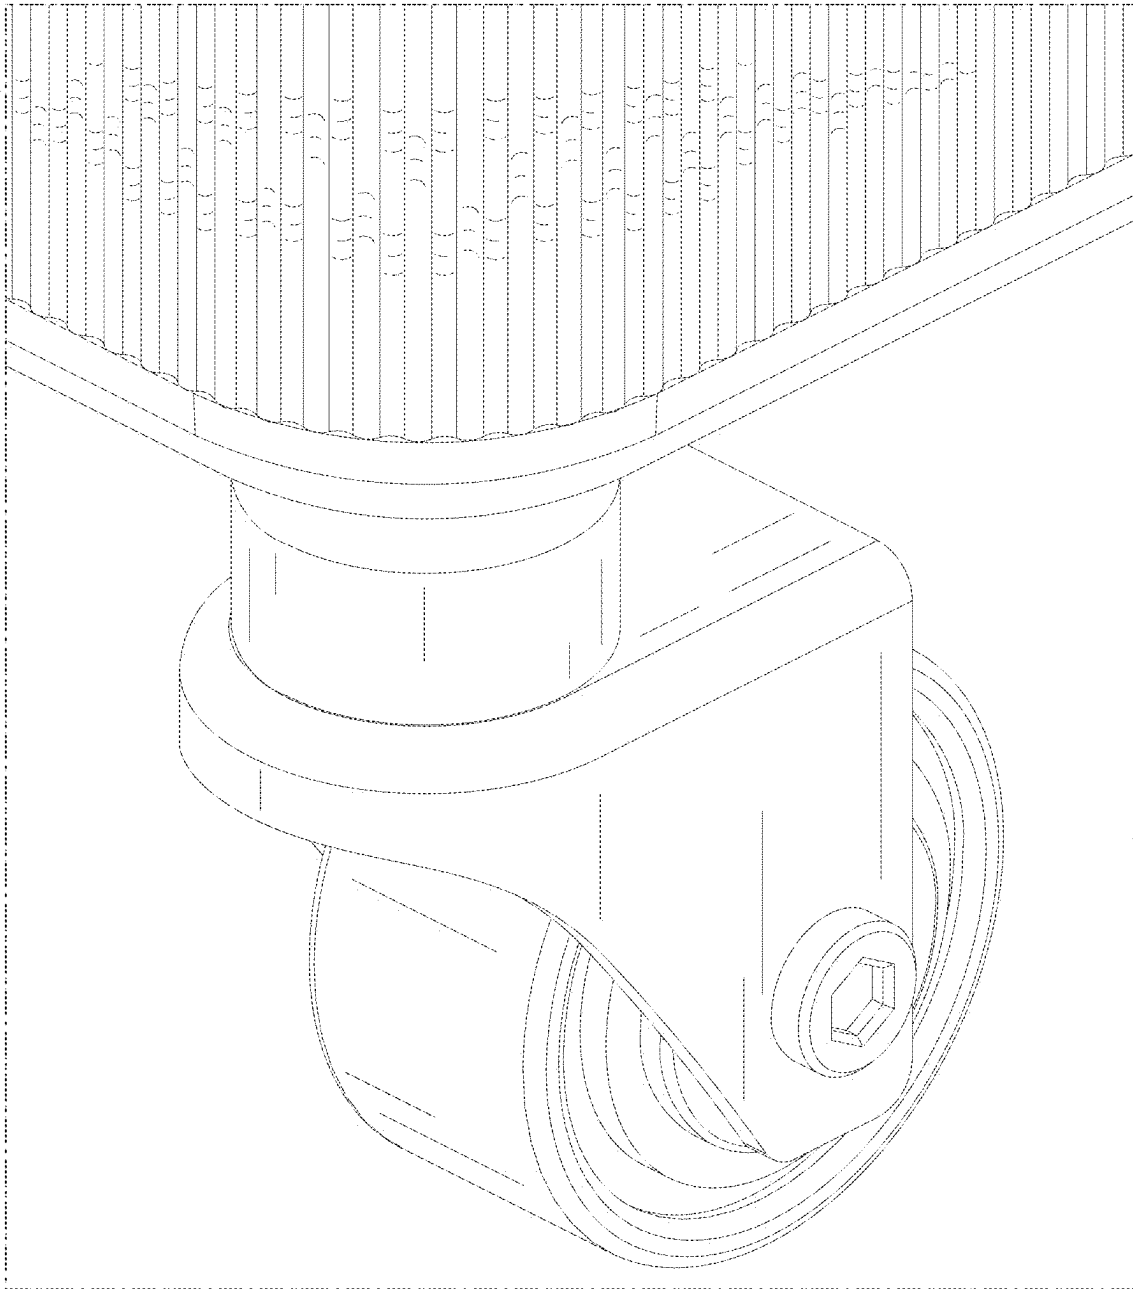


FIG. 9