ET-2200 Series Ethernet I/O Modules User Manual

Ethernet I/O Module   Ver. 1.3.0, Jun. 2018

WARRANTY

WARNING

COPYRIGHT

TRADEMARK

CONTACT US

If you have any questions, please feel free to contact us via email at:
service@icpdas.com, service.icpdas@gmail.com

### SUPPORT

This manual relates to the following modules:
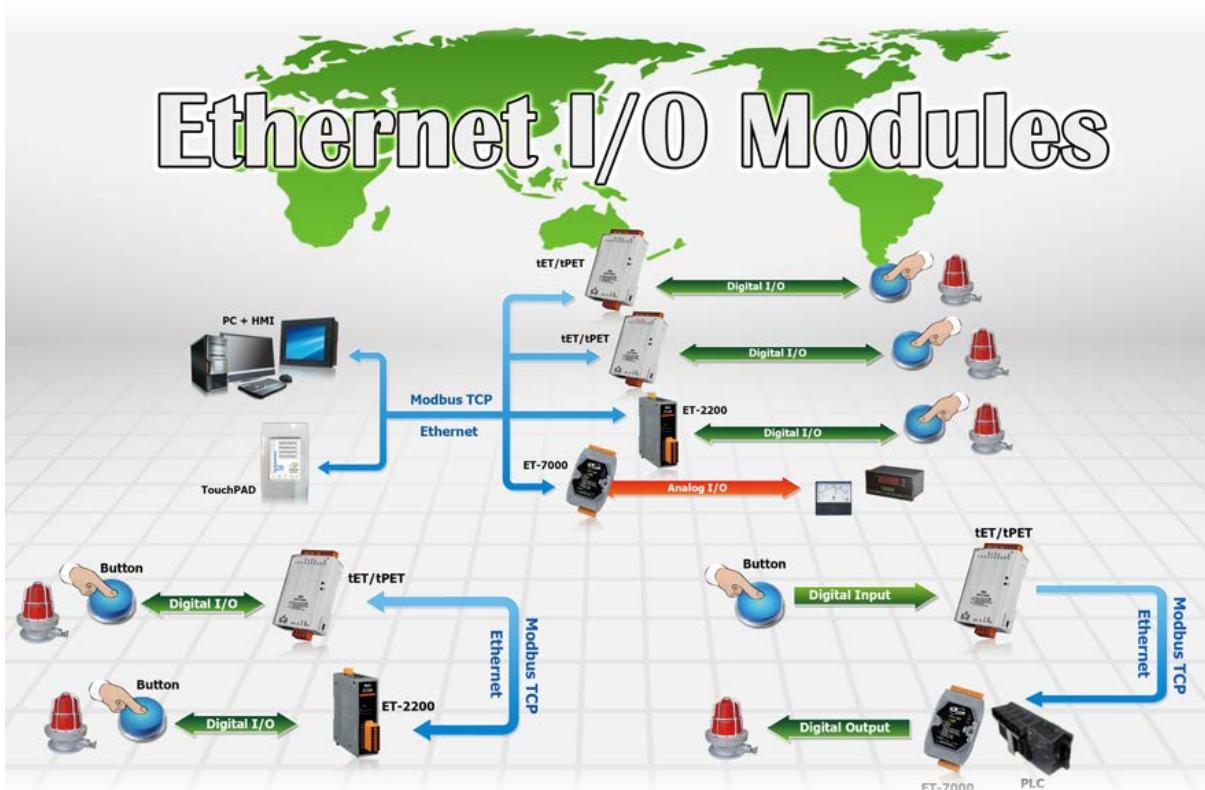
ET-2242, ET-2242U, ET-2251, ET-2254, ET-2254P, ET-2255, ET-2255U, ET-2260, ET-2261, ET-2261-16 and ET-2268

TABLE OF CONTENTS

1. Introduction

The ET-2200 series modules, a IP-based Ethernet I/O module, features a built-in web server which allows configuration, I/O monitoring and I/O control by simply using a regular web browser. In addition, the ET-2200 also supports Modbus TCP/UDP protocol that makes perfect integration to SCADA software.

1.1 Packing List

The shipping package includes the following items:

ET-2200 Module x 1   Quick Start x 1
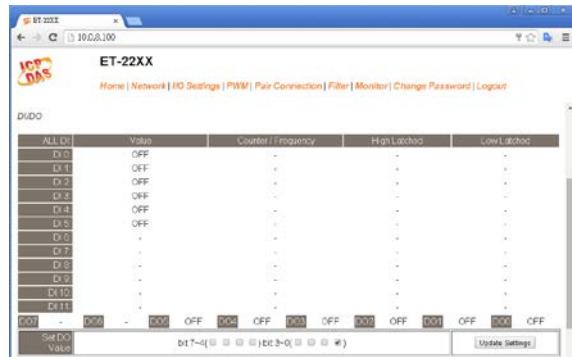
⚠ Note:

If any of these items are missing or damaged, please contact the local distributor for more information. Save the shipping materials and cartons in case you need to ship the module in the future.

1.2 Features

1. Built-in Web Server

The ET-2200 series module has a built-in web server that allows users to easily configure, monitor and control the module from a remote location using a web browser.
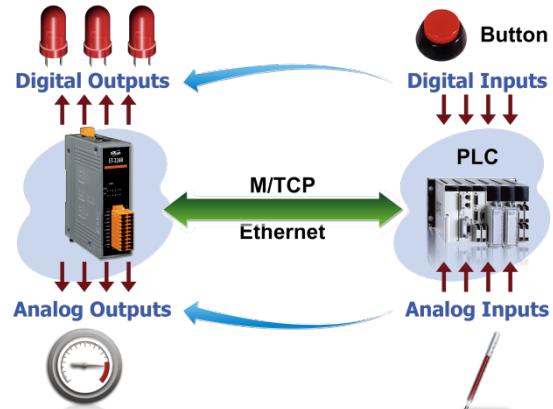
2. Support Modbus TCP/UDP Protocols

The Modbus TCP, Modbus UDP slave function on the Ethernet port can be used to provide data to remote SCADA software.

3. I/O Pair Connection (Push and Polling)

This function is used to create a DI to DO pair through the Ethernet. Once the configuration is completed, ET-2200 module can continuously poll the status of remote DI device using the Modbus TCP protocol and then write to local DO channels in the background.

4. Slim-Type Housing
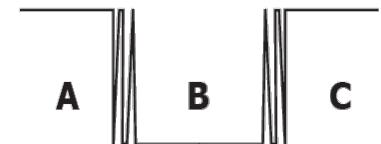
The ET-2200 modules are slim-type housing with about 3.3 cm in width. Compared with the palm-size module that has about 7 cm in width, more slim-type ET-2200 modules can be installed on the same DIN-Rail space.

5. Built-in Multi-function I/O

➢ All **Digital Output** modules provide:
- A **Power-on Value** (On boot up, the digital output value is set as the Power-on value)
- A **Safe Value** (If Modbus TCP communication is lost for a certain period, the digital output value will be set as the user-defined safe value)
- A **PWM Function**: The digital output channels support PWM (pulse generation) function that can be configured with different frequency (100 Hz Max.) and different duty cycle for each channel. The term "High Duty Cycle" describes the duration of 'on' time in proportion to the regular interval or 'period' of time. Similarly, the term "Low Duty Cycle" corresponds to the duration of the 'off' time. Consequently, it is not necessary to keep switching from ON to OFF from a remote controller. In this way, the ET-2200 series module reduces the complexity required for the control system and enhances timing accuracy. ⚠️ *Note: Because of the characteristics of the relay functions, it is recommended that the PWM on modules with relay functions is not used for extended periods of time.*

➢ All **Digital Input** modules provide:
- **Digital input channels that can also be used as 32-bit high speed (3 kHz) counters.**
- **High/Low Latched Status Commands:** The modules provide commands to read the status of any digital input channels that are latched high or latched low. The following is an example that shows the usefulness of the latched digital input. If we wish to read a key stroke from a key switch connected to the digital input channel of a module, the input signal of the key stroke is a pulse signal as shown in the figure.
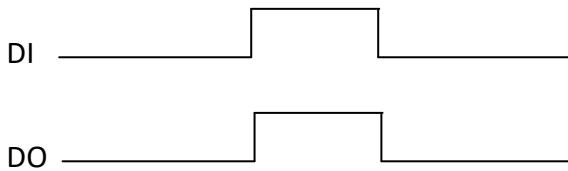
  If we just use the read digital input status command to read the signal and we cannot send the command during the B period due to some reasons, then we will lose the key stroke information. However, with the read latched digital input command, we can still get the key stroke information even we are not able to send command in B period.
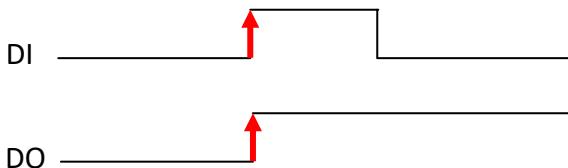
- **Frequency Measurement**: ET-2200 series modules also provide a frequency measurement function that retrieves the digital input counter value at specific times and calculates the frequency. Rather than polling via a remote host, the ET-2200 series modules can determine the frequency directly, reducing the communication delay caused by two ends and also improves the accuracy of the frequency measurement. In order to applying for more applications, this module provides 3 scan modes and 4 moving average methods for user to select the best way in their applications.

➢ **DIO Synchronization(Mirror Local DI to DO)**: ET-2200 series modules also provide a DIO synchronization function. The DIO synchronization is divided into three modes: **Level Sync**, **Rising Active** and **Falling Active**.
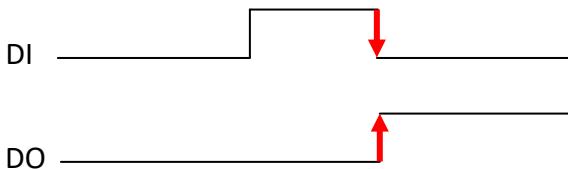
- **Level Sync (DO = DI)** Mode: The synchronization operation in DI and DO.

DI

DO

- **Rising Active (DO = ON)** Mode: When the specified DI state from OFF to ON, the corresponding DO will be set to ON.

DI

DO

- **Falling Active (DO = ON)** Mode: When the specified DI state from ON to OFF, the corresponding DO will be set to ON.

DI

DO

6. Built-in Dual Watchdog
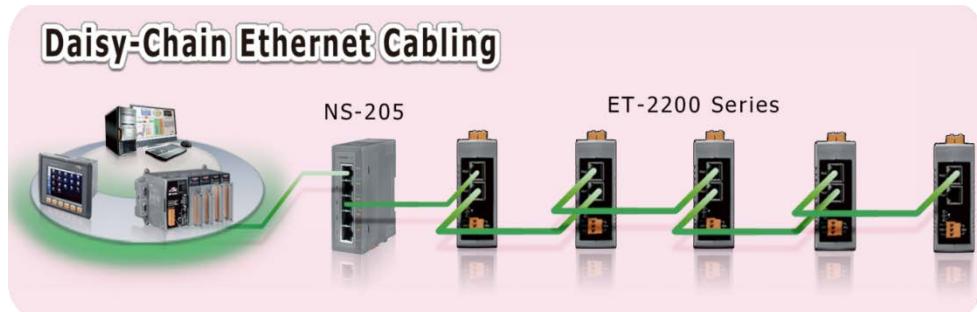
The Dual Watchdog consists of a CPU Watchdog (for hardware functions) and a Host Watchdog (for software functions).

➢ **CPU Watchdog** automatically resets it-self when the built-in firmware runs abnormally.

➢ **Host Watchdog** set the digital output with predefined safe-value when there is no communication between the module and host (PC or PLC) over a period of time (Watchdog timeout).

7. Daisy-chain Ethernet Cabling

The ET-2200 has a built-in two-port Ethernet switch to implement daisy-chain topology. The cabling is much easier and total costs of cable and switch are significantly reduced.

8. LAN Bypass

LAN Bypass feature guarantees the Ethernet communication. It will automatically active to continue the network traffic when the ET-2200 loses its power.

9. Highly Reliable Under Harsh Environment

- Wide Operating Temperature Range: -25 ~ +75°C
- Storage Temperature: -30 ~ +80°C
- Humidity 10 ~ 90% RH (Non-condensing)
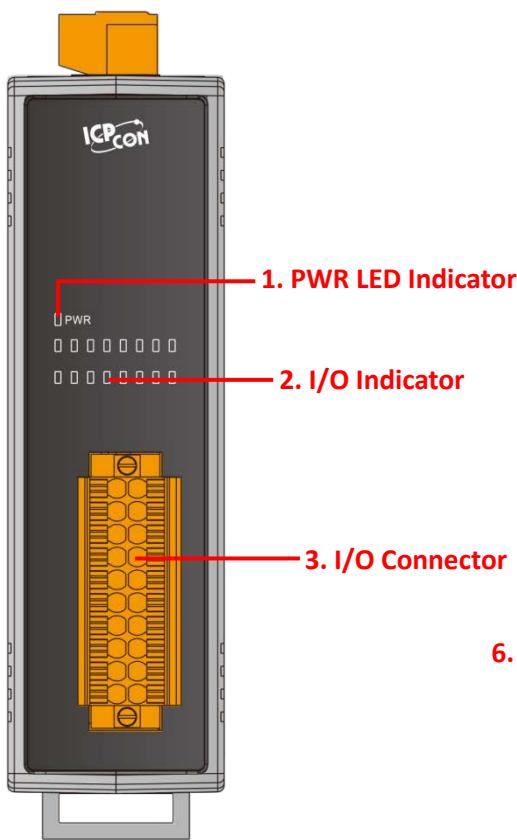
2. Hardware Information
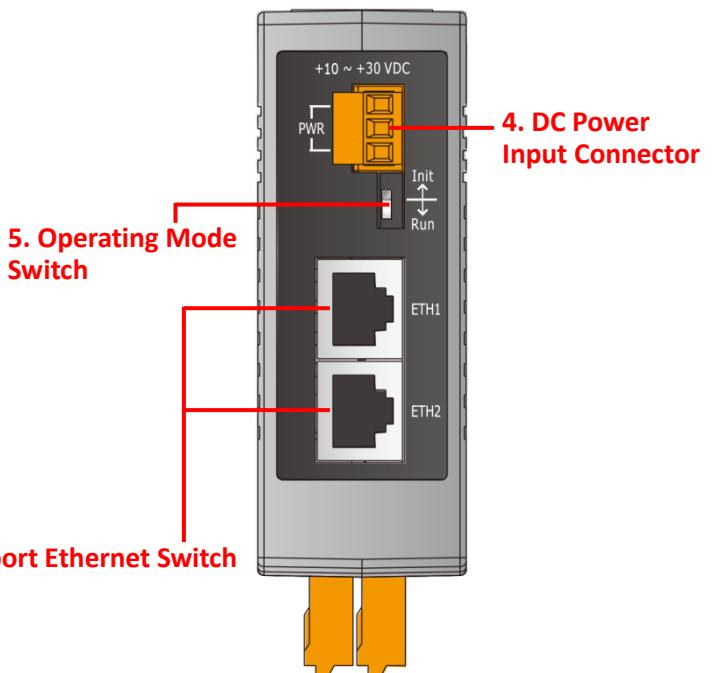
2.1 Appearance

The front panel and top panel of the ET-2200 module contain the I/O connector, LEDs, Ethernet Port and power connector.

Front Panel

Top Panel

1. PWR LED Indicator

2. I/O Indicator

3. I/O Connector

4. DC Power Input Connector

5. Operating Mode Switch

6. 2-port Ethernet Switch

1.	PWR LED Indicator

Once power is supplied to the ET-2200 series module, the system LED indicator will illuminate.

2.	I/O Indicator

The exact design and functionality depends on the module type which indicates the I/O status.

3.   I/O Connector

For more detailed information regarding the pin assignments for the I/O connector, refer to Section 2.3 "Pin Assignments".

4.   DC Power Input Connector

The definition for **"+Vs"** and **"GND"** for use as the power supply applies to all types of ET-2200 series module.

- ET-2242/2251/2254(P)/2255/2260/2261/2268:
  The valid power voltage range is from **+10 to +30 V$_{DC}$**.
- ET-2242U/2255U/2261-16:
  The valid power voltage range is from **+10 to +48 V$_{DC}$**.

The definition for **"F.G." (Frame Ground)**:

Electronic circuits are constantly vulnerable to Electrostatic Discharge (ESD), which becomes worse in a continental climate area. ET-2200 series module feature a new design for the frame ground, which provides a path that bypasses ESD, resulting in an enhanced ESD protection capability and ensuring that the module is more reliable.

5.   Operating Mode Switch

Init Mode: Use factory default settings for troubleshooting.

Run Mode: Use customer settings for normal operations.

The operating mode switch is set to the **"Run"** position by default. Refer to Section 3.1 "Configuring the Boot Mode" for more information.

6.   2-Port Ethernet Switch

The ET-2200 series modules are equipped with two RJ-45 10/100 Base-TX Ethernet switch ports. When an Ethernet link is detected and an Ethernet packet is received, the **Green LED** indicator and the **Yellow LED** indicator will be illuminated.

2.2 Specification

2.2.1 System Specification

Model	ET-2242	ET-2251	ET-2254(P)	ET-2255	ET-2260	ET-2261	ET-2268	ET-2261-16	ET-2242U	ET-2255U
System										
CPU	32-bit ARM									
Communication										
Ethernet Port	2 x RJ-45, 10/100 Base-Tx, switch Ports									
Protocol	Modbus TCP, Modbus UDP									
Security	Password and IP Filter									
I/O Pair Connection	Yes (Push, Polling)									
Dual Watchdog	Yes, Module, Communication (Configurable)									
LAN Bypass	Yes									
LED Indicators										
System Running	Yes									
Ethernet Link/Act	Yes									
DI/DO status	Yes									
2-Way Isolation										
Ethernet (Units: V_{DC})	1500									
I/O (Units: V_{DC})	3000	3750	3000	3750	3750	3000	3750	3000		3750
EMS Protection										
ESD (IEC 61000-4-2)	±8 kV Contact for Each Terminal and ±16 kV Air for Random Point								±8 kV Contact for Each Terminal and ±15 kV Air for Random Point	
EFT (IEC 61000-4-4)	±4 kV for Power Line									
Surge (IEC 61000-4-5)	±3 kV for Power Line								±2 kV for Power Line	
Power										
Reverse Polarity Protection	Yes									
Powered from Terminal Block	+10 ~ +30 V_{DC}								+10 ~ +48 V_{DC}	
Consumption — 24 V_{DC}	3.2 W (Max.)	2.9 W (Max.)	3.3 W (Max.)	2.9 W (Max.)	3.3 W (Max.)	3.3 W (Max.)	2.9 W (Max.)	4.32 W (Max.)	2.3 W (Max.)	2.3 W (Max.)
Consumption — 48 V_{DC}	-	-	-	-	-	-	-	4.71 W (Max.)	2.6 W (Max.)	2.7 W (Max.)
Mechanical										
Dimensions (L x W x H)	127 mm x 33 mm x 99 mm for ET-2242(U)/2251/2254(P)/2255(U)/2260/2261/2268 157 mm x 31 mm x 129 mm for only ET-2261-16									
Installation	DIN-Rail Mounting									
Environment										
Operating Temperature	-25 ~ +75°C									
Storage Temperature	-30 ~ +80°C									
Humidity	10 ~ 90% RH, Non-condensing									

2.2.2 I/O Specification

ET-2242/ET-2242U

Model	ET-2242	ET-2242U
Digital Output		
Channels	16	
Type	Open collector	Push-Pull
Sink/Source (NPN/PNP)	Sink	Sink/Source
Load Voltage	+3.5 V ~ +50 V	+3.5 V ~ +80 V
Max. Load Current	650 mA/Channel	500 mA/Channel
Overload Protection	1.4 A (with short-circuit protection)	-
Overvoltage Protection	+60 V_{DC}	-

ET-2251

Model		ET-2251
Digital Input/Counter		
Channels		16
Contact		Wet Contact
Sink/Source (NPN/PNP)		Sink/Source
On Voltage Level		+5 V_{DC} ~ +50 V_{DC}
Off Voltage Level		+1 V_{DC} Max.
Input Impedance		7.5kΩ
Counters	Max. Count	4,294,967,295 (32 bits)
	Max. Input Frequency	3 kHz
	Programmable Digital Filter	1 ~ 6500 ms (0.08 Hz ~ 500 Hz)
Overvoltage Protection		+70 V_{DC}

ET-2254/2254P

Model		ET-2254	ET-2254P
I/O Type		By Wire Connection, Configurable Universal DIO	
I/O Channels		16	
Digital Input			
Type		Dry Contact	
Sink/Source (NPN/PNP)		Source	
On Voltage Level		Close to GND	
Off Voltage Level		Open	
Input Impedance		3kΩ, 0.5 W	7.5kΩ, 1 W
Counters	Max. Count	4,294,967,295 (32 bits)	
	Max. Input Frequency	3 kHz	2.5 kHz
	Programmable Digital Filter	1 ~ 6500 ms (0.08 Hz ~ 500 Hz)	
Digital Output			
Type		Open-collector (Sink)	
Max. Load Current		100 mA/channel	400 mA/channel
Load Voltage		+5 V_{DC} to +30 V_{DC}	+5 V_{DC} to +50 V_{DC}
Short Circuit Protection		-	Yes
Power-on Value		Yes, Configurable	
Safe Value		Yes, Configurable	

ET-2255/ET-2255U

Model		ET-2255	ET-2255U
Digital Input/Counter			
Channels		8	
Contact		Wet Contact	
Sink/Source (NPN/PNP)		Sink/Source	
On Voltage Level		+5 V_{DC} ~ +50 V_{DC}	
Off Voltage Level		+1 V_{DC} Max.	
Input Impedance		7.5kΩ	
Counters	Max. Count	4,294,967,295 (32 bits)	
	Max. Input Frequency	3 kHz	
	Programmable Digital Filter	1 ~ 6500 ms (0.08 Hz ~ 500 Hz)	
Overvoltage Protection		+70 V_{DC}	
Digital Output			
Channels		8	
Type		Open Collector	Push-Pull
Sink/Source (NPN/PNP)		Sink	Sink/Source
Load Voltage		+3.5 V ~ +50 V	+3.5 V ~ +80 V
Max. Load Current		650 mA/Channel	500 mA/Channel
Overload Protection		1.4 A (with short-circuit protection)	-
Overvoltage Protection		+60 V_{DC}	-

ET-2260

Model	ET-2260
Digital Input/Counter	
Channels	6
Contact	Wet Contact
Sink/Source (NPN/PNP)	Sink/Source
On Voltage Level	+5 V_{DC} ~ +50 V_{DC}
Off Voltage Level	+3.5 V_{DC} Max.
Input Impedance	7.5kΩ
Counters — Max. Count	4,294,967,295 (32 bits)
Counters — Max. Input Frequency	3 kHz
Counters — Programmable Digital Filter	1 ~ 6500 ms (0.08 Hz ~ 500 Hz)
Overvoltage Protection	+70 V_{DC}
Power Relay	
Channels	6
Type	Power Relay, Form A (SPST N.O.)
Contact Rating	5 A @ 250 V_{AC}/24 V_{DC}(Resistive Load)
Min. Contact Load	10 mA @ 5 V
Operate Time	10 ms (max.)
Release Time	5 ms (max.)
Mechanical Endurance	2 × 10^7 ops.
Electrical Endurance	10^5 ops.
Power-on Value	Yes, Configurable
Safe Value	Yes, Configurable

ET-2261/2261-16
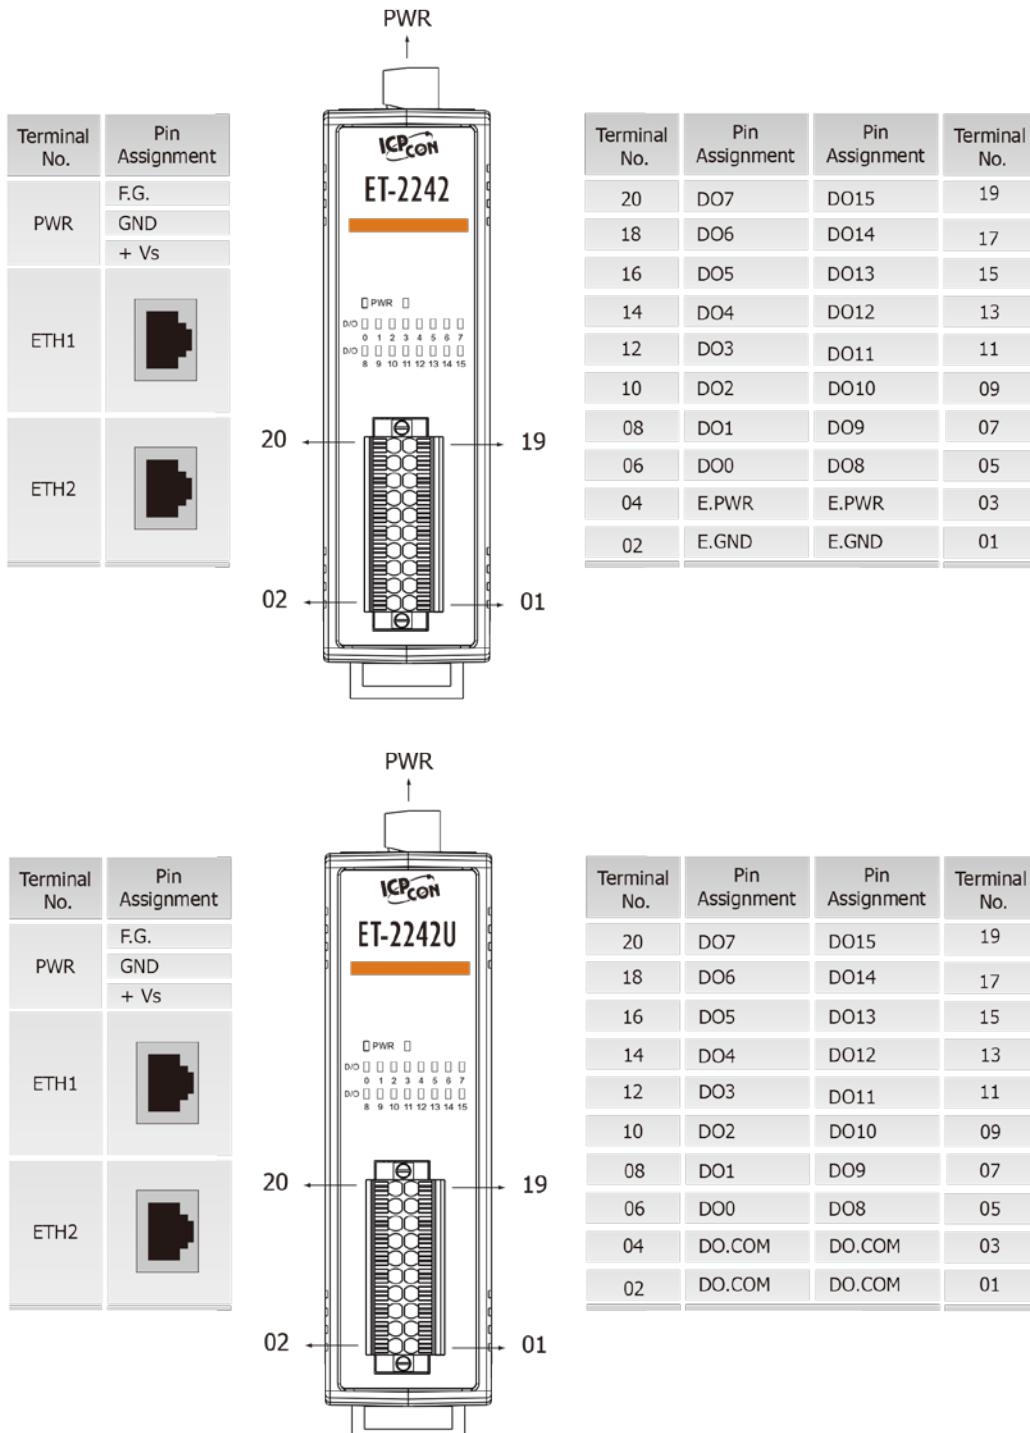
Model	ET-2261	ET-2261-16
Power Relay		
Channels	10	16
Type	Power Relay, Form A (SPST N.O.)	
Contact Rating	5 A @ 250 V_{AC}/24 V_{DC}(Resistive Load)	
Min. Contact Load	10 mA @ 5 V	
Operate Time	10 ms (max.)	
Release Time	5 ms (max.)	
Mechanical Endurance	2×10^7 ops.	
Electrical Endurance	10^5 ops.	
Power-on Value	Yes, Configurable	
Safe Value	Yes, Configurable	

ET-2268
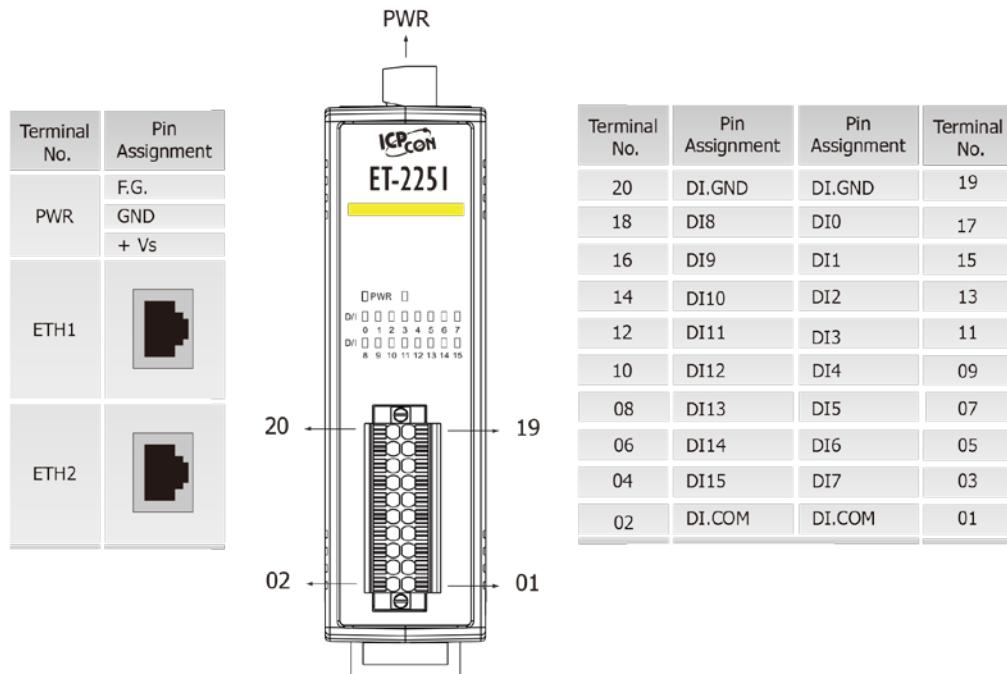
Model	ET-2268
Relay Output	
Channels	8 (Form A x 4, Form C x 4)
Relay Type	Signal Relay

Form A	Contact Rating	2 A @ 30 V_{DC} 0.24 A @ 220 V_{DC} 0.25 A @ 250 V_{DC}
	Min. Contact Load	10 mA @ 20 mV
	Contact Material	Siler Nickel, Gold-covered
	Operate Time	3 ms (Typical)
	Release Time	4ms (Typical)
	Mechanical Endurance	10^8 ops
	Electrical Endurance	2 x 10^5 ops
Form C	Contact Rating	2 A @ 30 V_{DC} 0.24 A @ 220 V_{DC} 0.25 A @ 250 V_{DC}
	Min. Contact Load	10 mA @ 20 mV
	Contact Material	Siler Nickel, Gold-covered
	Operate Time	3 ms (Typical)
	Release Time	4ms (Typical)
	Mechanical Endurance	10^8 ops
	Electrical Endurance	2 x 10^5 ops
Surge Strength		2000 V_{DC}
Power-on Value		Yes, Configurable
Safe Value		Yes, Configurable

2.3 Pin Assignments

ET-2242/ET-2242U

Terminal No.	Pin Assignment
PWR	F.G.
	GND
	+ Vs
ETH1	
ETH2	

Terminal No.	Pin Assignment	Pin Assignment	Terminal No.
20	DO7	DO15	19
18	DO6	DO14	17
16	DO5	DO13	15
14	DO4	DO12	13
12	DO3	DO11	11
10	DO2	DO10	09
08	DO1	DO9	07
06	DO0	DO8	05
04	E.PWR	E.PWR	03
02	E.GND	E.GND	01

Terminal No.	Pin Assignment
PWR	F.G.
	GND
	+ Vs
ETH1	
ETH2	

Terminal No.	Pin Assignment	Pin Assignment	Terminal No.
20	DO7	DO15	19
18	DO6	DO14	17
16	DO5	DO13	15
14	DO4	DO12	13
12	DO3	DO11	11
10	DO2	DO10	09
08	DO1	DO9	07
06	DO0	DO8	05
04	DO.COM	DO.COM	03
02	DO.COM	DO.COM	01

ET-2251

Terminal No.	Pin Assignment
PWR	F.G.
	GND
	+ Vs
ETH1	
ETH2	

Terminal No.	Pin Assignment	Pin Assignment	Terminal No.
20	DI.GND	DI.GND	19
18	DI8	DI0	17
16	DI9	DI1	15
14	DI10	DI2	13
12	DI11	DI3	11
10	DI12	DI4	09
08	DI13	DI5	07
06	DI14	DI6	05
04	DI15	DI7	03
02	DI.COM	DI.COM	01

ET-2254/2254P

Terminal No.	Pin Assignment
PWR	F.G.
	GND
	+ Vs
ETH1	
ETH2	

Terminal No.	Pin Assignment	Pin Assignment	Terminal No.
01	DIO0	DIO8	02
03	DIO1	DIO9	04
05	DIO2	DIO10	06
07	DIO3	DIO11	08
09	DIO4	DIO12	10
11	DIO5	DIO13	12
13	DIO6	DIO14	14
15	DIO7	DIO15	16
17	EXT.PWR	EXT.PWR	18
19	EXT.GND	EXT.GND	20

ET-2255/ET-2255U

Terminal No.	Pin Assignment
PWR	F.G.
	GND
	+ Vs
ETH1	
ETH2	

Terminal No.	Pin Assignment	Pin Assignment	Terminal No.
20	E.GND	DI.GND	19
18	DO0	DI0	17
16	DO1	DI1	15
14	DO2	DI2	13
12	DO3	DI3	11
10	DO4	DI4	09
08	DO5	DI5	07
06	DO6	DI6	05
04	DO7	DI7	03
02	E.PWR	DI.COM	01

Terminal No.	Pin Assignment
PWR	F.G.
	GND
	+ Vs
ETH1	
ETH2	

Terminal No.	Pin Assignment	Pin Assignment	Terminal No.
20	N/A	DI.GND	19
18	DO0	DI0	17
16	DO1	DI1	15
14	DO2	DI2	13
12	DO3	DI3	11
10	DO4	DI4	09
08	DO5	DI5	07
06	DO6	DI6	05
04	DO7	DI7	03
02	DO.COM	DI.COM	01

ET-2260

Terminal No.	Pin Assignment
PWR	F.G.
	GND
	+ Vs
ETH1	
ETH2	

Terminal No.	Pin Assignment	Pin Assignment	Terminal No.
01	NO0	GND	02
03	COM0	DI0	04
05	NO1	DI1	06
07	COM1	DI2	08
09	NO2	DI3	10
11	COM2	DI4	12
13	NO3	DI5	14
15	COM3	DICOM	16
17	NO4	NO5	18
19	COM4	COM5	20

ET-2261

Terminal No.	Pin Assignment
PWR	F.G.
	GND
	+ Vs
ETH1	
ETH2	

Terminal No.	Pin Assignment	Pin Assignment	Terminal No.
01	NO0	NO5	02
03	COM0	COM5	04
05	NO1	NO6	06
07	COM1	COM6	08
09	NO2	NO7	10
11	COM2	COM7	12
13	NO3	NO8	14
15	COM3	COM8	16
17	NO4	NO9	18
19	COM4	COM9	20

ET-2261-16

Terminal No.	Pin Assignment
PWR	F.G.
	GND
	+ Vs
ETH1	
ETH2	

Terminal No.	Pin Assignment	Pin Assignment	Terminal No.
01	NO0	COM0	19
02	NO1	COM1	20
03	NO2	COM2	21
04	NO3	COM3	22
05	NO4	COM4	23
06	NO5	COM5	24
07	NO6	COM6	25
08	NO7	COM7	26
09	N/A	N/A	27
10	N/A	N/A	28
11	NO8	COM8	29
12	NO9	COM9	30
13	NO10	COM10	31
14	NO11	COM11	32
15	NO12	COM12	33
16	NO13	COM13	34
17	NO14	COM14	35
18	NO15	COM15	36

ET-2268

Terminal No.	Pin Assignment
PWR	F.G.
	GND
	+ Vs
ETH1	
ETH2	

| Terminal No.	Pin Assignment	Pin Assignment	Terminal No.
01	NO0	NO4	02
03	COM0	COM4	04
05	NC0	NC4	06
07	NO1	NO5	08
09	COM1	COM5	10
11	NO2	NO6	12
13	COM2	COM6	14
15	NC2	NC6	16
17	NO3	NO7	18
19	COM3	COM7	20

2.4 Wiring Connections

Input Wiring

➢   Input Wiring for the **ET-2251/2255/2255U/2260**:

Model	Digital Input/ Counter	Readback as 1	Readback as 0
ET-2251 ET-2255 ET-2255U ET-2260	Dry Contact	Close to GND	Open
ET-2260	Sink	+10 ~ +50 VDC	OPEN or <4 VDC
	Source	+10 ~ +50 VDC	OPEN or <4 VDC
ET-2251 ET-2255 ET-2255U	Sink	+5 ~ +50 VDC	OPEN or <1 VDC
	Source	+5 ~ +50 VDC	OPEN or <1 VDC

➢ Input Wiring for the **ET-2254/2254P**:

Model	Input Type	ON State LED ON Readback as 1	OFF State LED OFF Readback as 0
		Close to GND	Open
ET-2254 ET-2254P	Dry Contact		

Output Wiring

➢ Output Wiring for **ET-2242/2254/2254P/2255**:

Model	Output Type	ON State Readback as 1	OFF State Readback as 0
ET-2242 ET-2254 ET-2254P ET-2255	Drive Relay		
	Resistance Load		

➢ Output Wiring for **ET-2242U/2255U**:

Model	Output Type	ON State Readback as 1	OFF State Readback as 0
ET-2242U ET-2255U	Sink		
	Source		

➢ Output Wiring for **ET-2260/2261/2261-16**:

Model	Power Relay	ON State Readback as 1	
ET-2260 ET-2261 ET-2261-16	Relay Output		
		OFF State Readback as 0	

➢ Output Wiring for **ET-2268**:
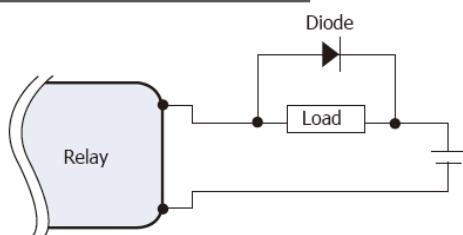
Model	Relay Output	ON State Readback as 1	OFF State Readback as 0
ET-2268	Form A Relay in NO1, NO3, NO4, NO7		
	Form C Relay in NO0, NO2, NO4, NO6		
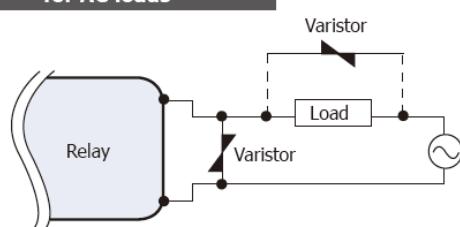
⚠ *Note for the ET-2260/2261/2261-16/2268:*
When inductive loads are connected to the relays, a large counter electromotive force may occur when the relay actuates because of the energy stored in the load. These fly back voltages can severely damage the relay contacts and greatly shorten the relay life. Limit these fly back voltages at your inductive load by installing a flyback diode for DC loads or a metal oxide varistor for AC loads.

for DC loads	for AC loads
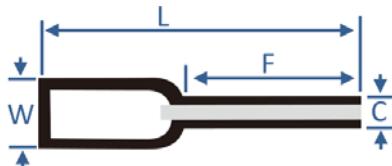
Varistor Selection:

Operating Voltage	Varistor Voltage	Max. Peak Current
100 ~ 120 V_{AC}	240 ~ 270 V_{AC}	> 1000 A
200 ~ 240 V_{AC}	440 ~ 470 V_{AC}	> 1000 A

2.5 Wiring to the Connector
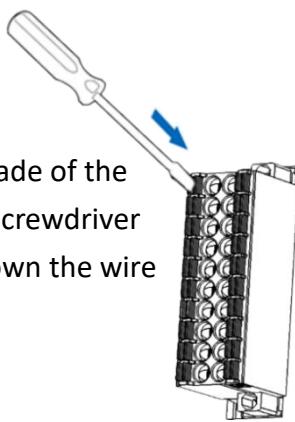
➢ **Insulated Terminals Dimensions:**
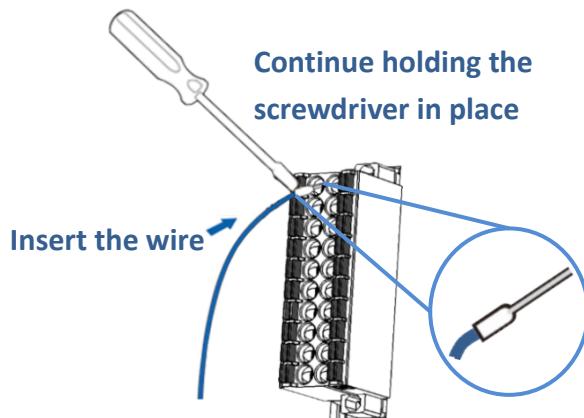
Dimensions (Unit: mm)				
Item NO.	F	L	C	W
CE007512	12.0	18.0	1.2	2.8

➢ **A tip for connecting the wire to the connector**

1. Use the blade of the flat-head screwdriver to push down the wire clamp.
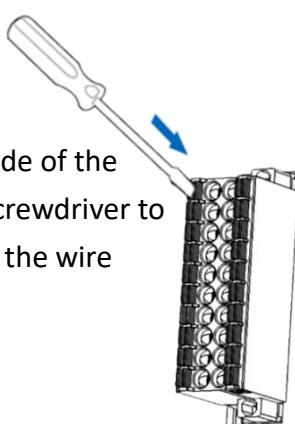
2. While holding the screwdriver in place, insert the wire into the terminal block.

Continue holding the screwdriver in place

Insert the wire
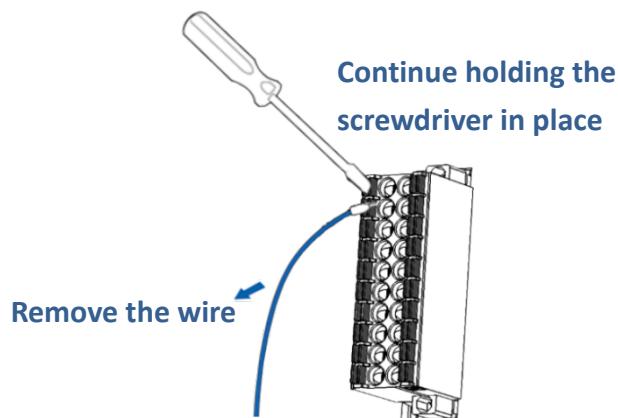
➢ **A tip for removing the wire from the connector**

1. Use the blade of the flat-head screwdriver to push down the wire clamp.
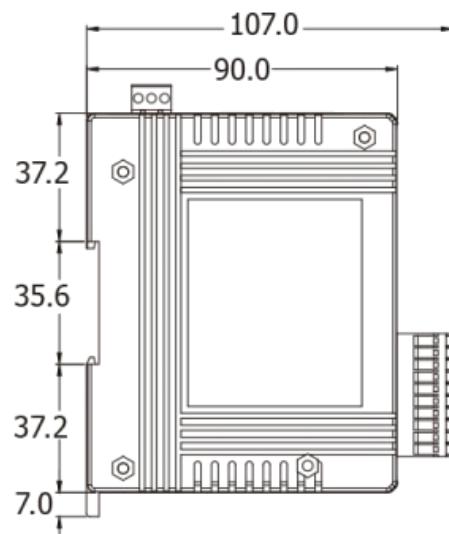
2. While holding the screwdriver in place, remove the wire from the terminal block.

Continue holding the screwdriver in place

Remove the wire
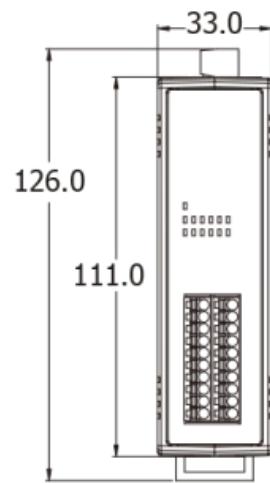
2.6 Dimensions

The following diagrams provide the dimensions of the ET-2200 series module and can be used as a reference when defining the specifications for any custom enclosures. All dimensions are in millimeters.
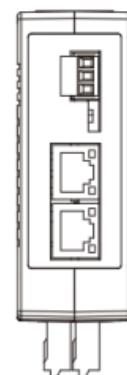
➢ **ET-2242(U)/2251/2254(P)/2255(U)/2260/2261/2268:**
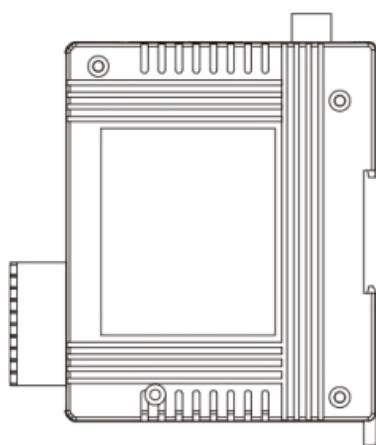
Left Side View	Front View	Top View
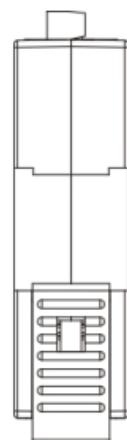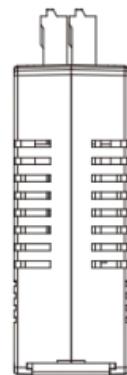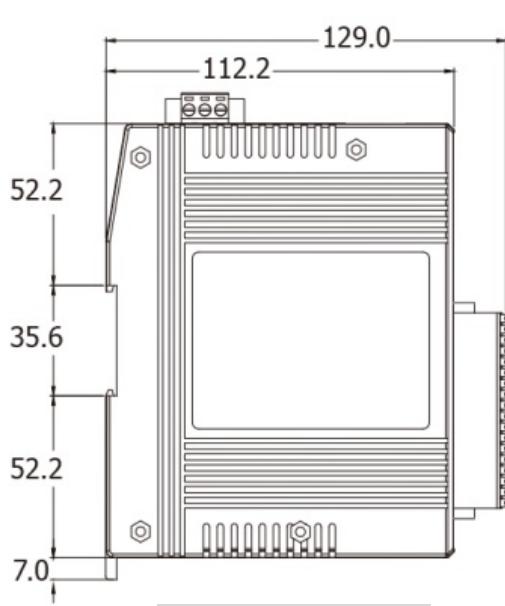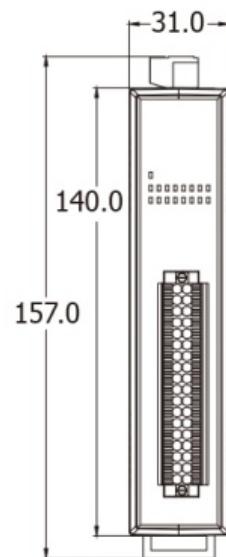
Right Side View	Rear View	Bottom View

➢ **ET-2261-16:**
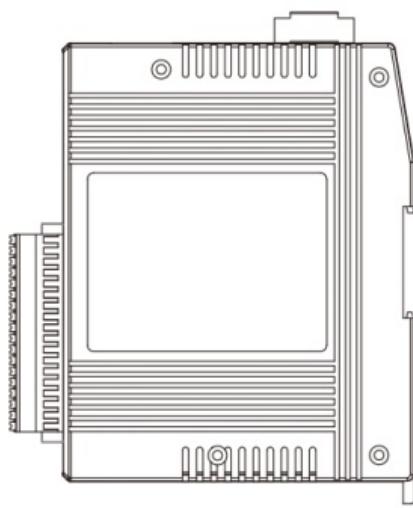
Left Side View

Front View

Top View

Right Side View

Rear View

Bottom View

3. Getting Started

This chapter provides a basic overview of how to configure and operate your ET-2200 series module.

3.1 Configuring the Boot Mode
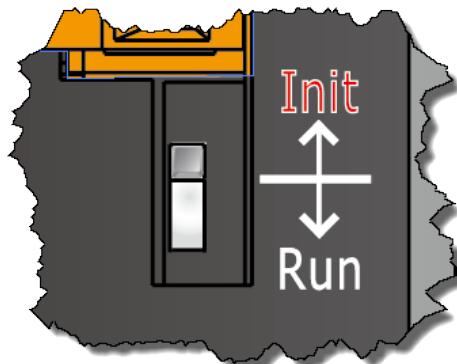
The ET-2200 series modules have two operating modes that can be selected by using the switch mechanism incorporated on the chassis.

⚠️ *Note that the module must be rebooted after changing the operating mode.*

➢ **Init Mode**
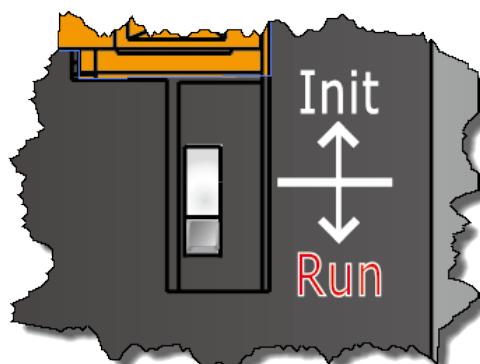
Init Mode should only be selected for troubleshooting.

1. Put the switch in **"Init"** position and then reboot the module to load factory settings.
2. Use eSearch Utility to reconfigure the module's network settings.
3. Put the switch back in **"Run"** position and then reboot the module to work in normal mode.

➢ **Run Mode**

Run Mode is the default operating mode and should be used in most cases.
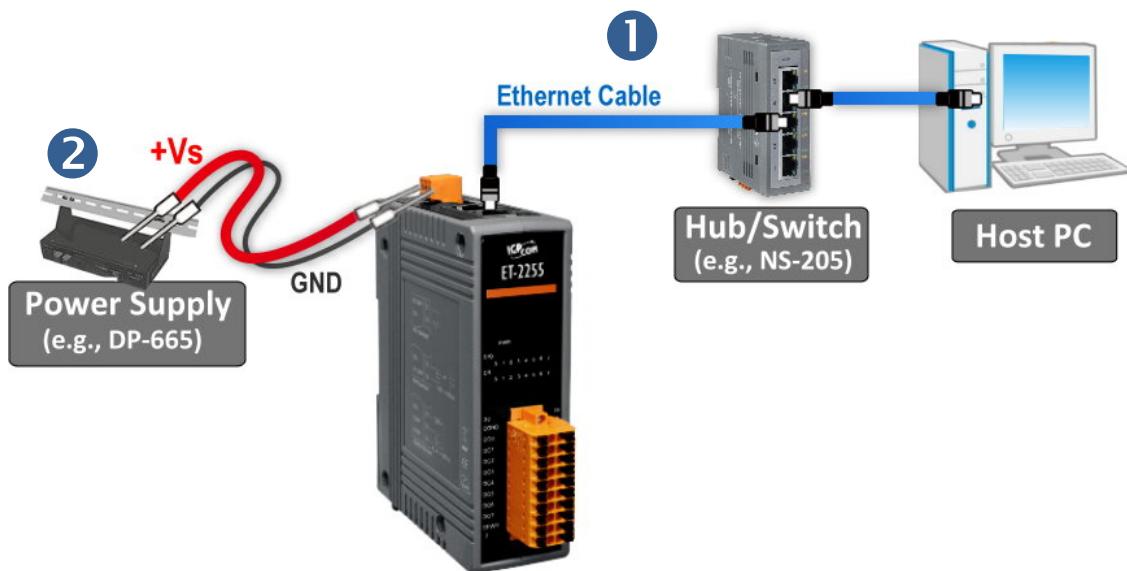
3.2 Connecting the Power and the Host PC

Step 1: Connect both the ET-2200 module and the Host PC to the same sub network or the same Ethernet Switch

Ensure that the network settings on the Host PC have been correctly configured and are functioning normally. Ensure that the Windows firewall or any Anti-Virus firewall is properly configured to allow incoming connections, or temporarily disable these functions, otherwise the **"Search Servers"** function in the eSearch Utility described in Section 3.3"Configuring the Network Settings" the may not perform as expected. Contact the System Administrator for instructions of how to do this.

Step 2: Apply power to the ET-2200. The valid power voltage range depends on the ET-2200 series module.

Step 3: Verify that the "PWR" LED indicator on the ET-2200 module is flashing
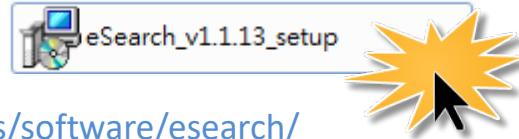
3.3 Configuring the Network Settings

Step 1: Get the eSearch Utility

The eSearch Utility can be obtained from the ICP DAS web site at:

http://ftp.icpdas.com/pub/cd/tinymodules/napdos/software/esearch/
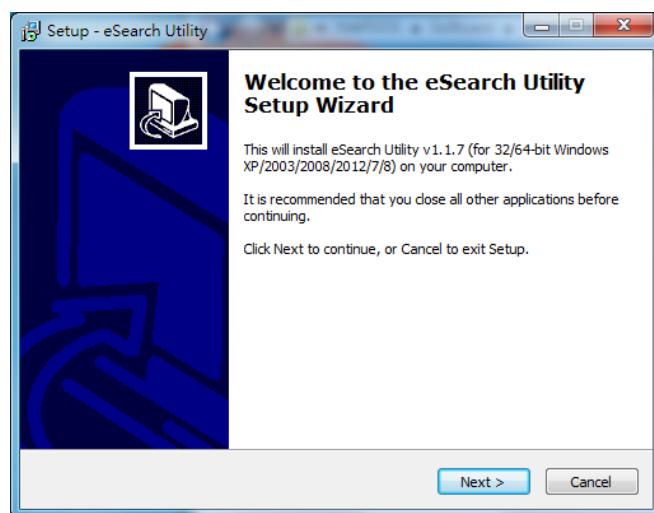
Step 2: Install the eSearch Utility
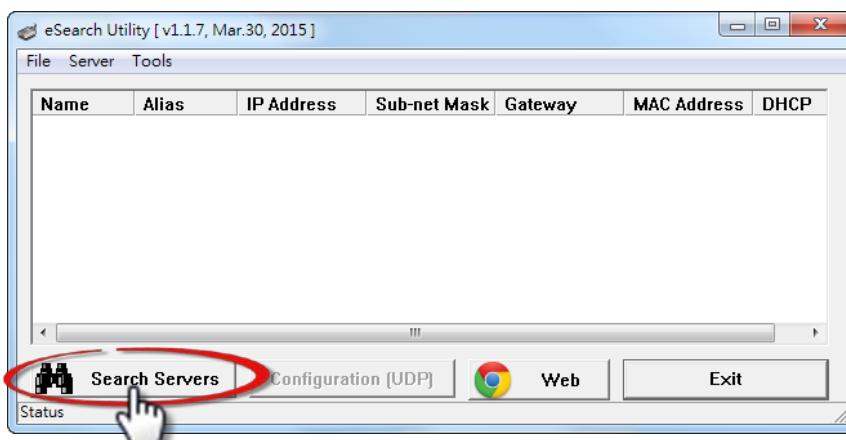
Follow the steps as suggested by the eSearch setup wizard to finish the installation.

After the installation has been completed, a new short cut for the eSearch Utility will be displayed on your desktop.
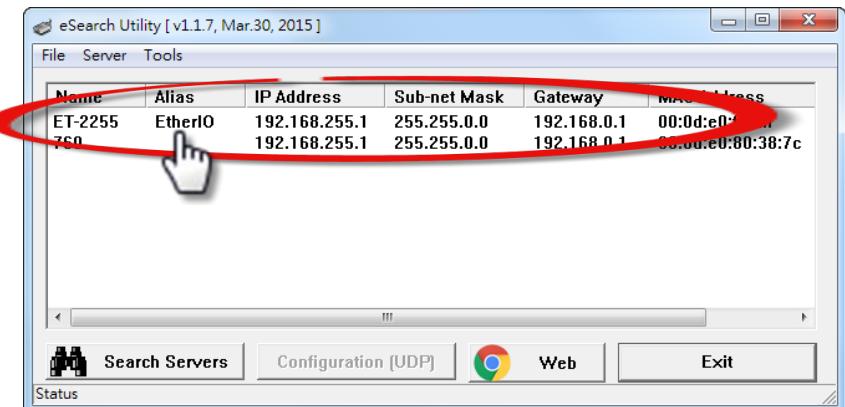
Step 3: Click the "Search Servers" button to search for the ET-2200 module

Step 4: Once the search process in complete, double-click the name of the ET-2200 module to open the "Configure Server (UDP)" dialog box
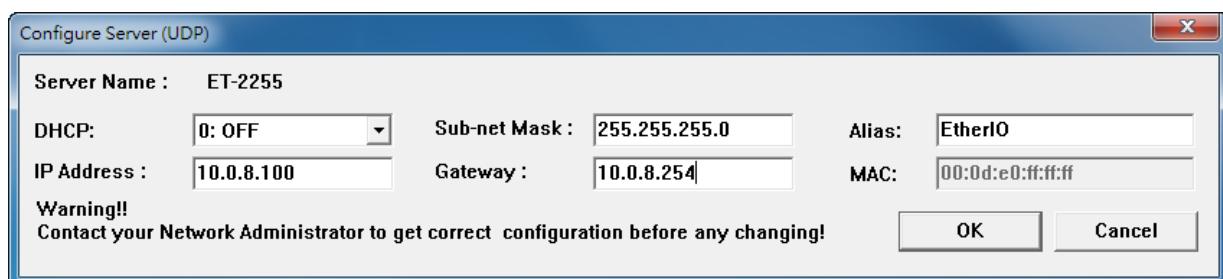
Factory Default Settings for the ET-2200 Series, as follows:

IP	192.168.255.1
Gateway	192.168.0.1
Mask	255.255.0.0
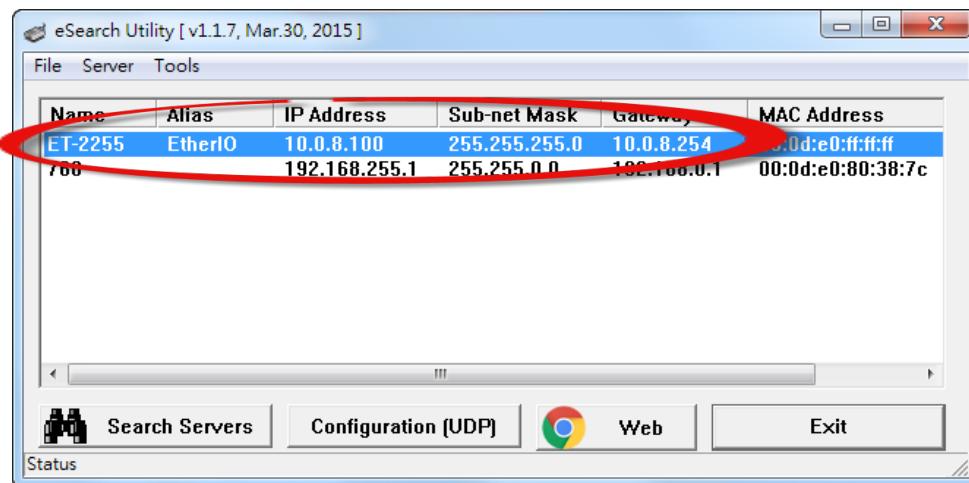
Step 5: Assign a new IP an address and then click the "OK" button.

Enter the relevant values for the **IP Address, Subnet Mask and Gateway**, etc., and then click the **"OK"** button. The new settings for the ET-2200 module will take effect within 2 seconds. If the correct network configuration information is unknown, contact the Network Administrator to obtain the relevant details.
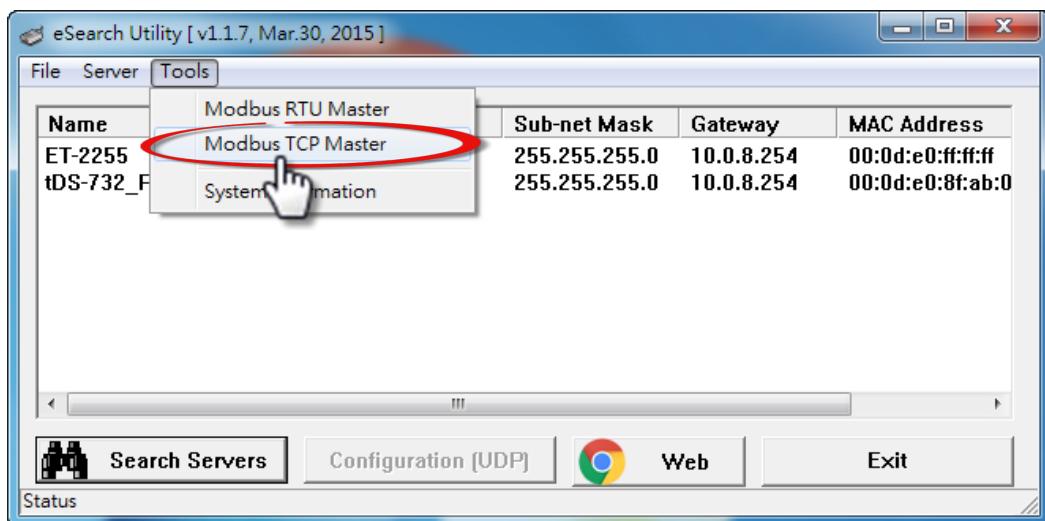
Step 6: Wait for 2 seconds and then click the "Search Servers" **button again to ensure that the ET-2200 module is operating correctly using the new configuration**
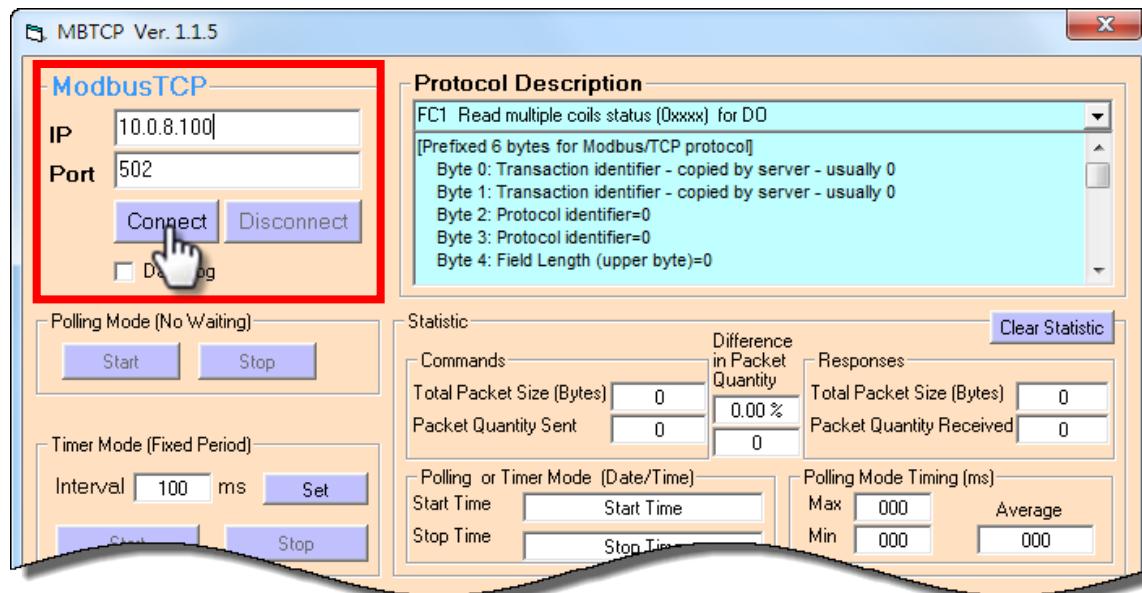
3.4 Modbus TCP Testing

Step 1: In the eSearch Utility, Select the "Modbus TCP Master" **item from the** "Tools" **menu to open the Modbus TCP Master Utility.**
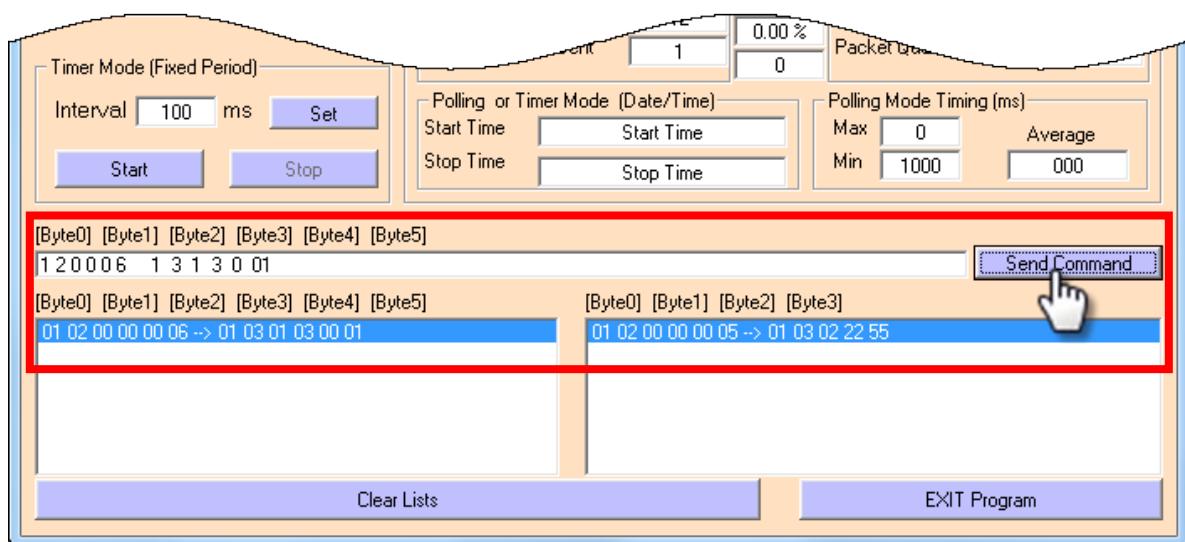
Step 2: Enter the "IP address" and "TCP Port"information for the ET-2200 module in the "Modbus TCP" section, and then click the "Connect" button to connect to the ET-2200.

Step 3: Refer to the "Protocol Description" filed in the top right-hand section of the Modbus Utility windows. You can send a request command and confirm that the response is correct.

For example, if the Modbus NetID (see Section 4.3.1) for the ET-2200 is 1, send the command "1 2 0 0 0 6 1313 0 1" to read the module name, the response will be "1 2 0 0 0 51 3222 55" (Refer to Section 6.2 "Modbus Message Structure" for more details information).

4. Web Configuration

All ET-2200 series module contain an advanced embedded web configuration system that provides I/O accessibility to the ET-2200 series module via a web browser.

4.1 Logging in to the Web Server

You can access the embedded ET-2200 series web server from any computer that has an Internet connection.

Step 1: Laugh web browser

Open a standard web browser. For example, Mozilla Firefox, Google Chrome and Internet Explorer are reliable and popular internet browsers that can be used to configure ET-2200 series module.

⚠ *Note that if you intend to use Internet Explorer, ensure that the cache function is disabled in order to avoid browser access errors. For more information, please refer to "FAQ_General_001: How to avoid a browser access error that causes a blank page to be displayed when using Internet Explorer".*
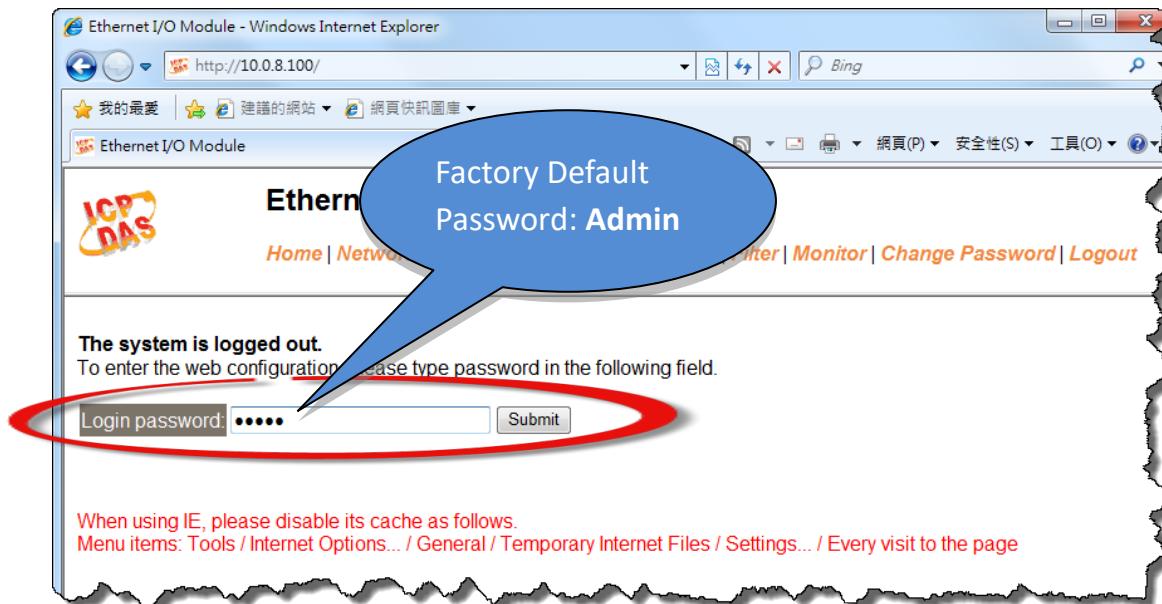
Step 2: Enter the URL for the ET-2200 module in the address bar of the browser or click the "Web" button in the eSearch Utility

Ensure that you have correctly configured the network settings for the ET-2200 series module, or refer to Section 3.3 "Configuring the Network Settings".

Step 3: Enter the password

Once the login screen is displayed, enter the password in the login password field (use the default password "**Admin**"), and then click the **"Submit"** button to enter the configuration web page.

Step 4: Log in to the ET-2200 Web Server

After logging into the ET-2200 web server, the main page will be displayed.

4.2 Home

Clicking the *Home* tab will display to the main page allowing you verify the ET-2200 series module hardware and software information and DIO control, each of which will be described in more detail below.

The first section provides basic information related to the ET-2200 series module hardware and software including items:

The Model Name, Firmware version, IP Address, Initial Switch position, Alias Name, MAC Address, and the TCP Port and System Timeout values. If the firmware for the ET-2200 series module is updated, you can use this page to check the version information for the ET-2200 software.

Model Name:	ET-2255U	Alias Name:	EtherIO
Firmware Version:	v1.4.6 [Jun.16 2017]	MAC Address:	00-0d-e0-e2-55-02
IP Address:	10.0.8.100	Initial Switch:	OFF
TCP Port Timeout: (Socket Watchdog, Seconds):	180	System Timeout: (Network Watchdog, Seconds)	0

The second section provides information related to the current status of pair-connection settings and Digital Output Control. *Note: User can click on the DO image to switch the output state.*

4.3 Network

Clicking the **Network** tab will display the **IP Address Configuration** page allowing you verify the current settings and configure the IP Address parameters, configure the general parameters and restore the default settings for the ET-2200 series module, each of which will be described in more detail below.

IP Address Configuration

The following table provides an overview of the parameters contained in the *IP Address Configuration* section:

Item	Description
Address Type	**Static IP:** If there is no DHCP server installed in your network, you can configure the network settings manually. Refer to Section"Manual Configuration" for more details.
	DHCP: Dynamic Host Configuration Protocol (DHCP) is a network application protocol that automatically assigns an IP address to each device. Refer to Section "Dynamic Configuration" for more details.
Static IP Address	Each ET-2200 module connected to the network must have its own unique IP address. This parameter is used to assign a specific IP address.
Subnet Mask	This parameter is used to assign the subnet mask for the ET-2200 module. The subnet mask indicates which portion of the IP address is used to identify the local network or subnet.
Default Gateway	This parameter is used to assign the IP Address of the Gateway to be used by the ET-2200 module. A Gateway (or router) is a device that is used to connect an individual network to one or more additional networks.
MAC Address	This parameter is used to set the User-defined MAC address, which must be in the format FF-FF-FF-FF-FF-FF.
Modbus TCP Slave	
Local Modbus TCP port	This parameter is used to set the local port to be used by the Modbus slave device. The default value is 502.
Local Modbus NetID	This parameter is used to set the Network ID to be used by the Modbus slave device. The default value is 1.
Update Settings	Click this button to save the revised settings to the ET-2200 module.

Dynamic Configuration

Dynamic configuration is very easy toperform. If a DHCP server is connected to you network, a network address can be dynamically configured by using the following procedure:

Step 1:Select **"DHCP"** from the **Address Type** drop-down menu.

Step 2: Click the **"Update Settings"** button to complete the configuration.

Address Type:	DHCP ▼ ①
Static IP Address:	10 . 0 . 8 . 102
Subnet Mask:	255 . 255 . 255 . 0
Default Gateway:	10 . 0 . 8 . 254
MAC Address:	00-0d-e0-c7-8a-9f (Format: FF-FF-FF-FF-FF-FF)
Local Modbus TCP port	502 (Default= 502)
Local Modbus NetID	1 (Default= 1) Enable ▼ (Default= Enab
	Update Settings ②

Manual Configuration

When using manual configuration, the network settings should be assigned in the following manner:

Step 1: Select **"Static IP"** from the **Address Type** drop-down menu.

Step 2: Enter the relevant details in the respective **network settings** fields.

Step 3: Click the **"Update Settings"** button to complete the configuration.

	①
Address Type:	Static IP ▼
Static IP Address:	10 . 0 . 8 . 102
Subnet Mask:	255 . 255 . 255 . 0 ②
Default Gateway:	10 . 0 . 8 . 254
MAC Address:	00-0d-e0-c7-8a-9f (Format: FF-FF-FF-FF-FF-FF)
Local Modbus TCP port	502 (Default= 502)
Local Modbus NetID	1 (Default= 1) Enable ▼ (Default= Enable)
	Update Settings ③

General Settings

General Settings

Ethernet Speed	Auto ▼ (Auto=10/100 Mbps Auto-negotiation)
System Timeout (Network Watchdog)	0 (30 ~ 65535 s, Default= 0, Disable= 0) Action:Reboot
TCP Timeout	180 (5 ~ 65535 s, Default= 180, Disable= 0) Action:Cut-off
UDP Configuration	Enable ▼ (Enable/Disable the UDP Configuration, Enable=default.)
Web Auto-logout	10 (1 ~ 65535 minutes, Default= 10, Disable= 0)
HTTP port	80 (Default= 80)
Alias Name	EtherIO (Max. 18 chars)
	Update Settings

The following table provides an overview of the parameters contained in the *General Settings* section:

Item	Description
Ethernet Speed	This parameter is used to set the Ethernet speed. The default value is Auto (Auto = 10/100 Mbps Auto-negotiation).
System Timeout (Network Watchdog)	This parameter is used to configure the system timeout value. If there is no activity on the network for a certain period of time, the system will be rebooted based on the configured system timeout value.
TCP Timeout (Seconds)	This parameter is used to configure the TCP timeout value. If Modbus TCP communication is idle for a certain period of time, the system will cut off the connection.
UDP Configuration	This parameter is used to enable or disable UDP configuration function.
Web Auto-logout	This parameter is used to configure the automatic logout value. If there is no activity on the web server for a certain period of time, the current user account will automatically logged out.
Alias Name	This parameter is used to assign an alias name for each ET-2200 module to assist with easy identification.
HTTP Port	This parameter is used to assign specific a HTTP port of ET-2200 module. The ET-2200 needs to be restarted when the HTTP port is changed. You need manually type the new HTTP port in the address bar of the browser. The default is 80. For example: if the HTTP port is set to 81, then enter the "IP address: HTTP port" (10.0.8.123:81).
Update Settings	Click this button to save the revised settings to the ET-2200 module.

Restore Factory Defaults

Restore Factory Defaults

Restore all options to their factory default states:	Restore Defaults
Forced Reboot	Reboot
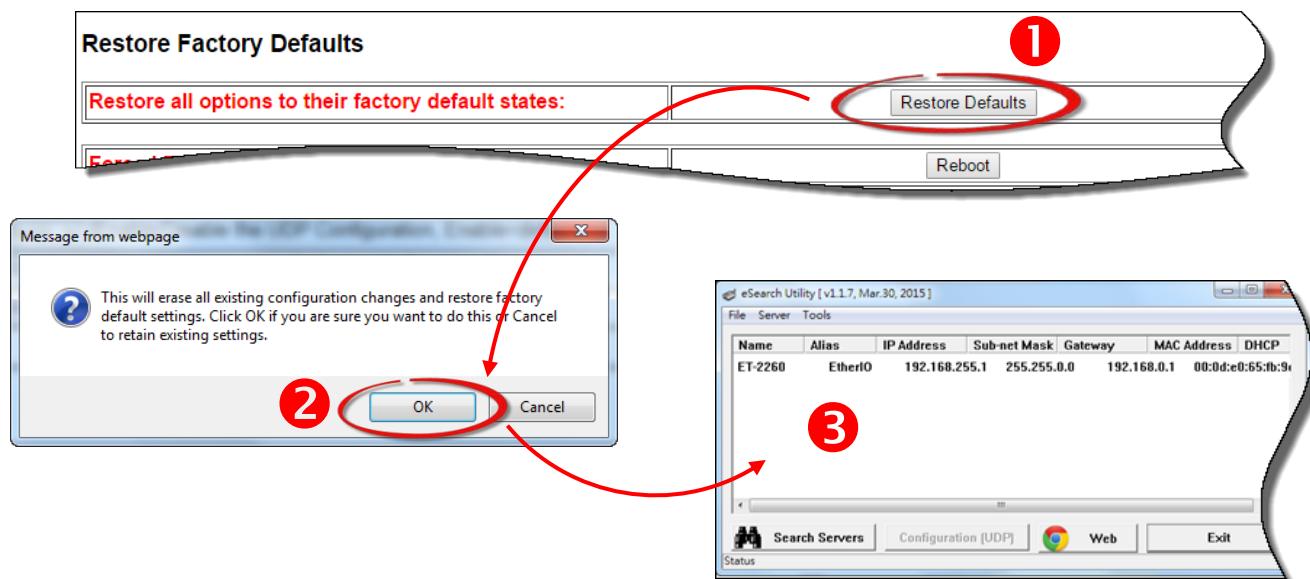
➢   **Restore all options to their factory default states**

To reset all parameters to their original factory default settings, use the following procedure:

Step 1: Click the **"Restore Defaults"** button to reset the configuration.

Step 2: Click the **"OK"** button in the message dialog box.

Step 3: Check whether the module has been reset to the original factory default settings for use with the eSearch Utility. Refer to Section 3.3 "Configuring the Network Settings".
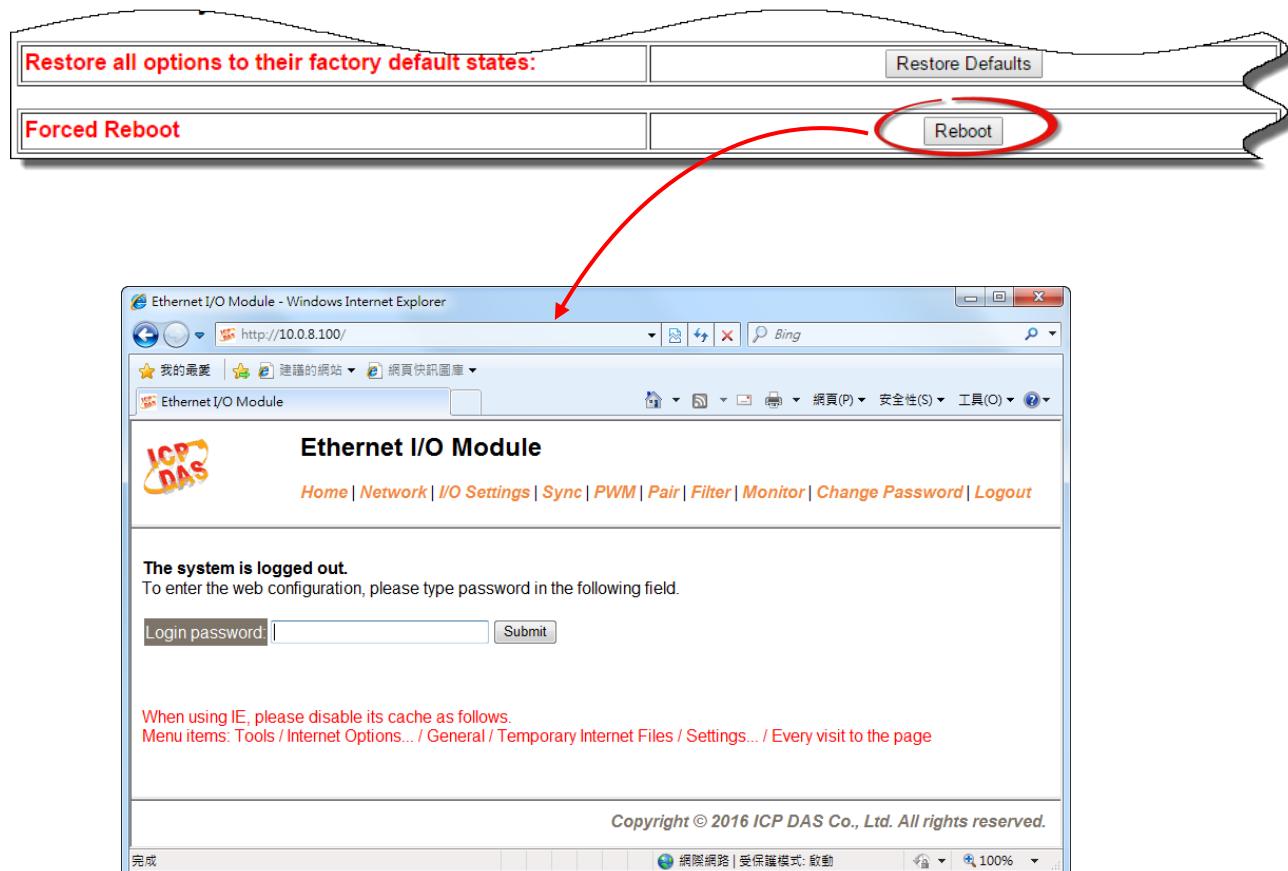
The following table provides an overview of the factory default settings:

Factory Default Settings	
IP Address	192.168.255.1
Gateway Address	192.168.0.1
Subnet Mask	255.255.0.0

➢ **Forced Reboot**

The **Forced Reboot** function: can be used to force the ET-2200 module to reboot or to remotely reboot the device. After the ET-2200 module has rebooted, the original login screen will be displayed requesting that you enter your Login Password before continuing.
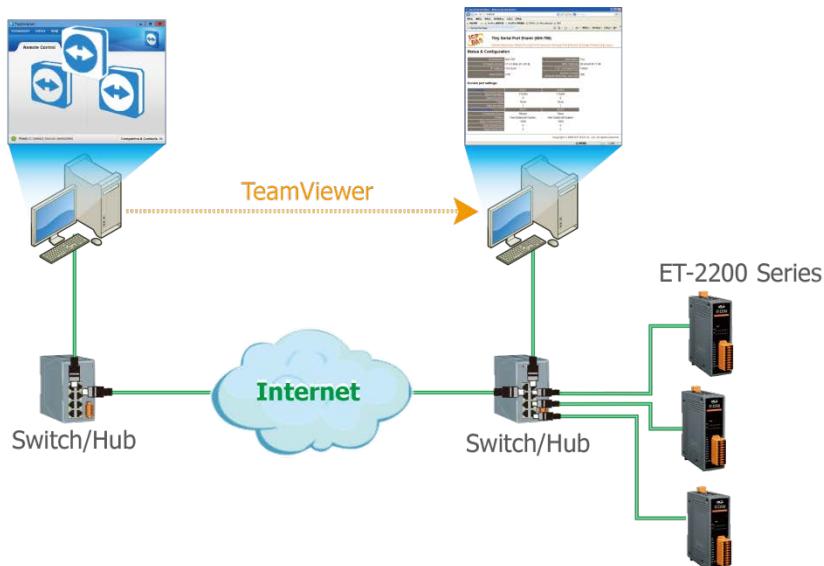
Firmware Update

Firmware Update

If the remote firmware update is failed, then the traditional firmware update (on-site) is required to make the module working again. Step 1: Refer to firmware update manaul first. Step 2: Run eSearch Utility to prepare and wait for update. Step 3: Click the [**Update**] button to **reboot** the module and start update. Step 4: Configure the module again.	Update

Firmware update requires initialization and local network operations. Traditional firmware update requires adjusting the Init/Run Switch and reboots the module manually for the initialization of firmware update, while new firmware allows user to initialize the module via web interface without adjusting the hardware switch. Initialization via web is useful when module is installed in remote site and can be accessed by a remote PC via TeamViewer.

⚠ *Note: If the remote firmware update is failed, then the traditional firmware update (Local) is required to make the module working again.*

For detailed information about how to remote update the Firmware for the ET-2200 module, refer to the**ET-2200_Firmware_Update_vxxx_en.pdf**.The location of the user manual on the CD and the download address are shown below:

CD:\\ NAPDOS\ET2200\Firmware\

http://ftp.icpdas.com/pub/cd/6000cd/napdos/et2200/firmware/

4.4 I/O Settings

Clicking the *I/O Settings* tab will display the *DO Control and DI/DO Configuration* page allowing you configure the Digital Input and Digital Output parameters for the ET-2200 series module. This page including Digital Output control, DI/DO Configuration, etc., each of which will be described in more detail below.

DO Control

The following table provides an overview of the parameters contained in the *Digital Output Control* section:

Item	Description
Set DO value	This parameter is used to manually assign a specific a value for the DO.
Update Settings	Click this button to set the revised settings to the ET-2200 module.

DI/DO Configuration

DI/DO Configuration:

Digital Output	Modbus Address	Setting
Host/Slave Watchdog Timeout	40257	0 (10 ~ 65535 Seconds, Default= 0, Disable= 0) Outputs DO with safe-value or **PWM** when host/slave timeout.
Enable Safe Value (Enable Watchdog)	00339 - 00332	0x0 Ch 7~4(☐ ☐ ☐ ☐) Ch 3~0(☐ ☐ ☐ ☐)
Safe Value	00274 - 00267	0x0 Ch 7~4(☐ ☐ ☐ ☐) Ch 3~0(☐ ☐ ☐ ☐)
Power-On Value	00242 - 00235	0x0 Ch 7~4(☐ ☐ ☐ ☐) Ch 3~0(☐ ☐ ☐ ☐)

Digital Input	Modbus Address	Setting
Enable Latched DI	00150	0 (Disable All= 0, Enable All= 1)
Clear Latched Status (High)	00032	0 (No Operation= 0, Clear All= 1)
Clear Latched Status (Low)	00033	0 (No Operation= 0, Clear All= 1)
DI Filter Level	-	0 (1 ~ 6500 ms, Default= 0, Disable= 0)

Digital Counter	Modbus Address	Setting
Enable Digital Counter	00158 - 00151	0x0 Ch 7~4(☐ ☐ ☐ ☐) Ch 3~0(☐ ☐ ☐ ☐)
Clear Digital Counter	00041 - 00034	0x0 Ch 7~4(☐ ☐ ☐ ☐) Ch 3~0(☐ ☐ ☐ ☐)
Preset Counter Value	40065 - 40050	Ch 07: 0 Ch 06: 0 Ch 05: 0 Ch 04: 0 Ch 03: 0 Ch 02: 0 Ch 01: 0 Ch 00: 0

Frequency Measurement (DI)	Modbus Address	Setting
Enable Frequency Measurement	00197 - 00190	0x0 Ch 7~4(☐ ☐ ☐ ☐) Ch 3~0(☐ ☐ ☐ ☐)
Scan Mode	40150	Single pulse ▼ 1000 ms: 1 Hz ~ 3 kHz (+/- 1 Hz error). 100 ms: 100 Hz to 3 kHz (+/- 10 Hz error). Single-pulse: 0.01 Hz ~ 1 Hz (+/- 0.01 Hz error), for stable signal only. Note: ET-2254P supports counter/frequency up-to 2.5 kHz.
Moving Average	40200	1 ▼

Universal DIO	Modbus Address	Setting
Force DI/DO Mode	00299 00307 - 00300	Dynamic ▼ Static: By configuration. Dynamic: Depends on DO requests. 0xff00 Ch 7~4(☐ ☐ ☐ ☐) Ch 3~0(☐ ☐ ☐ ☐) (0=DO, 1=DI; for ET-2254 Only)

Update Settings

The following table provides an overview of the parameters contained in the *DI/DO Configuration* section:

Item	Description
Digital Output	
Host/Slave Watchdog Timeout	This parameter is used to configure the Host Watchdog timeout value. If there is no Modbus TCP communication activity for the specified period (the timeout), then the Host Watchdog will activate an alarm.
Enable Safe Value (Enable Watchdog)	This parameter is used to enable the watchdog on each DO channels.

Safe Value	This parameter is used to define the DO safe value for the ET-2200 module. If the Host Watchdog alarm is activated, the DO will be set to the user-defined safe value.
Power-On Value	This parameter is used to define the DO Power-on value. On boot up, the DO is set to the user-defined Power-on value.

Digital Input	
Enable Latched DI	This parameter is uses to enable the latch function on all DI channels. The status of the DI will be recorded if it has been flagged as either high or low. 0 = Disable All; 1 = Enable All
Clear Latched Status (High)	This parameter is used to clear the status of all high latched D/I. 0 = No Operation; 1 = Clear All
Clear Latched Status (Low)	This parameter is used to clear the status of all low latched D/I. 0 = No Operation; 1= Clear All
DI Filter Level	The DI filter is a function that eliminates high-frequency noise from inputs. Settings range value: 1 ~ 6500 (ms); 0 = Disable (Default). Refer to "FAQ004_What is Digital-Input Filter (DI Filter)" for more detailed information.

Digital Counter	
Enable Digital Counter	This parameter is used to enable the digital counter on each DI channels.
Clear Digital Counter	This parameter is used to clear the values of each DI counters.
Preset Counter Value	This parameter is used to set the default value for each DI counters.

Frequency Measurement (DI)	
Enable Frequency Measurement	This parameter is used to enable the frequency measurement function on each DI channels.

Scan Mode	This parameter is used to define the scan mode for the frequency measurement.
	1000 ms: This mode provides a normal update rate and normal accuracy.
	The acceptable frequency range for the input signal is 1 Hz to 3 kHz ($\pm$ 1 Hz error).
	This mode can be used when the pulse width (signal source) contains small errors, since the measurement is based on the pulse count.
	100 ms: This mode provides fast update rate, but the accuracyis low.
	The acceptable frequency range for the input signal is 100 Hz to 3 kHz ($\pm$ 10 Hz error).
	This mode can be used when the pulse width (signal source) contains small errors, since the measurement is based on the pulse count.
	Single-pulse: This mode provides the highest accuracy but can only be used for stable signal.
	The data update rate depends on the signal frequency and the acceptable signal frequency range for the input signal is 0.01 Hz to 3.5 kHz ($\pm$ 0.01 Hz error).
	This mode can only be used when the pulse width (signal source) is stable, since the measurement is based on the width of a single pulse.
Moving Average	1 ==> No Average is used
	2 ==> Uses the average of 2 continuous sample values
	4 ==> Uses the average of 4 continuous sample values
	8 ==> Uses the average of 8 continuous sample values

Universal DIO

Force DI/DO Mode (For ET-2254(P) only)	**Dynamic:** Dynamic I/O type based on DO requests.
	Static: Static I/O type by configuration (web or Modbus).
	`0xff00` Ch 7~4(☐ ☐ ☐ ☐) Ch 3~0(☐ ☐ ☐ ☐)
	This parameter is used to set the Universal DIO channels to DI or DO Port.1 ==> DI; 0 ==> DO
Update Settings	Click this button to save the revised settings of DI/DO configuration to the ET-2200 module.

4.5 Sync

Clicking the **Sync** tab will display the **DIO Synchronization** page allowing you configure the Synchronous DIO, Min-switching time of DO and Auto-off Time of DO for the ET-2200 series module, each of which will be described in more detail below.

DIO Synchronization

The following table provides an overview of the parameters contained in the ***DIO Synchronization*** section:

Item	Description
Synchronous DIO (Local Mirror) Note: The ET-2254 supports these functions when low 8-bit are DI0 to DI7 and high 8-bit are DO8 to DO15.	
Level Sync (DO = DI)	This parameter is used to enable the synchronization operation in Digital Input/Output function.
Rising Active (DO = ON)	This parameter is used to enable rising active in Digital Input function. When the specified DI state changed from OFF to ON, the corresponding DO will be set to ON.
Falling Active (DO = ON)	This parameter is used toenable falling active in Digital Input function. When the specified DI state changed from ON to OFF, the corresponding DO will be set to ON.
Additional Controls	
Min-Switch Time of DO (0 to 65535 Seconds)	This parameter is used to set the minimum switching time between the ON and OFF state of the Digital Output. This protects some machines from being damaged by too many ON/OFF switches in a short time.
Auto-off Time of DO (0 to 65535 Seconds)	This parameter is used to set the auto-off time of the Digital Output. If the Digital Output is ON, the Digital Output will be auto-off based on the configured time value.
Update Settings	Click this button to save the revised settings of DIO configuration to the ET-2200 module.

4.6 PWM

Ethernet I/O Module

Home | Network | I/O Settings | Sync | PWM | Pair | Filter | Monitor | Change Password | Logout

Clicking the **PWM** tab will display the **PWM Configuration** page allowing you enable and configure the PWM parameters for the ET-2200 series module, including the PWM Alarm and duty cycle, etc., each of which will be described in more detail below.

PWM Configuration

PWM Configuration:

PWM Functions	Modbus Address	Setting
Enable PWM	00107 - 00100	0x0 Ch 7~4(☐ ☐ ☐ ☐) Ch 3~0(☐ ☐ ☐ ☐)
Enable PWM Alarm	00371 - 00364	0x0 Ch 7~4(☐ ☐ ☐ ☐) Ch 3~0(☐ ☐ ☐ ☐) (Activates the PWM outputs when Host/Slave Watchdog Timeout)
Duty Cycle	40115 - 40100	DO 07: (1000 , 1000) DO 06: (1000 , 1000) DO 05: (1000 , 1000) DO 04: (1000 , 1000) DO 03: (1000 , 1000) DO 02: (1000 , 1000) DO 01: (1000 , 1000) DO 00: (1000 , 1000) (High, Low: 10 ~ 65535 ms, 0= Disable)
		Update Settings

The following table provides an overview of the parameters contained in the **PWM Configuration** section:

Item	Description	Default Value
Enable PWM	This parameter is used to enable the PWM output function.	0
Enable PWM Alarm	This parameter is used to enable the PWM output alarm function when Host/Slave watchdog timeout.	0
Duty Cycle	This parameter is used to set the duty cycle for the DO channels. Two values are required for each DO channel. The first value is the high pulse width, while the second is the low pulse width. The duty cycle is in 1 ms units, and the resolution is approximately 5 ms. (10 to 65535 ms). A value of 0 will disable the duty cycle functions for that channel.	1000 (ms)
Update Settings	Click this button to save the revised settings to the ET-2200 module.	

⚠ *Note: Because of the characteristics of the relay functions, it is recommended that the PWM on ET-2260/2261/2268module (i.e., modules with relay functions) is not used for extended periods of time.*

4.7 Pair Connection

Clicking the **Pair** tab will display the **I/O Pair Connection Settings** page allowing you enable and configure the DI-to-DO pair connections for the ET-2200 series module, which will be described in more detail below.

I/O Pair-Connection Settings

The I/O pairconnection function is a specific feature of the ET-2200 series module that can be used to enable a pair of DI-to-DO connections via the Modbus TCP (Ethernet) protocol.

The following table provides an overview of the parameters contained in the **I/O Pair-Connection Settings** section:

Item	Description	Default
Mode	This parameter is used to define the Server mode for the ET-2200 series module. **Mode = Disable**: Server mode (Slave). **Mode = POLL**: Poll remote DI to local DO in the Client mode (Master). **Mode = PUSH**: Push local DI to remote DO in the Client mode (Master). The DI Count field must also be configured to enable Client mode.	Disable
Remote IP	The IP address of the remote device to access.	0
Remote Port	The TCP port number of the remote device to access. Range: 0 to 65535.	502
Net ID	The Modbus Net ID of the remote device to access. Range: 1 to 247.	1
Scan Time	For **"POLL"** mode, the module will update the DI/DO states based on the time period of the Scan Time parameter. For **"PUSH"** mode, the module will update remote DO state when the local DI state is changed. The module will also force update remote DO when the local DI is no change during the time period of the Scan Time parameter. Range: 1000 to 42949672965 ms.	1000 ms
DI Count	This parameter specifies how many digital I/O channels are mapped. Range: 1 to 16; 0= Disable.	0
DI Addr	For **"POLL"** mode, this parameter specifies the base address of the **Remote DI device** that will be mapped to the **Local DO register**. The range depends on the type of remote device being used. For **"PUSH"** mode, this parameter specifies the base address of the **Local DI register** that will be mapped to the **Remote DO device**. The range depends on the type of ET-2200 module being used.	0

DO Addr	For **"POLL"** mode, this parameter specifiesthe base address of the **Local DO register** that will be mapped to the **Remote DI device**. The range depends on the type of the ET-2200 module being used. For **"PUSH"** mode, this parameter specifies the base address of the **Remote DO device** that will be mapped to the **Local DI register**. The range depends on the type of remote device being used.	0
TCP/UDP	This parameter is used to set the type of Modbus protocol to be used and can be either TCP or UDP **for the "PUSH" mode only**.	TCP
Update	Click **"Submit"** button to save the revised settings to the ET-2200 module.	

4.8 Filter

Clicking the *Filter* tab will display the *Filter Settings* page allowing you configure the IP Filter list for the ET-2200 series module, which will be described in more detail below.

Filter Settings

The *Filter Settings* page is used to query or edit the IP Filter List (Available IP) for the ET-2200 series module. The IP filter list restricts the access of incoming packets based on the IP address. If one or more IP addresses are saved to the IP Filter table, only Clients whose IP address is specified in the IP Filter List (Available IP) will be able to access the ET-2200 series module.

The following table provides an overview of the parameters contained in the *IP Address Configuration* section:

Item	Description
Add "IP" to the List	This parameter is used to add an IP address to the Available IP List.
Delete IP # "number"	This parameter is used to delete IP# address from the Available IP List.
Delete All	This parameter is used to delete all IP address current contained in the Available IP List.
Save to Flash	This parameter is used to save the updated Available IP List to the Flash memory. Check the checkbox before clicking the **Submit** button of you wish to store the most recent list.
Submit	Click this button to save the revised settings to ET-2200 module.

4.9 Monitor

After clicking the **Monitor** tab, the Current Connection Status page will be displayed showing detailed information regarding the current status of the serial port connection settings for the ET-2200 series module.

Current Connection Status:

Server Mode	Server
Connected IP1:	0.0.0.0
IP2:	0.0.0.0
IP3:	0.0.0.0
IP4:	0.0.0.0
IP5:	0.0.0.0
IP6:	0.0.0.0
Available Connections:	32

4.10 Change Password

Ethernet I/O Module

Home | Network | I/O Settings | Sync | PWM | Pair | Filter | Monitor | Change Password | Logout

After clicking the **Password** tab, the **Change Password** page will be displayed. To change a password, first enter the old password in the **"Current password"** field (use the default password "**Admin**") and then enter a new password in the **"New password"** field. Re-enter the new password in the **"Confirm new password"** field, and then click the "**Submit**" button to update the password.

Change Password
The length of the password is 12 characters maximum.

Current password:	•••••	
New password:	••••	
Confirm new password:	••••	Submit

⚠️Note:
If you forgot your password, please refer to Appendix A. How do I restore the web password for the module to the factory default password?

4.11 Logout

Ethernet I/O Module

Home | Network | I/O Settings | Sync | PWM | Pair | Filter | Monitor | Change Password | Logout

Clicking the *Logout* tab will immediately log you out from the system and return you to the login page.

The system is logged out.
To enter the web configuration, please type password in the following field.

Login password: [_____] Submit

Note: This web configuration requires JavaScript enabled in your browser (Firefox, IE...).
If the web configuration does not work, please check the JavaScript settings first.

When using IE, please disable its cache as follows.
Menu items: Tools / Internet Options... / General / Temporary Internet Files / Settings... / Every visit to the page

5. I/O Pair Connection Applications
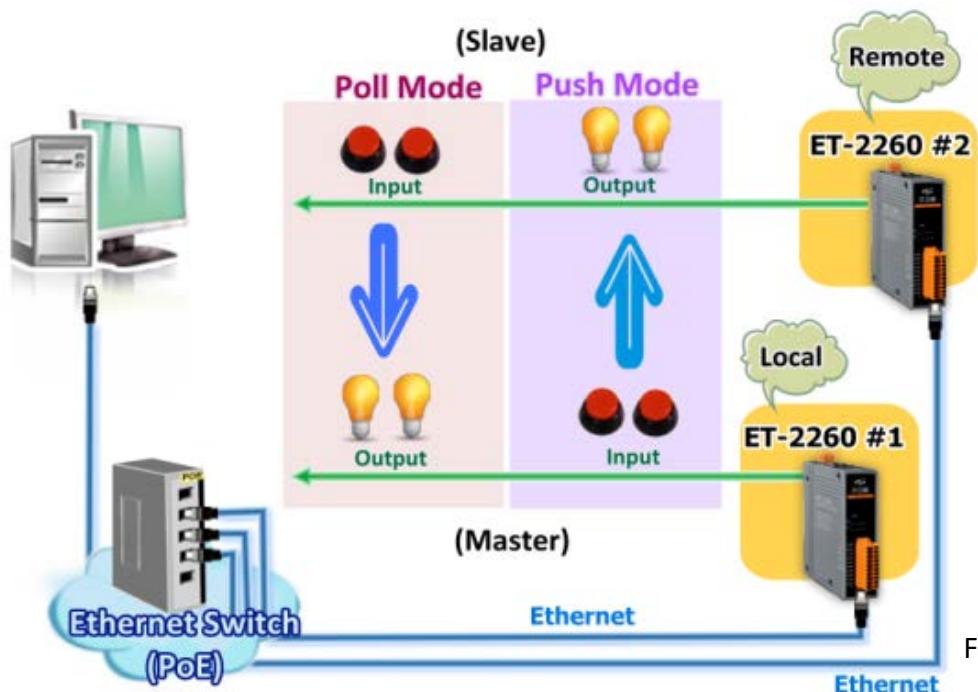
The ET-2200 series modules can be used to create DI-to-DO pair connections via the Ethernet. Once the configuration is complete, the modules can then poll the status of the local DI channels and then use the Modbus/TCP protocol to continuously write to a remote DO device in the background. This is useful when connecting Digital I/O devices that do not the mselves have Ethernet capability. The following will describe how to correctly configure the I/O pair-connection function.

5.1 One Module Polling the Remote DI/DO (1-to-1, Polling Mode)

Step 1: Connect the device to a Network, a PC and a Power supply.

Confirm that the ET-2200 series modules are functioning correctly. Refer to Chapter 3 "Getting Started" for more details. An example configuration shown below:

Note that ET-2260 module is used in this example.

Figure 5-1.1

Step 2: Configure the Ethernet Settings

Contact your Network Administrator to obtain the correct network configuration information for the ET-2200 series modules (e.g., ET-2260 #1 and #2), such as the IP Address, Subnet Mask, and Gateway details. Refer to Section 3.3 "Configuring the Network Settings" for more details.
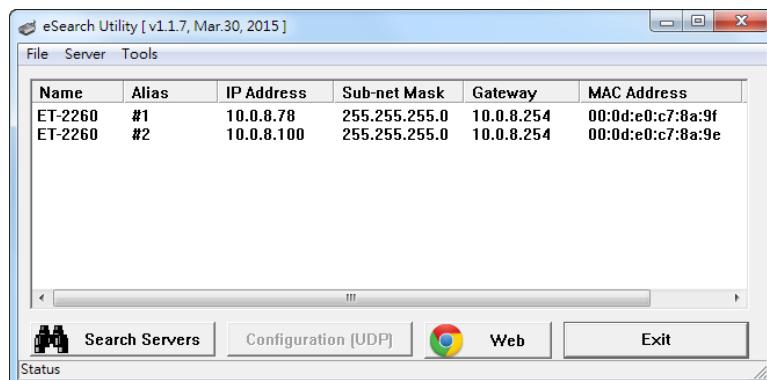
Figure 5-1.2

Step 3: Configure the I/O Pair connection on the Web Server

1. In the eSearch Utility, select **ET-2260 #1 module** and then click the "**Web**" button to launch the browser program and connect to the web server.
2. Enter the password in the Login password field **(the default password is "Admin")**, and then click the **"Submit"** button to display the configuration page.
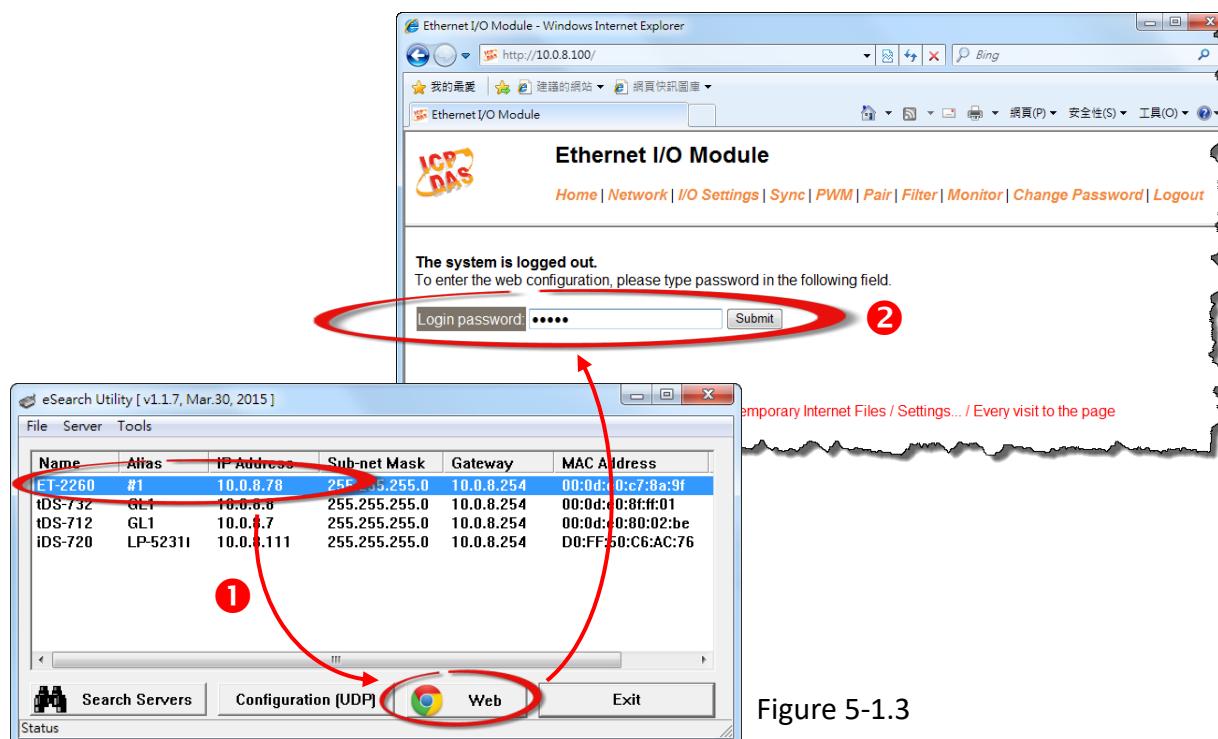
Figure 5-1.3

3. Click the **"Pair"** tab to display the I/O Pair-connection Settings page.
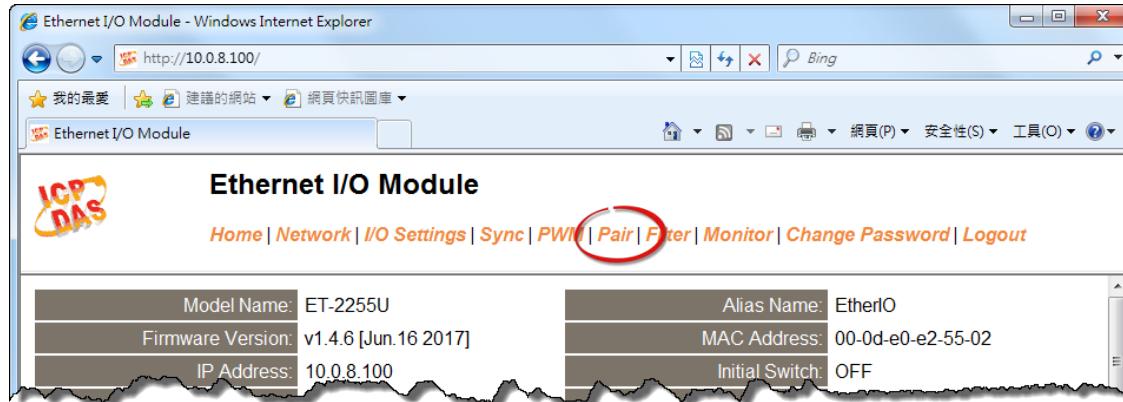
Figure 5-1.4

Polling Mode

4. In the "I/O Pair-connection Settings", select **"POLL"** from the "<u>Mode</u>" drop-down options.
5. Enter the **IP address for ET-2260 #2 module**in the "<u>Remote IP</u>" field.
6. Enter the **TCP Port for ET-2260#2 module** in the "<u>Remote Port</u>" field.
7. Enter a **DI Count Value for ET-2260 #2 module** in the "<u>DI Count</u>" field (Remote DI to Local DO).

> The following is an example of a <u>**Polling mode**</u> configuration:
>
> Enter **"2"** in the **"DI Count"** field. This means **DI x2 of ET-2260 #2 module** is mapped to **DO x2 of ET-2260 #1 module**.

8. Click the "**Submit**" button to complete the configuration.

Figure 5-1.5

Push Mode

4. In the "I/O Pair-connection Settings", select **"PUSH"** from the "<u>Mode</u>" drop-down options.

5. Enter the **IP address for ET-2260 #2 module** in the "<u>Remote IP</u>" field.

6. Enter the **TCP Port forET-2260#2 module** in the "<u>Remote Port</u>" field.

7. Enter a **DI Count Value for ET-2260 #1 module** in the "<u>DI Count</u>" field (Local DI to Remote DO).

> The following is an example of a **Push mode** configuration:
>
> Enter**"2"** in the **"DI Count"** field. This means **DI x2 of ET-2260 #1module**is mapped to **DO x2 of ET-2260 #2module**.

8. Select **Modbus protocol (e.g., "TCP")** from the **"TCP/UDP"** drop-down options.

9. Click the "**Submit**" button to complete the configuration.

I/O Pair-Connection Settings:

POLL Mode: (Remote DI -> Local DO)

PUSH Mode: (Local DI -> Remote DO)

Function in "BLUE" text available in "PUSH" Mode Only

| 1~5 | 6~10 | 11~12 |

#	Mode	Remote IP				Remote Port	Net ID	Scan Time		DI Count	DI Addr	DO Addr	TCP/UDP	Update
01	POLL ▼	10	0	8	100	502	1	1000	ms	2	0	0	TCP ▼	Submit
02	PUSH ▼	10	0	8	100	502	1	1000	ms	2	0	0	TCP ▼	Submit
03	Disable ▼	0	0	0	0	502	1	1000	ms	0	0	0	TCP ▼	Submit
04	Disable ▼	0	0	0	0	502	1	1000	ms	0	0	0	TCP ▼	Submit
05	Disable ▼	0	0	0	0	502	1	1000	ms	0	0	0	TCP ▼	Submit

Figure 5-1.6

5.2 Two Modules Pushing the Local DI to each other (1-to-1, Push Mode)

Step 1: Connect the device to a Network, a PC and a Power supply.

Confirm that the ET-2200 series modules are functioning correctly. Refer to Chapter 3 "Getting Started" for more details. An example configuration shown below:
Note that ET-2260 module is used in this example.
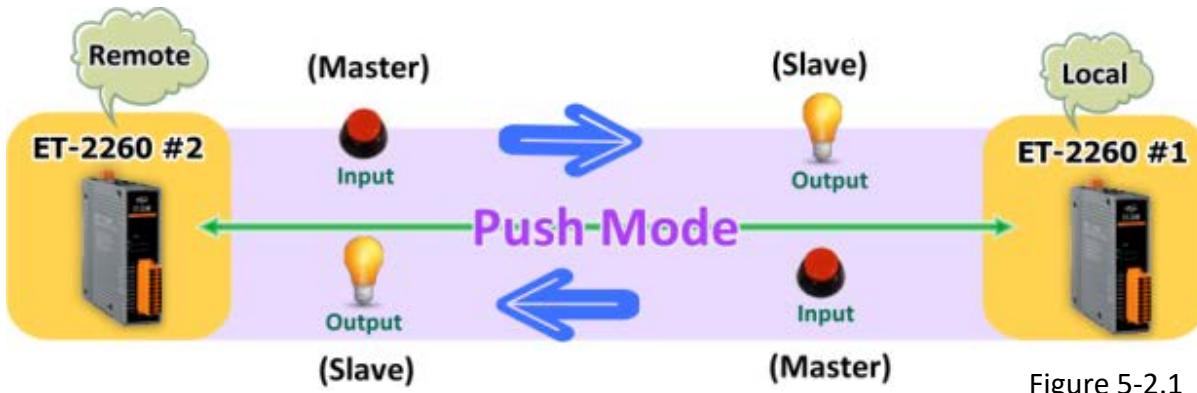
Figure 5-2.1

Step 2: Configure the Ethernet Settings

Contact your Network Administrator to obtain the correct network configuration information for the ET-2200 series modules (e.g., ET-2260 #1 and #2), such as the IP Address, Subnet Mask, and Gateway details. Refer to Section 3.3 "Configuring the Network Settings" for more details.
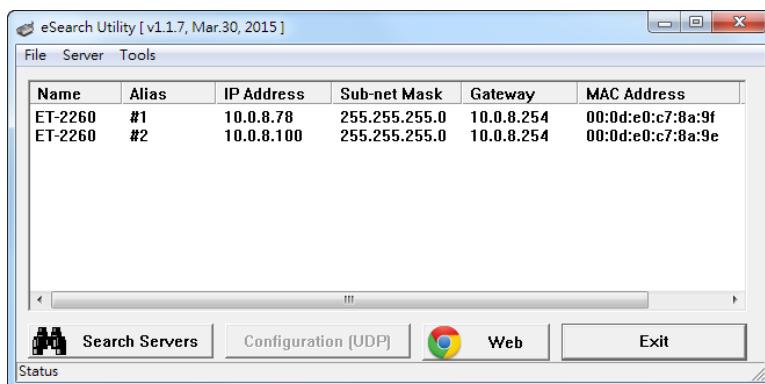
Figure 5-2.2

Step 3: Configure the I/O Pair connection on the ET-2260 #1 module

1. In the eSearch Utility, select **ET-2260 #1 module** and then click the "**Web**" button to launch the browser program and connect to the web server.
2. Enter the password in the Login password field **(thedefault password is "Admin")**, and then click the "**Submit**" button to display the configuration page.
3. Click the "**Pair**" tab to display the I/O Pair-connection Settings page.

Refer to Figures 5-1.3 to 5-1.4 for illustrations of how to perform the above procedure.

4. In the "I/O Pair-connection Settings", select **"PUSH"** from the "**Mode**" drop-down options.
5. Enter the **IP address for ET-2260 #2 module** in the "**Remote IP**" field.
6. Enter the **TCP Port for ET-2260#2 module** in the "**Remote Port**" field.
7. Enter a **DI Count Value for ET-2260 #1 module** in the "**DI Count**" field (Local DI to Remote DO).

> For example,enter"**1**" in the **"DI Count"** field. This means **DI x1 of ET-2260 #1 module**is mapped to **DO1 x of ET-2260 #2module**.

8. Select **Modbus protocol (e.g., "TCP")** from the **"TCP/UDP"** drop-down options.
9. Click the "**Submit**" button to complete the configuration.

Figure 5-2.3

Step 4: Configure the I/O Pair connection on the ET-2260 #2 module

1. In the eSearch Utility, select **ET-2260 #2 module** and then click the "**Web**" button to launch the browser program and connect to the web server.

2. Enter the password in the Login password field **(the default password is "Admin")**, and then click the **"Submit"** button to display the configuration page.

3. Click the **"Pair**" tab to display the I/O Pair-connectionSettings page.

Refer to Figures 5-1.3 to 5-1.4 for illustrations of how to perform the above procedure.

4. In the "I/O Pair-connection Settings", select **"PUSH"** from the "**Mode**" drop-down options.

5. Enter the **IP address for ET-2260 #1 module** in the "**Remote IP**" field.

6. Enter the **TCP Port for ET-2260#1 module** in the "**Remote Port**" field.

7. Enter a **DI Count Value for ET-2260 #2 module** in the "**DI Count**" field (Local DI to Remote DO).

> For example, enter **"1"** in the **"DI Count"** field. This means **DI x1 of ET-2260 #2 module** is mapped to **DO1 x of ET-2260 #1 module**.

8. Select **Modbus protocol (e.g., "TCP")** from the **"TCP/UDP"** drop-down options.

9. Click the "**Submit**" button to complete the configuration.

Figure 5-2.4

5.3 Several Modules Polling the Remote DI (M-to-1) (Polling Mode)

Step 1: Connect the device to a Network, a PC and a Power supply.

Confirm that the ET-2200 series modules and remote slave device are functioning correctly. Refer to Chapter 3 "Getting Started" for more details. An example configuration shown below:
Note that ET-2260 and PETL-7060 module is used in this example.
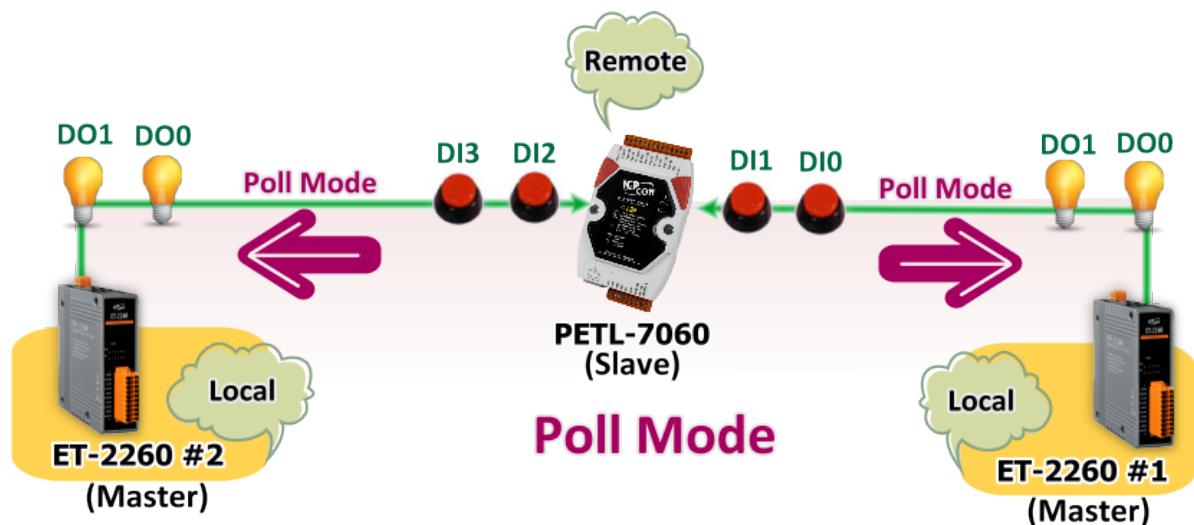
Figure 5-3.1

Step 2: Configure the Ethernet Settings

Contact your Network Administrator to obtain the correct network configuration information for the ET-2200 series modules and remote slave device (e.g., ET-2260 #1, #2 and PETL-7060), such as the IP Address, Subnet Mask, and Gateway details. Refer to Section 3.3 "Configuring the Network Settings" for more details.
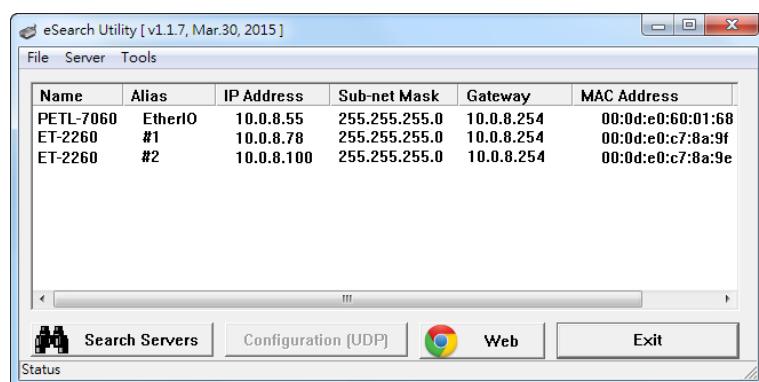
Figure 5-3.2

Step 3: Configure the I/O Pair connection on the ET-2260 #1 module

1. In the eSearch Utility, select **ET-2260 #1 module** and then click the "**Web**" button to launch the browser program and connect to the web server.
2. Enter the password in the Login password field **(the default password is "Admin")**, and then click the **"Submit"** button to display the configuration page.
3. Click the **"Pair"** tab to display the I/O Pair-connectionSettings page.

Refer to Figures 5-1.3 to 5-1.4 for illustrations of how to perform the above procedure.

4. In the "I/O Pair-connection Settings", select **"POLL"** from the "Mode" drop-down options.
5. Enter the **IP address for remote slave device (e.g., PETL-7060)** in the "Remote IP" field.
6. Enter the **TCP Port for remote slave device (e.g., PETL-7060)** in the "Remote Port" field.
7. Enter a **DI Count Value for remote slave device (e.g., PETL-7060)** in the "DI Count" field (Remote DI to Local DO).

> For example, enter **"2"** in the **"DI Count"** field. This means **DI x2 of the PETL-7060 module** is mapped to **DO x2 of ET-2260 #1 module**.

8. Enterthe **DI address for remote slave device (e.g., PETL-7060)** in the "DI Addr" field (Remote DI to Local DO).

> For example, enter **"0"** in the **"DI Addr"** field. This means **DI addresses DI0 and DI1 of the PETL-7060 module** are mapped to **DO x2 of ET-2260 #1 module**.

9. Click the **"Submit"** button to complete the configuration.

Figure 5-3.3

I/O Pair-Connection Settings:

POLL Mode: (Remote DI -> Local DO)

PUSH Mode: (Local DI -> Remote DO)

Function in "BLUE" text available in "PUSH" Mode Only

| 1~5 | 6~10 | 11~12 |

#	Mode	Remote IP				Remote Port	Net ID	Scan Time		DI Count	DI Addr	DO Addr	TCP/UDP	Update
01	POLL ▼	10	0	8	55	502	1	1000	ms	2	0	0	TCP ▼	Submit
02	Disable ▼	0	0	0	0	502	1	1000	ms	0	0	0	TCP ▼	Submit
03	Disable ▼	0	0	0	0	502	1	1000	ms	0	0	0	TCP ▼	Submit
04	Disable ▼	0	0	0	0	502	1	1000	ms	0	0	0	TCP ▼	Submit
05	Disable ▼	0	0	0	0	502	1	1000	ms	0	0	0	TCP ▼	Submit

Step 4: Configure the I/O Pair connection on the ET-2260 #2 module

1. In the eSearch Utility, select **ET-2260 #2 module** and then click the "**Web**" button to launch the browser program and connect to the web server.
2. Enter the password in the Login password field **(the default password is "Admin")**, and then click the **"Submit"** button to display the configuration page.
3. Click the **"Pair**" tab to display the I/O Pair-connection Settings page.

Refer to Figures 5-1.3 to 5-1.4 for illustrations of how to perform the above procedure.

4. In the "I/O Pair-connection Settings", select **"POLL"** from the "Mode" drop-down options.
5. Enter the **IP address forremote slave device (e.g., PETL-7060)** in the "Remote IP" field.
6. Enter the **TCP Port for remote slave device(e.g., PETL-7060)** in the "Remote Port" field.
7. Enter a **DI Count Value for remote slave device(e.g., PETL-7060)** in the "DI Count" field (Remote DI to Local DO).

> For example, enter **"2"** in the **"DI Count"** field. This means **DI x2 of the PETL-7060 module** is mapped to **DO x2 of ET-2260 #2 module**.

8. Enterthe **DI address for remote slave device (e.g., PETL-7060)** in the "DI Addr" field (Remote DI to Local DO).

> For example, enter **"2"** in the **"DI Addr"** field. This means **DI addresses DI2 and DI3 of the PETL-7060 module** are mapped to **DO x2 of ET-2260 #2 module**.

9. Click the "**Submit**" button to complete the configuration.

Figure 5-3.4

5.4 Several Modules Pushing the Local DI (M-to-1) (Push Mode)

Step 1: Connect the device to a Network, a PC and a Power supply.

Confirm that the ET-2200 series modules and remote slave device are functioning correctly. Refer to Chapter 3 "Getting Started" for more details. An example configuration shown below:
**Note that ET-2260 and PETL-7060 module is used in this example.**
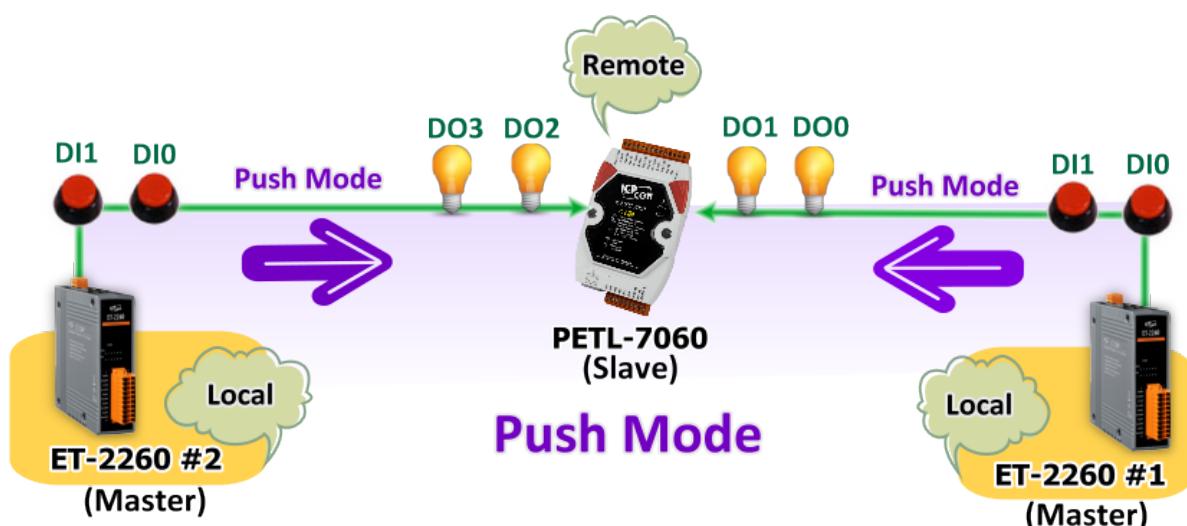
Figure 5-4.1

Step 2: Configure the Ethernet Settings

Contact your Network Administrator to obtain the correct network configuration information for the ET-2200 series modules and remote slave device (e.g., ET-2260 #1, #2 and PETL-7060), such as the IP Address, Subnet Mask, and Gateway details. Refer to Section 3.3 "Configuring the Network Settings"for more details.
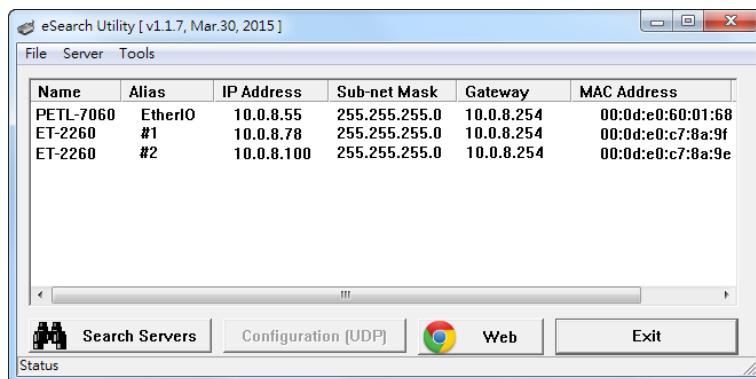
Figure 5-4.2

Step 3: Configure the I/O Pair connection on the ET-2260 #1 module

1. In the eSearch Utility, select **ET-2260 #1 module** and then click the "**Web**" button to launch the browser program and connect to the web server.
2. Enter the password in the Login password field **(the default password is "Admin")**, and then click the **"Submit"** button to display the configuration page.
3. Click the **"Pair**" tab to display the I/O Pair-connection Settings page.

Refer to Figures 5-1.3 to 5-1.4 for illustrations of how to perform the above procedure.

4. In the "I/O Pair-connection Settings", select **"PSUH"** from the "Mode" drop-down options.
5. Enter the **IP address for remote slave device (e.g., PETL-7060)** in the "Remote IP" field.
6. Enter the **TCP Port for remote slave device(e.g., PETL-7060)** in the "Remote Port" field.
7. Enter a **DI Count Value for ET-2260 #1 module** in the "DI Count" field (Local DI to Remote DO).

> For example, enter"2" in the **"DI Count"** field. This means **DI x2 of the ET-2260 #1 module** is mapped to **DO x2 of the PETL-7060 module.**

8. Enterthe **DO address for remote slave device (e.g., PETL-7060)** in the "DO Addr" field (Local DI to Remote DO).

> For example, enter **"0"** in the **"DO Addr"** field. This means **DO addresses DO0 and DO1 of the PETL-7060 module** are mapped to **DI x2 of ET-2260 #1 module**.

9. Select **Modbus protocol (e.g., "TCP")** from the **"TCP/UDP"** drop-down options.
10. Click the "**Submit**" button to complete the configuration.

Figure 5-4.3

I/O Pair-Connection Settings:

POLL Mode: (Remote DI -> Local DO)

PUSH Mode: (Local DI -> Remote DO)

Function in "BLUE" text available in "PUSH" Mode Only

| 1~5 | 6~10 | 11~12 |

#	Mode	Remote IP				Remote Port	Net ID	Scan Time		DI Count	DI Addr	DO Addr	TCP/UDP	Update
01	PUSH ▼	10	0	8	55	502	1	1000	ms	2	0	0	TCP ▼	Submit
02	Disable ▼	0	0	0	0	502	1	1000	ms	0	0	0	TCP ▼	Submit
03	Disable ▼	0	0	0	0	502	1	1000	ms	0	0	0	TCP ▼	Submit
04	Disable ▼	0	0	0	0	502	1	1000	ms	0	0	0	TCP ▼	Submit
05	Disable ▼	0	0	0	0	502	1	1000	ms	0	0	0	TCP ▼	Submit

Step 4: Configure the I/O Pair connection on the ET-2260 #2 module

1. In the eSearch Utility, select **ET-2260 #2 module** and then click the "**Web**" button to launch the browser program and connect to the web server.
2. Enter the password in the Login password field **(the default password is "Admin")**, and then click the **"Submit"** button to display the configuration page.
3. Click the **"Pair Connection"** tab to display the I/O Pair-connectionSettings page.

Refer to Figures 5-1.3 to 5-1.4 for illustrations of how to perform the above procedure.

4. In the "I/O Pair-connection Settings", select **"PSUH"** from the "<u>Mode</u>" drop-down options.
5. Enter the **IP address for remote slave device (e.g., PETL-7060)** in the "<u>Remote IP</u>" field.
6. Enter the **TCP Port for remote slave device(e.g., PETL-7060)** in the "<u>Remote Port</u>" field.
7. Enter a **DI Count Value for ET-2260 #2 module** in the "<u>DI Count</u>" field (Local DI to Remote DO).

> For example, enter"**2**" in the **"DI Count"** field. This means **DI x2 of the ET-2260 #2 module** is mapped to **DO x2 of the PETL-7060 module.**

8. Enter the **DO address for remote slave device (e.g., PETL-7060)** in the "<u>DO Addr</u>" field (Local DI to Remote DO).

> For example, enter **"2"** in the **"DO Addr"** field. This means **DO addresses DO2 and DO3 of the PETL-7060 module** are mapped to **DI x2 of ET-2260 #2 module**.

9. Select **Modbus protocol (e.g., "TCP")** from the "<u>TCP/UDP</u>" drop-down options.
10. Click the "**Submit**" button to complete the configuration.

Figure 5-4.4

6. Modbus Information

The ET-2200 series is a family of IP-based Modbus I/O devices that allow you to remotely control DI/DO terminals via an Ethernet connection and uses a master-slave communication technique in which only one device (the master) can initiate a transaction (called queries), while other devices (slaves) respond by either supplying the requested data to the master, or by taking the action requested in the query.

Most SCADA (Supervisory Control and Data Acquisition) and HMI software, such as Citect (Schneider Electric), ICONICS, iFIX, InduSoft, Intouch, Entivity Studio, Entivity Live, Entivity VLC, Trace Mode, Wizcon (ElUTIONS), and Wonderware, etc. can be used to easily integrate serial devices via the Modbus protocol.

Modbus/TCP master applications can also be developed using any programming language, such as VB, C# and so on.
ICP DAS provides the Modbus SDK that allows development of Modbus applications on a PC.

The relevant demo programs and SDK can be obtained from the following locations:
VB Demo: http://ftp.icpdas.com/pub/cd/6000cd/napdos/et7000_et7200/demo/pc_client/
.Net demo and SDK:http://ftp.icpdas.com/pub/cd/8000cd/napdos/modbus/nmodbus/

6.1 What is Modbus TCP/IP?

Modbus is a communication protocol that was developed by Modicon Inc. in 1979. Detailed information regarding the Modbus protocol can be found at: http://www.modbus.org.

The different versions of the Modbus protocol used today include Modbus RTU, which is based on serial communication interfaces such as RS-485 and RS-232, as well as Modbus ASCII and Modbus TCP, which uses the Modbus RTU protocol embedded into TCP packets.

Modbus TCP is an internet protocol. The protocol embeds a Modbus frame into a TCP frame so that a connection oriented approach is obtained, thereby making it more reliable. The master queries the slave and the slave responds with a reply. The protocol is open and, hence, highly scalable.

6.2 Modbus Message Structure

Modbus devices communicate using a master-slave (client-server) technique in which only one device (the master/client) can initiate transactions (called queries). The other devices (slaves/servers) respond by either supplying the requested data to the master, or by taking the action requested in the query.

A query from a master will consist of a slave, or broadcast, address, a function code defining the requested action, any required data, and an error checking field. A response from a slave consists of fields confirming the action taken, any data to be returned, and an error checking field.

➢ **The Modbus/TCP Message Structure**

Bytes 00 - 05	Bytes 06 - 11
6-byte header	RTU Data

➢ **The Leading 6 bytes of a Modbus/TCP Protocol Query**

Byte 00	Byte 01	Byte 02	Byte 03	Byte 04	Byte 05
Transaction Identifier		Protocol Identifier		Length Field (upper byte)	Length Field (lower byte)

✓ **Transaction identifier =** Assigned by the Modbus/TCP master (client)
✓ **Protocol identifier =** 0
✓ **Length field (upper byte) =** 0 (since all messages are smaller than 256)
✓ **Length field (lower byte) =**The number of following RTU data bytes

➢ Modbus RTU Data Structure

Byte 06	Byte 07	Bytes 08 - 09	Bytes 10 - 11
Net ID (Station Number)	Function Code	Data Field	
		Reference Number (Address Mapping)	Number of Points

✓ **Net ID:** Specifies the address of the receiver (i.e., the Modbus/TCP slave).

✓ **Function Code:** Specifies the message type.

✓ **Data Field:** The data block.

Net ID (Station Number)

The first byte in the frame structure of a Modbus RTU query is the address of the receiver. A valid address is in the range from 0 to 247. Address 0 is used for general broadcast purposes, while addresses 1 to 247 are assigned to individual Modbus devices.

Function Code

The second byte in the message structure of a Modbus RTU query is the function code, which describes what the slave device is required to do. Valid function codes range between 1 and 255. To answer the query, the slave device uses the same function code as contained in the request. The highest bit of the function code will only be set to '1' if an error occurs in the system. In this way, the master device will know whether or not the message has been correctly transmitted.

Code	Function	Reference (Address)
01 (0x01)	Read the Status of the Coils (Read DO Readback values)	0xxxx
02 (0x02)	Read the Status of the Input (Read DI values)	1xxxx
03 (0x03)	Read the Holding Registers (Read AO Readback values)	4xxxx
04 (0x04)	Read the Input Registers (Read AI values)	3xxxx
05 (0x05)	Force a Single Coil (Write DO value)	0xxxx
06 (0x06)	Set a Single Register (Write AO value)	4xxxx
15 (0x0F)	Force Multiple Coils (Write DO values)	0xxxx
16 (0x10)	Set Multiple Registers (Write AO values)	4xxxx

Data Field

Data is transmitted in 8-, 16- and 32-bit format. The data for 16-bit registers is transmitted in high-byte first format. For example: 0x0A0B will be transmittd as 0x0A, 0x0B. The data for 32-bit registers is transmitted as two 16-bit registers, and is low-word first. For example: 0x0A0B0C0D will be transmitted as 0x0C, 0x0D, 0x0A, 0x0B.

The data field for messages sent between a master device and a slave device contains additional information about the action to be taken by the master, or any information requested by the slave. If the master does not require this information, the data field can be empty.

Reference (Address)	Description
0xxxx	**Read/Write Discrete Outputs or Coils.** An 0x reference address is used to output device data to a Digital Output channel.
1xxxx	**Read Discrete Inputs.** The ON/OFF status of a 1x reference address is controlled by the corresponding Digital Input channel.
3xxxx	**Read Input Registers.** A 3x reference register contains a 16-bit value received from an external source, e.g. an analog signal.
4xxxx	**Read/Write Output or Holding Registers.** A 4x register is used to store 16 bits of numerical data (binary or decimal), or to send data from the CPU to an output channel.

⚠️ *For more details regarding Address Mapping (Reference Number), refer to Section 6.3 "Modbus Register Table".*

01(0x01) Read the Status of the Coils (Read DO Readback vaslues)

This function code is used to read either the current status of the coils or the current Digital Output readback value from the ET-2200 series module.

[Request]

Byte	Description	Size	Value
00	Net ID (Station Number)	1 Byte	1 to 247
01	Function Code	1 Byte	0x01
02-03	Starting DO Address	2 Bytes	Refer to Section 6.3 "Modbus Register Table" for the ET-2200 series module. Byte 02 = high byte Byte 03 = low byte
04-05	Number of Points (Channels)	2 Bytes	Byte 04 = high byte Byte 05 = low byte

[Response]

Byte	Description	Size	Value
00	Net ID (Station Number)	1 Byte	1 to 247
01	Function Code	1 Byte	0x01
02	Byte Count	1 Byte	Byte Count of the Response (n = (Points+7)/8)
03	Data	n Bytes	n= 1; Byte 03 = data bit 7 to 0 n= 2; Byte 04 = data bit 15 to 8 .... n= m; Byte m+2 = data bit (8m-1) to 8(m-1)

[Error Response]

Byte	Description	Size	Value
00	Net ID (Station Number)	1 Byte	1 to 247
01	Function Code	1 Byte	0x81
02	Exception Code	1 Byte	Refer to the Modbus Standard Specifications for more details

Example: Function 01 (0x01), Readback Dos

➢ **Reads the Digital Output value**

	[Leading 6 bytes]	[Request]
Command:	01 02 00 00 00 06	01 01 00 00 00 02
	[Leading 6 bytes]	[Response]
Response:	01 02 00 00 00 04	01 01 01 03

➢ **A description of the command and response is as follows:**

Command: [Leading 6 bytes]
Bytes 00-03   01 02 00 00 (Message Number)
Bytes 04-05   00 06 (Number of bytes remaining in this frame)

[Request]
Byte 00   01 (Net ID)
Byte 01   01 (Function Code)
Byte 02-03   00 00 (Starting DO Address)
Byte 04-05   00 02 (Number of Points)

Response: [Leading 6 bytes]
Bytes 00-03   01 02 00 00 (Message Number)
Bytes 04-05   00 04 (Number of bytes remaining in this frame)

[Response]
Byte 00   01 (Net ID)
Byte 01   01 (Function Code)
Byte 02   01 (Byte Count of the Response)
Byte 03   03 (Value for DO0 to DO1)

02(0x02) Read the Status of the Input (Read DI values)

This function code is used to read the current Digital Input value from the ET-2200 series module.

[Request]

Byte	Description	Size	Value
00	Net ID (Station Number)	1 Byte	1 to 247
01	Function Code	1 Byte	0x02
02-03	Starting DI Address	2 Bytes	Refer to Section 6.3 "Modbus Register Table" for the ET-2200 series module. Byte 02 = high byte Byte 03 = low byte
04-05	Number of Points (Channels)	2 Bytes	Byte 04 = high byte Byte 05 = low byte

[Response]

Byte	Description	Size	Value
00	Net ID (Station Number)	1 Byte	1 to 247
01	Function Code	1 Byte	0x02
02	Byte Count	1 Byte	Byte Count of Response (n =(Points+7)/8)
03	Data	n Bytes	n= 1; Byte 03 = data bit 7 to 0 n= 2; Byte 04 = data bit 15 to 8 .... n= m; Byte m+2 = data bit (8m-1) to 8(m-1)

[Error Response]

Byte	Description	Size	Value
00	Net ID (Station Number)	1 Byte	1 to 247
01	Function Code	1 Byte	0x82
02	Exception Code	1 Byte	Refer to the Modbus Standard Specifications for more details

Example: Function 02 (0x02), ReadDIs

➢ **Reads the Digital Input value**

	[Leading 6 bytes]	[Request]
Command:	01 02 00 00 00 06	01 02 00 00 00 02
	[Leading 6 bytes]	[Response]
Response:	01 02 00 00 00 04	01 02 01 03

➢ **A description of the command and response is as follows:**

Command:　　　**[Leading 6 bytes]**

Bytes 00-03	01 02 00 00	(Message Number)
Bytes 04-05	00 06	(Number of bytes remaining in this frame)

[Request]

Byte 00	01	(Net ID)
Byte 01	02	(Function Code)
Byte 02-03	00 00	(Starting DI Address)
Byte 04-05	00 02	(Number of Points)

Response:　　　**[Leading 6 bytes]**

Bytes 00-03	01 02 00 00	(Message Number)
Bytes 04-05	00 04	(Number of bytes remaining in this frame)

[Response]

Byte 00	01	(Net ID)
Byte 01	02	(Function Code)
Byte 02	01	(Byte Count of the Response)
Byte 03	03	(Value for DI0 to DI1)

03(0x03) Read the Holding Registers (Read AO Readback values)

This function code is used to readback either the current values in the holding registers or the Analog Output value from the ET-2200 series module. These registers are also used to store the preset valuesfor the Digital Counter, the host watchdog timer, the module name and the TCP timeout, etc.

[Request]

Byte	Description	Size	Value
00	Net ID (Station Number)	1 Byte	1 to 247
01	Function Code	1 Byte	0x03
02-03	Starting AO Address	2 Bytes	Refer to Section 6.3 "Modbus Register Table" for the ET-2200 series module. Byte 02 = high byte Byte 03 = low byte
04-05	Number of 16-bit Registers (Channels)	2 Bytes	Word Count Byte 04 = high byte Byte 05 = low byte

[Response]

Byte	Description	Size	Value
00	Net ID (Station Number)	1 Byte	1 to 247
01	Function Code	1 Byte	0x03
02	Byte Count	1 Byte	Byte Count of the Response (n=Points x 2 Bytes)
03~	Register Values	n Bytes	Register Values n= 2;　Byte 03 = high byte 　　　　Byte 04 = low byte .... n= m;　Byte 03 = high byte 　　　　Byte 04 = low byte .... Byte m+1 = high byte Byte m+2 = low byte

[Error Response]

Byte	Description	Size	Value
00	Net ID (Station Number)	1 Byte	1 to 247
01	Function Code	1 Byte	0x83
02	Exception Code	1 Byte	Refer to the Modbus Standard Specifications for more details

Example: Function 03 (0x03), Read AOs

➢ **Reads the name of the module for the ET-2260**

	[Leading 6 bytes]	[Request]
Command:	01 02 00 00 00 06	01 03 01 03 00 01
	[Leading 6 bytes]	**[Response]**
Response:	01 02 00 00 00 07	01 03 022260

➢ **A description of the command and response is as follows:**

Command: [Leading 6 bytes]

Bytes 00-03	01 02 00 00 (Message Number)
Bytes 04-05	00 06 (Number of bytes remaining in this frame)

[Request]

Byte 00	01 (Net ID)
Byte 01	03 (Function Code)
Byte 02-03	01 03 (Starting AO Address)
Byte 04-05	00 01 (Number of Points)

Response: [Leading 6 bytes]

Bytes 00-03	01 02 00 00 (Message Number)
Bytes 04-05	00 07 (Number of bytes remaining in this frame)

[Response]

Byte 00	01 (Net ID)
Byte 01	03 (Function Code)
Byte 02	02 (Byte Count of the Response)
Byte 03-04	2260 (Module Name)

04(0x04) Read the Input Registers (Read AI values)

This function code is used to read either the input registers or the current analog input value from the ET-2200 series module.These registers are also used to store the current value for the digital counter, the number of DI channels and the number of DO channels, etc.

[Request]

Byte	Description	Size	Value
00	Net ID (Station Number)	1 Byte	1 to 247
01	Function Code	1 Byte	0x04
02-03	Starting AI Address	2 Bytes	Refer to Section 6.3 "Modbus Register Table" for the ET-2200 series module. Byte 02 = high byte Byte 03 = low byte
04-05	Number of 16-bit Registers (Channels)	2 Bytes	Word Count Byte 04 = high byte Byte 05 = low byte

[Response]

Byte	Description	Size	Value
00	Net ID (Station Number)	1 Byte	1 to 247
01	Function Code	1 Byte	0x04
02	Byte Count	1 Byte	Byte Count of the Response (n=Points x 2 Bytes)
03~	Register Values	n Bytes	Register Values n= 2; Byte 03 = high byte Byte 04 = low byte .... n= m; Byte 03 = high byte Byte 04 = low byte .... Byte m+1 = high byte Byte m+2 = low byte

[Error Response]

Byte	Description	Size	Value
00	Net ID (Station Number)	1 Byte	1 to 247
01	Function Code	1 Byte	0x84
02	Exception Code	1 Byte	Refer to the Modbus Standard Specifications for more details.

Example: Function 04 (0x04), Read AIs

➢ **Reads the number of the DI channels on the ET-2260**

	[Leading 6 bytes]	[Request]
Command:	01 02 00 00 00 06	01 04 00 64 00 01
	[Leading 6 bytes]	[Response]
Response:	01 02 00 00 00 05	01 04 0200 02

➢ **A description of the command and response is as follows:**

Command: [Leading 6 bytes]

Bytes 00-03	01 02 00 00 (Message Number)
Bytes 04-05	00 06 (Number of bytes remaining in this frame)

[Request]

Byte 00	01 (Net ID)
Byte 01	04 (Function Code)
Byte 02-03	0064 (Starting AI Address)
Byte 04-05	00 01 (Number of 16-bit Registers)

Response: [Leading 6 bytes]

Bytes 00-03	01 02 00 00 (Message Number)
Bytes 04-05	00 05 (Number of bytes remaining in this frame)

[Response]

Byte 00	01 (Net ID)
Byte 01	04 (Function Code)
Byte 02	02 (Byte Count of the Response)
Byte 03-04	00 02 (Number of DI channels on the ET-2260)

05(0x05) Force a Single Coil (Write DO value)

This function code is used to set the status of a single coil or a single Digital Output value for the ET-2200 series module.

[Request]

Byte	Description	Size	Value
00	Net ID (Station Number)	1 Byte	1 to 247
01	Function Code	1 Byte	0x05
02-03	DO Address	2 Bytes	Refer to Section 6.3 "Modbus Register Table" for the ET-2200 series module. Byte 02 = high byte Byte 03 = low byte
04-05	Output Value	2 Bytes	0xFF 00 sets the output to ON. 0x00 00 sets the output to OFF. All other values are invalid and will not affect the coil. Byte 04 = high byte Byte 05 = low byte

[Response]

Byte	Description	Size	Value
00	Net ID (Station Number)	1 Byte	1 to 247
01	Function Code	1 Byte	0x05
02-03	DO Address	2 Bytes	The value is the same as Bytes 02-03 of the Request
04-05	Output Value	2 Bytes	The value is the same as Bytes 04-05 of the Request

[Error Response]

Byte	Description	Size	Value
00	Net ID (Station Number)	1 Byte	1 to 247
01	Function Code	1 Byte	0x85
02	Exception Code	1 Byte	Refer to the Modbus Standard Specifications for more details.

Example: Function 05 (0x05), WriteDO

➢ **Sets channel DO1 to ON**

	[Leading 6 bytes]	[Request]
Command:	01 02 00 00 00 06	01 05 00 01FF 00
	[Leading 6 bytes]	[Response]
Response:	01 02 00 00 00 06	01 05 0001FF 00

➢ **A description of the command and response is as follows:**

Command: [Leading 6 bytes]

Bytes 00-03	01 02 00 00 (Message Number)
Bytes 04-05	00 06 (Number of bytes remaining in this frame)

[Request]

Byte 00	01 (Net ID)
Byte 01	05 (Function Code)
Byte 02-03	0001(DO Address)
Byte 04-05	FF 00 (Setsthe output to ON)

Response: [Leading 6 bytes]

Bytes 00-03	01 02 00 00 (Message Number)
Bytes 04-05	00 06 (Number of bytes remaining in this frame)

[Response]

Byte 00	01 (Net ID)
Byte 01	05 (Function Code)
Byte 02-03	00 01(DO Address)
Byte 04-05	FF 00 (Indicates that the DO has been set to ON)

06(0x06) Set a Single Register (Write AO value)

This function code is used to set a specific holding register to store the configuration valuesfor the ET-2200 series module.

[Request]

Byte	Description	Size	Value
00	Net ID (Station Number)	1 Byte	1 to 247
01	Function Code	1 Byte	0x06
02-03	AO Address	2 Bytes	Refer to Section 6.3 "Modbus Register Table" for the ET-2200 series module. Byte 02 = high byte Byte 03 = low byte
04-05	Register Value	2 Bytes	Register Value Byte 04 = high byte Byte 05 = low byte

[Response]

Byte	Description	Size	Value
00	Net ID (Station Number)	1 Byte	1 to 247
01	Function Code	1 Byte	0x06
02-03	AO Address	2 Bytes	The value is the same as Bytes 02-03 of the Request
04-05	Register Value	2 Bytes	The value is the same as Bytes 04-05 of the Request

[Error Response]

Byte	Description	Size	Value
00	Net ID (Station Number)	1 Byte	1 to 247
01	Function Code	1 Byte	0x86
02	Exception Code	1 Byte	Refer to the Modbus Standard Specifications for more details.

Example: Function 06 (0x06), WriteAO

➢ **Sets the system timeout to 60 seconds**

	[Leading 6 bytes]	[Request]
Command:	01 02 00 00 00 06	01 06 0108003C
	[Leading 6 bytes]	[Response]
Response:	01 02 00 00 00 06	01 06 0108003C

➢ **A description of the command and response is as follows:**

Command:	[Leading 6 bytes]

Bytes 00-03	01 02 00 00 (Message Number)

Bytes 04-05	00 06 (Number of bytes remaining in this frame)

[Request]

Byte 00	01 (Net ID)

Byte 01	06 (Function Code)

Byte 02-03	0108 (AO Address)

Byte 04-05	003C (Setsthe system timeout to 60 seconds)

Response:	[Leading 6 bytes]

Bytes 00-03	01 02 00 00 (Message Number)

Bytes 04-05	00 06 (Number of bytes remaining in this frame)

[Response]

Byte 00	01 (Net ID)

Byte 01	06 (Function Code)

Byte 02-03	01 08 (AO Address)

Byte 04-05	003C (Indicates that the system timeouthas been set to 60 seconds)

15(0x0F) Force Multiple Coils (Write DO values)

This function code is used to set the status of multiple coils or to write multiple Digital Output values for the ET-2200 series module.

[Request]

Byte	Description	Size	Value
00	Net ID (Station Number)	1 Byte	1 to 247
01	Function Code	1 Byte	0x0F
02-03	Starting DO Address	2 Bytes	Refer to Section 6.3 "Modbus Register Table" for the ET-2200 series module. Byte 02 = high byte Byte 03 = low byte
04-05	Number of Output Channels (Points)	2 Bytes	Byte 04 = high byte Byte 05 = low byte
06	Byte count	1 Byte	n = (Points +7)/8
07	Output value	n Bytes	A bit corresponds to a channel. A value of 1 for a bit denotes that the channel is ON, while a value of denotes that the channel is OFF. n= 1; Byte 07 = data bit 7 to 0 n= 2; Byte 08 = data bit 15 to 8 .... n= m; Byte m+6 = data bit (8m-1) to 8 (m-1)

[Response]

Byte	Description	Size	Value
00	Net ID (Station Number)	1 Byte	1 to 247
01	Function Code	1 Byte	0x0F
02-03	Starting DO Address	2 Bytes	The value is the same as Bytes 02-03 of the Request
04-05	Number of Output Channels (Points)	2Bytes	The value is the same as Bytes 04-05 of the Request

[Error Response]

Byte	Description	Size	Value
00	Net ID (Station Number)	1 Byte	1to 247
01	Function Code	1 Byte	0x8F
02	Exception Code	1 Byte	Refer to the Modbus Standard Specifications for more details.

Example: Function 15 (0x0F), WriteDOs

➢ **Sets the safe value (DO0 ~ DO1)**

	[Leading 6 bytes]	[Request]
Command:	01 02 00 00 00 08	01 0F 010B0002 01 03
	[Leading 6 bytes]	[Response]
Response:	01 02 00 00 00 06	01 0F 010B 00 02

➢ **A description of the command and response is as follows:**

Command:

[Leading 6 bytes]

Bytes 00-03	01 02 00 00 (Message Number)
Bytes 04-05	00 08 (Number of bytes remaining in this frame)

[Request]

Byte 00	01 (Net ID)
Byte 01	0F (Function Code)
Byte 02-03	010B (Starting DO Address)
Byte 04-05	0002 (Number of Output Channels)
Byte 06	01 (Byte Count)
Byte 07	03 (Output Value)

Response:

[Leading 6 bytes]

Bytes 00-03	01 02 00 00 (Message Number)
Bytes 04-05	00 06 (Number of bytes remaining in this frame)

[Response]

Byte 00	01 (Net ID)
Byte 01	0F (Function Code)
Byte 02-03	01 0B (Starting DO Address)
Byte 04-05	00 02 (Number of Input Channels)

16(0x10) Set Multiple Registers (Write AO values)

This function code is used to set multiple holding registers that are used to store the configuration valuesfor the ET-2200 series module.

[Request]

Byte	Description	Size	Value
00	Net ID (Station Number)	1 Byte	1 to 247
01	Function Code	1 Byte	0x10
02-03	Starting AO Address	2 Bytes	Refer to Section 6.3 "Modbus Register Table" for the ET-2200 series module. Byte 02 = high byte Byte 03 = low byte
04-05	Number of 16-bit Registers (Channels)	2 Bytes	Word Count. Byte 04 = high byte Byte 05 = low byte
06	Byte Count	1 Byte	n =Points x 2 Bytes
07	Register Values	n Bytes	Register Values. n= 2; Byte 03 = high byte Byte 04 = low byte .... n= m; Byte 03 = high byte Byte 04 = low byte .... Byte m+1 = high byte Byte m+2 = low byte

[Response]

Byte	Description	Size	Value
00	Net ID (Station Number)	1 Byte	1 to 247
01	Function Code	1 Byte	0x10
02-03	Starting AO Address	2 Bytes	The value is the same as Bytes 02-03 of the Request
04-05	Number of 16-bit Registers (Channels)	2 Bytes	The value is the same as Bytes 04-05 of the Request

[Error Response]

Byte	Description	Size	Value
00	Net ID (Station Number)	1 Byte	1 to 247
01	Function Code	1 Byte	0x90
02	Exception Code	1 Byte	Refer to the Modbus Standard Specifications for more details.

Example: Function 16 (0x10), WriteAOs

➢ **Sets the preset value for the digital counter**

	[Leading 6 bytes]	[Request]
Command:	01 02 00 00 00 0B	01 10 00320001 02 03 E8 00 00
	[Leading 6 bytes]	[Response]
Response:	01 02 00 00 00 06	01 10 0032 00 01

➢ **A description of the command and response is as follows:**

Command:

[Leading 6 bytes]

Bytes 00-03	01 02 00 00 (Message Number)
Bytes 04-05	00 0B (Number of bytes remaining in this frame)

[Request]

Byte 00	01 (Net ID)
Byte 01	10 (Function Code)
Byte 02-03	0032 (Starting AO Address)
Byte 04-05	0001 (Number of 16-bit Registers)
Byte 06	02 (Byte Count)
Byte 07-10	03 E8 00 00 (Preset value for the digital counter)

Response:

[Leading 6 bytes]

Bytes 00-03	01 02 00 00 (Message Number)
Bytes 04-05	00 06 (Number of bytes remaining in this frame)

[Response]

Byte 00	01 (Net ID)
Byte 01	10 (Function Code)
Byte 02-03	0032 (Starting AO Address)
Byte 04-05	00 01 (word count)

6.3 Modbus Register Table

Data from 16-bit registers is transmitted in high-byte first order. For example: 0x0A0B ==> 0x0A, 0x0B. Data from 32-bit registers is transmitted as two 16-bit registers, and is in low-word first order. For example: 0x0A0B0C0D ==> 0x0C, 0x0D, 0x0A, 0x0B.

6.3.1 Common Functions

➢ **0xxxx: DO Address (Base 0)**

Starting Address	Points	Description	Bits per Point	Range	Access Type
127 (0x7F)	1	Restores all default web settings	1	1 = Restore	W (Pulse)
128 (0x80)	1	Default ID Settings	1	1 = Restore	W (Pulse)
133 (0x85)	1	Reboots the ET-2200 module	1	1 = Reboot	W (Pulse)
Notes	"**W**": Write				

➢ **3xxxx: AIAddress (Base 0)**

Starting Address	Points	Description	Bits per Point	Range	Access Type
151 (0x97)	1	Firmware Version	16	"123" denotes that the version is 1.2.3	R
158 (0x9E)	1	Modbus Communication Status	16	0 = No Error 1 = Timeout	R
160 (0xA0)	1	Pair-Connection Status	16	0 = Normal 1 = Timeout 2 = Disconnected	R
Notes	"**R**": Read				

➤ 4xxxx: AOAddress (Base 0)

Starting Address	Points	Description	Bits per Point	Range	Access Type
255 (0xFF)	1	CPU Reset Status	16	1 = Reset at Power-on 2 = Reset by the WDT 3 = Reset using the reset command	R/W
257 (0x101)	1	Setsthe Host Watchdog Timer (WDT)	16	**<5:** Disabled **5 to 65535:** Enabled (units: seconds) **0:**Default If the ET-2200 series module loses communication with the host PC for more than the period defined in the WDT settings, the DO channels will revert to their safe values and the Host WDT Events Counter will be increased by one.	R/W/F
258 (0x102)	1	Host WDT Events	16	Denotes how many Host WDT Events have occurred since the last CPU reset	R/W
259 (0x103)	1	Module Name	16	Module Name	R
263 (0x107)	1	Setsthe TCP Timeout Value	16	**<5:** Disabled **5 to 65535:** Enabled (units: seconds) **0:** Default	R/W/F
264 (0x108)	1	Setsthe System Timeout Value	16	**<30:** Disabled **30~65535:** Enabled (unit: second) **0:** default	R/W/F
Notes	**"R":** Read; **"W":** Write; **"F":** Setting is recorded in flash as default. **Warning:** Frequent writing to the Flash can cause it to become corrupt.				

6.3.2 Specific Functions

The nDI and nDO parameters for each ET-2200 series module used in the following Modbus Address Tables are as follows:

Model Name	Universal DIO (UDIO)	Number of DO channels (nDO)	Number of DI channels (nDI)
ET-2242 ET-2242U	-	16	-
ET-2251	-	-	16
ET-2254 ET-2254P	16	Depend on your configuration	Depend on your configuration
ET-2255 ET-2255U	-	8	8
ET-2260	-	6	6
ET-2261	-	10	-
ET-2261-16	-	16	-
ET-2268	-	8	-

> ➤ **0xxxx: DOAddress (Base 0)**

Starting Address	Points	Description	Bits per Point	Range	Access Type
0 (0x00)	1 to nDO	Digital Output Channels	1	0 = Off 1 = On	R/W
32 (0x20)	1	Clears the status of all high latched DI Channels	1	1 = Clear	W
33 (0x21)	1	Clearsthe status of all low latched DI Channels	1	1 = Clear	W
34 (0x22)	1 to nDI	Clears the high speed digital counter for all DI Channels	1	1 = Clear	W
60 (0x3C)	1	Saves specific data to Flash (The access type for some registersis labeled with an "**E**")	1	0: cannot be write 1: can be write	W
100 (0x64)	1 to nDO	Enables the PWM for all DO Channels	1	0 = Off 1 = On (Default= 0)	R/W
150 (0x96)	1	Enables the high and low latches for all DI Channels	1	0 = Disable 1 = Enable (Default= 0)	R/W/F

151 (0x97)	1 to nDI	Enables the high speed digital counter for all DI Channels	1	0 = Disable 1 = Enable (Default= 0)	R/W/F
190 (0xBE)	1 to nDI	Enables frequency measurement for all DI Channels	1	0 = Disable 1 = Enable (Default= 0)	R/W/F
235 (0xEB)	1 to nDO	Sets the Power-on value for all DO Channels	1	0 = Off 1 = On (Default= 0)	R/W/F
267 (0x10B)	1 to nDO	Sets the Safe value for all DO Channels	1	0 = Off 1 = On (Default= 0)	R/W/F
299 (0x12B)	1	Force the DI/DO Mode. **(for the ET-2254 only)** 0 = Dynamic I/O type based on DO requests. 1 = Static I/O type by configuration (web or Modbus).	1	0 = Dynamic 1= Static	R/W
300 ~ 315 (0x12C ~ 0x13B)	1 to UDIO	Sets the Universal DIO channels to DI or DO Port. **(for the ET-2254 only)** 300 is the CH0 address, 301 is the CH1 address, and so on.	1	0 = DO type 1= DI type	R/W
Notes	"**R**": Read "**W**": Write "**F**": Settings are recorded in flash by default "**E**": After writing DO[60] register, the data will be stored in flash. **Warning:** Frequency writing to the Flash can cause it to become corrupt.				

⚠️ *Because of the characteristics of the relay functions, it is recommended that the PWM on ET-2260/2261/2268 series (i.e., modules with relay functions) is not used for extended periods of time.*

➤ **1xxxx: DIAddress (Base 0)**
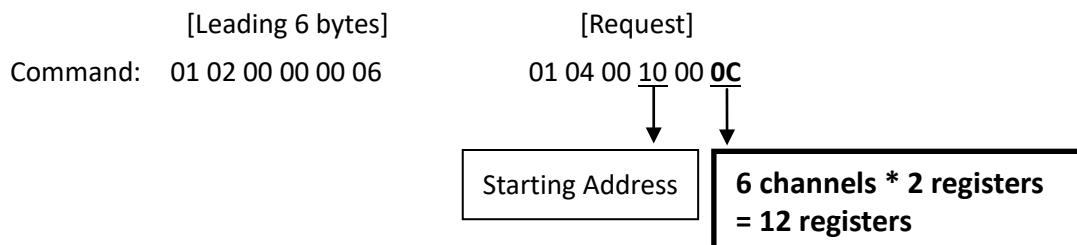
Starting Address	Points	Description	Bits per Point	Range	Access Type
0 (0x00)	1 to nDI	The status of all Digital Input Channels	1	0 = Off 1 = On	R
32 (0x20)	1 to nDI	The status of all high latched DI Channels	1	0 = None 1 = Latched	R
64 (0x40)	1 to nDI	The status of all low latched DI Channels	1	0 = None 1 = Latched	R
Notes	"**R**": Read				

➢ **3xxxx: AIAddress (Base 0)**

Starting Address	Points	Description	Bits per Point	Value	Access Type
16 (0x10)	1 to nDI	The Digital Counter Value	32	0 to 4294967296	R
64 (0x40)	1 to nDI	The frequency Value * 1,000. (Note: The Client must first divide the value by 1,000.)	32	0 to 4294967296	R

⚠️ *Note: The "DI Counter (0x10)" and "DI Frequency (0x40)" that the records data as 32-bit value and is transmitted as two 16-bit registers. Consequently, the register address has an offset of 2, i.e., the address of the second channel will be at starting-address +2, and so on. You can refer to "FAQ003_How do I read DI Counter for the PETL/tET/tPET Series Modules correctly" for more detailed information.*

Example: Reads the 6 DI Counter on the ET-2260.

	[Leading 6 bytes]	[Request]
Command:	01 02 00 00 00 06	01 04 00 <u>10</u> 00 **0C**

Starting Address

6 channels * 2 registers = 12 registers
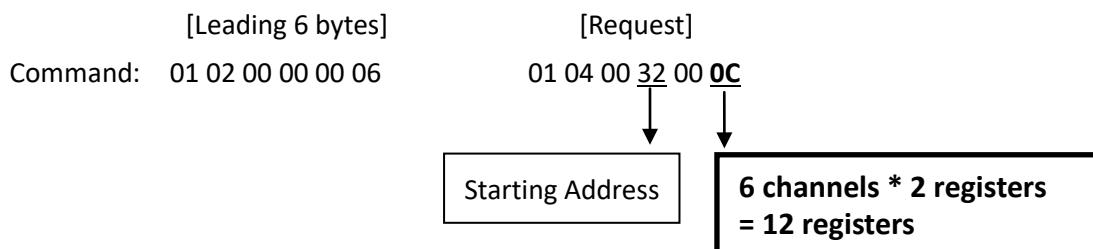
Starting Address	Points	Description	Bits per Point	Value	Access Type
100 (0x64)	1	Number of DI Channels	16	nDI	R
110 (0x6E)	1	Number of DO Channels	16	nDO	R
121 (0x79)	1	Number of high-speed counters	16	nDI	R
Notes	"**R**": Read				

➢ 4xxxx: AOAddress (Base 0)

Starting Address	Points	Description	Bits per Point	Range	Access Type
50 (0x32)	1 to nDI	The preset value for the high speed digital counter	32	0 to 4294967296	R/W/E

⚠️ *Note: "Preset DI Counter Value (0x32)" that the records data as 32-bit valueand is transmitted as two 16-bit registers.Consequently, the register address has an offset of 2, i.e.,the address of the second channel will be at starting-address +2, and so on. You can refer to "FAQ003_How do I read DI Counter for the PETL/tET/tPET Series Modules correctly" for more detailed information.*

Example: Reads the preset value of 6DI Counteron the ET-2260.

          [Leading 6 bytes]   [Request]

Command: 01 02 00 00 00 06   01 04 00 <u>32</u> 00 **<u>0C</u>**

                                    ↓   ↓

                 | Starting Address | | **6 channels * 2 registers = 12 registers** |

Starting Address	Points	Description	Bits per Point	Range	Access Type
100 (0x64)	1 to nDO	The duty cycle for the DO PWM The first word (16-bit register) is the high pulse width, while the second word is the low pulse width. The units rein ms, and the resolution is about 10 ms.	32	0 to 65535; 0 to 65535;	R/W/E
150 (0x64)	1 to nDO	The Scan mode for the DI frequency measurement. Refer to Section 4.4.2 "DI/DO Configuration" for more details.	16	1000= 1000ms 100= 100ms 2000=Single pulse	R/W/F
200 (0x64)	1 to nDI	The moving average of the DI frequency measurement.	16	1=No average 2= Average 2 values 4= Average 4 values 8=Average 8 values	R/W/F

| 268 (0x10C)	1 to nDO	The Min-Switching Time for all DO Channels	16	1 to 65535 second	R/W/F
284 (0x11C)	1 to nDO	The Auto-off Time for all DO Channels	16	1 to 65535 second	R/W/F
Notes	"**R**": Read "**W**": Write "**F**": Settings are recorded in flash by default "**E**": After writing the DO[60] register, the data will be stored in flash. **Warning:** Frequent writing to the Flash can cause it to become corrupt.				
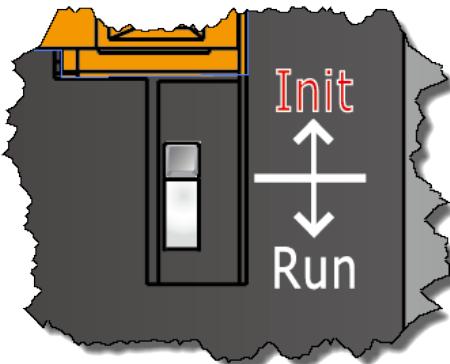
Appendix A: Troubleshooting

How do I restore the web password for the module to the factory default password?
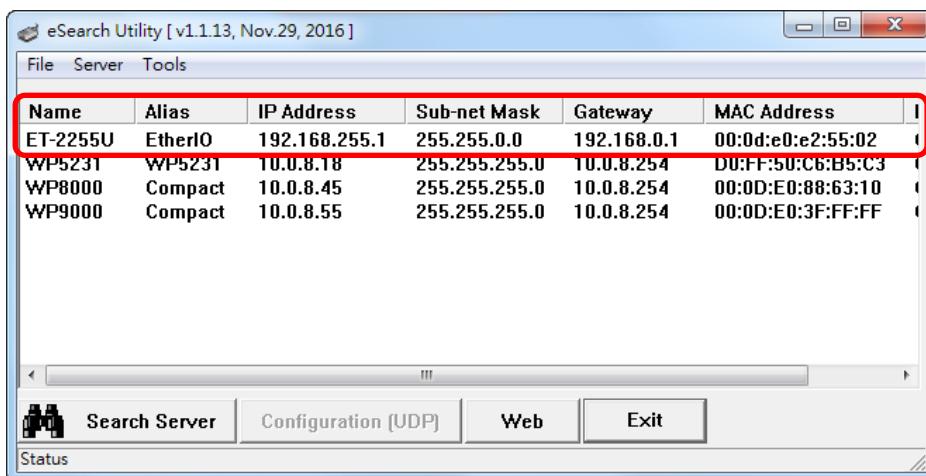
The instructions below outline the procedure for resetting the web password to the factory default value.

*Note: Be aware that **ALL** settings will be restored to the factory default values after the module is reset.*
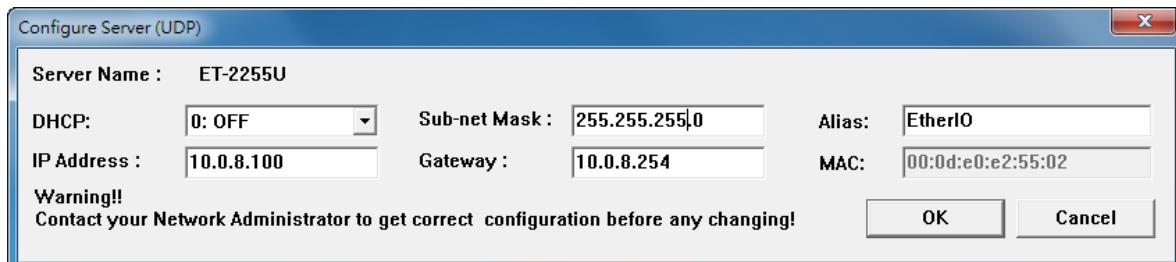
Step 1 Locate the Init/Run switch that can be found on the top side of the ET-2200 module and set it to the **"Init"** position. Reboot the module to **load factory default settings** including default web password.
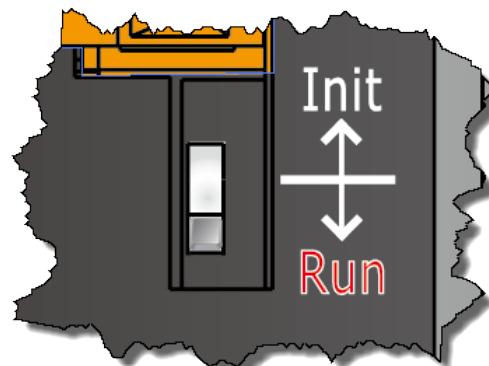

Step 2 Execute either the VxComm Utility or the eSearch Utility to search for any ET-2200 modules connected to the network. Verify that the ET-2200 has been reset to the original factory default settings. For example, the module should be shown as having the default IP address, which is 192.168.255.1.
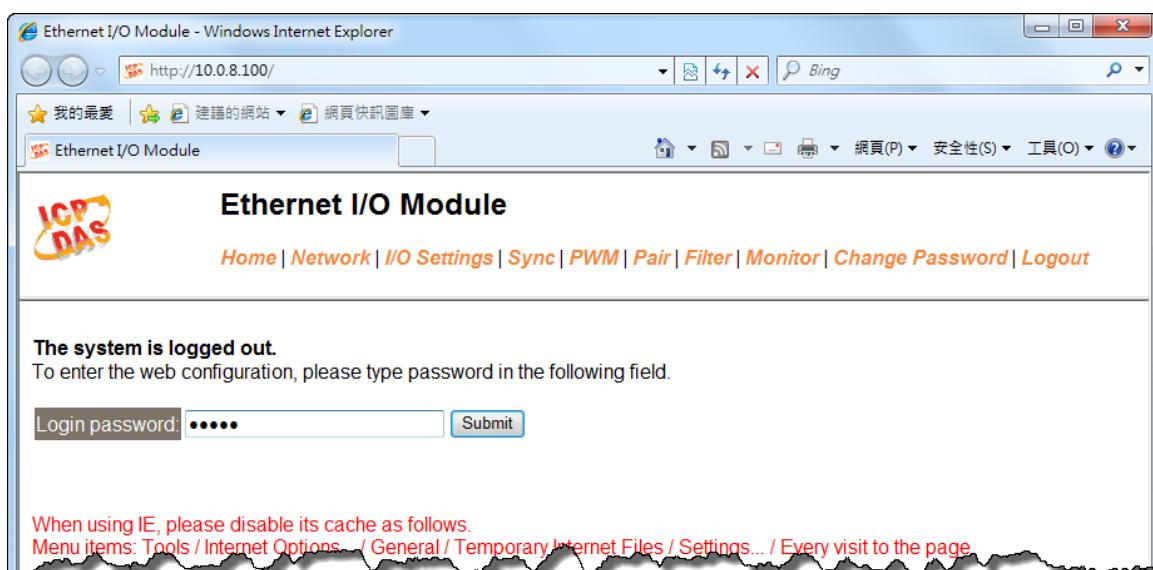
Step 3 Double-click the name of the module to open the Configure Server (UDP) dialog box, and modify the basic settings as necessary, e.g., the IP, Mask and Gateway addresses, and then click the **"OK"** button to **save the new settings**.

Step 4 Reset the Init/Run switch on the ET-2200 module to the **"Run"** position and reboot the device.

Step 5 Log in to the web configuration pages for the ET-2200 module, using the default web password, **"Admin"**.

Appendix B: Revision History

This chapter provides revision history information to this document.

The table below shows the revision history.

Revision	Date	Description
1.0.0	Sep. 2015	Initial issue
1.1.0	Nov. 2015	Added the software and hardware information about the ET-2242, ET-2251 and ET-2255.
1.1.3	Feb. 2016	1. Added the software and hardware information about the ET-2254P, ET-2261 and ET-2268. 2. Updated the information about the Firmware Version v1.3.9 [Jan.20, 2016] in Chapter 4 Web Configuration.
1.2.0	Jul. 2017	1. Added the software and hardware information about the ET-2242U and ET-2255U. 2. Updated the information about the Firmware Version v1.4.6 [Jun.16, 2017] in Chapter 4 Web Configuration. 3. Added Chapter Appendix A:Troubleshooting. 4. Added Chapter Appendix B: Revision History.
1.3.0	Jun. 2018	Added the hardware information about the ET-2261-16.