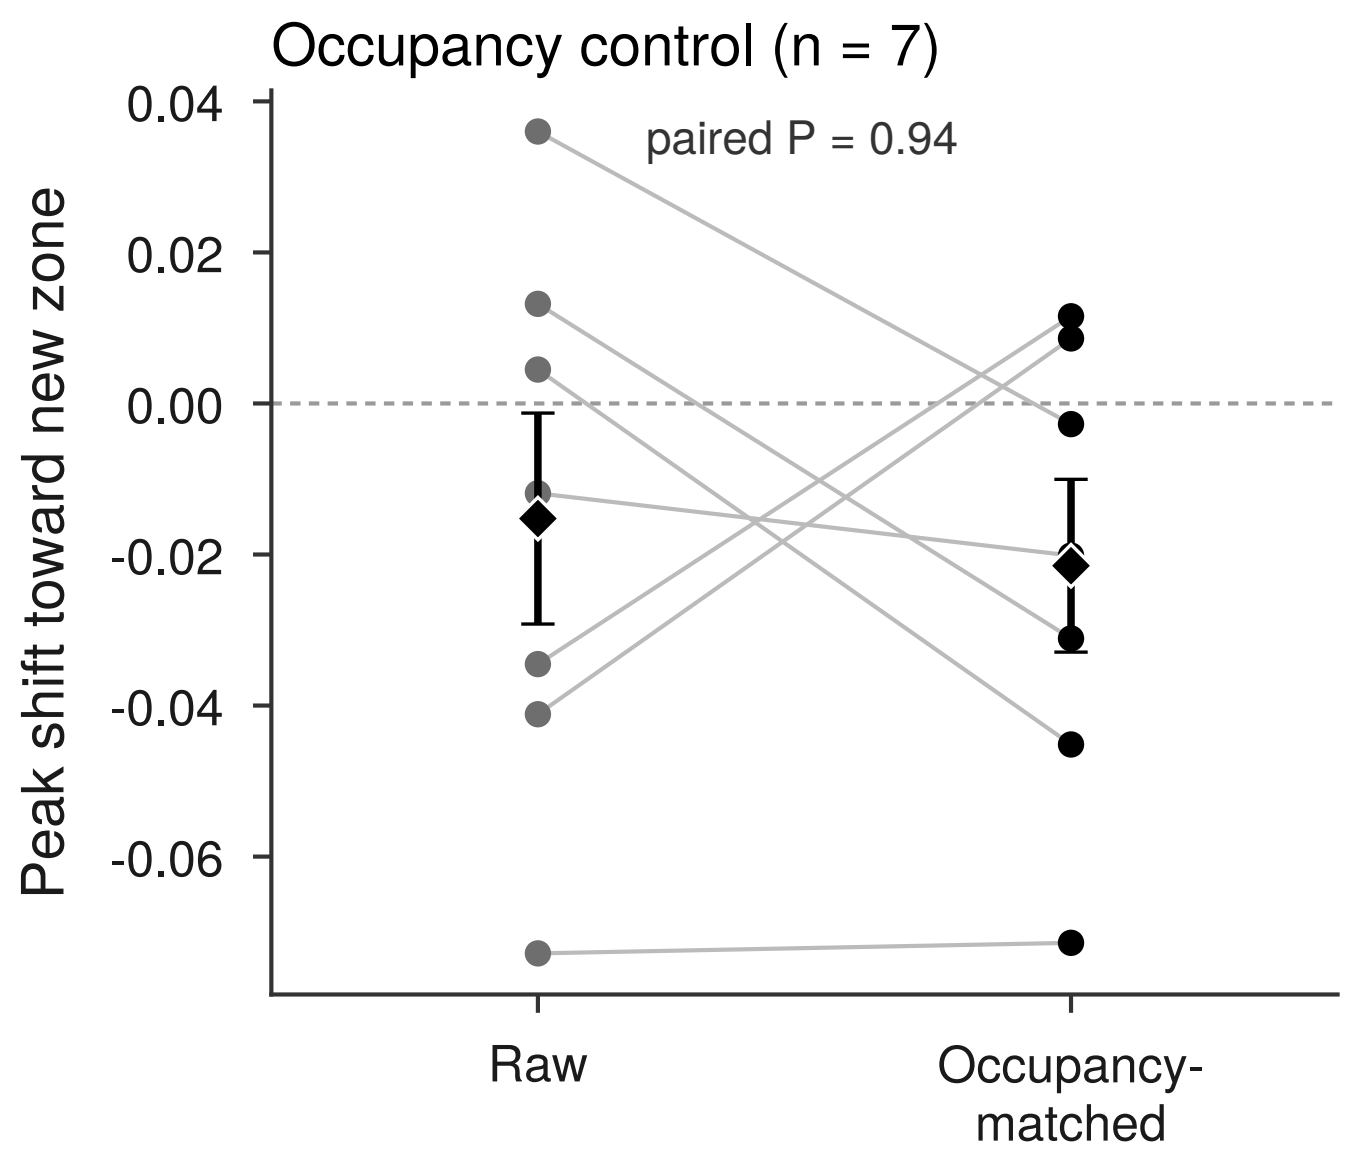
Occupancy control (n = 7)
paired P = 0.94
Peak shift toward new zone
0.04
0.02
0.00
-0.02
-0.04
-0.06
Raw
Occupancy-matched