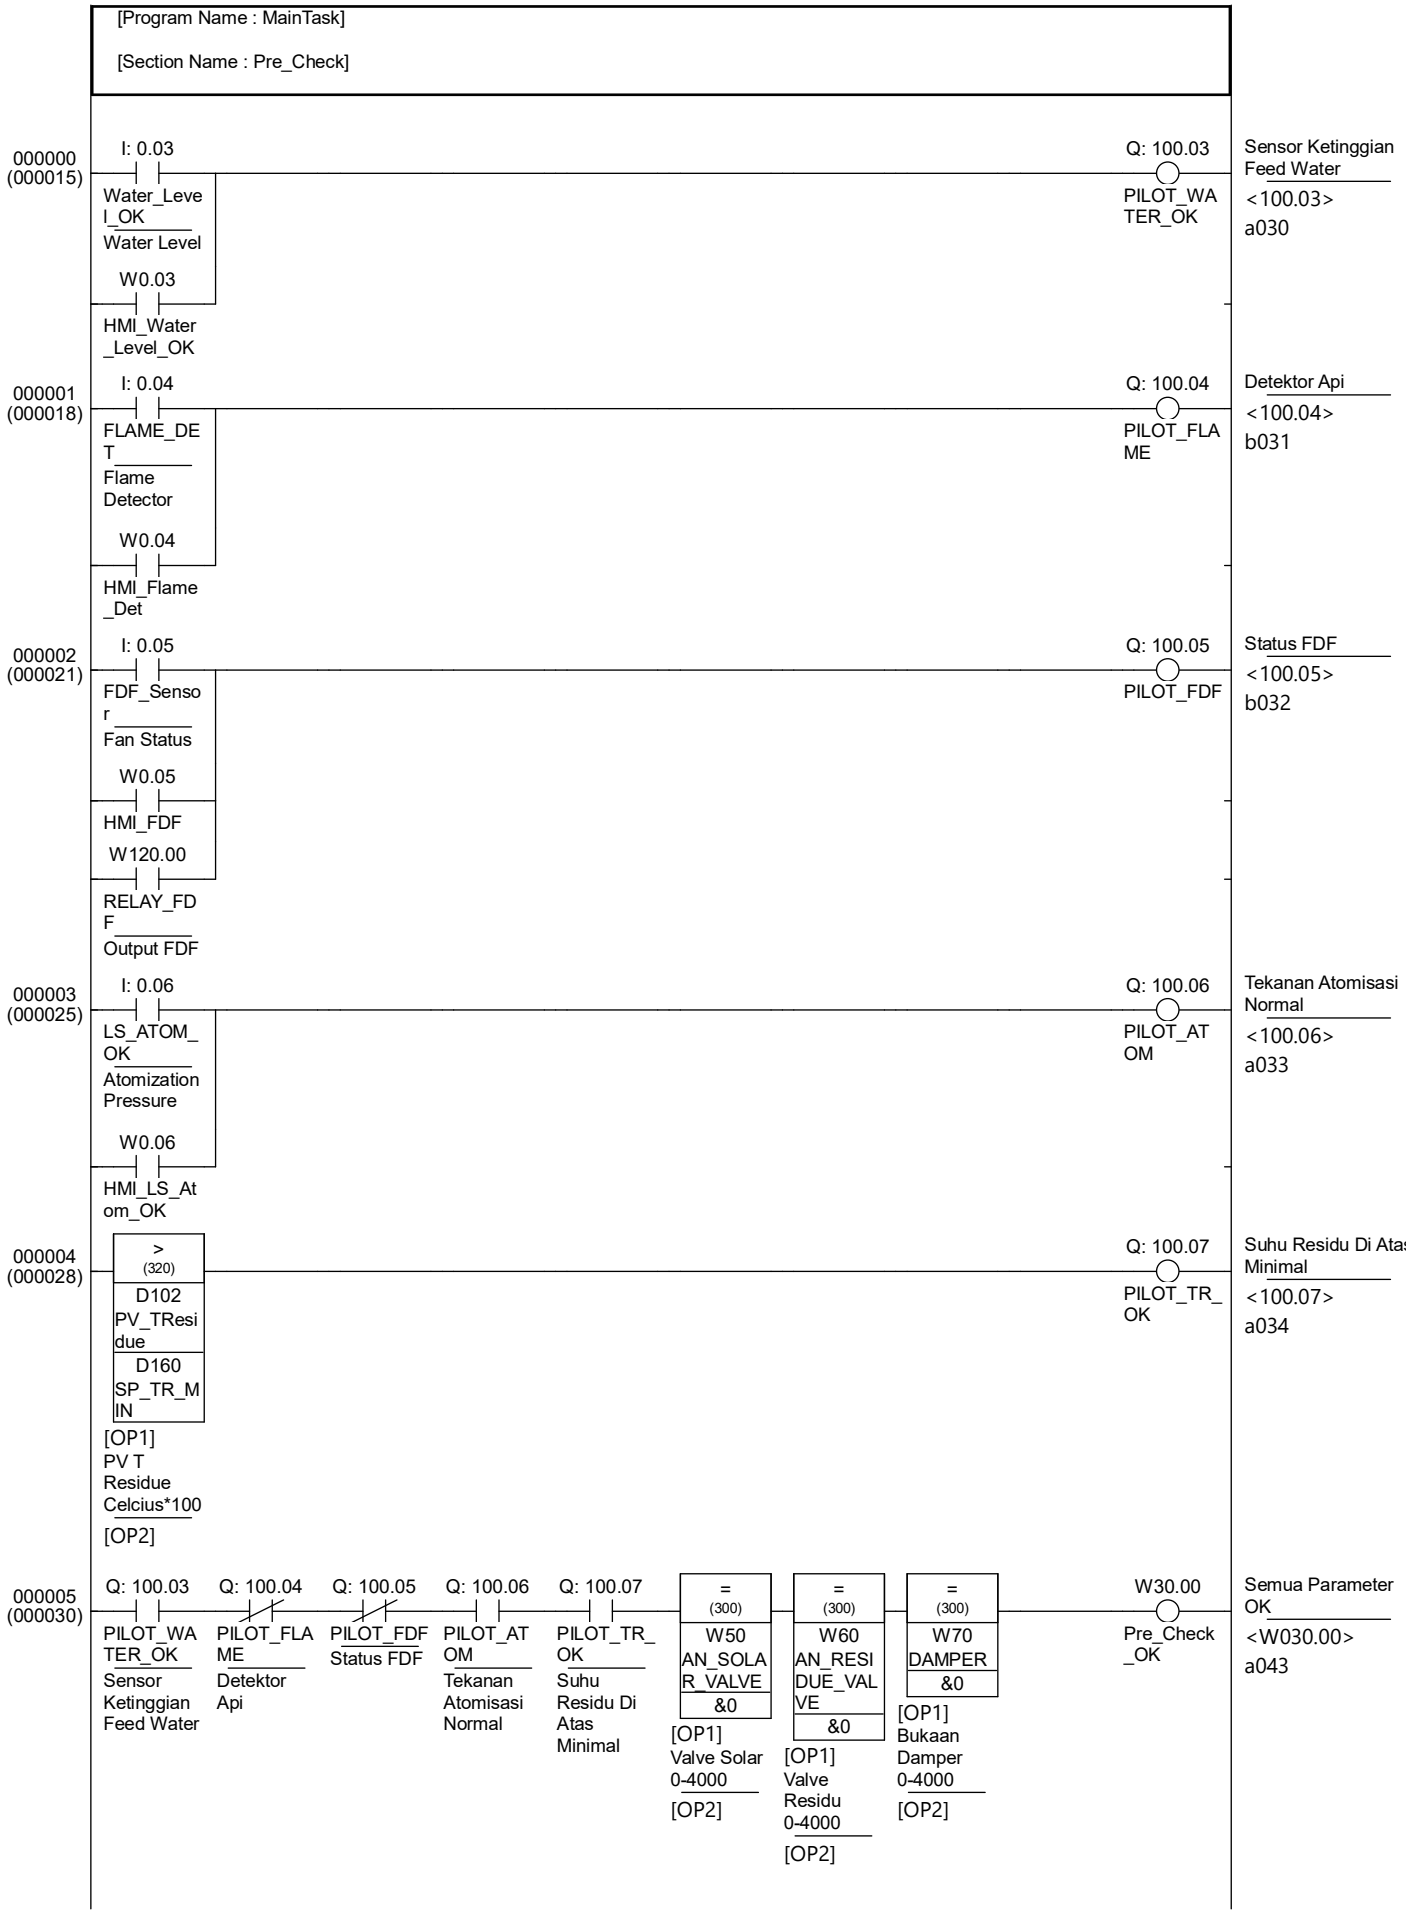
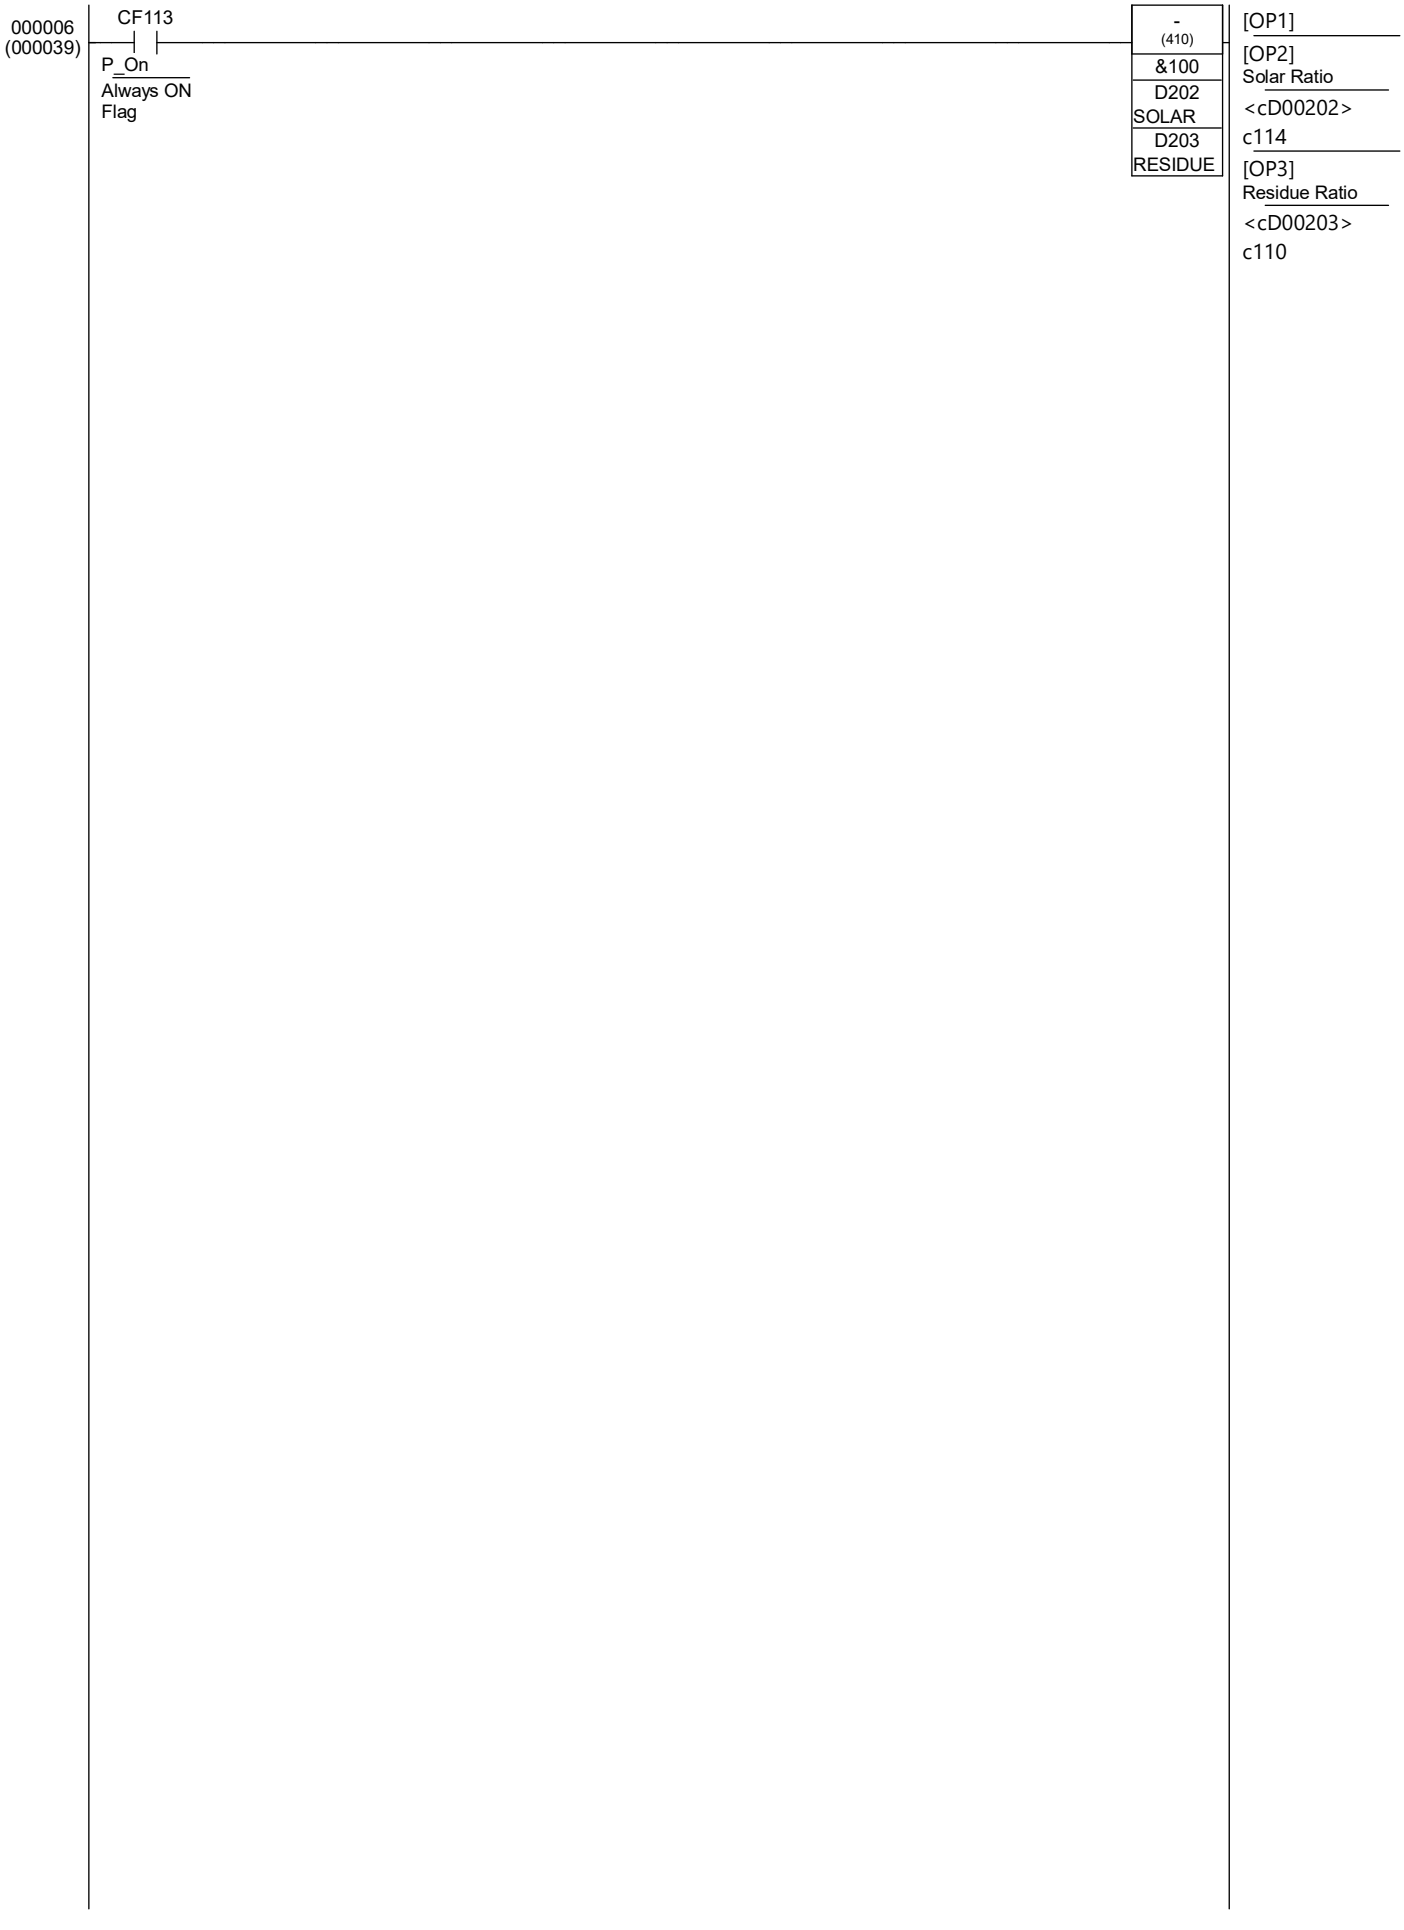
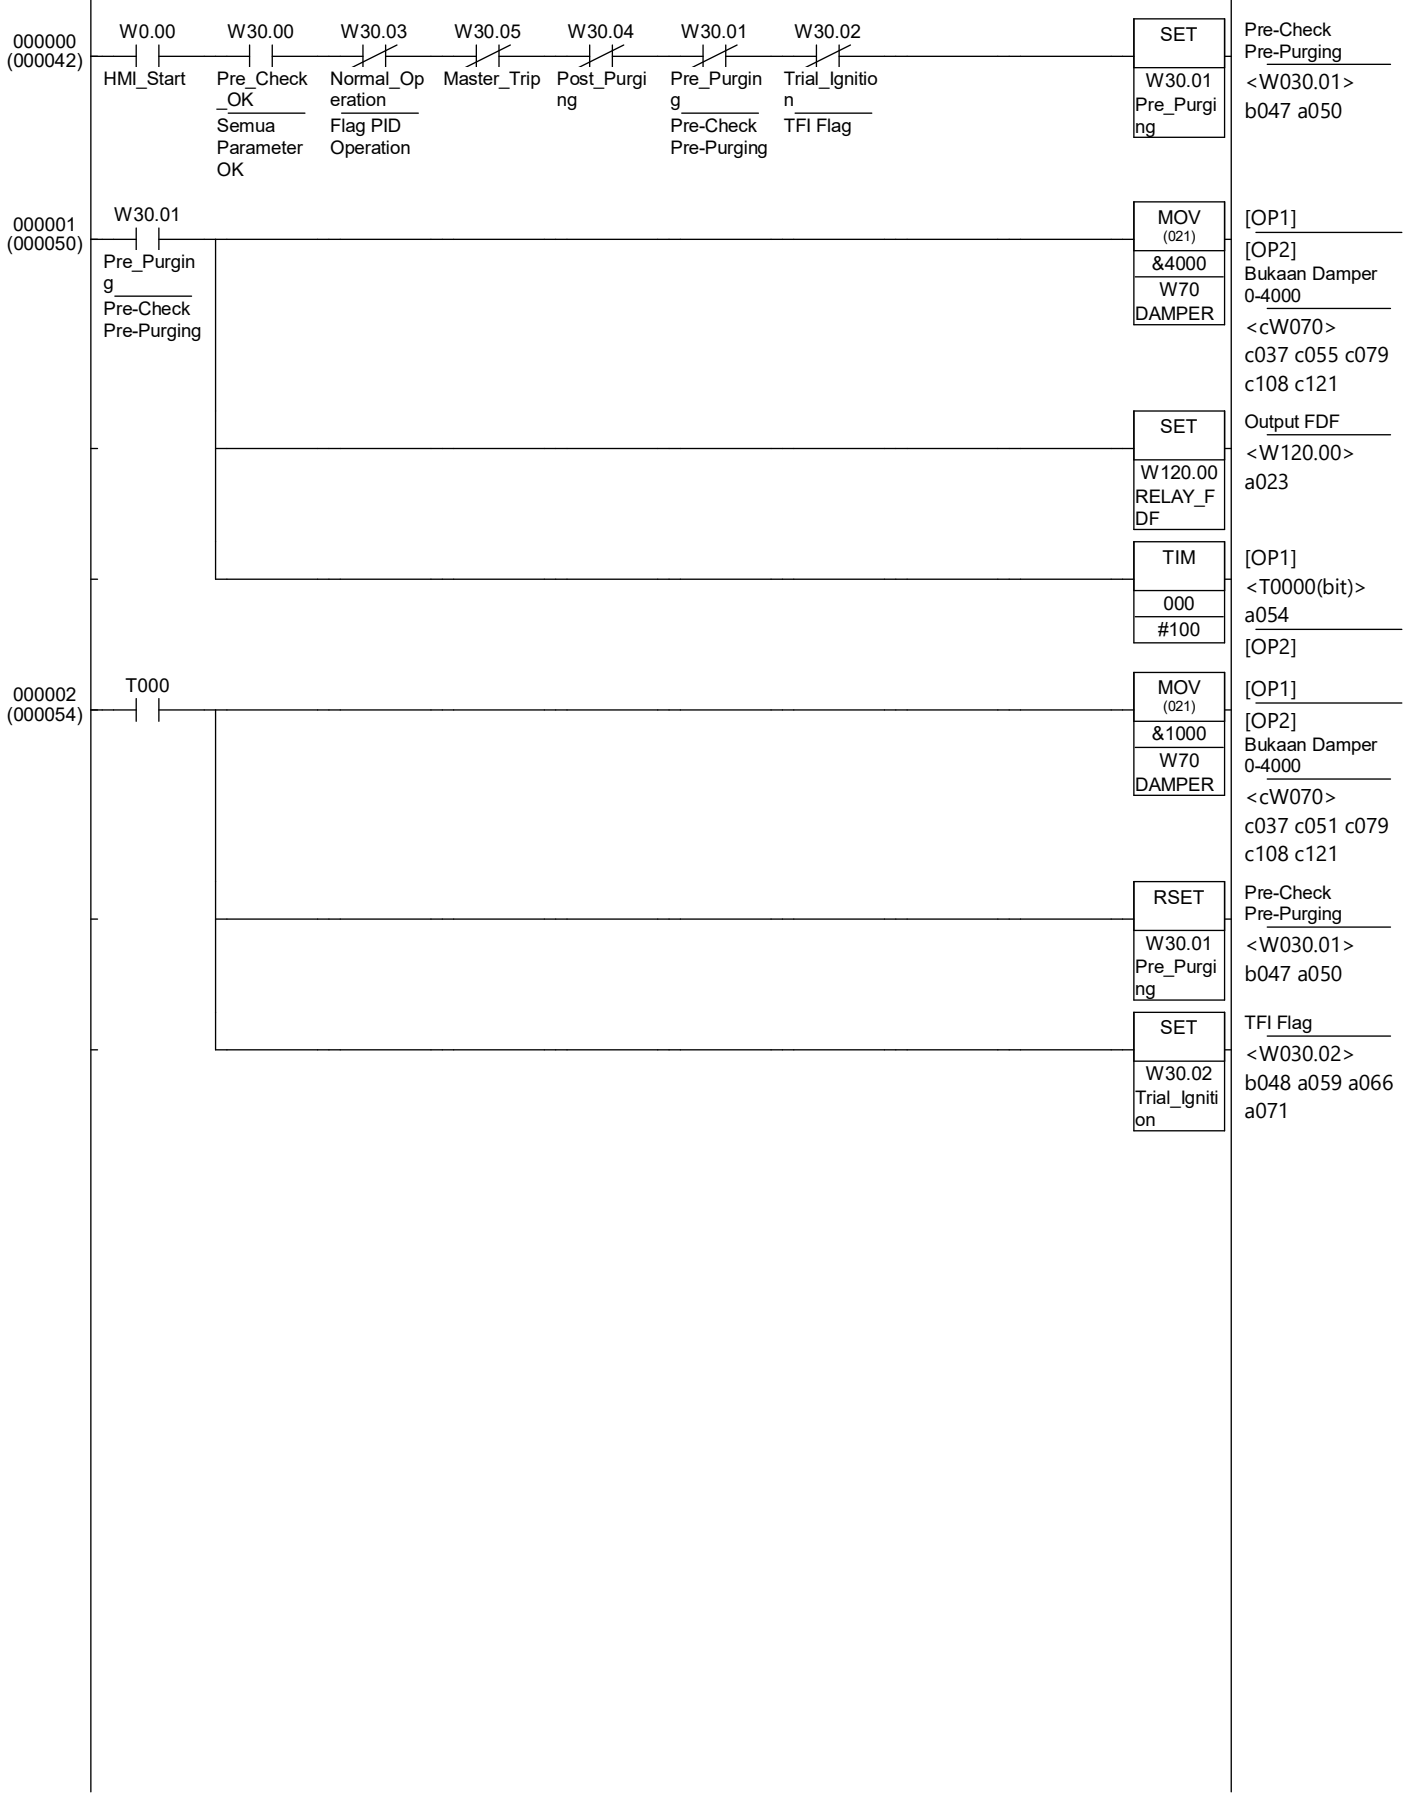
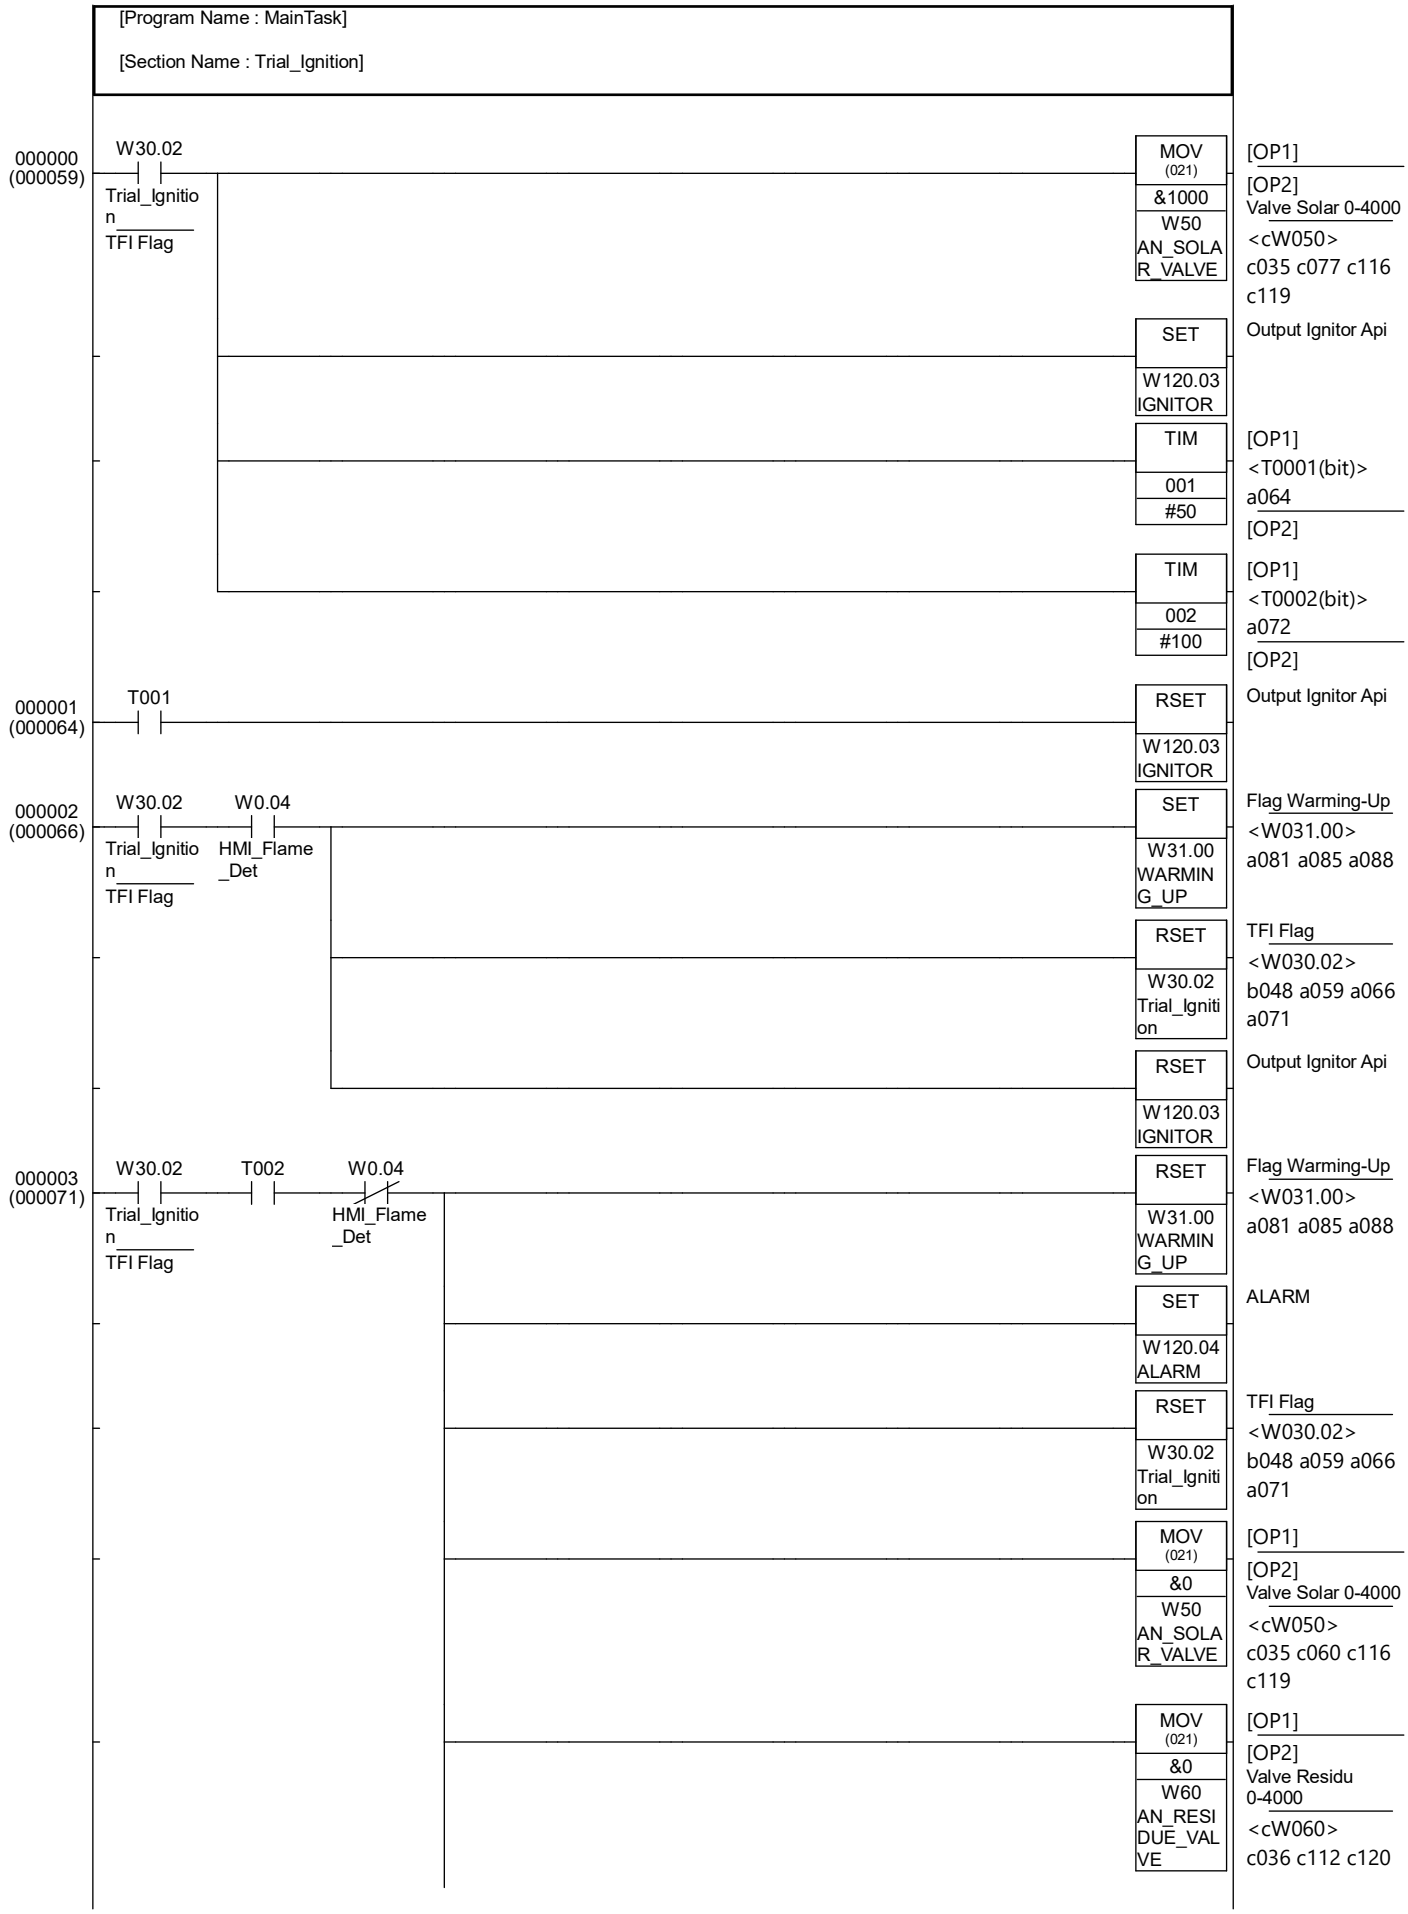

[Program Name : MainTask]
[Section Name : Pre_Check]
000000
(000015)
I: 0.03
Water_Level_OK
Water Level
W0.03
HMI_Water_Level_OK
Q: 100.03
PILOT_WATER_OK
Sensor Ketinggian Feed Water
<100.03>
a030
000001
(000018)
I: 0.04
FLAME_DET
Flame Detector
W0.04
HMI_Flame_Det
Q: 100.04
PILOT_FLAME
Detektor Api
<100.04>
b031
000002
(000021)
I: 0.05
FDF_Sensor
Fan Status
W0.05
HMI_FDF
W120.00
RELAY_FDF
Output FDF
Q: 100.05
PILOT_FDF
Status FDF
<100.05>
b032
000003
(000025)
I: 0.06
LS_ATOM_OK
Atomization Pressure
W0.06
HMI_LS_Atom_OK
Q: 100.06
PILOT_ATOM
Tekanan Atomisasi Normal
<100.06>
a033
000004
(000028)
>
(320)
D102
PV_TResidue
D160
SP_TR_MIN
[OP1]
PV T Residue Celcius*100
[OP2]
Q: 100.07
PILOT_TR_OK
Suhu Residu Di Atas Minimal
<100.07>
a034
000005
(000030)
Q: 100.03
PILOT_WATER_OK
Sensor Ketinggian Feed Water
Q: 100.04
PILOT_FLAME
Detektor Api
Q: 100.05
PILOT_FDF
Status FDF
Q: 100.06
PILOT_ATOM
Tekanan Atomisasi Normal
Q: 100.07
PILOT_TR_OK
Suhu Residu Di Atas Minimal
=
(300)
W50
AN_SOLAR_VALVE
&0
[OP1]
Valve Solar 0-4000
[OP2]
=
(300)
W60
AN_RESIDUE_VALVE
&0
[OP1]
Valve Residu 0-4000
[OP2]
=
(300)
W70
DAMPER
&0
[OP1]
Bukaan Damper 0-4000
[OP2]
W30.00
Pre_Check_OK
Semua Parameter OK
<W030.00>
a043

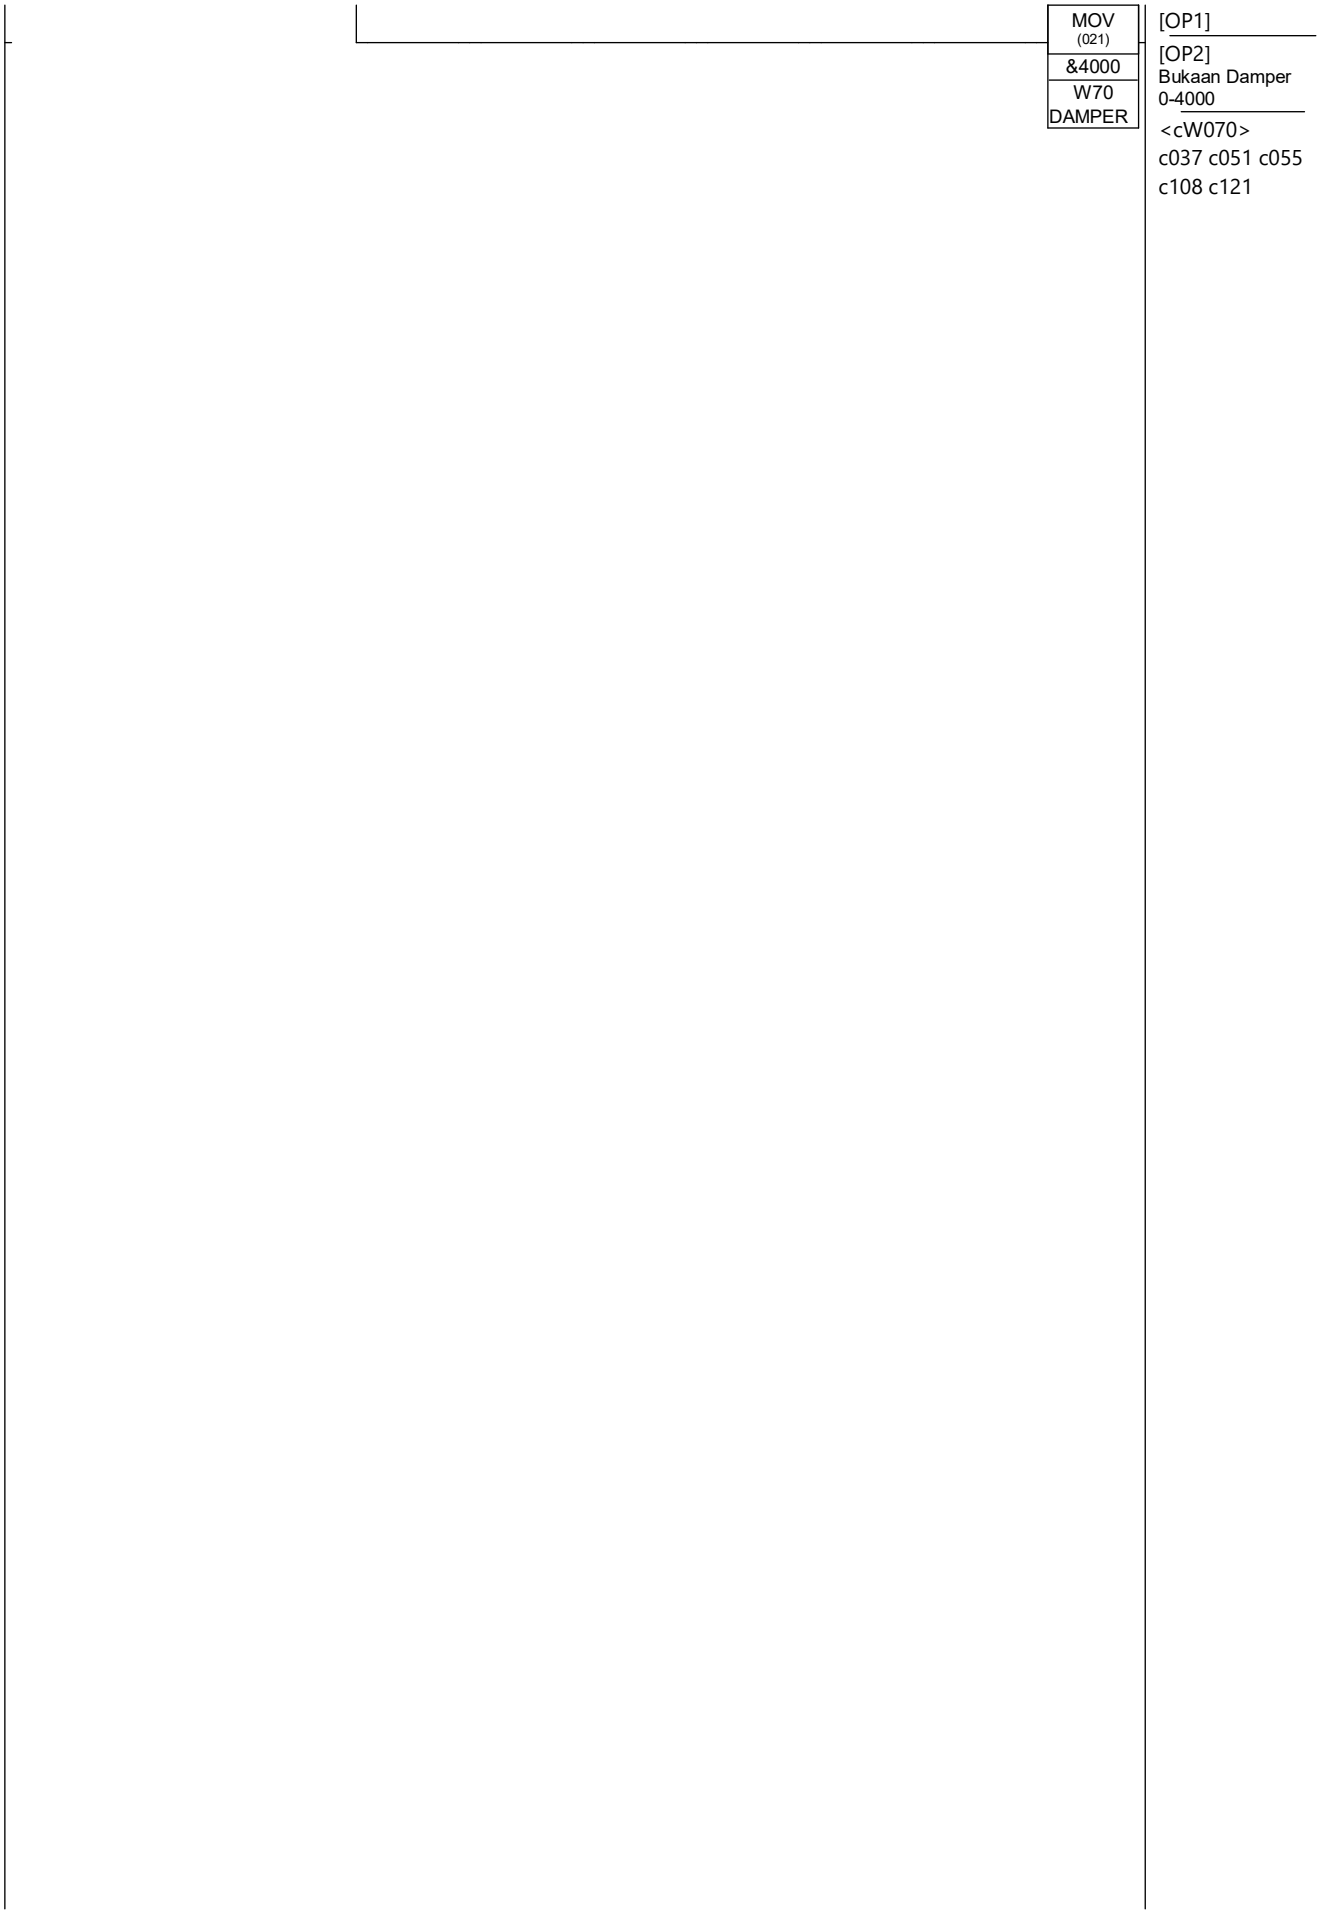

000006
(000039)
CF113
P_On
Always ON
Flag
-
(410)
&100
D202
SOLAR
D203
RESIDUE
[OP1]
[OP2]
Solar Ratio
<cD00202>
c114
[OP3]
Residue Ratio
<cD00203>
c110

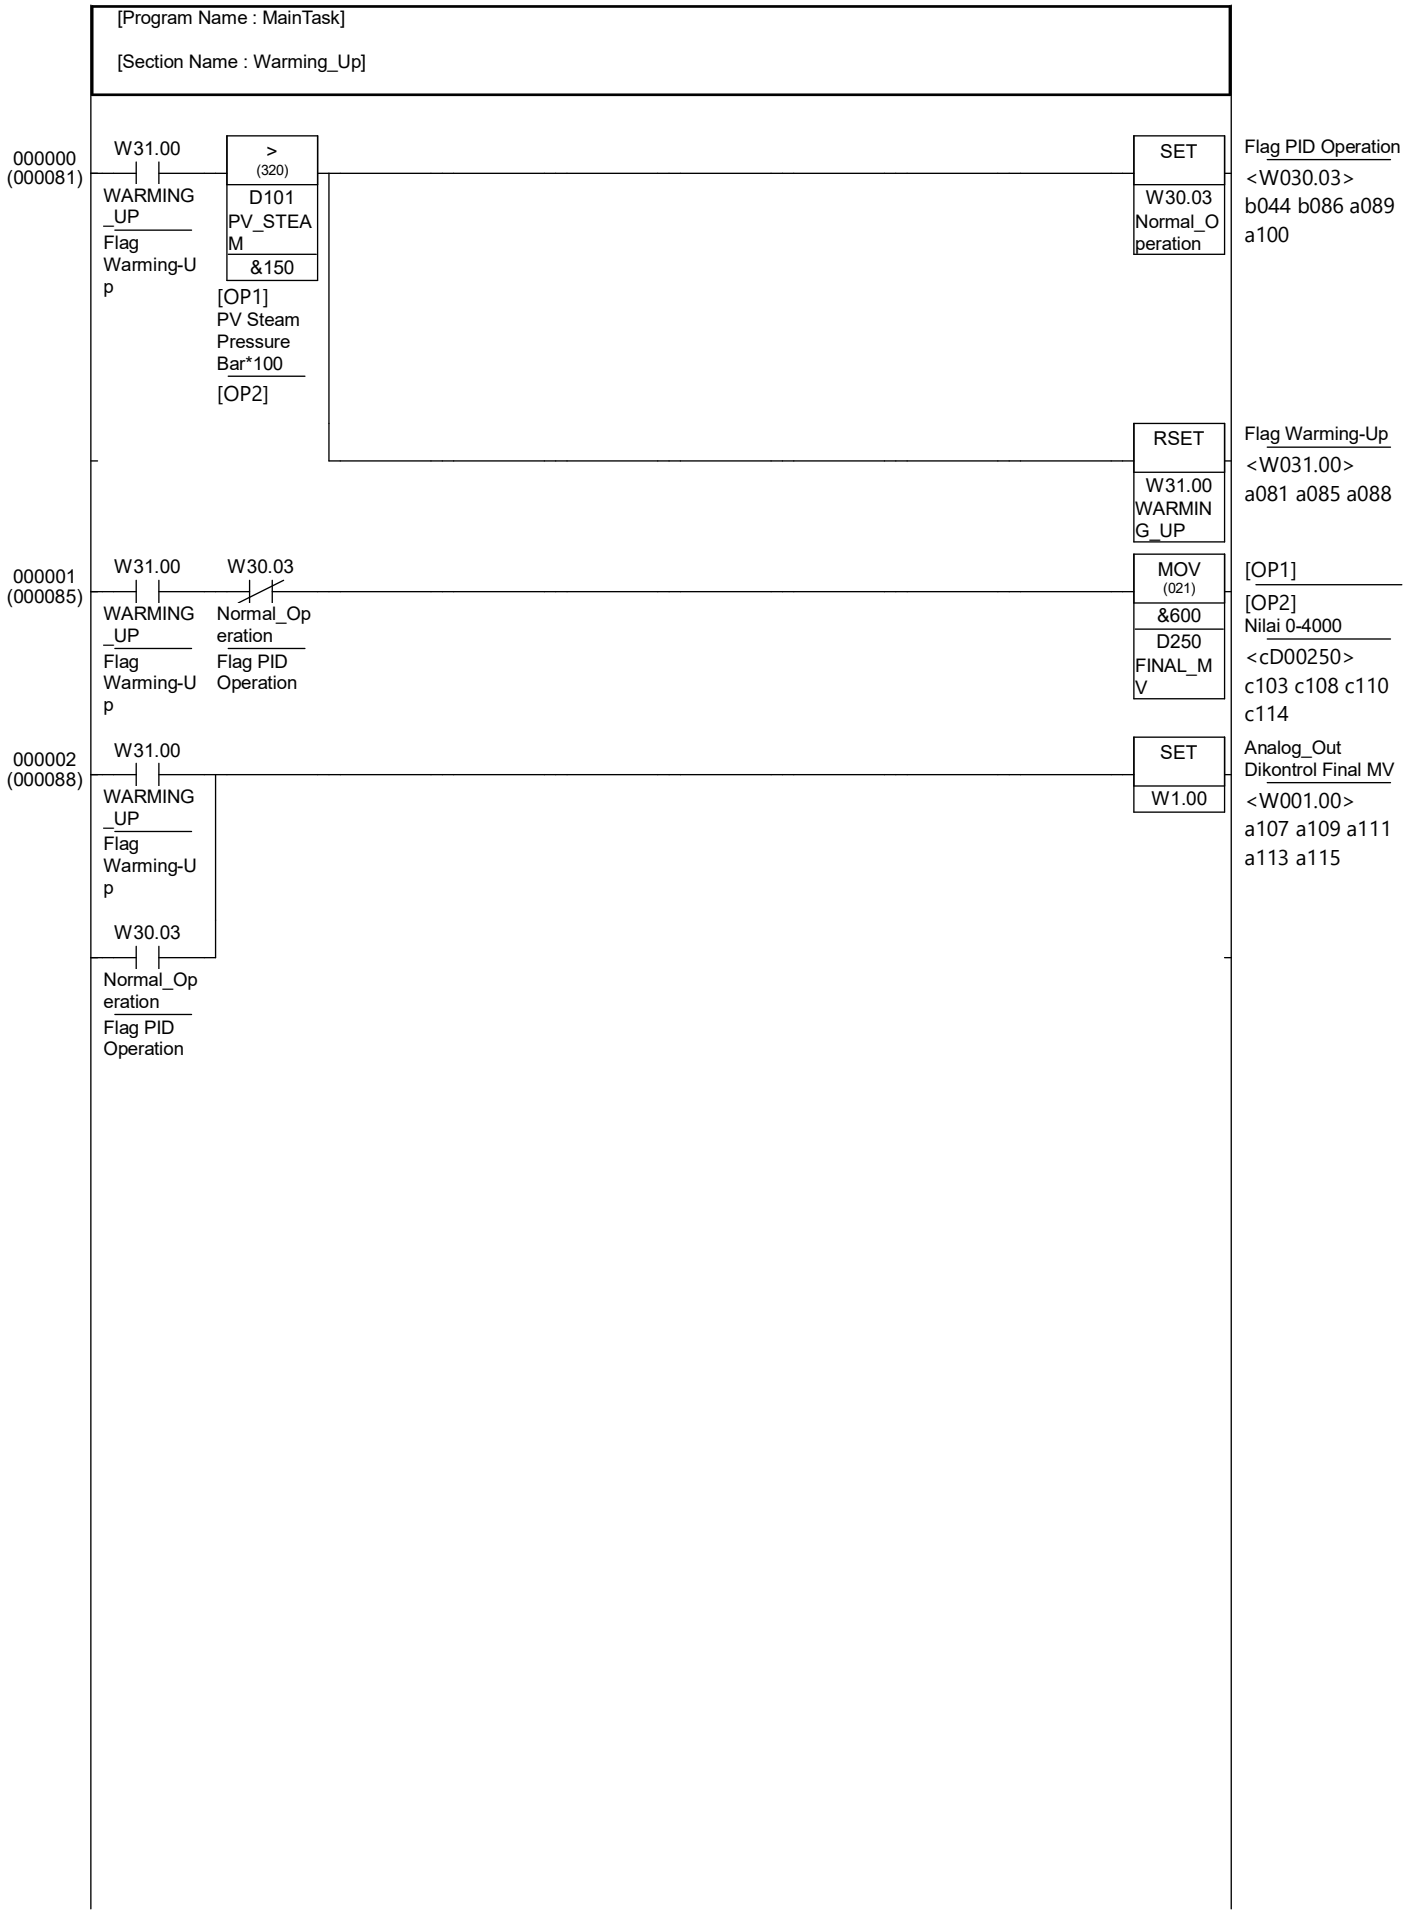
[Program Name : MainTask]

[Section Name : Pre_Purging]




[Program Name : MainTask]
[Section Name : Trial_Ignition]
000000
(000059)
W30.02
Trial_Ignition
TFI Flag
MOV
(021)
&1000
W50
AN_SOLAR_VALVE
[OP1]
[OP2]
Valve Solar 0-4000
<cW050>
c035 c077 c116 c119
SET
W120.03
IGNITOR
Output Ignitor Api
TIM
001
#50
[OP1]
<T0001(bit)>
a064
[OP2]
TIM
002
#100
[OP1]
<T0002(bit)>
a072
[OP2]
000001
(000064)
T001
RSET
W120.03
IGNITOR
Output Ignitor Api
000002
(000066)
W30.02
Trial_Ignition
TFI Flag
W0.04
HMI_Flame_Det
SET
W31.00
WARMING_UP
Flag Warming-Up
<W031.00>
a081 a085 a088
RSET
W30.02
Trial_Ignition
TFI Flag
<W030.02>
b048 a059 a066 a071
RSET
W120.03
IGNITOR
Output Ignitor Api
000003
(000071)
W30.02
Trial_Ignition
TFI Flag
T002
W0.04
HMI_Flame_Det
RSET
W31.00
WARMING_UP
Flag Warming-Up
<W031.00>
a081 a085 a088
SET
W120.04
ALARM
ALARM
RSET
W30.02
Trial_Ignition
TFI Flag
<W030.02>
b048 a059 a066 a071
MOV
(021)
&0
W50
AN_SOLAR_VALVE
[OP1]
[OP2]
Valve Solar 0-4000
<cW050>
c035 c060 c116 c119
MOV
(021)
&0
W60
AN_RESIDUE_VALVE
[OP1]
[OP2]
Valve Residu 0-4000
<cW060>
c036 c112 c120


MOV
(021)
&4000
W70
DAMPER
[OP1]
[OP2]
Bukaan Damper
0-4000
<cW070>
c037 c051 c055
c108 c121


[Program Name : MainTask]
[Section Name : Warming_Up]
000000
(000081)
W31.00
WARMING_UP
Flag Warming-Up
>
(320)
D101
PV_STEAM
&150
[OP1]
PV Steam Pressure Bar*100
[OP2]
SET
W30.03
Normal_Operation
Flag PID Operation
<W030.03>
b044 b086 a089 a100
RSET
W31.00
WARMING_UP
Flag Warming-Up
<W031.00>
a081 a085 a088
000001
(000085)
W31.00
WARMING_UP
Flag Warming-Up
W30.03
Normal_Operation
Flag PID Operation
MOV
(021)
&600
D250
FINAL_MV
[OP1]
[OP2]
Nilai 0-4000
<cD00250>
c103 c108 c110 c114
000002
(000088)
W31.00
WARMING_UP
Flag Warming-Up
W30.03
Normal_Operation
Flag PID Operation
SET
W1.00
Analog_Out
Dikontrol Final MV
<W001.00>
a107 a109 a111 a113 a115

[Program Name : MainTask]

[Section Name : Normal_Operation]

000000
(000092)

A200.11
P_First_Cycle
First Cycle Flag

MOV (021)	D201 SP_STEAM	D500

[OP1] Set Point Steam*100 <cD00201> c102
[OP2] SET POINT PID <cD00500> c101 c102

MOV (021)	#0100	D501

[OP1]
[OP2] P

MOV (021)	#0050	D502

[OP1]
[OP2] I

MOV (021)	#0000	D503

[OP1]
[OP2] D

MOV (021)	#0050	D504

[OP1]
[OP2] t Period

MOV (021)	&2	D505

[OP1]
[OP2] Forward Reverse

MOV (021)	&915	D506

[OP1]
[OP2] I/O Setting

000001
(000100)

W30.03
Normal_Operation
Flag PID Operation

PIDAT (191)	D101 PV_STEAM	D500
	D200 MV_PIDAT	

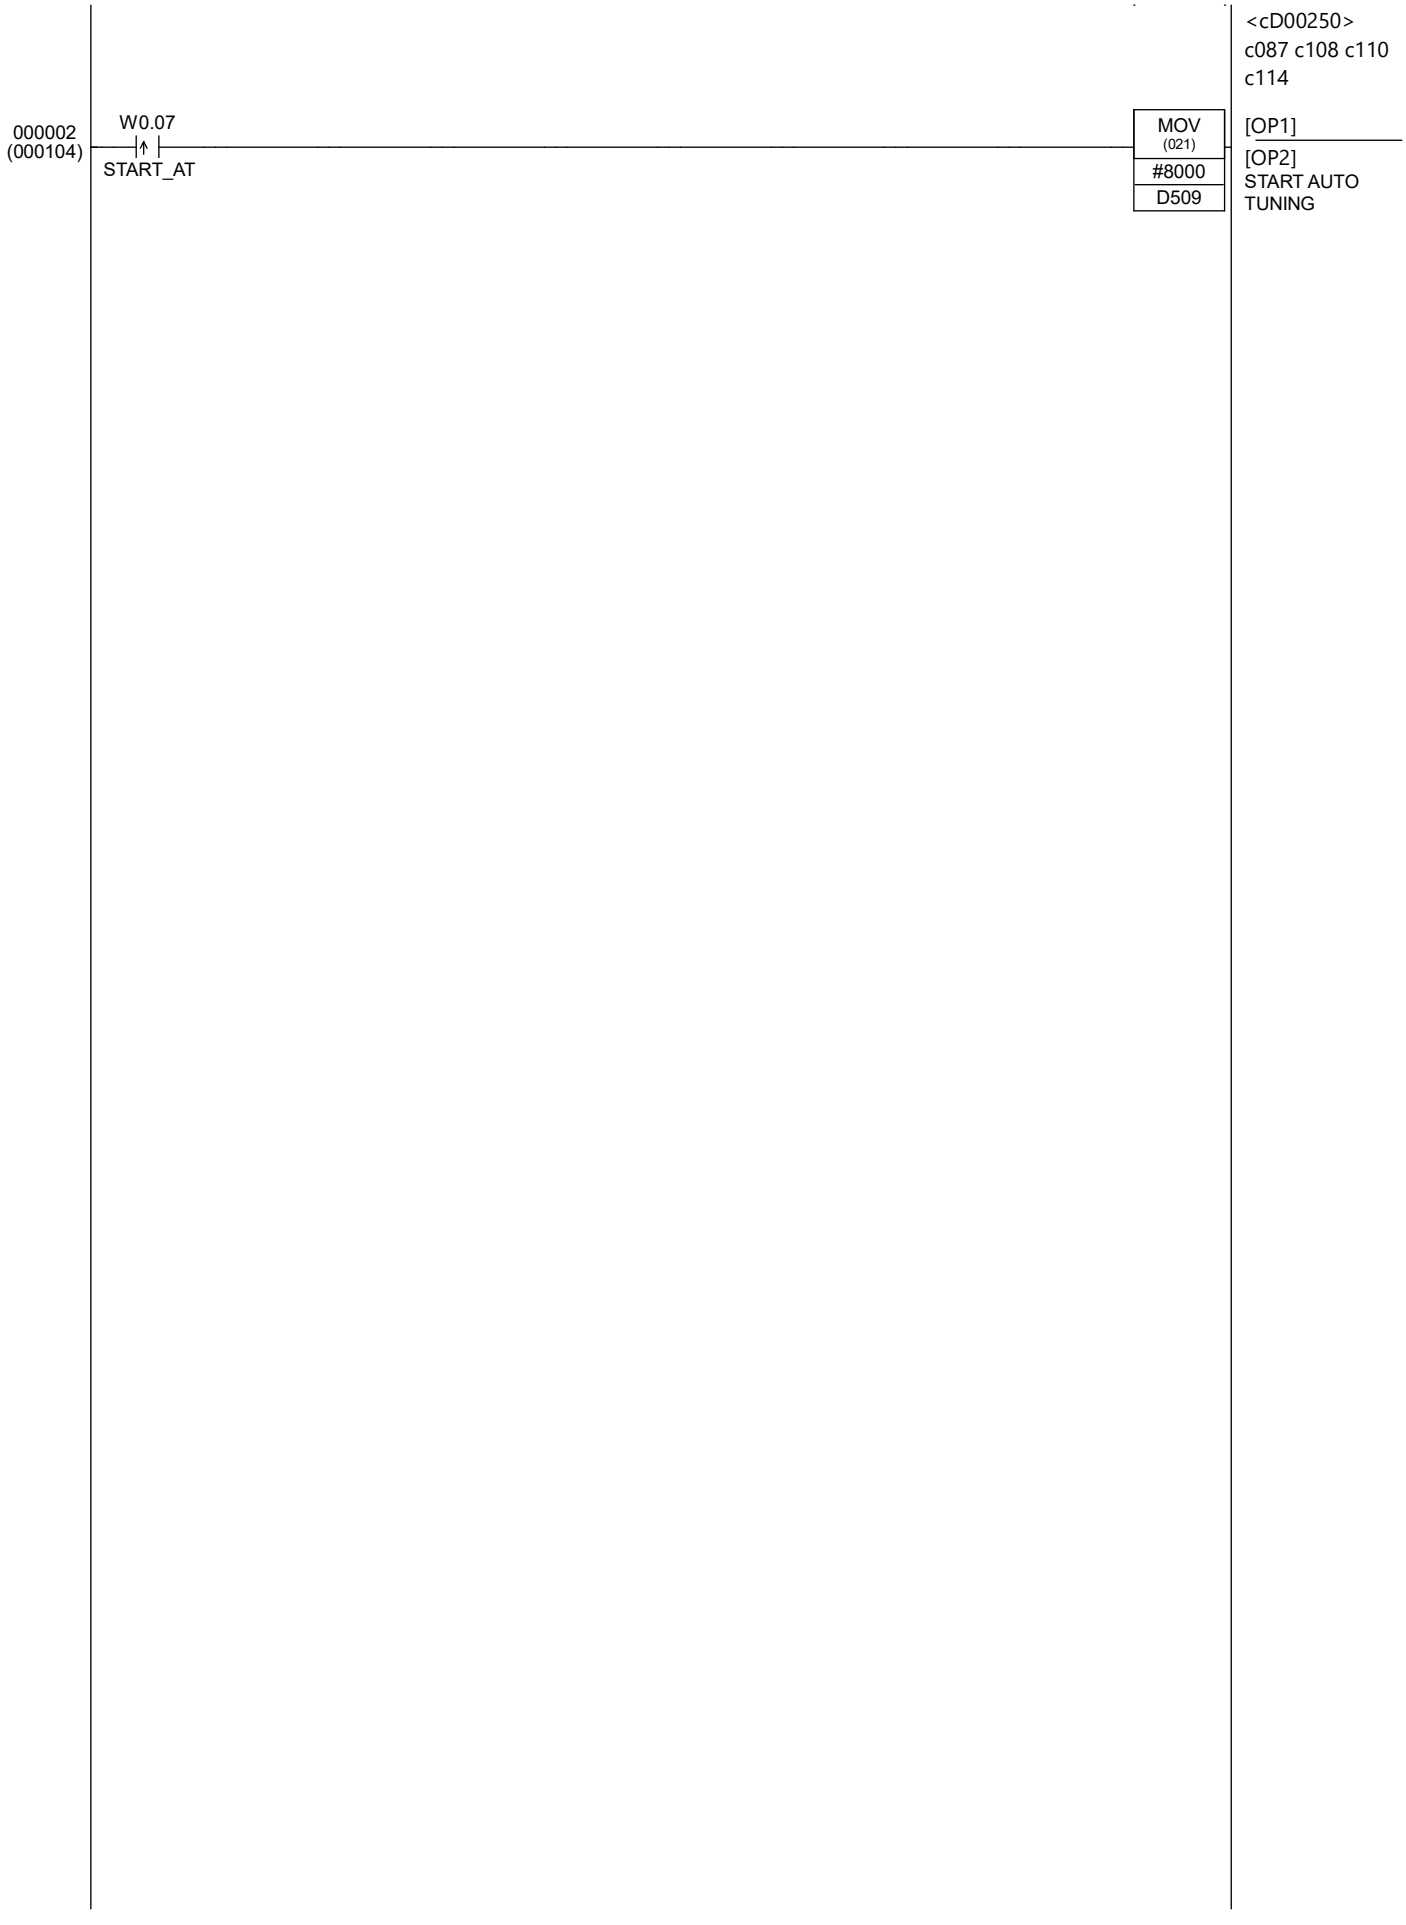
[OP1] PV Steam Pressure Bar*100 <cD00101> c012 c082
[OP2] SET POINT PID <cD00500> c093 c102
[OP3] Nilai 0-2000 <cD00200> c103

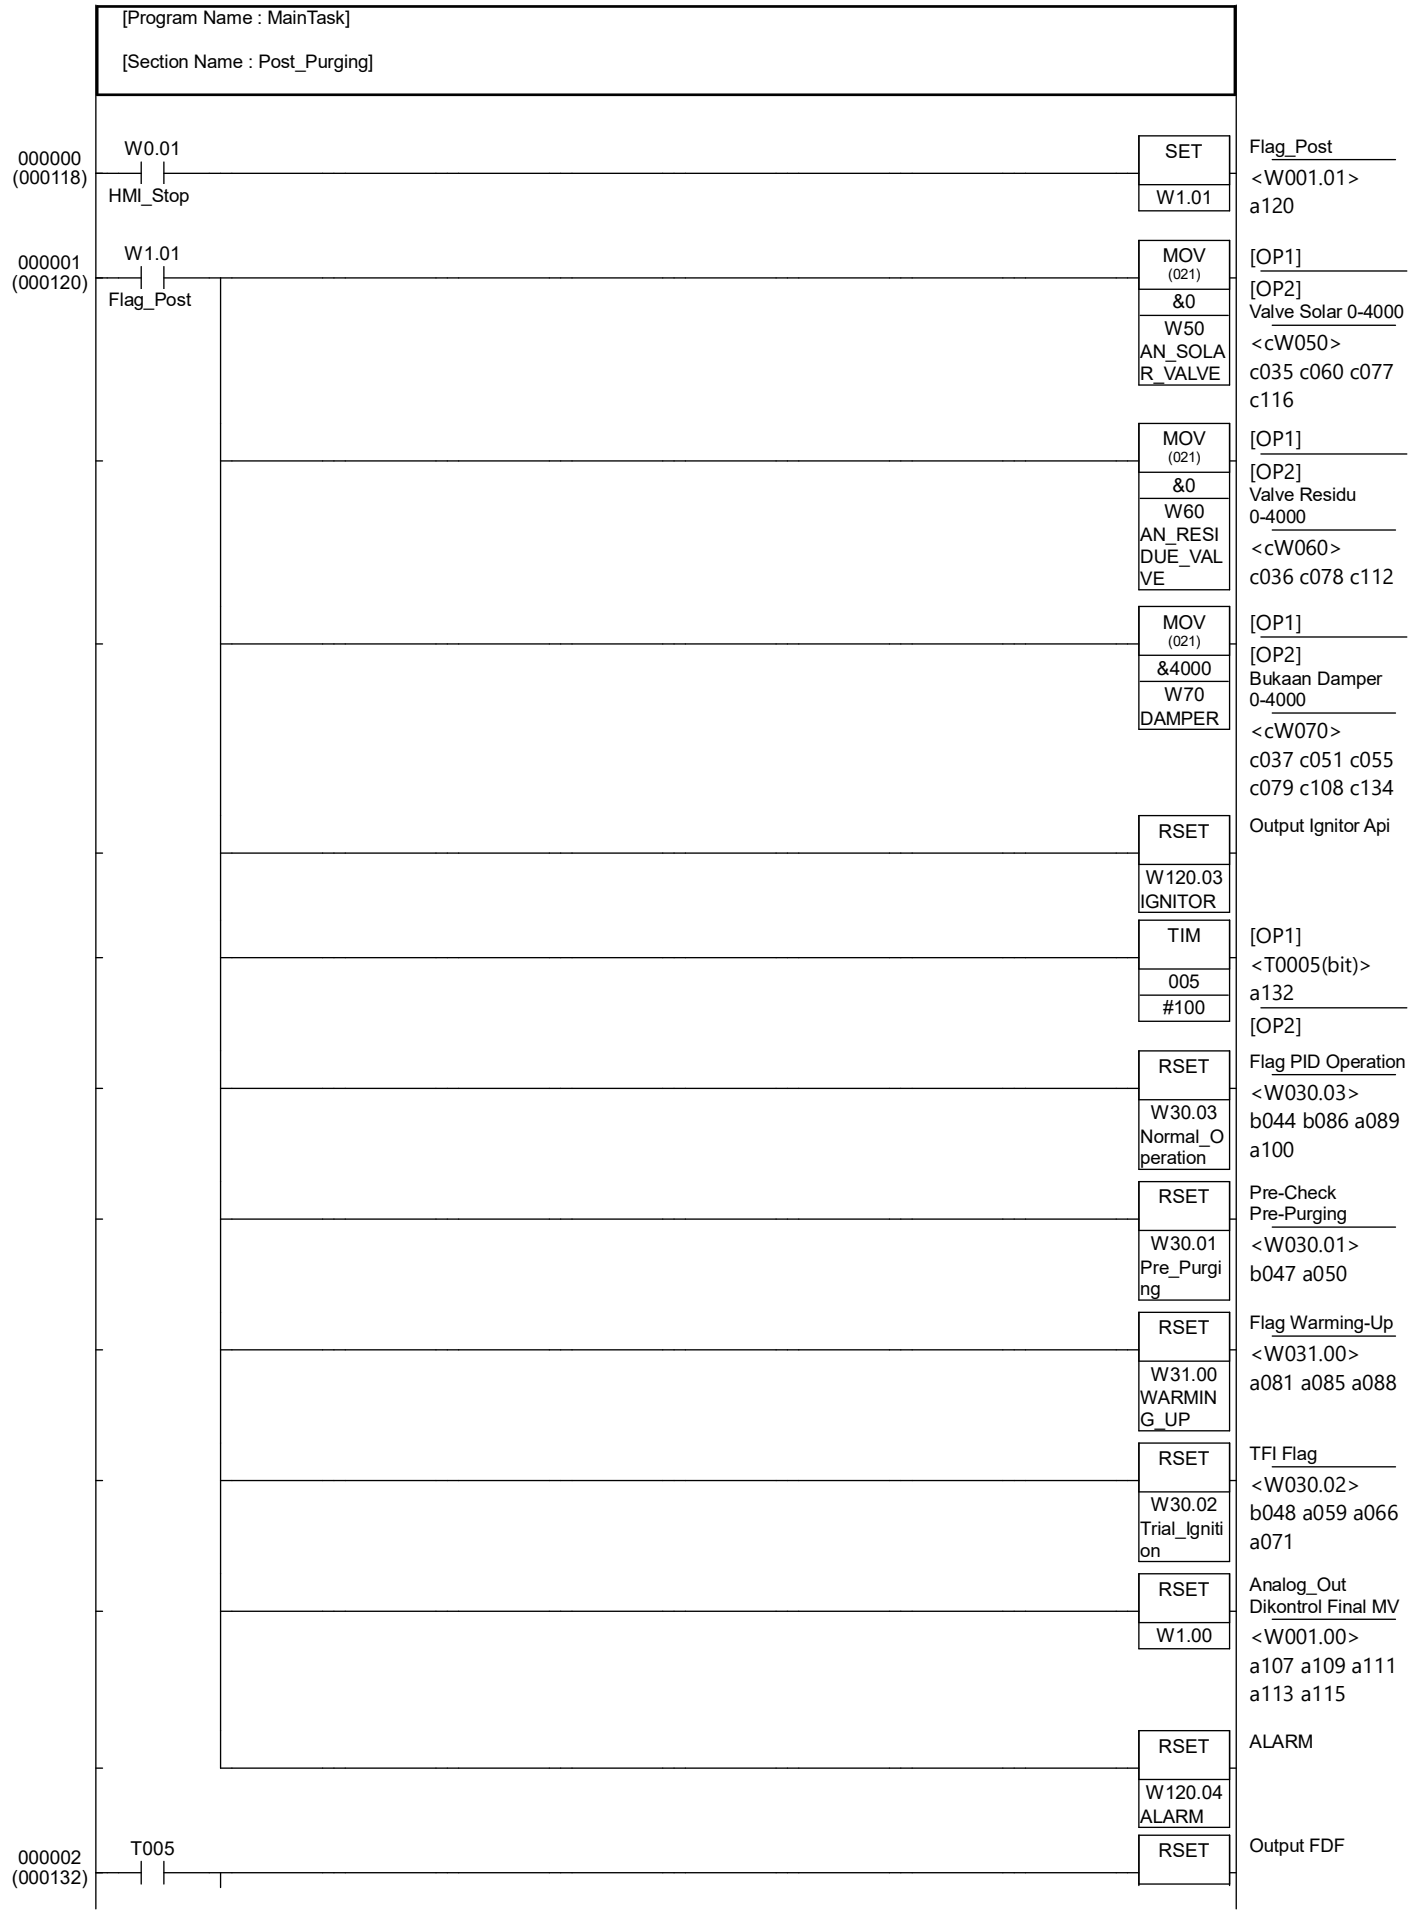
MOV (021)	D201 SP_STEAM	D500

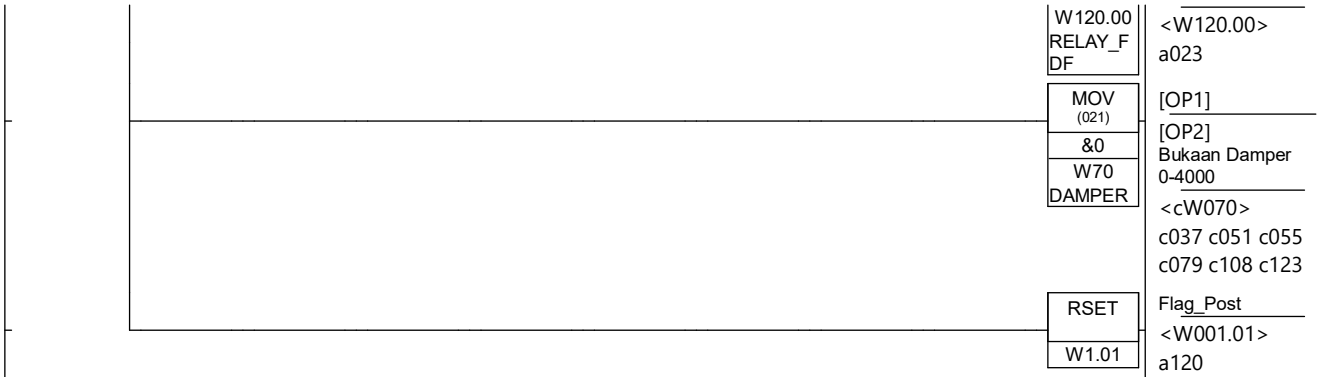
[OP1] Set Point Steam*100 <cD00201> c093
[OP2] SET POINT PID <cD00500> c093 c101

*L (421)	D200 MV_PIDAT	
	&2	
	D250 FINAL_MV	

[OP1] Nilai 0-2000 <cD00200> c101
[OP2]
[OP3] Nilai 0-4000


000002
(000104)
W0.07
START_AT
MOV
(021)
#8000
D509
<cD00250>
c087 c108 c110
c114
[OP1]
[OP2]
START AUTO
TUNING


[Program Name : MainTask]
[Section Name : Post_Purging]
000000
(000118)
W0.01
HMI_Stop
SET
W1.01
Flag_Post
<W001.01>
a120
000001
(000120)
W1.01
Flag_Post
MOV
(021)
&0
W50
AN_SOLAR_VALVE
[OP1]
[OP2]
Valve Solar 0-4000
<cW050>
c035 c060 c077
c116
MOV
(021)
&0
W60
AN_RESIDUE_VALVE
[OP1]
[OP2]
Valve Residu
0-4000
<cW060>
c036 c078 c112
MOV
(021)
&4000
W70
DAMPER
[OP1]
[OP2]
Bukaan Damper
0-4000
<cW070>
c037 c051 c055
c079 c108 c134
RSET
W120.03
IGNITOR
Output Ignitor Api
TIM
005
#100
[OP1]
<T0005(bit)>
a132
[OP2]
RSET
W30.03
Normal_Operation
Flag PID Operation
<W030.03>
b044 b086 a089
a100
RSET
W30.01
Pre_Purging
Pre-Check
Pre-Purging
<W030.01>
b047 a050
RSET
W31.00
WARMING_UP
Flag Warming-Up
<W031.00>
a081 a085 a088
RSET
W30.02
Trial_Ignition
TFI Flag
<W030.02>
b048 a059 a066
a071
RSET
W1.00
Analog_Out
Dikontrol Final MV
<W001.00>
a107 a109 a111
a113 a115
RSET
W120.04
ALARM
ALARM
000002
(000132)
T005
RSET
Output FDF


W120.00
RELAY_FDF
<W120.00>
a023
MOV
(021)
[OP1]
[OP2]
&0
Bukaan Damper
0-4000
W70
DAMPER
<cW070>
c037 c051 c055
c079 c108 c123
RSET
Flag_Post
W1.01
<W001.01>
a120

[Program Name : MainTask]

[Section Name : Analog_Out]

000000
(000107)

W1.00
Analog_Out
Dikontrol
Final MV

MOV
(021)
D250
FINAL_MV
W70
DAMPER

[OP1]
Nilai 0-4000
<cD00250>
c087 c103 c110 c114
[OP2]
Bukaan Damper 0-4000
<cW070>
c037 c051 c055 c079 c121

000001
(000109)

W1.00
Analog_Out
Dikontrol
Final MV

*
(420)
D250
FINAL_MV
D203
RESIDUE
D400

[OP1]
Nilai 0-4000
<cD00250>
c087 c103 c108 c114
[OP2]
Residue Ratio
<cD00203>
c040
[OP3]
<cD00400>
c112

000002
(000111)

W1.00
Analog_Out
Dikontrol
Final MV

/L
(431)
D400
D1
Konstanta
W60
AN_RESIDUE_VALVE

[OP1]
<cD00400>
c110
[OP2]
<cD00001>
c009
[OP3]
Valve Residu 0-4000
<cW060>
c036 c078 c120

000003
(000113)

W1.00
Analog_Out
Dikontrol
Final MV

*
(420)
D250
FINAL_MV
D202
SOLAR
D404

[OP1]
Nilai 0-4000
<cD00250>
c087 c103 c108 c110
[OP2]
Solar Ratio
<cD00202>
c040
[OP3]
<cD00404>
c116

000004
(000115)

W1.00
Analog_Out
Dikontrol
Final MV

/L
(431)
D404
+100
W50
AN_SOLAR_VALVE

[OP1]
<cD00404>
c114
[OP2]
[OP3]
Valve Solar 0-4000
<cW050>
c035 c060 c077 c119

[Program Name : MainTask]

[Section Name : ADC_Scalling]

000000
(000011)

CF113
P_On
Always ON Flag

SCL (194)
201 STEAM_PRESSURE
D20
D101 PV_STEAM

[OP1] STEAM PRESSURE ADC
[OP2] VARIABEL Scalling Steam
<cD00020>
c001
[OP3] PV Steam Pressure Bar*100
<cD00101>
c082 c101

SCL (194)
202 T_RESIDUE
D30
D102 PV_TResidue

[OP1] T ADC
[OP2] Variable Scalling Suhu Residu
<cD00030>
c005
[OP3] PV T Residue Celcius*100
<cD00102>
c028