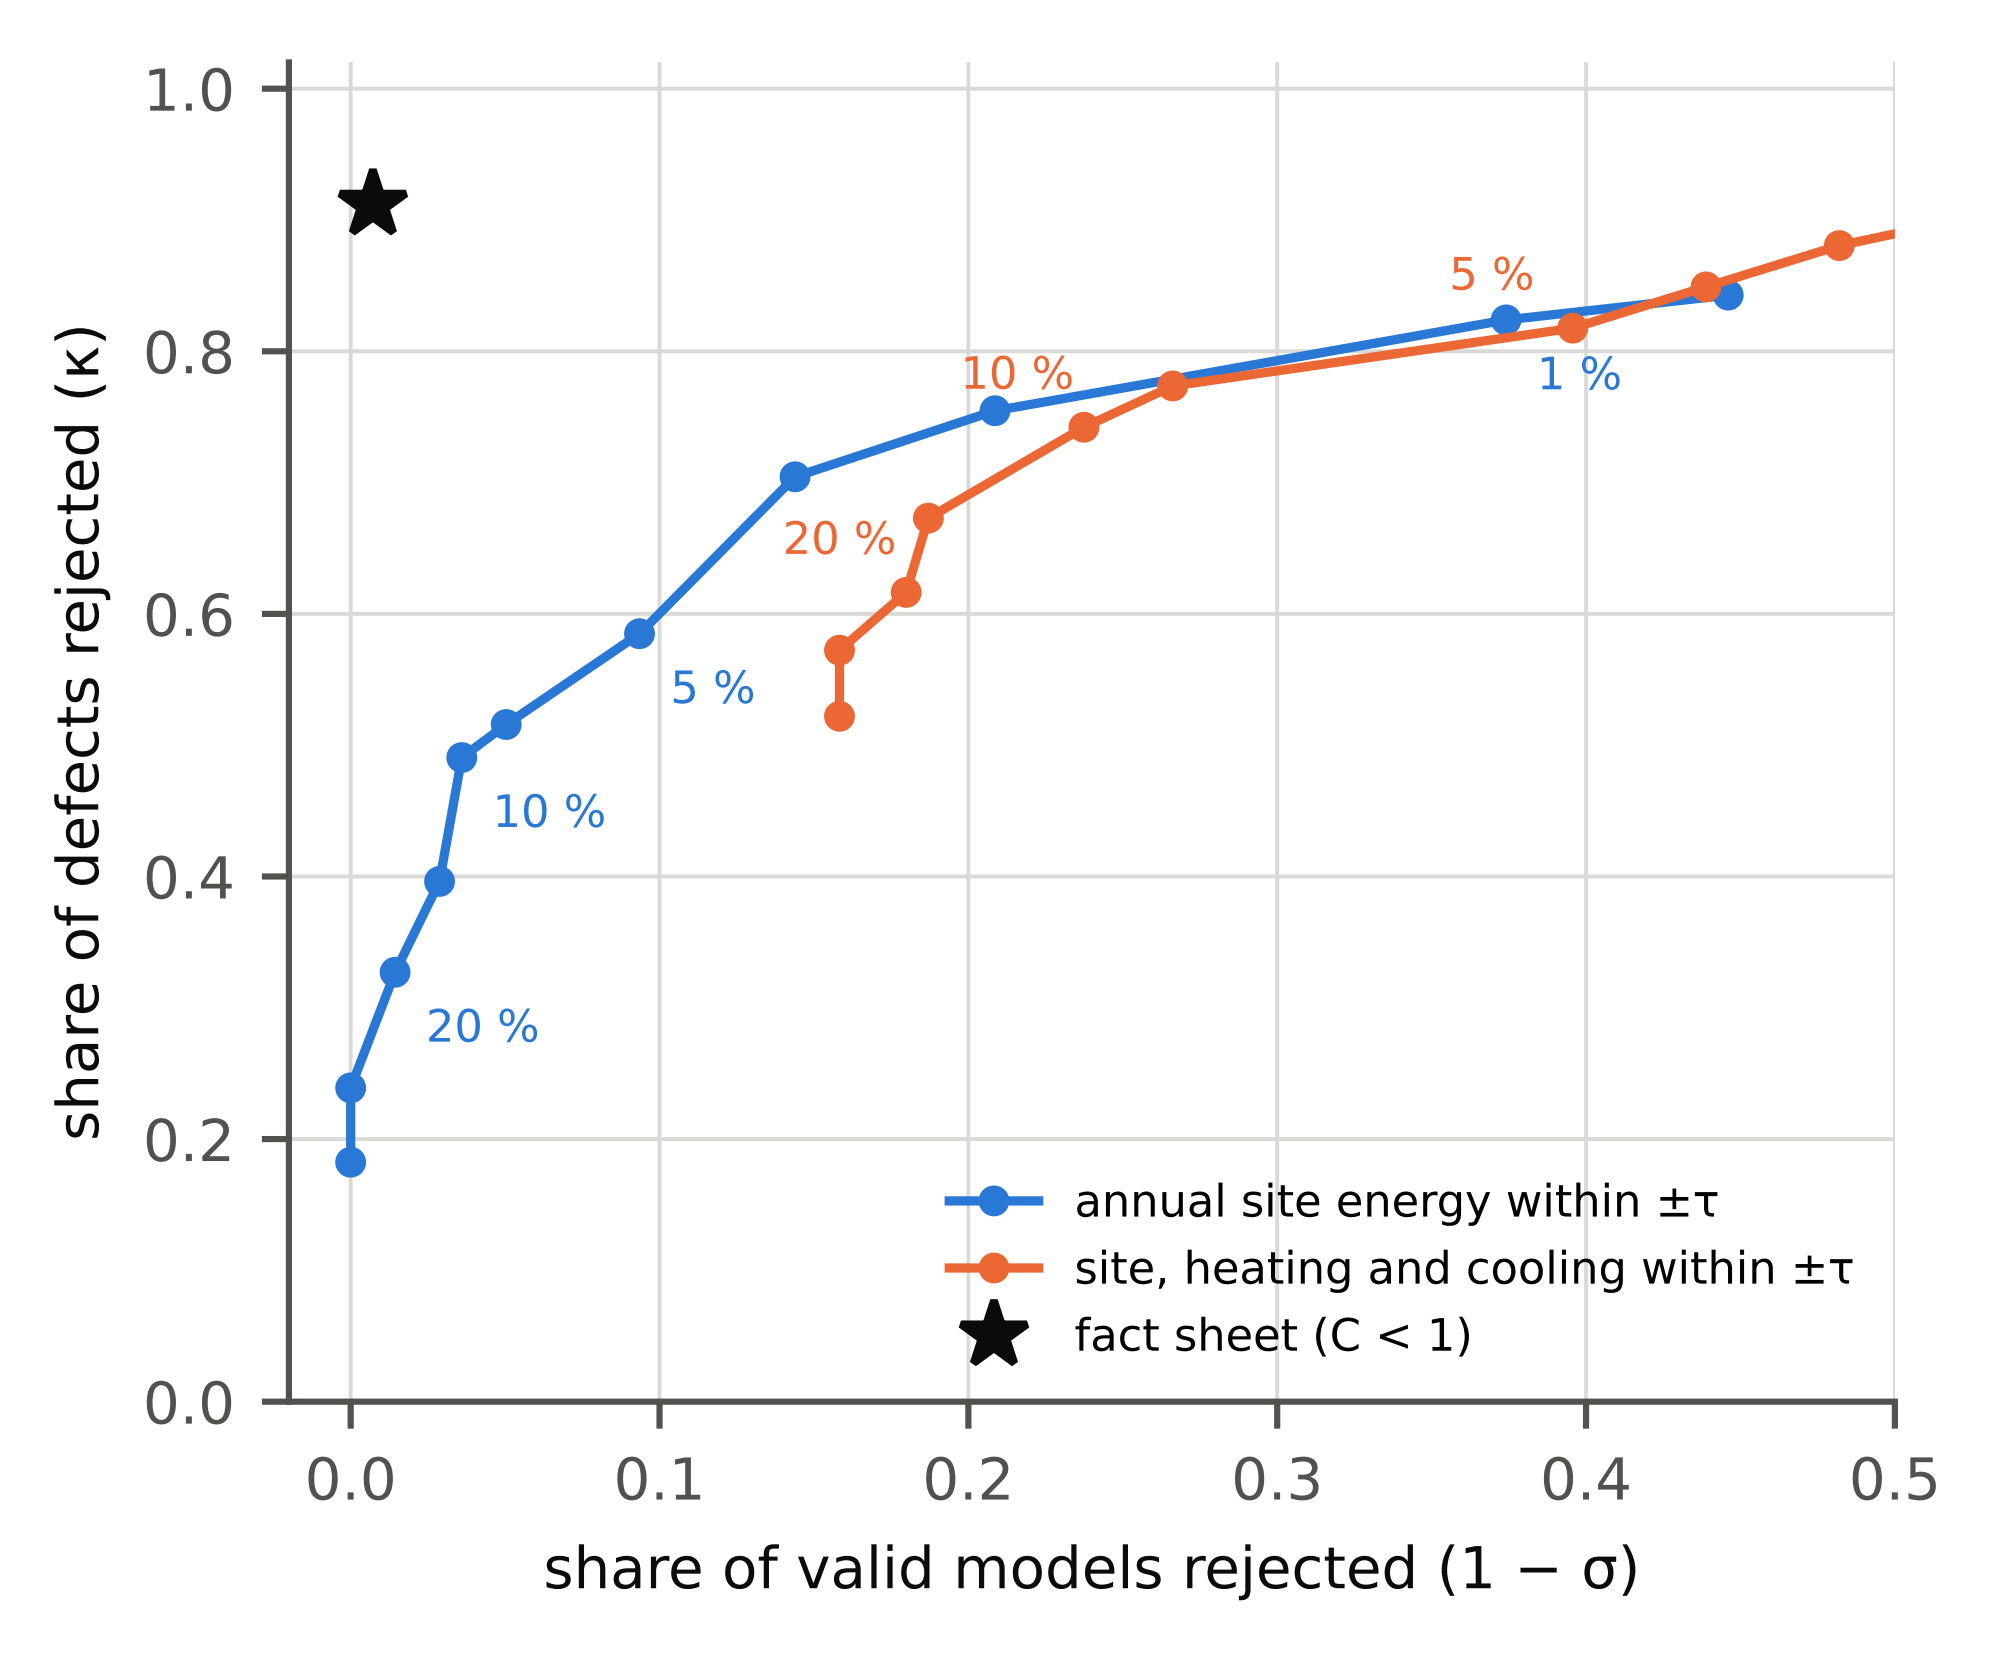
1.0
0.8
0.6
0.4
0.2
0.0
share of defects rejected (κ)
0.0
0.1
0.2
0.3
0.4
0.5
share of valid models rejected (1 − σ)
5 %
10 %
20 %
1 %
annual site energy within ±τ
site, heating and cooling within ±τ
fact sheet (C < 1)