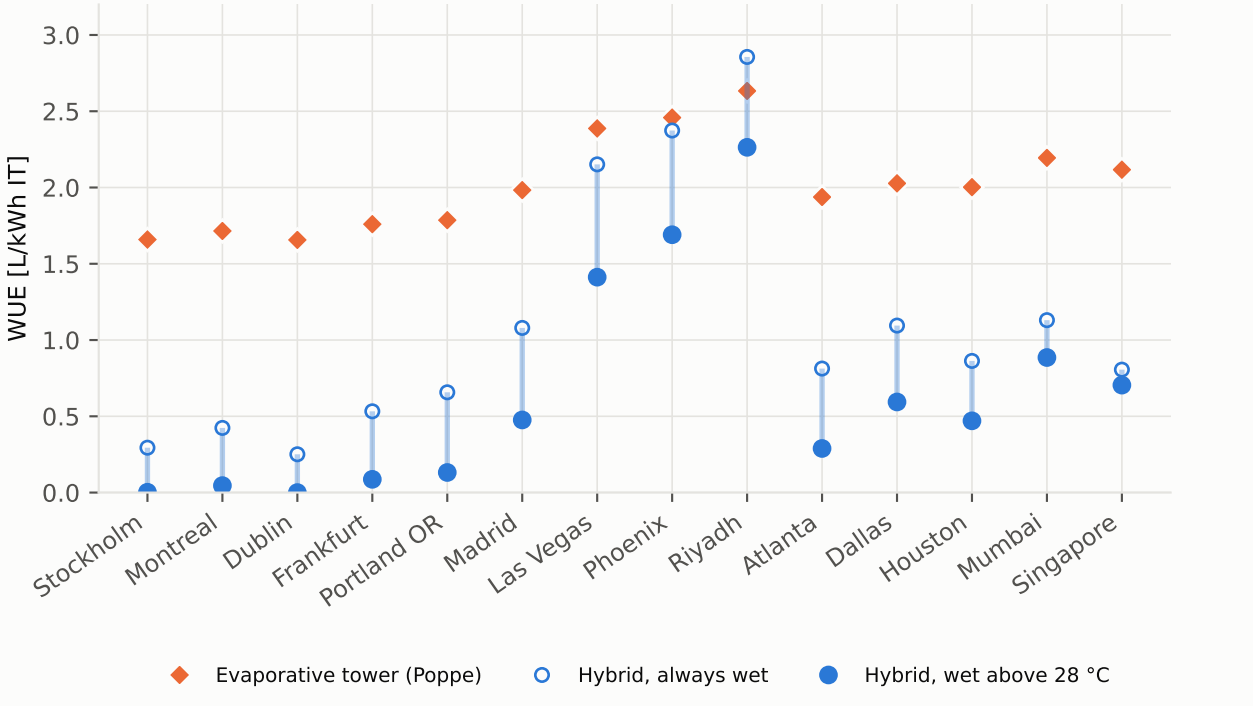
Site water use: hybrid dry cooler vs evaporative tower (sites by mean wet-bulb)
WUE [L/kWh IT]
3.0
2.5
2.0
1.5
1.0
0.5
0.0
Stockholm
Montreal
Dublin
Frankfurt
Portland OR
Madrid
Las Vegas
Phoenix
Riyadh
Atlanta
Dallas
Houston
Mumbai
Singapore
Evaporative tower (Poppe)
Hybrid, always wet
Hybrid, wet above 28 °C