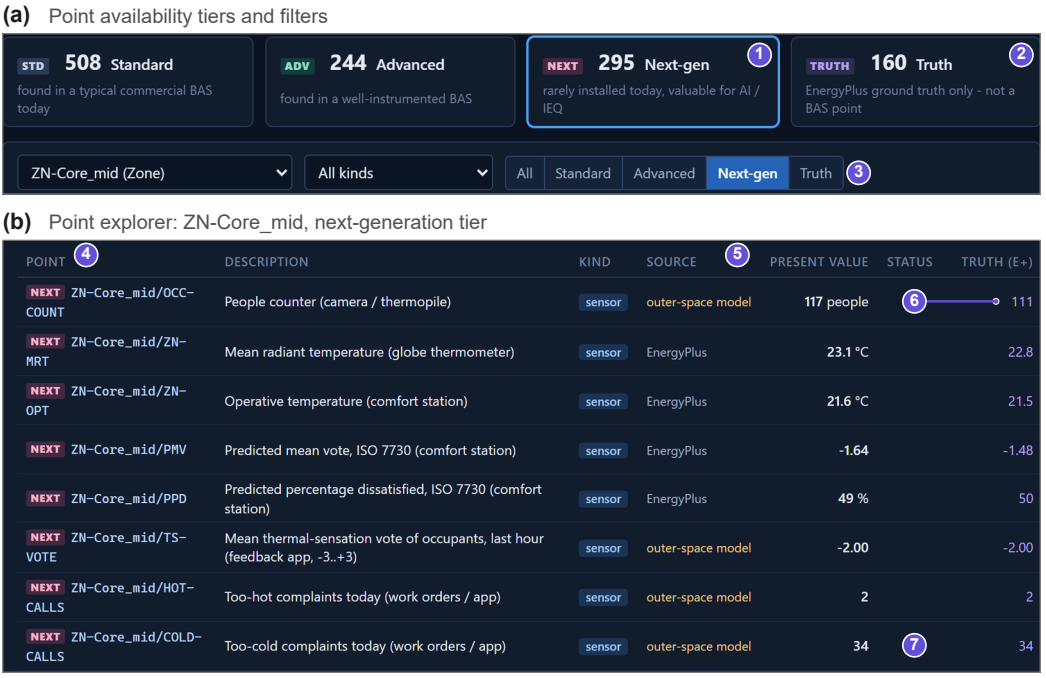

(a) Point availability tiers and filters
STD 508 Standard
found in a typical commercial BAS today
ADV 244 Advanced
found in a well-instrumented BAS
NEXT 295 Next-gen
rarely installed today, valuable for AI / IEQ
1
TRUTH 160 Truth
EnergyPlus ground truth only - not a BAS point
2
ZN-Core_mid (Zone)
All kinds
All
Standard
Advanced
Next-gen
Truth
3
(b) Point explorer: ZN-Core_mid, next-generation tier
4
5
POINT
DESCRIPTION
KIND
SOURCE
PRESENT VALUE
STATUS
TRUTH (E+)
NEXT ZN-Core_mid/OCC-COUNT
People counter (camera / thermopile)
sensor
outer-space model
117 people
6
111
NEXT ZN-Core_mid/ZN-MRT
Mean radiant temperature (globe thermometer)
sensor
EnergyPlus
23.1 °C
22.8
NEXT ZN-Core_mid/ZN-OPT
Operative temperature (comfort station)
sensor
EnergyPlus
21.6 °C
21.5
NEXT ZN-Core_mid/PMV
Predicted mean vote, ISO 7730 (comfort station)
sensor
EnergyPlus
-1.64
-1.48
NEXT ZN-Core_mid/PPD
Predicted percentage dissatisfied, ISO 7730 (comfort station)
sensor
EnergyPlus
49 %
50
NEXT ZN-Core_mid/TS-VOTE
Mean thermal-sensation vote of occupants, last hour (feedback app, -3..+3)
sensor
outer-space model
-2.00
-2.00
NEXT ZN-Core_mid/HOT-CALLS
Too-hot complaints today (work orders / app)
sensor
outer-space model
2
2
NEXT ZN-Core_mid/COLD-CALLS
Too-cold complaints today (work orders / app)
sensor
outer-space model
34
7
34