
(a) Real building: the local controller drives the **measured** value to the set point



(b) Virtual BAS: EnergyPlus closes the loop on the **true** value with an ideal controller

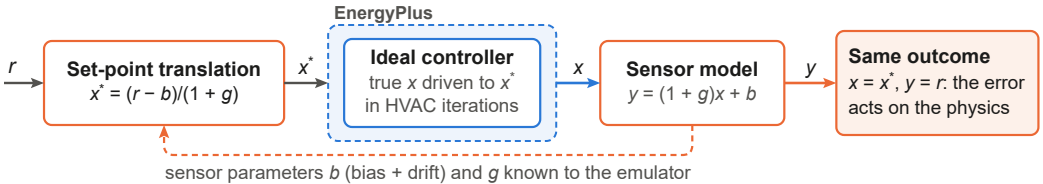

Stuck or spoofed reading: integral wind-up, $x^* = x_{max}$ or x_{min}. Missing reading: last output held.