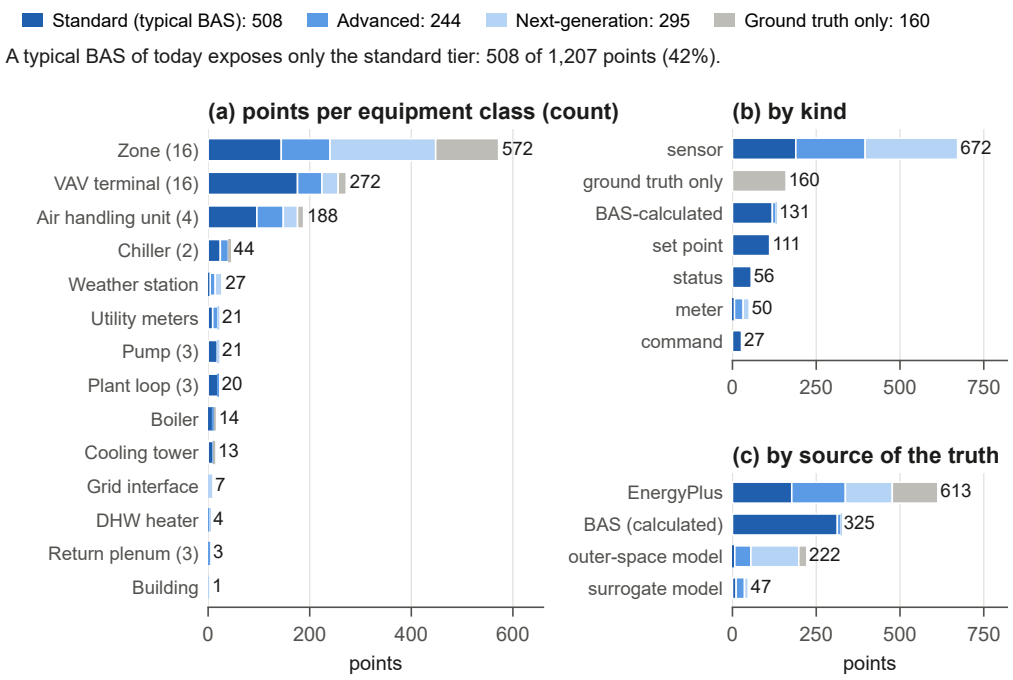
Standard (typical BAS): 508
Advanced: 244
Next-generation: 295
Ground truth only: 160
A typical BAS of today exposes only the standard tier: 508 of 1,207 points (42%).
(a) points per equipment class (count)
Zone (16)
572
VAV terminal (16)
272
Air handling unit (4)
188
Chiller (2)
44
Weather station
27
Utility meters
21
Pump (3)
21
Plant loop (3)
20
Boiler
14
Cooling tower
13
Grid interface
7
DHW heater
4
Return plenum (3)
3
Building
1
0
200
400
600
points
(b) by kind
sensor
672
ground truth only
160
BAS-calculated
131
set point
111
status
56
meter
50
command
27
0
250
500
750
(c) by source of the truth
EnergyPlus
613
BAS (calculated)
325
outer-space model
222
surrogate model
47
0
250
500
750
points