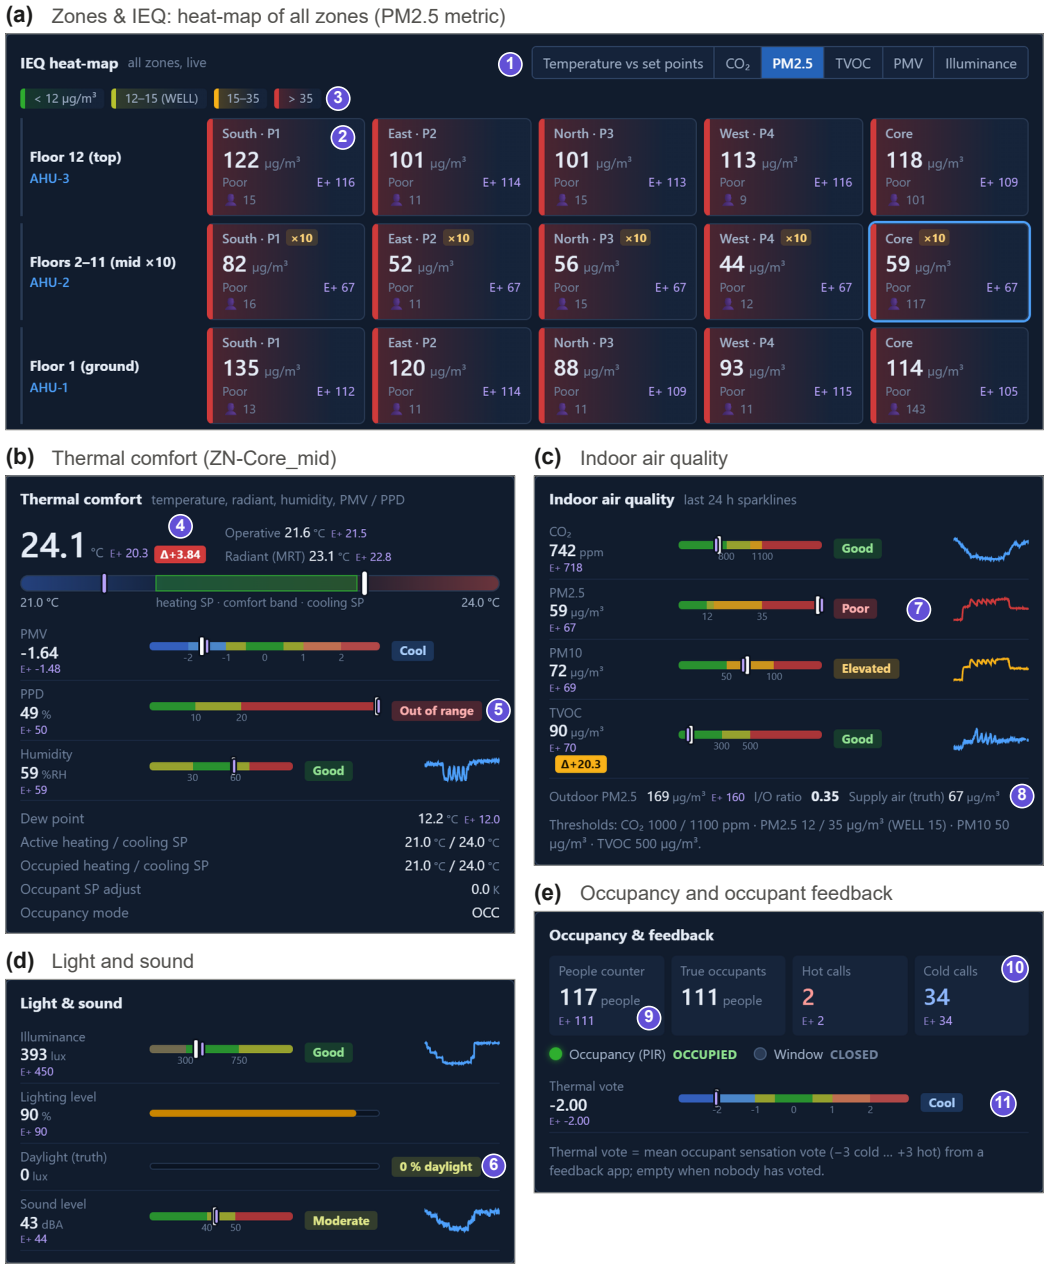

(a) Zones & IEQ: heat-map of all zones (PM2.5 metric)
IEQ heat-map all zones, live
1
Temperature vs set points
CO₂
PM2.5
TVOC
PMV
Illuminance
< 12 µg/m³
12–15 (WELL)
15–35
> 35
3
Floor 12 (top)
AHU-3
South · P1
2
122 µg/m³
Poor
E+ 116
15
East · P2
101 µg/m³
Poor
E+ 114
11
North · P3
101 µg/m³
Poor
E+ 113
15
West · P4
113 µg/m³
Poor
E+ 116
9
Core
118 µg/m³
Poor
E+ 109
101
Floors 2–11 (mid ×10)
AHU-2
South · P1 ×10
82 µg/m³
Poor
E+ 67
16
East · P2 ×10
52 µg/m³
Poor
E+ 67
11
North · P3 ×10
56 µg/m³
Poor
E+ 67
15
West · P4 ×10
44 µg/m³
Poor
E+ 67
12
Core ×10
59 µg/m³
Poor
E+ 67
117
Floor 1 (ground)
AHU-1
South · P1
135 µg/m³
Poor
E+ 112
13
East · P2
120 µg/m³
Poor
E+ 114
11
North · P3
88 µg/m³
Poor
E+ 109
11
West · P4
93 µg/m³
Poor
E+ 115
11
Core
114 µg/m³
Poor
E+ 105
143
(b) Thermal comfort (ZN-Core_mid)
Thermal comfort temperature, radiant, humidity, PMV / PPD
4
24.1 °C E+ 20.3
Δ+3.84
Operative 21.6 °C E+ 21.5
Radiant (MRT) 23.1 °C E+ 22.8
21.0 °C
heating SP · comfort band · cooling SP
24.0 °C
PMV
-1.64
E+ -1.48
-2
-1
0
1
2
Cool
PPD
49 %
E+ 50
10
20
Out of range
5
Humidity
59 %RH
E+ 59
30
60
Good
Dew point 12.2 °C E+ 12.0
Active heating / cooling SP 21.0 °C / 24.0 °C
Occupied heating / cooling SP 21.0 °C / 24.0 °C
Occupant SP adjust 0.0 K
Occupancy mode OCC
(c) Indoor air quality
Indoor air quality last 24 h sparklines
CO₂
742 ppm
E+ 718
800
1100
Good
PM2.5
59 µg/m³
E+ 67
12
35
Poor
7
PM10
72 µg/m³
E+ 69
50
100
Elevated
TVOC
90 µg/m³
E+ 70
Δ+20.3
300
500
Good
Outdoor PM2.5 169 µg/m³ E+ 160 I/O ratio 0.35 Supply air (truth) 67 µg/m³
8
Thresholds: CO₂ 1000 / 1100 ppm · PM2.5 12 / 35 µg/m³ (WELL 15) · PM10 50 µg/m³ · TVOC 500 µg/m³.
(d) Light and sound
Light & sound
Illuminance
393 lux
E+ 450
300
750
Good
Lighting level
90 %
E+ 90
Daylight (truth)
0 lux
0 % daylight
6
Sound level
43 dBA
E+ 44
40
50
Moderate
(e) Occupancy and occupant feedback
Occupancy & feedback
People counter
117 people
E+ 111
9
True occupants
111 people
Hot calls
2
E+ 2
Cold calls
34
E+ 34
10
Occupancy (PIR) OCCUPIED
Window CLOSED
Thermal vote
-2.00
E+ -2.00
-2
-1
0
1
2
Cool
11
Thermal vote = mean occupant sensation vote (−3 cold … +3 hot) from a feedback app; empty when nobody has voted.