


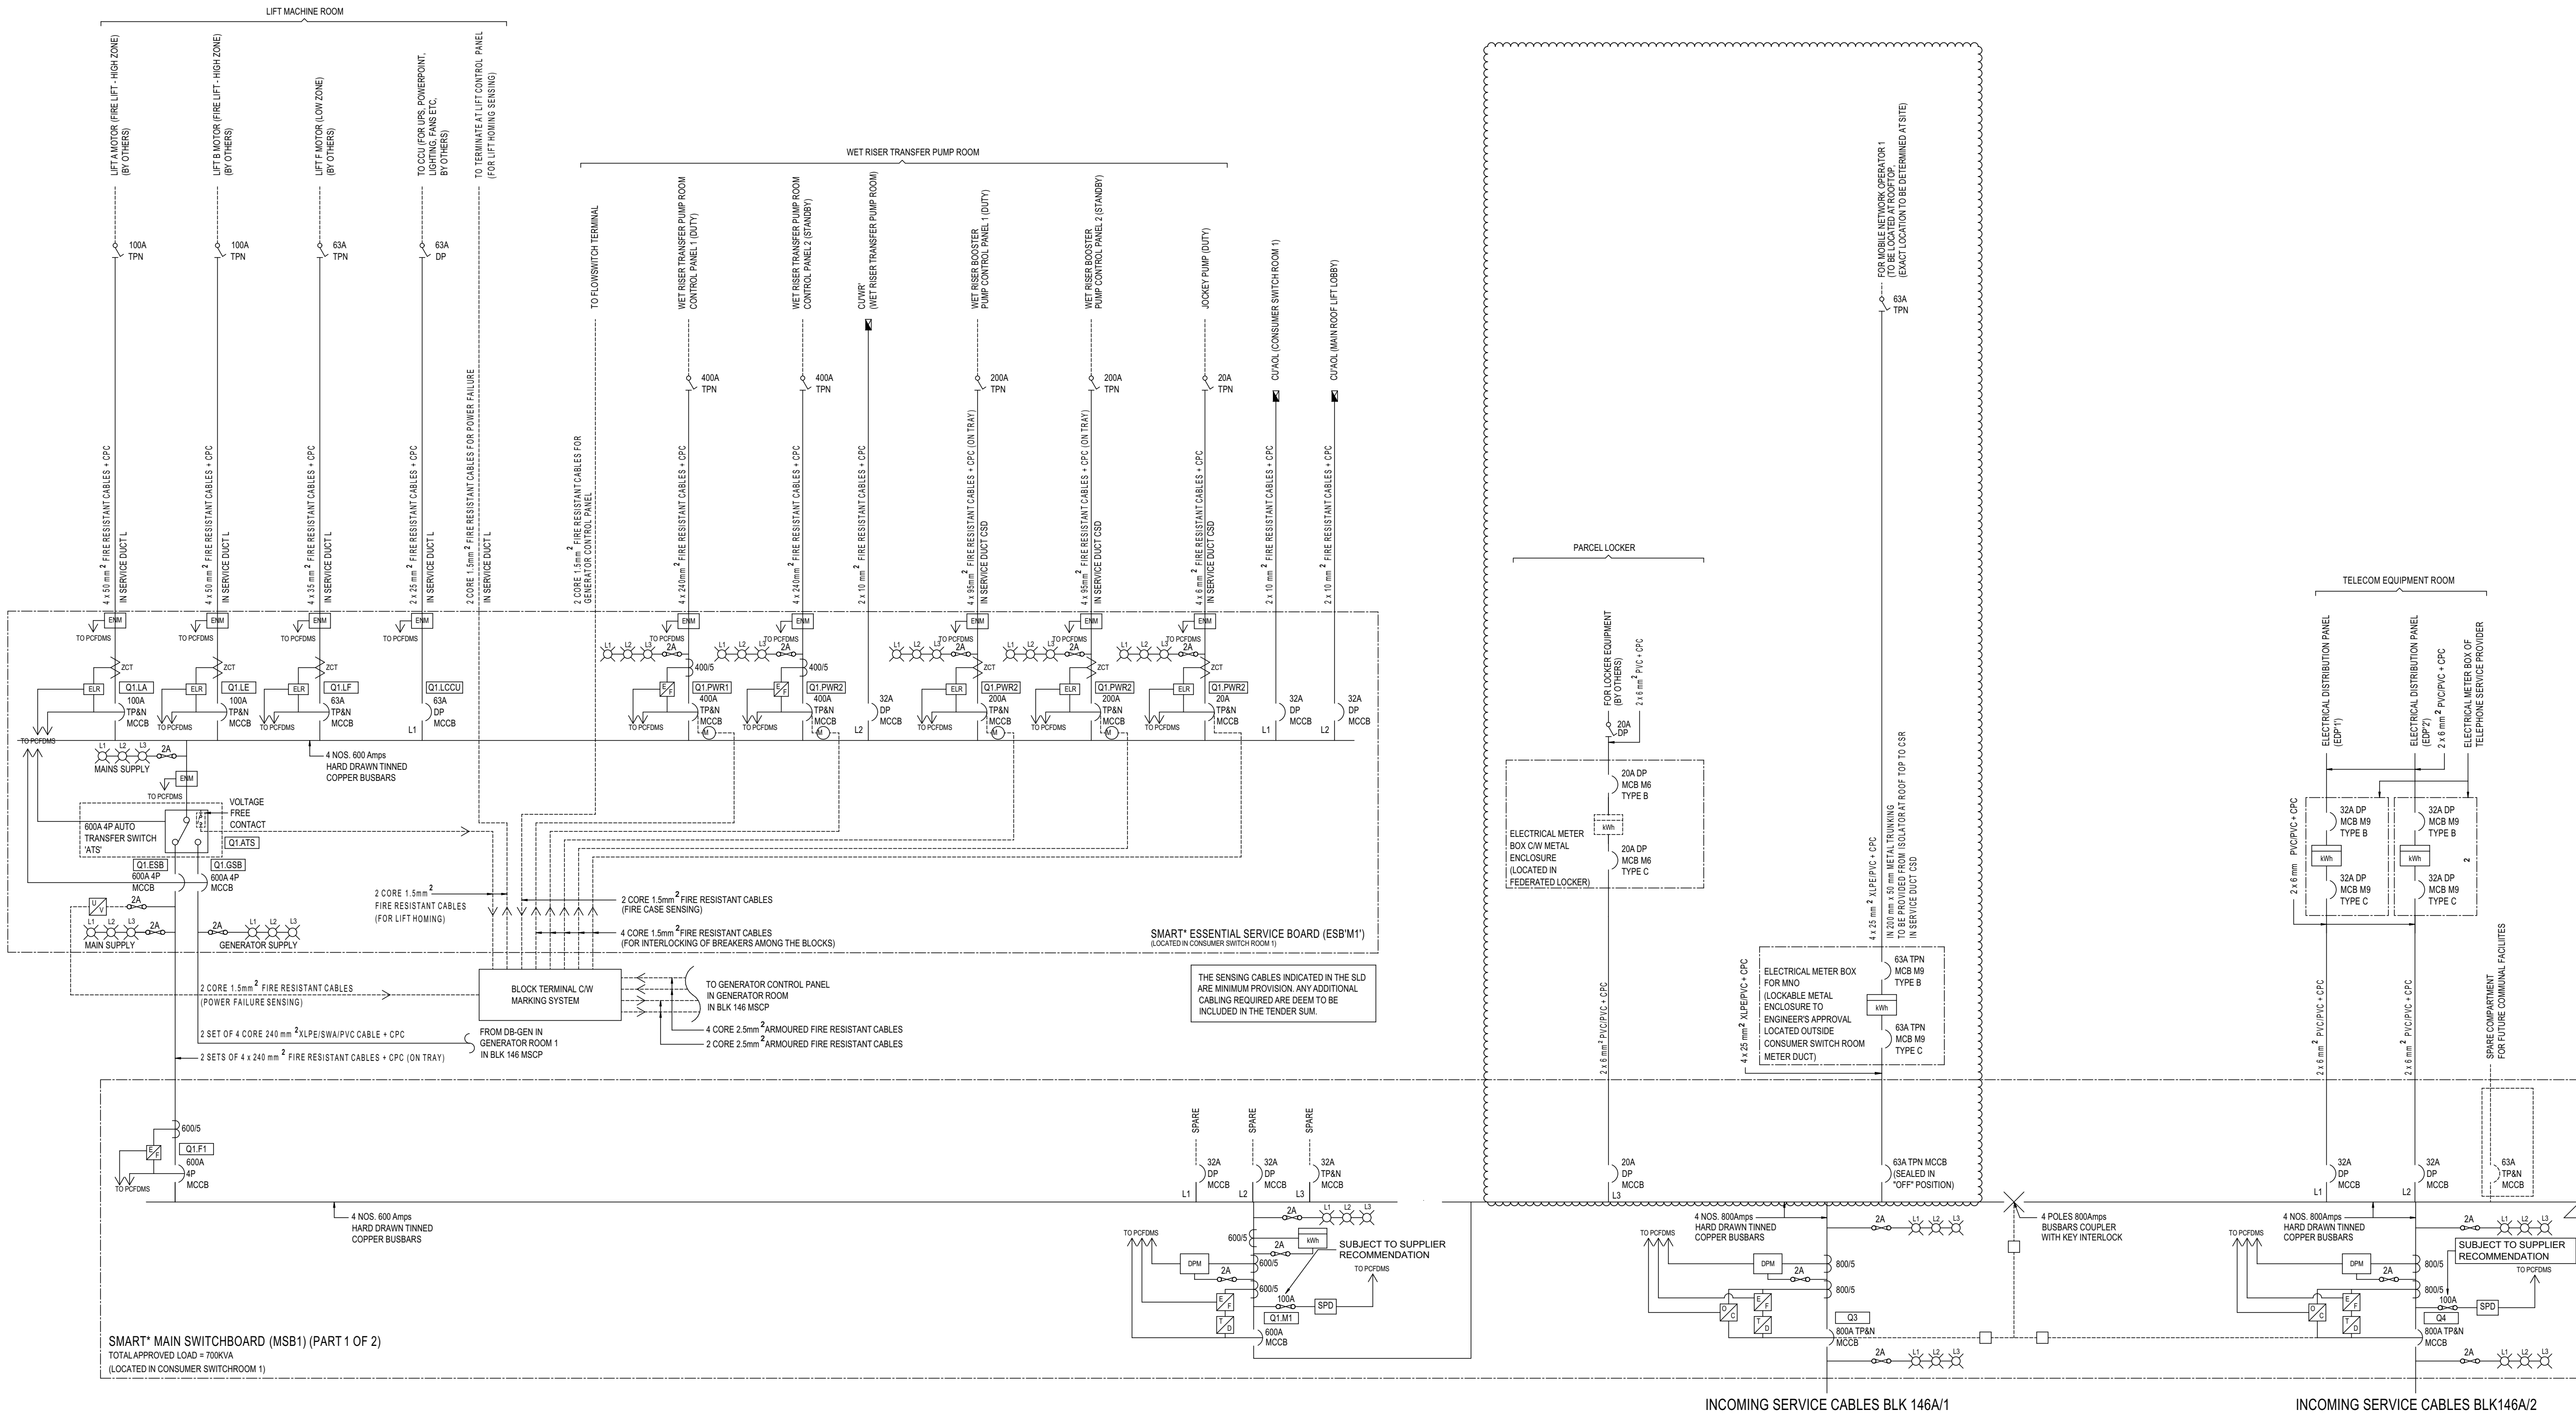

INCOMING SERVICE CABLES BLK 146A/1

INCOMING SERVICE CABLES BLK 146A/2

NOTES:

- 1) MAX. OF 3 OUTPUTS CONNECTION TO EACH TIME SWITCH.
 - 2) ADDITION OF TIME SWITCH REQUIRE WHEN THERE ARE MORE THAN 3 OUTPUTS CONNECTION.
 - 3) FOR TIME SETTING OF T1 TO T4 REFER TO TIME SWITCH SYSTEM STANDARD DRG.
 - 4) FRC DENOTES FIRE RESISTANT CABLES.
 - 5) TIMER TO BE LINKED WITH SMART LIGHTING SYSTEM.
- ABBREVIATION**
- LSS - LIGHT SENSITIVE SWITCH
 - BPS - BY-PASS SWITCH
 - TS - TIME SWITCH
 - SLS - SMART LIGHTING SYSTEM

ELECTRICAL LEGEND

	HRC FUSE
	CIRCUIT BREAKER
	ISOLATOR
	CONTACTOR
	CURRENT TRANSFORMER

	CABLE TERMINATION FOR CAT 6 CABLE (4 WAY CAT 6 QUAD RJ45 SOCKET FACEPLATE)
	PHASE SELECTOR SWITCH
	VOLTMETER
	AMMETER
	MAXIMUM DEMAND AMMETER

	PHASE INDICATOR LIGHTS
	EARTH ELECTRODE C/W INSPECTION PIT
	TIME DELAY RELAY
	DIGITAL EARTH FAULT RELAY WITH LCD DISPLAY
	INVERSE DEFINITE MINIMUM TIME LAG OVER CURRENT RELAY INTEGRATED SURGE ARRESTER AGAINST TRANSIENT OVERVOLTAGE
	DIGITAL PHOTOCELL & ACCESSORIES TO BE INTEGRATED WITH SMART LIGHTING SYSTEM

	SURGE PROTECTION DEVICE (SPD TYPE 1 + SPD TYPE 2)
	EARTH LEAKAGE RELAY WITH SETTING OF 20% OF THE MCCB RATING AND TO THE MAX OF 30A
	KEY INTERLOCK BETWEEN COUPLER AND INCOMERS
	kWh METER BY SP POWER GRID
	kWh METER (PRIVATE METERING)
	kWh METER (BY OTHERS)

	SINGLE PHASE UNFUSED TAP-OFF UNIT
	SINGLE PHASE MCCB TAP-OFF UNIT
	THREE PHASE MCCB TAP-OFF UNIT
	DIGITAL POWER METER
	ZERO-PHASE-SEQUENCE CURRENT TRANSFORMER

	CURRENT TRANSFORMER STRIPS
	DIGITAL TIME SWITCH
	MOTORIZED MCCB
	UNDER VOLTAGE RELAY (TIME & VOLTAGE ADJUSTABLE TYPE)
	PCFDMs DEVICE TAGGING
	POWER CONSUMPTION & FAULT DETECTION MONITORING SYSTEM (PCFDMs)

	ENERGY METER
--	--------------

	REV
--	-----

	AMENDMENT
--	-----------

	DATE
	DRAWN BY
	CHECKED BY
	DE
	QP

	REV
	AMENDMENT
	DATE
	DRAWN BY
	CHECKED BY
	DE
	QP

	SCALE: N.T.S.
	DATE: JUN 2025
	DRAWN BY: JOHN KWOK
	CHECKED BY: NG CH
	NG CHER HEONG DESIGN ENGINEER
	NG CHER HEONG QUALIFIED PERSON

	DRAWING NO.: HB-D24027-ME-111
	REVISION: C
	LOT NO.: 042411 PT, 04244N PT, 04242A PT, 04248M, 04251M PT, 04252W PT, 04245X PT, 04247C, 02983K, 04264C, 04265M PT, 04263L, 02525M, 04262X PT, 02520K PT, 00457X PT, 03775A PT, 04250C PT, 04246L PT, 00245A PT, 04261N PT
	MUKIM NO.: 01
	JOB TITLE: PROJECT DN
	DRAWING TITLE: SINGLE LINE DIAGRAM OF MAIN SWITCHBOARD 1 (PART 1 OF 2)

TENDER DRAWING



HDB Hub 480 Lorong 8 Toa Payoh
Singapore 310480

OWNER SIGNATURE:

PRECINCT NAME:

BTO

PROJECT TITLE

BUILDING WORKS AT PROJECT DN

LOT NO.: 042411 PT, 04244N PT, 04242A PT, 04248M, 04251M PT, 04252W PT, 04245X PT, 04247C, 02983K, 04264C, 04265M PT, 04263L, 02525M, 04262X PT, 02520K PT, 00457X PT, 03775A PT, 04250C PT, 04246L PT, 00245A PT, 04261N PT

MUKIM NO.: 01

JOB TITLE

PROJECT DN

DRAWING TITLE (EST. BLK. NO. 146A)

SINGLE LINE DIAGRAM OF MAIN SWITCHBOARD 1 (PART 1 OF 2)

DRAWING NO.: HB-D24027-ME-111

REVISION: C

SCALE: N.T.S.

DATE: JUN 2025

DRAWN BY: JOHN KWOK

CHECKED BY: NG CH

NG CHER HEONG
DESIGN ENGINEER

NG CHER HEONG
QUALIFIED PERSON

THE OWNERSHIP OF THE COPYRIGHT IN THIS DRAWING IS RETAINED BY HOUSING & DEVELOPMENT BOARD WHOSE CONSENT MUST BE SOUGHT BEFORE ANY USE OR REPRODUCTION OF THE DRAWING OR ANY PART THEREOF CAN BE MADE.