


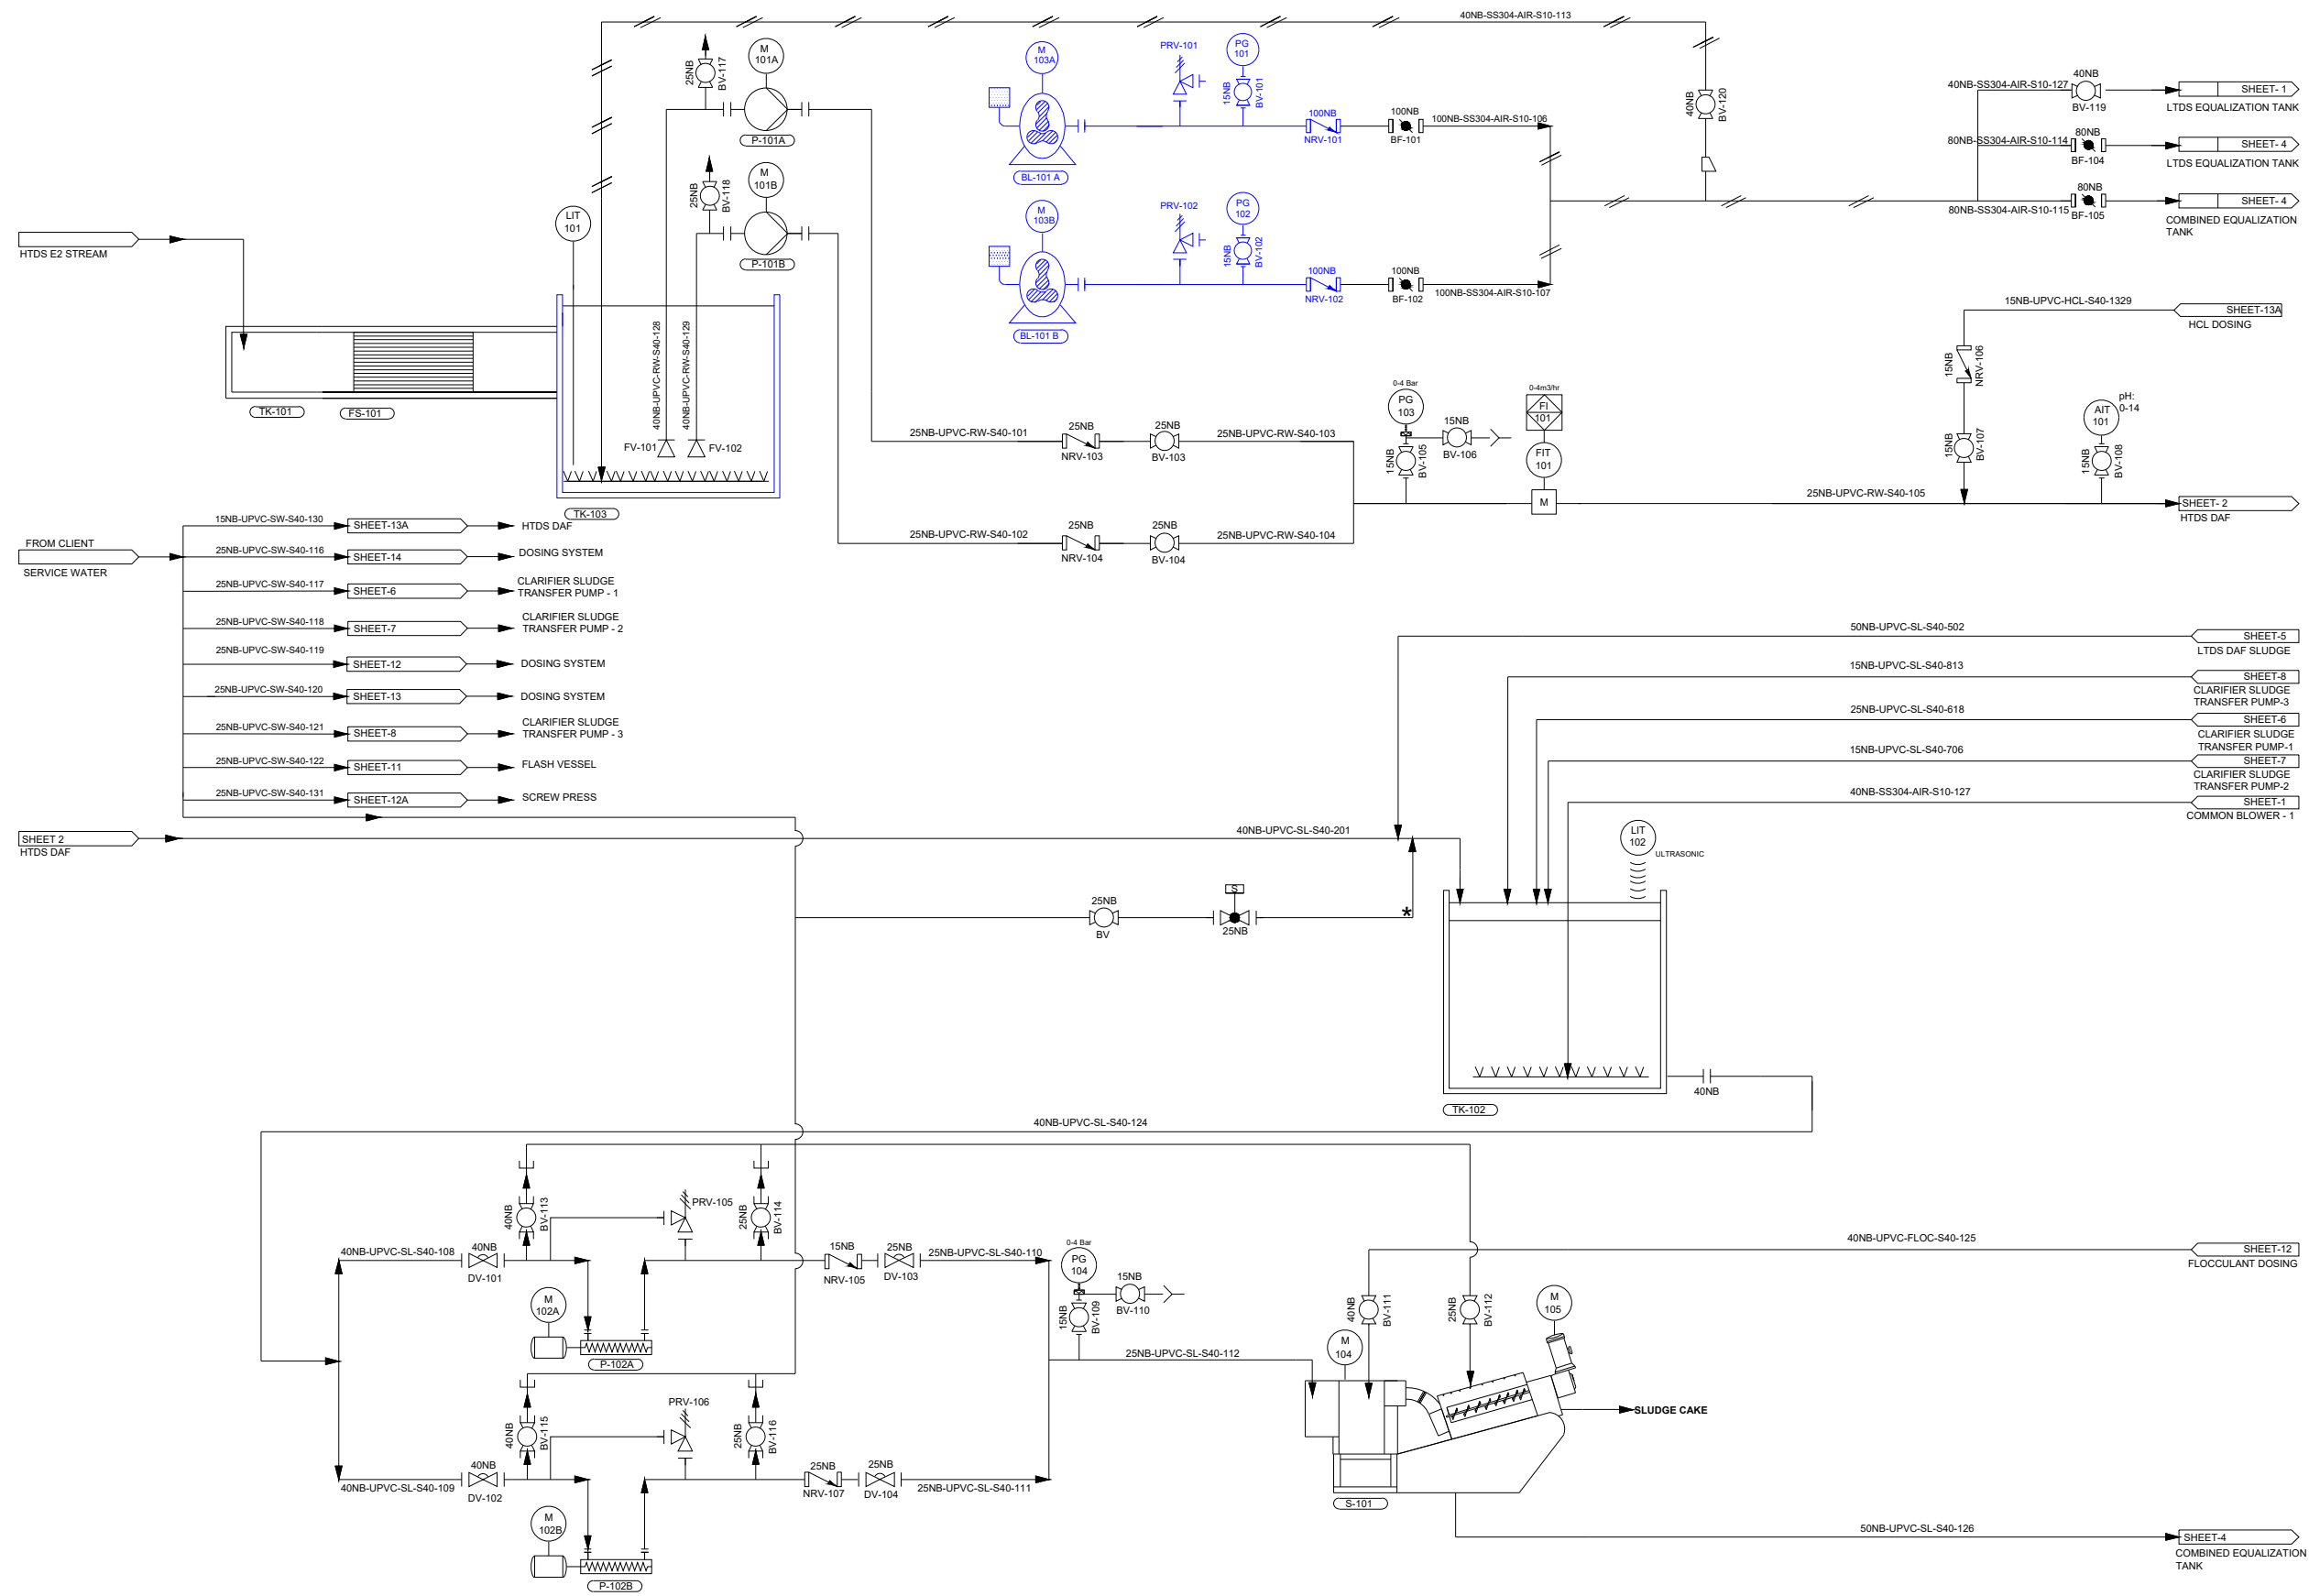

FS-101 HTDS MANUAL FINE SCREEN Capacity: 5 m3/hr Quantity: 1No MOC:SS316	TK-101 HTDS MANUAL SCREEN CHAMBER Quantity: 1No MOC:SS304	TK-103 HTDS EQUALIZATION TANK Capacity: 59m3 Quantity: 1No MOC:RCC	BL-101A/B COMMON BLOWER - 1 Capacity: 600m3/hr@0.5 Bar Quantity: 1W+1S MOC:CI	P-101A/B HTDS DAF FEED PUMP Capacity:2.5m3/hr@2.5 Bar Quantity: 1W+1S MOC: PVDF	TK-102 CHEMICAL SLUDGE CONDITIONING TANK Capacity:59m3 Quantity: 1 No MOC: RCC	P-102A/B SCREW PRESS FEED PUMP Capacity:4m3/hr@2 Bar Quantity: 1W+1S MOC: CI/SS/NBR	S-101 SCREW PRESS Capacity:4m3/hr Quantity: 1No MOC: SS
---	---	---	--	--	---	--	--

NOTE:
1. **BLUE** COLOUR INDICATES THE SUPPLY BY CIPLA
2. **RED** COLOUR INDICATES THE SUPPLY BY CIPLA
3. **BLACK** COLOUR INDICATES THE SUPPLY BY EEPL
* BOTH LTDS & HTDS DAF SLUDGE LINE TO BE COMBINED BY DAF SYSTEM. COMMON AUTO FLUSHING LINE TO BE AT COMMON HEADER LINE

DRAWING STATUS :

- ☐ FOR ENQUIRY
- ☐ FOR REVIEW
- ☐ FOR INFORMATION
- ☒ FOR APPROVAL
- ☐ FOR CONSTRUCTION
- ☐ AS BUILT

CLIENT :
M/S. CIPLA LIMITED,VIRGONAGAR


PROJECT :
200 KLD ETP R&R

CONTRACTOR :

DRAWING TITLE :
P&ID - CIPLA ETP REFURBISHMENT

DRAWN BY : BM	DATE : 25-12-2025
CHECKED BY : JK	
APPROVED BY : AS	
EEPL-CIPLA-ETP-R&R-2025-12	REV : 02
	SHEET : 1 of 14

THIS DRAWING IS A PROPERTY OF EEPL NO PART OR WHOLE SHOULD BE REPRODUCED, COPIED OR GIVEN TO OTHERS WHATSOEVER WITHOUT PRIOR CONSENT

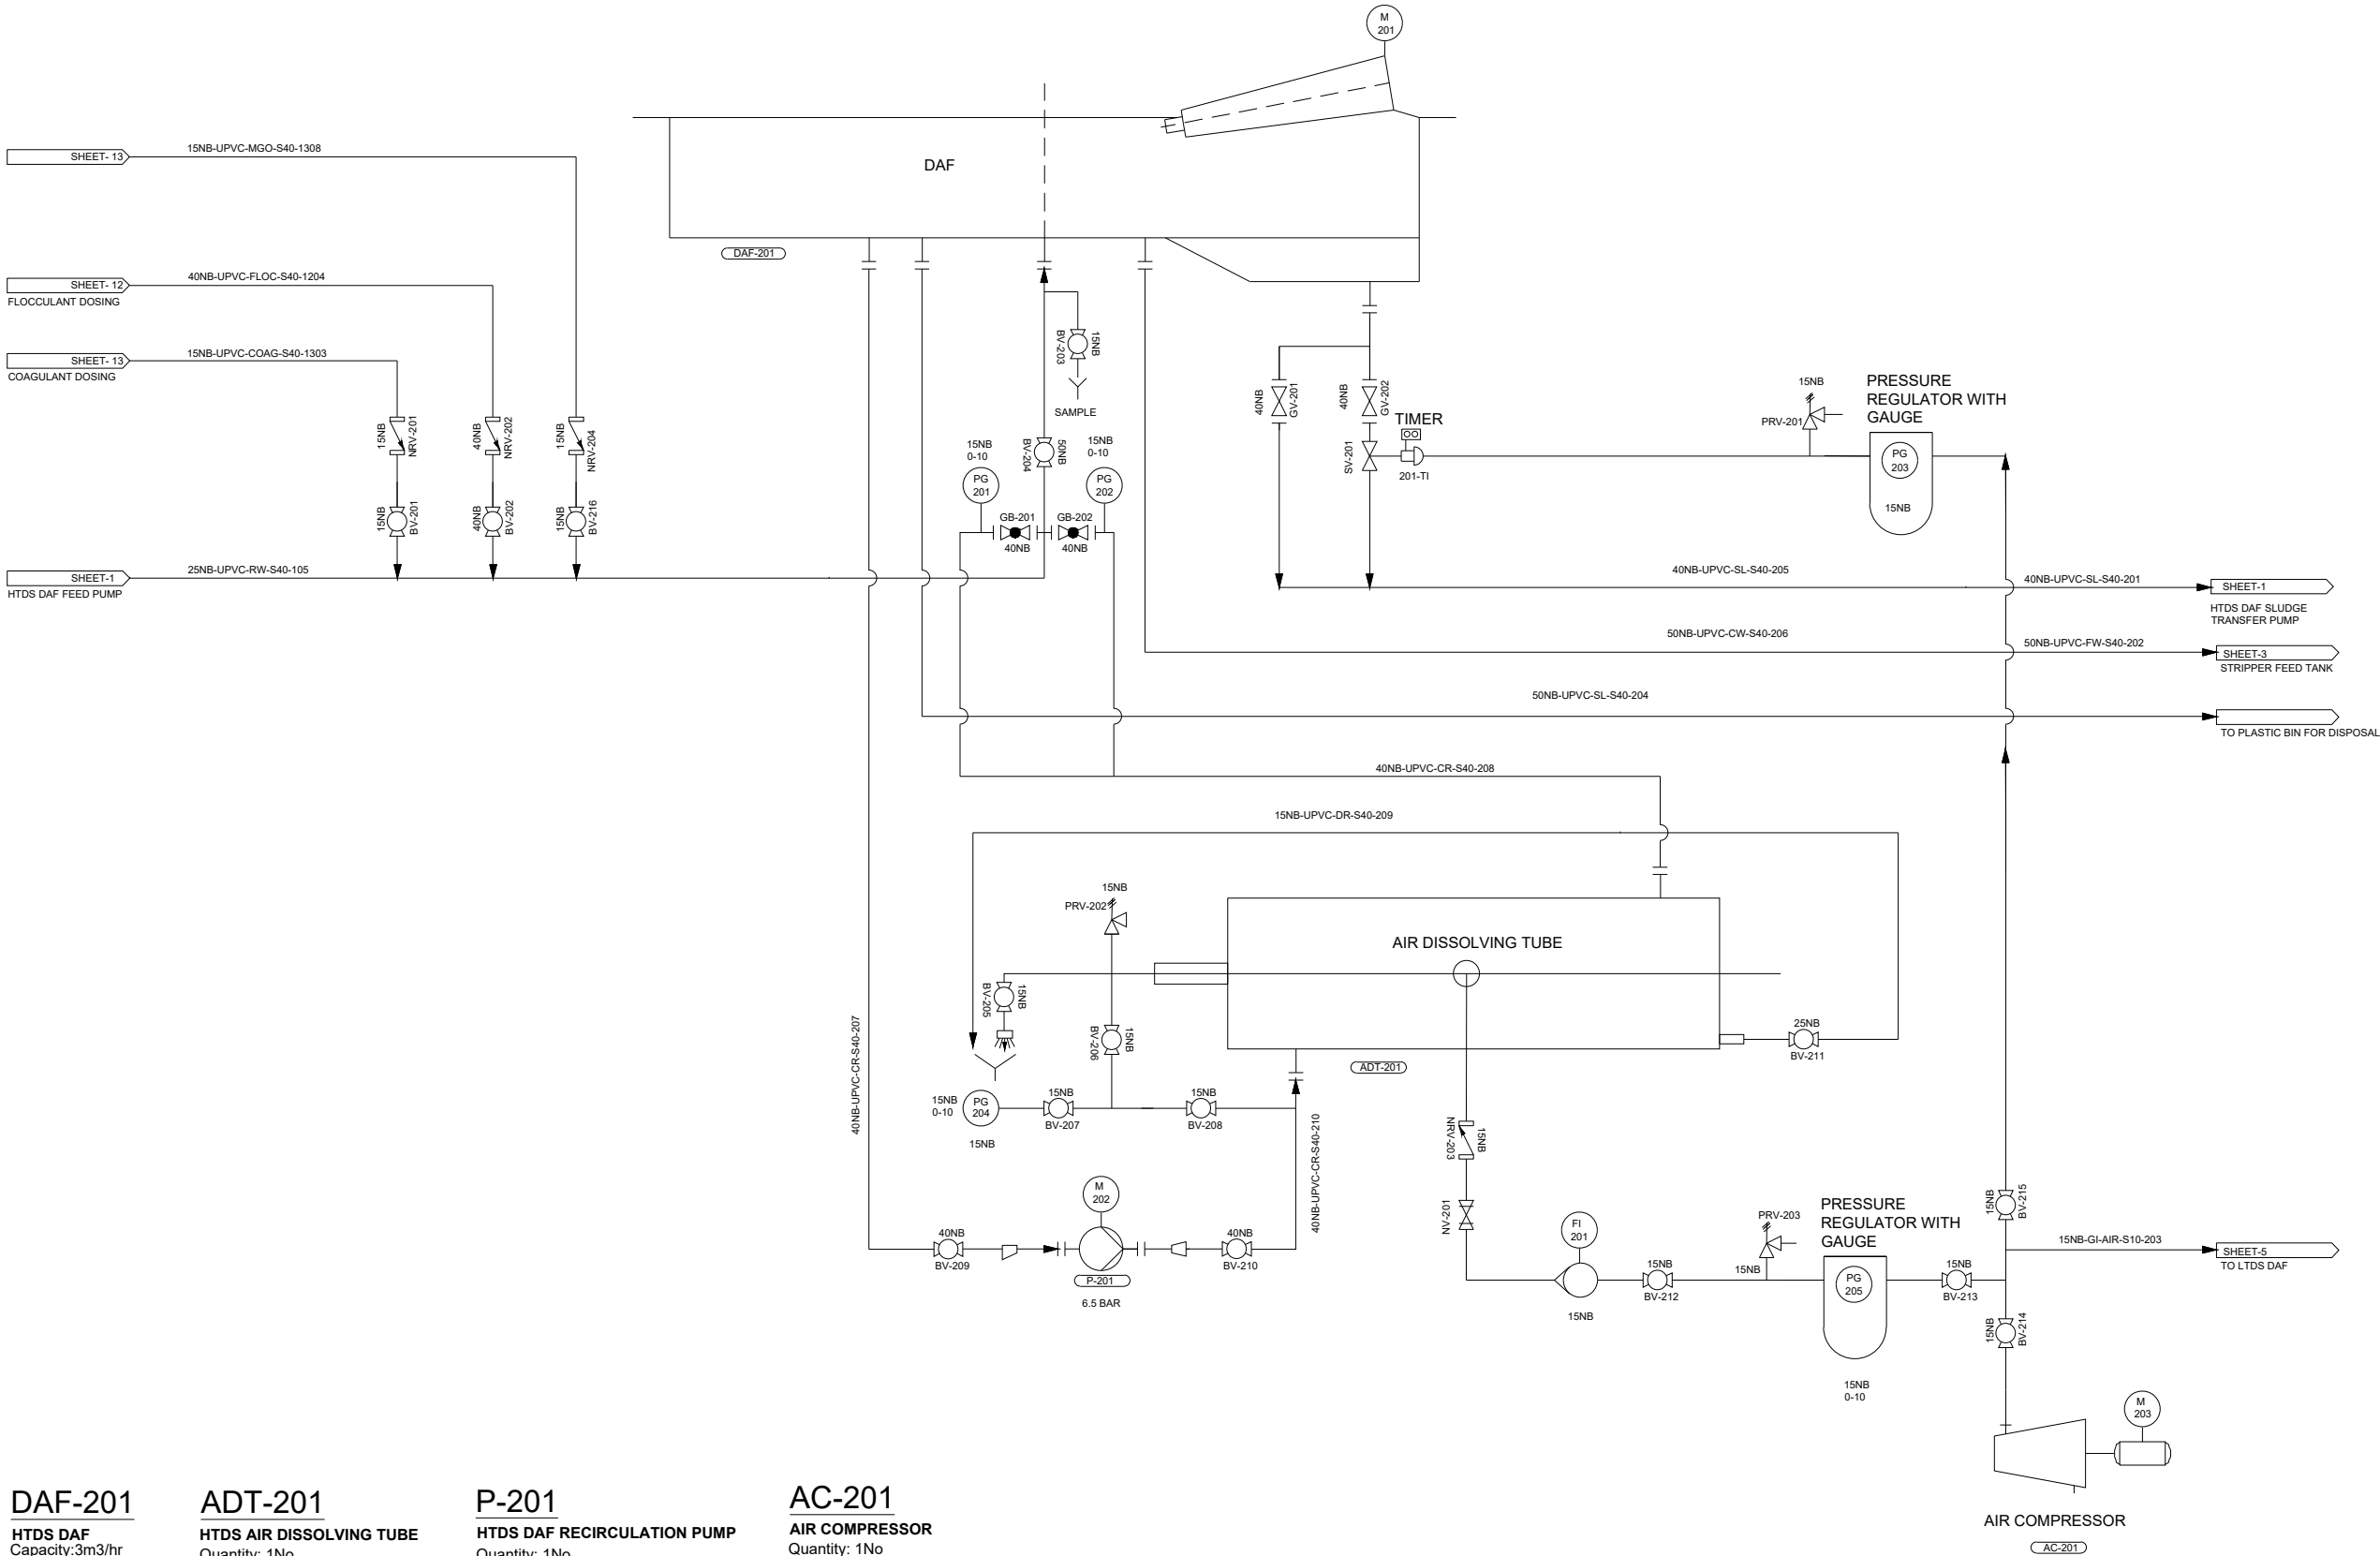

DAF-201
HTDS DAF
Capacity: 3m³/hr
Quantity: 1No
WETTED PART
MOC: SS316
SHELL MOC: SS304

ADT-201
HTDS AIR DISSOLVING TUBE
Quantity: 1No

P-201
HTDS DAF RECIRCULATION PUMP
Quantity: 1No
Capacity: 1m³/hr @6.5 BAR
MOC: SS316

AC-201
AIR COMPRESSOR
Quantity: 1No
Capacity: 10m³/hr @6.5 BAR
MOC: CI

DRAWING STATUS :

- | | |
|---|--|
| ☐ FOR ENQUIRY | ☐ FOR REVIEW |
| ☐ FOR INFORMATION | ☒ FOR APPROVAL |
| ☐ FOR CONSTRUCTION | ☐ AS BUILT |

CLIENT :

M/S. CIPLA LIMITED, VIRGONAGAR

PROJECT :

200 KLD ETP R&R

CONTRACTOR :



DRAWING TITLE :

P&ID - CIPLA ETP REFURBISHMENT

DRAWN BY : BM

CHECKED BY : JK

APPROVED BY : AS


DATE :
25-12-2025

EEPL-CIPLA-ETP-R&R-2025-12

REV : 02

SHEET : 2 of 14

THIS DRAWING IS A PROPERTY OF
EEPL NO PART OR WHOLE SHOULD BE
REPRODUCED, COPIED OR GIVEN TO
OTHERS WHATSOEVER WITHOUT
PRIOR CONSENT

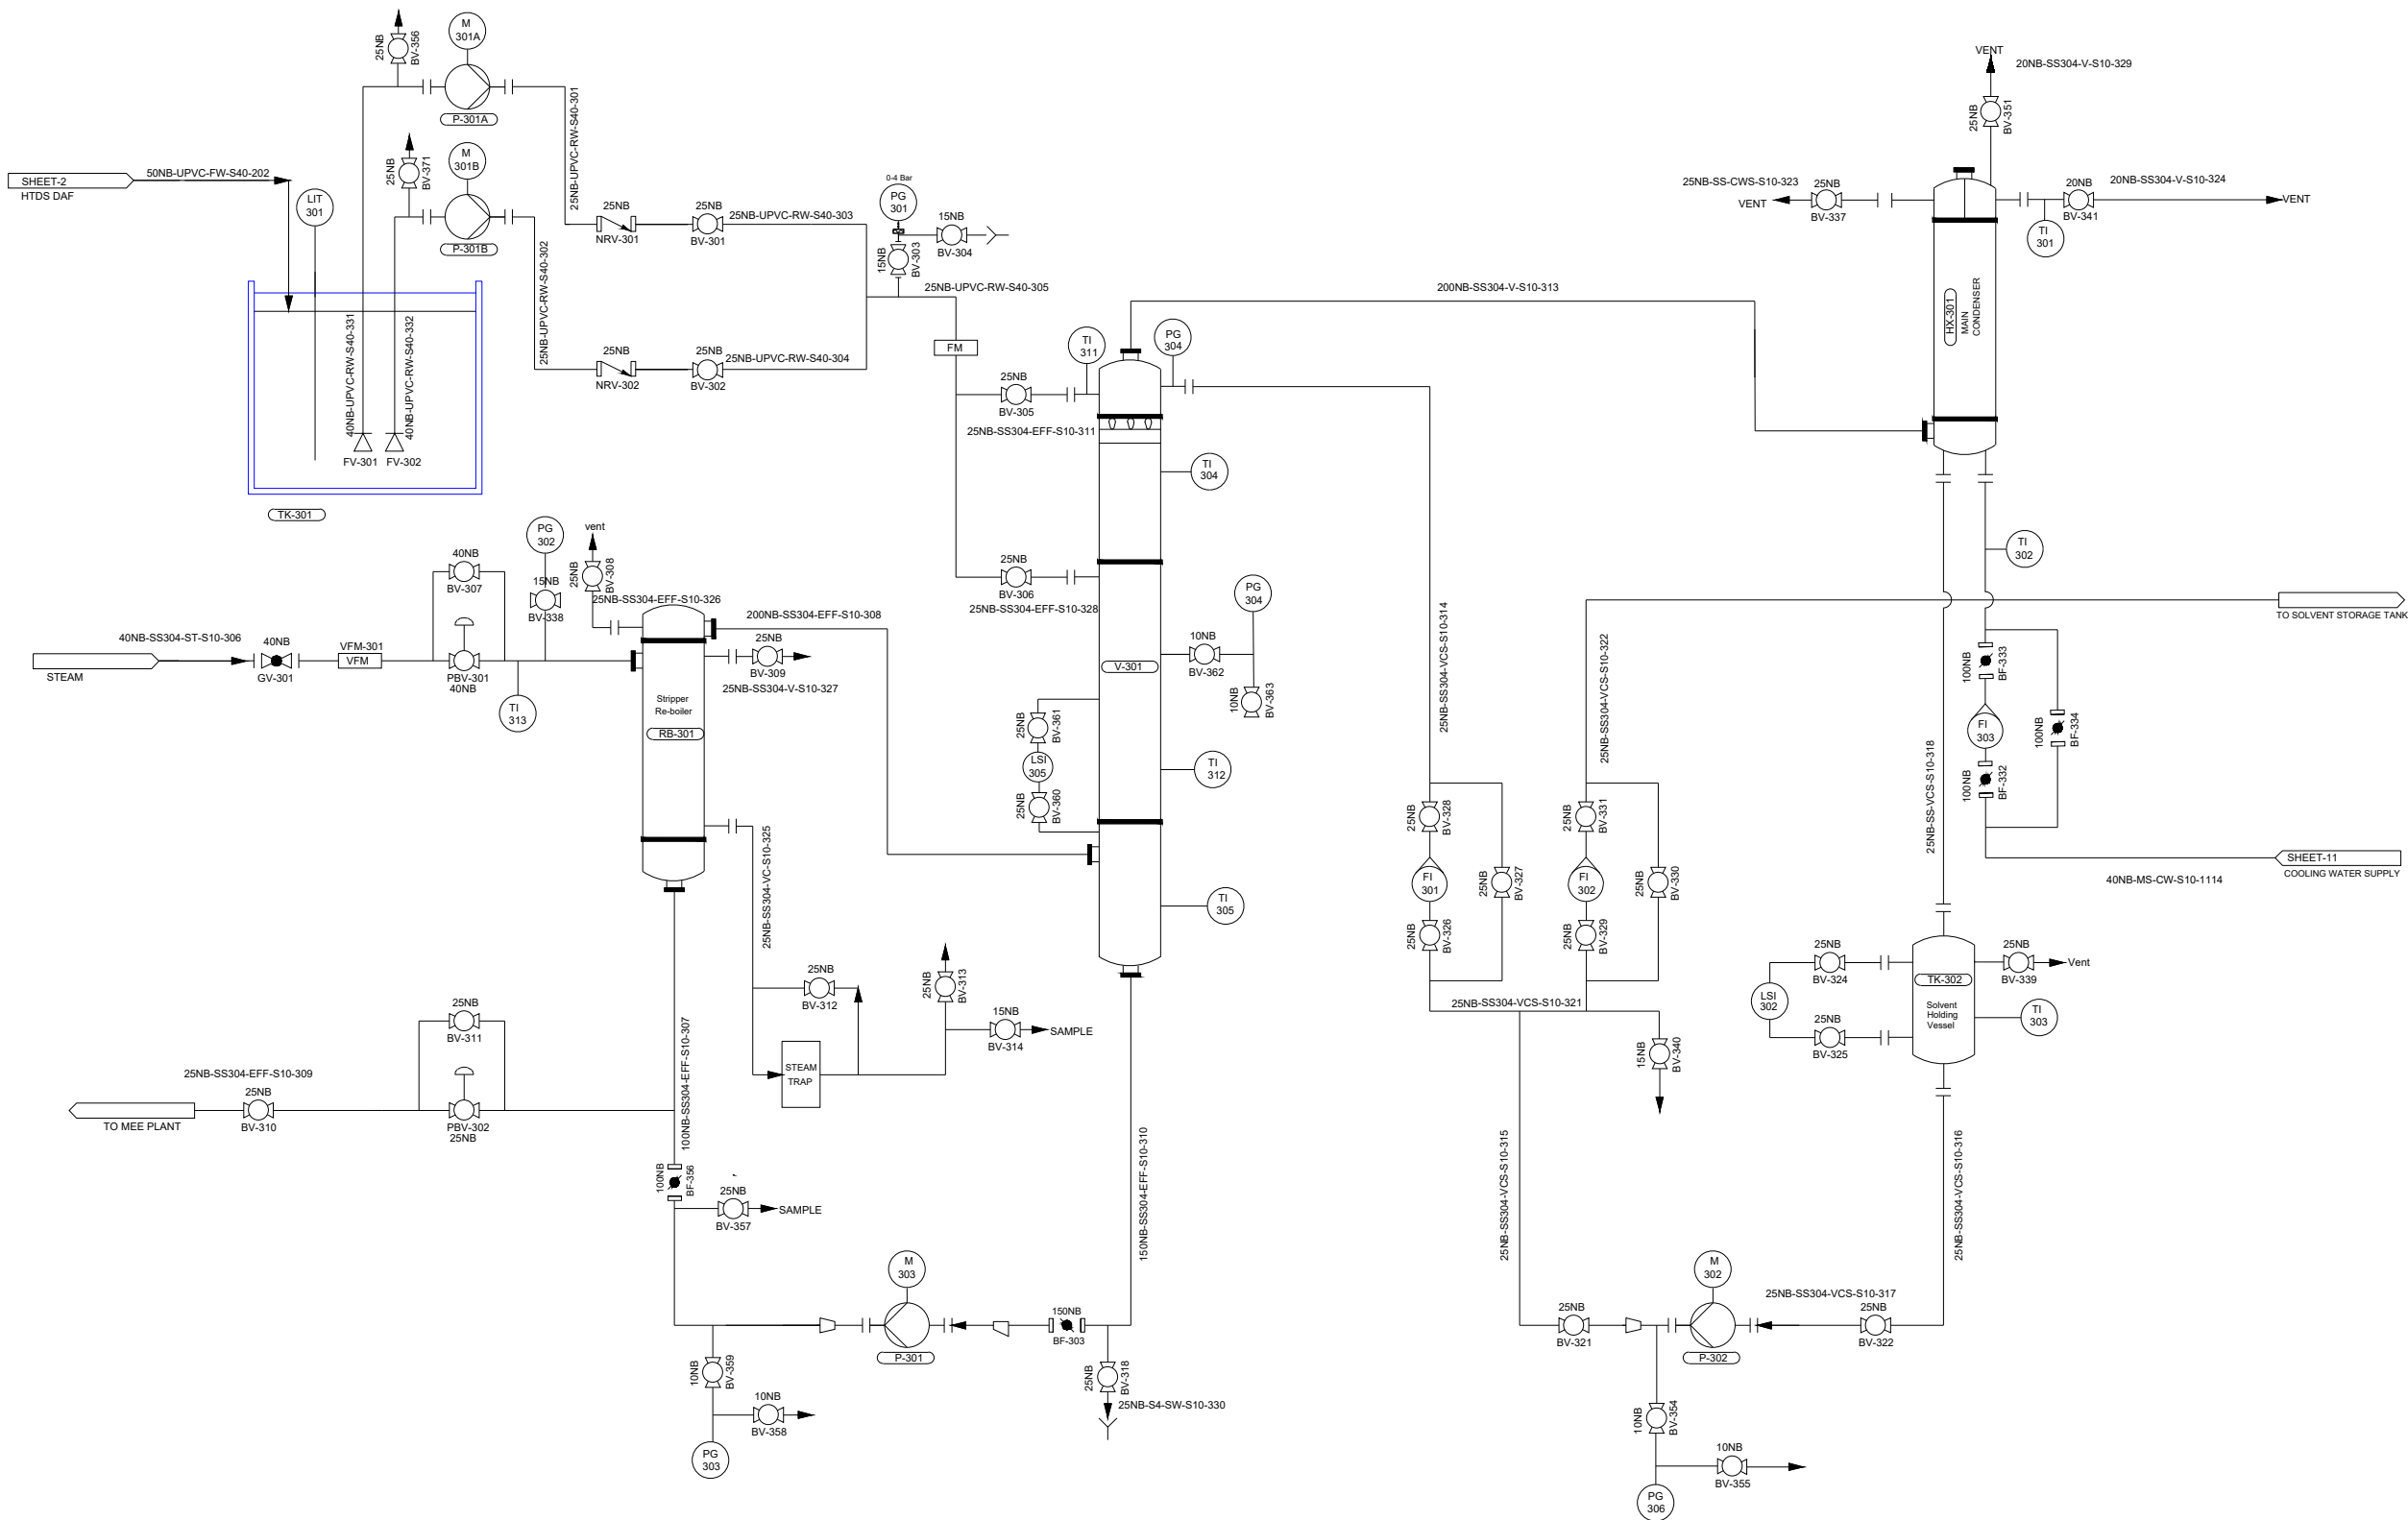

TK-301
STRIPPER FEED TANK
Capacity: 100KL
Quantity: 1No
MOC: RCC

P-301A/B
STRIPPER FEED PUMP
Capacity: 3m³/hr @ 3.5 Bar
Quantity: 1W+1S
MOC: PVDF

RB-301
REBOILER
Quantity: 1No
Area: 15m²
Shell: SS304
Tube: TIGR 2

V-301
STRIPPER COLOUMN
Quantity: 1No
Capacity: 60 klpd
MOC: SS316L

HX-301
MAIN CONDENSER
Quantity: 1No
Area: 15m²
Shell: SS304
Tube: SS304

TK-302
REFLUX DRUM
Quantity: 1No
Capacity: 1KL
MOC: SS304

P-301
STRIPPER RECIRCULATION PUMP
Quantity: 1No
Area: 60m³/hr
MOC: SS316

P-302
REFLUX PUMP
Quantity: 1No
Area: 2m³/hr
MOC: SS316

DRAWING STATUS :

- | | |
|---|--|
| ☐ FOR ENQUIRY | ☐ FOR REVIEW |
| ☐ FOR INFORMATION | ☒ FOR APPROVAL |
| ☐ FOR CONSTRUCTION | ☐ AS BUILT |

CLIENT :

M/S. CIPLA LIMITED, VIRGONAGAR

PROJECT :

200 KLD ETP R&R

CONTRACTOR :



DRAWING TITLE :

P&ID - CIPLA ETP REFURBISHMENT

DRAWN BY : BM

CHECKED BY : JK

APPROVED BY : AS



DATE :
25-12-2025

EEPL-CIPLA-ETP-R&R-2025-12

REV : 02

SHEET : 3 of 14

THIS DRAWING IS A PROPERTY OF EEPL NO PART OR WHOLE SHOULD BE REPRODUCED, COPIED OR GIVEN TO OTHERS WHATSOEVER WITHOUT PRIOR CONSENT

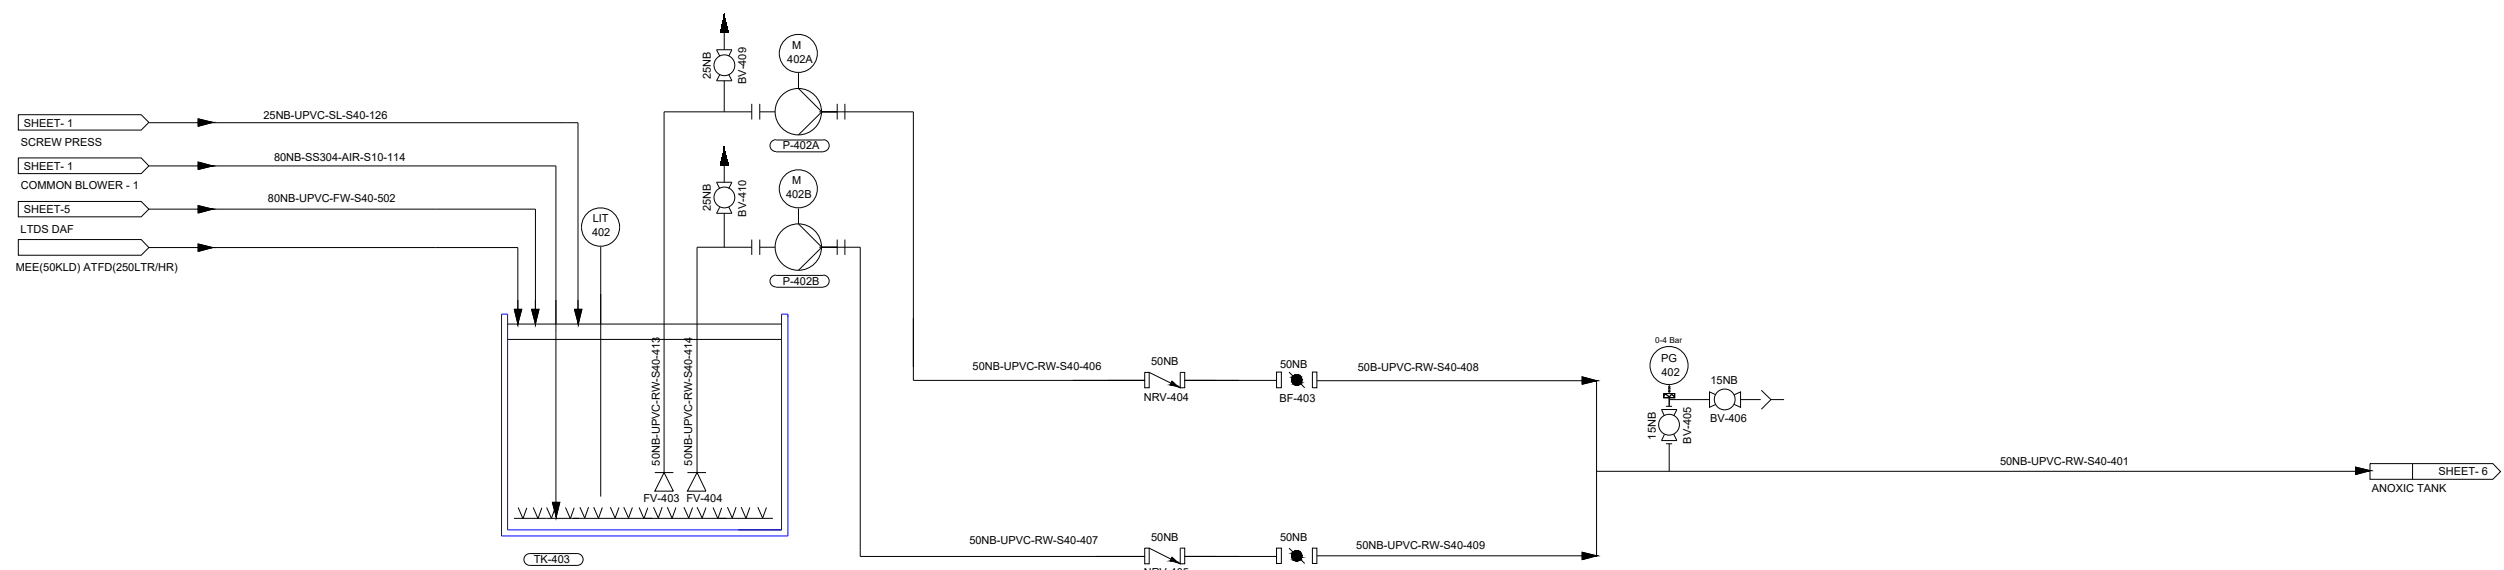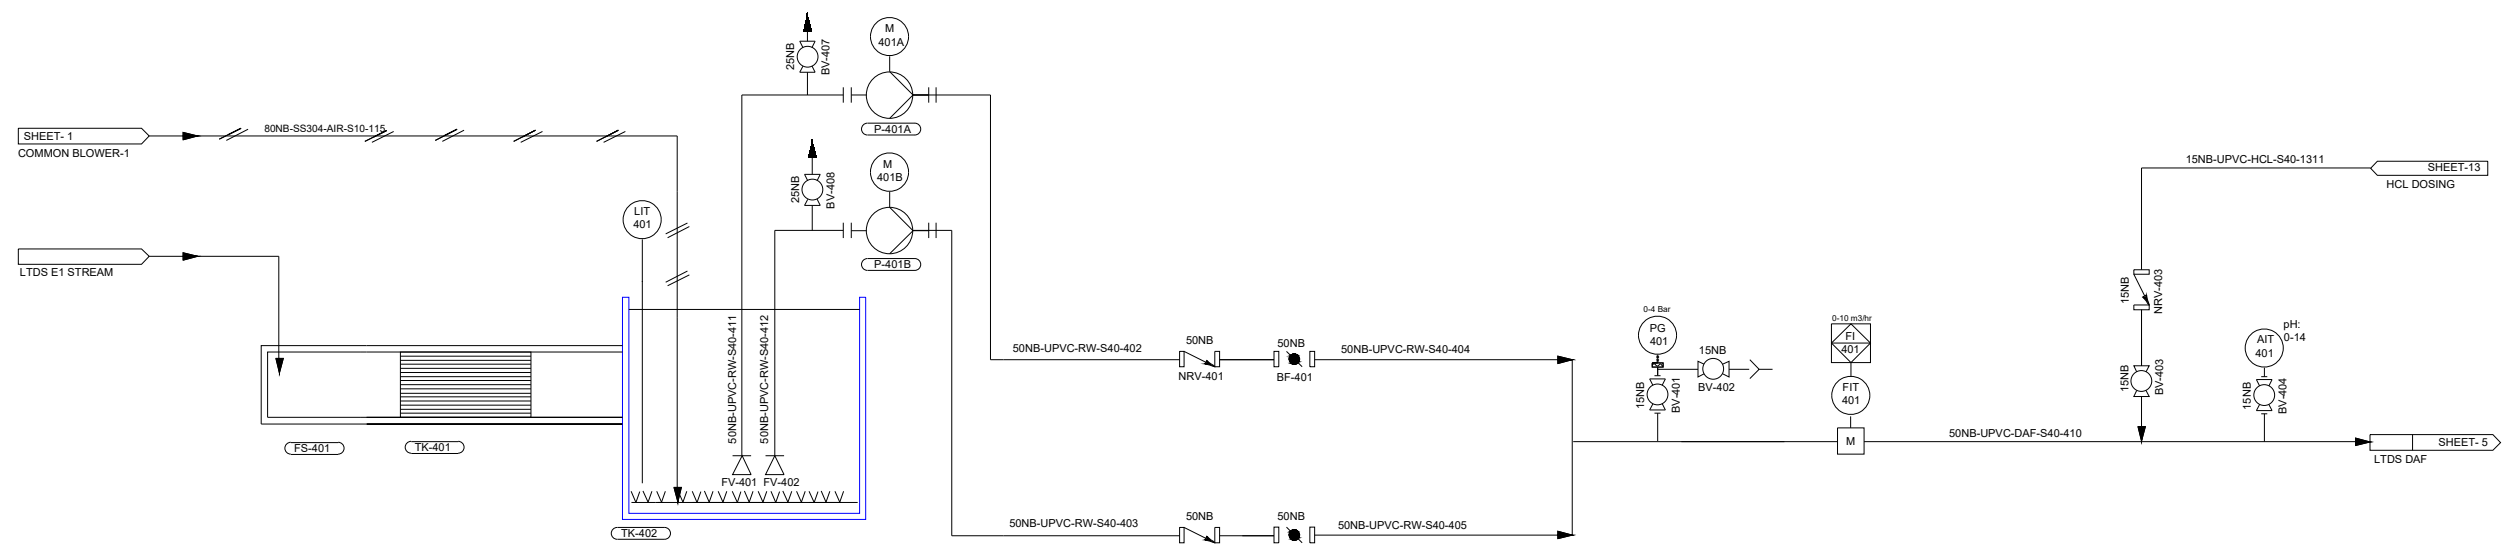

FS-401

LTDS MANUAL
FINE SCREEN
Capacity: 15m³/hr
Quantity: 1No
MOC:SS316

TK-401

LTDS MANUAL
SCREEN CHAMBER
Quantity: 1No
MOC:SS304

TK-402

LTDS EQUALIZATION
TANK
Capacity:156m³
Quantity: 1No
MOC:RCC

P-401A/B

LTDS DAF FEED PUMP
Capacity:7.5m³/hr@2.5 Bar
Quantity: 1W+1S
MOC: PVDF

TK-403

COMBINED EQUALIZATION
TANK
Capacity: 156m³
Quantity: 1 No
MOC: RCC

P-402A/B

ANOXIC TANK FEED PUMP
Capacity:10m³/hr@2 Bar
Quantity: 1W+1S
MOC: PVDF

NOTE:

1. BLUE COLOUR INDICATES THE SUPPLY BY CIPLA
2. RED COLOUR INDICATES THE SUPPLY BY CIPLA
3. BLACK COLOUR INDICATES THE SUPPLY BY EEPL

DRAWING STATUS :

- | | |
|---|--|
| ☐ FOR ENQUIRY | ☐ FOR REVIEW |
| ☐ FOR INFORMATION | ☒ FOR APPROVAL |
| ☐ FOR CONSTRUCTION | ☐ AS BUILT |

CLIENT :

M/S. CIPLA LIMITED,VIRGONAGAR

PROJECT :

200 KLD ETP R&R

CONTRACTOR :



DRAWING TITLE :

P&ID - CIPLA ETP REFURBISHMENT

DRAWN BY : BM

CHECKED BY : JK

APPROVED BY : AS


DATE :
25-12-2025

EEPL-CIPLA-ETP-R&R-2025-12

REV : 02

SHEET : 4 of 14

THIS DRAWING IS A PROPERTY OF
EEPL NO PART OR WHOLE SHOULD BE
REPRODUCED, COPIED OR GIVEN TO
OTHERS WHATSOEVER WITHOUT
PRIOR CONSENT

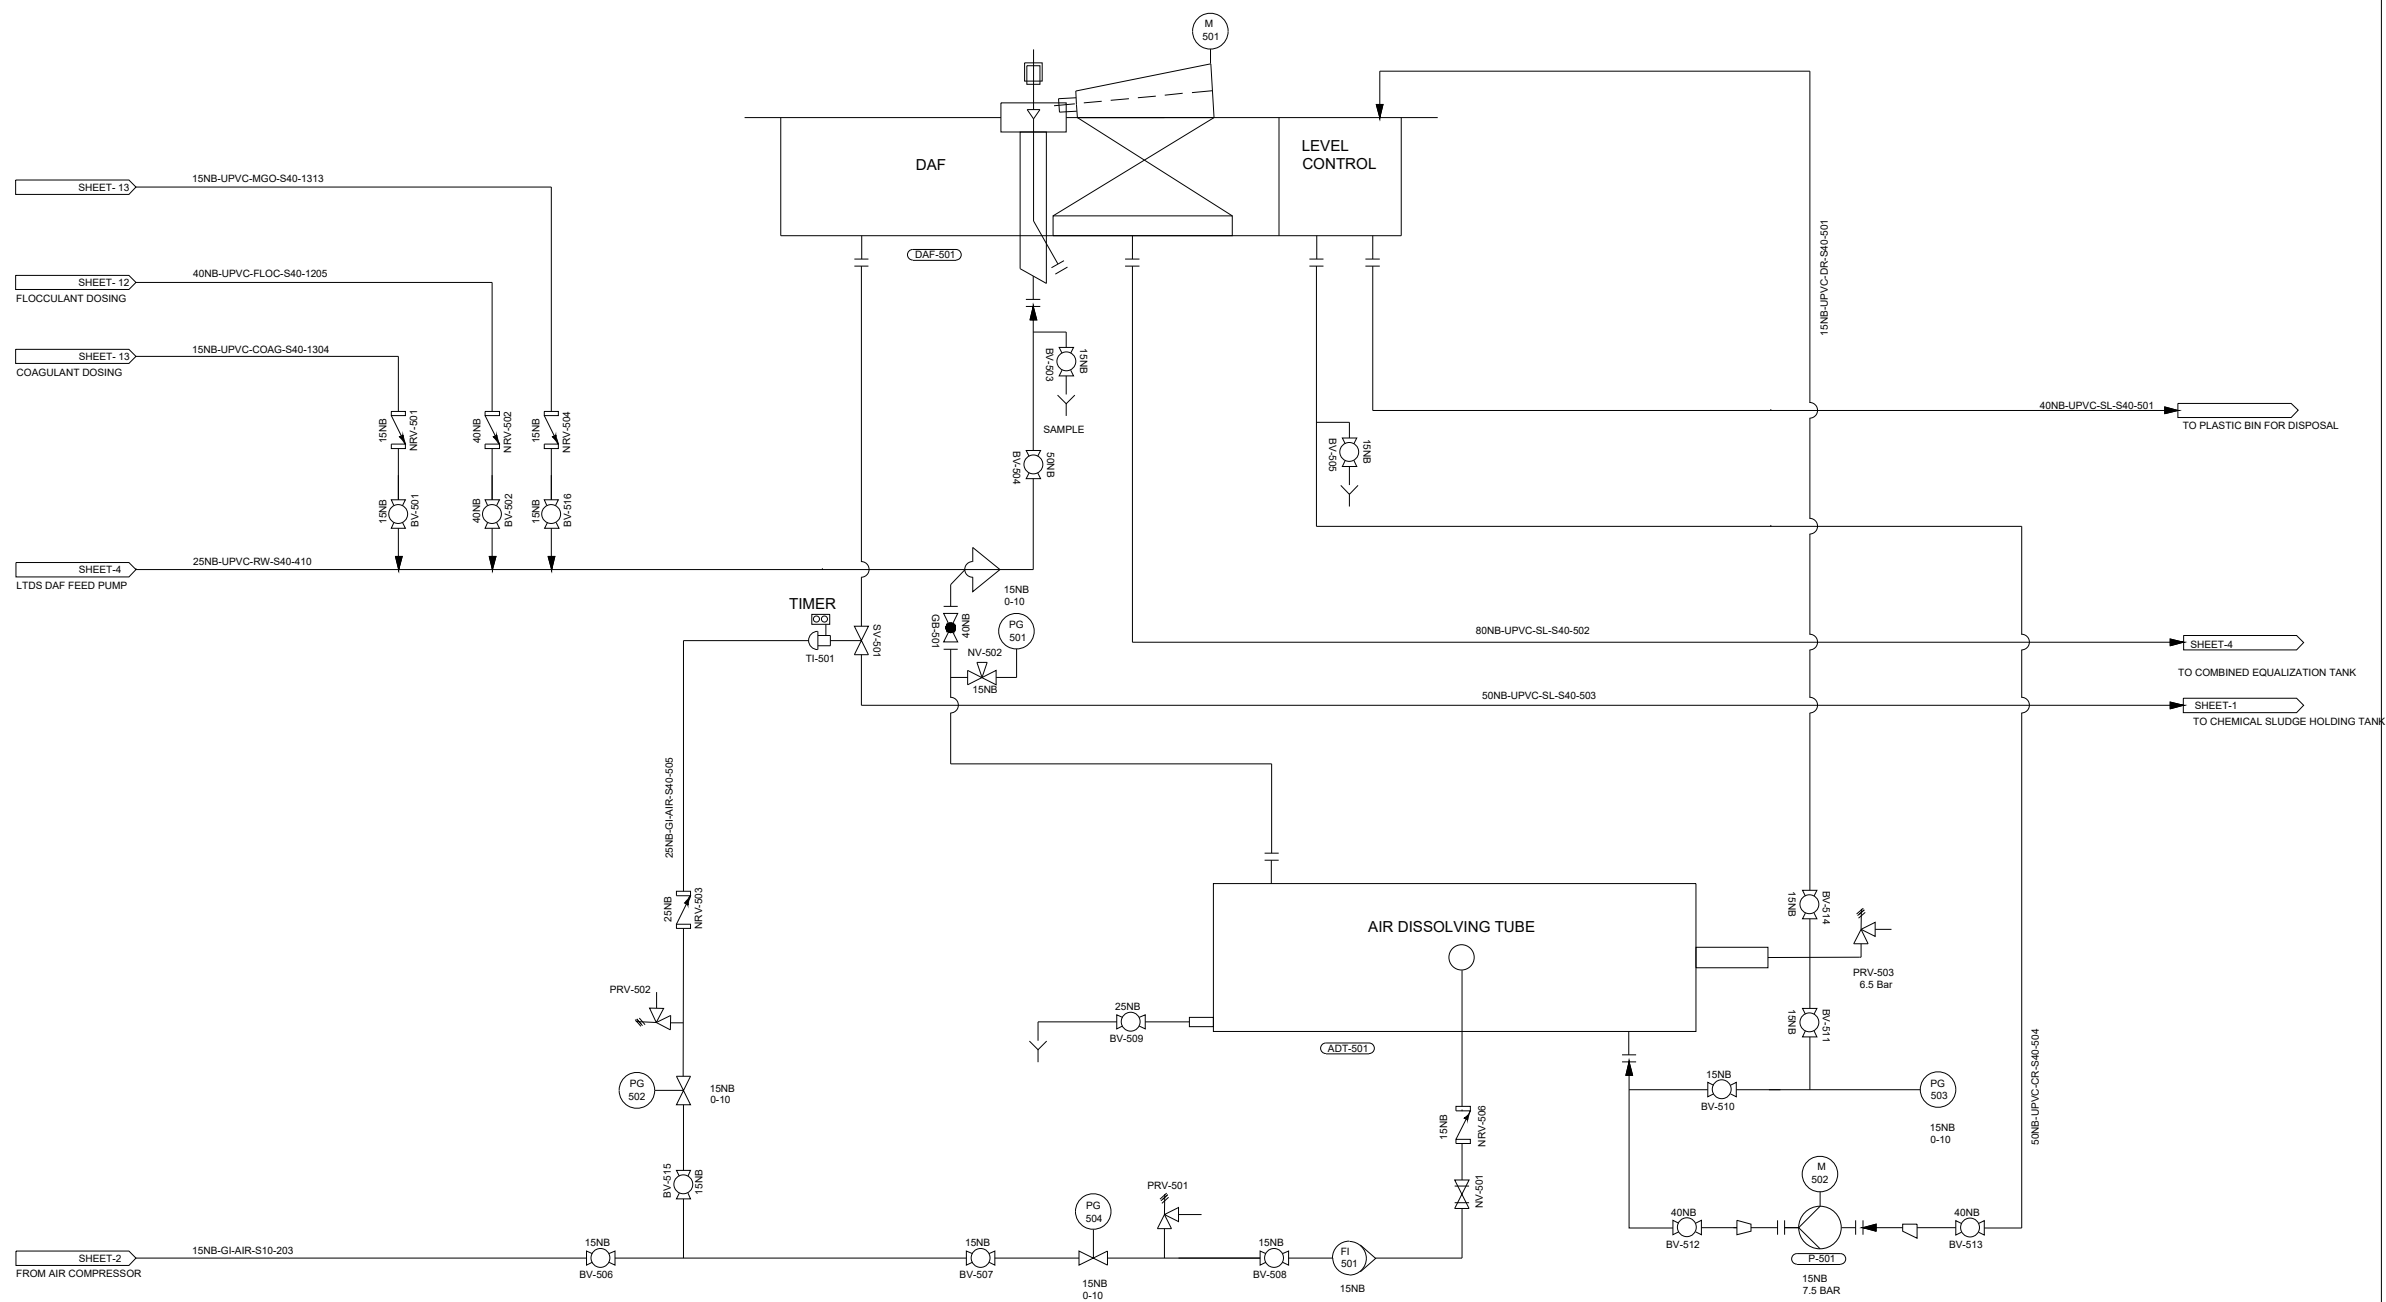

DRAWING STATUS :

☐ FOR ENQUIRY	☐ FOR REVIEW
☐ FOR INFORMATION	☒ FOR APPROVAL
☐ FOR CONSTRUCTION	☐ AS BUILT

CLIENT :

M/S. CIPLA LIMITED,VIRGONAGAR

PROJECT :

200 KLD ETP R&R

CONTRACTOR :


ecologic
eepl
engineering pvt ltd

DRAWING TITLE :

P&ID - CIPLA ETP REFURBISHMENT

DRAWN BY : BM	DATE : 24-12-2025
CHECKED BY : JK	
APPROVED BY : AS	
EEPL-CIPLA-ETP-R&R-2025-12	REV : 01
	SHEET : 5 of 14

THIS DRAWING IS A PROPERTY OF
EEPL NO PART OR WHOLE SHOULD BE
REPRODUCED, COPIED OR GIVEN TO
OTHERS WHATSOEVER WITHOUT
PRIOR CONSENT

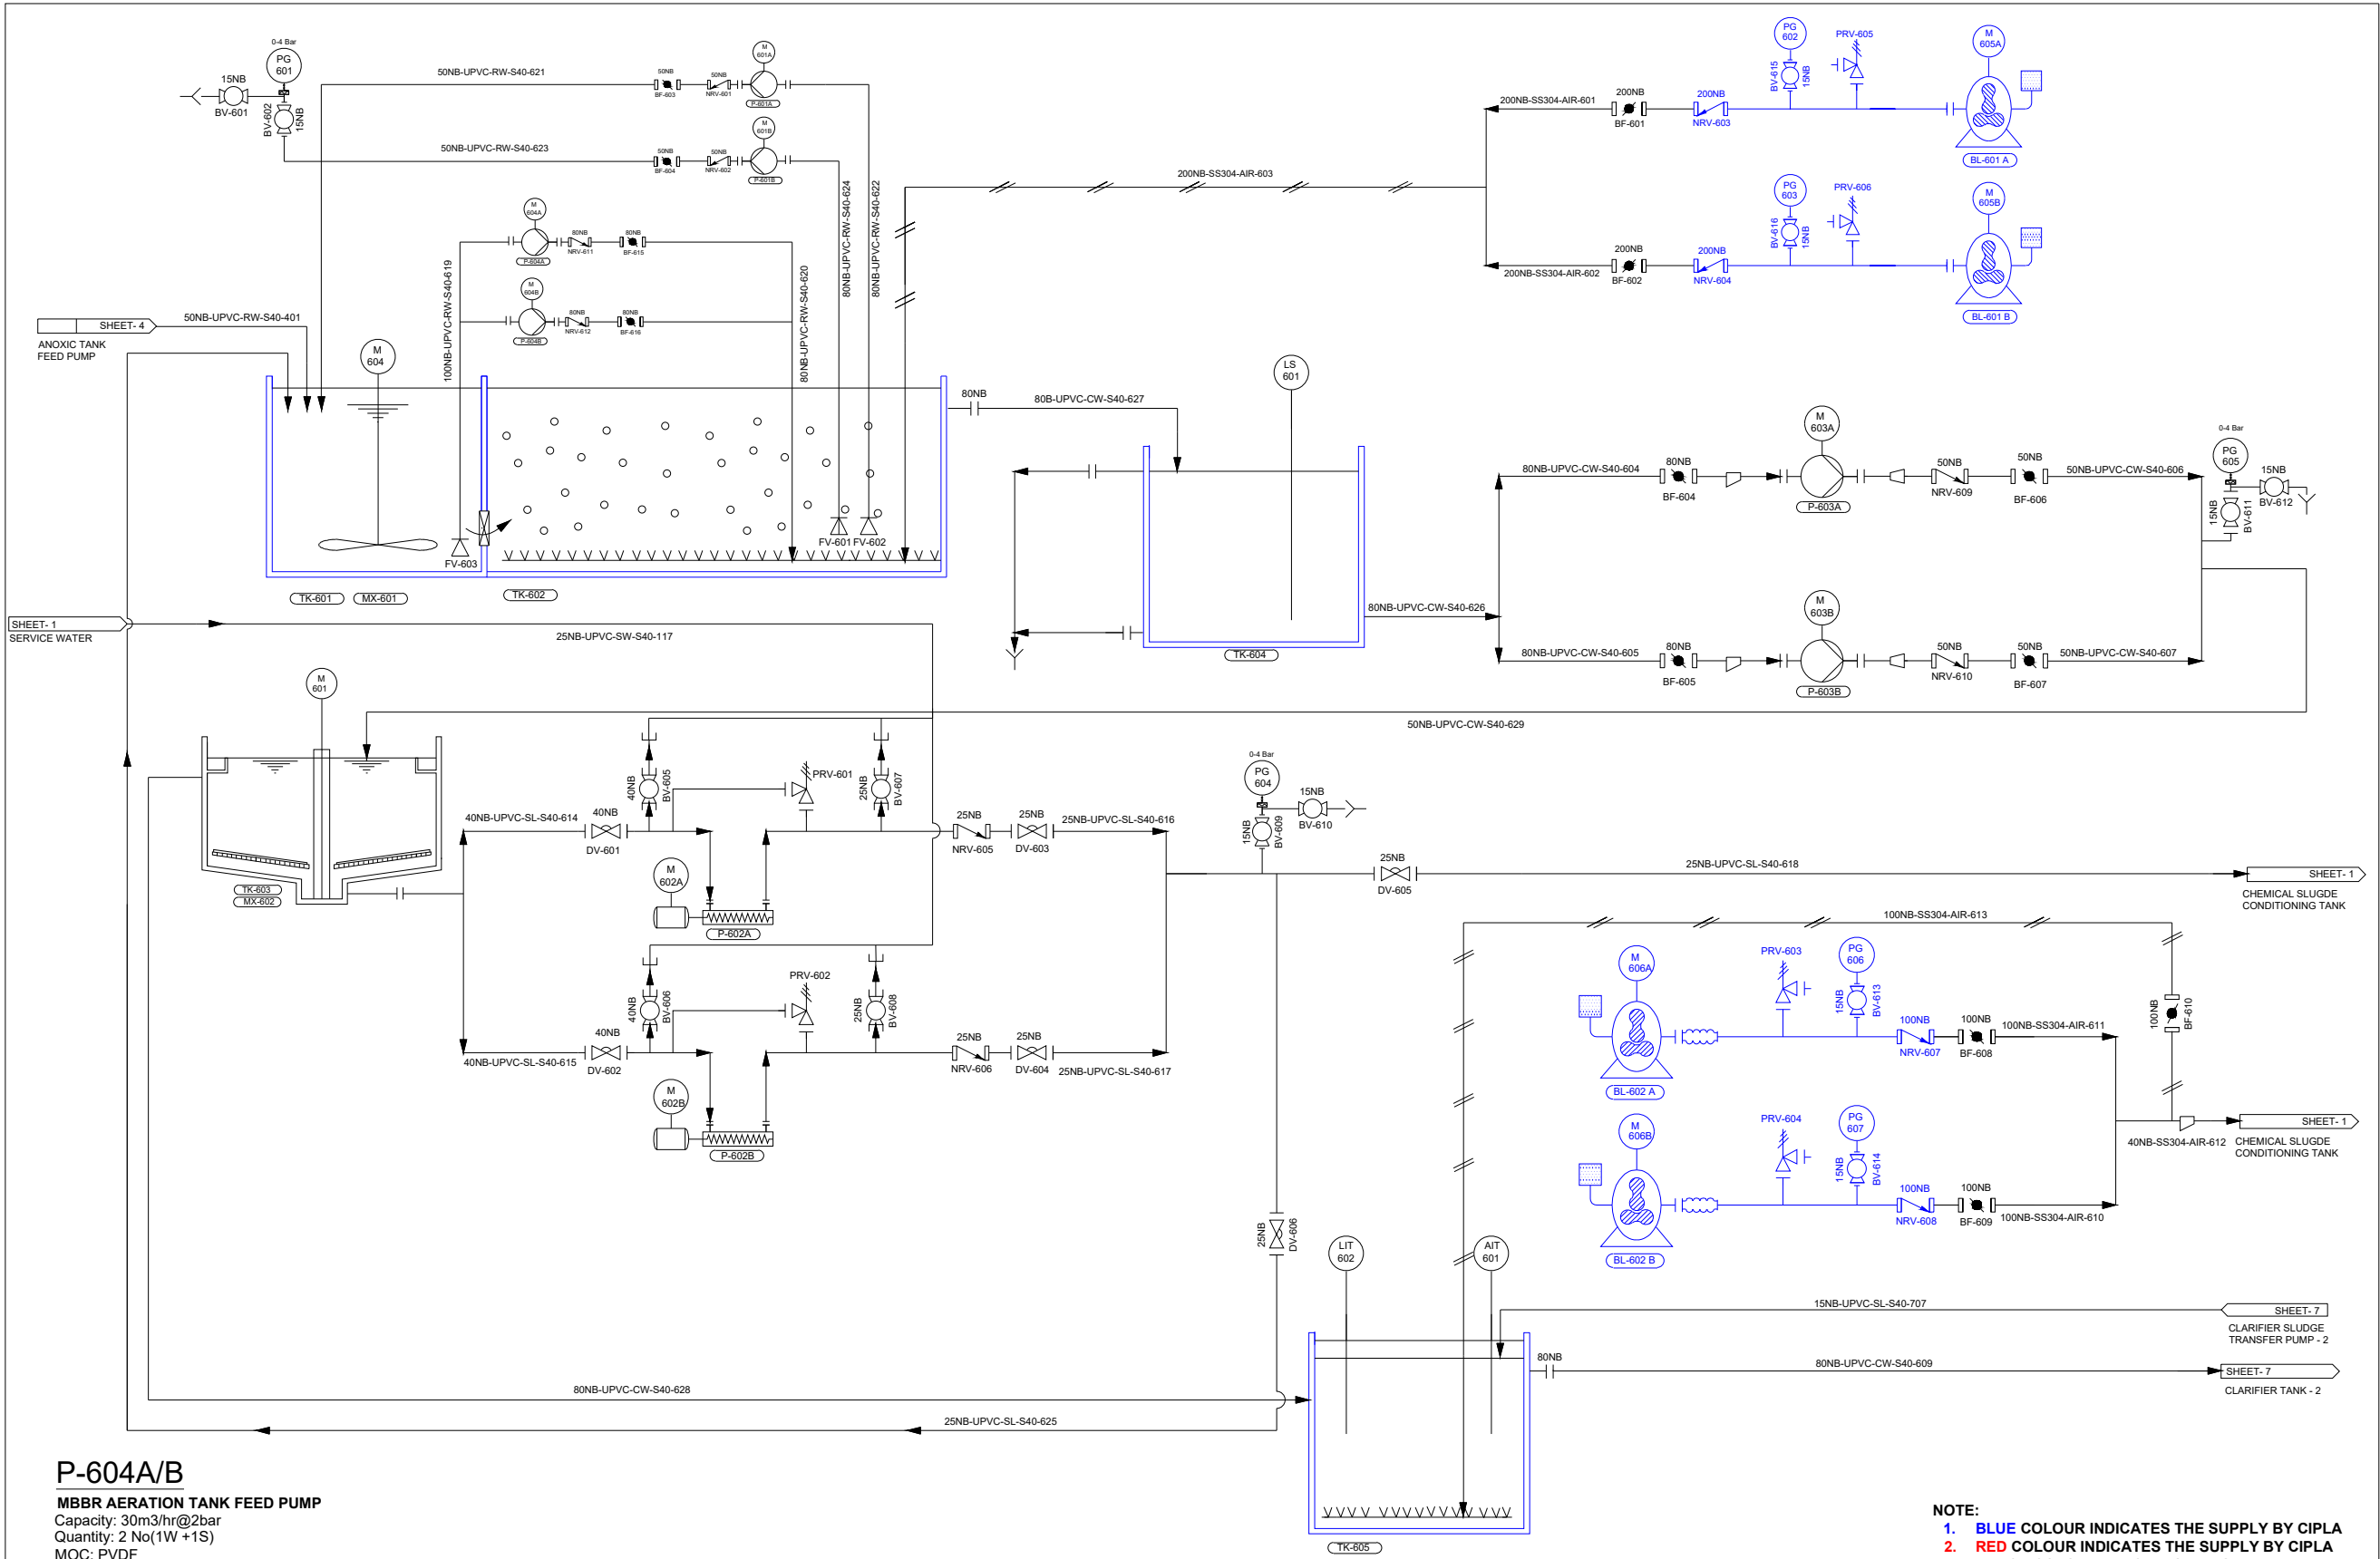

P-604A/B
MBBR AERATION TANK FEED PUMP
Capacity: 30m3/hr@2bar
Quantity: 2 No(1W+1S)
MOC: PVDF

TK-601
ANOXIC TANK
Capacity: 21m3
Quantity: 1 No
MOC: RCC

MX-601
ANOXIC TANK MIXER
Quantity: 1 No
MOC: SS316

TK-602
MBBR AERATION TANK
Capacity: 568m3
Quantity: 1 No
MOC: RCC

BL-601A/B
MBBR BLOWER
Capacity: 1400m3/hr@0.5 Bar
Quantity: 1W+1S
MOC:CI

P-601A/B
INTERNAL RECIRCULATION PUMP
Capacity:20m3/hr@2 Bar
Quantity: 1W+1S
MOC: PVDF

TK-603
CLARIFIER TANK-1
Quantity: 1 No
MOC: MSEP

MX-602
CLARIFIER MECHANISM-1
Quantity: 1 No
MOC: MSEP

TK-604
CLARIFIER FEED TANK
Quantity: 1 No
MOC: RCC
Capacity: 10m3

P-602A/B
CLARIFIER SLUDGE TRANSFER PUMP - 1
Capacity:3m3/hr
Quantity: 1W+1S
MOC: CI/SS/NBR

P-603A/B
CLARIFIER TANK FEED PUMP
Capacity:10m3/hr@2 Bar
Quantity: 1W+1S
MOC: PVDF

TK-605
AERATION TANK
Capacity: 200m3
Quantity: 1 No
MOC: RCC

BL-602A/B
COMMON BLOWER - 2
Capacity: 600m3/hr@0.5 Bar
Quantity: 1W+1S
MOC:CI

DRAWING STATUS :

- | | |
|---|--|
| ☐ FOR ENQUIRY | ☐ FOR REVIEW |
| ☐ FOR INFORMATION | ☒ FOR APPROVAL |
| ☐ FOR CONSTRUCTION | ☐ AS BUILT |

CLIENT :

M/S. CIPLA LIMITED,VIRGONAGAR

PROJECT :

200 KLD ETP R&R

CONTRACTOR :



DRAWING TITLE :

P&ID - CIPLA ETP REFURBISHMENT

DRAWN BY : BM

CHECKED BY : JK

APPROVED BY : AS


DATE :
25-12-2025

EEPL-CIPLA-ETP-R&R-2025-12

REV : 02

SHEET : 6 of 14

THIS DRAWING IS A PROPERTY OF EEPL NO PART OR WHOLE SHOULD BE REPRODUCED, COPIED OR GIVEN TO OTHERS WHATSOEVER WITHOUT PRIOR CONSENT

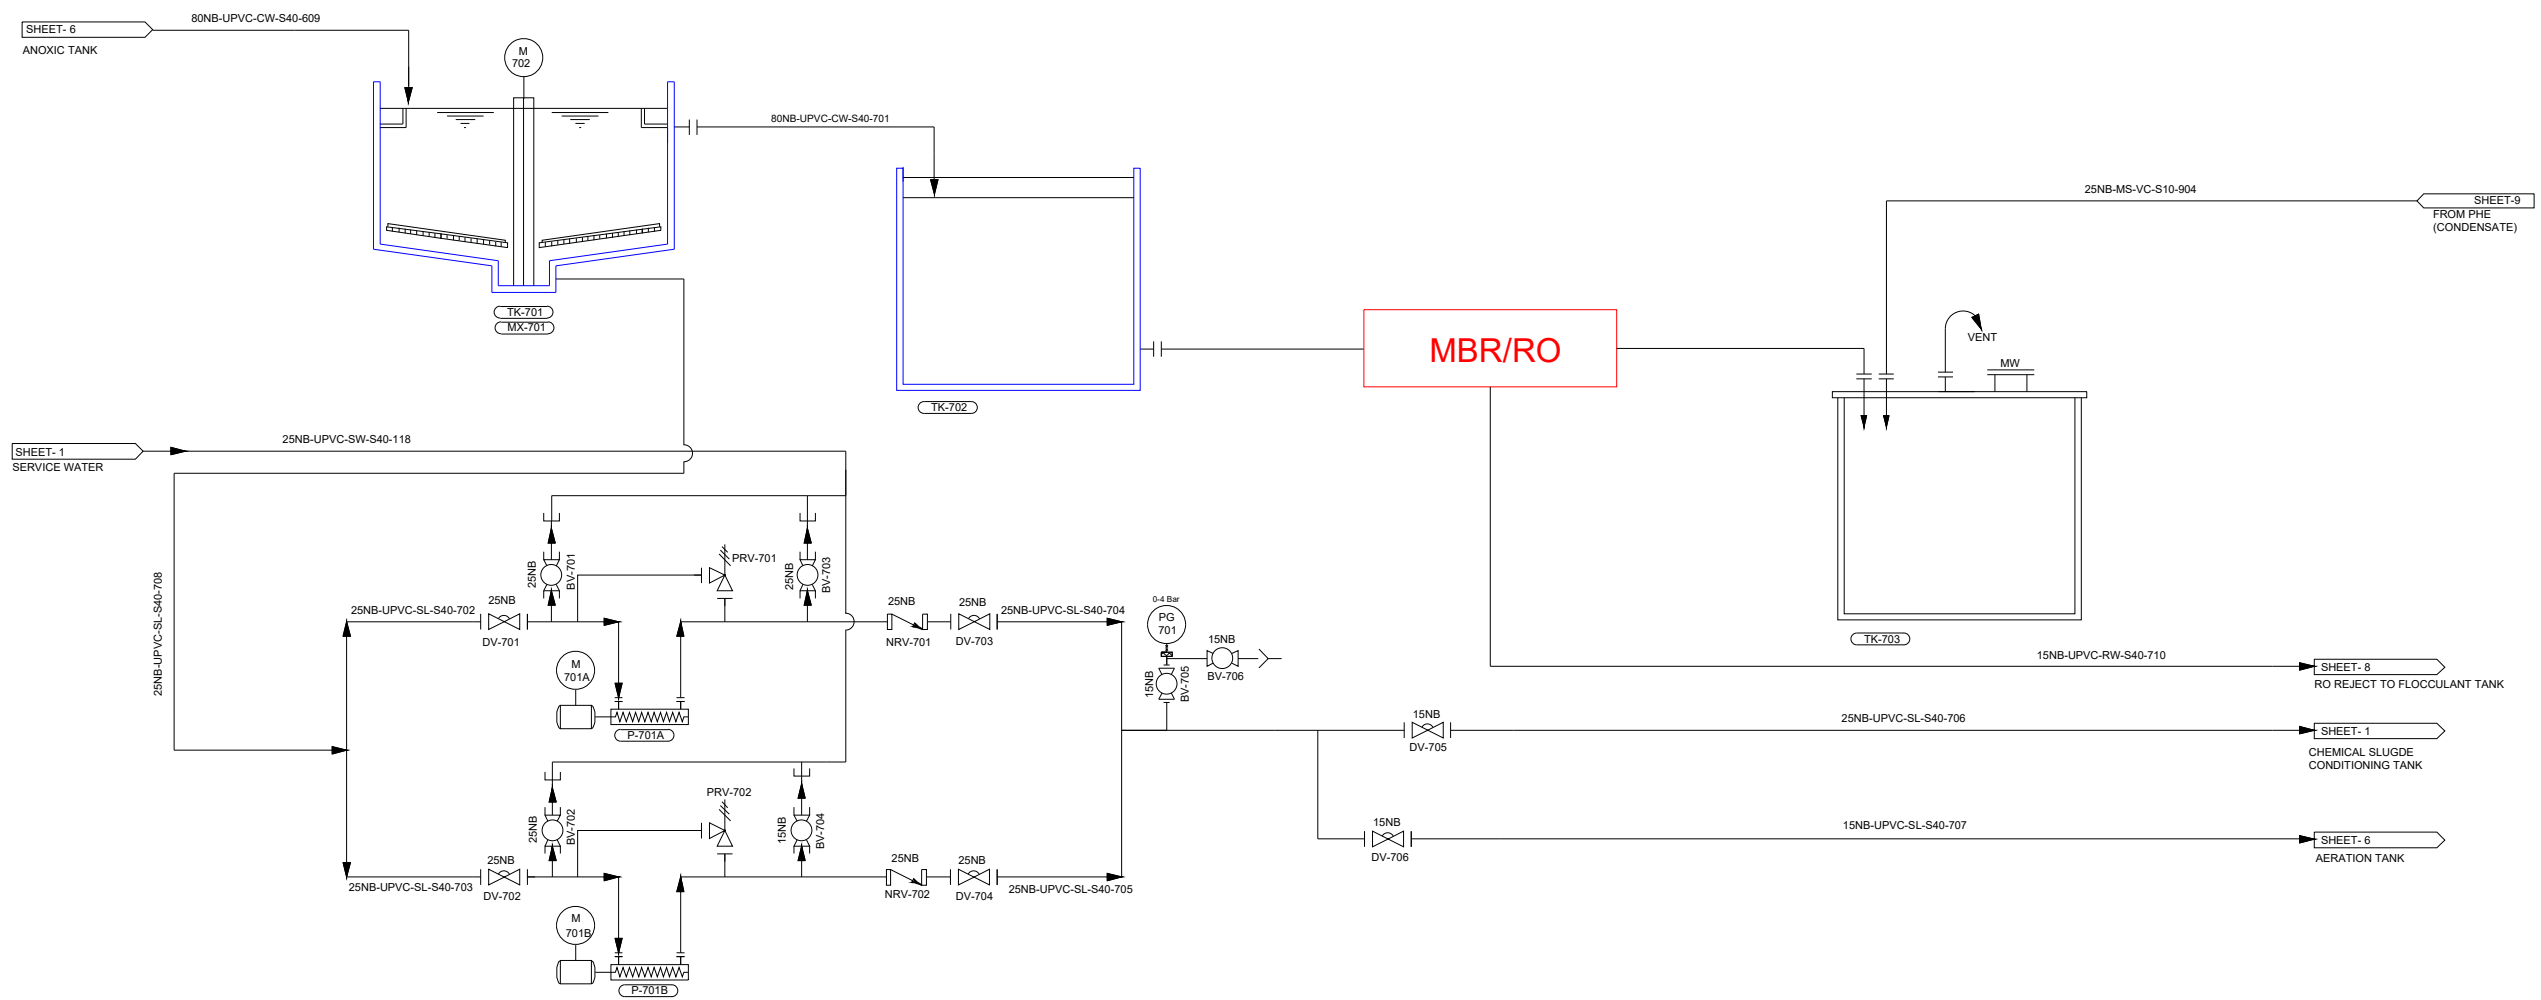

TK-701

CLARIFIER TANK-2
Quantity: 1 No
MOC: RCC

MX-701

CLARIFIER MECHANISM-2
Quantity: 1 No
MOC: MSEP

TK-702

MBR FEED TANK
Quantity: 1 No
MOC: RCC

TK-703

RO PERMEATE TANK
Quantity: 1 No

P-701A/B

CLARIFIER SLUDGE
TRANSFER PUMP - 2
Capacity: 0.8m³/hr @ 2 Bar
Quantity: 1W+1S
MOC: CI/SS/NBR

- NOTE:
1. BLUE COLOUR INDICATES THE SUPPLY BY CIPLA
 2. RED COLOUR INDICATES THE SUPPLY BY CIPLA
 3. BLACK COLOUR INDICATES THE SUPPLY BY EEPL

DRAWING STATUS :

- | | |
|---|--|
| ☐ FOR ENQUIRY | ☐ FOR REVIEW |
| ☐ FOR INFORMATION | ☒ FOR APPROVAL |
| ☐ FOR CONSTRUCTION | ☐ AS BUILT |

CLIENT :

M/S. CIPLA LIMITED,VIRGONAGAR

PROJECT :

200 KLD ETP R&R

CONTRACTOR :



DRAWING TITLE :

P&ID - CIPLA ETP REFURBISHMENT

DRAWN BY : BM

CHECKED BY : JK

APPROVED BY : AS


DATE :
25-12-2025

EEPL-CIPLA-ETP-R&R-2025-12

REV : 02

SHEET : 7 of 14

THIS DRAWING IS A PROPERTY OF
EEPL NO PART OR WHOLE SHOULD BE
REPRODUCED, COPIED OR GIVEN TO
OTHERS WHATSOEVER WITHOUT
PRIOR CONSENT

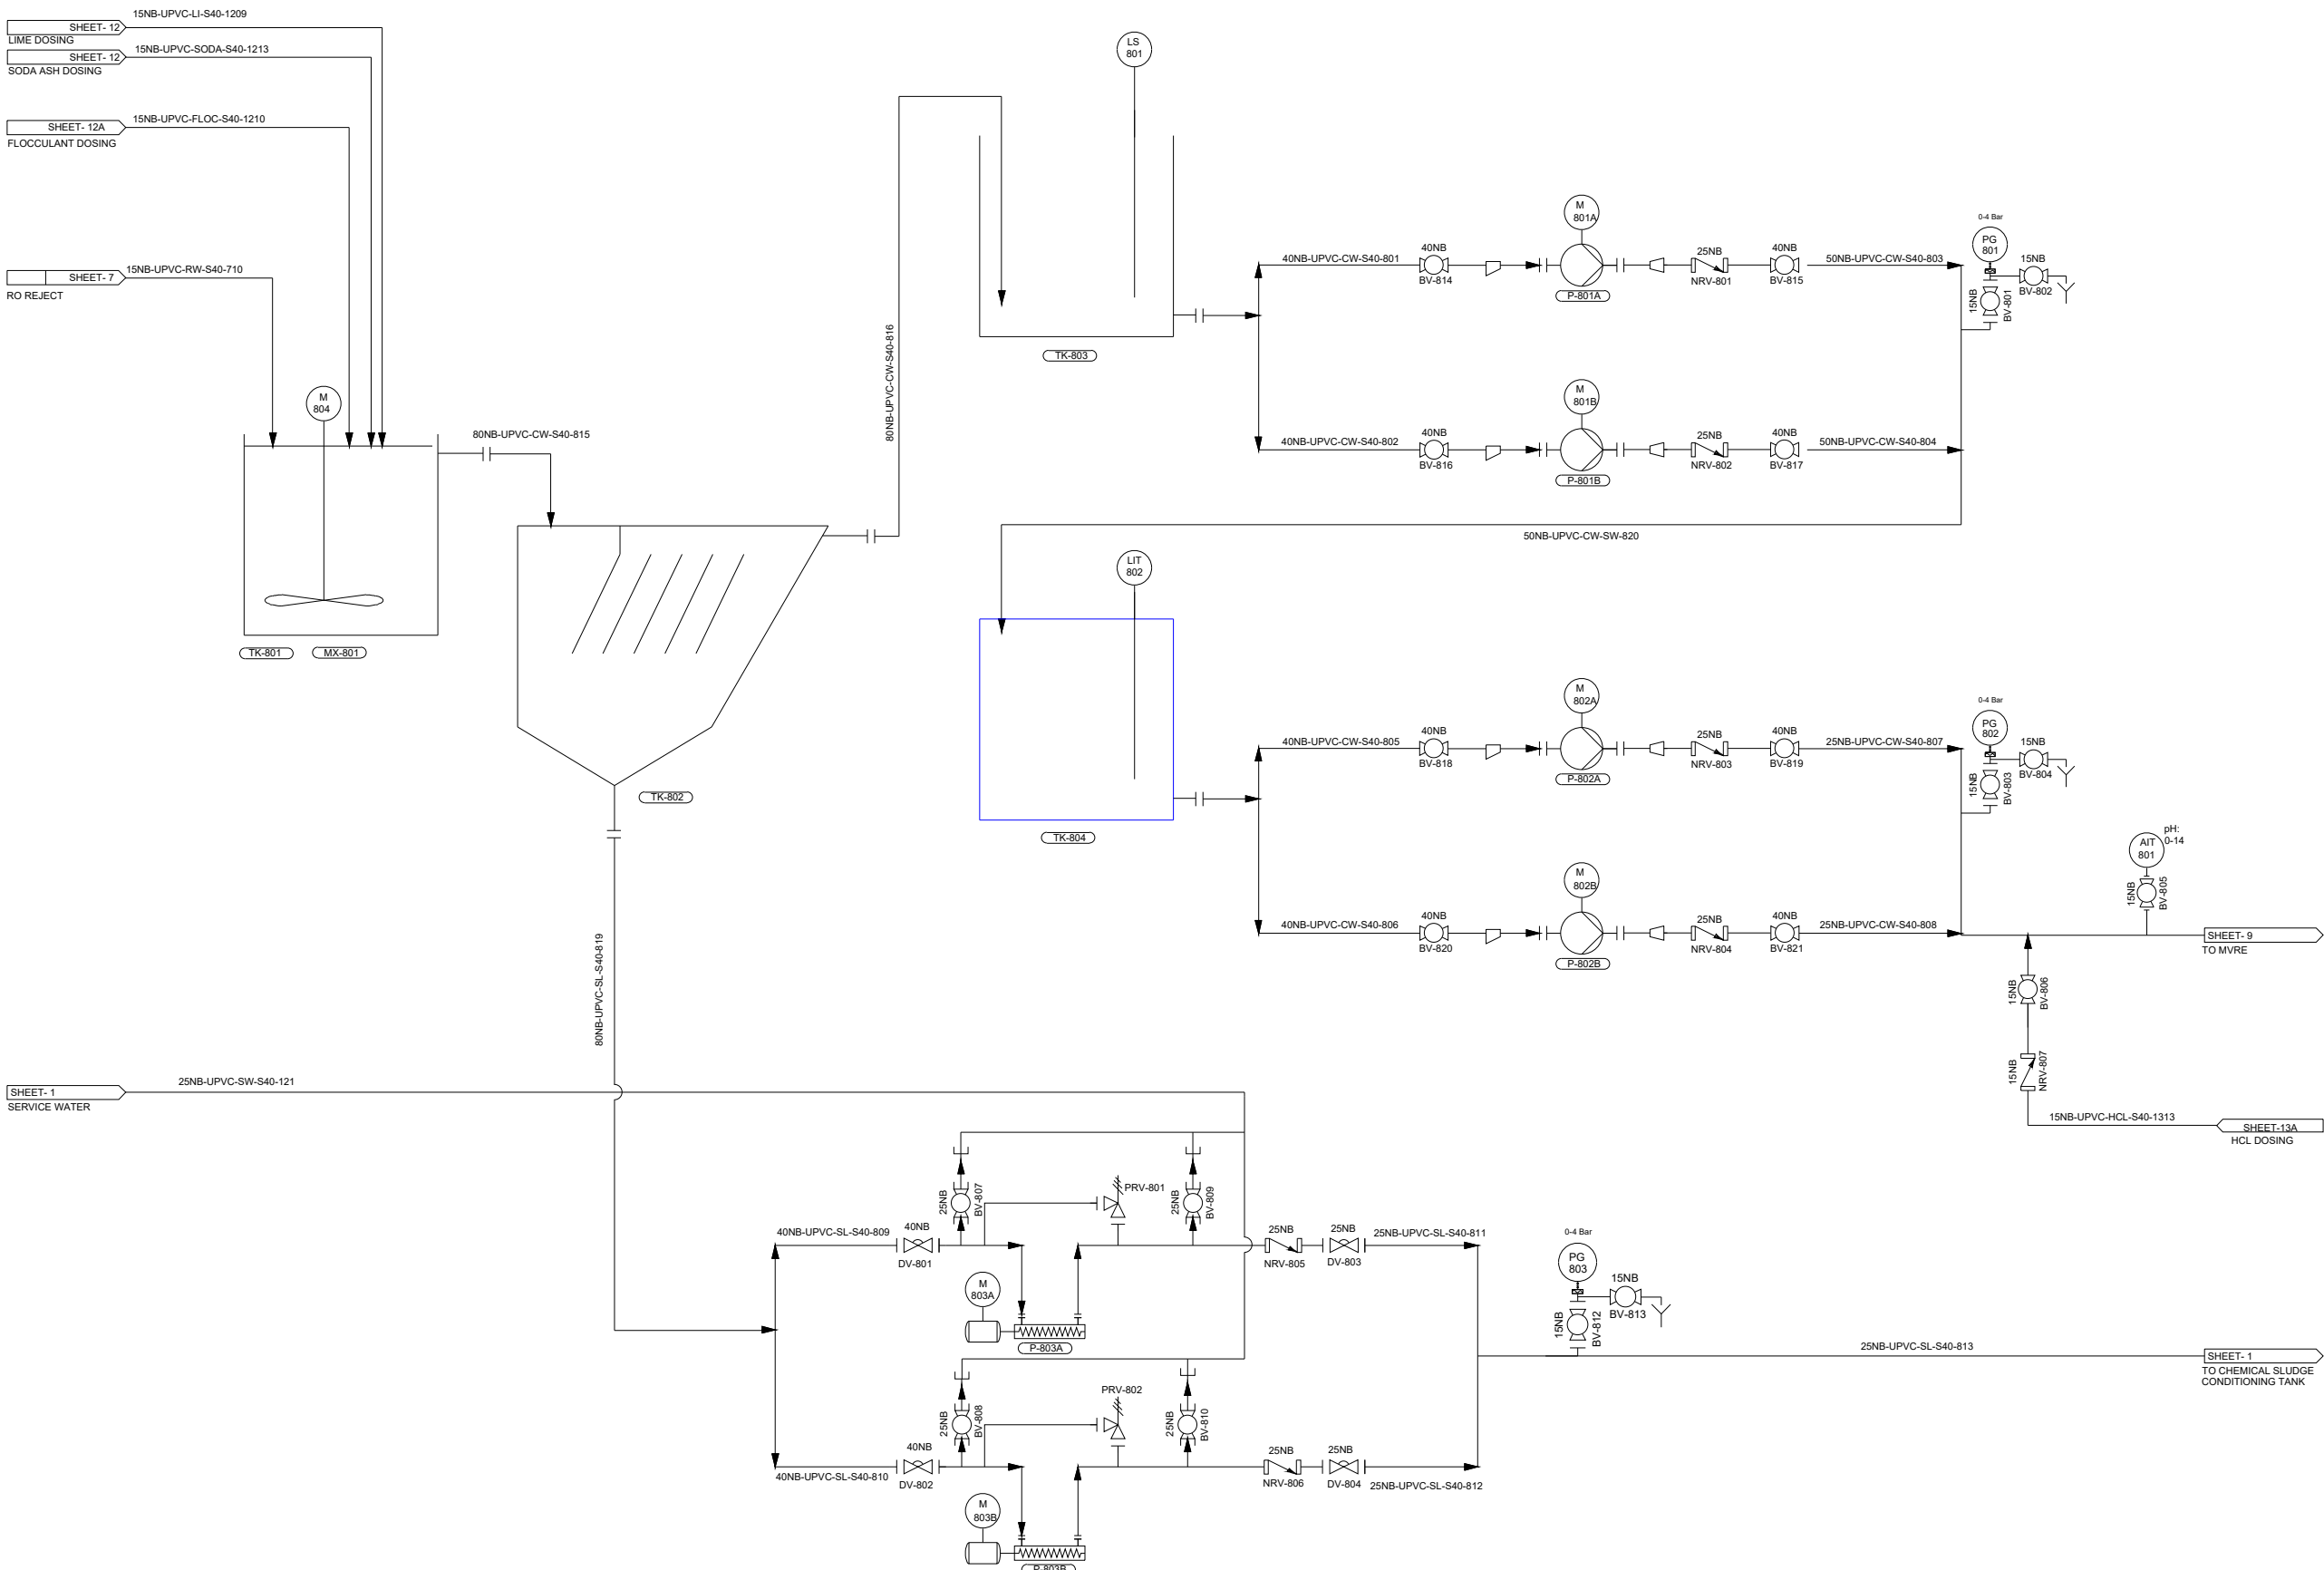

TK-801

FLOCCULANT TANK
Quantity: 1 No
MOC: MSEP
Capacity:1m3

MX-801

FLOCCULANT MIXER
Quantity: 1 No
MOC: MSFRP

TK-802

LAMELLA CLARIFIER
Quantity: 1 No
MOC: MSEP
Capacity:3m3
SIZE: 1.5mL x 1mW x 2mH

TK-803

BREAK TANK
Quantity: 1 No
MOC: HDPE
Capacity:2m3

P-801A/B

CLARIFIER WATER TRANSFER PUMP
Capacity:3m3/hr @ 3Bar
Quantity: 1W+1S
MOC: PVDF

TK-804

MVRE FEED TANK
Quantity: 1 No
MOC: GFS
Capacity:125m3

P-803A/B

CLARIFIER SLUDGE TRANSFER PUMP - 3
Capacity:1m3/hr @ 2Bar
Quantity: 1W+1S
MOC: CI/SS/NBR

P-802A/B

MVRE FEED PUMP
Capacity:3m3/hr @ 2Bar
Quantity: 1W+1S
MOC: PVDF

NOTE:

1. BLUE COLOUR INDICATES THE SUPPLY BY CIPLA
2. RED COLOUR INDICATES THE SUPPLY BY CIPLA
3. BLACK COLOUR INDICATES THE SUPPLY BY EEPL

DRAWING STATUS :

- | | |
|---|--|
| ☐ FOR ENQUIRY | ☐ FOR REVIEW |
| ☐ FOR INFORMATION | ☒ FOR APPROVAL |
| ☐ FOR CONSTRUCTION | ☐ AS BUILT |

CLIENT :

M/S. CIPLA LIMITED,VIRGONAGAR

PROJECT :

200 KLD ETP R&R

CONTRACTOR :



DRAWING TITLE :

P&ID - CIPLA ETP REFURBISHMENT

DRAWN BY : BM

CHECKED BY : JK

APPROVED BY : AS


DATE :
25-12-2025

EEPL-CIPLA-ETP-R&R-2025-12

REV : 02

SHEET : 8 of 14

THIS DRAWING IS A PROPERTY OF EEPL NO PART OR WHOLE SHOULD BE REPRODUCED, COPIED OR GIVEN TO OTHERS WHATSOEVER WITHOUT PRIOR CONSENT

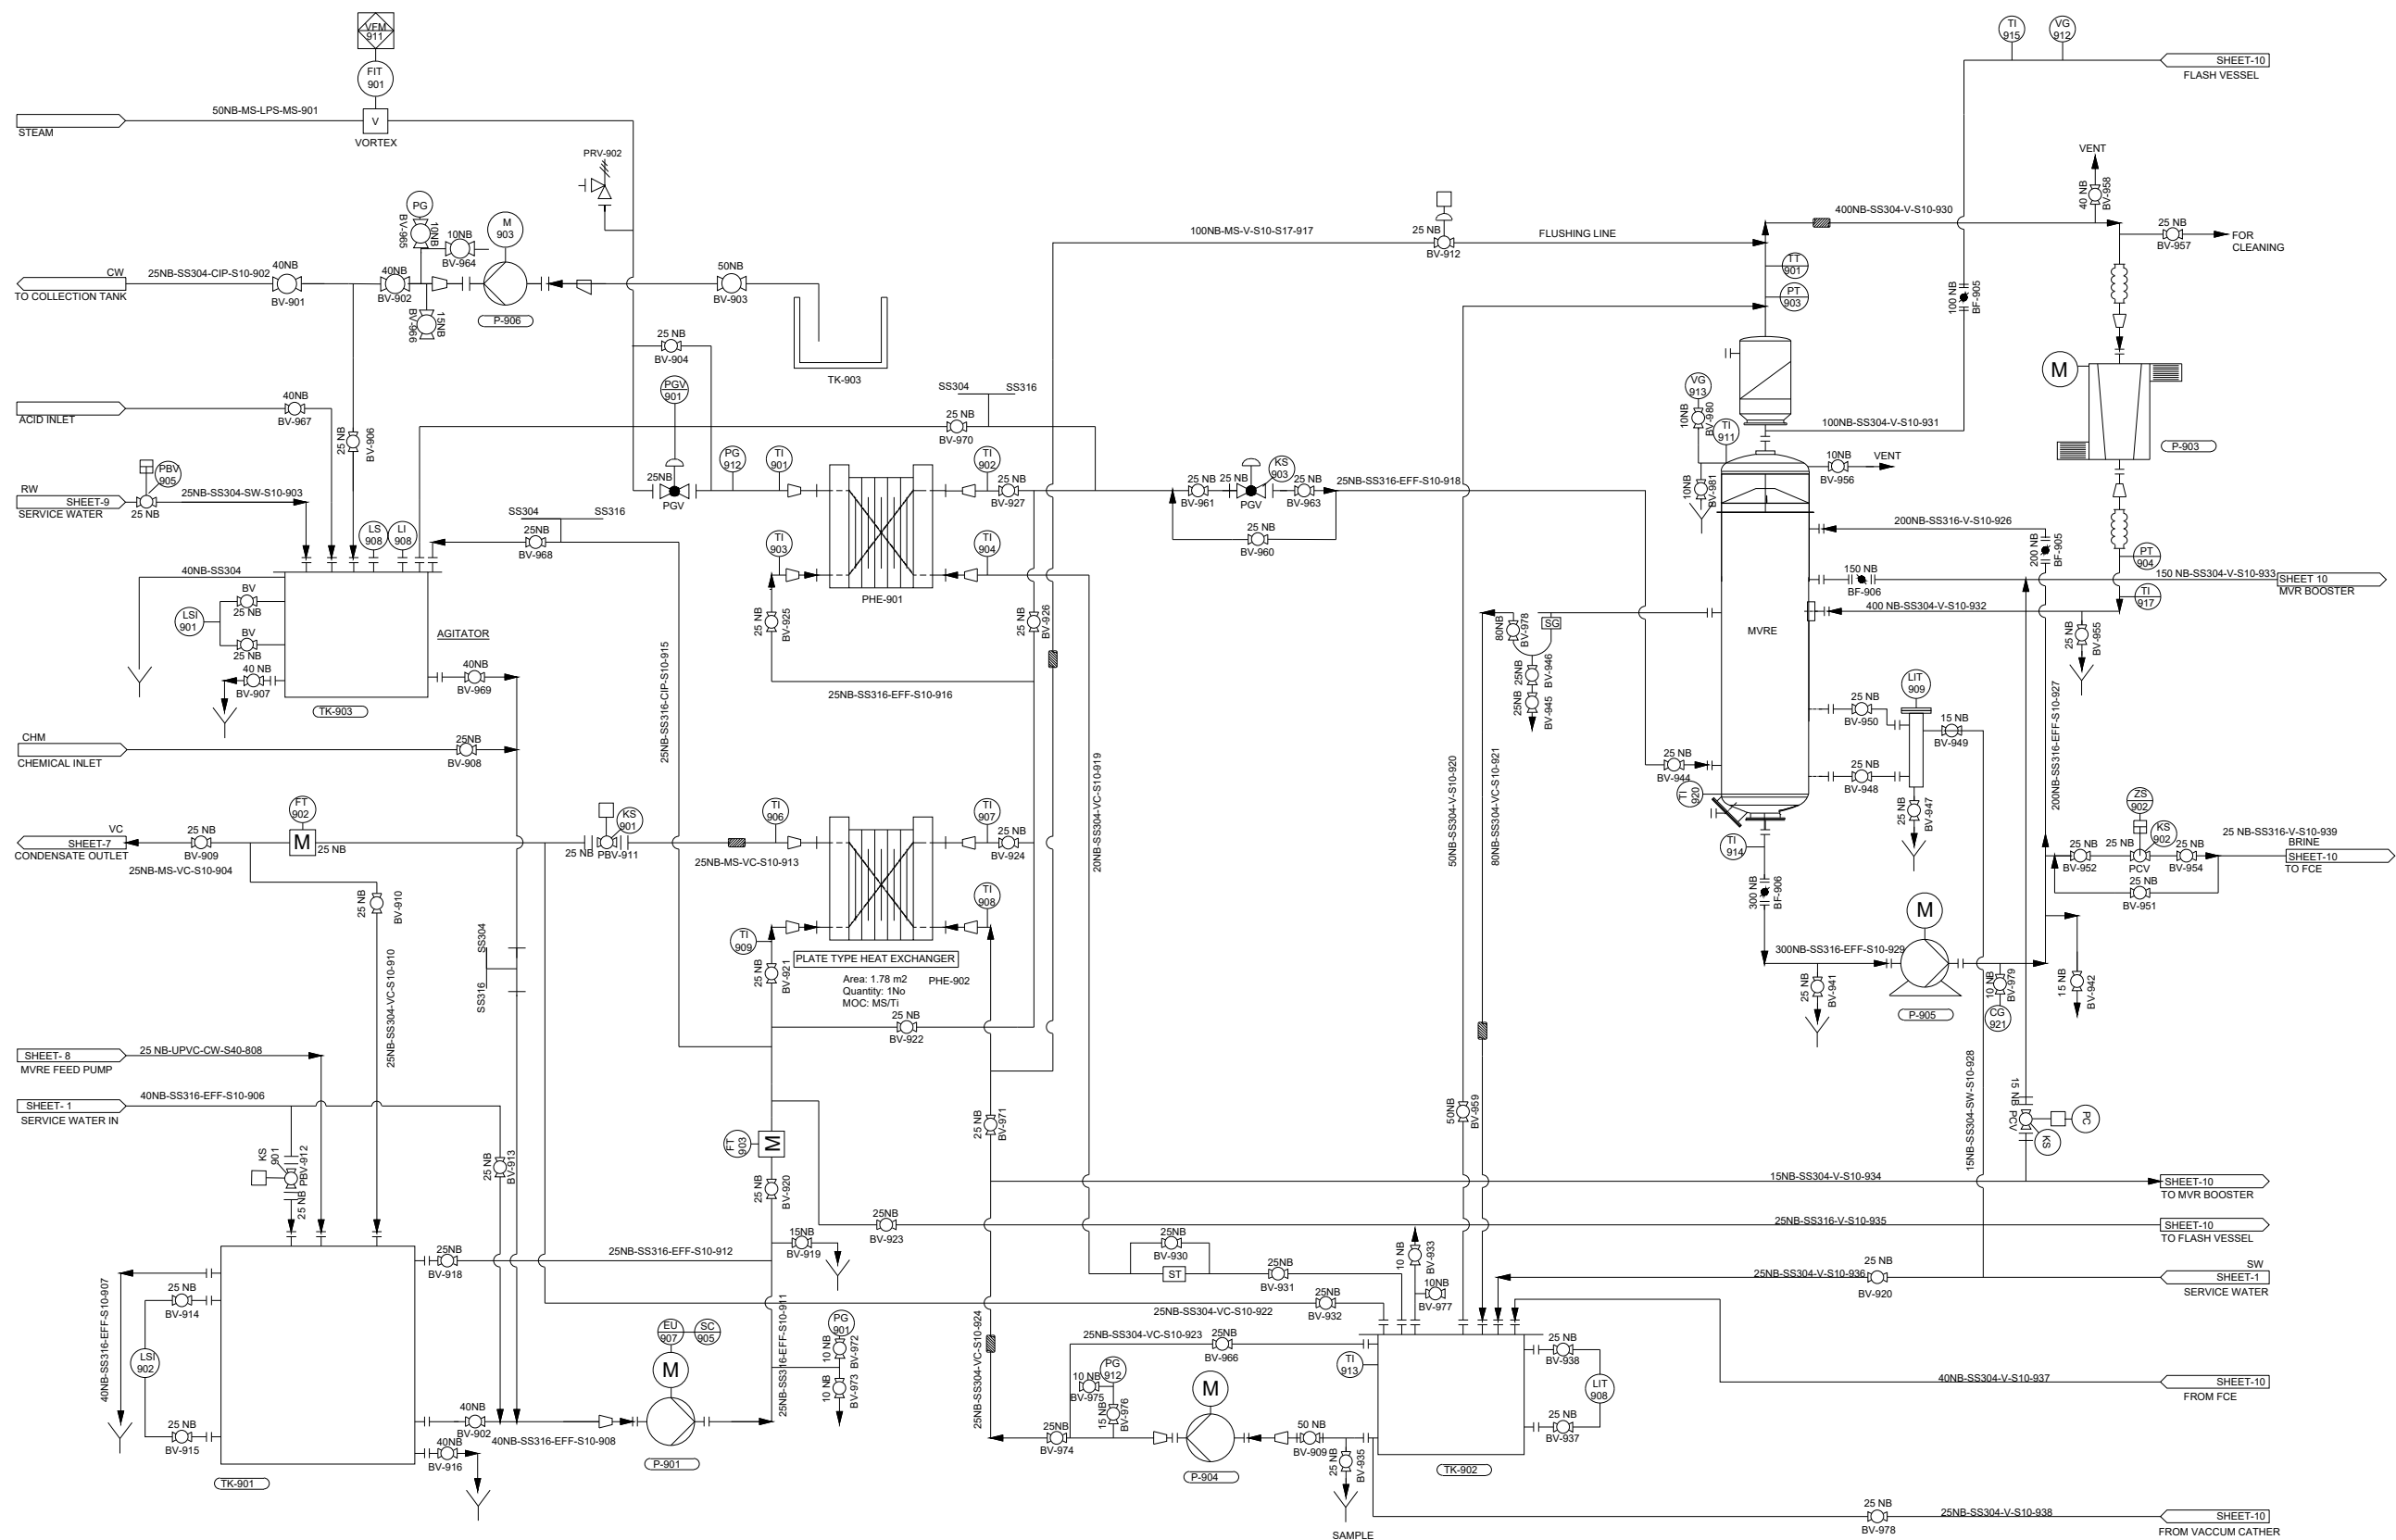

TK-901

FEED TANK WITH BAG FILTER
Quantity: 1 No
MOC: FRP
Capacity: 5KL

P-901

FEED PUMP
Quantity: 1 No
MOC: SS316
Capacity: 4m³/hr
Pressure: 4bar

P-902

WATER RING VACUUM PUMP
Quantity: 1 No
MOC: SS304
Capacity: 175m³/hL

P-903

MVR BOOSTER PUMP
Quantity: 1 No
MOC: Ni Alloy+grey
cast iron FG260
Capacity: 1800m³/hr

TK-902

CONDENSATE TANK
Quantity: 1 No
MOC: SS304
Capacity: 3KL

P-904

CONDENSATE PUMP
Quantity: 1 No
MOC: SS316
Capacity: 4m³/hr
Pressure: 4bar

TK-903

CHEMICAL TANK
Quantity: 1 No
MOC: PP

P-904

RECIRCULATION PUMP
Quantity: 1 No
MOC: SS316
Capacity: 250m³/hr
Pressure: 0.7bar

TK-903

DRAIN SUMP
Quantity: 1 No
MOC: RCC

P-906

DRAIN SUMP PUMP
Quantity: 1 No
MOC: SS316
Capacity: 10m³/hr
Pressure: 3bar

PHE-901/902

PLATE TYPE HEAT EXCHANGER

NOTE:

1. BLUE COLOUR INDICATES THE SUPPLY BY CIPLA
2. RED COLOUR INDICATES THE SUPPLY BY CIPLA
3. BLACK COLOUR INDICATES THE SUPPLY BY EEPL
4. STEAM LINE PIPING SHOULD BE IN CIPLA SCOPE

DRAWING STATUS :

- | | |
|---|--|
| ☐ FOR ENQUIRY | ☐ FOR REVIEW |
| ☐ FOR INFORMATION | ☒ FOR APPROVAL |
| ☐ FOR CONSTRUCTION | ☐ AS BUILT |

CLIENT :

M/S. CIPLA LIMITED,VIRGONAGAR

PROJECT :

200 KLD ETP R&R

CONTRACTOR :



DRAWING TITLE :

P&ID - CIPLA ETP REFURBISHMENT

DRAWN BY : BM

CHECKED BY : JK

APPROVED BY : AS


DATE :
25-12-2025

EEPL-CIPLA-ETP-R&R-2025-12

REV : 02

SHEET : 9 of 14

THIS DRAWING IS A PROPERTY OF
EEPL NO PART OR WHOLE SHOULD BE
REPRODUCED, COPIED OR GIVEN TO
OTHERS WHATSOEVER WITHOUT
PRIOR CONSENT

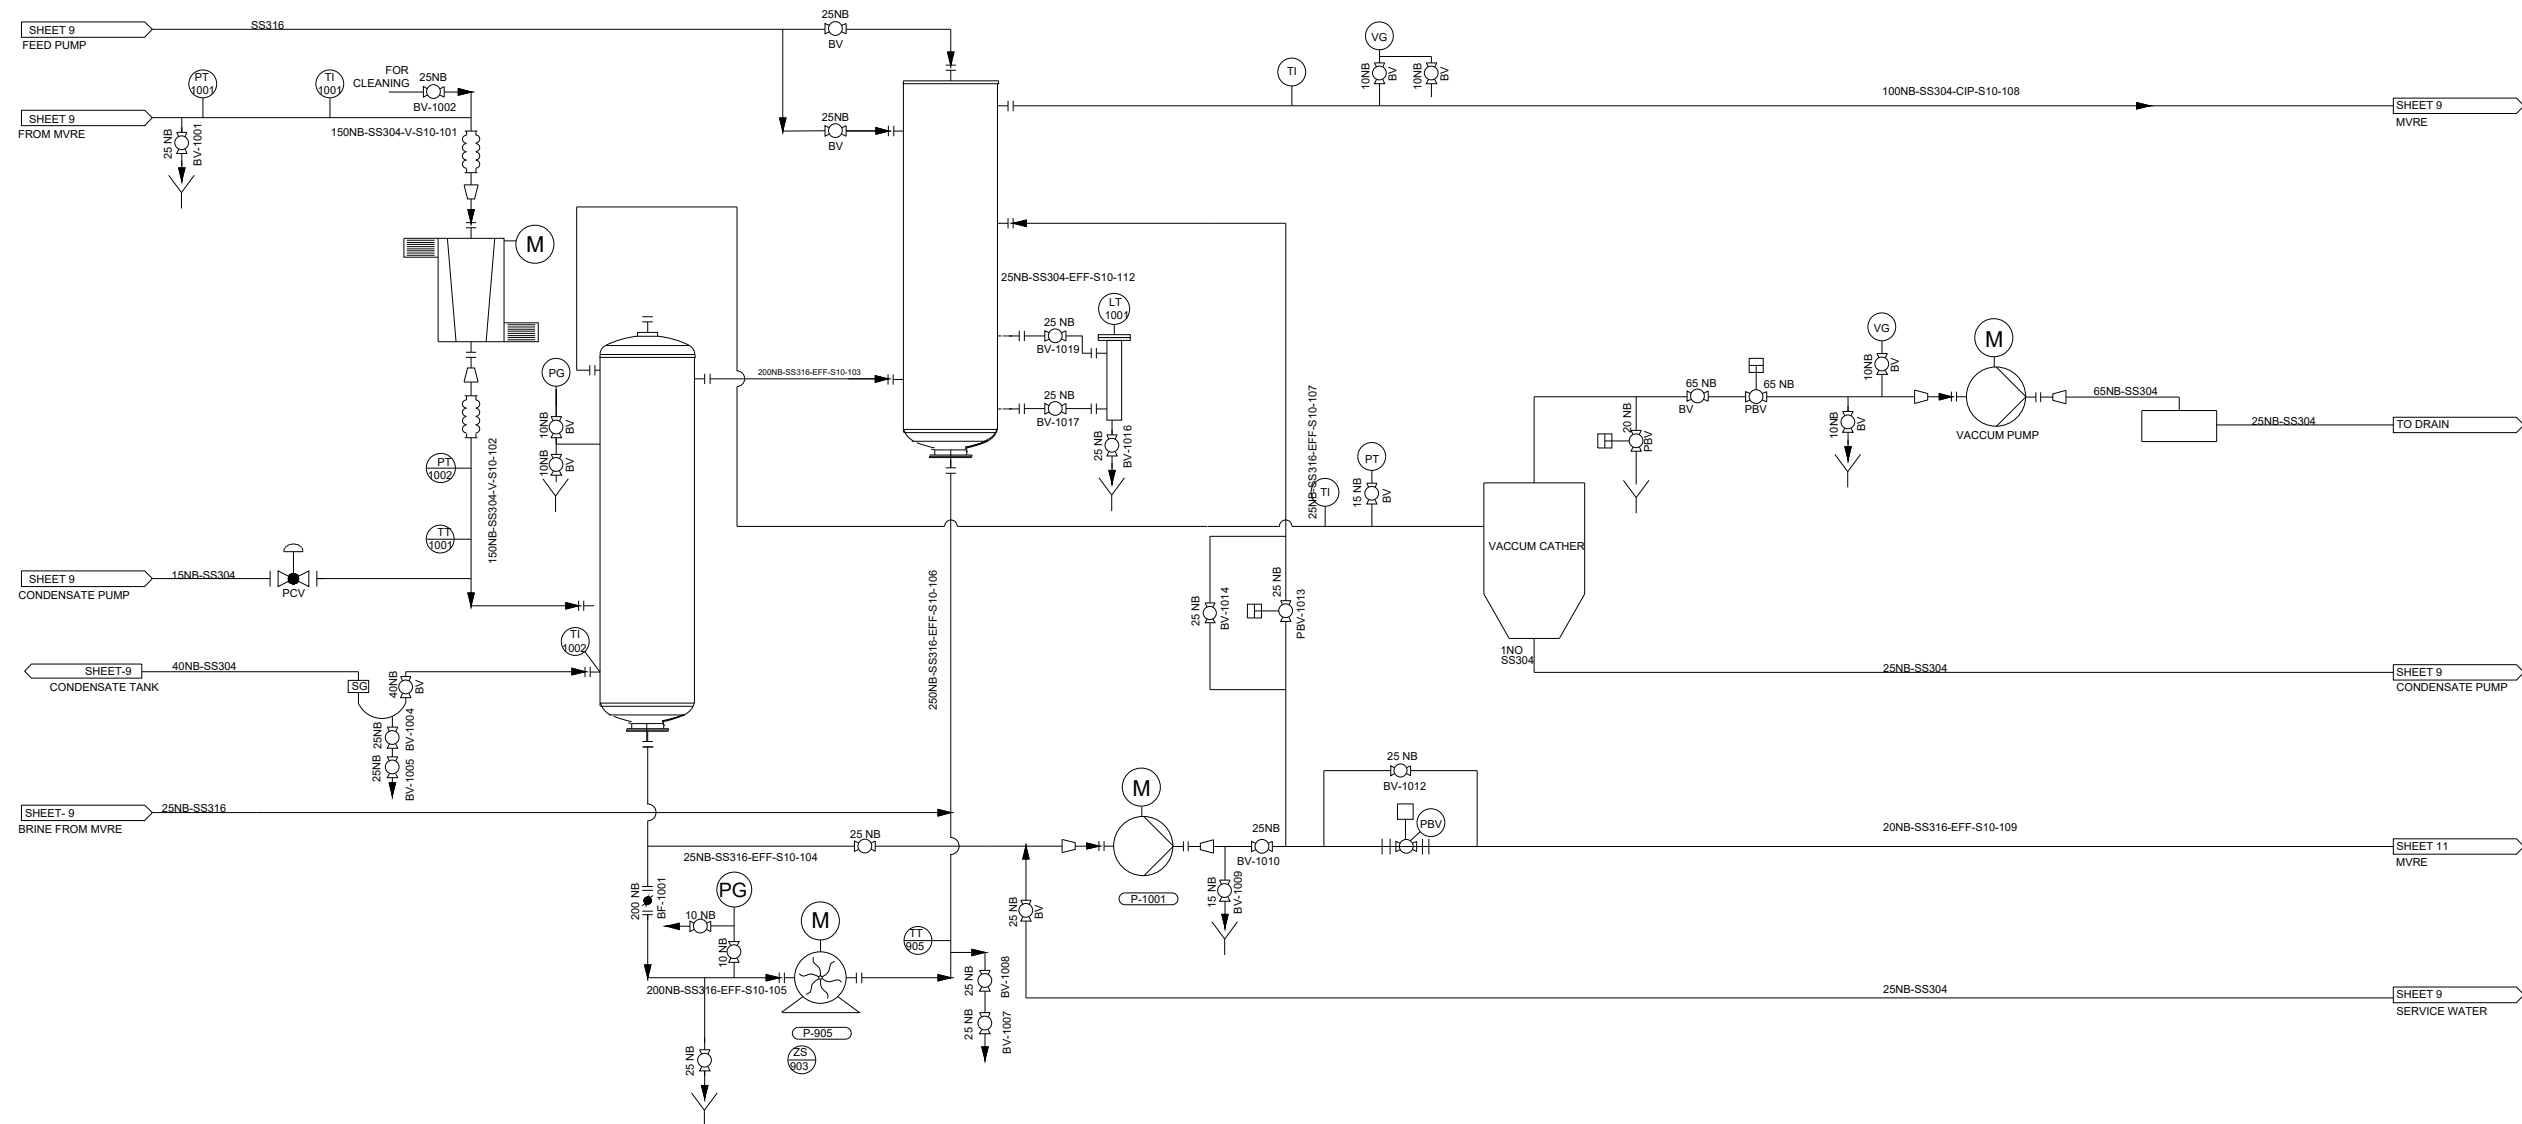

MVRE-1001 MVRE BOOSTER Capacity: 1800m3/hr Pressure: INLET-24KPA OUTLET-36KPA MOC: Ni Alloy + Grey cast iron FG260	CONC-1001 CONCENTRATE PUMP Capacity: 1m3/hr Pressure: 2.5 BAR MOC: SS304	HTR-1001 SHELL TUBE HEAT EXCHANGER MOC:PLATES S316L	AFT-1001 AFTD FEED TANK MOC: SS316L Capacity: 2 kl	P-905 AXIAL FLOW PUMP MOC: SS316 Capacity: 220m3/hr@5.5bar
---	---	--	--	--

- NOTE:
1. BLUE COLOUR INDICATES THE SUPPLY BY CIPLA
 2. RED COLOUR INDICATES THE SUPPLY BY CIPLA
 3. BLACK COLOUR INDICATES THE SUPPLY BY EEPL
 4. STEAM LINE PIPING SHOULD BE IN CIPLA SCOPE

DRAWING STATUS :

- | | |
|---|--|
| ☐ FOR ENQUIRY | ☐ FOR REVIEW |
| ☐ FOR INFORMATION | ☒ FOR APPROVAL |
| ☐ FOR CONSTRUCTION | ☐ AS BUILT |

CLIENT :

M/S. CIPLA LIMITED,VIRGONAGAR

PROJECT :

200 KLD ETP R&R

CONTRACTOR :



DRAWING TITLE :

P&ID - CIPLA ETP REFURBISHMENT

DRAWN BY : BM

CHECKED BY : JK

APPROVED BY : AS


DATE :
25-12-2025

EEPL-CIPLA-ETP-R&R-2025-12

REV : 02

SHEET : 10 of 14

THIS DRAWING IS A PROPERTY OF
EEPL NO PART OR WHOLE SHOULD BE
REPRODUCED, COPIED OR GIVEN TO
OTHERS WHATSOEVER WITHOUT
PRIOR CONSENT

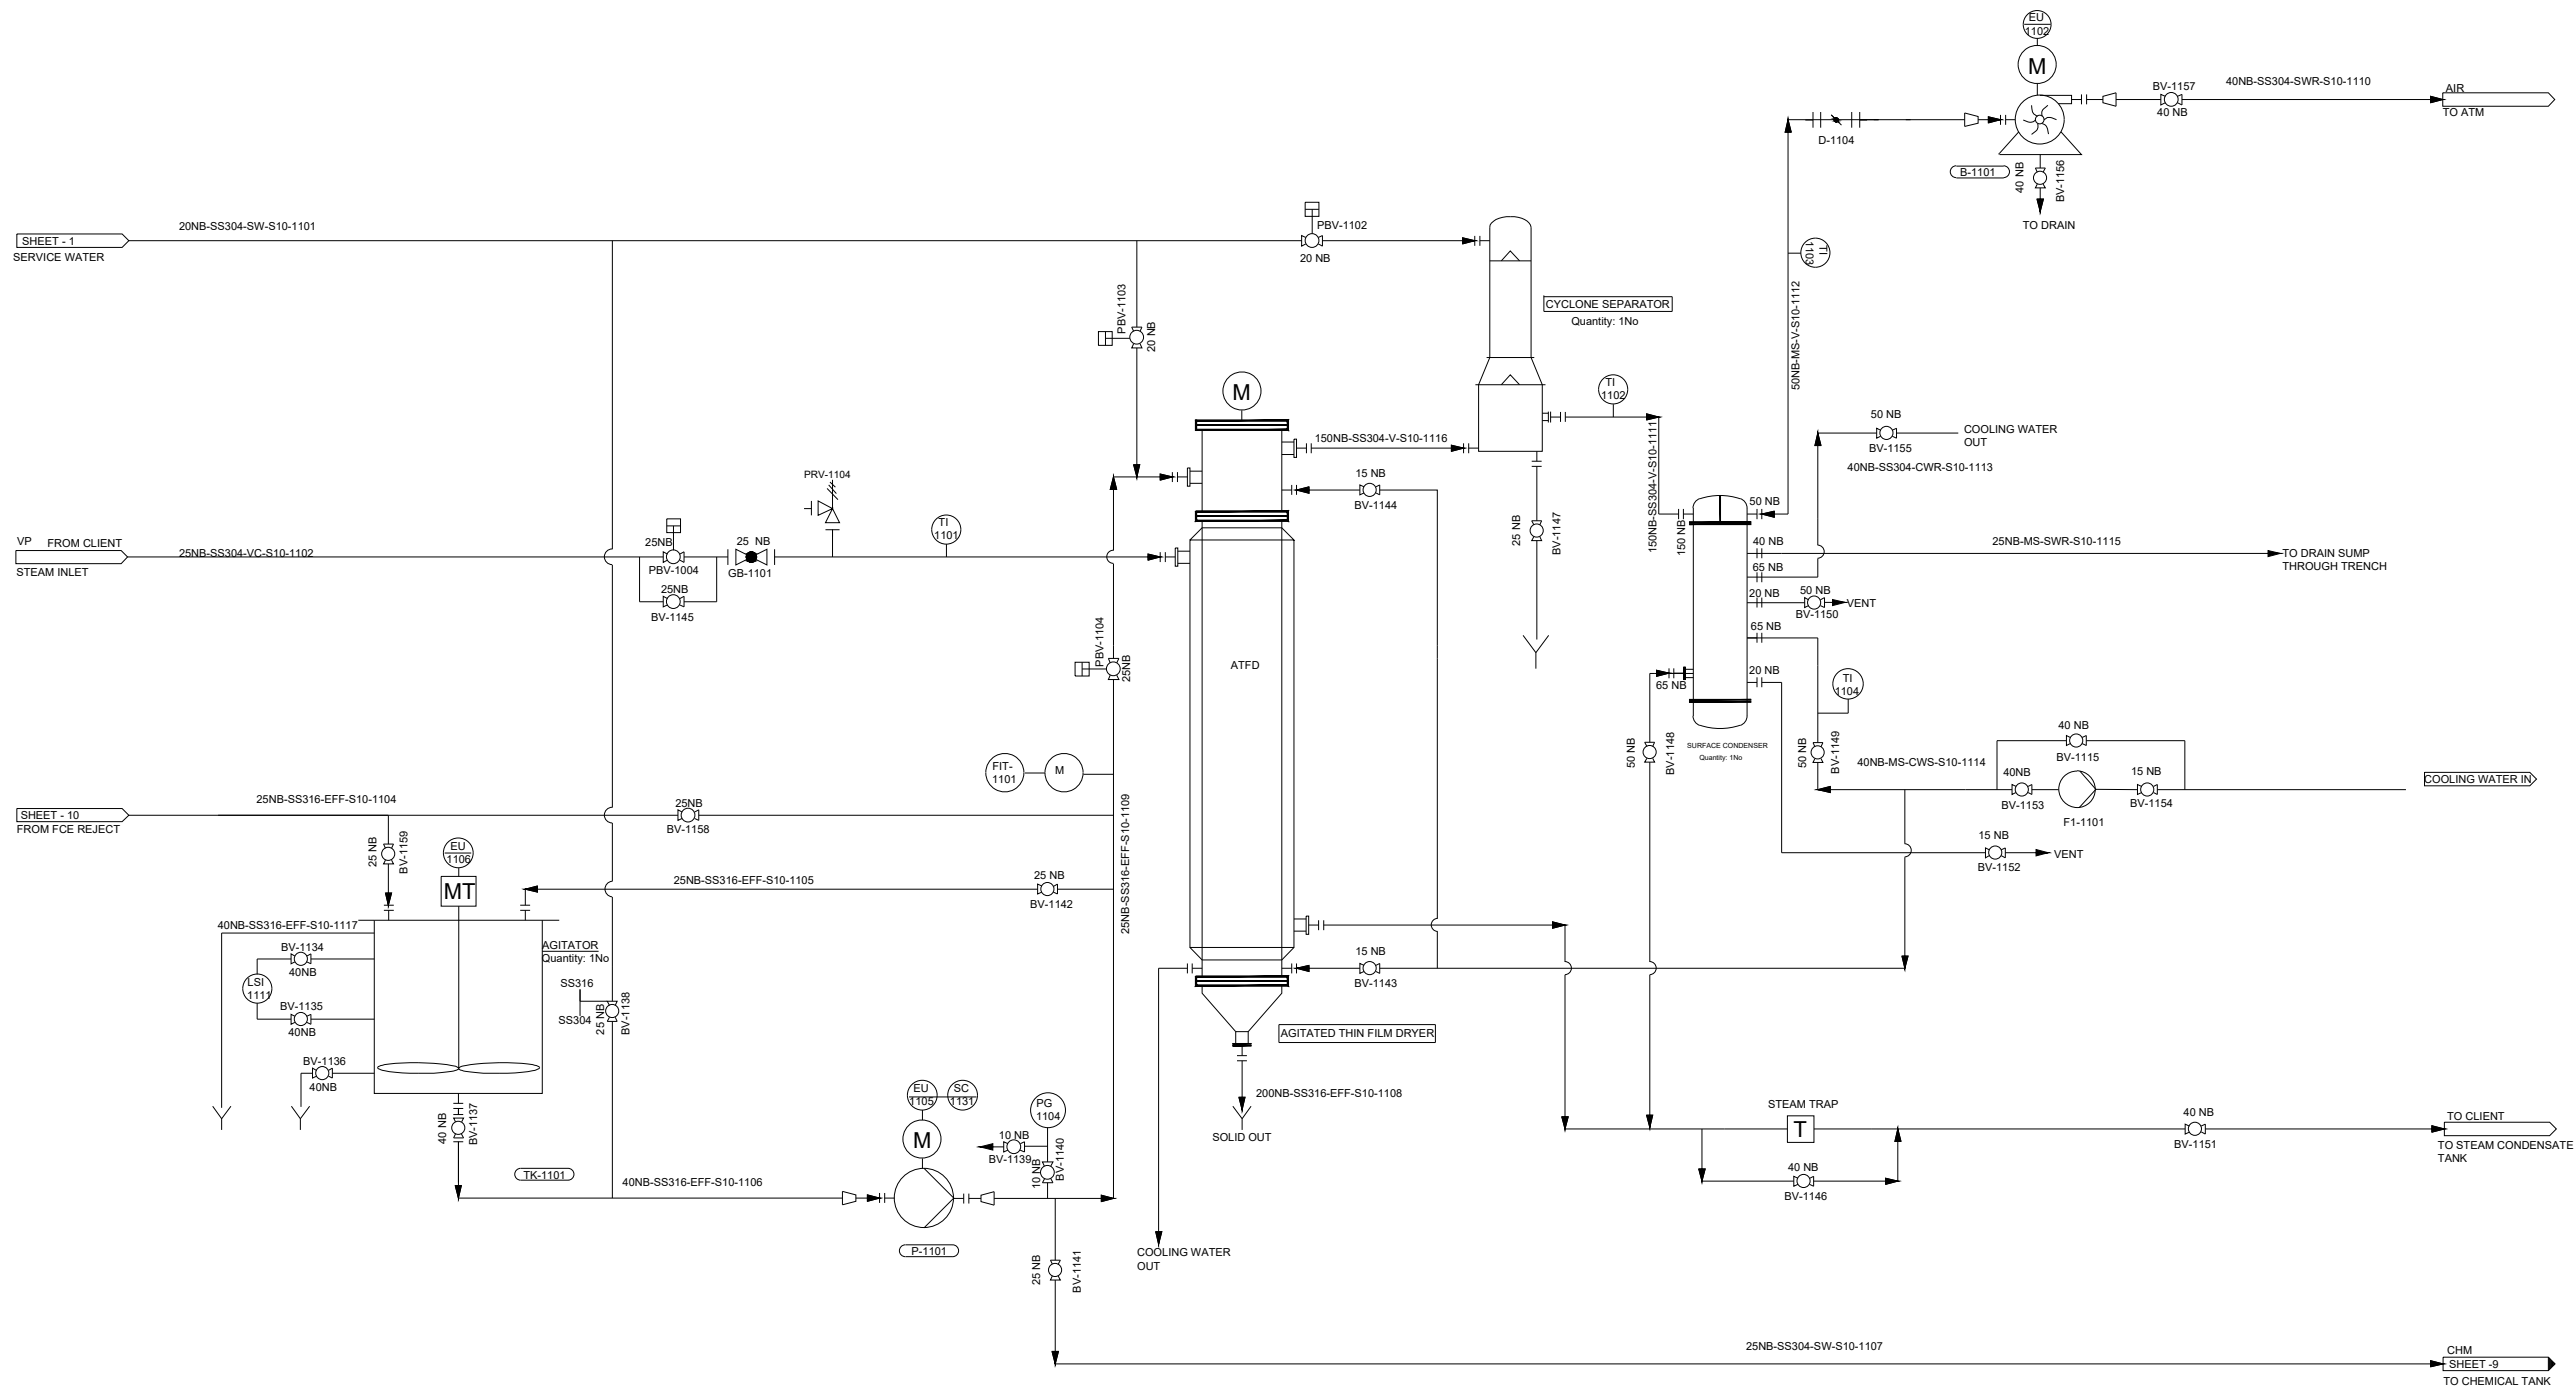

TK-1101
REJECT TANK
Quantity: 1 No
MOC: SS316

P-1101
ATFD FEED PUMP
Quantity: 1 No
MOC: SS316

B-1101
AIR BLOWER
Quantity: 1 No

P-1102
COOLING TOWER PUMP
Quantity: 1 No
MOC: SS

P-1103
CONDENSATE PUMP
Quantity: 1 No
MOC: SS

- NOTE:**
1. **BLUE** COLOUR INDICATES THE SUPPLY BY CIPLA
 2. **RED** COLOUR INDICATES THE SUPPLY BY CIPLA
 3. **BLACK** COLOUR INDICATES THE SUPPLY BY EEPL
 4. STEAM LINE PIPING SHOULD BE IN CIPLA SCOPE

DRAWING STATUS :

- | | |
|---|--|
| ☐ FOR ENQUIRY | ☐ FOR REVIEW |
| ☐ FOR INFORMATION | ☒ FOR APPROVAL |
| ☐ FOR CONSTRUCTION | ☐ AS BUILT |

CLIENT :

M/S. CIPLA LIMITED,VIRGONAGAR

PROJECT :

200 KLD ETP R&R

CONTRACTOR :



DRAWING TITLE :

P&ID - CIPLA ETP REFURBISHMENT

DRAWN BY : BM

CHECKED BY : JK

APPROVED BY : AS


DATE :
25-12-2025


EEPL-CIPLA-ETP-R&R-2025-12

REV : 02

SHEET : 11 of 14

THIS DRAWING IS A PROPERTY OF EEPL NO PART OR WHOLE SHOULD BE REPRODUCED, COPIED OR GIVEN TO OTHERS WHATSOEVER WITHOUT PRIOR CONSENT

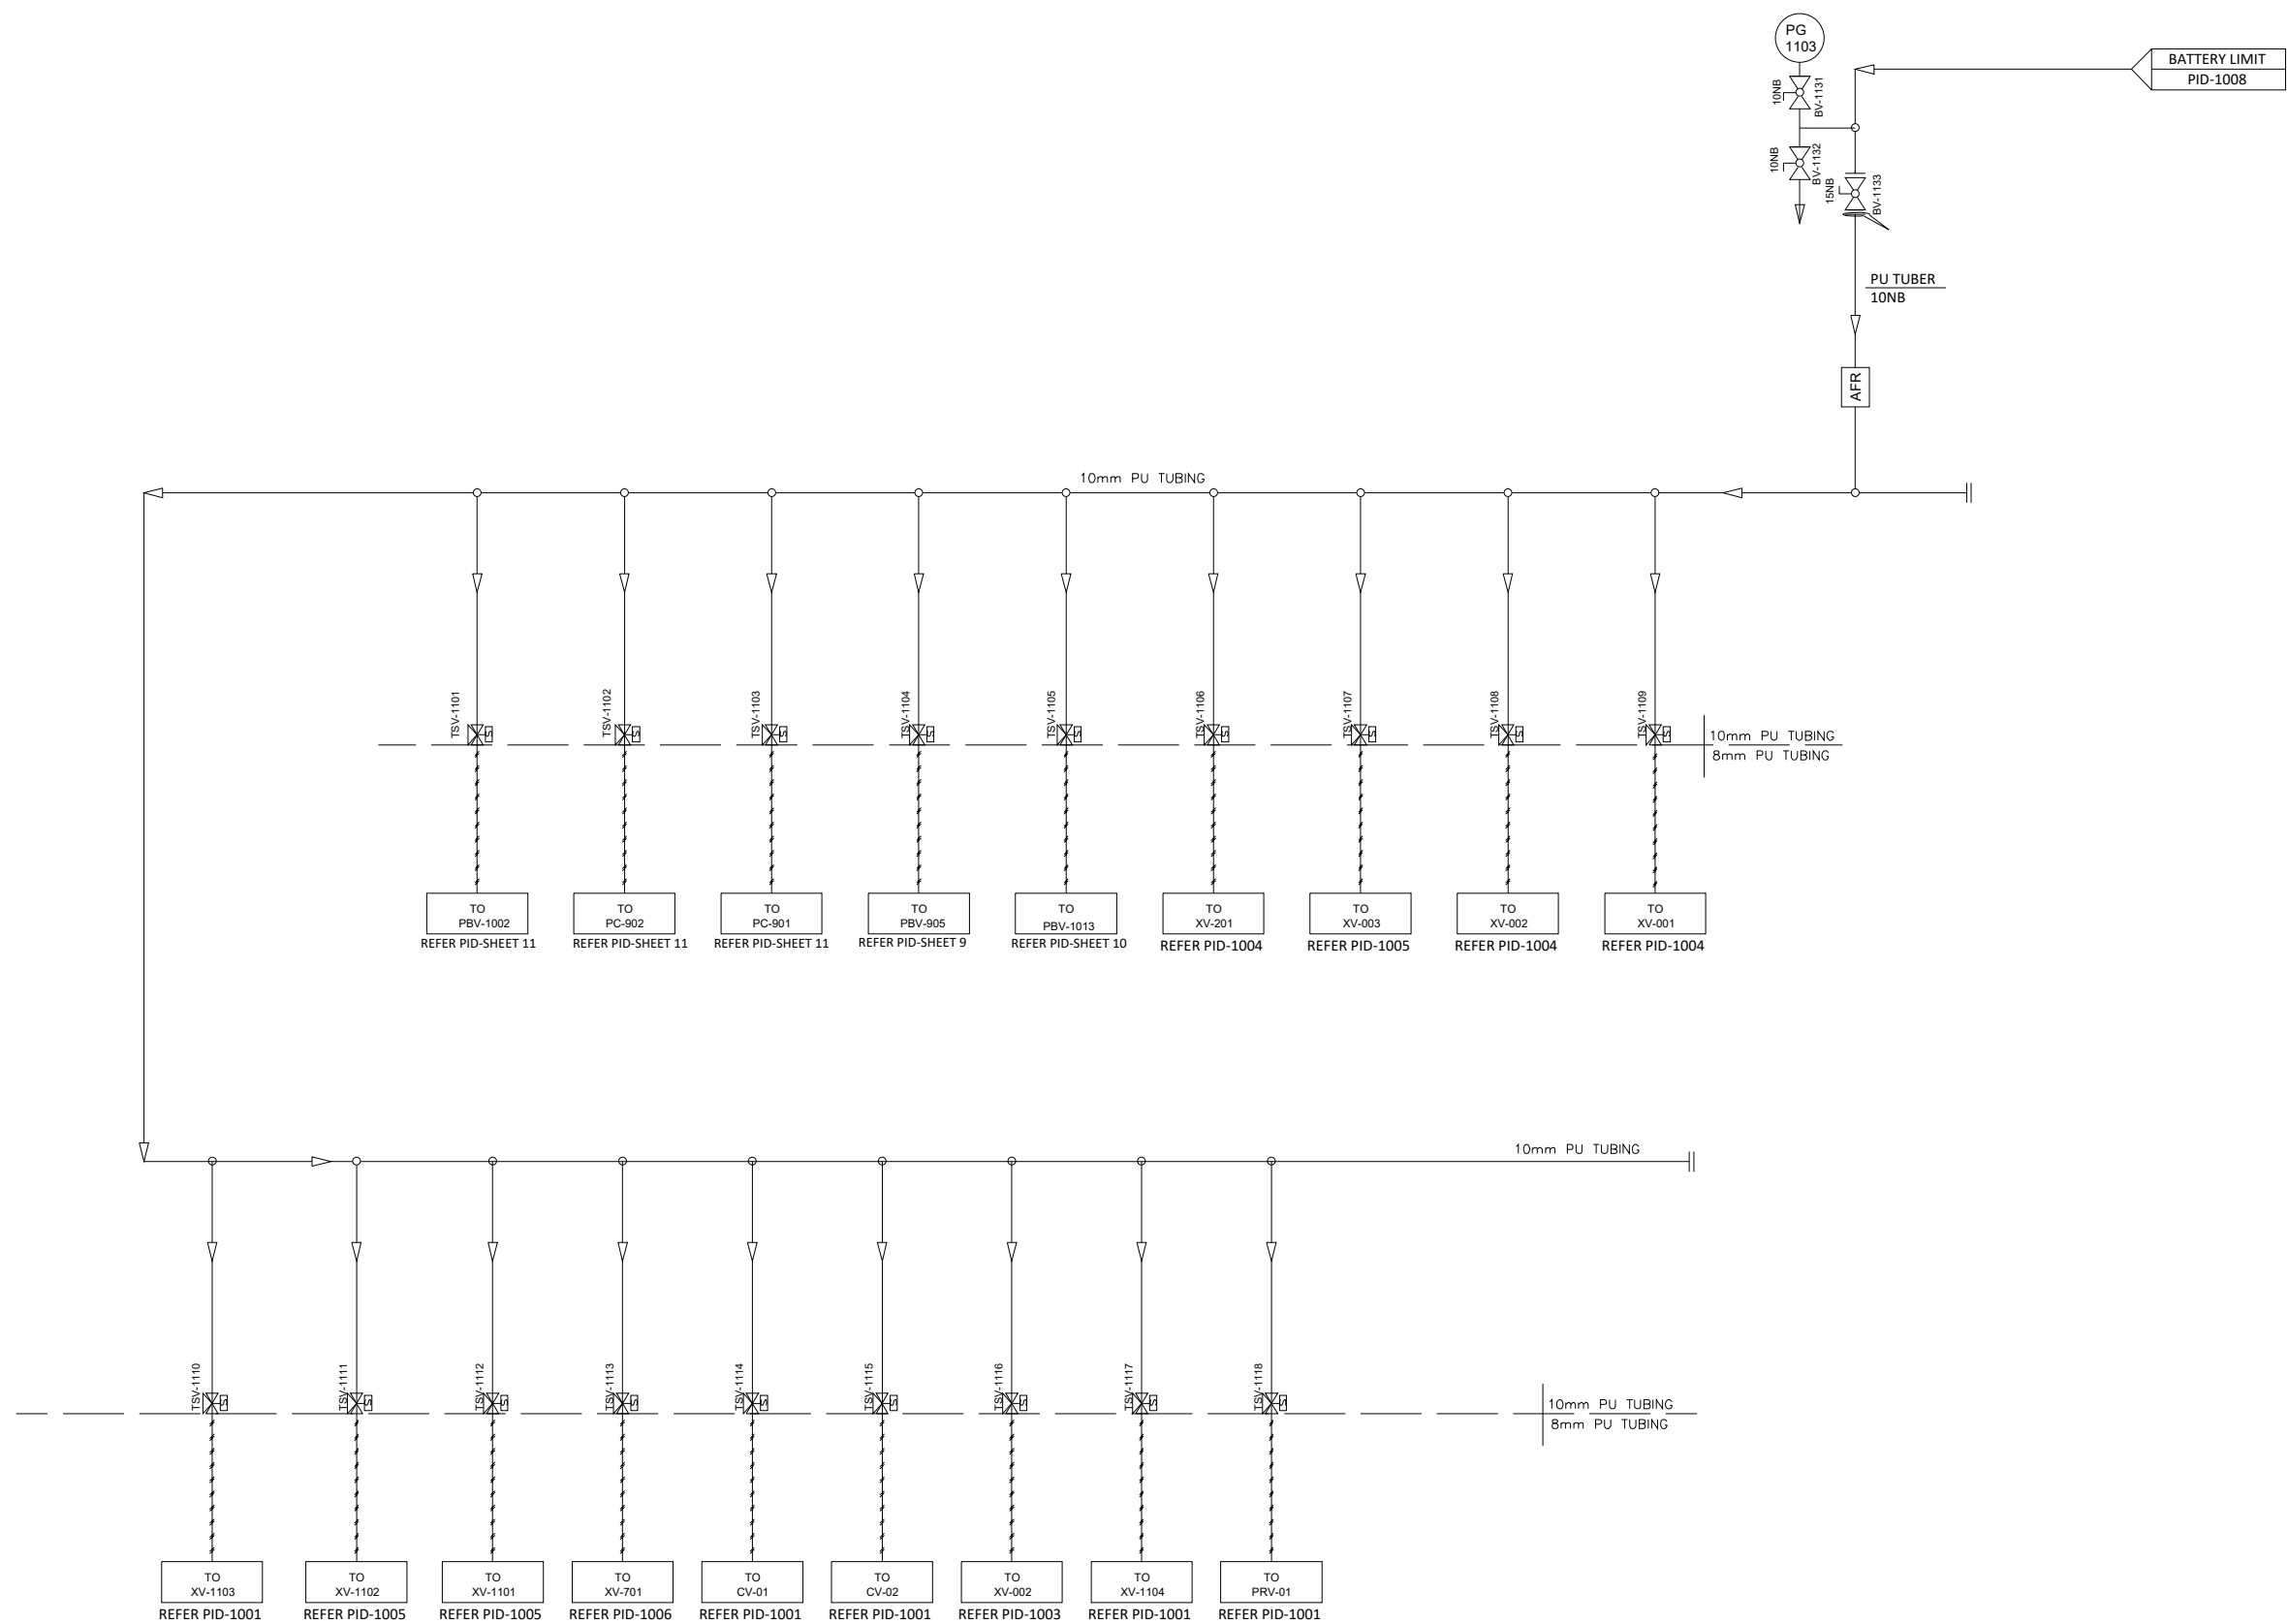

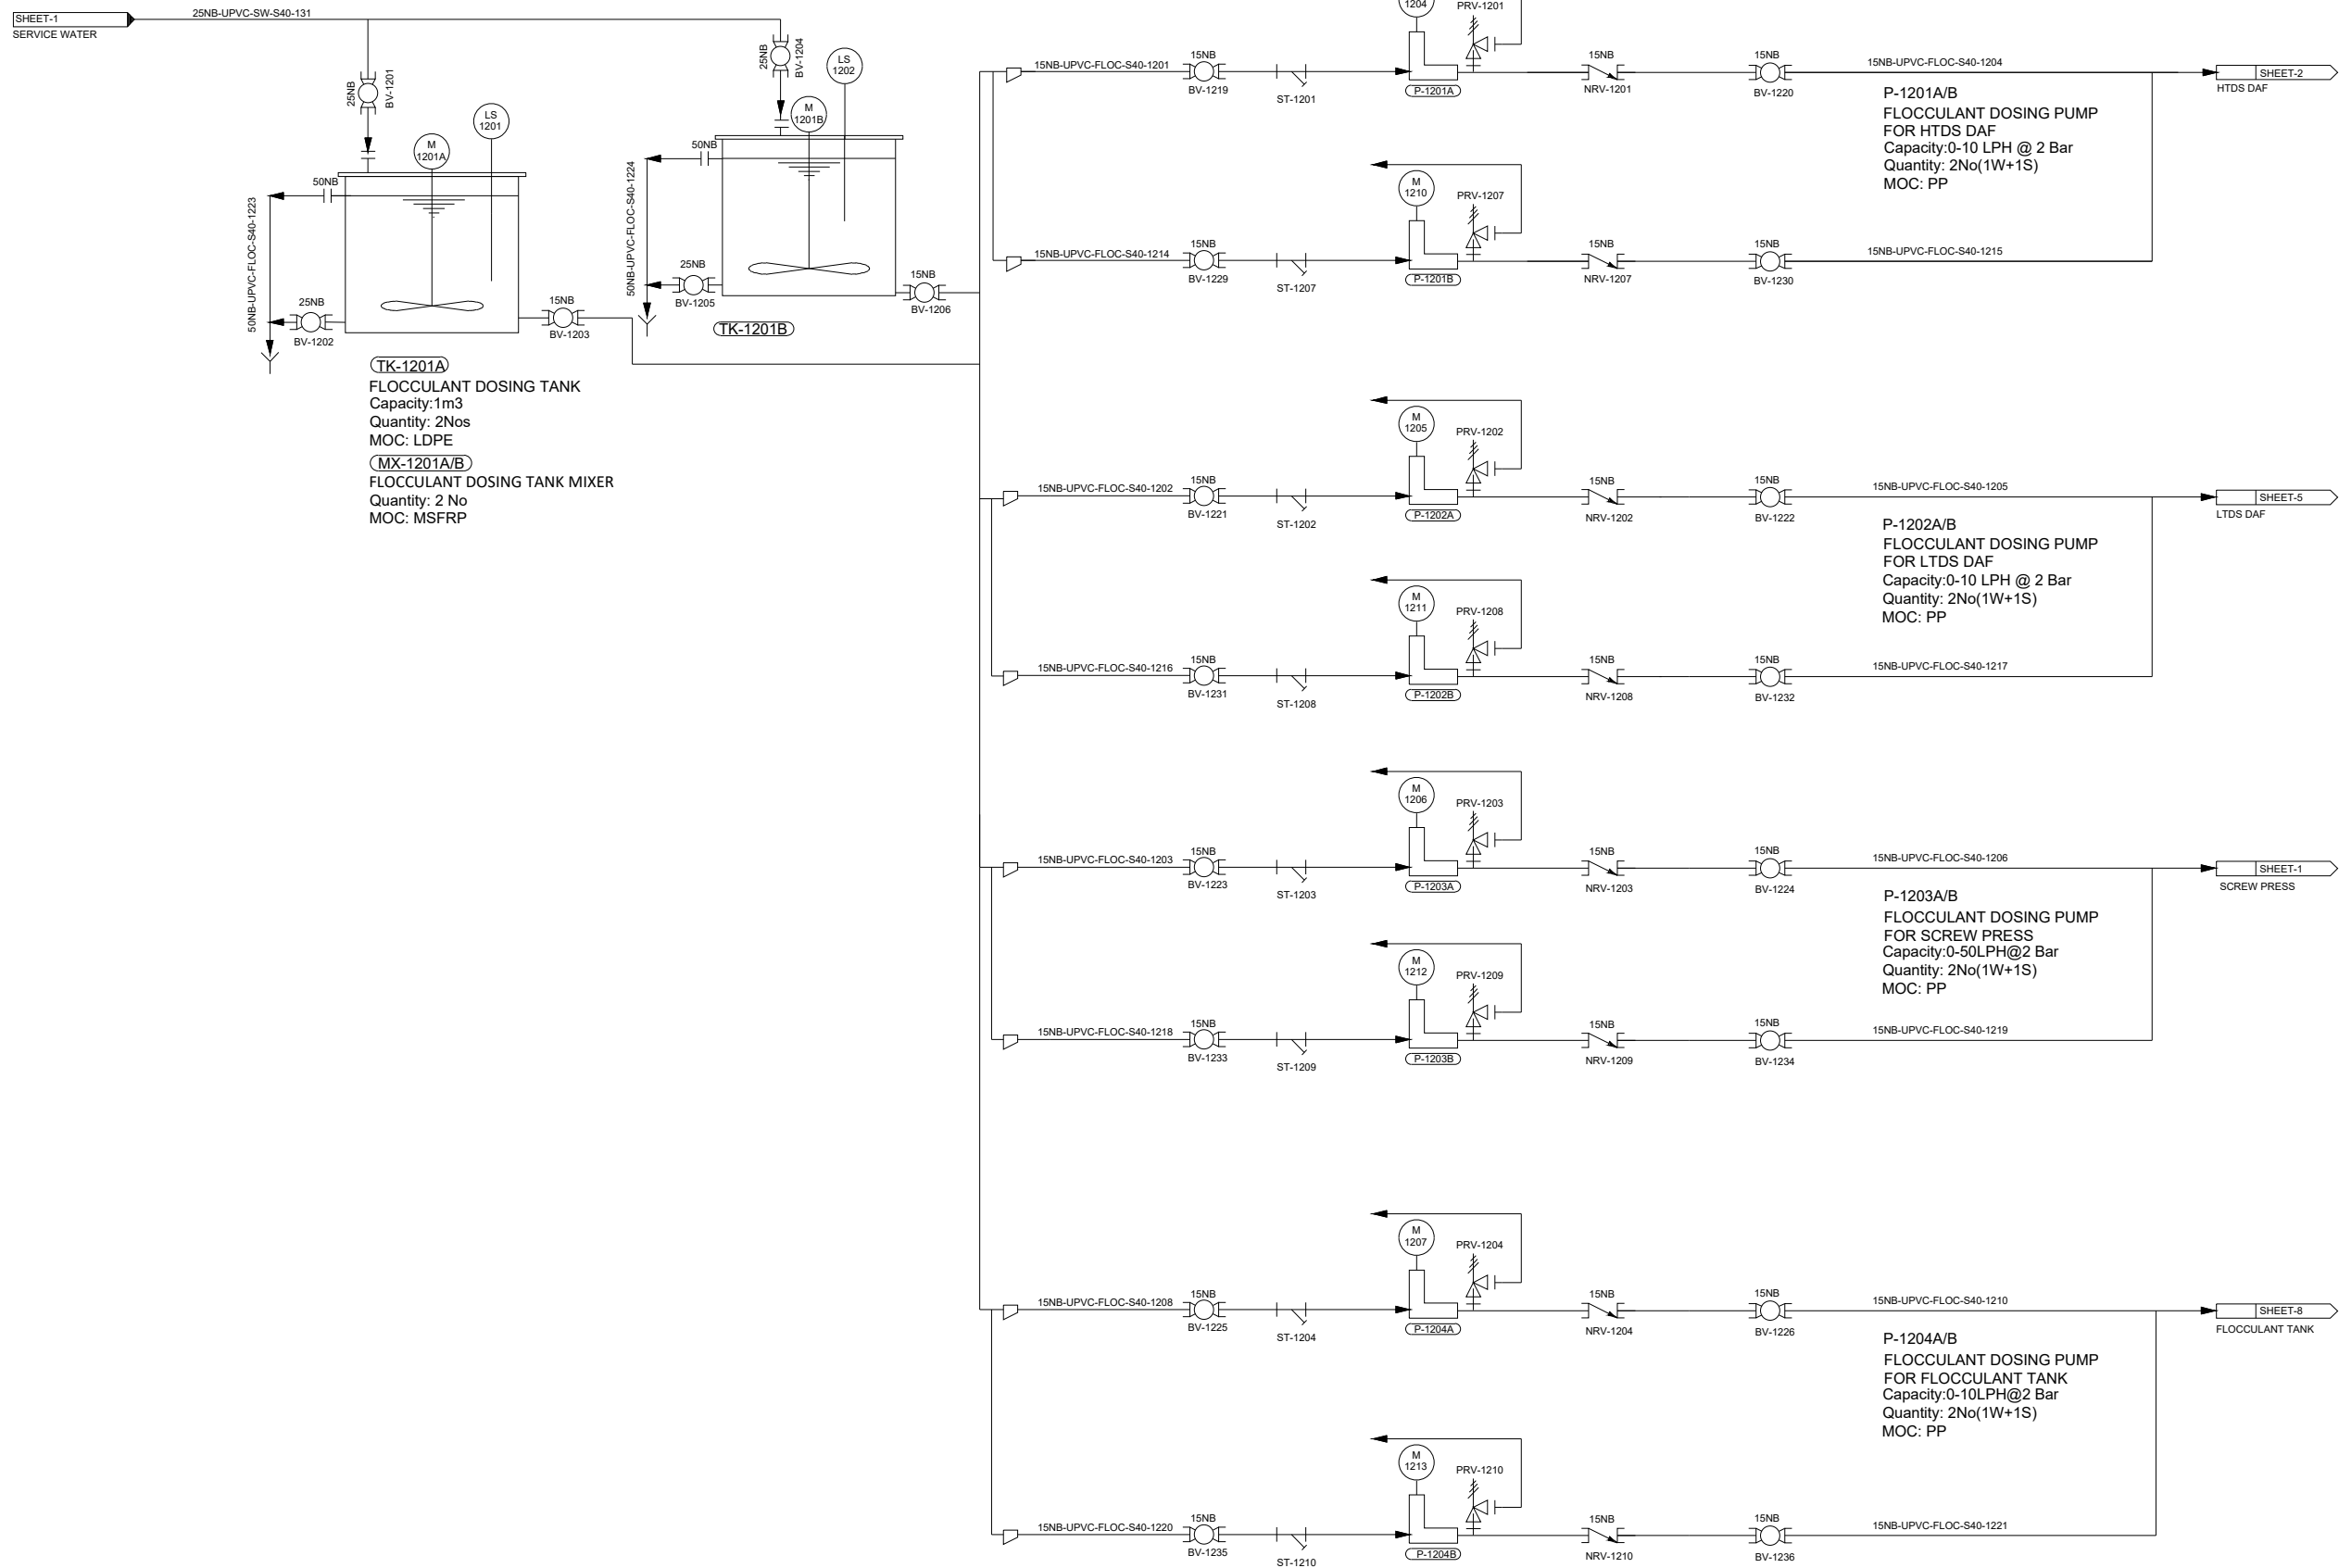

NOTE:

1. BLUE COLOUR INDICATES THE SUPPLY BY CIPLA
2. RED COLOUR INDICATES THE SUPPLY BY CIPLA
3. BLACK COLOUR INDICATES THE SUPPLY BY EEPL

DRAWING STATUS :

- | | |
|---|--|
| ☐ FOR ENQUIRY | ☐ FOR REVIEW |
| ☐ FOR INFORMATION | ☒ FOR APPROVAL |
| ☐ FOR CONSTRUCTION | ☐ AS BUILT |

CLIENT :

M/S. CIPLA LIMITED,VIRGONAGAR

PROJECT :

200 KLD ETP R&R

CONTRACTOR :



DRAWING TITLE :

P&ID - CIPLA ETP REFURBISHMENT

DRAWN BY : BM

CHECKED BY : JK

APPROVED BY : AS


DATE :
25-12-2025

EEPL-CIPLA-ETP-R&R-2025-12

REV : 02

SHEET : 12A of 14

THIS DRAWING IS A PROPERTY OF
EEPL NO PART OR WHOLE SHOULD BE
REPRODUCED, COPIED OR GIVEN TO
OTHERS WHATSOEVER WITHOUT
PRIOR CONSENT

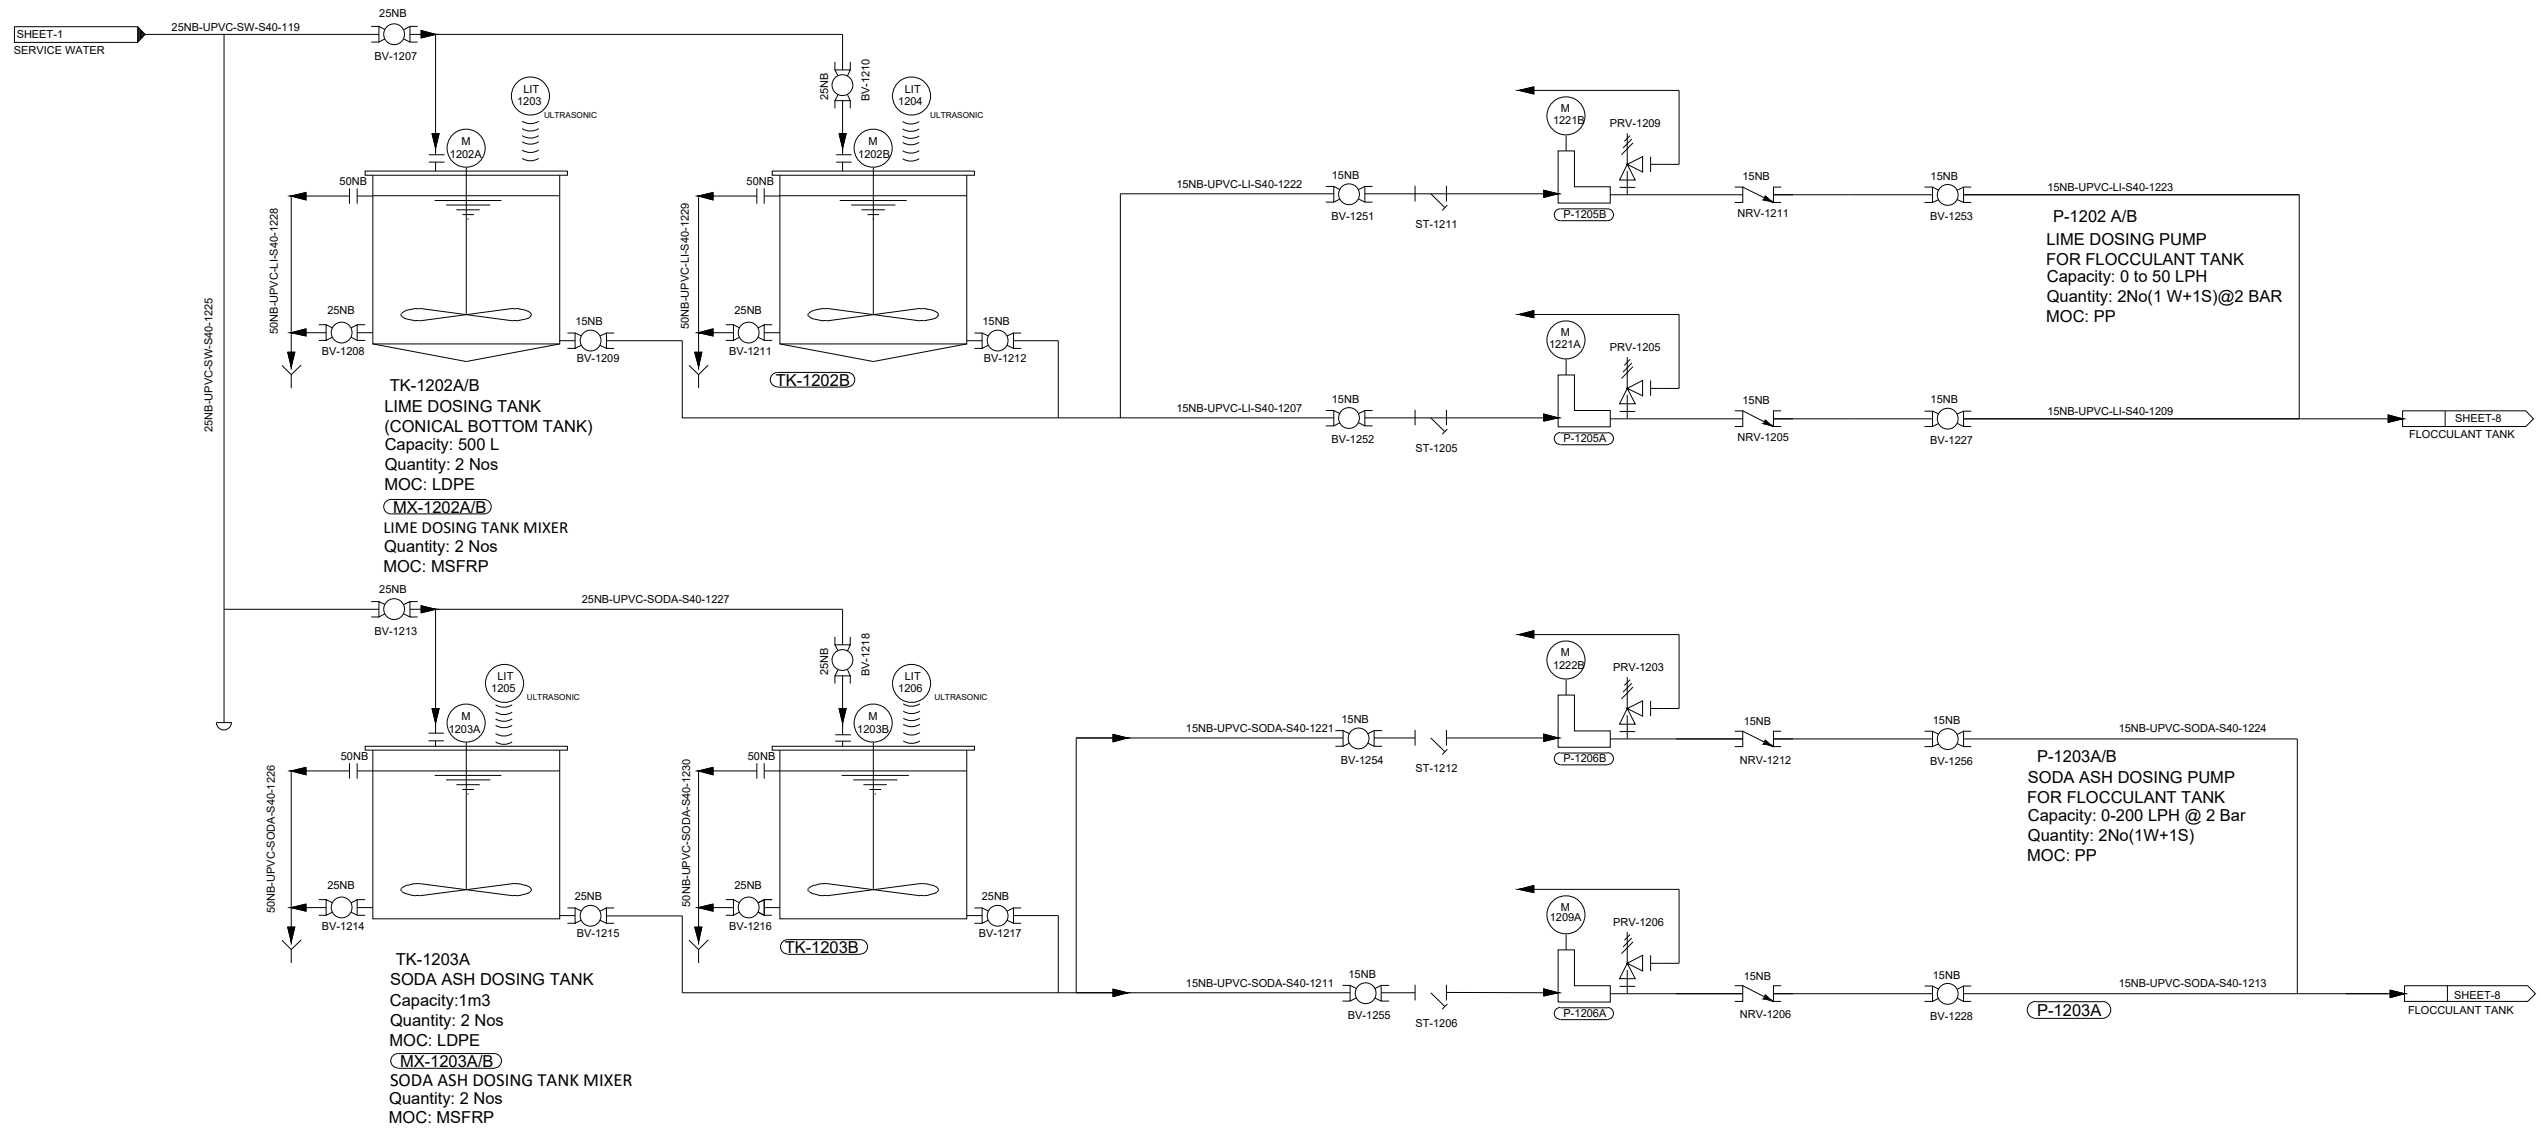

DRAWING STATUS :

☐ FOR ENQUIRY	☐ FOR REVIEW
☐ FOR INFORMATION	☒ FOR APPROVAL
☐ FOR CONSTRUCTION	☐ AS BUILT

CLIENT :

M/S. CIPLA LIMITED,VIRGONAGAR

PROJECT :

200 KLD ETP R&R

CONTRACTOR :


ecologic eepl engineering pvt ltd

DRAWING TITLE :


P&ID - CIPLA ETP REFURBISHMENT

DRAWN BY : BM	DATE : 25-12-2025
CHECKED BY : JK	
APPROVED BY : AS	
EEPL-CIPLA-ETP-R&R-2025-12	REV : 02
	SHEET : 12 of 14

NOTE:

1. BLUE COLOUR INDICATES THE SUPPLY BY CIPLA
2. RED COLOUR INDICATES THE SUPPLY BY CIPLA
3. BLACK COLOUR INDICATES THE SUPPLY BY EEPL

THIS DRAWING IS A PROPERTY OF
EEPL NO PART OR WHOLE SHOULD BE
REPRODUCED, COPIED OR GIVEN TO
OTHERS WHATSOEVER WITHOUT
PRIOR CONSENT

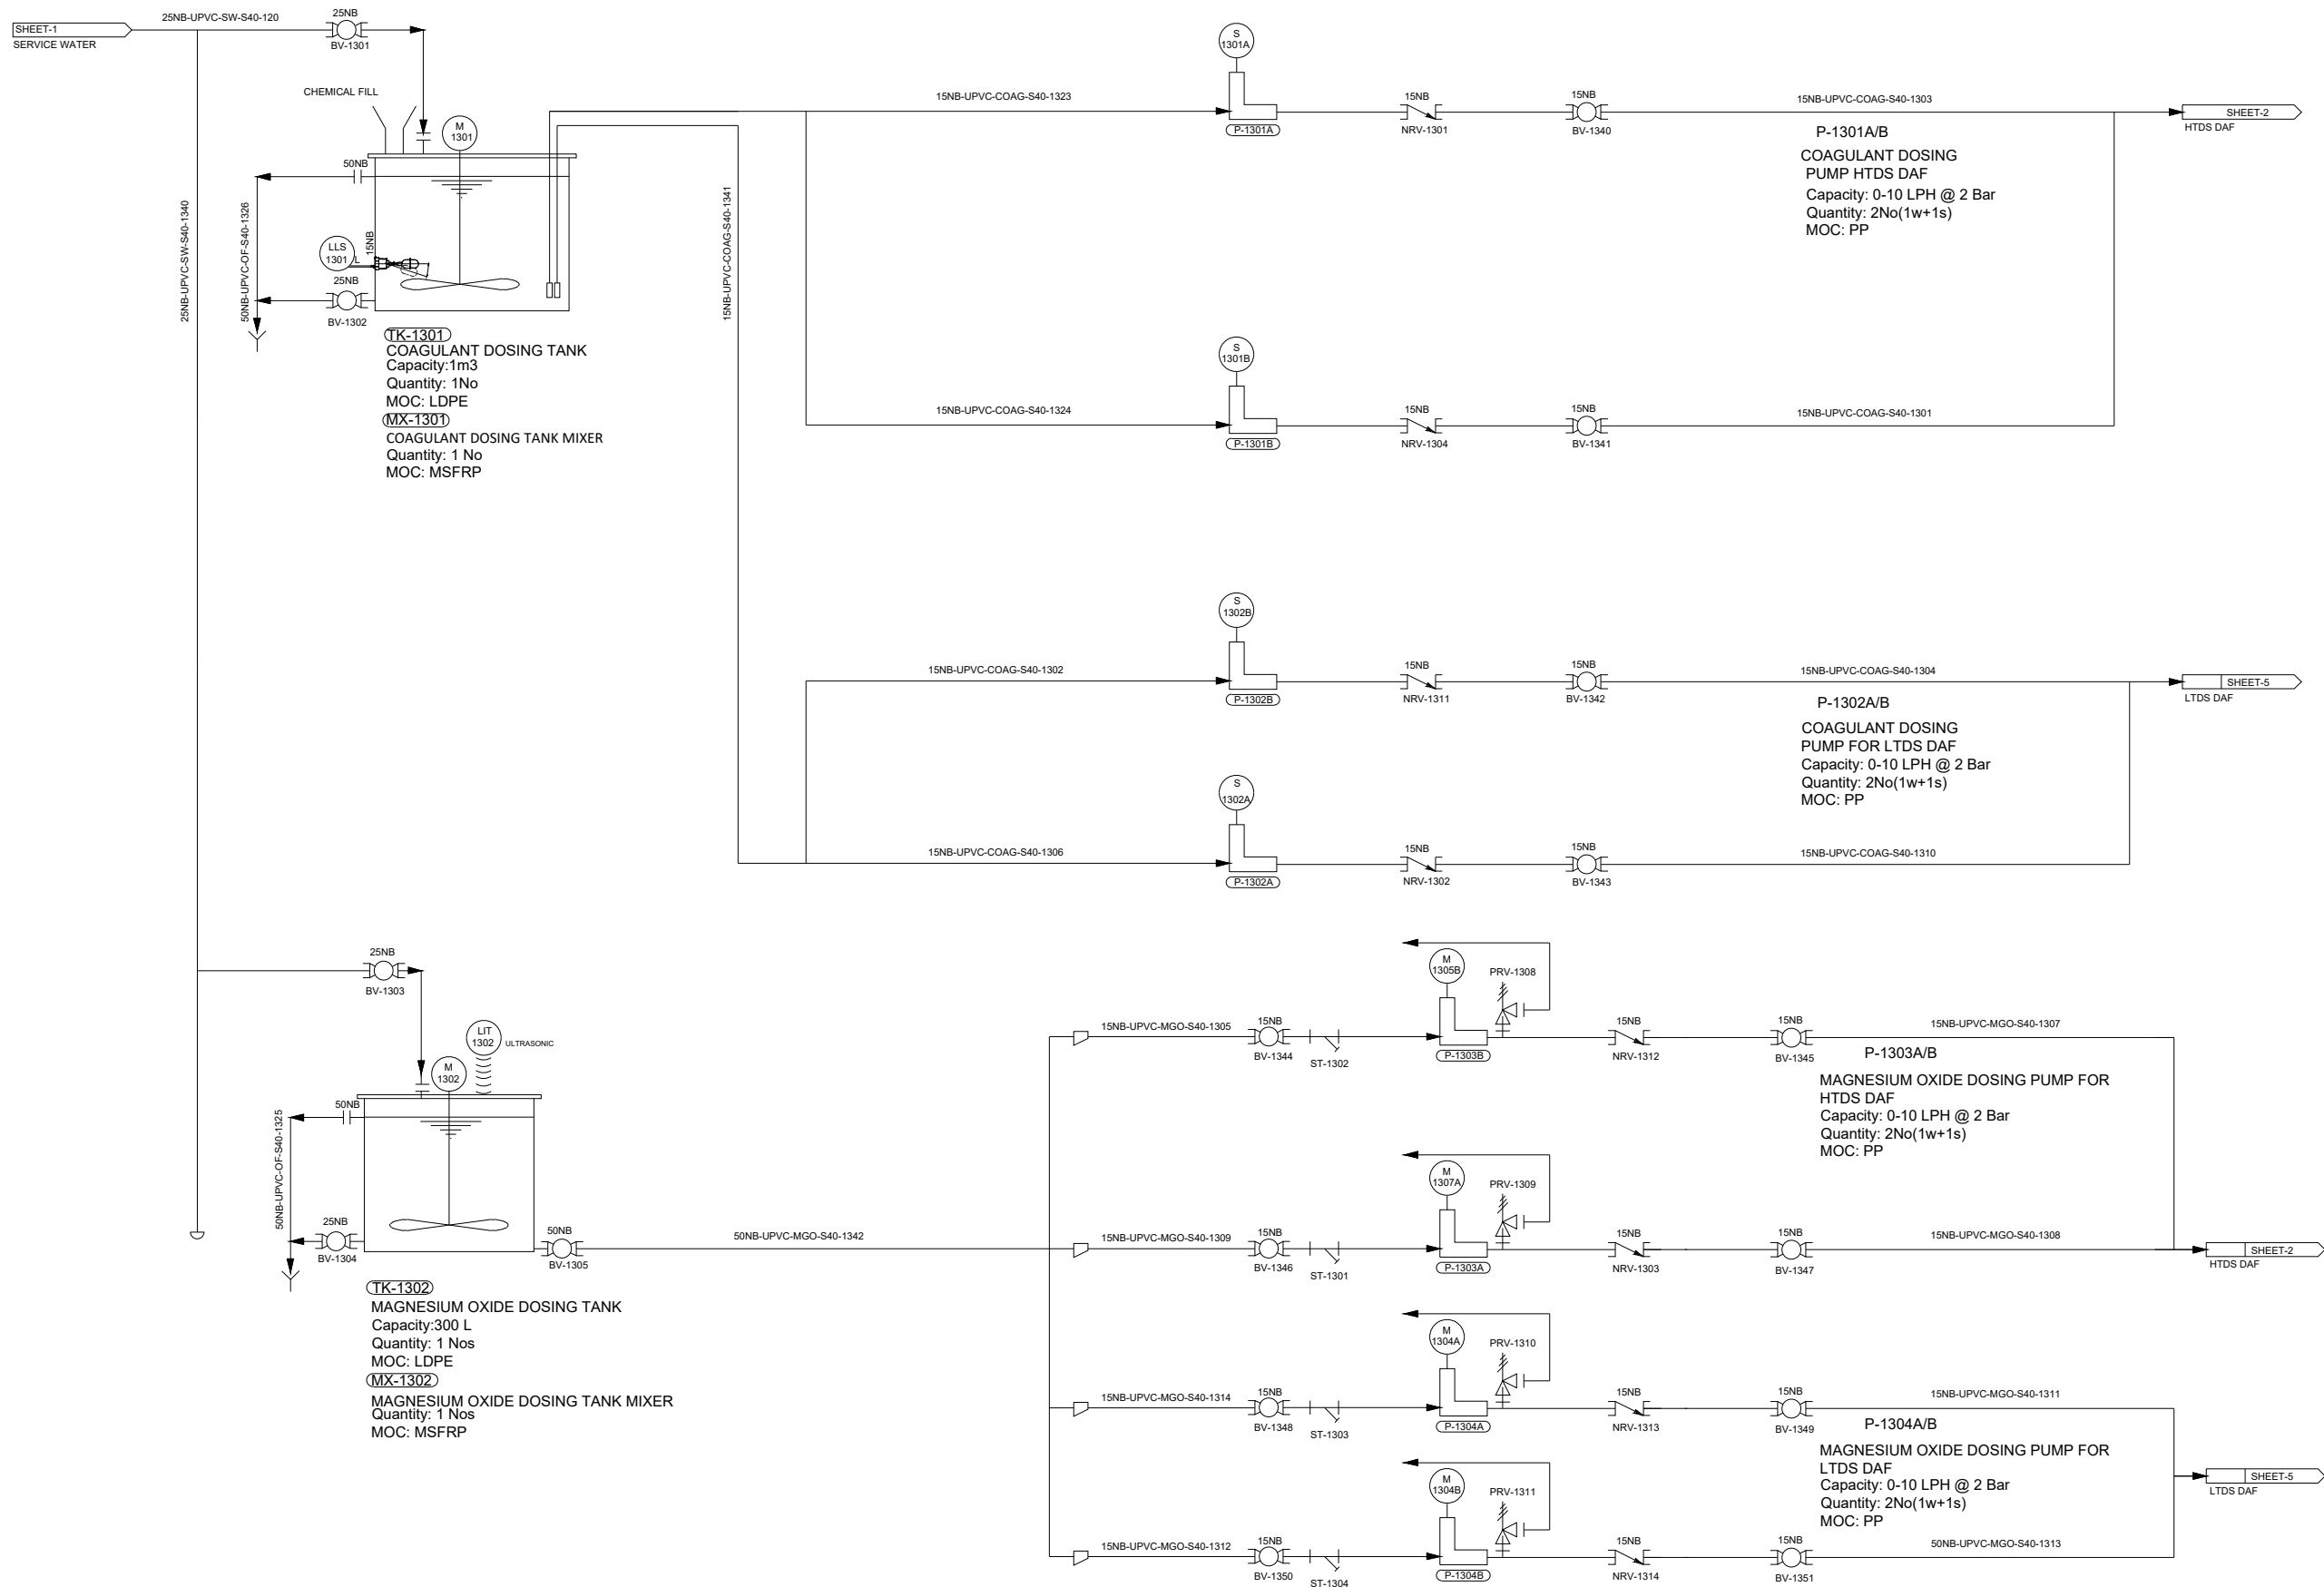

DRAWING STATUS :

- ☐ FOR ENQUIRY ☐ FOR REVIEW
☐ FOR INFORMATION ☒ FOR APPROVAL
☐ FOR CONSTRUCTION ☐ AS BUILT

CLIENT :

M/S. CIPLA LIMITED,VIRGONAGAR

PROJECT :

200 KLD ETP R&R

CONTRACTOR :



DRAWING TITLE :

P&ID - CIPLA ETP REFURBISHMENT

DRAWN BY : BM

CHECKED BY : JK

APPROVED BY : AS

DATE :
25-12-2025


EEPL-CIPLA-ETP-R&R-2025-12

REV : 02

SHEET : 13 of 14

THIS DRAWING IS A PROPERTY OF
EEPL NO PART OR WHOLE SHOULD BE
REPRODUCED, COPIED OR GIVEN TO
OTHERS WHATSOEVER WITHOUT
PRIOR CONSENT

SHEET-1
SERVICE WATER

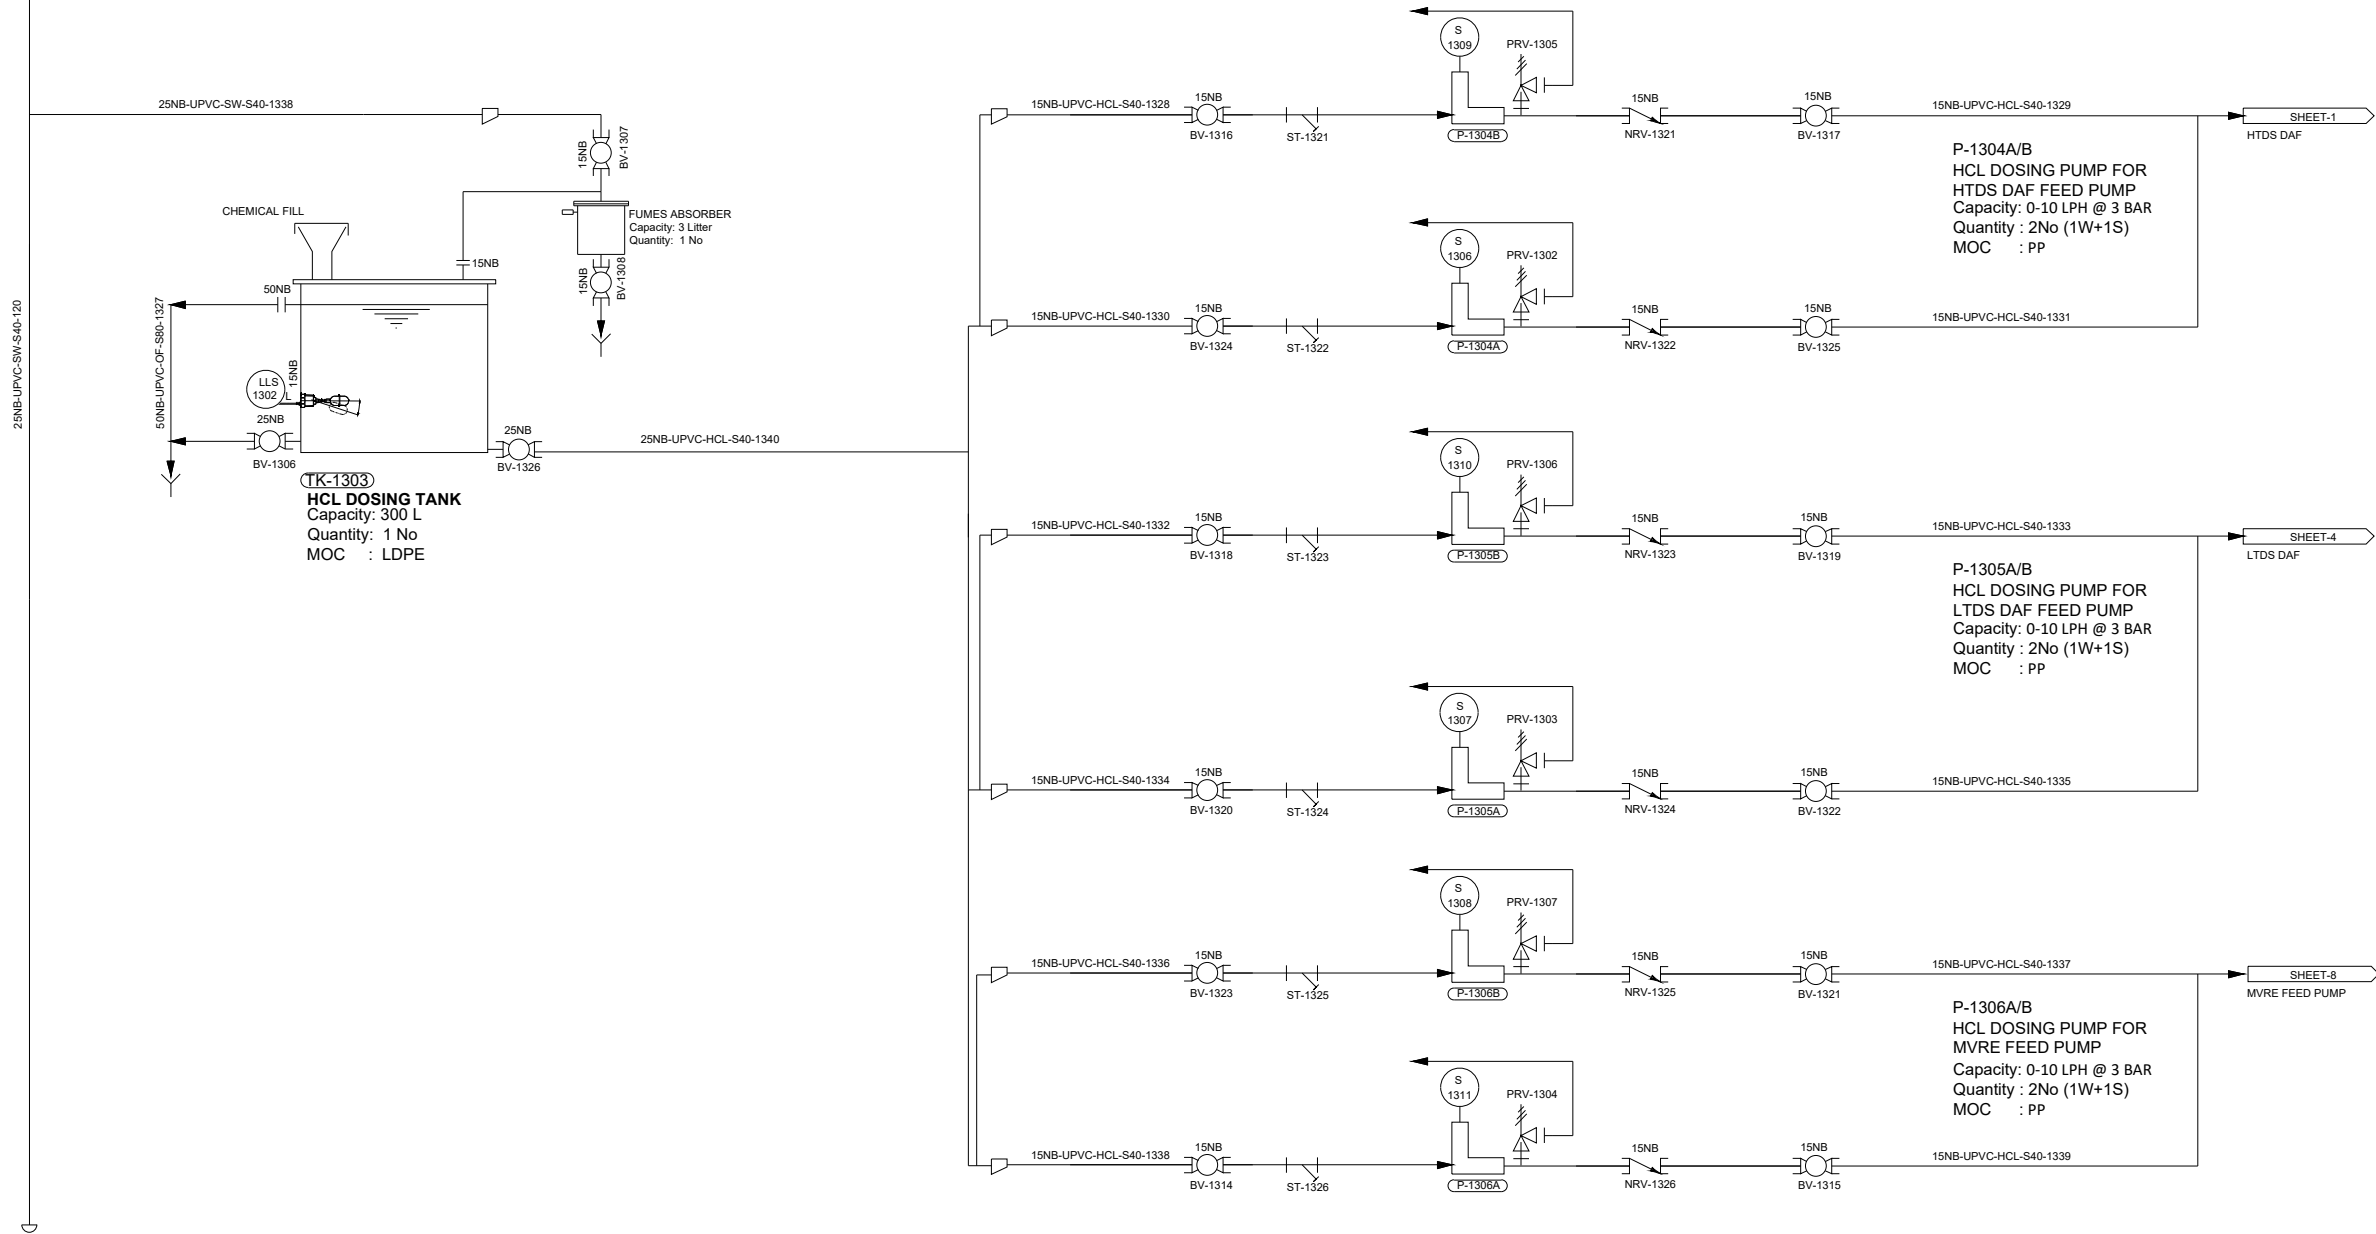

NOTE:
1. BLUE COLOUR INDICATES THE SUPPLY BY CIPLA
2. RED COLOUR INDICATES THE SUPPLY BY CIPLA
3. BLACK COLOUR INDICATES THE SUPPLY BY EEPL

DRAWING STATUS :

☐ FOR ENQUIRY ☐ FOR REVIEW
☐ FOR INFORMATION ☒ FOR APPROVAL
☐ FOR CONSTRUCTION ☐ AS BUILT

CLIENT :

M/S. CIPLA LIMITED,VIRGONAGAR

PROJECT :

200 KLD ETP R&R

CONTRACTOR :



DRAWING TITLE :

P&ID - CIPLA ETP REFURBISHMENT

DRAWN BY : BM

CHECKED BY : JK

APPROVED BY : AS

DATE :
25-12-2025

EEPL-CIPLA-ETP-R&R-2025-12

REV : 02

SHEET : 13A of 14

THIS DRAWING IS A PROPERTY OF
EEPL NO PART OR WHOLE SHOULD BE
REPRODUCED, COPIED OR GIVEN TO
OTHERS WHATSOEVER WITHOUT
PRIOR CONSENT

VALVE SYMBOLS

GATE VALVE (FLANGED)

BUTTERFLY VALVE (FLANGED)

BUTTERFLY VALVE (SOCKET)

BALL VALVE (FLANGED)

BALL VALVE (SOCKET)

BALL VALVE (SCREWED)

GLOBE VALVE (FLANGED)

CHECK VALVE (FLANGED)

CHECK VALVE (SOCKET)

PNEUMATIC BUTTERFLY (FLANGED)

FLOW CONTROL VALVE (FLANGED)

PRESSURE RELIEF VALVE

EXPANSION BELOW

STEAM TRAP

FOOT VALVE

DIAPHRAGM VALVE

PUMP AND BLOWER SYMBOLS

HORIZONTAL CENTRIFUGAL PUMP

SUBMERSIBLE PUMP

SCREW PUMP

DOSEING PUMP

TWIN LOBE BLOWER

CENTRIFUGAL BLOWER

COMPRESSOR

EQUIPMENT SYMBOLS

HRSOC

SLUDGE THICKENER

CLOSED RSC TANK

OPEN RSC TANK

DOSEING TANK

ULTRA FINE SCREEN

MICRON CARTRIDGE FILTER

RSCSG

PLATE & FRAME FILTER

AGITATOR

CENTRIFUGE

HUMIDIFIER AND DEHUMIDIFIER

MECHANICAL SCREEN

MANUAL SCREEN

OIL SKIMMER

SUBMERSIBLE MIXER

PROCESS INDEX

CV - CHECK VALVE

BV - BALL VALVE

PB/V - PNEUMATIC BUTTERFLY VALVE

BF - BUTTERFLY VALVE

GV - GATE VALVE

GB - GLOBE VALVE

FV - FOOT VALVE

EXP - EXPANSION BELOW

SM - STATIC MIXER

TK - TANK

P - PUMP

RG - REVERSE OSMOSIS

DT - DOSEING TANK

BL - BLOWER

DP - DOSEING PUMP

PB/V - PNEUMATIC BALL VALVE

PSV - PRESSURE SAFETY VALVE

FCV - FLOW CONTROL VALVE

DV - DIAPHRAGM VALVE

FCV - FLOW CONTROL VALVE

NV - NEEDLE VALVE

LINE TAG:

XX - XXX - XX - XX

TAG

SERVICE

MAJC

SIZE

VALVE TAG:

XX - XXX

TAG

VALVE TYPE

INSTRUMENT TAG:

PG XXX

INSTRUMENTATION TYPE

TAG

MISCELLANEOUS SYMBOLS

MANUAL GATE

STATIC MIXER

EPC CONTRACTOR

TERMINATION POINT

CLIENT

SAMPLING

FLUSHING CONNECTION

PRE FILTER / POST FILTER

AIR DRYER

SCREEN CONTAINER

CONVEYOR WITH COMPACTOR

Pipe Flocculator

DAMPNER

INSTRUMENTATION

MOTOR

LEVEL INDICATING TRANSMITTER

PRESSURE GAUGE

FLOW CONTROL VALVE

DIFFERENTIAL PRESSURE SWITCH

LEVEL INDICATOR

POSITION TRANSMITTER

ANALYZER

TEMPERATURE INDICATOR

LEVEL SWITCH

VARIABLE FREQUENCY CONTROL

FLOW INDICATOR TRANSMITTER

FLOW INDICATOR

PRESSURE INDICATING TRANSMITTER

INSTRUMENT SYMBOL

FLOW INDICATING TRANSMITTER

INTERLOCK

ROTAMETER

FLOW INDICATOR (ORIFICE TYPE)

SERVICE

EFF - EFFLUENT

ROP - PERMEATE WATER

DR - DRAIN

OF - OVERFLOW

SW - SERVICE WATER

SL - SLUDGE

R - REJECT

CP - CHEMICAL CLEANING

POLY - POLY DOSING

pH - pH DOSING

ALK - ALKALI DOSING

ACID - ACID DOSING

LI - LIME DOSING

NHCL - SODIUM HYPOCHLORITE DOSING

CIT - CITRIC DOSING

SODA - SODA ASH DOSING

CG - COAGULANT DOSING

ANT - ANTISCALANT DOSING

SMS - SMS DOSING

AIR - AIR

IR - INSTRUMENT AIR

CW - CLARIFIED WATER

CR - CLARIFIED RECYCLED WATER

FLOC - FLOCCULANT DOSING

TYPICAL PG / PS ISOLATION

SYMBOLS	NOMENCLATURE
WW	WASTE WATER
VP	VAPOR
VC	VAPOR CONDENSATE
NCG	NO CONDENSATE GASES
RW	RAW WATER
CHM	CHEMICAL
HW	HOT WATER
CW	COOLING WATER
AIR	AIR
DR	DRAIN
TF	THERMIC FLUID

INSTRUMENTATION IDENTIFICATION LETTERS (USED INSIDE INSTRUMENT BALLOONS OR ID BLOCKS)			
FC	FLOW CONTROL	PC	PRESSURE CONTROL
FCV	FLOW CONTROL VALVE	PCV	PRESSURE CONTROL VALVE
FIC	FLOW INDICATING CONTROLLER	PIC	PRESSURE INDICATING CONTROLLER
FT	FLOW TRANSMITTER	PT	PRESSURE TRANSMITTER
JC	POWER CONTROL	SC	SPEED CONTROL
JCV	POWER CONTROL VALVE	TC	TEMPERATURE CONTROL
JIC	POWER INDICATING CONTROLLER	TCV	TEMPERATURE CONTROL VALVE
KS	TIME SCHEDULE VALVE	TIC	TEMPERATURE INDICATING CONTROLLER
LC	LEVEL CONTROL	TT	TEMPERATURE TRANSMITTER
LCV	LEVEL CONTROL VALVE	WC	WEIGHT CONTROL
LIC	LEVEL INDICATING CONTROLLER	WCV	WEIGHT CONTROL VALVE
LT	LEVEL TRANSMITTER	ZS	POSITION SWITCH
EU	ELECTRIC UNIT	FS	FLOW SWITCH
LS	LEVEL SWITCH	ST	STEAM TRAP

DRAWING STATUS :

☐ FOR ENQUIRY

☐ FOR REVIEW

☐ FOR INFORMATION

☒ FOR APPROVAL

☐ FOR CONSTRUCTION

☐ AS BUILT

CLIENT :

M/S. CIPLA LIMITED,VIRGONAGAR

PROJECT :

200 KLD ETP R&R

CONTRACTOR :

ecologic

eepl

engineering pvt ltd

DRAWING TITLE :

P&ID - CIPLA ETP REFURBISHMENT

DRAWN BY : BM	DATE : 25-12-2025
CHECKED BY : JK	
APPROVED BY : AS	
EEPL-CIPLA-ETP-R&R-2025-12	REV : 02
SHEET : 14 of 14	

THIS DRAWING IS A PROPERTY OF EEPL NO PART OR WHOLE SHOULD BE REPRODUCED, COPIED OR GIVEN TO OTHERS WHATSOEVER WITHOUT PRIOR CONSENT