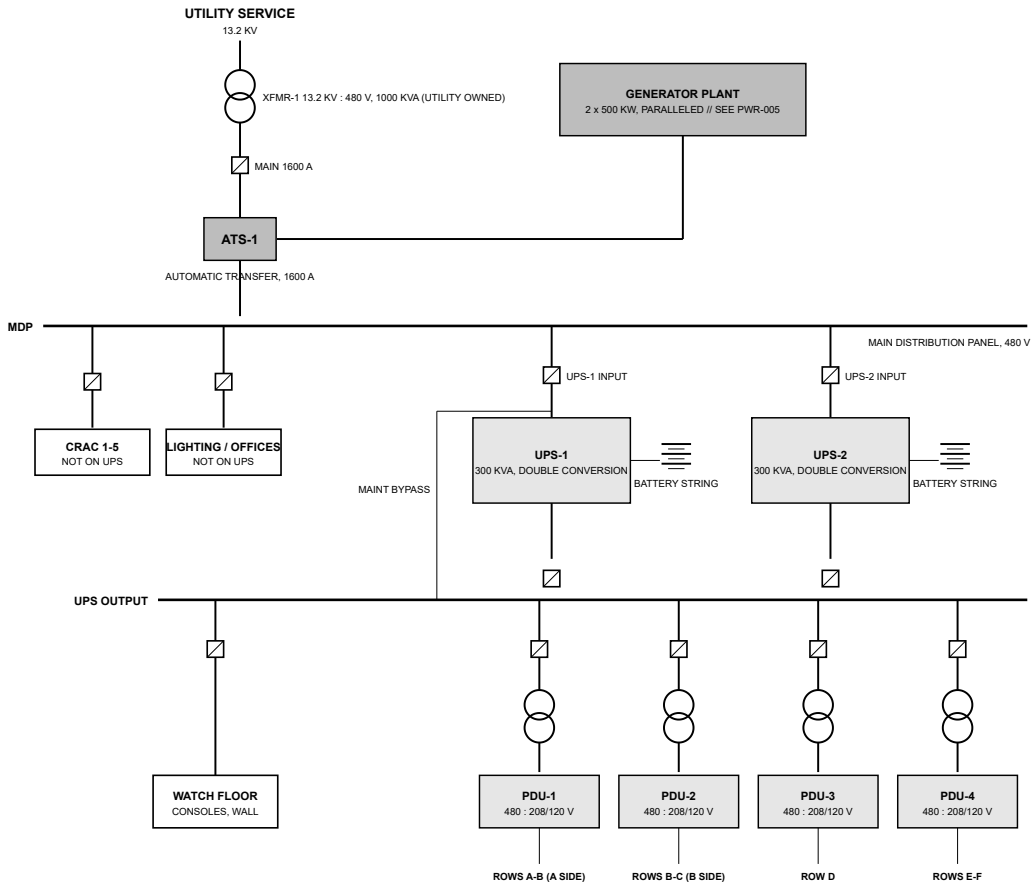


ONE-LINE DIAGRAM. NOT TO SCALE. CABLE SIZES PER PANEL SCHEDULES.

ONE-LINE DIAGRAM // SCALE: NONE

SUPERSEDED
SEE REGISTER FOR CURRENT REVISION

REVISIONS

REV	DATE	DESCRIPTION	BY	APPR
F	21 JUL 2008	Row E circuits.	JH	CD
E	16 MAY 2005	Second generator. Generator plant moved to PWR-005.		
D	09 AUG 2004	2 x 300 kVA UPS replace the 80 kVA units.		
C	04 OCT 1999	Generator fuel capacity raised. Load bank connection.		
B	30 JUN 1997	As built. Distribution circuits for rows A-C.		
A	03 SEP 1996	Initial issue. Utility feed, 500 kW diesel generator, automatic transfer switch, 2 x 80 kVA UPS.		

NOTES

1. Utility service 13.2 kV, transformer owned by the utility. Service entrance 480 V, 1600 A.
2. Generator plant and paralleling switchgear per PWR-005.
3. UPS: 2 x 300 KVA. Battery runtime at least 10 min at full load.
4. Cooling units, lighting and offices on generator-backed power, not on UPS.
5. Each cabinet fed from two PDUs (A and B side). Positions per FLR-001.
6. Emergency power off (EPO) at the machine room entry trips all UPS outputs and cooling.

LEGEND

- Generator
- Circuit breaker
- Transformer
- Bus
- Transfer switch / switchgear
- Future / provision only

OER // ENGINEERING

POWER ONE-LINE DIAGRAM, SITE A

DRAWING NO.	REV	SHEET
PWR-001	F	1 OF 1

DRAWN	CHECKED	APPROVED
J. HOLLOWAY	E. BROOKS	C. DOYLE

DATE	SERIES
21 JUL 2008	POWER

CONTROLLED DOCUMENT // CUSTODIAN: ENGINEERING / MAINTENANCE // DO NOT SCALE