REVISIONS


REV	DATE	DESCRIPTION	BY	APPR
A	23 AUG 1999	Initial issue. Generator, UPS and transfer switch for the alternate operations room.	MD	RS

NOTES

1. Service from the building landlord, 480 V.
2. Generator 100 KW diesel in an outdoor enclosure, belly tank about 24 h at full load.
3. UPS: 1 x 30 KVA. Runtime at least 15 min at full load.
4. Sized for the alternate operations room (SITE-B-001).
5. Generator run under load at each quarterly switchover drill (SITE-B-002).

LEGEND

- Generator
- Circuit breaker
- Transformer
- Bus
- Transfer switch / switchgear

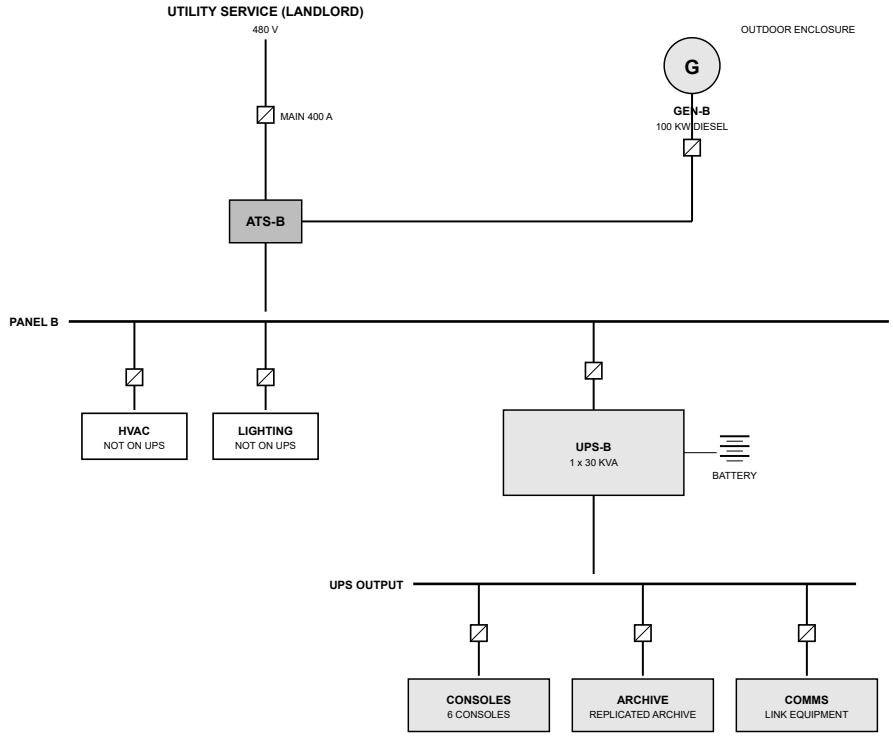

ONE-LINE DIAGRAM. NOT TO SCALE.

ONE-LINE DIAGRAM, SITE B // SCALE: NONE

SUPERSEDED
SEE REGISTER FOR CURRENT REVISION

OER // ENGINEERING

POWER ONE-LINE DIAGRAM, SITE B

DRAWING NO.	REV	SHEET
PWR-002	A	1 OF 1

DRAWN	CHECKED	APPROVED
M. DWYER	D. PORTER	R. SHAW

DATE	SERIES
23 AUG 1999	POWER

CONTROLLED DOCUMENT // CUSTODIAN: ENGINEERING / MAINTENANCE // DO NOT SCALE