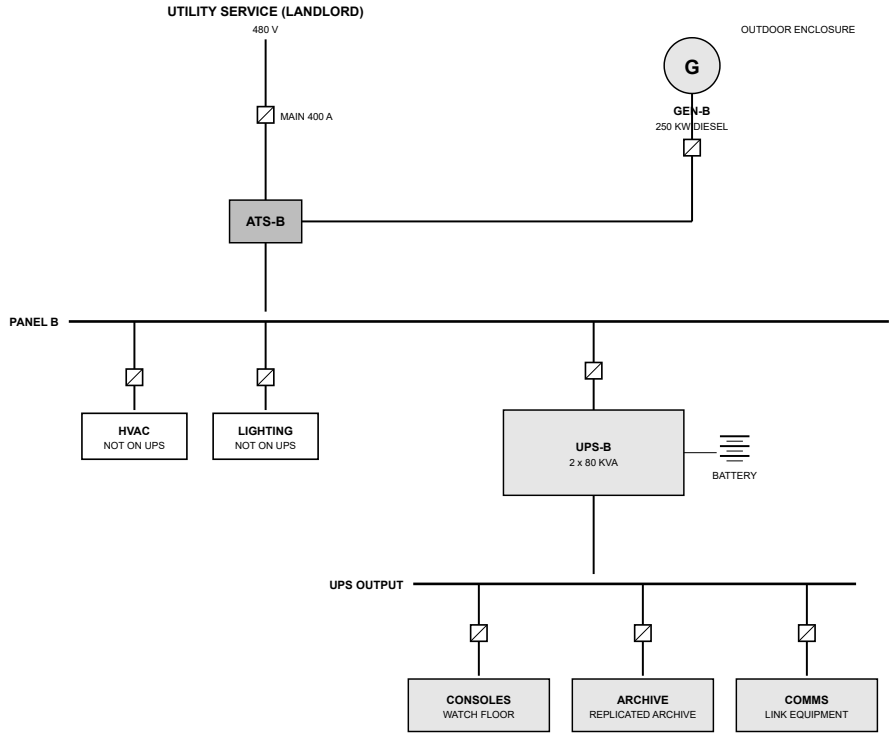


ONE-LINE DIAGRAM. NOT TO SCALE.

ONE-LINE DIAGRAM, SITE B // SCALE: NONE

SUPERSEDED
SEE REGISTER FOR CURRENT REVISION

REVISIONS

REV	DATE	DESCRIPTION	BY	APPR
C	17 SEP 2012	UPS replaced.	MC	MG
B	13 MAY 2002	Expanded for the full watch floor.		
A	23 AUG 1999	Initial issue. Generator, UPS and transfer switch for the alternate operations room.		

NOTES

1. Service from the building landlord, 480 V.
2. Generator 250 KW diesel in an outdoor enclosure, belly tank about 24 h at full load.
3. UPS: 2 x 80 KVA. Runtime at least 15 min at full load.
4. Sized for the full watch floor (SITE-B-001).
5. Generator run under load at each quarterly switchover drill (SITE-B-002).

LEGEND

- Generator
- Circuit breaker
- Transformer
- Bus
- Transfer switch / switchgear

OER // ENGINEERING

POWER ONE-LINE DIAGRAM, SITE B

DRAWING NO.	REV	SHEET
PWR-002	C	1 OF 1

DRAWN	CHECKED	APPROVED
M. CARTER	E. BROOKS	M. GRANT

DATE	SERIES
17 SEP 2012	POWER

CONTROLLED DOCUMENT // CUSTODIAN: ENGINEERING / MAINTENANCE // DO NOT SCALE