
REVISIONS

REV	DATE	DESCRIPTION	BY	APPR
B	04 APR 2011	Fuel polishing system. Provision for a third generator.	MC	MG
A	16 MAY 2005	Initial issue. Two generators, paralleling switchgear.		

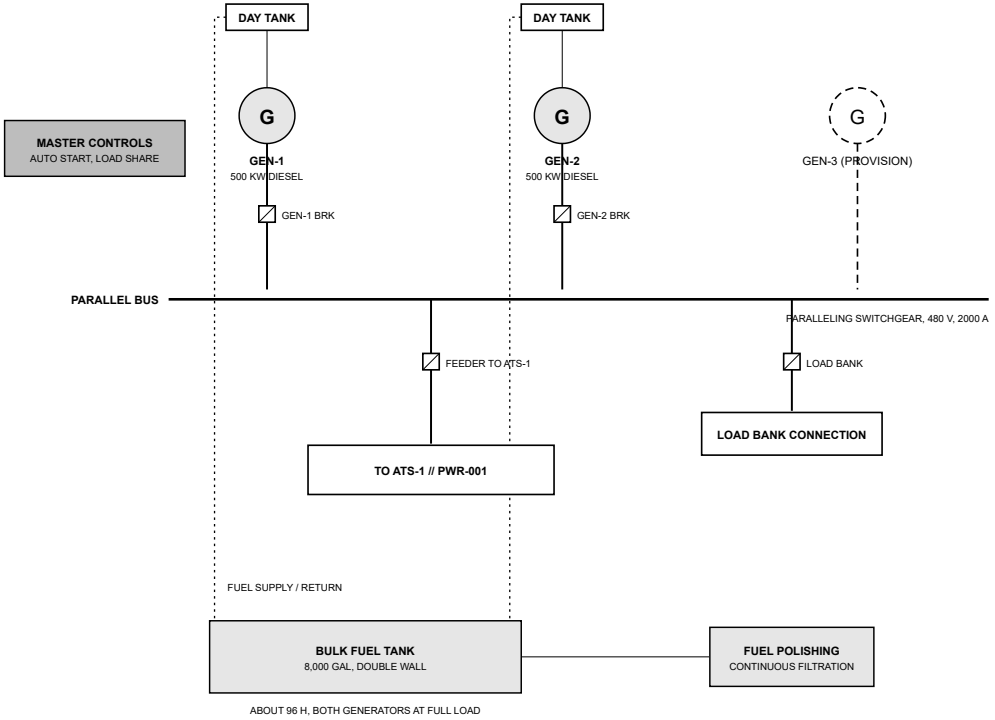

ONE-LINE DIAGRAM. NOT TO SCALE.

GENERATOR PLANT ONE-LINE // SCALE: NONE

SUPERSEDED
SEE REGISTER FOR CURRENT REVISION

NOTES

1. Two 500 kW diesel generators paralleled on a common bus. Either one carries the critical load.
2. Automatic start on loss of utility; both units sync and close to the bus, then feed ATS-1 (PWR-001).
3. Bulk tank 8,000 gal with day tanks at each generator.
4. Fuel polishing filters the bulk tank continuously.
5. Bus, breaker space and foundation provided for a third generator (GEN-3, not installed).
6. Monthly run under load; annual load bank test at the load bank connection.

LEGEND

- Generator
- Circuit breaker
- Transformer
- Bus
- Transfer switch / switchgear
- Future / provision only

OER // ENGINEERING

GENERATOR PLANT AND PARALLELING SWITCHGEAR, SITE A

DRAWING NO.	REV	SHEET
PWR-005	B	1 OF 1

DRAWN	CHECKED	APPROVED
M. CARTER	E. BROOKS	M. GRANT

DATE	SERIES
04 APR 2011	POWER

CONTROLLED DOCUMENT // CUSTODIAN: ENGINEERING / MAINTENANCE // DO NOT SCALE