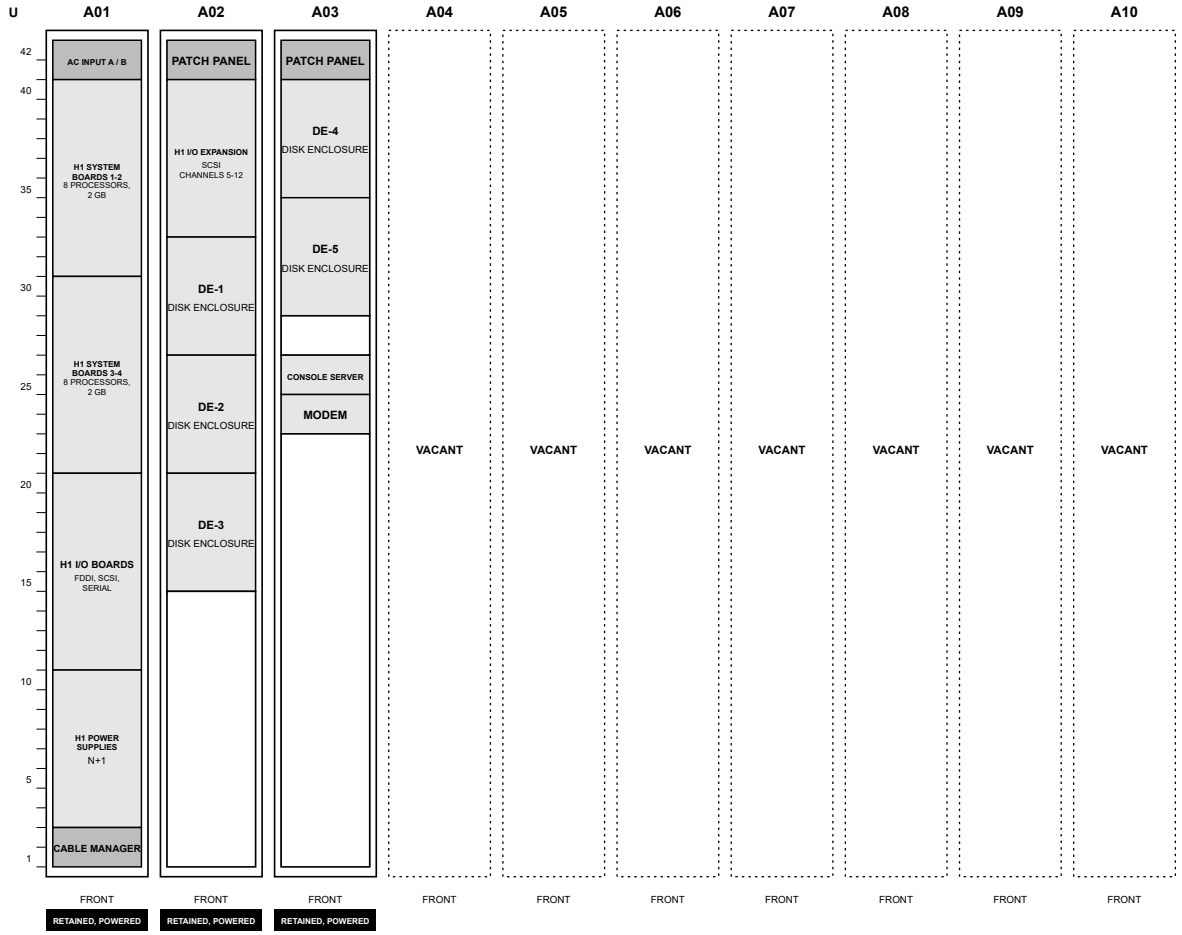


FRONT ELEVATIONS, ROW A // SCALE: NONE

SUPERSEDED
SEE REGISTER FOR CURRENT REVISION

REVISIONS

REV	DATE	DESCRIPTION	BY	APPR
E	15 JUL 2013	Database on the flash tier. A08-A10 removed. A01-A03 retained, powered.	MC	MG
D	24 APR 2006	A04-A07 removed. A01-A03 retained, powered.		
C	15 JAN 2001	A08-A10: second central host generation, 32 processors, 32 GB. A01-A03 retained, powered.		
B	16 MAR 1998	A04-A07: central host pair, primary and standby, 24 processors, 8 GB each. A01-A03 retained, powered.		
A	03 JUL 1997	Initial issue. A01-A03: central host, 16 processors, 4 GB, with disk enclosures.		

NOTES

1. Cabinets 42U, 24 in wide x 42 in deep, front view. Positions per FLR-001.
2. A01-A03: original central host H1, retained, powered.
3. Each cabinet fed from two power distribution units (A and B side). See PWR-001.
4. Blank panels in all empty spaces (airflow).
5. Cabinet fronts face the cold aisle.

LEGEND

- Installed equipment
- Power / cabling / switching
- Blank panel
- Vacant position

OER // ENGINEERING

RACK ELEVATIONS, ROW A (CENTRAL HOSTS)

DRAWING NO.	REV	SHEET
RCK-01	E	1 OF 1

DRAWN	CHECKED	APPROVED
M. CARTER	M. TURNER	M. GRANT

DATE	SERIES
15 JUL 2013	RACKS

CONTROLLED DOCUMENT // CUSTODIAN: ENGINEERING / MAINTENANCE // DO NOT SCALE