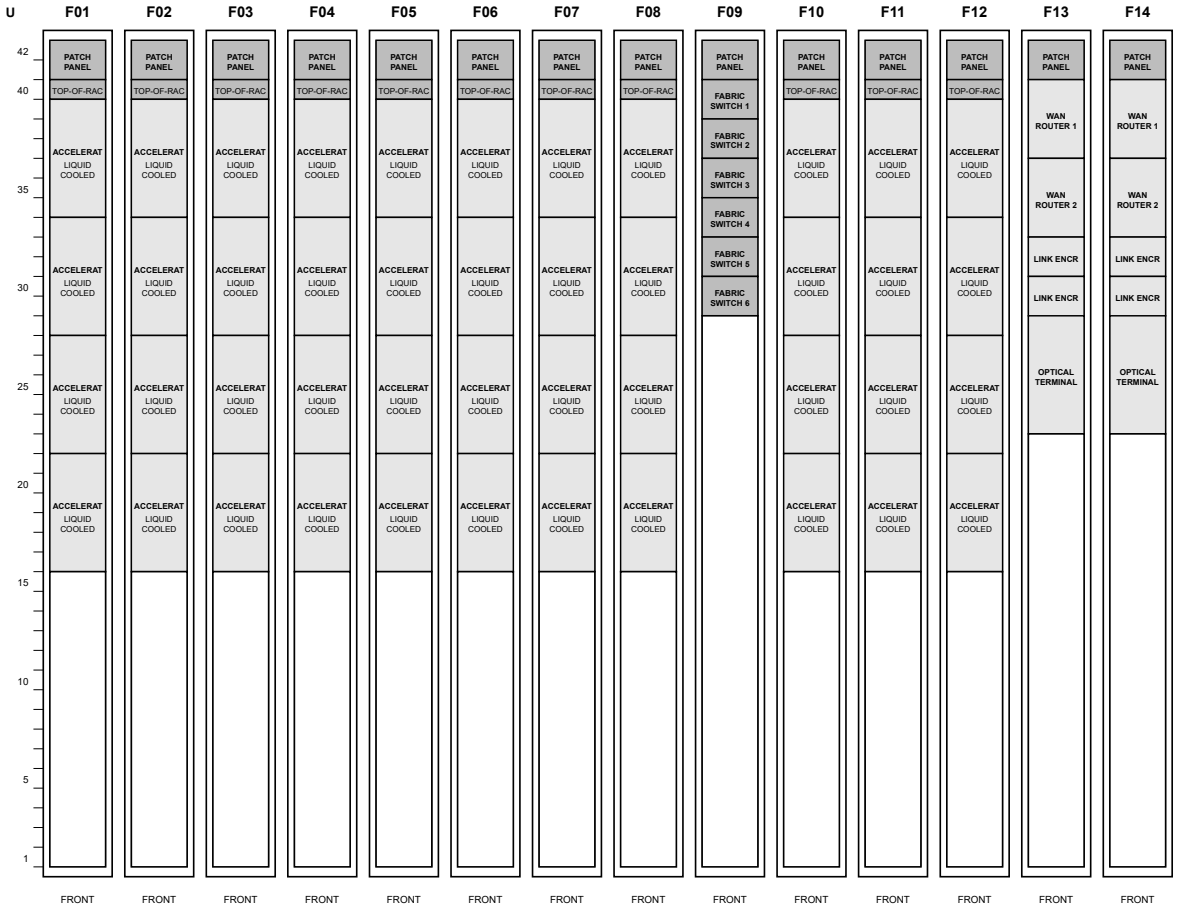


FRONT ELEVATIONS, ROW F // SCALE: NONE

REVISIONS

REV	DATE	DESCRIPTION	BY	APPR
B	03 JUN 2024	Row extended. Current-generation accelerators. WAN equipment from row C.	SW	AC
A	24 FEB 2020	Initial issue. Accelerator nodes.		

NOTES

1. Cabinets 42U, 24 in wide x 42 in deep, front view. Positions per FLR-001.
2. Accelerator nodes liquid cooled from CDU-1 / CDU-2, see MEC-001.
3. Each cabinet fed from two power distribution units (A and B side). See PWR-001.
4. Blank panels in all empty spaces (airflow).
5. Cabinet fronts face the cold aisle.

LEGEND

- Installed equipment
- Power / cabling / switching
- Blank panel
- Vacant position

OER // ENGINEERING

RACK ELEVATIONS, ROW F (ACCELERATORS)

DRAWING NO.	REV	SHEET
RCK-06	B	1 OF 1

DRAWN	CHECKED	APPROVED
S. WALSH	C. NGUYEN	A. COLE

DATE	SERIES
03 JUN 2024	RACKS

CONTROLLED DOCUMENT // CUSTODIAN: ENGINEERING / MAINTENANCE // DO NOT SCALE