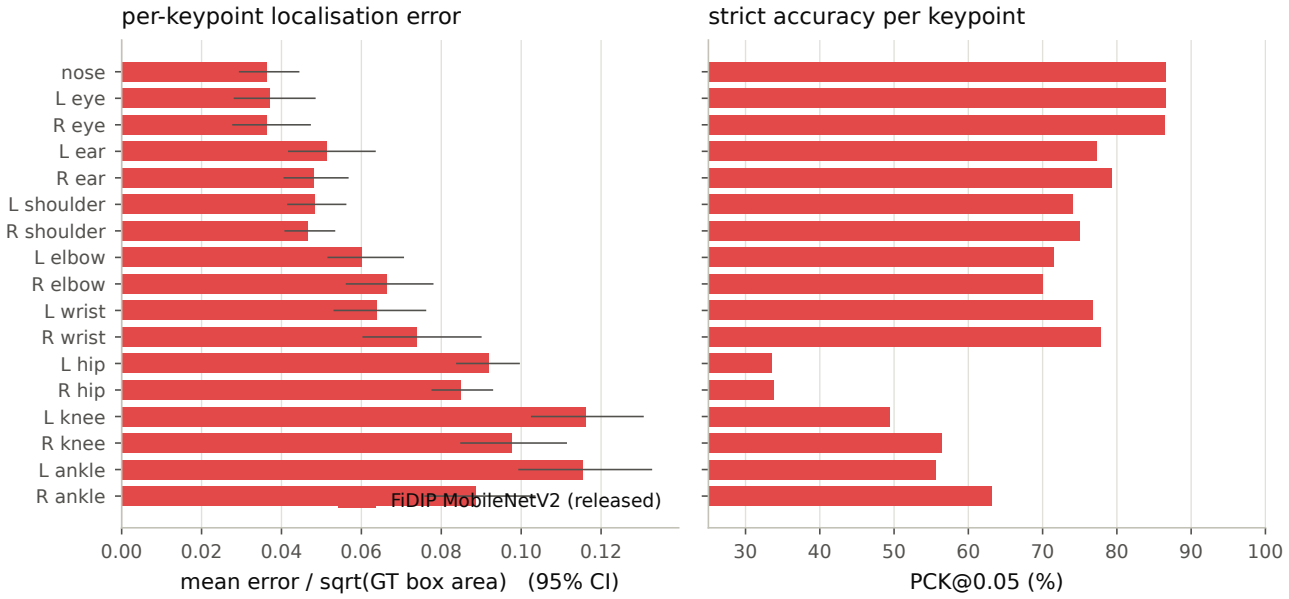
per-keypoint localisation error
nose
L eye
R eye
L ear
R ear
L shoulder
R shoulder
L elbow
R elbow
L wrist
R wrist
L hip
R hip
L knee
R knee
L ankle
R ankle
FiDIP MobileNetV2 (released)
0.00
0.02
0.04
0.06
0.08
0.10
0.12
mean error / sqrt(GT box area) (95% CI)
strict accuracy per keypoint
30
40
50
60
70
80
90
100
PCK@0.05 (%)