

Report No.:XFL300TW-2800K

Test Time: 2025-04-10 17:12

Luminaire Property

Luminaire Manufacturer: LUXIBEL

Voltage: 219.6 V

Power: 269.20 W

Current: 1.250 A

Power Factor: 0.981

Photometric Results

CIE Class: Direct

Measurement Flux: 20109.7 lm

Downward Ratio: 100%

Horizontal Diffuse Angle(10%,50%,80%,100%): H117.8,H49,H24.4,H0

Vertical Diffuse Angle(10%,50%,80%,100%): V118.2,V48.9,V24.8,V1

Luminaire Efficacy Rating (LER): 74.75

Max. Intensity: 18691.41 cd

S/MH(C0/C180): 0.72

Total Rated Lamp Lumens: 20109.7 lm

Efficiency: 100%

Upward Ratio: 0%

Central Intensity: 18634.8 cd


Pos of Max. Intensity: H90 V1

S/MH(C90/C270): 0.72

Picture Of Luminaire



Luminous Intensity Distribution Curve

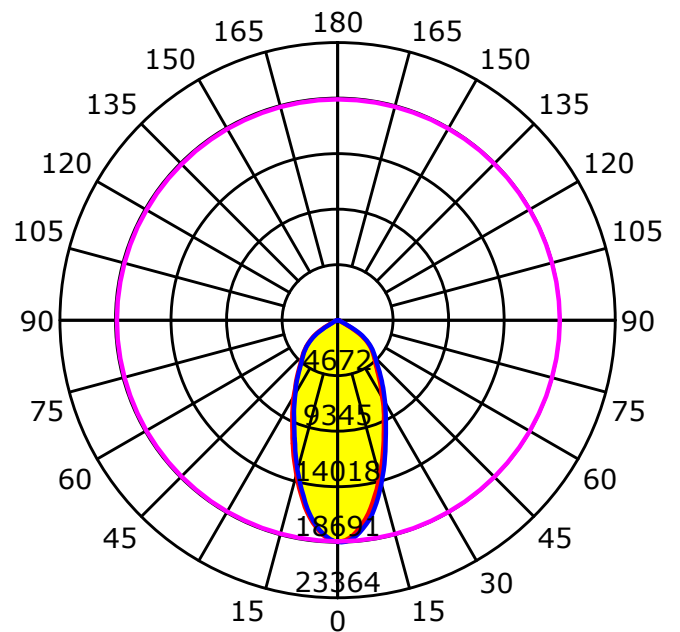

Unit: cd

Average Diffuse Angle(50%): 48.9°

— C0-C180 — C90-C270 — G1

C Plane (°):0.0-360.0: 90.0

Test Lab: BTL

Test Type: TYPE C

Temperature:

Operator:Honor.Ch in

Gamma Plane (°):0.0-180.0:1.0



Test Device: GPM-1600L

Distance: 8.443 m

Humidity:

Inspector: C


Luminous Intensity Distribution Curve

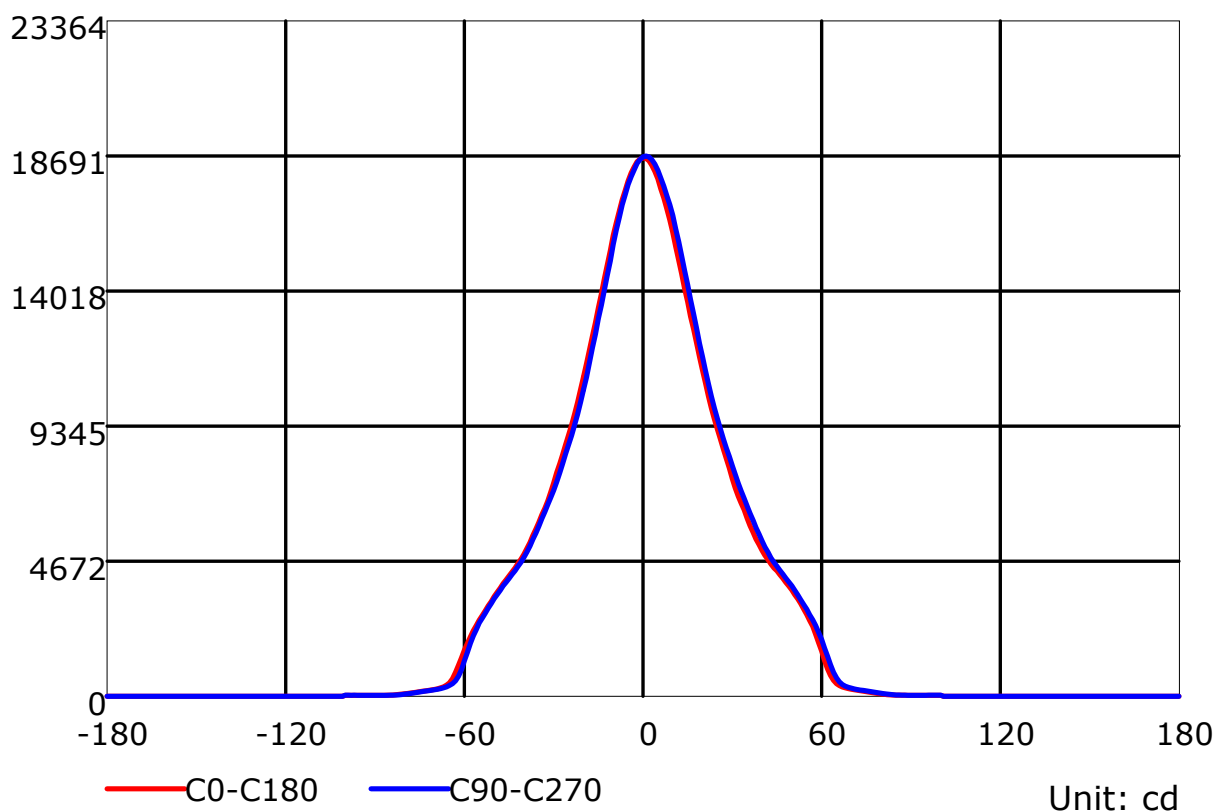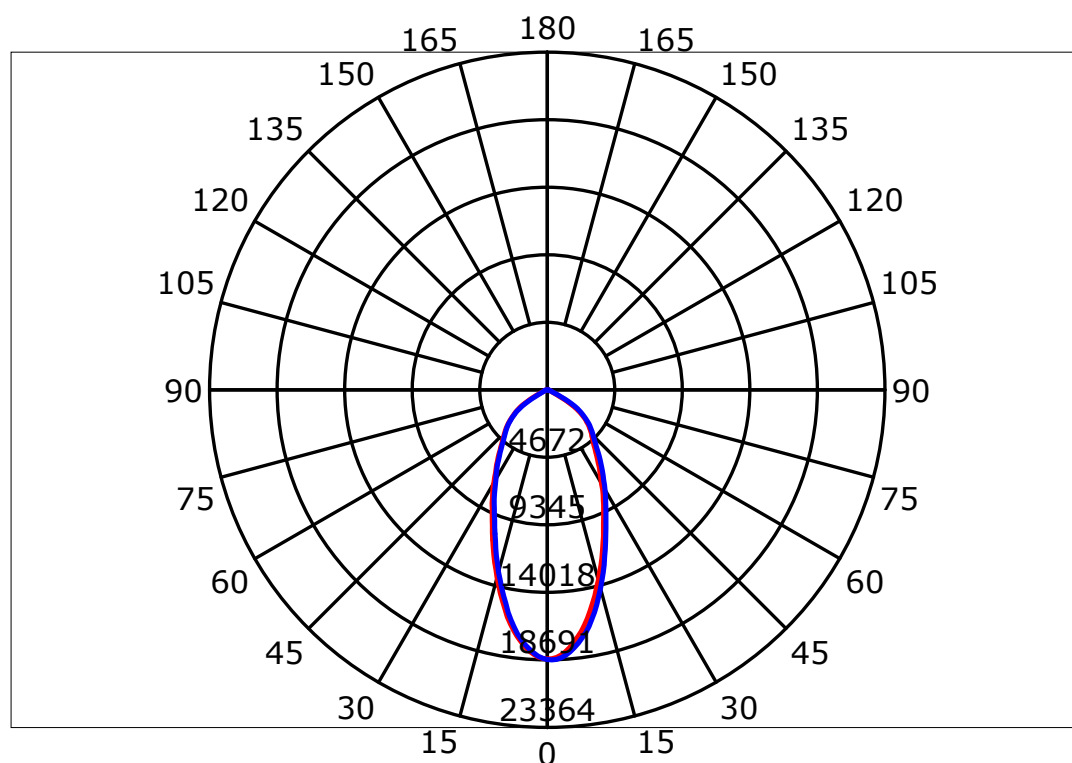

C Plane (°):0.0-360.0: 90.0
 Test Lab: BTL
 Test Type: TYPE C
 Temperature:
 Operator: Honor Chen

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1600L
 Distance: 8.443 m
 Humidity:
 Inspector: C

Luminous Intensity Distribution Curve(cd/klm)

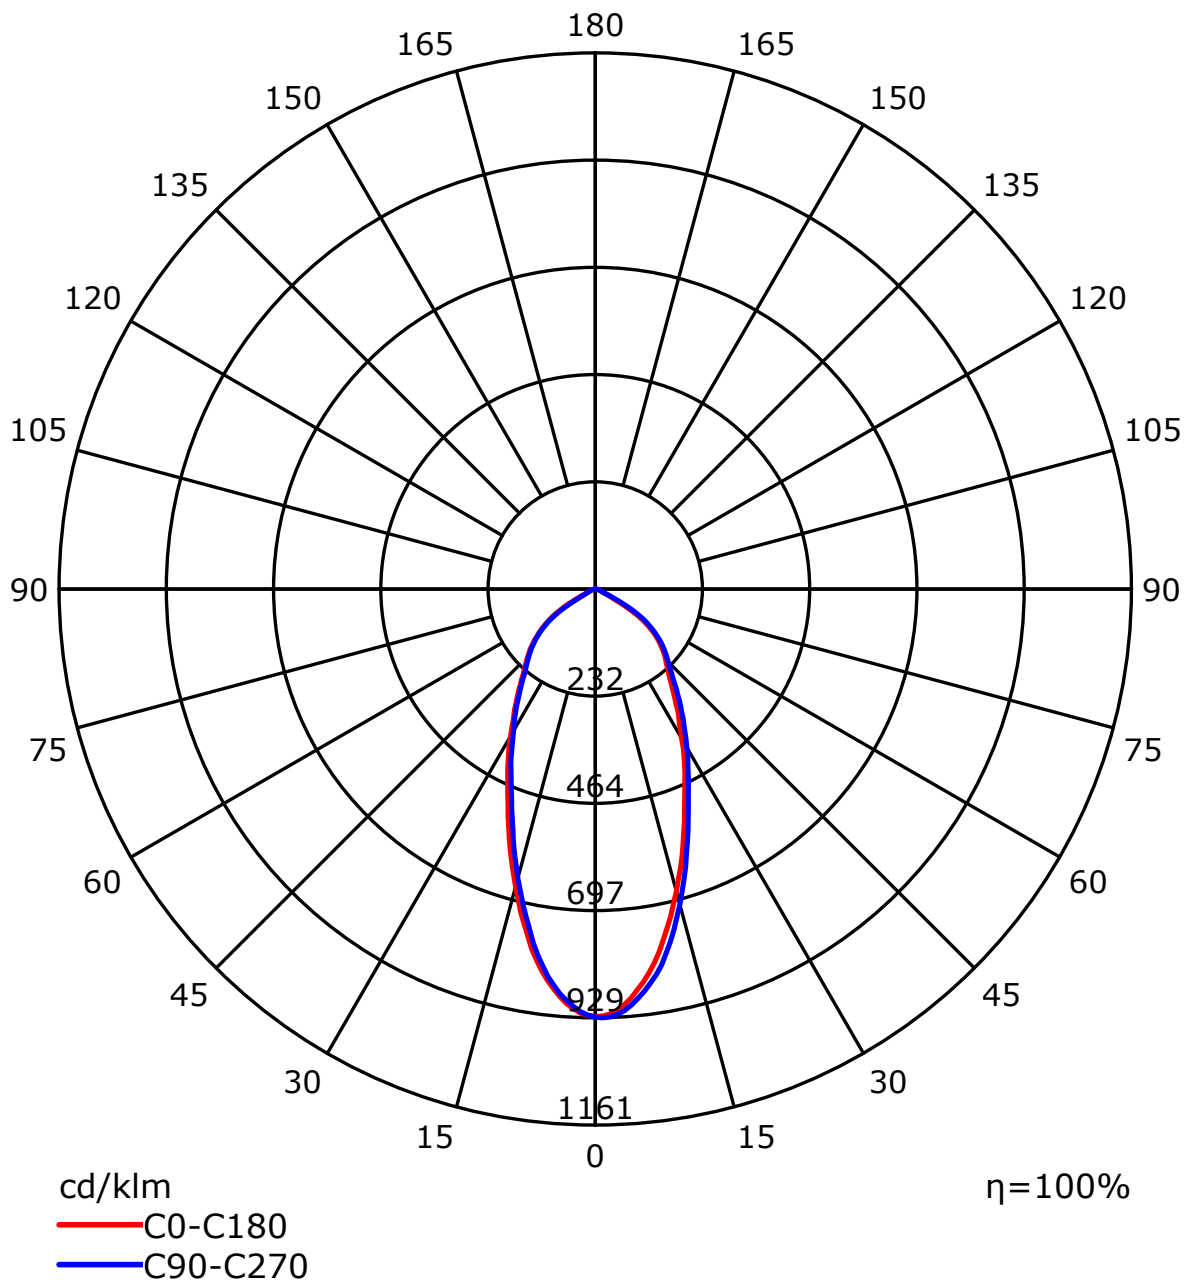


C Plane (°):0.0-360.0: 90.0
 Test Lab: BTL
 Test Type: TYPE C
 Temperature:
 Operator: Honor Chen

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1600L
 Distance: 8.443 m
 Humidity:
 Inspector: C

Coefficients Of Utilization - Zonal Cavity Method

RC	0.8	0.8	0.8	0.8	0.7	0.7	0.7	0.7	0.5	0.5	0.5	0.3	0.3	0.3	0.1	0.1	0.1	0
RW	0.7	0.5	0.3	0.1	0.7	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0
RCR	RF = 0.2																	
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	112	108	105	103	109	106	103	101	102	100	98	98	96	95	95	93	92	90
2	105	98	93	89	102	97	92	88	93	89	86	90	87	84	87	85	82	81
3	98	89	83	78	95	88	82	78	85	80	76	83	79	75	80	77	74	72
4	91	82	75	70	89	80	74	69	78	73	68	76	71	67	74	70	66	65
5	85	75	68	62	83	74	67	62	72	66	61	70	65	61	68	64	60	58
6	80	69	62	56	78	68	61	56	66	60	56	65	59	55	63	59	55	53
7	75	64	56	51	73	63	56	51	62	55	51	60	55	51	59	54	50	49
8	71	59	52	47	69	59	52	47	57	51	47	56	51	46	55	50	46	45
9	67	55	48	43	65	55	48	43	54	47	43	53	47	43	52	47	43	41
10	63	52	45	40	62	51	45	40	50	44	40	49	44	40	49	44	40	38


Spacing Criteria (0-180): 0.72
 Spacing Criteria (90-270): 0.72
 Spacing Criteria (Diagonal): 0.84

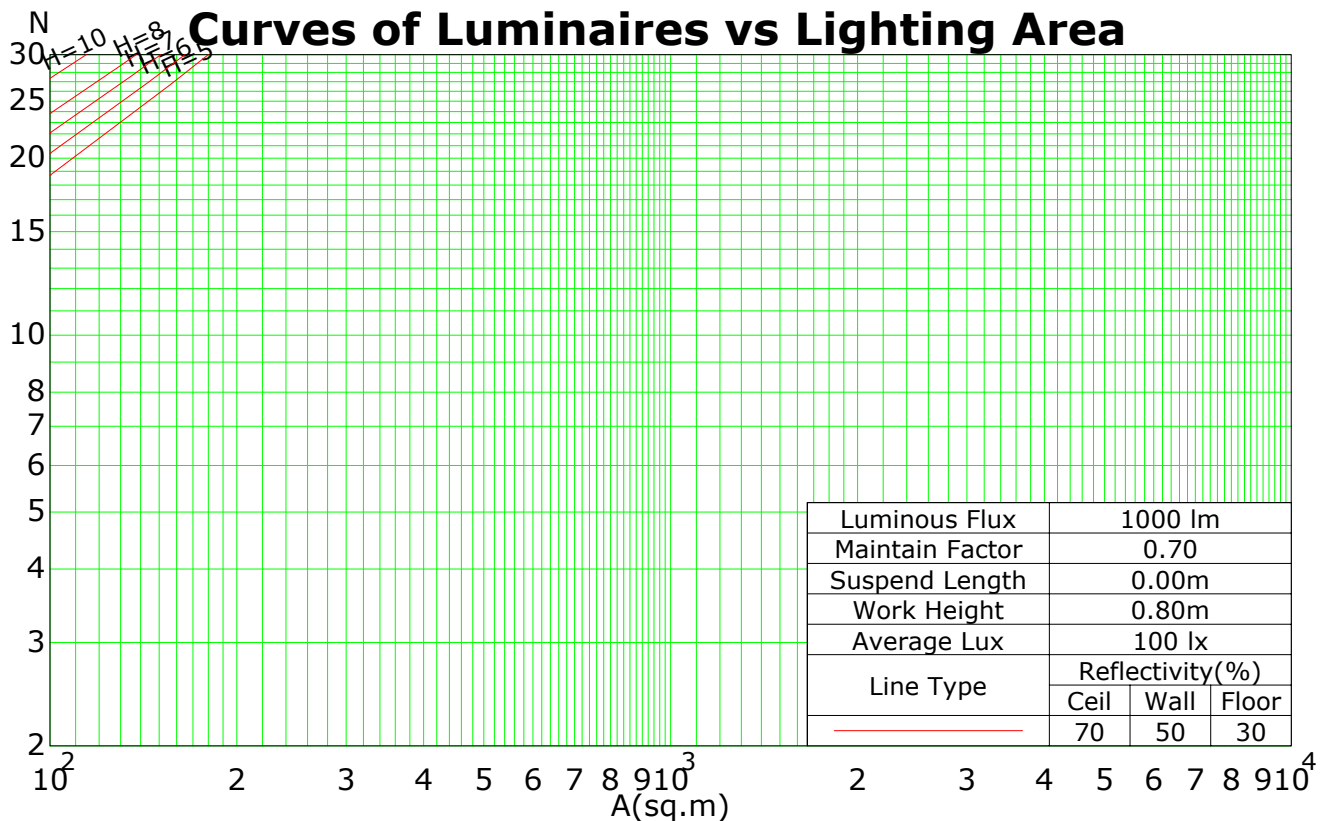

C Plane (°):0.0-360.0: 90.0
 Test Lab: BTL
 Test Type: TYPE C
 Temperature:
 Operator: Honor Chen

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1600L
 Distance: 8.443 m
 Humidity:
 Inspector: C

Isocandela (rectangle)

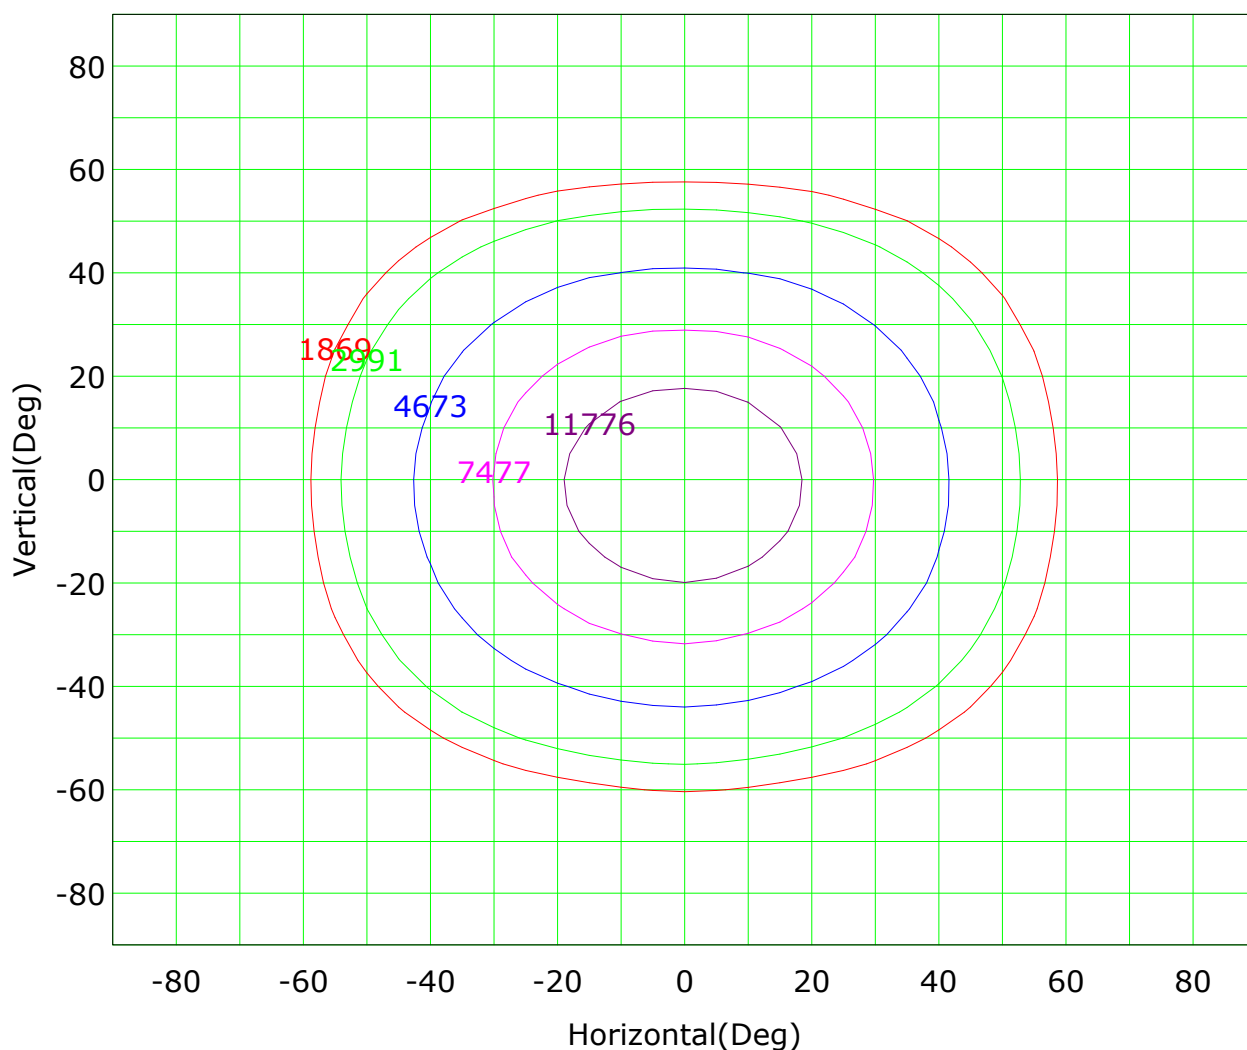


Imax (100%): 18691 cd

(10%): 1869 cd	(16%): 2991 cd
(25%): 4673 cd	(40%): 7477 cd
(63%): 11776 cd	(100%): 18691 cd

C Plane (°):0.0-360.0: 90.0
 Test Lab:BTL
 Test Type: TYPE C
 Temperature:
 Operator:Honor Chen

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1600L
 Distance: 8.443 m
 Humidity:
 Inspector: C

Isocandela (sphere)

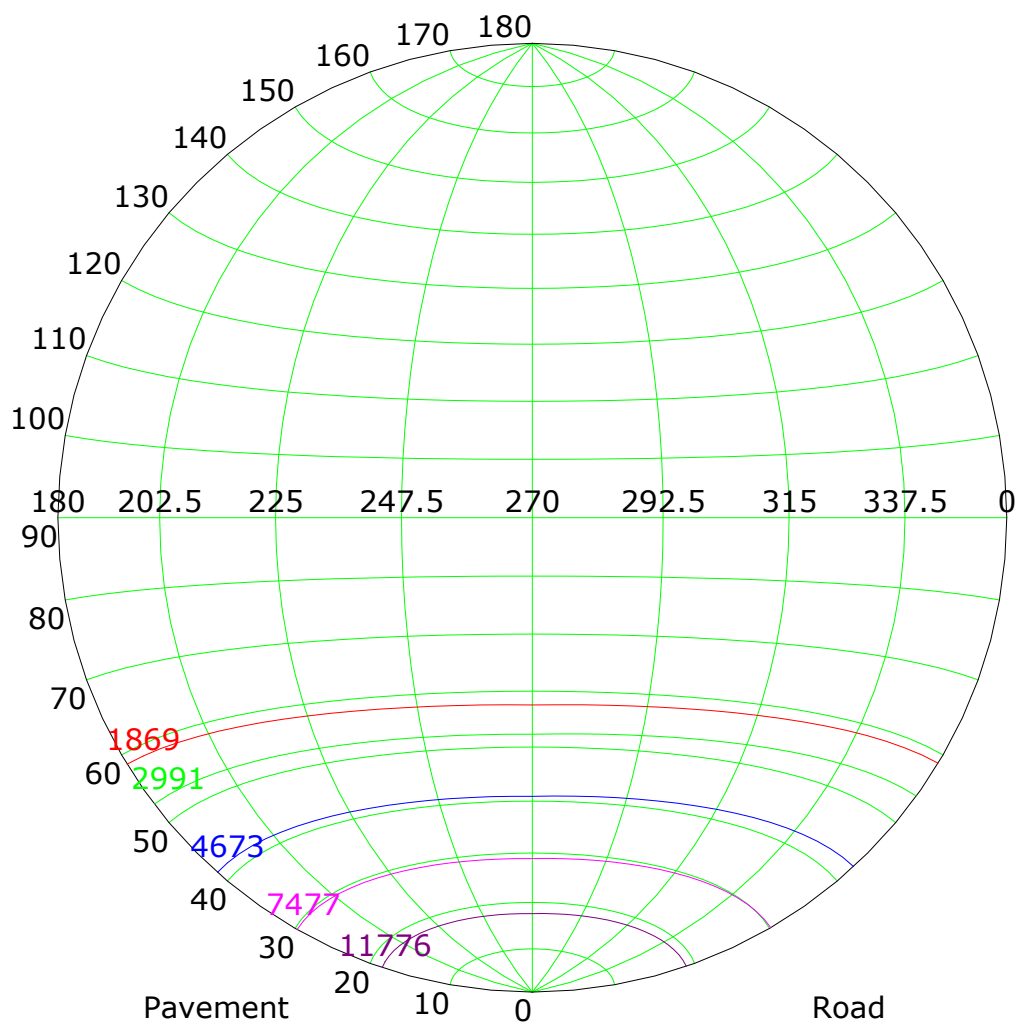


Imax (100%): 18691 cd

(10%): 1869 cd	(16%): 2991 cd
(25%): 4673 cd	(40%): 7477 cd
(63%): 11776 cd	(100%): 18691 cd

C Plane (°):0.0-360.0: 90.0
 Test Lab:BTL
 Test Type: TYPE C
 Temperature:
 Operator:Honor Chen

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1600L
 Distance: 8.443 m
 Humidity:
 Inspector: C

IsoLux Plot

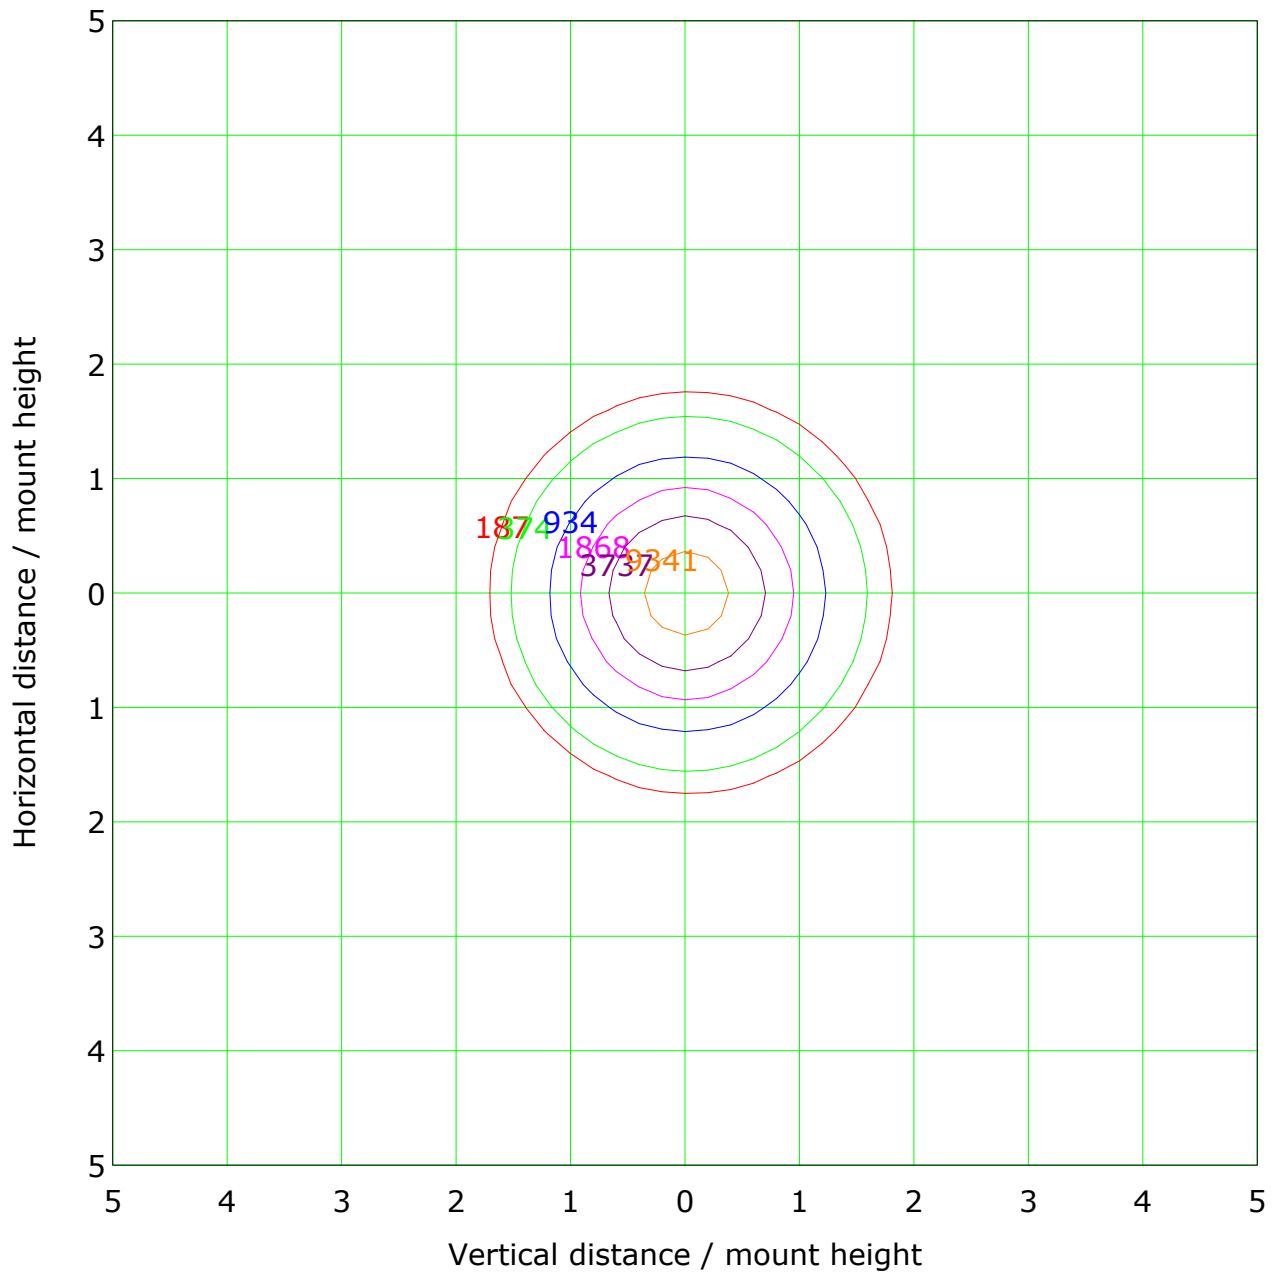

Mounting Height: 1.0m Max Lux(100%): 18682.9 lx


(1%): 186.8 lx	(2%): 373.7 lx
(5%): 934.1 lx	(10%): 1868.3 lx
(20%): 3736.6 lx	(50%): 9341.4 lx
(100%): 18682.9 lx	

C Plane (°): 0.0-360.0: 90.0
 Test Lab: BTL
 Test Type: TYPE C
 Temperature:
 Operator: Honor Chen

Gamma Plane (°): 0.0-180.0: 1.0
 Test Device: GPM-1600L
 Distance: 8.443 m
 Humidity:
 Inspector: C

Roadway CU Curve

Efficiency(%)


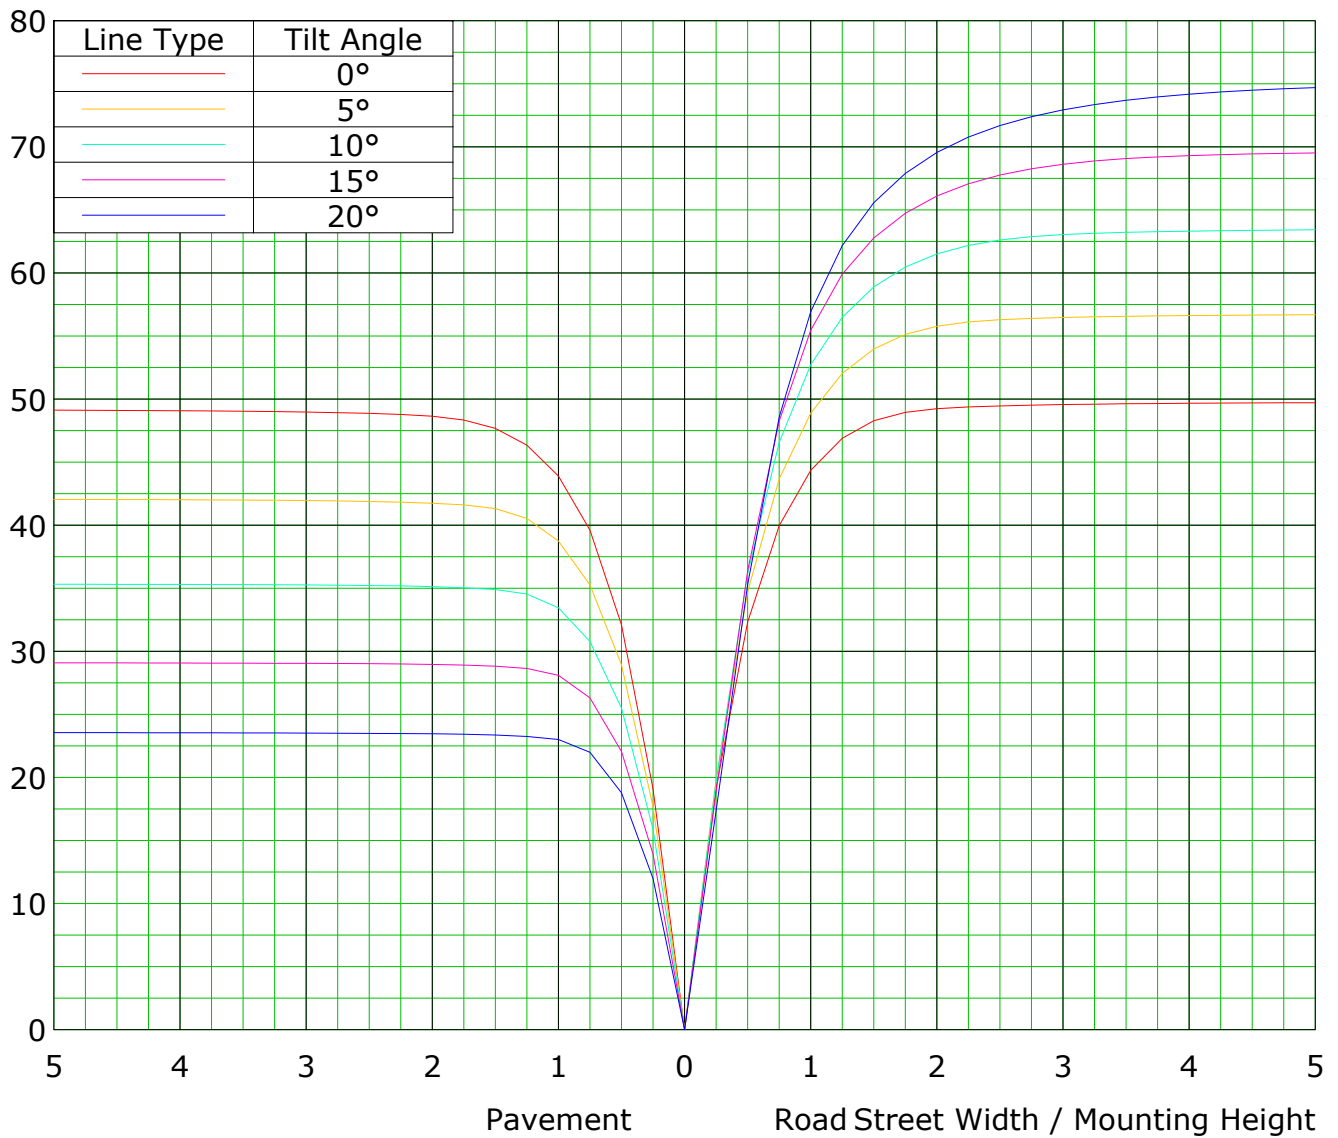


C Plane (°):0.0-360.0: 90.0
 Test Lab:BTL
 Test Type: TYPE C
 Temperature:
 Operator:Honor Chen

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1600L
 Distance: 8.443 m
 Humidity:
 Inspector: C

Lum Limit Curve

Dazzle	Quality	Illuminance (lx)							
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

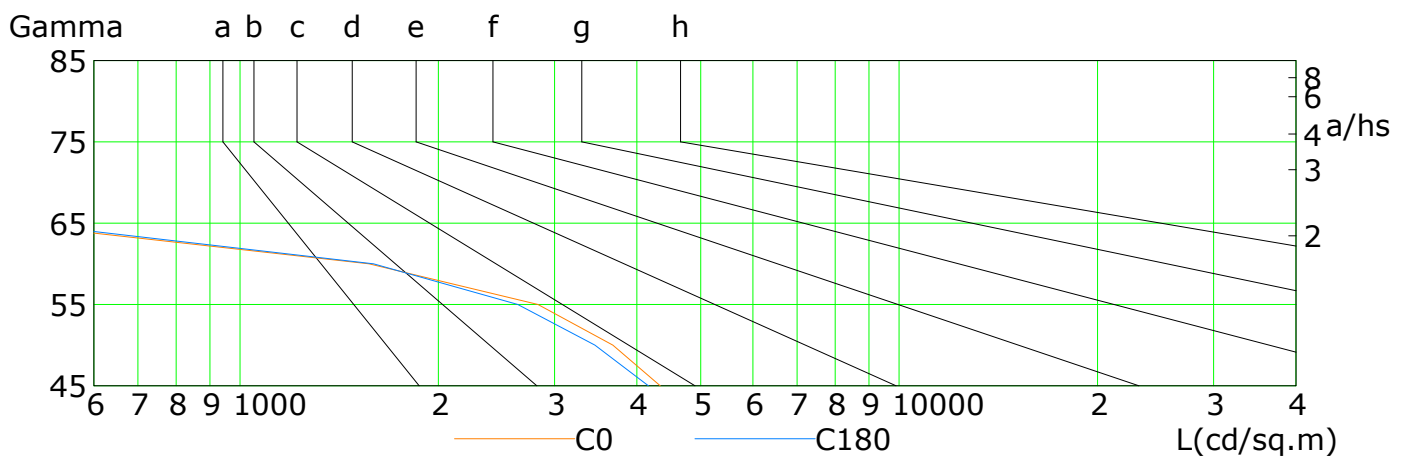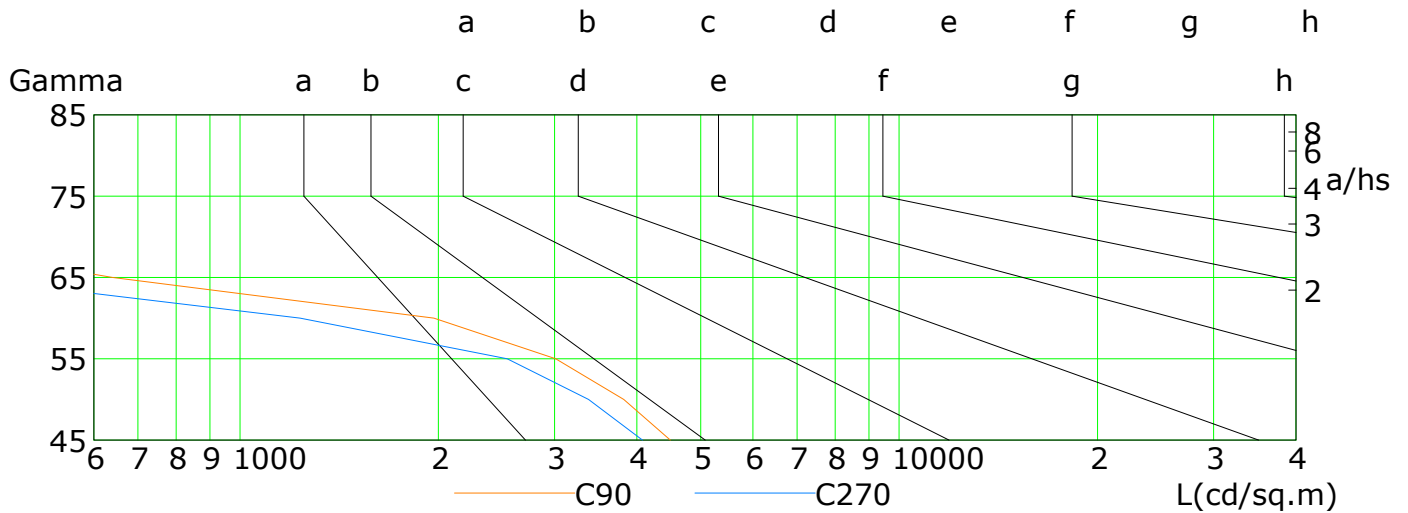


L(cd/sq.m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	4342	3678	2831	1569	442	246	161	85	43
C90	4497	3821	3012	1969	641	285	189	107	50
C180	4164	3454	2638	1595	467	242	162	90	42
C270	4078	3378	2543	1234	377	227	151	78	39

C Plane (°):0.0-360.0: 90.0
 Test Lab:BTL
 Test Type: TYPE C
 Temperature:
 Operator:Honor Chen

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1600L
 Distance: 8.443 m
 Humidity:
 Inspector: C


Illuminance at a Distance

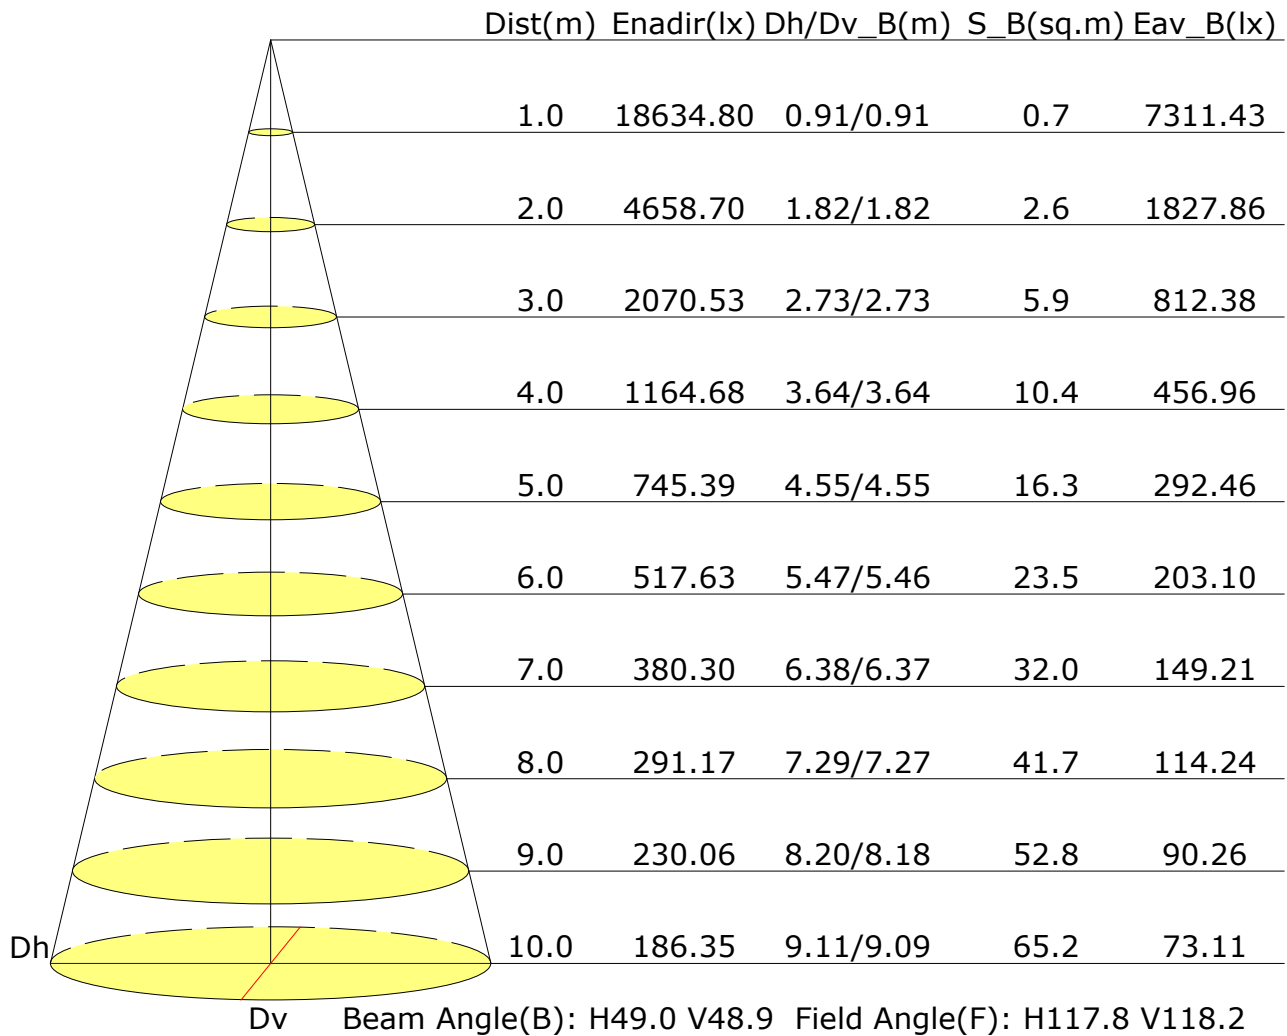

C Plane (°):0.0-360.0: 90.0
 Test Lab: BTL
 Test Type: TYPE C
 Temperature:
 Operator: Honor Chen

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1600L
 Distance: 8.443 m
 Humidity:
 Inspector: C

Vertical IsoLux Plot

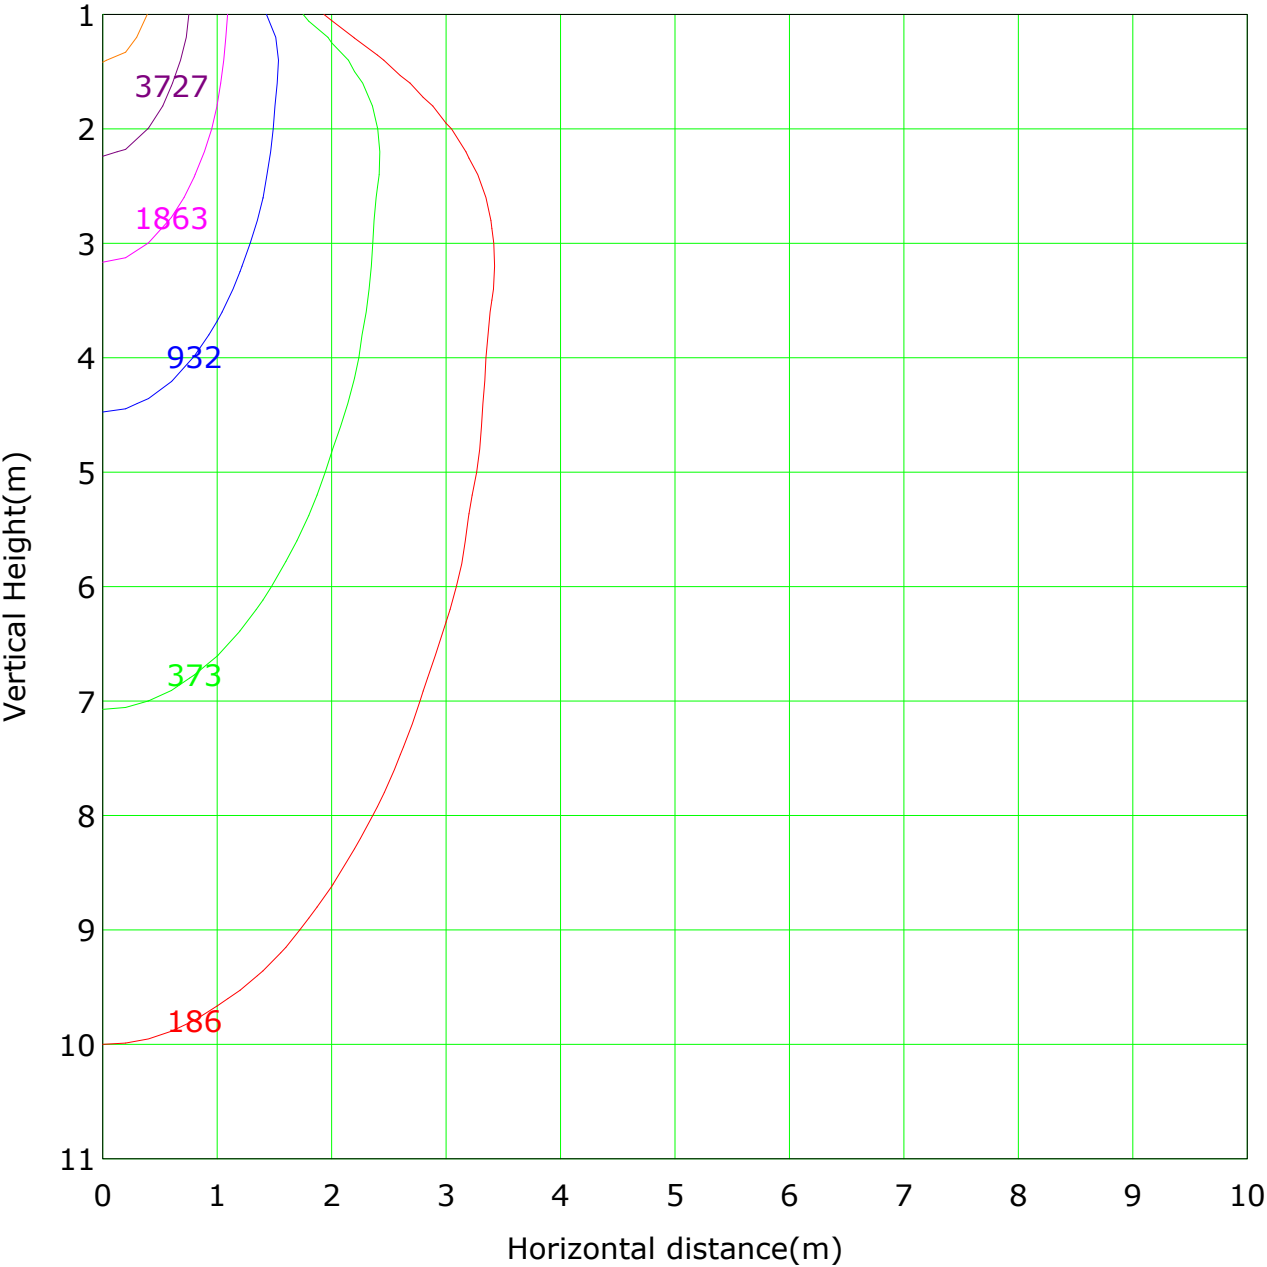

Lowest(m): 1.0m Highest(m): 11.0m Max Lux: 18634.8 lx

(1%): 186.3 lx	(2%): 372.7 lx
(5%): 931.7 lx	(10%):1863.5 lx
(20%):3727.0 lx	(50%):9317.4 lx
(100%):18634.8 lx	

C Plane (°):0.0-360.0: 90.0
Test Lab:BTL
Test Type: TYPE C
Temperature:
Operator:Honor Chen

Gamma Plane (°):0.0-180.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector: C

Area Flux Table

Unit: lm

-90	0.1	0.3	0.5	0.7	0.9	1.1	1.2	1.3	1.4	1.4	1.3	1.2	1.1	0.9	0.7	0.5	0.3	0.1	14.8	0.0
-80	0.1	0.3	0.7	1.2	2.0	2.9	3.7	4.3	4.6	4.6	4.3	3.7	2.8	2.0	1.2	0.6	0.3	0.1	39.3	0.0
-70	0.1	0.4	1.2	2.5	4.2	6.3	9.1	12.4	14.6	14.5	12.2	8.9	6.3	4.2	2.5	1.2	0.4	0.1	101.1	0.0
-60	0.1	0.6	1.9	4.0	9.1	24.5	46.2	64.0	73.2	73.5	64.8	46.7	24.0	8.8	4.1	1.9	0.6	0.1	448.0	292.0
-50	0.1	0.8	2.6	7.8	31.4	65.1	92.5	112.3	122.7	123.1	113.5	94.7	67.4	31.4	7.4	2.6	0.8	0.1	876.2	812.5
-40	0.1	1.0	3.4	19.0	56.8	92.7	125.6	156.8	176.9	177.3	157.9	127.3	95.5	59.5	18.4	3.4	1.0	0.1	1272.9	229.5
-30	0.1	1.2	4.9	32.1	73.1	114.3	166.2	222.2	260.3	261.0	224.4	168.3	116.6	76.6	32.9	4.7	1.2	0.1	1760.4	726.7
-20	0.2	1.3	7.0	40.9	83.6	134.9	211.4	304.7	382.6	383.9	308.0	214.6	137.4	87.0	43.0	6.5	1.3	0.1	2348.8	320.2
-10	0.2	1.3	8.6	45.2	89.2	148.8	244.4	378.4	505.3	506.7	383.3	249.1	152.0	92.6	48.0	8.0	1.3	0.1	2862.0	836.7
0	0.2	1.3	8.7	45.5	89.7	150.1	247.4	385.3	516.6	518.0	390.2	252.1	153.3	93.1	48.4	8.1	1.3	0.1	2909.2	884.4
10	0.2	1.3	7.3	42.0	85.1	138.4	218.8	319.9	410.5	411.8	323.2	222.0	141.0	88.5	44.1	6.9	1.3	0.1	2462.2	433.9
20	0.1	1.2	5.2	34.1	75.5	118.6	175.2	238.2	284.6	285.3	240.1	177.3	120.9	79.0	34.8	5.0	1.2	0.1	1876.4	843.8
30	0.1	1.0	3.6	21.4	60.4	97.4	133.4	170.0	195.5	195.9	171.0	135.1	100.2	63.1	20.9	3.6	1.0	0.1	1373.8	333.4
40	0.1	0.8	2.7	9.1	36.7	71.4	100.1	122.0	135.1	135.5	123.3	102.3	73.7	36.7	8.7	2.7	0.8	0.1	961.9	903.0
50	0.1	0.6	2.0	4.3	11.4	32.1	57.6	77.2	88.2	88.5	78.0	58.0	31.6	11.1	4.4	2.0	0.6	0.1	547.9	428.3
60	0.1	0.4	1.3	2.8	4.6	7.4	12.3	19.1	24.2	24.1	18.9	12.2	7.4	4.7	2.7	1.3	0.4	0.1	144.1	0.0
70	0.1	0.3	0.7	1.4	2.3	3.4	4.4	5.2	5.7	5.7	5.2	4.4	3.3	2.3	1.4	0.7	0.3	0.1	46.8	0.0
80	0.1	0.3	0.5	0.7	0.9	1.2	1.4	1.6	1.8	1.8	1.6	1.4	1.2	1.0	0.7	0.5	0.3	0.1	17.2	0.0
90	2.2	14.6	62.8	314.7	717.3	210.2	285.1	459.5	820.3	621.2	762.1	387.9	323.5	574.2	332.4	60.2	14.4	2.2	2006.4	
Flux(T)	0.0	0.0	0.0	210.0	643.0	1142.1	1786.2	2531.2	3141.8	3151.0	2558.1	1815.6	169.0	671.8	224.8	0.0	0.0	0.0		1904.5
Flux(E)	0.0	0.0	0.0	210.0	643.0	1142.1	1786.2	2531.2	3141.8	3151.0	2558.1	1815.6	169.0	671.8	224.8	0.0	0.0	0.0		1904.5


Horizontal plane

C Plane (°):0.0-360.0: 90.0
Test Lab:BTL
Test Type: TYPE C
Temperature:
Operator:Honor Chen

Gamma Plane (°):0.0-180.0:1.0
Test Device: GPM-1600L
Distance: 8.443 m
Humidity:
Inspector: C

The Average Illuminance Effective Figure

Flux Out: 15216.82lm

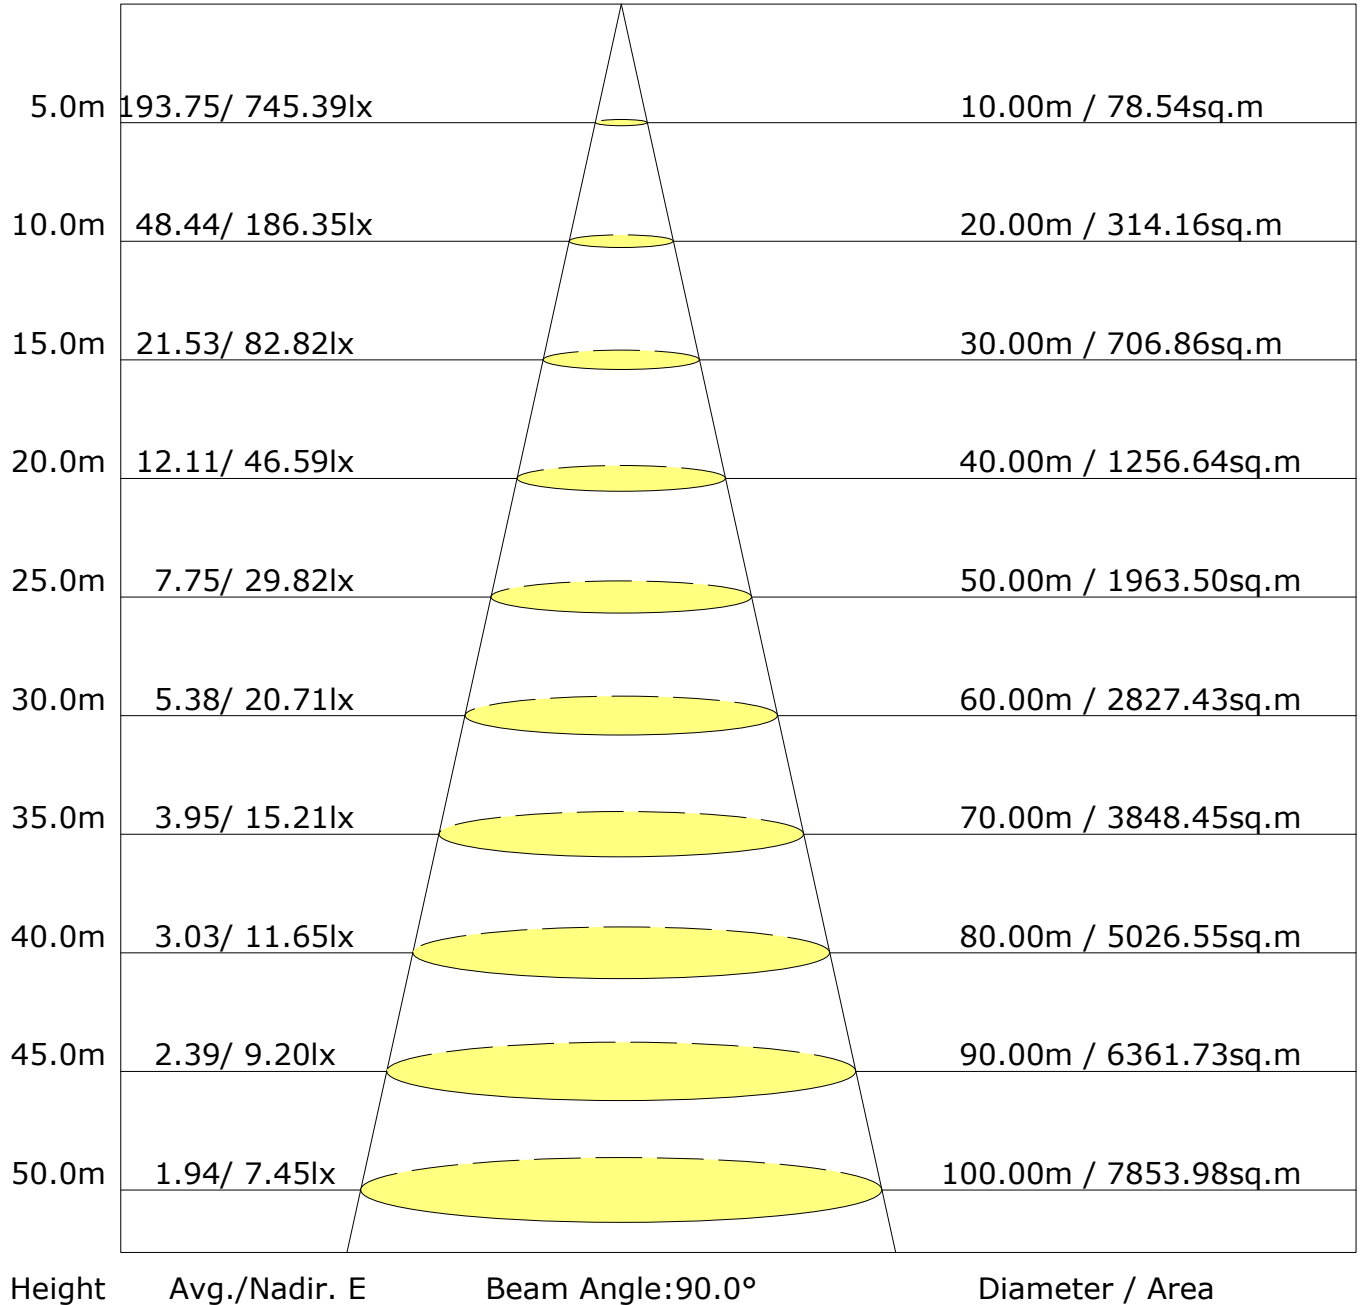

C Plane (°): 0.0-360.0: 90.0
 Test Lab: BTL
 Test Type: TYPE C
 Temperature:
 Operator: Honor Chen

Gamma Plane (°): 0.0-180.0: 1.0
 Test Device: GPM-1600L
 Distance: 8.443 m
 Humidity:
 Inspector: C


UGR Table

Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
3H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
4H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
6H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
8H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
12H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
X=4H Y=2H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
3H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
4H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
6H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
8H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
12H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
X=8H Y=4H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
6H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
8H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
12H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
X=12H Y=4H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
6H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
8H	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$	-1.\$
Variations with the observer position at spacings:										
S=1.0H	-1.\$/-1.\$					-1.\$/-1.\$				
S=1.5H	-1.\$/-1.\$					-1.\$/-1.\$				
S=2.0H	-1.\$/-1.\$					-1.\$/-1.\$				

Calculate in accordance with CIE Pub.117. The table is revised with 20110lm ($8\log(F/F_0) = 10.4$).

C Plane (°):0.0-360.0: 90.0
 Test Lab:BTL
 Test Type: TYPE C
 Temperature:
 Operator:Honor Chen

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1600L
 Distance: 8.443 m
 Humidity:
 Inspector: C

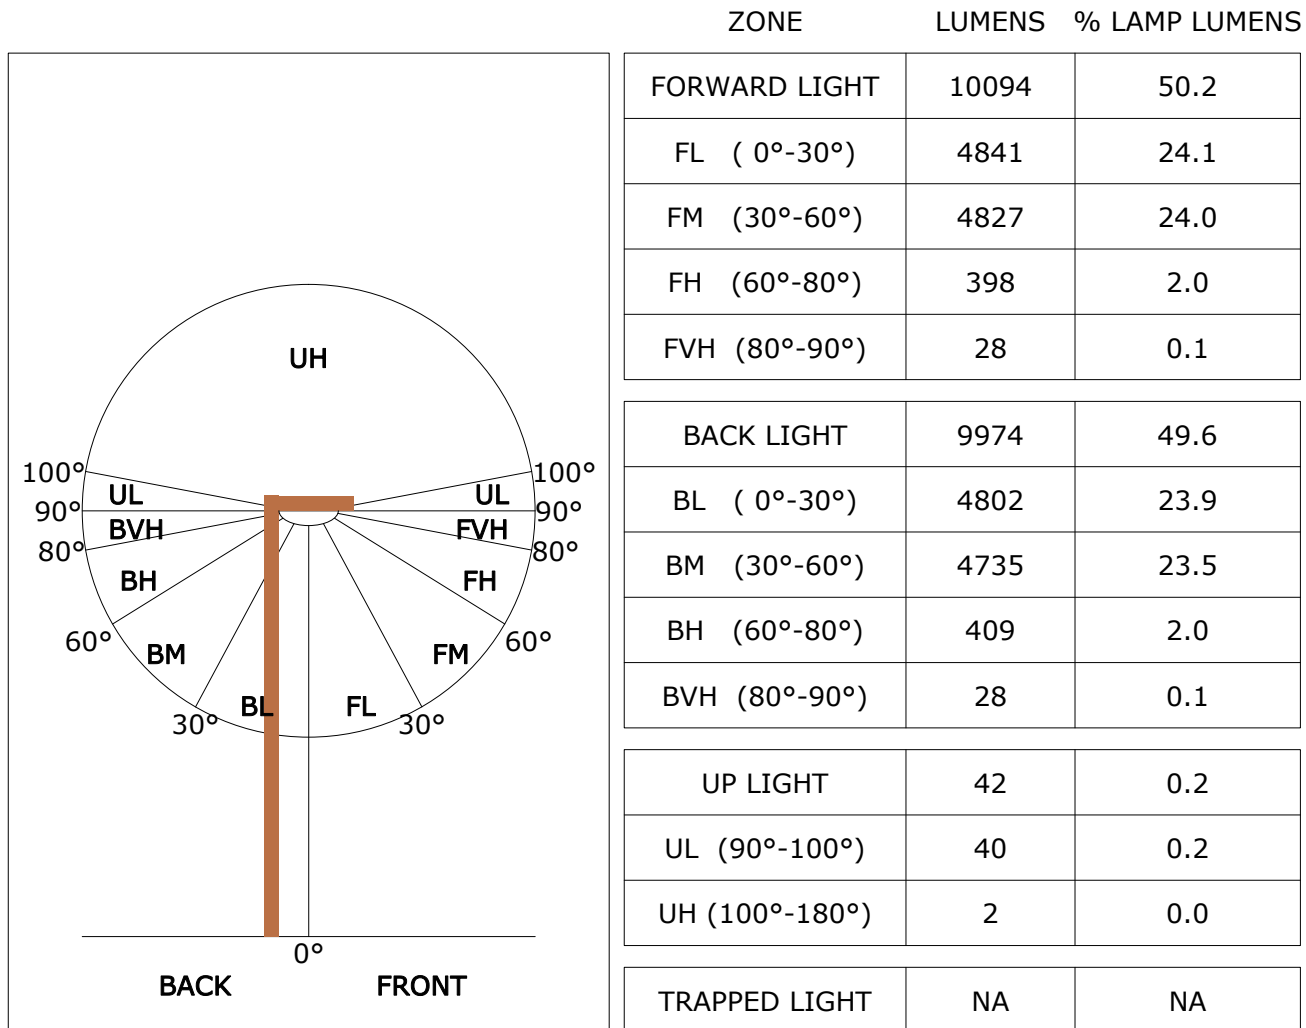
FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM

BUG(Backlight,Uplight,Glare) Rating Base On TM-15-07	
Asymmetrical Luminaire Types (Type I,II,III,IV)	B4 U2 G1
Quadrilateral Symmetrical Luminaire Types (Type V,Area Light)	B4 U2 G1

C Plane (°):0.0-360.0: 90.0
 Test Lab: BTL
 Test Type: TYPE C
 Temperature:
 Operator: Honor Chen

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1600L
 Distance: 8.443 m
 Humidity:
 Inspector: C

LCS Graph

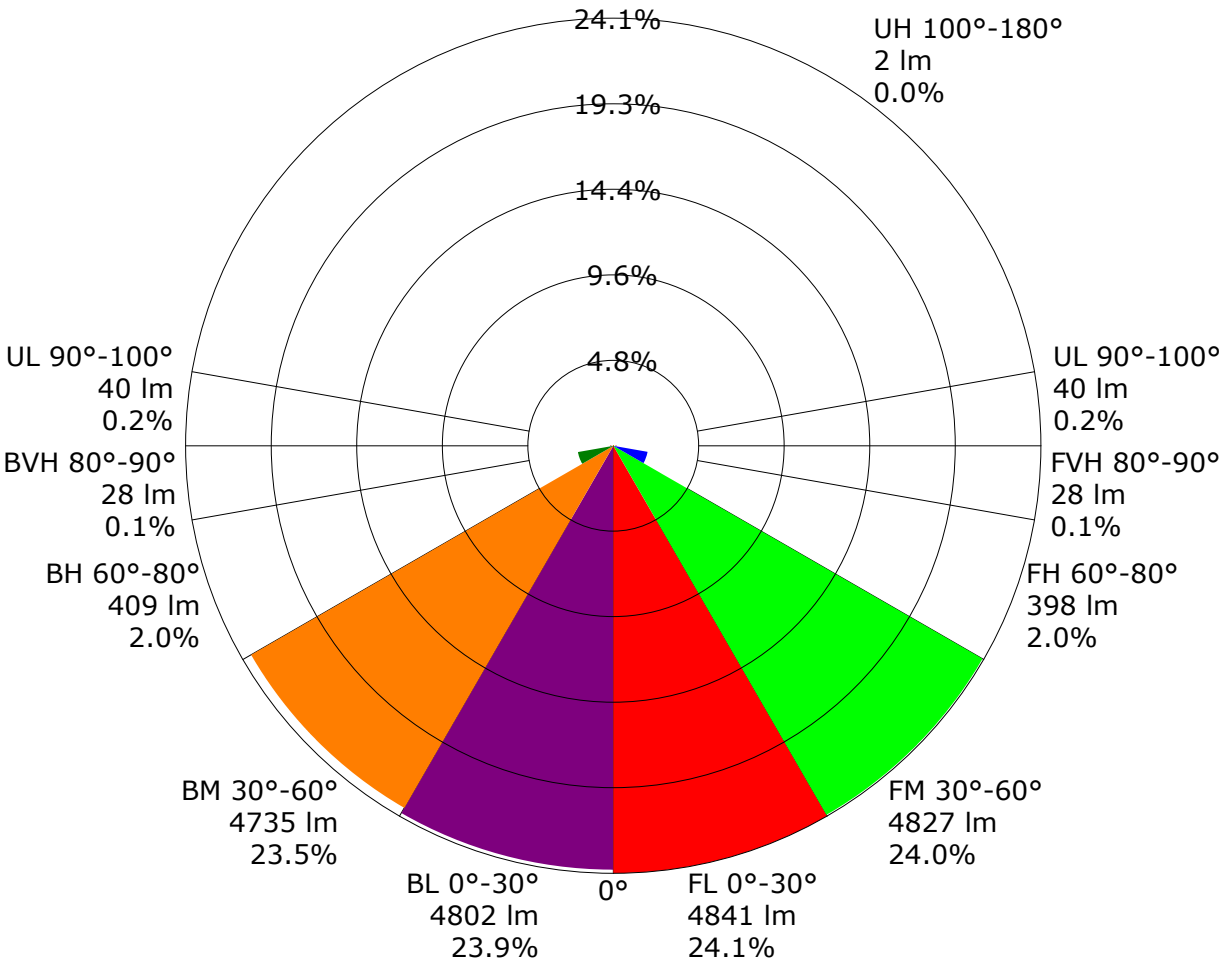

Back Light

Forward Light

Scale= MAX LCS%
Trapped Light:NA,NA

Utilisation Factor Table(Floor cavity)

Utilisation Factors UF(F)			SHR NOM = 0.75									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.69	0.79	0.85	0.90	0.96	0.99	1.02	1.05	1.08	
	0.30		0.63	0.72	0.79	0.84	0.91	0.95	0.98	1.02	1.05	
	0.20		0.58	0.68	0.75	0.80	0.87	0.92	0.95	1.00	1.03	
0.50	0.50	0.20	0.67	0.77	0.83	0.87	0.93	0.96	0.98	1.02	1.03	
	0.30		0.62	0.71	0.78	0.82	0.89	0.93	0.95	0.99	1.01	
	0.20		0.58	0.67	0.74	0.79	0.85	0.90	0.93	0.97	0.99	
0.30	0.50	0.20	0.66	0.75	0.81	0.85	0.90	0.93	0.95	0.98	1.00	
	0.30		0.61	0.70	0.76	0.81	0.87	0.90	0.93	0.96	0.98	
	0.20		0.57	0.67	0.73	0.78	0.84	0.88	0.91	0.94	0.96	
0.00	0.00	0.00	0.55	0.64	0.70	0.75	0.80	0.84	0.87	0.90	0.92	
Rating:269W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

C Plane (°):0.0-360.0: 90.0
 Test Lab:BTL
 Test Type: TYPE C
 Temperature:
 Operator:Honor Chen

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1600L
 Distance: 8.443 m
 Humidity:
 Inspector: C

Utilisation Factor Table(Wall)

Utilisation Factors UF(W)			SHR NOM = 0.75									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.81	0.65	0.54	0.47	0.36	0.30	0.25	0.19	0.16	
	0.30		0.68	0.56	0.47	0.41	0.33	0.27	0.23	0.18	0.15	
	0.20		0.58	0.49	0.42	0.37	0.30	0.25	0.22	0.17	0.14	
0.50	0.50	0.20	0.78	0.62	0.52	0.44	0.34	0.32	0.24	0.18	0.15	
	0.30		0.66	0.54	0.46	0.40	0.31	0.26	0.22	0.17	0.14	
	0.20		0.57	0.48	0.41	0.36	0.29	0.24	0.21	0.16	0.13	
0.30	0.50	0.20	0.76	0.59	0.49	0.42	0.32	0.26	0.22	0.17	0.14	
	0.30		0.64	0.52	0.44	0.38	0.30	0.25	0.21	0.16	0.13	
	0.20		0.56	0.47	0.40	0.35	0.28	0.23	0.20	0.15	0.13	
0.00	0.00	0.00	0.45	0.36	0.30	0.25	0.20	0.16	0.13	0.10	0.08	
Rating:269W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

C Plane (°):0.0-360.0: 90.0
 Test Lab:BTL
 Test Type: TYPE C
 Temperature:
 Operator:Honor Chen

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1600L
 Distance: 8.443 m
 Humidity:
 Inspector: C

Utilisation Factor Table(Ceiling cavity)

Utilisation Factors UF(C)			SHR NOM = 0.75								
Room Reflectance			Room Index(RI)								
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00
0.70	0.50	0.20	0.15	0.16	0.17	0.18	0.19	0.20	0.20	0.21	0.21
	0.30		0.09	0.11	0.13	0.14	0.15	0.17	0.17	0.19	0.20
	0.20		0.05	0.07	0.09	0.10	0.12	0.14	0.15	0.17	0.18
0.50	0.50	0.20	0.14	0.16	0.17	0.17	0.18	0.19	0.19	0.20	0.20
	0.30		0.09	0.11	0.12	0.13	0.15	0.16	0.17	0.18	0.19
	0.20		0.05	0.07	0.09	0.10	0.12	0.14	0.15	0.16	0.17
0.30	0.50	0.20	0.14	0.15	0.16	0.17	0.18	0.18	0.19	0.19	0.20
	0.30		0.09	0.11	0.12	0.13	0.14	0.16	0.16	0.17	0.18
	0.20		0.05	0.07	0.09	0.10	0.12	0.13	0.14	0.16	0.17
0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Rating:269W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980											

C Plane (°):0.0-360.0: 90.0
 Test Lab:BTL
 Test Type: TYPE C
 Temperature:
 Operator:Honor Chen

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1600L
 Distance: 8.443 m
 Humidity:
 Inspector: C

Zonal Lumen

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-1.0	18632.5	17.8	17.8	0.09	0.09
1.0-2.0	18574.6	53.3	71.2	0.27	0.35
2.0-3.0	18450.5	88.3	159.4	0.44	0.79
3.0-4.0	18266.6	122.3	281.7	0.61	1.40
4.0-5.0	18036.2	155.2	436.9	0.77	2.17
5.0-6.0	17748.6	186.5	623.4	0.93	3.10
6.0-7.0	17429.0	216.4	839.8	1.08	4.18
7.0-8.0	17082.0	244.5	1084.3	1.22	5.39
8.0-9.0	16700.0	270.7	1355.0	1.35	6.74
9.0-10.0	16286.4	294.8	1649.8	1.47	8.20
10.0-11.0	15812.3	316.0	1965.7	1.57	9.78
11.0-12.0	15318.8	334.9	2300.7	1.67	11.44
12.0-13.0	14841.4	352.3	2652.9	1.75	13.19
13.0-14.0	14337.0	367.0	3019.9	1.83	15.02
14.0-15.0	13834.3	379.8	3399.8	1.89	16.91
15.0-16.0	13339.5	390.9	3790.7	1.94	18.85
16.0-17.0	12848.3	400.2	4190.9	1.99	20.84
17.0-18.0	12376.4	408.1	4599.0	2.03	22.87
18.0-19.0	11881.1	413.4	5012.4	2.06	24.93
19.0-20.0	11394.6	417.1	5429.5	2.07	27.00
20.0-21.0	10946.6	420.4	5849.9	2.09	29.09
21.0-22.0	10501.1	422.0	6272.0	2.10	31.19
22.0-23.0	10078.2	422.9	6694.9	2.10	33.29
23.0-24.0	9688.1	423.6	7118.5	2.11	35.40
24.0-25.0	9318.9	423.8	7542.3	2.11	37.51
25.0-26.0	8983.3	424.1	7966.4	2.11	39.61
26.0-27.0	8646.5	423.1	8389.5	2.10	41.72
27.0-28.0	8312.3	420.9	8810.4	2.09	43.81
28.0-29.0	7999.0	418.6	9228.9	2.08	45.89
29.0-30.0	7673.7	414.4	9643.3	2.06	47.95
30.0-31.0	7358.2	409.5	10052.8	2.04	49.99
31.0-32.0	7067.3	404.9	10457.8	2.01	52.00
32.0-33.0	6797.1	400.5	10858.3	1.99	54.00
33.0-34.0	6552.1	396.6	11254.9	1.97	55.97
34.0-35.0	6293.9	390.9	11645.8	1.94	57.91
35.0-36.0	6035.6	384.3	12030.1	1.91	59.82

C Plane (°):0.0-360.0: 90.0
 Test Lab:BTL
 Test Type: TYPE C
 Temperature:
 Operator:Honor Chen

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1600L
 Distance: 8.443 m
 Humidity:
 Inspector: C

Zonal Lumen (Continue 1)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
36.0-37.0	5802.4	378.5	12408.6	1.88	61.70
37.0-38.0	5569.2	371.8	12780.4	1.85	63.55
38.0-39.0	5347.1	365.0	13145.4	1.82	65.37
39.0-40.0	5139.6	358.5	13503.9	1.78	67.15
40.0-41.0	4945.6	352.2	13856.1	1.75	68.90
41.0-42.0	4780.1	347.3	14203.5	1.73	70.63
42.0-43.0	4622.6	342.5	14546.0	1.70	72.33
43.0-44.0	4472.1	337.6	14883.5	1.68	74.01
44.0-45.0	4336.2	333.3	15216.8	1.66	75.67
45.0-46.0	4204.2	328.8	15545.7	1.64	77.30
46.0-47.0	4073.2	324.0	15869.7	1.61	78.92
47.0-48.0	3935.4	318.2	16187.8	1.58	80.50
48.0-49.0	3793.4	311.6	16499.4	1.55	82.05
49.0-50.0	3653.6	304.7	16804.1	1.52	83.56
50.0-51.0	3501.6	296.3	17100.3	1.47	85.04
51.0-52.0	3343.8	287.0	17387.3	1.43	86.46
52.0-53.0	3183.8	277.0	17664.3	1.38	87.84
53.0-54.0	3013.6	265.7	17930.0	1.32	89.16
54.0-55.0	2841.4	253.7	18183.6	1.26	90.42
55.0-56.0	2655.8	240.0	18423.7	1.19	91.62
56.0-57.0	2457.7	224.7	18648.4	1.12	92.73
57.0-58.0	2244.7	207.6	18856.0	1.03	93.77
58.0-59.0	1992.5	186.3	19042.3	0.93	94.69
59.0-60.0	1723.4	162.8	19205.1	0.81	95.50
60.0-61.0	1440.9	137.5	19342.7	0.68	96.19
61.0-62.0	1158.2	111.6	19454.3	0.56	96.74
62.0-63.0	913.0	88.8	19543.1	0.44	97.18
63.0-64.0	704.9	69.2	19612.3	0.34	97.53
64.0-65.0	545.8	54.0	19666.3	0.27	97.79
65.0-66.0	440.1	43.9	19710.2	0.22	98.01
66.0-67.0	369.4	37.1	19747.4	0.18	98.20
67.0-68.0	321.3	32.6	19779.9	0.16	98.36
68.0-69.0	287.4	29.3	19809.2	0.15	98.51
69.0-70.0	261.2	26.8	19836.1	0.13	98.64
70.0-71.0	240.1	24.8	19860.9	0.12	98.76
71.0-72.0	222.0	23.1	19884.0	0.11	98.88

C Plane (°):0.0-360.0: 90.0
 Test Lab:BTL
 Test Type: TYPE C
 Temperature:
 Operator:Honor Chen

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1600L
 Distance: 8.443 m
 Humidity:
 Inspector: C

Zonal Lumen (Continue 2)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
72.0-73.0	205.9	21.5	19905.5	0.11	98.98
73.0-74.0	190.4	20.0	19925.5	0.10	99.08
74.0-75.0	174.1	18.4	19943.9	0.09	99.18
75.0-76.0	158.1	16.8	19960.7	0.08	99.26
76.0-77.0	142.1	15.2	19975.9	0.08	99.33
77.0-78.0	126.4	13.5	19989.4	0.07	99.40
78.0-79.0	111.9	12.0	20001.4	0.06	99.46
79.0-80.0	97.6	10.5	20011.9	0.05	99.51
80.0-81.0	83.9	9.1	20021.0	0.05	99.56
81.0-82.0	71.9	7.8	20028.8	0.04	99.60
82.0-83.0	61.2	6.7	20035.5	0.03	99.63
83.0-84.0	52.7	5.7	20041.2	0.03	99.66
84.0-85.0	46.4	5.1	20046.3	0.03	99.68
85.0-86.0	42.3	4.6	20050.9	0.02	99.71
86.0-87.0	40.0	4.4	20055.3	0.02	99.73
87.0-88.0	38.6	4.2	20059.5	0.02	99.75
88.0-89.0	37.4	4.1	20063.6	0.02	99.77
89.0-90.0	36.4	4.0	20067.6	0.02	99.79
90.0-91.0	36.2	4.0	20071.6	0.02	99.81
91.0-92.0	36.3	4.0	20075.5	0.02	99.83
92.0-93.0	36.4	4.0	20079.5	0.02	99.85
93.0-94.0	36.4	4.0	20083.5	0.02	99.87
94.0-95.0	36.5	4.0	20087.5	0.02	99.89
95.0-96.0	36.8	4.0	20091.5	0.02	99.91
96.0-97.0	37.0	4.0	20095.5	0.02	99.93
97.0-98.0	37.2	4.0	20099.6	0.02	99.95
98.0-99.0	37.3	4.0	20103.6	0.02	99.97
99.0-100.0	37.5	4.1	20107.7	0.02	99.99
100.0-101.0	18.9	2.0	20109.7	0.01	100.00
101.0-102.0	0.0	0.0	20109.7	0.00	100.00
102.0-103.0	0.0	0.0	20109.7	0.00	100.00
103.0-104.0	0.0	0.0	20109.7	0.00	100.00
104.0-105.0	0.0	0.0	20109.7	0.00	100.00
105.0-106.0	0.0	0.0	20109.7	0.00	100.00
106.0-107.0	0.0	0.0	20109.7	0.00	100.00
107.0-108.0	0.0	0.0	20109.7	0.00	100.00

C Plane (°):0.0-360.0: 90.0
 Test Lab:BTL
 Test Type: TYPE C
 Temperature:
 Operator:Honor Chen

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1600L
 Distance: 8.443 m
 Humidity:
 Inspector: C

Zonal Lumen (Continue 3)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
108.0-109.0	0.0	0.0	20109.7	0.00	100.00
109.0-110.0	0.0	0.0	20109.7	0.00	100.00
110.0-111.0	0.0	0.0	20109.7	0.00	100.00
111.0-112.0	0.0	0.0	20109.7	0.00	100.00
112.0-113.0	0.0	0.0	20109.7	0.00	100.00
113.0-114.0	0.0	0.0	20109.7	0.00	100.00
114.0-115.0	0.0	0.0	20109.7	0.00	100.00
115.0-116.0	0.0	0.0	20109.7	0.00	100.00
116.0-117.0	0.0	0.0	20109.7	0.00	100.00
117.0-118.0	0.0	0.0	20109.7	0.00	100.00
118.0-119.0	0.0	0.0	20109.7	0.00	100.00
119.0-120.0	0.0	0.0	20109.7	0.00	100.00
120.0-121.0	0.0	0.0	20109.7	0.00	100.00
121.0-122.0	0.0	0.0	20109.7	0.00	100.00
122.0-123.0	0.0	0.0	20109.7	0.00	100.00
123.0-124.0	0.0	0.0	20109.7	0.00	100.00
124.0-125.0	0.0	0.0	20109.7	0.00	100.00
125.0-126.0	0.0	0.0	20109.7	0.00	100.00
126.0-127.0	0.0	0.0	20109.7	0.00	100.00
127.0-128.0	0.0	0.0	20109.7	0.00	100.00
128.0-129.0	0.0	0.0	20109.7	0.00	100.00
129.0-130.0	0.0	0.0	20109.7	0.00	100.00
130.0-131.0	0.0	0.0	20109.7	0.00	100.00
131.0-132.0	0.0	0.0	20109.7	0.00	100.00
132.0-133.0	0.0	0.0	20109.7	0.00	100.00
133.0-134.0	0.0	0.0	20109.7	0.00	100.00
134.0-135.0	0.0	0.0	20109.7	0.00	100.00
135.0-136.0	0.0	0.0	20109.7	0.00	100.00
136.0-137.0	0.0	0.0	20109.7	0.00	100.00
137.0-138.0	0.0	0.0	20109.7	0.00	100.00
138.0-139.0	0.0	0.0	20109.7	0.00	100.00
139.0-140.0	0.0	0.0	20109.7	0.00	100.00
140.0-141.0	0.0	0.0	20109.7	0.00	100.00
141.0-142.0	0.0	0.0	20109.7	0.00	100.00
142.0-143.0	0.0	0.0	20109.7	0.00	100.00
143.0-144.0	0.0	0.0	20109.7	0.00	100.00

C Plane (°):0.0-360.0: 90.0
 Test Lab:BTL
 Test Type: TYPE C
 Temperature:
 Operator:Honor Chen

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1600L
 Distance: 8.443 m
 Humidity:
 Inspector: C

Zonal Lumen (Continue 4)

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
144.0-145.0	0.0	0.0	20109.7	0.00	100.00
145.0-146.0	0.0	0.0	20109.7	0.00	100.00
146.0-147.0	0.0	0.0	20109.7	0.00	100.00
147.0-148.0	0.0	0.0	20109.7	0.00	100.00
148.0-149.0	0.0	0.0	20109.7	0.00	100.00
149.0-150.0	0.0	0.0	20109.7	0.00	100.00
150.0-151.0	0.0	0.0	20109.7	0.00	100.00
151.0-152.0	0.0	0.0	20109.7	0.00	100.00
152.0-153.0	0.0	0.0	20109.7	0.00	100.00
153.0-154.0	0.0	0.0	20109.7	0.00	100.00
154.0-155.0	0.0	0.0	20109.7	0.00	100.00
155.0-156.0	0.0	0.0	20109.7	0.00	100.00
156.0-157.0	0.0	0.0	20109.7	0.00	100.00
157.0-158.0	0.0	0.0	20109.7	0.00	100.00
158.0-159.0	0.0	0.0	20109.7	0.00	100.00
159.0-160.0	0.0	0.0	20109.7	0.00	100.00
160.0-161.0	0.0	0.0	20109.7	0.00	100.00
161.0-162.0	0.0	0.0	20109.7	0.00	100.00
162.0-163.0	0.0	0.0	20109.7	0.00	100.00
163.0-164.0	0.0	0.0	20109.7	0.00	100.00
164.0-165.0	0.0	0.0	20109.7	0.00	100.00
165.0-166.0	0.0	0.0	20109.7	0.00	100.00
166.0-167.0	0.0	0.0	20109.7	0.00	100.00
167.0-168.0	0.0	0.0	20109.7	0.00	100.00
168.0-169.0	0.0	0.0	20109.7	0.00	100.00
169.0-170.0	0.0	0.0	20109.7	0.00	100.00
170.0-171.0	0.0	0.0	20109.7	0.00	100.00
171.0-172.0	0.0	0.0	20109.7	0.00	100.00
172.0-173.0	0.0	0.0	20109.7	0.00	100.00
173.0-174.0	0.0	0.0	20109.7	0.00	100.00
174.0-175.0	0.0	0.0	20109.7	0.00	100.00
175.0-176.0	0.0	0.0	20109.7	0.00	100.00
176.0-177.0	0.0	0.0	20109.7	0.00	100.00
177.0-178.0	0.0	0.0	20109.7	0.00	100.00
178.0-179.0	0.0	0.0	20109.7	0.00	100.00
179.0-180.0	0.0	0.0	20109.7	0.00	100.00

C Plane (°):0.0-360.0: 90.0
 Test Lab: BTL
 Test Type: TYPE C
 Temperature:
 Operator: Honor Chen

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1600L
 Distance: 8.443 m
 Humidity:
 Inspector: C

Candlepower Table

Unit: cd

G\C	C0.0	C90.0	C180.0	C270.0	C360.0					
G0.0	18634.8	18660.5	18634.8	18660.5	18634.8					
G1.0	18612.8	18691.4	18589.7	18575.6	18612.8					
G2.0	18535.2	18659.9	18494.9	18437.2	18535.2					
G3.0	18374.9	18565.6	18315.7	18220.3	18374.9					
G4.0	18162.1	18411.6	18105.0	17977.7	18162.1					
G5.0	17901.2	18195.7	17829.9	17706.8	17901.2					
G6.0	17557.9	17931.0	17505.0	17361.4	17557.9					
G7.0	17244.0	17650.2	17176.4	17006.1	17244.0					
G8.0	16885.1	17334.2	16792.3	16567.5	16885.1					
G9.0	16491.0	17016.6	16381.5	16131.5	16491.0					
G10.0	16049.3	16638.8	15946.0	15636.3	16049.3					
G11.0	15564.0	16172.9	15421.0	15069.9	15564.0					
G12.0	15088.7	15730.1	14930.0	14574.1	15088.7					
G13.0	14630.7	15243.3	14461.0	14073.2	14630.7					
G14.0	14103.0	14725.1	13924.3	13535.0	14103.0					
G15.0	13648.2	14235.6	13434.4	13068.6	13648.2					
G16.0	13142.5	13722.6	12930.3	12533.6	13142.5					
G17.0	12707.6	13227.9	12462.3	12059.9	12707.6					
G18.0	12242.2	12750.0	11996.0	11565.2	12242.2					
G19.0	11744.9	12206.6	11506.0	11037.5	11744.9					
G20.0	11276.5	11739.7	11040.1	10605.2	11276.5					
G21.0	10846.8	11270.2	10614.6	10179.7	10846.8					
G22.0	10379.3	10804.8	10161.9	9751.5	10379.3					
G23.0	9973.2	10380.9	9773.0	9400.5	9973.2					
G24.0	9593.8	9968.5	9387.4	9027.3	9593.8					
G25.0	9235.4	9596.4	9036.8	8705.6	9235.4					
G26.0	8912.6	9262.6	8715.0	8401.7	8912.6					
G27.0	8557.8	8907.3	8364.5	8050.6	8557.8					
G28.0	8238.2	8595.6	8048.0	7736.2	8238.2					
G29.0	7904.4	8304.2	7743.5	7421.8	7904.4					
G30.0	7527.1	7975.1	7385.6	7128.3	7527.1					
G31.0	7211.1	7680.6	7074.3	6883.6	7211.1					
G32.0	6921.8	7373.5	6758.3	6635.2	6921.8					
G33.0	6685.0	7106.3	6509.9	6386.8	6685.0					
G34.0	6452.8	6847.4	6280.4	6148.4	6452.8					
G35.0	6151.5	6572.8	6013.2	5884.8	6151.5					
G36.0	5901.5	6327.6	5785.7	5647.4	5901.5					

C Plane (°):0.0-360.0: 90.0
 Test Lab:BTL
 Test Type: TYPE C
 Temperature:
 Operator:Honor Chen

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1600L
 Distance: 8.443 m
 Humidity:
 Inspector: C

Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C90.0	C180.0	C270.0	C360.0					
G37.0	5672.6	6085.5	5566.2	5432.5	5672.6					
G38.0	5440.9	5830.3	5322.0	5203.5	5440.9					
G39.0	5252.3	5608.6	5120.8	4998.7	5252.3					
G40.0	5044.3	5372.8	4912.7	4806.3	5044.3					
G41.0	4875.0	5163.7	4748.7	4641.3	4875.0					
G42.0	4733.0	4983.5	4596.2	4499.8	4733.0					
G43.0	4583.1	4793.8	4442.1	4349.4	4583.1					
G44.0	4442.7	4639.2	4302.8	4223.6	4442.7					
G45.0	4341.5	4497.2	4164.4	4078.5	4341.5					
G46.0	4207.9	4360.4	4031.8	3951.7	4207.9					
G47.0	4085.3	4225.7	3901.9	3820.7	4085.3					
G48.0	3947.5	4088.4	3747.3	3666.1	3947.5					
G49.0	3816.5	3954.8	3603.7	3523.0	3816.5					
G50.0	3678.1	3820.7	3454.4	3377.9	3678.1					
G51.0	3519.3	3668.2	3283.0	3211.2	3519.3					
G52.0	3372.6	3509.4	3133.1	3053.5	3372.6					
G53.0	3213.8	3341.2	2964.9	2882.1	3213.8					
G54.0	3022.0	3175.1	2797.2	2712.4	3022.0					
G55.0	2831.3	3012.1	2637.9	2543.1	2831.3					
G56.0	2629.0	2821.9	2453.5	2317.8	2629.0					
G57.0	2426.2	2646.8	2272.7	2093.5	2426.2					
G58.0	2157.4	2455.1	2064.6	1841.4	2157.4					
G59.0	1858.2	2209.3	1829.9	1523.9	1858.2					
G60.0	1569.4	1968.8	1594.6	1233.6	1569.4					
G61.0	1243.5	1666.9	1330.0	920.7	1243.5					
G62.0	951.6	1387.1	1071.1	694.9	951.6					
G63.0	728.4	1101.5	832.7	537.1	728.4					
G64.0	556.5	832.2	613.1	437.6	556.5					
G65.0	441.8	640.9	467.4	376.8	441.8					
G66.0	373.6	501.5	389.4	329.6	373.6					
G67.0	325.4	408.7	330.1	296.6	325.4					
G68.0	294.0	350.0	295.5	269.9	294.0					
G69.0	266.2	312.3	265.7	245.2	266.2					
G70.0	246.3	284.5	241.6	227.4	246.3					
G71.0	230.1	256.8	222.2	212.2	230.1					
G72.0	213.3	235.8	206.5	199.1	213.3					
G73.0	197.0	219.6	192.3	183.4	197.0					

C Plane (°):0.0-360.0: 90.0

Test Lab: BTL

Test Type: TYPE C

Temperature:

Operator: Honor Chen

Gamma Plane (°):0.0-180.0:1.0

Test Device: GPM-1600L

Distance: 8.443 m

Humidity:

Inspector: C

Candlepower Table (Continue 2)

Unit: cd

G\C	C0.0	C90.0	C180.0	C270.0	C360.0					
G74.0	178.7	204.9	179.7	167.2	178.7					
G75.0	160.9	188.6	161.9	150.9	160.9					
G76.0	145.7	172.9	147.3	136.3	145.7					
G77.0	128.9	155.6	132.1	118.4	128.9					
G78.0	114.2	139.4	117.4	104.8	114.2					
G79.0	99.6	123.7	104.8	91.7	99.6					
G80.0	85.4	107.4	90.1	78.1	85.4					
G81.0	72.3	93.8	80.2	63.9	72.3					
G82.0	60.3	82.3	68.7	53.5	60.3					
G83.0	51.3	68.7	57.6	47.7	51.3					
G84.0	45.6	58.2	49.3	43.0	45.6					
G85.0	43.5	49.8	42.5	39.3	43.5					
G86.0	41.9	45.1	38.8	37.7	41.9					
G87.0	40.9	40.9	36.2	38.3	40.9					
G88.0	39.8	39.8	35.6	37.7	39.8					
G89.0	37.2	38.3	34.6	36.2	37.2					
G90.0	36.7	37.7	34.1	36.7	36.7					
G91.0	35.6	37.7	34.6	36.7	35.6					
G92.0	35.6	37.7	34.6	37.7	35.6					
G93.0	36.2	37.7	34.1	37.7	36.2					
G94.0	35.6	37.2	34.6	37.7	35.6					
G95.0	35.6	38.3	35.1	37.7	35.6					
G96.0	36.2	38.8	35.1	37.7	36.2					
G97.0	36.2	38.8	34.6	38.8	36.2					
G98.0	36.7	39.3	35.1	38.3	36.7					
G99.0	36.7	38.8	35.1	38.8	36.7					
G100.0	37.2	39.3	35.6	38.8	37.2					
G101.0	0.0	0.0	0.0	0.0	0.0					
G102.0	0.0	0.0	0.0	0.0	0.0					
G103.0	0.0	0.0	0.0	0.0	0.0					
G104.0	0.0	0.0	0.0	0.0	0.0					
G105.0	0.0	0.0	0.0	0.0	0.0					
G106.0	0.0	0.0	0.0	0.0	0.0					
G107.0	0.0	0.0	0.0	0.0	0.0					
G108.0	0.0	0.0	0.0	0.0	0.0					
G109.0	0.0	0.0	0.0	0.0	0.0					
G110.0	0.0	0.0	0.0	0.0	0.0					

C Plane (°):0.0-360.0: 90.0

Test Lab:BTL

Test Type: TYPE C

Temperature:

Operator:Honor Chen

Gamma Plane (°):0.0-180.0:1.0

Test Device: GPM-1600L

Distance: 8.443 m

Humidity:

Inspector: C

Candlepower Table (Continue 3)

Unit: cd

G\C	C0.0	C90.0	C180.0	C270.0	C360.0					
G111.0	0.0	0.0	0.0	0.0	0.0					
G112.0	0.0	0.0	0.0	0.0	0.0					
G113.0	0.0	0.0	0.0	0.0	0.0					
G114.0	0.0	0.0	0.0	0.0	0.0					
G115.0	0.0	0.0	0.0	0.0	0.0					
G116.0	0.0	0.0	0.0	0.0	0.0					
G117.0	0.0	0.0	0.0	0.0	0.0					
G118.0	0.0	0.0	0.0	0.0	0.0					
G119.0	0.0	0.0	0.0	0.0	0.0					
G120.0	0.0	0.0	0.0	0.0	0.0					
G121.0	0.0	0.0	0.0	0.0	0.0					
G122.0	0.0	0.0	0.0	0.0	0.0					
G123.0	0.0	0.0	0.0	0.0	0.0					
G124.0	0.0	0.0	0.0	0.0	0.0					
G125.0	0.0	0.0	0.0	0.0	0.0					
G126.0	0.0	0.0	0.0	0.0	0.0					
G127.0	0.0	0.0	0.0	0.0	0.0					
G128.0	0.0	0.0	0.0	0.0	0.0					
G129.0	0.0	0.0	0.0	0.0	0.0					
G130.0	0.0	0.0	0.0	0.0	0.0					
G131.0	0.0	0.0	0.0	0.0	0.0					
G132.0	0.0	0.0	0.0	0.0	0.0					
G133.0	0.0	0.0	0.0	0.0	0.0					
G134.0	0.0	0.0	0.0	0.0	0.0					
G135.0	0.0	0.0	0.0	0.0	0.0					
G136.0	0.0	0.0	0.0	0.0	0.0					
G137.0	0.0	0.0	0.0	0.0	0.0					
G138.0	0.0	0.0	0.0	0.0	0.0					
G139.0	0.0	0.0	0.0	0.0	0.0					
G140.0	0.0	0.0	0.0	0.0	0.0					
G141.0	0.0	0.0	0.0	0.0	0.0					
G142.0	0.0	0.0	0.0	0.0	0.0					
G143.0	0.0	0.0	0.0	0.0	0.0					
G144.0	0.0	0.0	0.0	0.0	0.0					
G145.0	0.0	0.0	0.0	0.0	0.0					
G146.0	0.0	0.0	0.0	0.0	0.0					
G147.0	0.0	0.0	0.0	0.0	0.0					

C Plane (°):0.0-360.0: 90.0

Test Lab:BTL

Test Type: TYPE C

Temperature:

Operator:Honor Chen

Gamma Plane (°):0.0-180.0:1.0

Test Device: GPM-1600L

Distance: 8.443 m

Humidity:

Inspector: C

Candlepower Table (Continue 4)

Unit: cd

G\C	C0.0	C90.0	C180.0	C270.0	C360.0					
G148.0	0.0	0.0	0.0	0.0	0.0					
G149.0	0.0	0.0	0.0	0.0	0.0					
G150.0	0.0	0.0	0.0	0.0	0.0					
G151.0	0.0	0.0	0.0	0.0	0.0					
G152.0	0.0	0.0	0.0	0.0	0.0					
G153.0	0.0	0.0	0.0	0.0	0.0					
G154.0	0.0	0.0	0.0	0.0	0.0					
G155.0	0.0	0.0	0.0	0.0	0.0					
G156.0	0.0	0.0	0.0	0.0	0.0					
G157.0	0.0	0.0	0.0	0.0	0.0					
G158.0	0.0	0.0	0.0	0.0	0.0					
G159.0	0.0	0.0	0.0	0.0	0.0					
G160.0	0.0	0.0	0.0	0.0	0.0					
G161.0	0.0	0.0	0.0	0.0	0.0					
G162.0	0.0	0.0	0.0	0.0	0.0					
G163.0	0.0	0.0	0.0	0.0	0.0					
G164.0	0.0	0.0	0.0	0.0	0.0					
G165.0	0.0	0.0	0.0	0.0	0.0					
G166.0	0.0	0.0	0.0	0.0	0.0					
G167.0	0.0	0.0	0.0	0.0	0.0					
G168.0	0.0	0.0	0.0	0.0	0.0					
G169.0	0.0	0.0	0.0	0.0	0.0					
G170.0	0.0	0.0	0.0	0.0	0.0					
G171.0	0.0	0.0	0.0	0.0	0.0					
G172.0	0.0	0.0	0.0	0.0	0.0					
G173.0	0.0	0.0	0.0	0.0	0.0					
G174.0	0.0	0.0	0.0	0.0	0.0					
G175.0	0.0	0.0	0.0	0.0	0.0					
G176.0	0.0	0.0	0.0	0.0	0.0					
G177.0	0.0	0.0	0.0	0.0	0.0					
G178.0	0.0	0.0	0.0	0.0	0.0					
G179.0	0.0	0.0	0.0	0.0	0.0					
G180.0	0.0	0.0	0.0	0.0	0.0					

C Plane (°):0.0-360.0: 90.0
 Test Lab:BTL
 Test Type: TYPE C
 Temperature:
 Operator:Honor Chen

Gamma Plane (°):0.0-180.0:1.0
 Test Device: GPM-1600L
 Distance: 8.443 m
 Humidity:
 Inspector: C