Constrained area: 2030 optimal system

Area use distribution - Area available: 60000 m^2

P2X (0.0%)
0 m^2

IT (100.0%)
60000 m^2

Storage (0.0%)
0 m^2
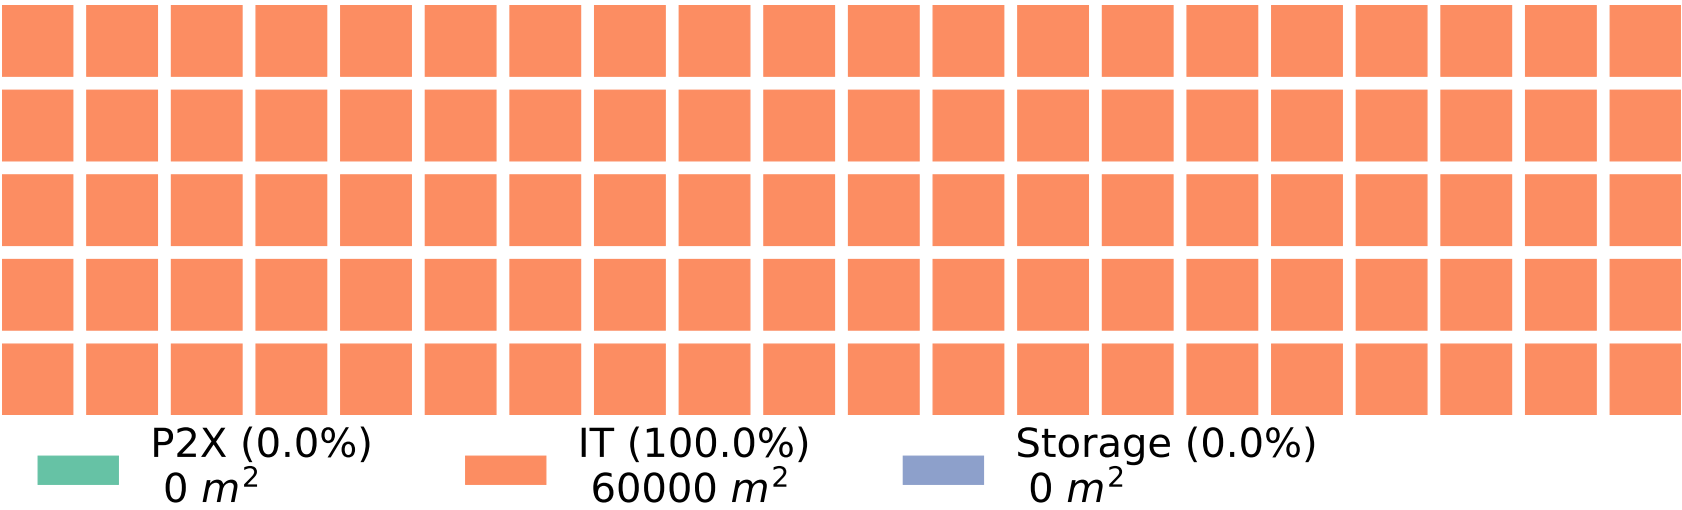
Installed capacity distribution - Total capacity: 5.2 GW/GWh

P2X (0%)
0.0 GW

IT (42%)
2.2 GW

Storage (0%)
0.0 GWh

Links (57%)
3.0 GW