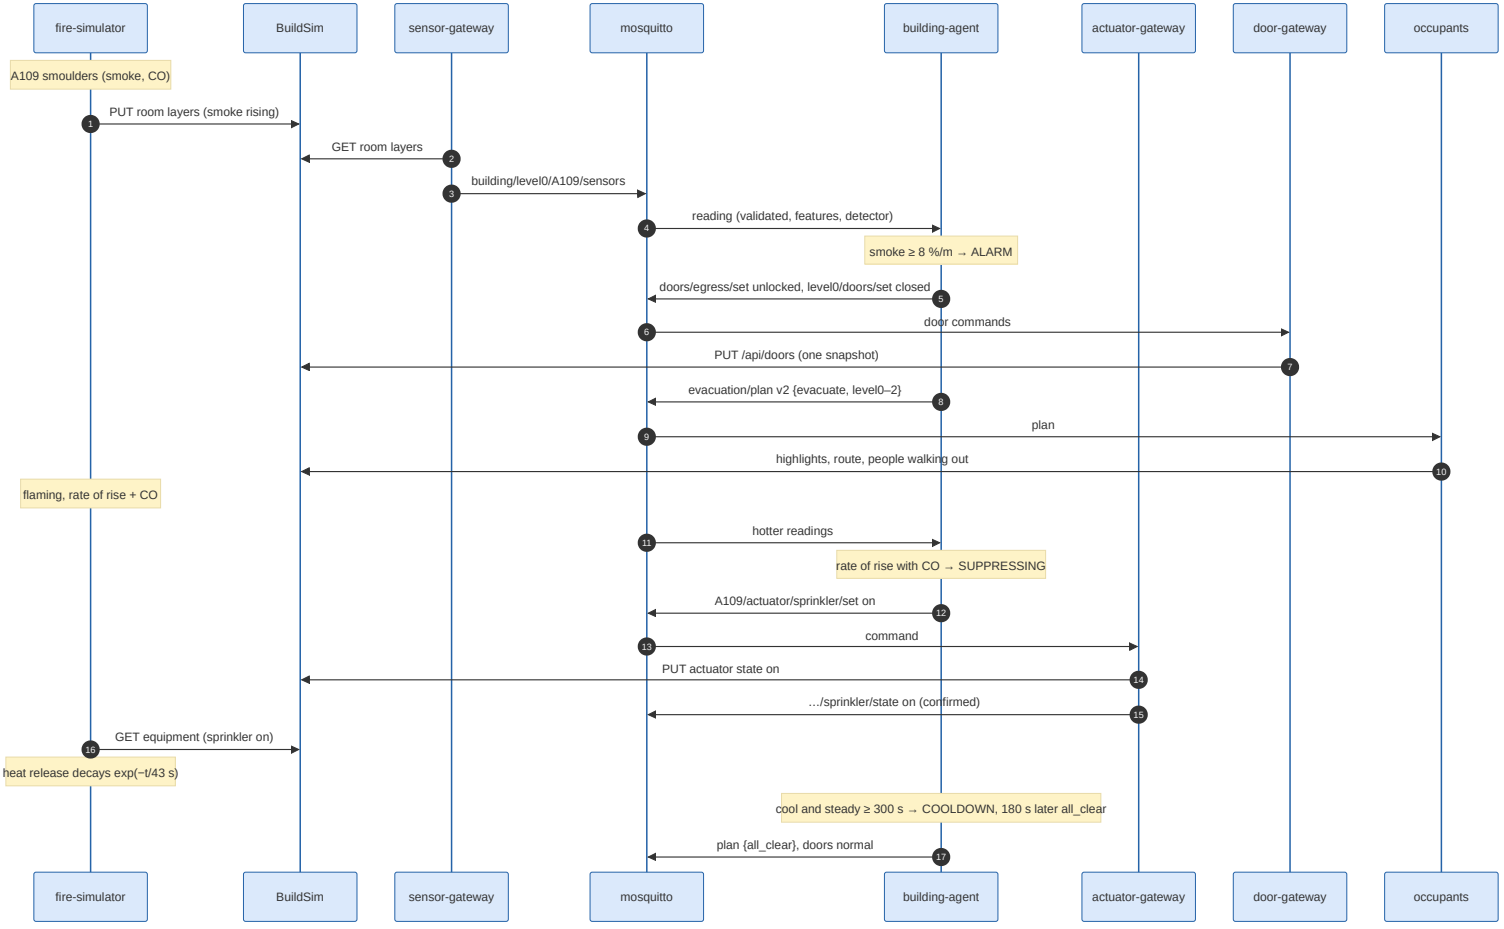
fire-simulator
BuildSim
sensor-gateway
mosquitto
building-agent
actuator-gateway
door-gateway
occupants
A109 smoulders (smoke, CO)
1
PUT room layers (smoke rising)
GET room layers
2
3
building/level0/A109/sensors
reading (validated, features, detector)
4
smoke ≥ 8 %/m → ALARM
doors/egress/set unlocked, level0/doors/set closed
5
door commands
6
PUT /api/doors (one snapshot)
7
evacuation/plan v2 {evacuate, level0–2}
8
plan
9
highlights, route, people walking out
10
flaming, rate of rise + CO
hotter readings
11
rate of rise with CO → SUPPRESSING
A109/actuator/sprinkler/set on
12
command
13
PUT actuator state on
14
…/sprinkler/state on (confirmed)
15
GET equipment (sprinkler on)
16
heat release decays exp(−t/43 s)
cool and steady ≥ 300 s → COOLDOWN, 180 s later all_clear
plan {all_clear}, doors normal
17
fire-simulator
BuildSim
sensor-gateway
mosquitto
building-agent
actuator-gateway
door-gateway
occupants