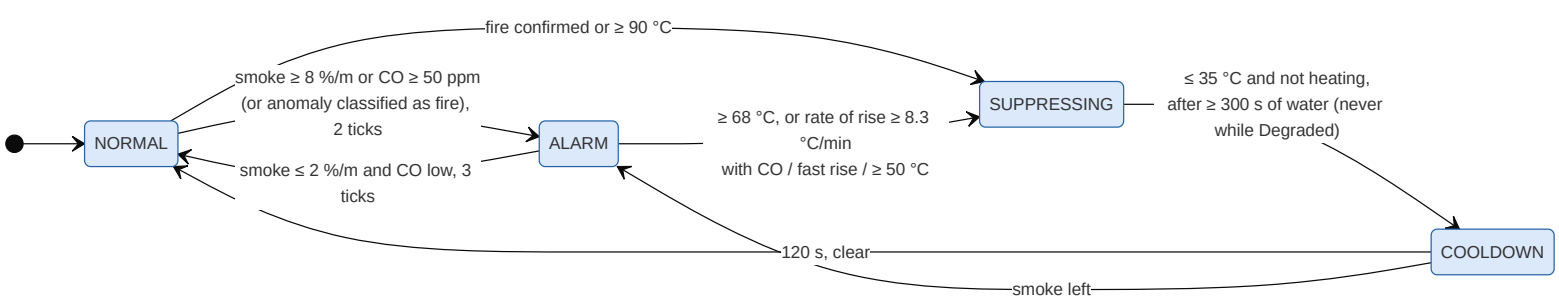
NORMAL
ALARM
SUPPRESSING
COOLDOWN
fire confirmed or ≥ 90 °C
smoke ≥ 8 %/m or CO ≥ 50 ppm
(or anomaly classified as fire),
2 ticks
smoke ≤ 2 %/m and CO low, 3
ticks
≥ 68 °C, or rate of rise ≥ 8.3
°C/min
with CO / fast rise / ≥ 50 °C
≤ 35 °C and not heating,
after ≥ 300 s of water (never
while Degraded)
120 s, clear
smoke left