Bulk(1)= SI(53.96)TI(1.35)AL(18.52)MG(8.11)FE(10.14)CA(10.15)NA(5.08)K(0.22)H(6.84)O(173.85)

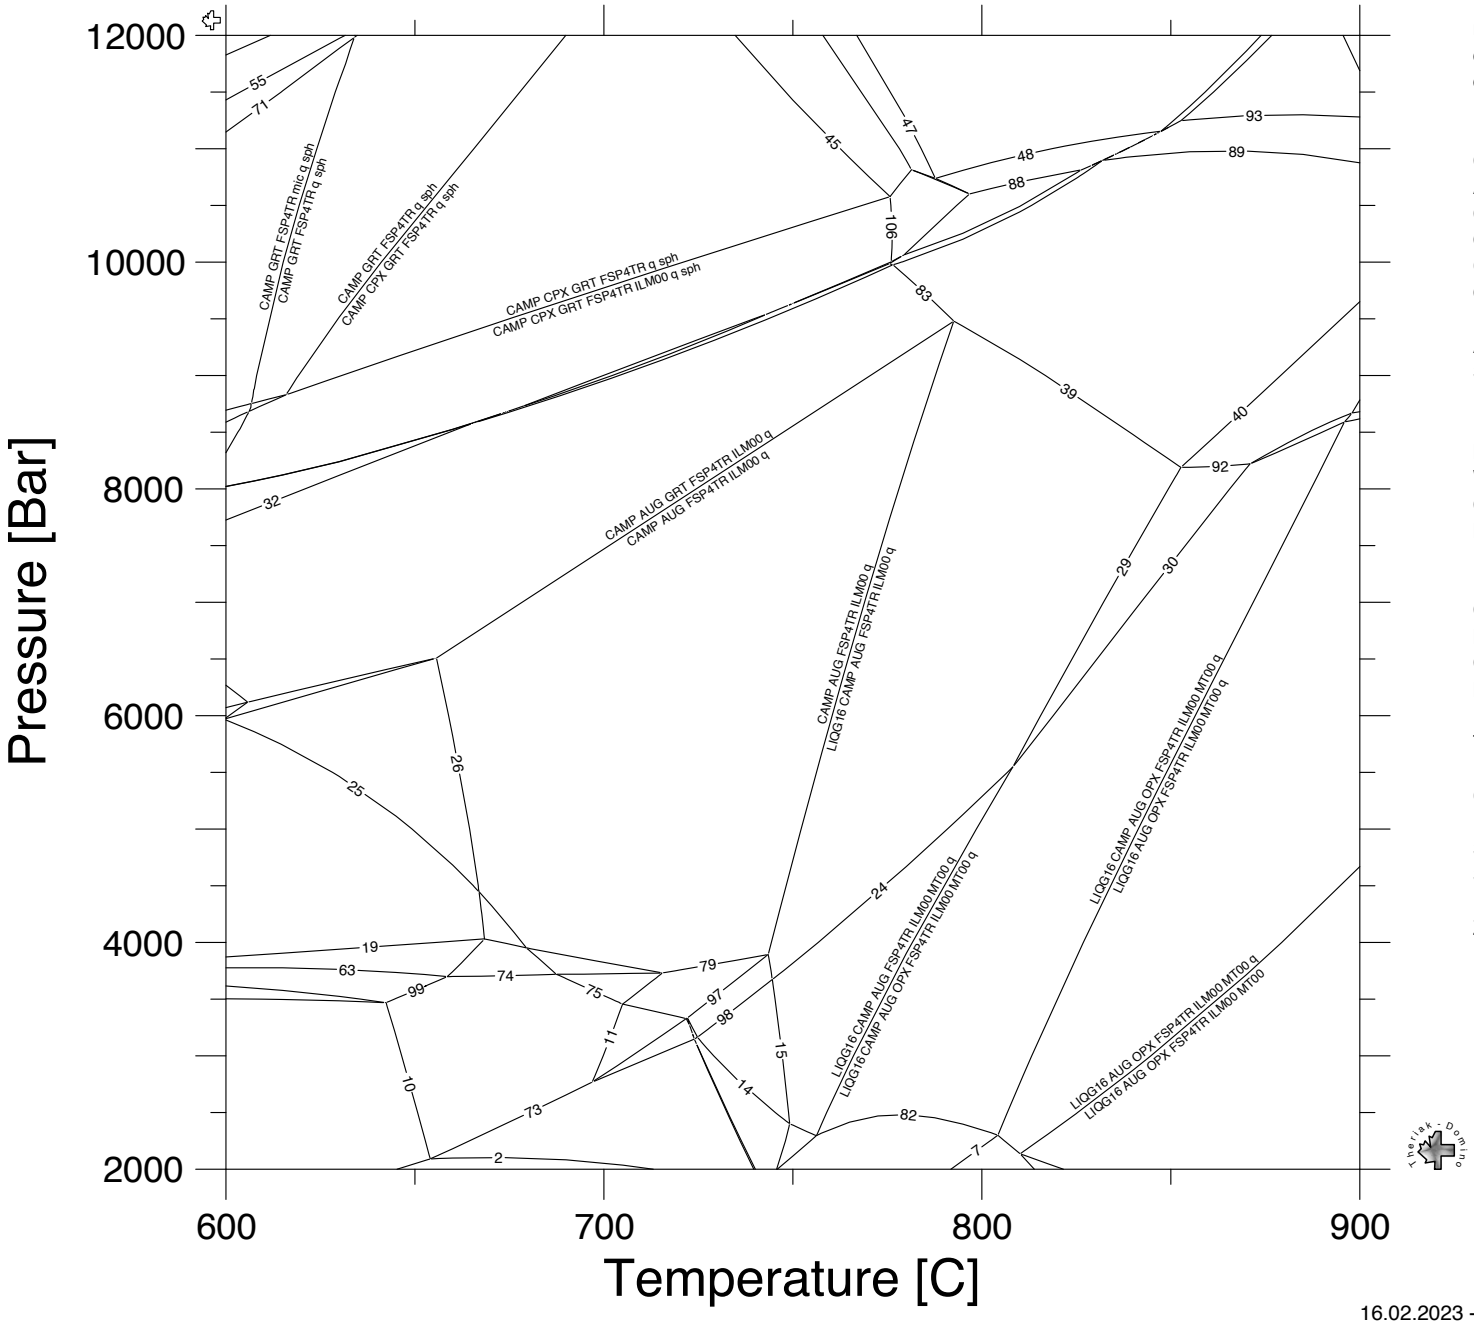

med-H BL478
domino version: 2023.02.16
database: td-ds62-mb50test.txt
H2O: PS94H2O
LIQG16: external+margules
CAMP: site mixing+margules
AUG: site mixing+margules
CPX: site mixing+margules
OPX: site mixing+margules
GRT: site mixing+margules
OL: site mixing+margules
FSP4TR: site mixing+margules
ABHGP: site mixing+margules
SPIN: site mixing+margules
ILM00: site mixing+margules
EPI: site mixing+margules
BIO: site mixing+margules
WM: site mixing+margules
CHL: site mixing+margules
MIN: site mixing+margules
PREH: site mixing+margules
PMP: site mixing
CRND: site mixing+margules
MT00: site mixing+margules
CTD: site mixing+margules
MRG: site mixing+margules

TEST= 0.1000E-008
LO1MAX= 350
GCMAX= 300
DELXSTAR= 0.1000E-002
STEPSTAR= 780
STEPMAX= 300
DELXMIN= 0.3000E-013
ZEROEM= 0.2220E-023
PMINAAA= 0.2225E-306
PMINXXX= 0.2442E-023
PMINXELSI=0.0000E+000

16.02.2023 - 13:10:45 CPU time: 1h 54m 43.97s