

NOTES:


1. ALL PIPES ARE PEX TUBING.
(5/8" O.D. UNLESS OTHERWISE STATED.)
2. THE PIPE DRAINS WILL BE LOCATED AT THE LOWEST POINT IN THE SYSTEM.
3. PIPING WILL BE SECURED TO PREVENT ACCIDENTAL LOW POINTS.
4. L. P. D. IS REFERRED TO AS LOW POINT DRAINS.
5. BACKFLOW PREVENTING VALVES ARE MANUFACTURED INTO CITY WATER FILL AND PUMP.

SYMBOL LEGEND

T	1 1/2" BRASS TEE
E	1 1/2" BRASS ELBOW
C	1 1/2" SWIVEL FIXTURE CONNECTION

WATER LINE SCHEDULE

1 1/4" O.D.	FLEX HOSE
1 1/2" O.D.	HIGH-PRESSURE HOSE
5/8" O.D.	PEX-TUBE (HOT)
5/8" O.D.	PEX-TUBE (COLD)

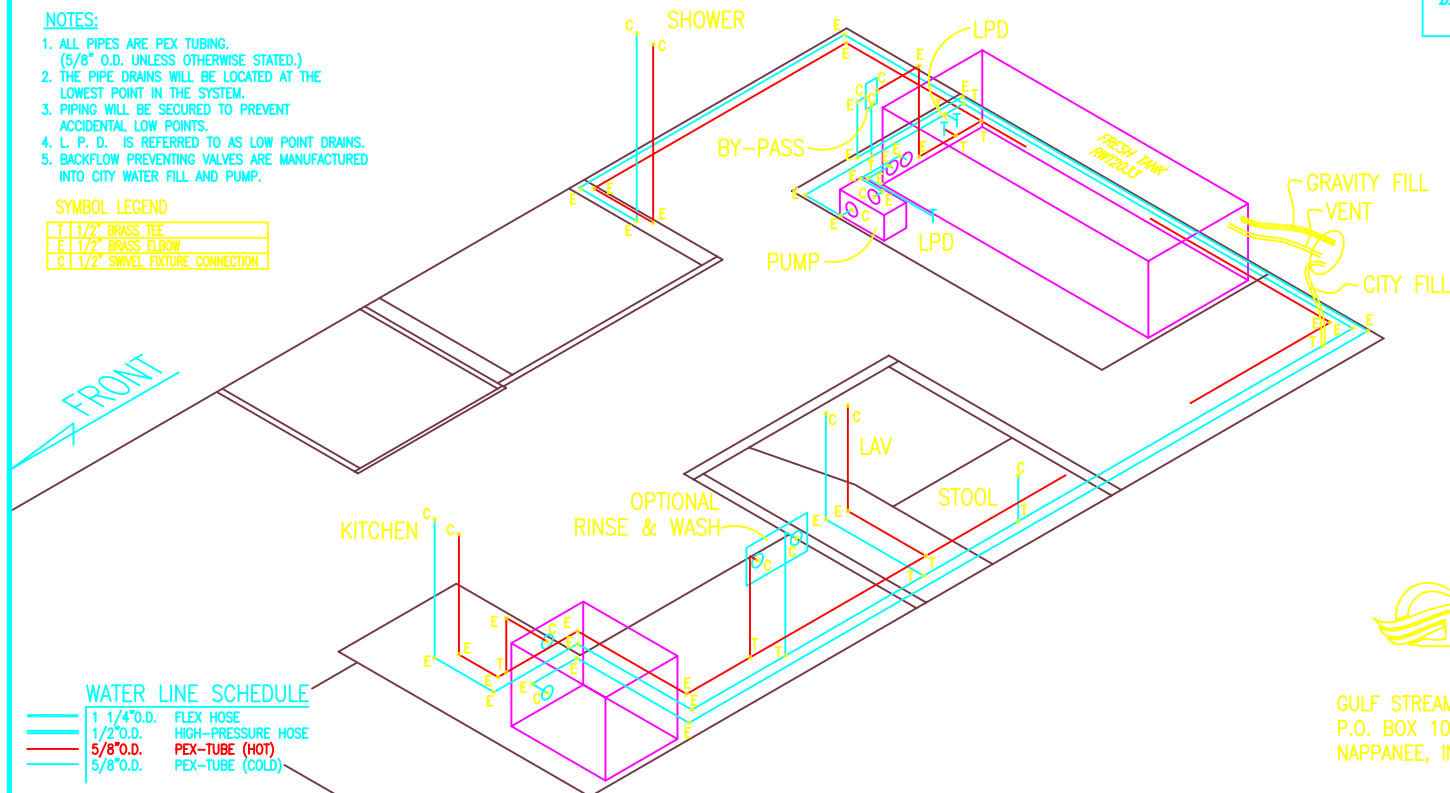

DRAWING NUMBER
CWLO064



GULF STREAM COACH, INC.
P.O. BOX 1005
NAPPANEE, IN 46550

THIS DOCUMENT IS THE SOLE PROPERTY OF GULF STREAM COACH, INC. UNAUTHORIZED USE, DISCLOSURE, OR DISSEMINATION OF INFORMATION CONTAINED HEREIN IS STRICTLY PROHIBITED. THIS DOCUMENT CONTAINS CONFIDENTIAL INFORMATION, TRADE SECRETS, AND PROPRIETARY INFORMATION AND ANY UNAUTHORIZED USE OR POSSESSION OF THIS DOCUMENT WILL WARRANT PROSECUTION. COPYRIGHT GULF STREAM COACH, INC.

NO.	REVISION	DATE	DATE OF LAST ISSUE
1.	CHG. MODEL USAGE	SB 10/15/99	
2.	ADDED SYMBOLS	SB 3/10/2000	4-2-99
3.	MOVED WATER TANK	SB 5/20/2002	11-15-99
			4-7-2000

W6280E

SCALE: 3/8

APPROVED BY DRAWN BY: SB

DATE: 3/15/99

FRESH WATER SUPPLY

DRAWING NUMBER
CWLO064