
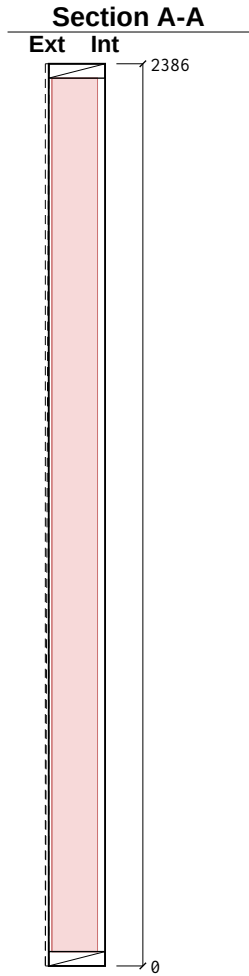
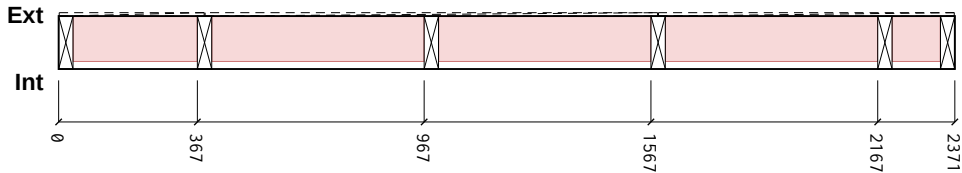


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

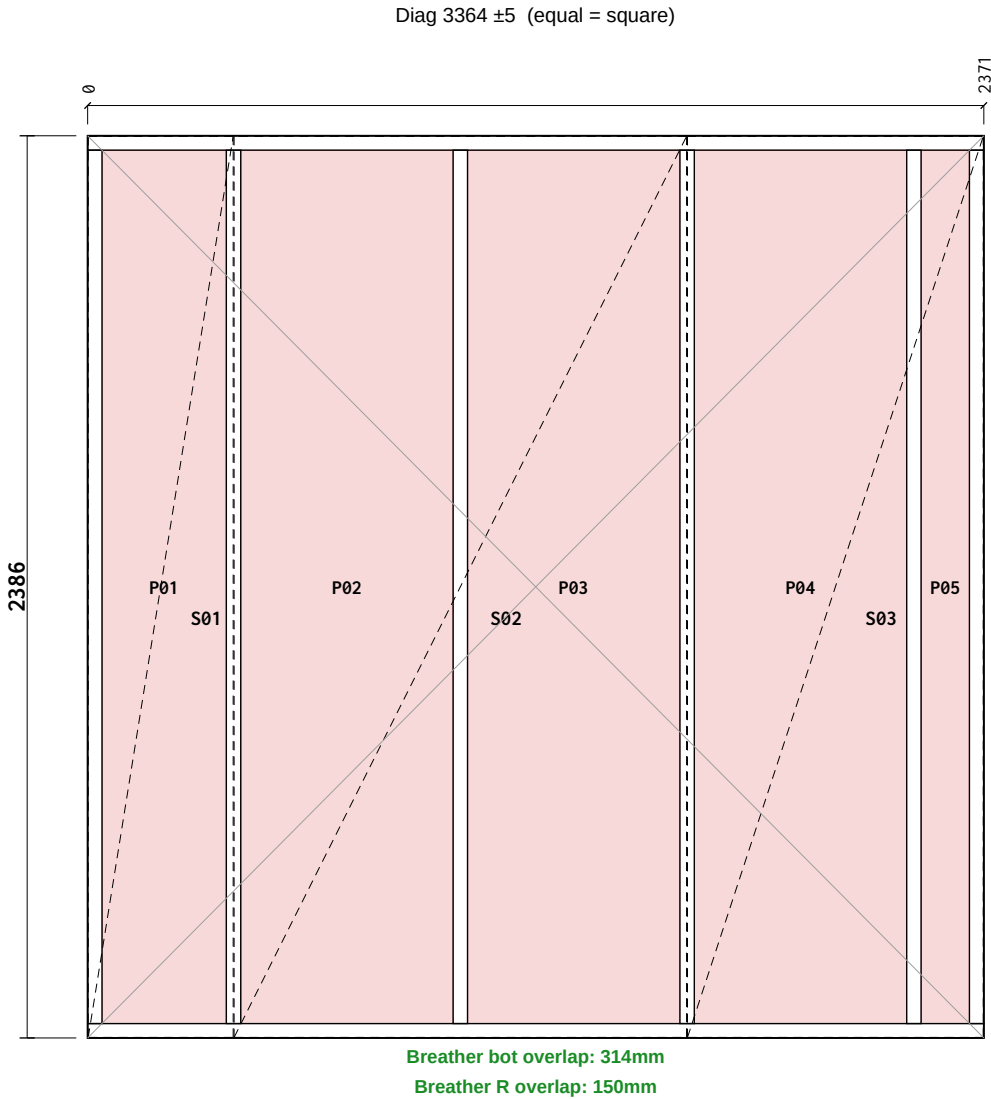

## Cut List

| Item                   | Section    | Len  | Bot° | Top° | Qty |
|------------------------|------------|------|------|------|-----|
| BR1 Bottom Rail        | 38×140 C16 | 2371 | 0    | 0    | 1   |
| TR1 Top Rail           | 38×140 C16 | 2371 | 0    | 0    | 1   |
| ES1 End Stud           | 38×140 C16 | 2310 | 0    | 0    | 1   |
| ES2 End Stud           | 38×140 C16 | 2310 | 0    | 0    | 1   |
| VS1 Vertical Stud      | 38×140 C16 | 2310 | 0    | 0    | 4   |
| Total: 8 pcs / 18.60 m |            |      |      |      |     |

## Sheathing & Insulation

| Material  | W    | H    | Label |
|-----------|------|------|-------|
| OSB 9mm   | 384  | 2383 | S01   |
| OSB 9mm   | 1197 | 2383 | S02   |
| OSB 9mm   | 782  | 2383 | S03   |
| PIR 120mm | 328  | 2310 | P01   |
| PIR 120mm | 561  | 2310 | P02   |
| PIR 120mm | 561  | 2310 | P03   |
| PIR 120mm | 561  | 2310 | P04   |
| PIR 120mm | 127  | 2310 | P05   |

### General Notes:

**Frame Nailing:**  
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails  
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**  
Components ≤ 100mm should be +/- 1mm  
Components > 100mm should be +/- 1.5mm  
Stepped check should be +/- 1.5mm  
Sloped Opening sizes are +/-2mm


**Nailing:**  
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**  
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).  
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**  
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

**Panel Changes:**  
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

### KEY PLAN






Revisions (Rev · Date · Note):

C01 - Construction issue

|                 |            |                                      |      |        |             |          |  |              |
|-----------------|------------|--------------------------------------|------|--------|-------------|----------|--|--------------|
| Date:           | 2026-09-13 | Scale:                               | 1:20 | Drawn: | TS          | Checked: |  |              |
| Project Name:   |            | MP Adams Plot 3, Eckington           |      |        |             |          |  |              |
| Site:           |            | Eckington                            |      |        | Client:     |          |  | MP Adams     |
| Title:          |            | Panel Fabrication — 38 x 140 C16 CLS |      |        |             |          |  |              |
| Project Number: |            | P3                                   |      |        | Revision:   |          |  | C01          |
| Panel No:       |            | GF-EX1                               |      |        | Drawing No: |          |  | P3-MF-GF-EX1 |
| Panel L×H×T:    |            | 2371×2386×149                        |      |        | Weight:     |          |  | 93 kg        |
| Status:         |            | CONSTRUCTION                         |      |        | Sheet:      |          |  | 1 / 1        |

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

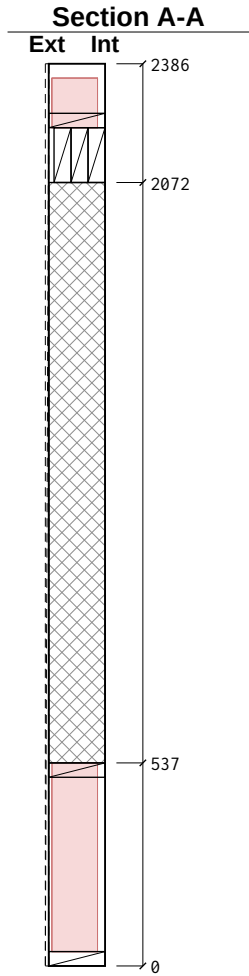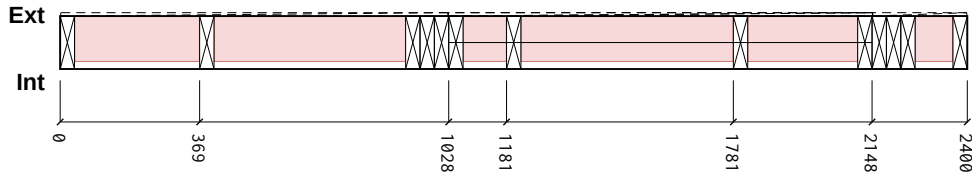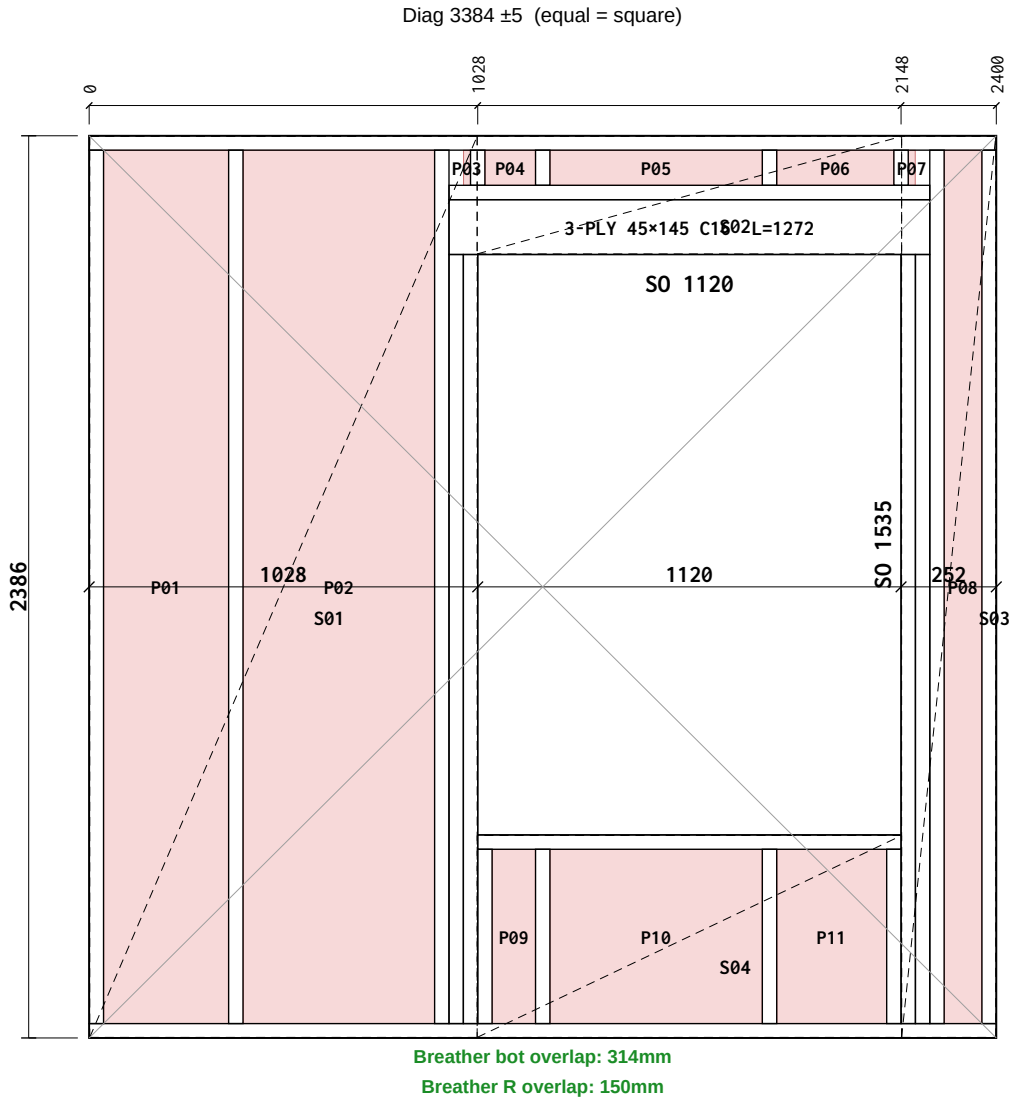

## Cut List

| Item              | Section     | Len  | Bot° | Top° | Qty |
|-------------------|-------------|------|------|------|-----|
| BR1 Bottom Rail   | 38×140 C16  | 2400 | 0    | 0    | 1   |
| TR1 Top Rail      | 38×140 C16  | 2400 | 0    | 0    | 1   |
| TR2 Top Rail      | 38×140 C16  | 1272 | 0    | 0    | 1   |
| ES1 End Stud      | 38×140 C16  | 2310 | 0    | 0    | 1   |
| ES2 End Stud      | 38×140 C16  | 2310 | 0    | 0    | 1   |
| KS1 Vertical Stud | 38×140 C16  | 2310 | 0    | 0    | 2   |
| CS1 Cripple Stud  | 38×140 C16  | 2034 | 0    | 0    | 4   |
| SP1 Sill Plate    | 38×140 C16  | 1120 | 0    | 0    | 1   |
| LP1 Lintel Ply    | 1272×45 C16 | 1272 | 0    | 0    | 3   |
| SS1 Sill Support  | 38×140 C16  | 461  | 0    | 0    | 2   |
| OS1 OSB Support   | 38×140 C16  | 93   | 0    | 0    | 2   |
| VS1 Vertical Stud | 38×140 C16  | 2310 | 0    | 0    | 1   |
| VS2 Vertical Stud | 38×140 C16  | 461  | 0    | 0    | 2   |
| VS3 Vertical Stud | 38×140 C16  | 93   | 0    | 0    | 2   |

Total: 24 pcs / 32.91 m

## Sheathing & Insulation

| Material  | W    | H    | Label |
|-----------|------|------|-------|
| OSB 9mm   | 1025 | 2383 | S01   |
| OSB 9mm   | 1123 | 311  | S02   |
| OSB 9mm   | 249  | 2383 | S03   |
| OSB 9mm   | 1123 | 534  | S04   |
| PIR 120mm | 330  | 2310 | P01   |
| PIR 120mm | 505  | 2310 | P02   |
| PIR 120mm | 18   | 93   | P03   |
| PIR 120mm | 133  | 93   | P04   |
| PIR 120mm | 561  | 93   | P05   |
| PIR 120mm | 309  | 93   | P06   |
| PIR 120mm | 18   | 93   | P07   |
| PIR 120mm | 99   | 2310 | P08   |
| PIR 120mm | 114  | 460  | P09   |
| PIR 120mm | 561  | 460  | P10   |
| PIR 120mm | 290  | 460  | P11   |

### General Notes:

**Frame Nailing:**  
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails  
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**  
Components ≤ 100mm should be +/- 1mm  
Components > 100mm should be +/- 1.5mm  
Stepped check should be +/- 1.5mm  
Sloped Opening sizes are +/-2mm


**Nailing:**  
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**  
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).  
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**  
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

**Panel Changes:**  
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

### KEY PLAN



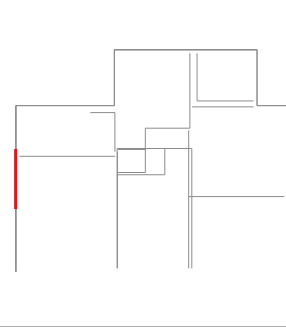


Revisions (Rev · Date · Note):

### C01 - Construction issue

|                 |            |        |      |               |    |          |  |                                      |  |  |  |              |  |  |  |
|-----------------|------------|--------|------|---------------|----|----------|--|--------------------------------------|--|--|--|--------------|--|--|--|
| Date:           | 2026-09-13 | Scale: | 1:20 | Drawn:        | TS | Checked: |  |                                      |  |  |  |              |  |  |  |
| Project Name:   |            |        |      |               |    |          |  | MP Adams Plot 3, Eckington           |  |  |  |              |  |  |  |
| Site:           |            |        |      | Eckington     |    |          |  | Client:                              |  |  |  | MP Adams     |  |  |  |
| Title:          |            |        |      |               |    |          |  | Panel Fabrication — 38 x 140 C16 CLS |  |  |  |              |  |  |  |
| Project Number: |            |        |      | P3            |    |          |  | Revision:                            |  |  |  | C01          |  |  |  |
| Panel No:       |            |        |      | GF-EX2        |    |          |  | Drawing No:                          |  |  |  | P3-MF-GF-EX2 |  |  |  |
| Panel L×H×T:    |            |        |      | 2400×2386×149 |    |          |  | Weight:                              |  |  |  | 109 kg       |  |  |  |
| Status:         |            |        |      | CONSTRUCTION  |    |          |  | Sheet:                               |  |  |  | 1 / 1        |  |  |  |

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

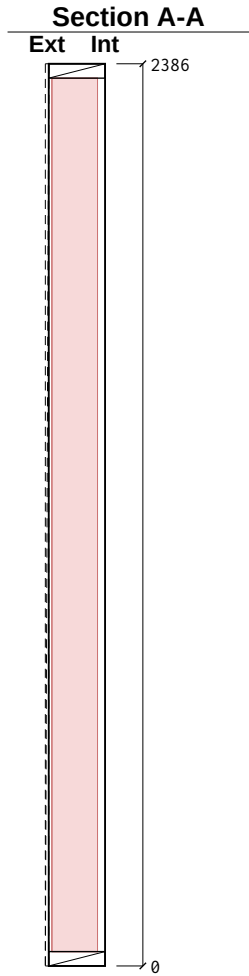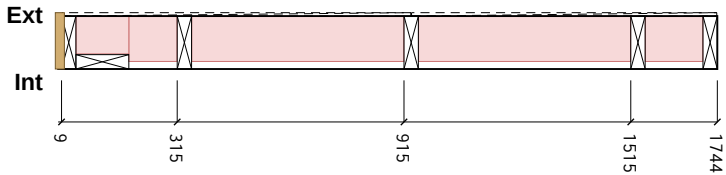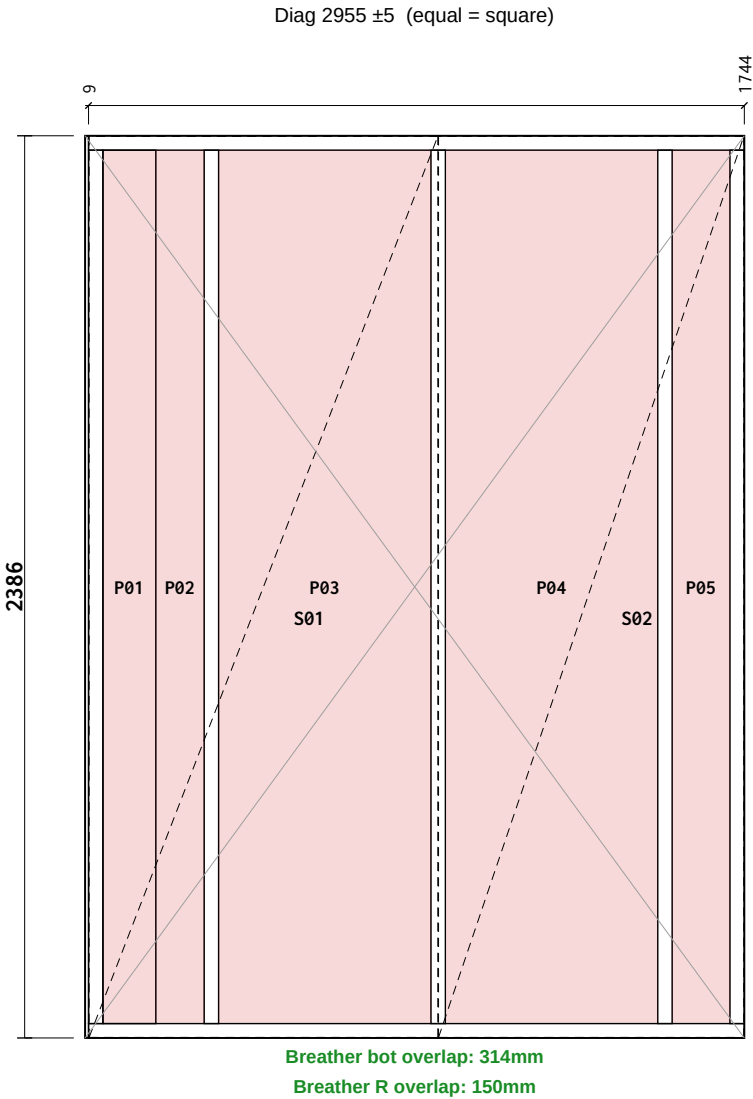

### Cut List

| Item                   | Section    | Len  | Bot° | Top° | Qty |
|------------------------|------------|------|------|------|-----|
| BR1 Bottom Rail        | 38×140 C16 | 1735 | 0    | 0    | 1   |
| TR1 Top Rail           | 38×140 C16 | 1735 | 0    | 0    | 1   |
| ES1 End Stud           | 38×140 C16 | 2310 | 0    | 0    | 1   |
| ES2 End Stud           | 38×140 C16 | 2310 | 0    | 0    | 1   |
| VS1 Vertical Stud      | 38×140 C16 | 2310 | 0    | 0    | 3   |
| JS1 Junction Stud      | 38×140 C16 | 2310 | 0    | 0    | 1   |
| Total: 8 pcs / 17.33 m |            |      |      |      |     |

### Sheathing & Insulation

| Material        | W   | H    | Label |
|-----------------|-----|------|-------|
| OSB 9mm         | 923 | 2383 | S01   |
| OSB 9mm         | 807 | 2383 | S02   |
| PIR 100mm       | 140 | 2310 | P01   |
| PIR 120mm       | 128 | 2310 | P02   |
| PIR 120mm       | 561 | 2310 | P03   |
| PIR 120mm       | 561 | 2310 | P04   |
| PIR 120mm       | 152 | 2310 | P05   |
| OSB End Cap 9mm | 146 | 2383 | E01   |

#### General Notes:

**Frame Nailing:**  
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails  
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**  
Components ≤ 100mm should be +/- 1mm  
Components > 100mm should be +/- 1.5mm  
Stepped check should be +/- 1.5mm  
Sloped Opening sizes are +/-2mm


**Nailing:**  
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**  
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).  
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**  
Laps 100mm horizontal / 150mm vertical, upper lapping lower.




**Panel Changes:**  
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

#### KEY PLAN



|                                |                                      |                            |      |             |              |          |  |
|--------------------------------|--------------------------------------|----------------------------|------|-------------|--------------|----------|--|
| Revisions (Rev · Date · Note): |                                      | C01 - Construction issue   |      |             |              |          |  |
| Date:                          | 2026-09-13                           | Scale:                     | 1:20 | Drawn:      | TS           | Checked: |  |
| Project Name:                  |                                      | MP Adams Plot 3, Eckington |      |             |              |          |  |
| Site:                          | Eckington                            |                            |      | Client:     | MP Adams     |          |  |
| Title:                         | Panel Fabrication — 38 x 140 C16 CLS |                            |      |             |              |          |  |
| Project Number:                | P3                                   |                            |      | Revision:   | C01          |          |  |
| Panel No:                      | GF-EX3                               |                            |      | Drawing No: | P3-MF-GF-EX3 |          |  |
| Panel L×H×T:                   | 1744×2386×149                        |                            |      | Weight:     | 78 kg        |          |  |
| Status:                        | CONSTRUCTION                         |                            |      | Sheet:      | 1 / 1        |          |  |

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

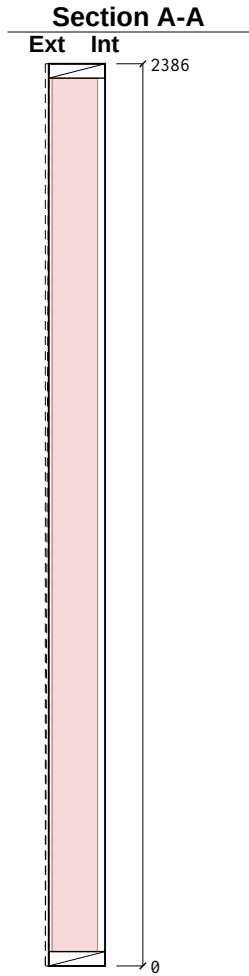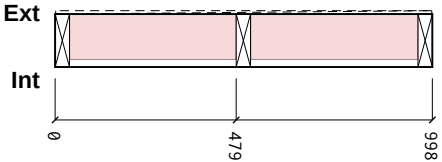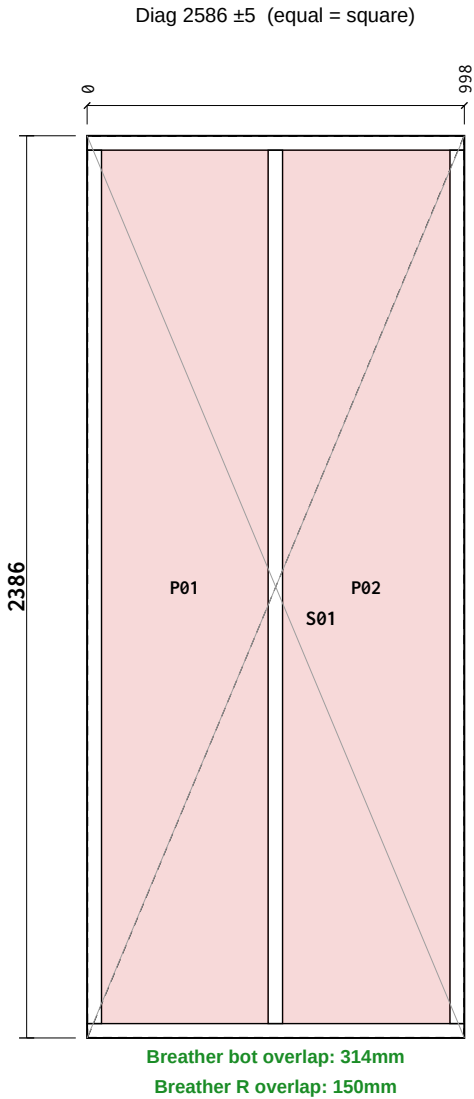

### Cut List

| Item                  | Section    | Len  | Bot° | Top° | Qty |
|-----------------------|------------|------|------|------|-----|
| BR1 Bottom Rail       | 38×140 C16 | 998  | 0    | 0    | 1   |
| TR1 Top Rail          | 38×140 C16 | 998  | 0    | 0    | 1   |
| ES1 End Stud          | 38×140 C16 | 2310 | 0    | 0    | 1   |
| ES2 End Stud          | 38×140 C16 | 2310 | 0    | 0    | 1   |
| VS1 Vertical Stud     | 38×140 C16 | 2310 | 0    | 0    | 1   |
| Total: 5 pcs / 8.93 m |            |      |      |      |     |

### Sheathing & Insulation

| Material  | W   | H    | Label |
|-----------|-----|------|-------|
| OSB 9mm   | 995 | 2383 | S01   |
| PIR 120mm | 440 | 2310 | P01   |
| PIR 120mm | 442 | 2310 | P02   |

#### General Notes:

**Frame Nailing:**  
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails  
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**  
Components ≤ 100mm should be +/- 1mm  
Components > 100mm should be +/- 1.5mm  
Stepped check should be +/- 1.5mm  
Sloped Opening sizes are +/-2mm


**Nailing:**  
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**  
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).  
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**  
Laps 100mm horizontal / 150mm vertical, upper lapping lower.




**Panel Changes:**  
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

#### KEY PLAN



|                                |                                      |                            |      |             |              |          |  |
|--------------------------------|--------------------------------------|----------------------------|------|-------------|--------------|----------|--|
| Revisions (Rev · Date · Note): |                                      | C01 - Construction issue   |      |             |              |          |  |
| Date:                          | 2026-09-13                           | Scale:                     | 1:20 | Drawn:      | TS           | Checked: |  |
| Project Name:                  |                                      | MP Adams Plot 3, Eckington |      |             |              |          |  |
| Site:                          | Eckington                            |                            |      | Client:     | MP Adams     |          |  |
| Title:                         | Panel Fabrication — 38 x 140 C16 CLS |                            |      |             |              |          |  |
| Project Number:                | P3                                   |                            |      | Revision:   | C01          |          |  |
| Panel No:                      | GF-EX4                               |                            |      | Drawing No: | P3-MF-GF-EX4 |          |  |
| Panel L×H×T:                   | 998×2386×149                         |                            |      | Weight:     | 42 kg        |          |  |
| Status:                        | CONSTRUCTION                         |                            |      | Sheet:      | 1 / 1        |          |  |

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

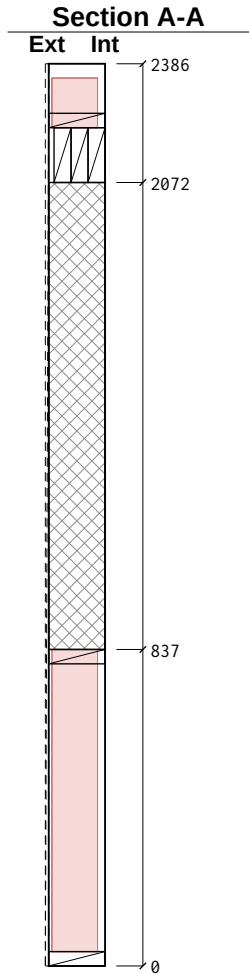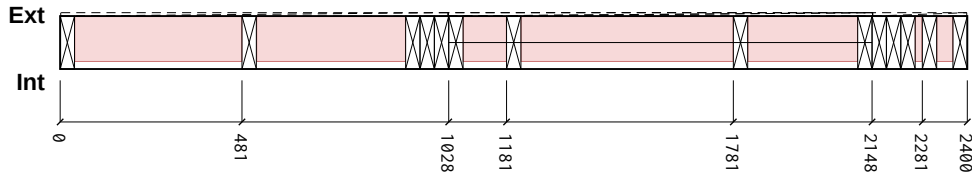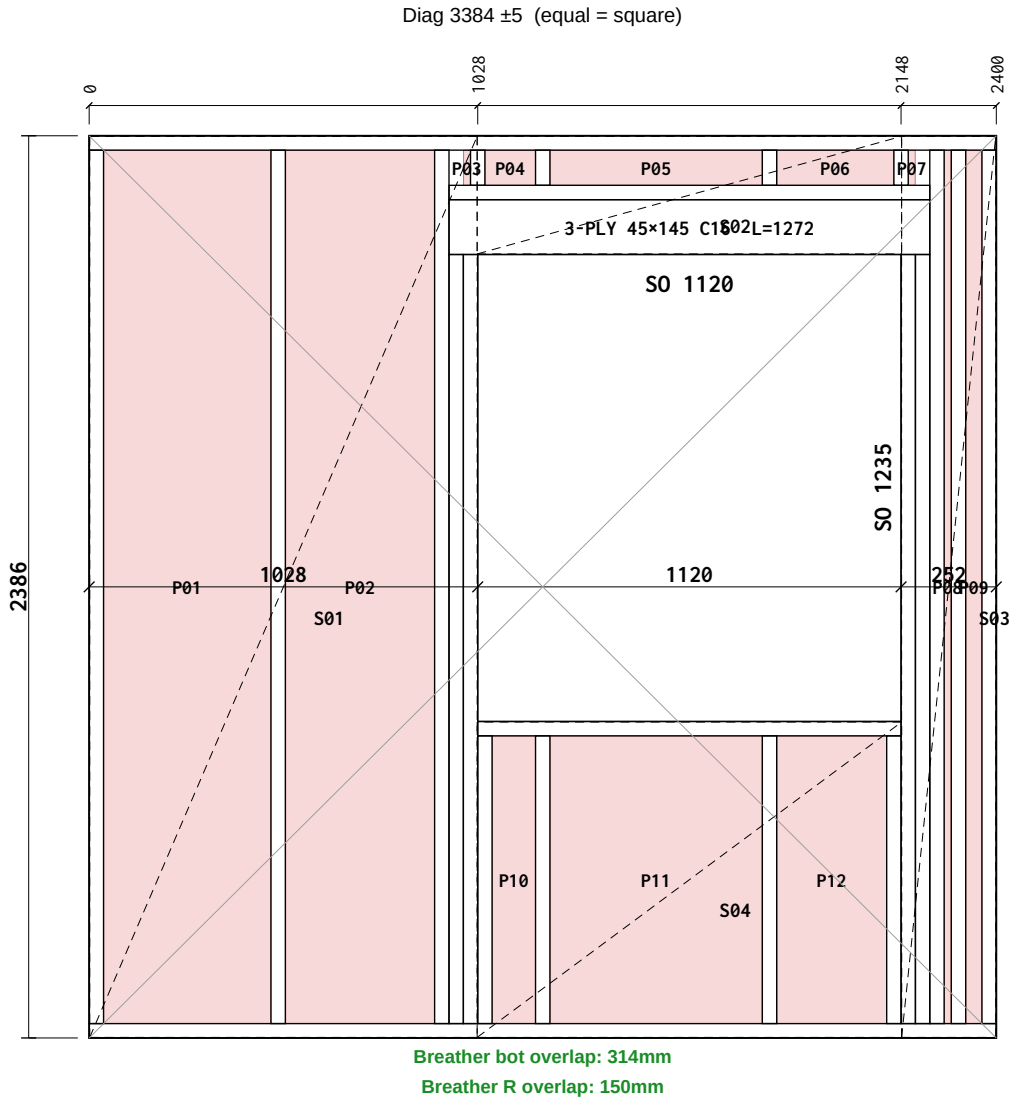

## Cut List

| Item              | Section     | Len  | Bot° | Top° | Qty |
|-------------------|-------------|------|------|------|-----|
| BR1 Bottom Rail   | 38×140 C16  | 2400 | 0    | 0    | 1   |
| TR1 Top Rail      | 38×140 C16  | 2400 | 0    | 0    | 1   |
| TR2 Top Rail      | 38×140 C16  | 1272 | 0    | 0    | 1   |
| ES1 End Stud      | 38×140 C16  | 2310 | 0    | 0    | 1   |
| ES2 End Stud      | 38×140 C16  | 2310 | 0    | 0    | 1   |
| KS1 Vertical Stud | 38×140 C16  | 2310 | 0    | 0    | 2   |
| CS1 Cripple Stud  | 38×140 C16  | 2034 | 0    | 0    | 4   |
| SP1 Sill Plate    | 38×140 C16  | 1120 | 0    | 0    | 1   |
| LP1 Lintel Ply    | 1272×45 C16 | 1272 | 0    | 0    | 3   |
| SS1 Sill Support  | 38×140 C16  | 761  | 0    | 0    | 2   |
| OS1 OSB Support   | 38×140 C16  | 93   | 0    | 0    | 2   |
| VS1 Vertical Stud | 38×140 C16  | 2310 | 0    | 0    | 2   |
| VS2 Vertical Stud | 38×140 C16  | 761  | 0    | 0    | 2   |
| VS3 Vertical Stud | 38×140 C16  | 93   | 0    | 0    | 2   |

Total: 25 pcs / 36.42 m

## Sheathing & Insulation

| Material  | W    | H    | Label |
|-----------|------|------|-------|
| OSB 9mm   | 1025 | 2383 | S01   |
| OSB 9mm   | 1123 | 311  | S02   |
| OSB 9mm   | 249  | 2383 | S03   |
| OSB 9mm   | 1123 | 834  | S04   |
| PIR 120mm | 442  | 2310 | P01   |
| PIR 120mm | 394  | 2310 | P02   |
| PIR 120mm | 18   | 93   | P03   |
| PIR 120mm | 133  | 93   | P04   |
| PIR 120mm | 561  | 93   | P05   |
| PIR 120mm | 309  | 93   | P06   |
| PIR 120mm | 18   | 93   | P07   |
| PIR 120mm | 17   | 2310 | P08   |
| PIR 120mm | 42   | 2310 | P09   |
| PIR 120mm | 114  | 760  | P10   |
| PIR 120mm | 561  | 760  | P11   |
| PIR 120mm | 290  | 760  | P12   |

### General Notes:

**Frame Nailing:**  
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails  
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**  
Components ≤ 100mm should be +/- 1mm  
Components > 100mm should be +/- 1.5mm  
Stepped check should be +/- 1.5mm  
Sloped Opening sizes are +/-2mm


**Nailing:**  
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**  
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).  
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**  
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

**Panel Changes:**  
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

### KEY PLAN

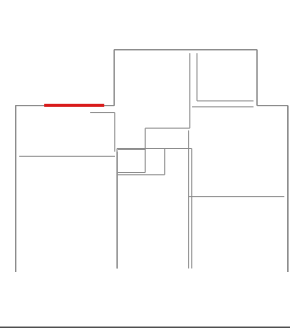



Revisions (Rev · Date · Note):

### C01 - Construction issue


|                 |            |                                      |      |             |    |              |  |
|-----------------|------------|--------------------------------------|------|-------------|----|--------------|--|
| Date:           | 2026-09-13 | Scale:                               | 1:20 | Drawn:      | TS | Checked:     |  |
| Project Name:   |            | MP Adams Plot 3, Eckington           |      |             |    |              |  |
| Site:           |            | Eckington                            |      | Client:     |    | MP Adams     |  |
| Title:          |            | Panel Fabrication — 38 x 140 C16 CLS |      |             |    |              |  |
| Project Number: |            | P3                                   |      | Revision:   |    | C01          |  |
| Panel No:       |            | GF-EX5                               |      | Drawing No: |    | P3-MF-GF-EX5 |  |
| Panel L×H×T:    |            | 2400×2386×149                        |      | Weight:     |    | 119 kg       |  |
| Status:         |            | CONSTRUCTION                         |      | Sheet:      |    | 1 / 1        |  |

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2446 ±5 (equal = square)

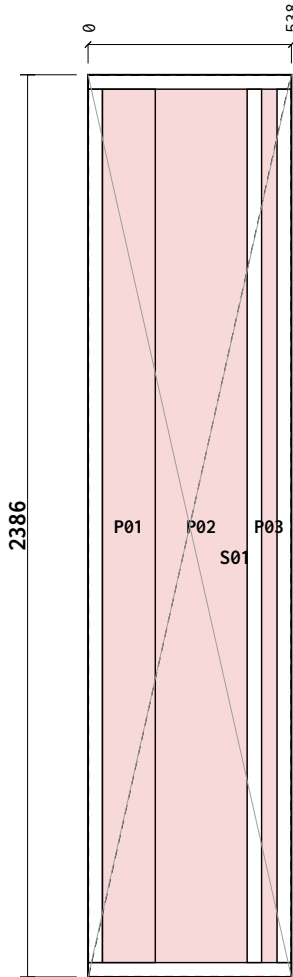

### Section A-A

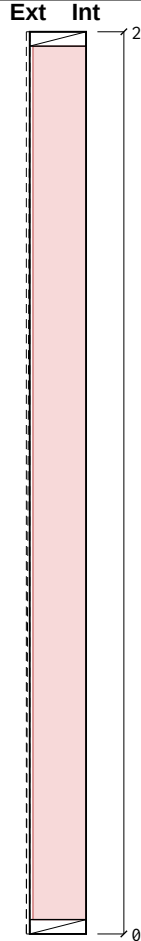

### Cut List

| Item                   | Section    | Len  | Bot° | Top° | Qty |
|------------------------|------------|------|------|------|-----|
| BR1 Bottom Rail        | 38×140 C16 | 538  | 0    | 0    | 1   |
| TR1 Top Rail           | 38×140 C16 | 538  | 0    | 0    | 1   |
| ES1 End Stud           | 38×140 C16 | 2310 | 0    | 0    | 1   |
| ES2 End Stud           | 38×140 C16 | 2310 | 0    | 0    | 1   |
| VS1 Vertical Stud      | 38×140 C16 | 2310 | 0    | 0    | 1   |
| JS1 Junction Stud      | 38×140 C16 | 2310 | 0    | 0    | 1   |
| Total: 6 pcs / 10.32 m |            |      |      |      |     |

### Sheathing & Insulation

| Material  | W   | H    | Label |
|-----------|-----|------|-------|
| OSB 9mm   | 535 | 2383 | S01   |
| PIR 100mm | 140 | 2310 | P01   |
| PIR 120mm | 242 | 2310 | P02   |
| PIR 120mm | 40  | 2310 | P03   |

#### General Notes:

**Frame Nailing:**  
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails  
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**  
Components ≤ 100mm should be +/- 1mm  
Components > 100mm should be +/- 1.5mm  
Stepped check should be +/- 1.5mm  
Sloped Opening sizes are +/-2mm


**Nailing:**  
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**  
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).  
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**  
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

**Panel Changes:**  
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

#### KEY PLAN






Revisions (Rev · Date · Note):

#### C01 - Construction issue

|                 |              |                                      |      |             |              |          |  |
|-----------------|--------------|--------------------------------------|------|-------------|--------------|----------|--|
| Date:           | 2026-09-13   | Scale:                               | 1:20 | Drawn:      | TS           | Checked: |  |
| Project Name:   |              | MP Adams Plot 3, Eckington           |      |             |              |          |  |
| Site:           | Eckington    |                                      |      | Client:     | MP Adams     |          |  |
| Title:          |              | Panel Fabrication — 38 x 140 C16 CLS |      |             |              |          |  |
| Project Number: | P3           |                                      |      | Revision:   | C01          |          |  |
| Panel No:       | GF-EX6       |                                      |      | Drawing No: | P3-MF-GF-EX6 |          |  |
| Panel L×H×T:    | 538×2386×149 |                                      |      | Weight:     | 34 kg        |          |  |
| Status:         | CONSTRUCTION |                                      |      | Sheet:      | 1 / 1        |          |  |

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

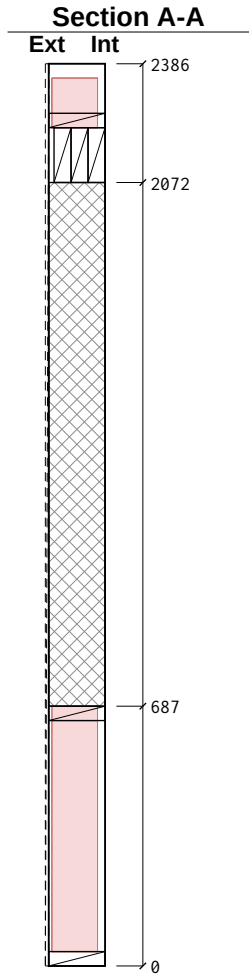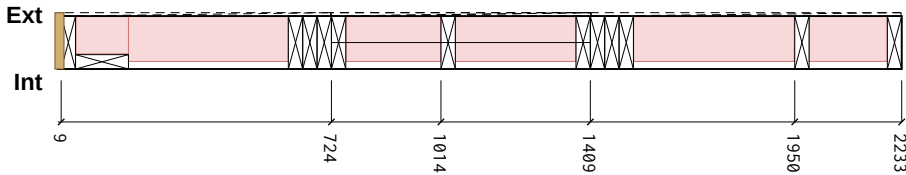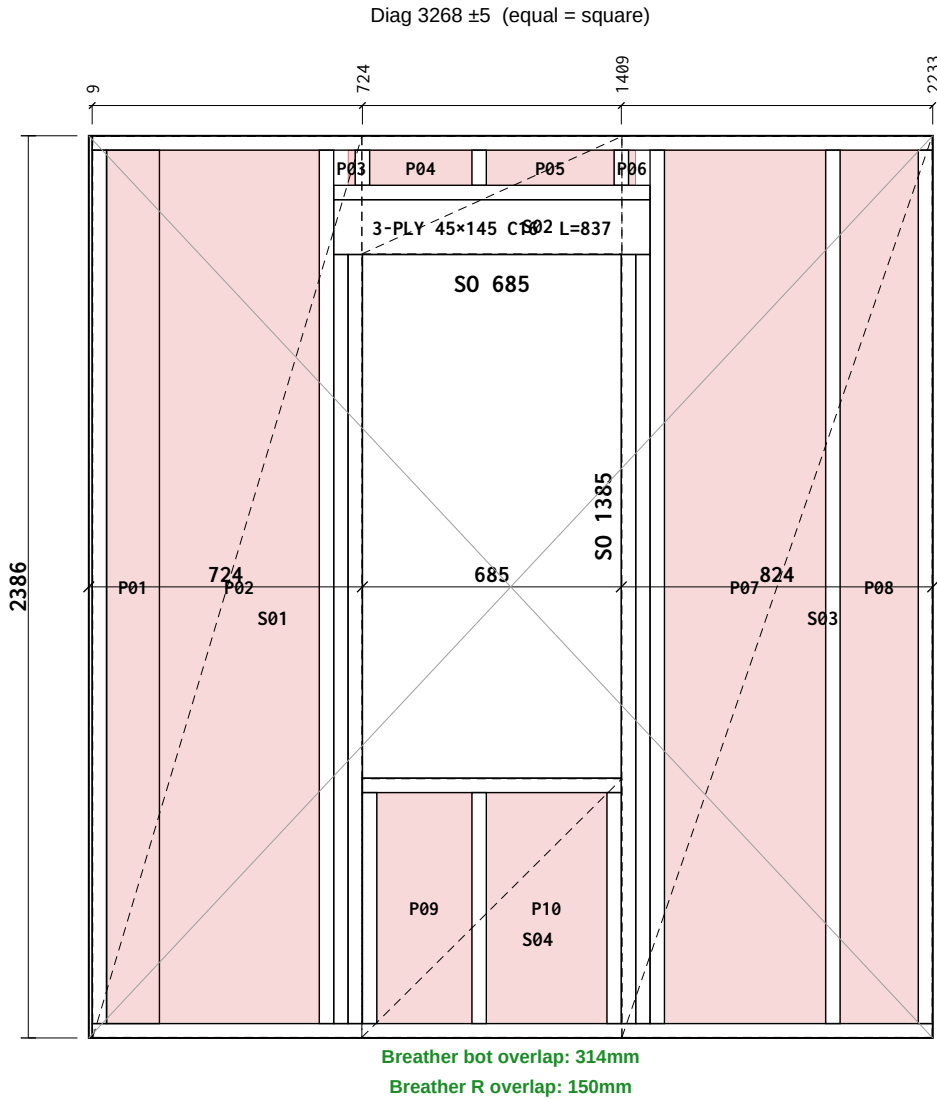

## Cut List

| Item              | Section    | Len  | Bot° | Top° | Qty |
|-------------------|------------|------|------|------|-----|
| BR1 Bottom Rail   | 38×140 C16 | 2224 | 0    | 0    | 1   |
| TR1 Top Rail      | 38×140 C16 | 2224 | 0    | 0    | 1   |
| TR2 Top Rail      | 38×140 C16 | 837  | 0    | 0    | 1   |
| ES1 End Stud      | 38×140 C16 | 2310 | 0    | 0    | 1   |
| ES2 End Stud      | 38×140 C16 | 2310 | 0    | 0    | 1   |
| KS1 Vertical Stud | 38×140 C16 | 2310 | 0    | 0    | 2   |
| CS1 Cripple Stud  | 38×140 C16 | 2034 | 0    | 0    | 4   |
| SP1 Sill Plate    | 38×140 C16 | 685  | 0    | 0    | 1   |
| LP1 Lintel Ply    | 837×45 C16 | 837  | 0    | 0    | 3   |
| SS1 Sill Support  | 38×140 C16 | 611  | 0    | 0    | 2   |
| OS1 OSB Support   | 38×140 C16 | 93   | 0    | 0    | 2   |
| VS1 Vertical Stud | 38×140 C16 | 2310 | 0    | 0    | 1   |
| VS2 Vertical Stud | 38×140 C16 | 611  | 0    | 0    | 1   |
| VS3 Vertical Stud | 38×140 C16 | 93   | 0    | 0    | 1   |
| JS1 Junction Stud | 38×140 C16 | 2310 | 0    | 0    | 1   |

Total: 23 pcs / 32.59 m

## Sheathing & Insulation

| Material        | W   | H    | Label |
|-----------------|-----|------|-------|
| OSB 9mm         | 712 | 2383 | S01   |
| OSB 9mm         | 688 | 311  | S02   |
| OSB 9mm         | 821 | 2383 | S03   |
| OSB 9mm         | 688 | 684  | S04   |
| PIR 100mm       | 139 | 2310 | P01   |
| PIR 120mm       | 422 | 2310 | P02   |
| PIR 120mm       | 18  | 93   | P03   |
| PIR 120mm       | 270 | 93   | P04   |
| PIR 120mm       | 337 | 93   | P05   |
| PIR 120mm       | 18  | 93   | P06   |
| PIR 120mm       | 425 | 2310 | P07   |
| PIR 120mm       | 206 | 2310 | P08   |
| PIR 120mm       | 251 | 610  | P09   |
| PIR 120mm       | 318 | 610  | P10   |
| OSB End Cap 9mm | 146 | 2383 | E01   |

### General Notes:

**Frame Nailing:**  
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails  
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**  
Components ≤ 100mm should be +/- 1mm  
Components > 100mm should be +/- 1.5mm  
Stepped check should be +/- 1.5mm  
Sloped Opening sizes are +/-2mm


**Nailing:**  
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**  
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).  
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**  
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

**Panel Changes:**  
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

### KEY PLAN






Revisions (Rev · Date · Note):

### C01 - Construction issue

|                 |                                      |        |      |             |              |          |  |
|-----------------|--------------------------------------|--------|------|-------------|--------------|----------|--|
| Date:           | 2026-09-13                           | Scale: | 1:20 | Drawn:      | TS           | Checked: |  |
| Project Name:   | MP Adams Plot 3, Eckington           |        |      |             |              |          |  |
| Site:           | Eckington                            |        |      | Client:     | MP Adams     |          |  |
| Title:          | Panel Fabrication — 38 x 140 C16 CLS |        |      |             |              |          |  |
| Project Number: | P3                                   |        |      | Revision:   | C01          |          |  |
| Panel No:       | GF-EX7                               |        |      | Drawing No: | P3-MF-GF-EX7 |          |  |
| Panel L×H×T:    | 2233×2386×149                        |        |      | Weight:     | 113 kg       |          |  |
| Status:         | CONSTRUCTION                         |        |      | Sheet:      | 1 / 1        |          |  |

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

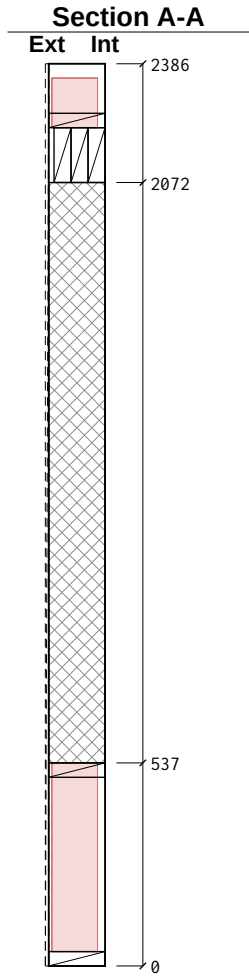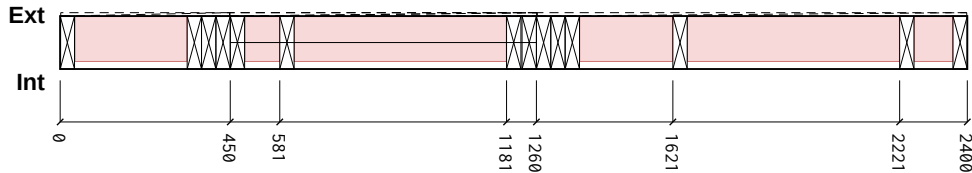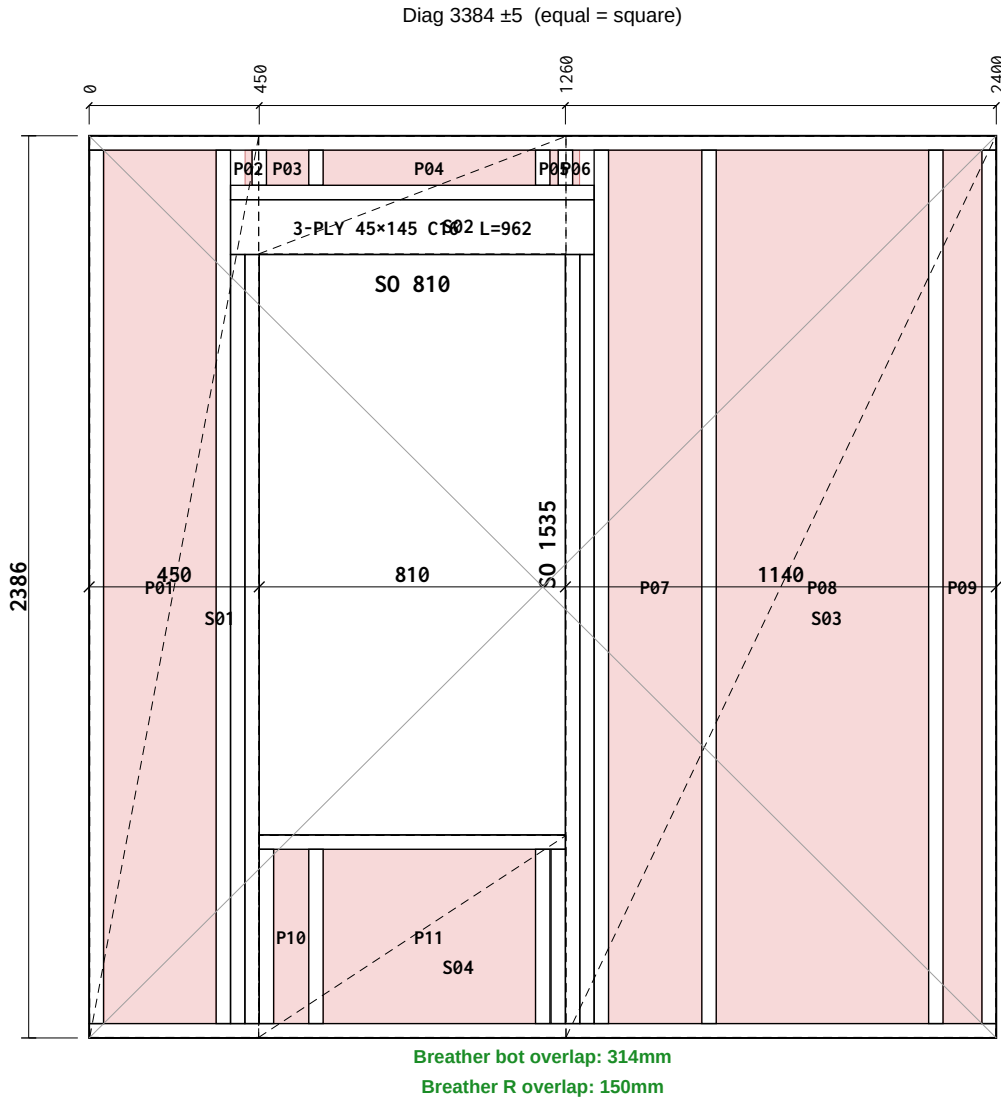

### Cut List

| Item              | Section    | Len  | Bot° | Top° | Qty |
|-------------------|------------|------|------|------|-----|
| BR1 Bottom Rail   | 38×140 C16 | 2400 | 0    | 0    | 1   |
| TR1 Top Rail      | 38×140 C16 | 2400 | 0    | 0    | 1   |
| TR2 Top Rail      | 38×140 C16 | 962  | 0    | 0    | 1   |
| ES1 End Stud      | 38×140 C16 | 2310 | 0    | 0    | 1   |
| ES2 End Stud      | 38×140 C16 | 2310 | 0    | 0    | 1   |
| KS1 Vertical Stud | 38×140 C16 | 2310 | 0    | 0    | 2   |
| CS1 Cripple Stud  | 38×140 C16 | 2034 | 0    | 0    | 4   |
| SP1 Sill Plate    | 38×140 C16 | 810  | 0    | 0    | 1   |
| LP1 Lintel Ply    | 962×45 C16 | 962  | 0    | 0    | 3   |
| SS1 Sill Support  | 38×140 C16 | 461  | 0    | 0    | 2   |
| OS1 OSB Support   | 38×140 C16 | 93   | 0    | 0    | 2   |
| VS1 Vertical Stud | 38×140 C16 | 2310 | 0    | 0    | 2   |
| VS2 Vertical Stud | 38×140 C16 | 461  | 0    | 0    | 2   |
| VS3 Vertical Stud | 38×140 C16 | 93   | 0    | 0    | 2   |

Total: 25 pcs / 33.67 m

### Sheathing & Insulation

| Material  | W    | H    | Label |
|-----------|------|------|-------|
| OSB 9mm   | 447  | 2383 | S01   |
| OSB 9mm   | 813  | 311  | S02   |
| OSB 9mm   | 1137 | 2383 | S03   |
| OSB 9mm   | 813  | 534  | S04   |
| PIR 120mm | 297  | 2310 | P01   |
| PIR 120mm | 18   | 93   | P02   |
| PIR 120mm | 111  | 93   | P03   |
| PIR 120mm | 561  | 93   | P04   |
| PIR 120mm | 21   | 93   | P05   |
| PIR 120mm | 18   | 93   | P06   |
| PIR 120mm | 245  | 2310 | P07   |
| PIR 120mm | 561  | 2310 | P08   |
| PIR 120mm | 102  | 2310 | P09   |
| PIR 120mm | 92   | 460  | P10   |
| PIR 120mm | 561  | 460  | P11   |
| PIR 120mm | 2    | 460  | P12   |

#### General Notes:

**Frame Nailing:**  
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails  
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**  
Components ≤ 100mm should be +/- 1mm  
Components > 100mm should be +/- 1.5mm  
Stepped check should be +/- 1.5mm  
Sloped Opening sizes are +/-2mm


**Nailing:**  
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**  
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).  
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**  
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

**Panel Changes:**  
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

#### KEY PLAN



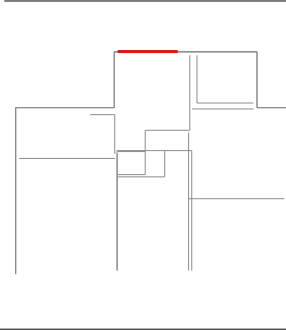


Revisions (Rev · Date · Note):

#### C01 - Construction issue

|                 |            |                                      |      |             |              |          |  |
|-----------------|------------|--------------------------------------|------|-------------|--------------|----------|--|
| Date:           | 2026-09-13 | Scale:                               | 1:20 | Drawn:      | TS           | Checked: |  |
| Project Name:   |            | MP Adams Plot 3, Eckington           |      |             |              |          |  |
| Site:           | Eckington  |                                      |      | Client:     | MP Adams     |          |  |
| Title:          |            | Panel Fabrication — 38 x 140 C16 CLS |      |             |              |          |  |
| Project Number: |            | P3                                   |      | Revision:   | C01          |          |  |
| Panel No:       |            | GF-EX8                               |      | Drawing No: | P3-MF-GF-EX8 |          |  |
| Panel L×H×T:    |            | 2400×2386×149                        |      | Weight:     | 114 kg       |          |  |
| Status:         |            | CONSTRUCTION                         |      | Sheet:      | 1 / 1        |          |  |

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

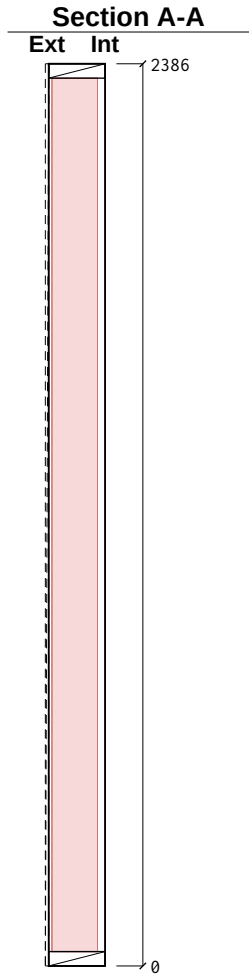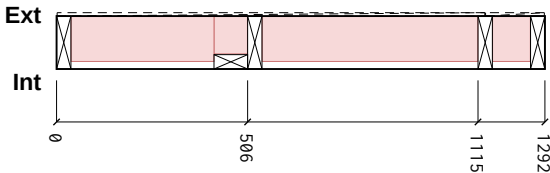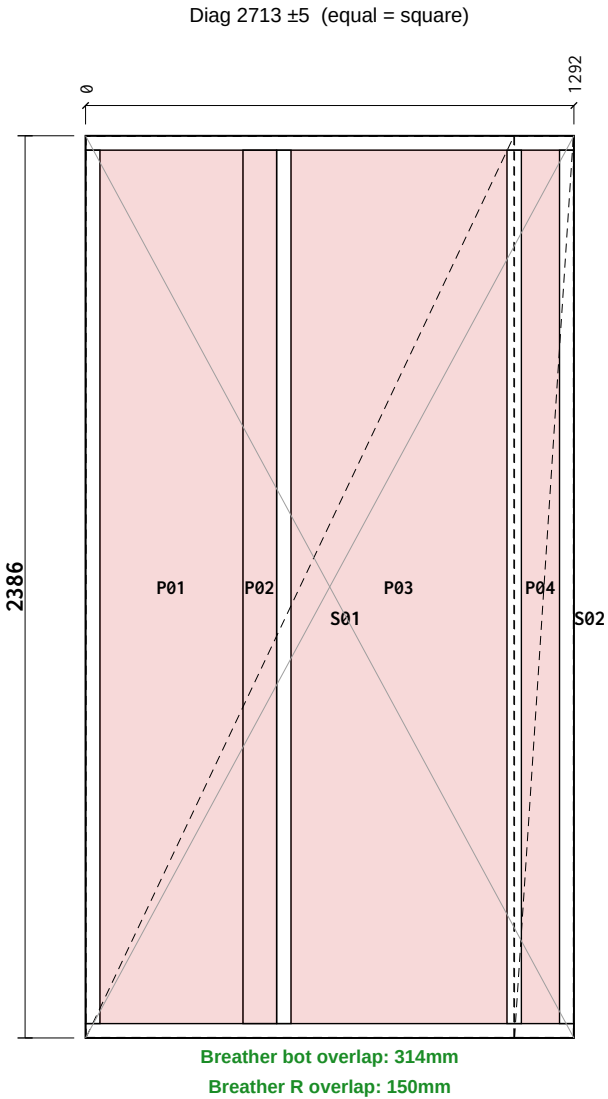

### Cut List

| Item                   | Section    | Len  | Bot° | Top° | Qty |
|------------------------|------------|------|------|------|-----|
| BR1 Bottom Rail        | 38×140 C16 | 1292 | 0    | 0    | 1   |
| TR1 Top Rail           | 38×140 C16 | 1292 | 0    | 0    | 1   |
| ES1 End Stud           | 38×140 C16 | 2310 | 0    | 0    | 1   |
| ES2 End Stud           | 38×140 C16 | 2310 | 0    | 0    | 1   |
| VS1 Vertical Stud      | 38×140 C16 | 2310 | 0    | 0    | 2   |
| JS1 Junction Stud      | 38×89 C16  | 2310 | 0    | 0    | 1   |
| Total: 7 pcs / 14.13 m |            |      |      |      |     |

### Sheathing & Insulation

| Material  | W    | H    | Label |
|-----------|------|------|-------|
| OSB 9mm   | 1131 | 2383 | S01   |
| OSB 9mm   | 156  | 2383 | S02   |
| PIR 120mm | 378  | 2310 | P01   |
| PIR 100mm | 89   | 2310 | P02   |
| PIR 120mm | 570  | 2310 | P03   |
| PIR 120mm | 100  | 2310 | P04   |

#### General Notes:

**Frame Nailing:**  
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails  
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**  
Components ≤ 100mm should be +/- 1mm  
Components > 100mm should be +/- 1.5mm  
Stepped check should be +/- 1.5mm  
Sloped Opening sizes are +/-2mm


**Nailing:**  
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**  
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).  
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**  
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

**Panel Changes:**  
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

#### KEY PLAN






Revisions (Rev · Date · Note):

#### C01 - Construction issue

|                 |               |                                      |      |             |              |          |  |
|-----------------|---------------|--------------------------------------|------|-------------|--------------|----------|--|
| Date:           | 2026-09-13    | Scale:                               | 1:20 | Drawn:      | TS           | Checked: |  |
| Project Name:   |               | MP Adams Plot 3, Eckington           |      |             |              |          |  |
| Site:           | Eckington     |                                      |      | Client:     | MP Adams     |          |  |
| Title:          |               | Panel Fabrication — 38 x 140 C16 CLS |      |             |              |          |  |
| Project Number: | P3            |                                      |      | Revision:   | C01          |          |  |
| Panel No:       | GF-EX9        |                                      |      | Drawing No: | P3-MF-GF-EX9 |          |  |
| Panel L×H×T:    | 1292×2386×149 |                                      |      | Weight:     | 57 kg        |          |  |
| Status:         | CONSTRUCTION  |                                      |      | Sheet:      | 1 / 1        |          |  |

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

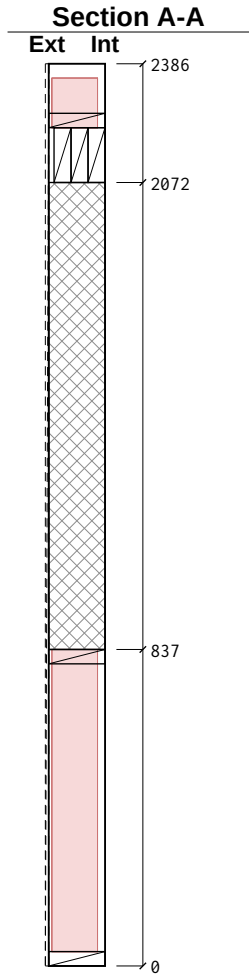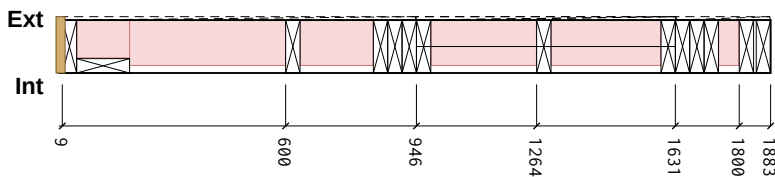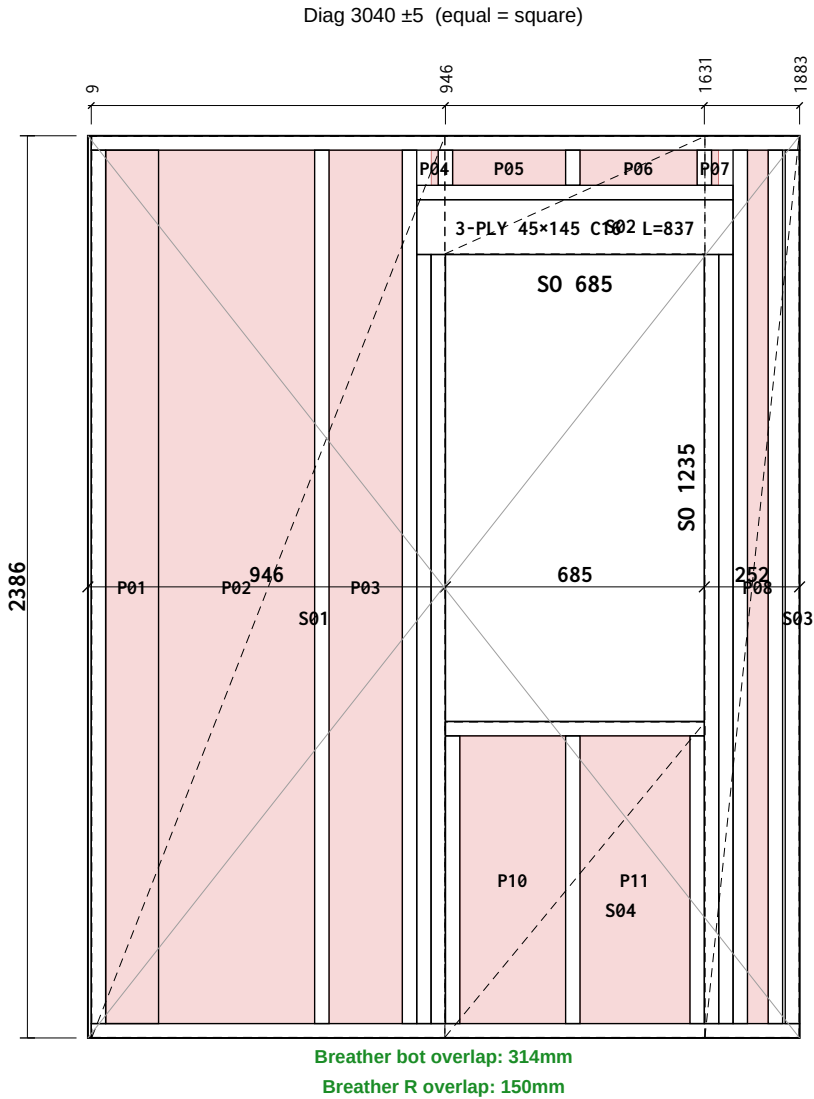

## Cut List

| Item              | Section    | Len  | Bot° | Top° | Qty |
|-------------------|------------|------|------|------|-----|
| BR1 Bottom Rail   | 38x140 C16 | 1874 | 0    | 0    | 1   |
| TR1 Top Rail      | 38x140 C16 | 1874 | 0    | 0    | 1   |
| TR2 Top Rail      | 38x140 C16 | 837  | 0    | 0    | 1   |
| ES1 End Stud      | 38x140 C16 | 2310 | 0    | 0    | 1   |
| ES2 End Stud      | 38x140 C16 | 2310 | 0    | 0    | 1   |
| KS1 Vertical Stud | 38x140 C16 | 2310 | 0    | 0    | 2   |
| CS1 Cripple Stud  | 38x140 C16 | 2034 | 0    | 0    | 4   |
| SP1 Sill Plate    | 38x140 C16 | 685  | 0    | 0    | 1   |
| LP1 Lintel Ply    | 837x45 C16 | 837  | 0    | 0    | 3   |
| SS1 Sill Support  | 38x140 C16 | 761  | 0    | 0    | 2   |
| OS1 OSB Support   | 38x140 C16 | 93   | 0    | 0    | 2   |
| VS1 Vertical Stud | 38x140 C16 | 2310 | 0    | 0    | 2   |
| VS2 Vertical Stud | 38x140 C16 | 761  | 0    | 0    | 1   |
| VS3 Vertical Stud | 38x140 C16 | 93   | 0    | 0    | 1   |
| JS1 Junction Stud | 38x140 C16 | 2310 | 0    | 0    | 1   |

Total: 24 pcs / 34.65 m

## Sheathing & Insulation

| Material        | W   | H    | Label |
|-----------------|-----|------|-------|
| OSB 9mm         | 934 | 2383 | S01   |
| OSB 9mm         | 688 | 311  | S02   |
| OSB 9mm         | 249 | 2383 | S03   |
| OSB 9mm         | 688 | 834  | S04   |
| PIR 100mm       | 140 | 2310 | P01   |
| PIR 120mm       | 412 | 2310 | P02   |
| PIR 120mm       | 193 | 2310 | P03   |
| PIR 120mm       | 18  | 93   | P04   |
| PIR 120mm       | 298 | 93   | P05   |
| PIR 120mm       | 309 | 93   | P06   |
| PIR 120mm       | 18  | 93   | P07   |
| PIR 120mm       | 53  | 2310 | P08   |
| PIR 120mm       | 6   | 2310 | P09   |
| PIR 120mm       | 279 | 760  | P10   |
| PIR 120mm       | 290 | 760  | P11   |
| OSB End Cap 9mm | 146 | 2383 | E01   |

### General Notes:

**Frame Nailing:**  
140mm Frames Nail Using 3no, 3.1x90mm length field galvanised twisted strip nails  
90mm Frames Nail Using 2no, 3.1x90mm length field galvanised twisted strip nails

**Sheathing Nails:**  
Components ≤ 100mm should be +/- 1mm  
Components > 100mm should be +/- 1.5mm  
Stepped check should be +/- 1.5mm  
Sloped Opening sizes are +/-2mm


**Nailing:**  
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**  
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).  
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**  
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

**Panel Changes:**  
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

### KEY PLAN





Revisions (Rev · Date · Note):

### C01 - Construction issue

|                 |                                      |        |      |             |               |          |  |
|-----------------|--------------------------------------|--------|------|-------------|---------------|----------|--|
| Date:           | 2026-09-13                           | Scale: | 1:20 | Drawn:      | TS            | Checked: |  |
| Project Name:   | MP Adams Plot 3, Eckington           |        |      |             |               |          |  |
| Site:           | Eckington                            |        |      | Client:     | MP Adams      |          |  |
| Title:          | Panel Fabrication — 38 x 140 C16 CLS |        |      |             |               |          |  |
| Project Number: | P3                                   |        |      | Revision:   | C01           |          |  |
| Panel No:       | GF-EX10                              |        |      | Drawing No: | P3-MF-GF-EX10 |          |  |
| Panel LxHxT:    | 1883x2386x149                        |        |      | Weight:     | 110 kg        |          |  |
| Status:         | CONSTRUCTION                         |        |      | Sheet:      | 1 / 1         |          |  |


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 3197  $\pm 5$  (equal = square)

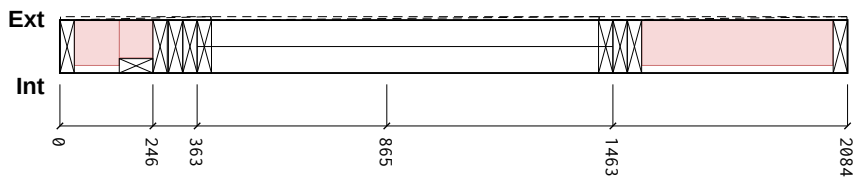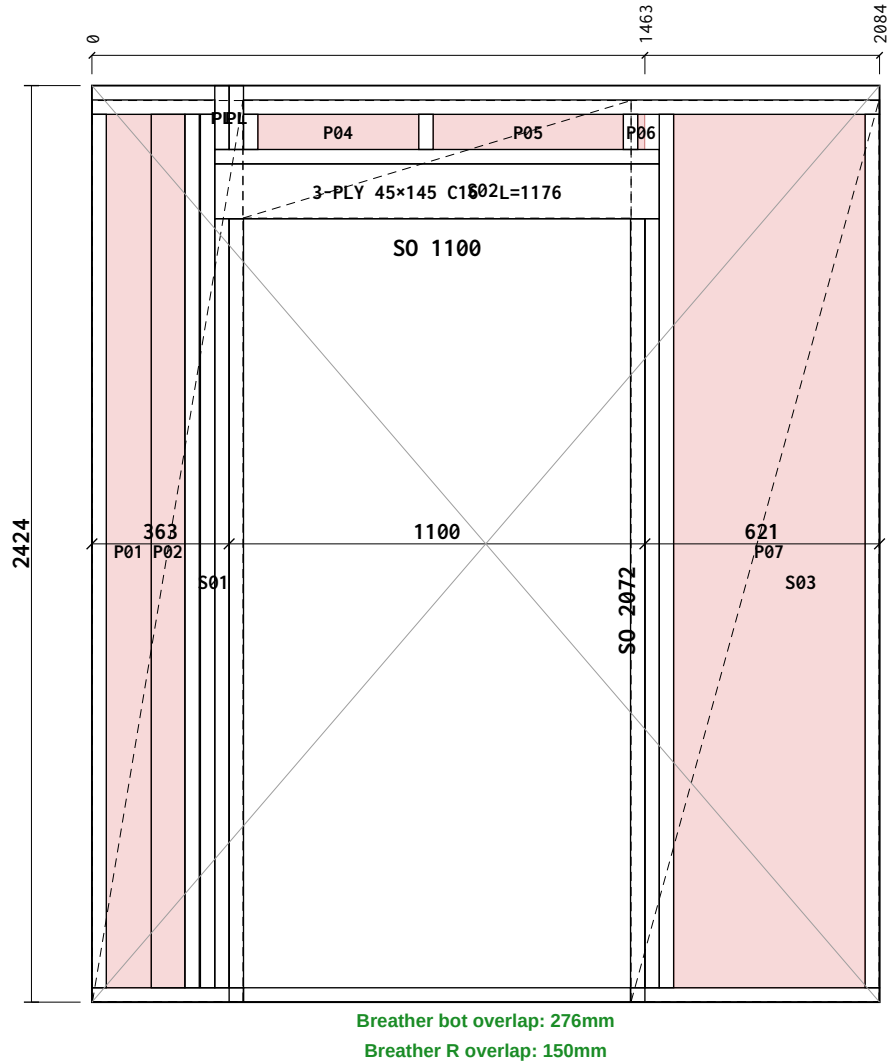

## Section A-A

| Ext | Int |
|-----|-----|
| 1   | 1   |
| 2   | 2   |
| 3   | 3   |
| 4   | 4   |
| 5   | 5   |
| 6   | 6   |
| 7   | 7   |
| 8   | 8   |
| 9   | 9   |
| 10  | 10  |
| 11  | 11  |
| 12  | 12  |
| 13  | 13  |
| 14  | 14  |
| 15  | 15  |
| 16  | 16  |
| 17  | 17  |
| 18  | 18  |
| 19  | 19  |
| 20  | 20  |
| 21  | 21  |
| 22  | 22  |
| 23  | 23  |
| 24  | 24  |
| 25  | 25  |
| 26  | 26  |
| 27  | 27  |
| 28  | 28  |
| 29  | 29  |
| 30  | 30  |
| 31  | 31  |
| 32  | 32  |
| 33  | 33  |
| 34  | 34  |
| 35  | 35  |
| 36  | 36  |
| 37  | 37  |
| 38  | 38  |
| 39  | 39  |
| 40  | 40  |
| 41  | 41  |
| 42  | 42  |
| 43  | 43  |
| 44  | 44  |
| 45  | 45  |
| 46  | 46  |
| 47  | 47  |
| 48  | 48  |
| 49  | 49  |
| 50  | 50  |
| 51  | 51  |
| 52  | 52  |
| 53  | 53  |
| 54  | 54  |
| 55  | 55  |
| 56  | 56  |
| 57  | 57  |
| 58  | 58  |
| 59  | 59  |
| 60  | 60  |
| 61  | 61  |
| 62  | 62  |
| 63  | 63  |
| 64  | 64  |
| 65  | 65  |
| 66  | 66  |
| 67  | 67  |
| 68  | 68  |
| 69  | 69  |
| 70  | 70  |
| 71  | 71  |
| 72  | 72  |
| 73  | 73  |
| 74  | 74  |
| 75  | 75  |
| 76  | 76  |
| 77  | 77  |
| 78  | 78  |
| 79  | 79  |
| 80  | 80  |
| 81  | 81  |
| 82  | 82  |
| 83  | 83  |
| 84  | 84  |
| 85  | 85  |
| 86  | 86  |
| 87  | 87  |
| 88  | 88  |
| 89  | 89  |
| 90  | 90  |
| 91  | 91  |
| 92  | 92  |
| 93  | 93  |
| 94  | 94  |
| 95  | 95  |
| 96  | 96  |
| 97  | 97  |
| 98  | 98  |
| 99  | 99  |
| 100 | 100 |

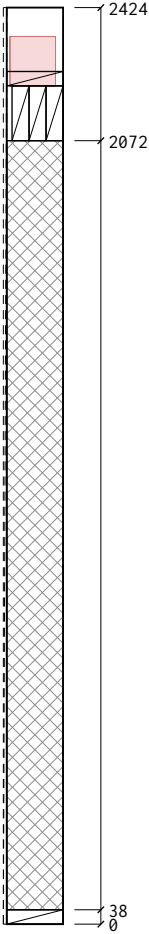

## Cut List

| Item              | Section     | Len  | Bot* | Top* | Qty |
|-------------------|-------------|------|------|------|-----|
| BR1 Bottom Rail   | 38x140 C16  | 1024 | 0    | 0    | 1   |
| BR2 Bottom Rail   | 38x140 C16  | 659  | 0    | 0    | 1   |
| BR3 Bottom Rail   | 38x140 C16  | 401  | 0    | 0    | 1   |
| TR1 Top Rail      | 38x140 C16  | 1683 | 0    | 0    | 1   |
| TR2 Top Rail      | 38x140 C16  | 1176 | 0    | 0    | 1   |
| TR3 Top Rail      | 38x140 C16  | 325  | 0    | 0    | 1   |
| ES1 End Stud      | 38x140 C16  | 2310 | 0    | 0    | 1   |
| ES2 End Stud      | 38x140 C16  | 2310 | 0    | 0    | 1   |
| KS1 Vertical Stud | 38x140 C16  | 2310 | 0    | 0    | 2   |
| CS1 Cripple Stud  | 38x140 C16  | 2034 | 0    | 0    | 4   |
| CS2 Cripple Stud  | 38x140 C16  | 93   | 0    | 0    | 1   |
| LP1 Lintel Ply    | 1176x45 C16 | 1176 | 0    | 0    | 3   |
| OS1 OSB Support   | 38x140 C16  | 93   | 0    | 0    | 1   |
| VS1 Vertical Stud | 38x140 C16  | 2310 | 0    | 0    | 1   |
| VS2 Vertical Stud | 38x140 C16  | 93   | 0    | 0    | 1   |
| JS1 Junction Stud | 38x89 C16   | 2310 | 0    | 0    | 1   |

Total: 22 pcs / 31.07 m

## Sheathing & Insulation

| Material  | W    | HLabel          |
|-----------|------|-----------------|
| OSB 9mm   | 398  | 2383 <b>S01</b> |
| OSB 9mm   | 1027 | 311 <b>S02</b>  |
| OSB 9mm   | 656  | 2383 <b>S03</b> |
| PIR 120mm | 118  | 2310 <b>P01</b> |
| PIR 100mm | 89   | 2310 <b>P02</b> |
| PIR 120mm | 1    | 2310 <b>P03</b> |
| PIR 120mm | 425  | 93 <b>P04</b>   |
| PIR 120mm | 502  | 93 <b>P05</b>   |
| PIR 120mm | 18   | 93 <b>P06</b>   |
| PIR 120mm | 505  | 2310 <b>P07</b> |

**General Notes:**

### Frame Nailing:

140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails  
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

### Sheathing Nails:

Components  $\leq 100\text{mm}$  should be  $\pm 1\text{mm}$   
 Components  $> 100\text{mm}$  should be  $\pm 1.5\text{mm}$   
 Stepped check should be  $\pm 1.5\text{mm}$   
 Sloped Opening sizes are  $\pm 2\text{mm}$

**Nailing:**

30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

### Manufacturing Tolerances:

Length  $\pm 3$  · Height  $\pm 2$  · Diagonals  $\pm 5$  · Openings 0/+5 (mm).  
Do not scale — work to figured dimensions. All dims in mm.


**Breather Membrane:**

Laps 100mm horizontal / 150mm vertical, upper lapping lower.

### Panel Changes:

When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

## KEY PLAN


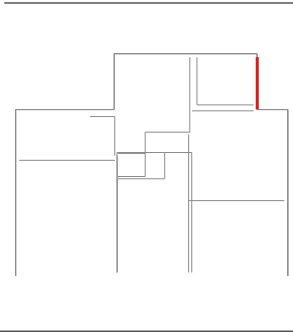


Revisions (Rev · Date · Note):

## C01 - Construction issue

|                 |                                      |                            |      |             |               |          |  |
|-----------------|--------------------------------------|----------------------------|------|-------------|---------------|----------|--|
| Date:           | 2026-09-13                           | Scale:                     | 1:20 | Drawn:      | TS            | Checked: |  |
| Project Name:   |                                      | MP Adams Plot 3, Eckington |      |             |               |          |  |
| Site:           | Eckington                            |                            |      | Client:     | MP Adams      |          |  |
| Title:          | Panel Fabrication — 38 x 140 C16 CLS |                            |      |             |               |          |  |
| Project Number: | P3                                   |                            |      | Revision:   | C01           |          |  |
| Panel No:       | GF-EX11                              |                            |      | Drawing No: | P3-MF-GF-EX11 |          |  |
| Panel L×H×T:    | 2084×2424×149                        |                            |      | Weight:     | 92 kg         |          |  |
| Status:         | CONSTRUCTION                         |                            |      | Sheet:      | 1 / 1         |          |  |

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

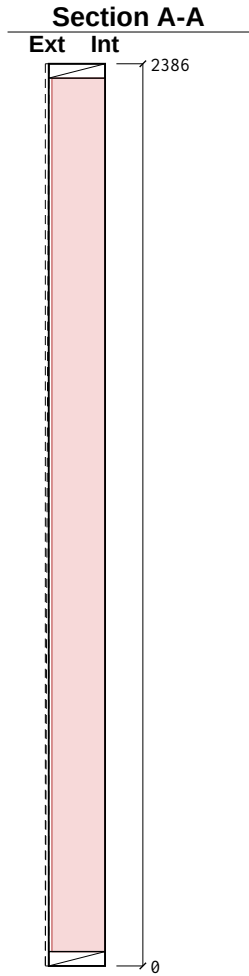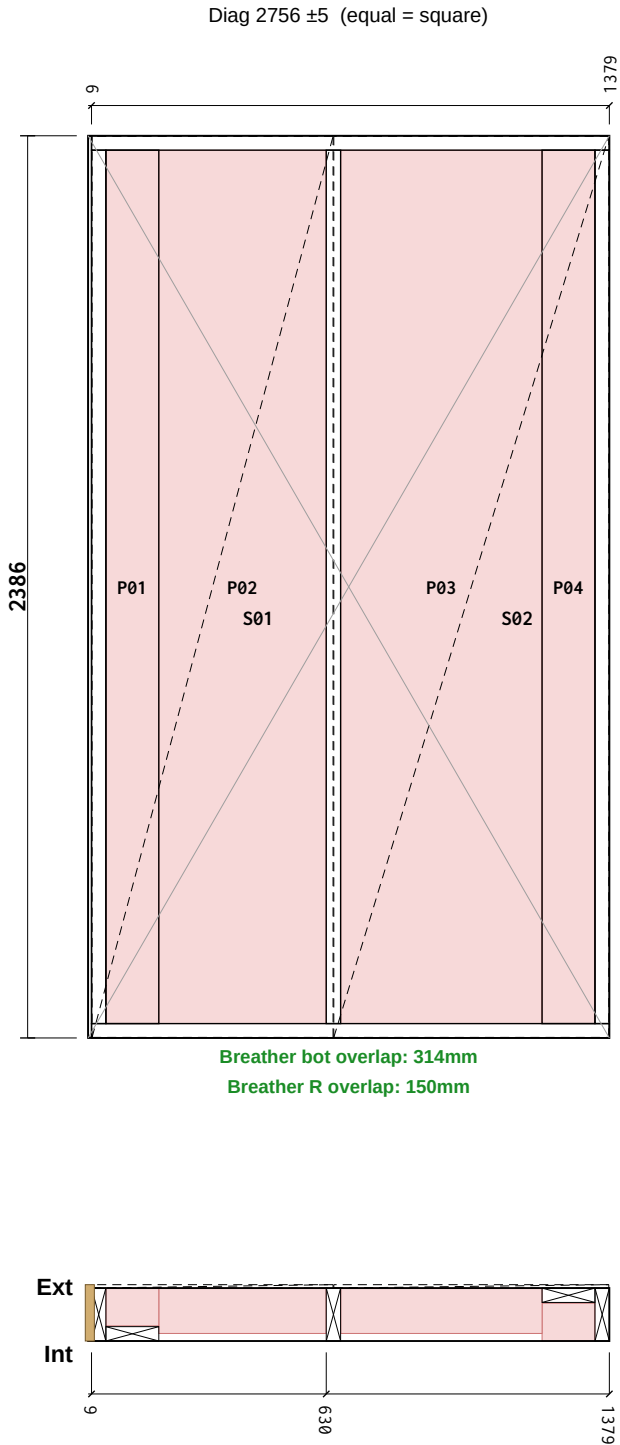

### Cut List

| Item                   | Section    | Len  | Bot° | Top° | Qty |
|------------------------|------------|------|------|------|-----|
| BR1 Bottom Rail        | 38×140 C16 | 1370 | 0    | 0    | 1   |
| TR1 Top Rail           | 38×140 C16 | 1370 | 0    | 0    | 1   |
| ES1 End Stud           | 38×140 C16 | 2310 | 0    | 0    | 1   |
| ES2 End Stud           | 38×140 C16 | 2310 | 0    | 0    | 1   |
| VS1 Vertical Stud      | 38×140 C16 | 2310 | 0    | 0    | 1   |
| JS1 Junction Stud      | 38×140 C16 | 2310 | 0    | 0    | 2   |
| Total: 7 pcs / 14.29 m |            |      |      |      |     |

### Sheathing & Insulation

| Material        | W   | H    | Label |
|-----------------|-----|------|-------|
| OSB 9mm         | 637 | 2383 | S01   |
| OSB 9mm         | 728 | 2383 | S02   |
| PIR 100mm       | 140 | 2310 | P01   |
| PIR 120mm       | 442 | 2310 | P02   |
| PIR 120mm       | 533 | 2310 | P03   |
| PIR 100mm       | 140 | 2310 | P04   |
| OSB End Cap 9mm | 146 | 2383 | E01   |

#### General Notes:

**Frame Nailing:**  
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails  
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**  
Components ≤ 100mm should be +/- 1mm  
Components > 100mm should be +/- 1.5mm  
Stepped check should be +/- 1.5mm  
Sloped Opening sizes are +/-2mm


**Nailing:**  
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**  
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).  
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**  
Laps 100mm horizontal / 150mm vertical, upper lapping lower.



**Panel Changes:**  
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

#### KEY PLAN



|                                |            |                                      |      |                          |          |               |  |
|--------------------------------|------------|--------------------------------------|------|--------------------------|----------|---------------|--|
| Revisions (Rev · Date · Note): |            |                                      |      | C01 - Construction issue |          |               |  |
| Date:                          | 2026-09-13 | Scale:                               | 1:20 | Drawn:                   | TS       | Checked:      |  |
| Project Name:                  |            | MP Adams Plot 3, Eckington           |      |                          |          |               |  |
| Site:                          | Eckington  |                                      |      | Client:                  | MP Adams |               |  |
| Title:                         |            | Panel Fabrication — 38 x 140 C16 CLS |      |                          |          |               |  |
| Project Number:                |            | P3                                   |      | Revision:                |          | C01           |  |
| Panel No:                      |            | GF-EX12                              |      | Drawing No:              |          | P3-MF-GF-EX12 |  |
| Panel L×H×T:                   |            | 1379×2386×149                        |      | Weight:                  |          | 63 kg         |  |
| Status:                        |            | CONSTRUCTION                         |      | Sheet:                   |          | 1 / 1         |  |

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

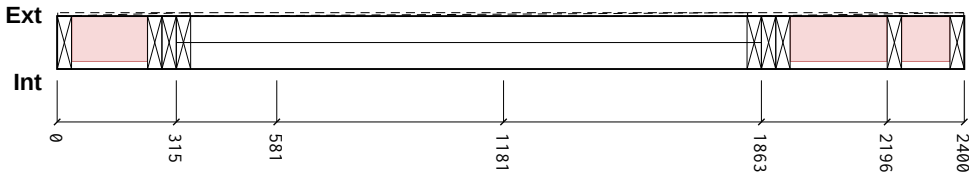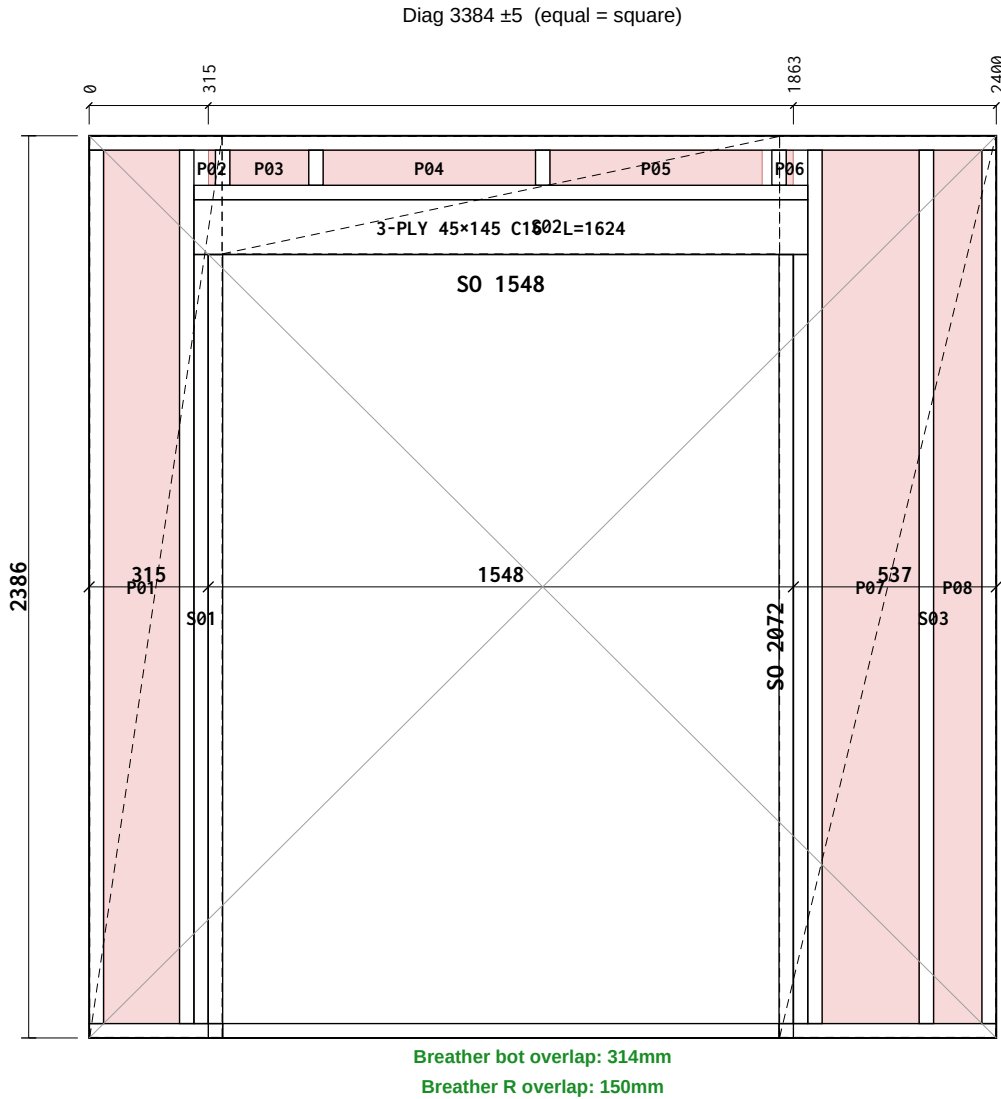

### Cut List

| Item              | Section     | Len  | Bot° | Top° | Qty |
|-------------------|-------------|------|------|------|-----|
| BR1 Bottom Rail   | 38×140 C16  | 1472 | 0    | 0    | 1   |
| BR2 Bottom Rail   | 38×140 C16  | 575  | 0    | 0    | 1   |
| BR3 Bottom Rail   | 38×140 C16  | 353  | 0    | 0    | 1   |
| TR1 Top Rail      | 38×140 C16  | 2400 | 0    | 0    | 1   |
| TR2 Top Rail      | 38×140 C16  | 1624 | 0    | 0    | 1   |
| ES1 End Stud      | 38×140 C16  | 2310 | 0    | 0    | 1   |
| ES2 End Stud      | 38×140 C16  | 2310 | 0    | 0    | 1   |
| KS1 Vertical Stud | 38×140 C16  | 2310 | 0    | 0    | 2   |
| CS1 Cripple Stud  | 38×140 C16  | 2034 | 0    | 0    | 4   |
| LP1 Lintel Ply    | 1624×45 C16 | 1624 | 0    | 0    | 3   |
| OS1 OSB Support   | 38×140 C16  | 93   | 0    | 0    | 2   |
| VS1 Vertical Stud | 38×140 C16  | 2310 | 0    | 0    | 1   |
| VS2 Vertical Stud | 38×140 C16  | 93   | 0    | 0    | 2   |

Total: 21 pcs / 31.35 m

### Sheathing & Insulation

| Material  | W    | H    | Label |
|-----------|------|------|-------|
| OSB 9mm   | 350  | 2383 | S01   |
| OSB 9mm   | 1475 | 311  | S02   |
| OSB 9mm   | 572  | 2383 | S03   |
| PIR 120mm | 200  | 2310 | P01   |
| PIR 120mm | 18   | 93   | P02   |
| PIR 120mm | 208  | 93   | P03   |
| PIR 120mm | 561  | 93   | P04   |
| PIR 120mm | 561  | 93   | P05   |
| PIR 120mm | 18   | 93   | P06   |
| PIR 120mm | 255  | 2310 | P07   |
| PIR 120mm | 127  | 2310 | P08   |

### General Notes:

**Frame Nailing:**  
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails  
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**  
Components ≤ 100mm should be +/- 1mm  
Components > 100mm should be +/- 1.5mm  
Stepped check should be +/- 1.5mm  
Sloped Opening sizes are +/-2mm


**Nailing:**  
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**  
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).  
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**  
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

**Panel Changes:**  
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

### KEY PLAN





Revisions (Rev · Date · Note):

### C01 - Construction issue

|                                             |                           |           |          |
|---------------------------------------------|---------------------------|-----------|----------|
| Date: 2026-09-13                            | Scale: 1:20               | Drawn: TS | Checked: |
| Project Name: MP Adams Plot 3, Eckington    |                           |           |          |
| Site: Eckington                             | Client: MP Adams          |           |          |
| Title: Panel Fabrication — 38 x 140 C16 CLS |                           |           |          |
| Project Number: P3                          | Revision: C01             |           |          |
| Panel No: GF-EX13                           | Drawing No: P3-MF-GF-EX13 |           |          |
| Panel L×H×T: 2400×2386×149                  | Weight: 93 kg             |           |          |
| Status: CONSTRUCTION                        | Sheet: 1 / 1              |           |          |

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

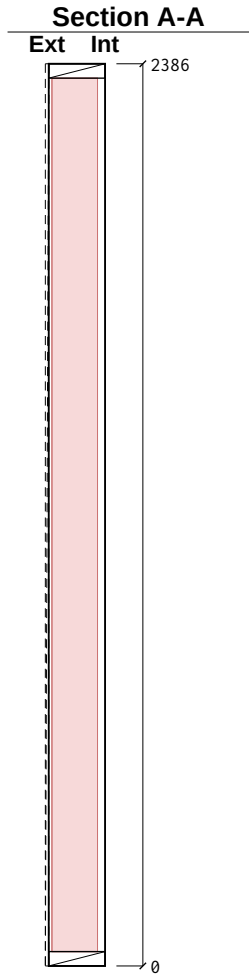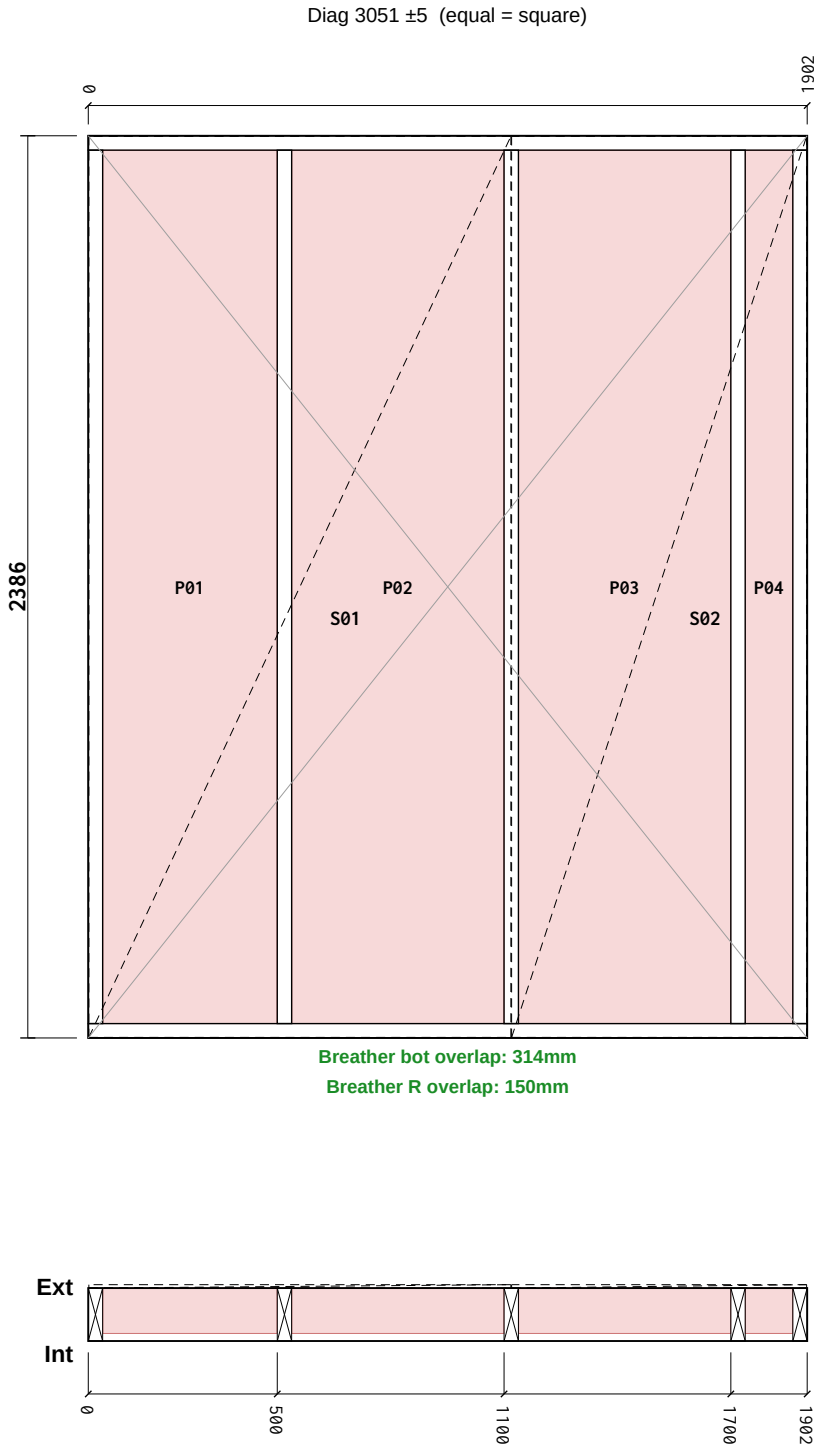

### Cut List

| Item                   | Section    | Len  | Bot° | Top°  | Qty |
|------------------------|------------|------|------|-------|-----|
| BR1 Bottom Rail        | 38×140 C16 | 1902 | 0    | 0     | 1   |
| TR1 Top Rail           | 38×140 C16 | 1902 | 0    | 0     | 1   |
| ES1 End Stud           | 38×140 C16 | 2310 | 0    | 0     | 1   |
| ES2 End Stud           | 38×140 C16 | 2310 | 0    | 0     | 1   |
| VS1 Vertical Stud      | 38×140 C16 | 2310 | 0    | 0     | 3   |
| Total: 7 pcs / 15.35 m |            |      |      |       |     |
| Sheathing & Insulation |            |      |      |       |     |
| Material               |            | W    | H    | Label |     |
| OSB 9mm                |            | 1116 | 2383 | S01   |     |
| OSB 9mm                |            | 781  | 2383 | S02   |     |
| PIR 120mm              |            | 461  | 2310 | P01   |     |
| PIR 120mm              |            | 561  | 2310 | P02   |     |
| PIR 120mm              |            | 561  | 2310 | P03   |     |
| PIR 120mm              |            | 125  | 2310 | P04   |     |

#### General Notes:

**Frame Nailing:**  
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails  
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**  
Components ≤ 100mm should be +/- 1mm  
Components > 100mm should be +/- 1.5mm  
Stepped check should be +/- 1.5mm  
Sloped Opening sizes are +/-2mm


**Nailing:**  
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**  
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).  
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**  
Laps 100mm horizontal / 150mm vertical, upper lapping lower.




**Panel Changes:**  
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

#### KEY PLAN



|                                |                                      |                            |      |             |               |          |  |
|--------------------------------|--------------------------------------|----------------------------|------|-------------|---------------|----------|--|
| Revisions (Rev · Date · Note): |                                      | C01 - Construction issue   |      |             |               |          |  |
| Date:                          | 2026-09-13                           | Scale:                     | 1:20 | Drawn:      | TS            | Checked: |  |
| Project Name:                  |                                      | MP Adams Plot 3, Eckington |      |             |               |          |  |
| Site:                          | Eckington                            |                            |      | Client:     | MP Adams      |          |  |
| Title:                         | Panel Fabrication — 38 x 140 C16 CLS |                            |      |             |               |          |  |
| Project Number:                | P3                                   |                            |      | Revision:   | C01           |          |  |
| Panel No:                      | GF-EX14                              |                            |      | Drawing No: | P3-MF-GF-EX14 |          |  |
| Panel L×H×T:                   | 1902×2386×149                        |                            |      | Weight:     | 76 kg         |          |  |
| Status:                        | CONSTRUCTION                         |                            |      | Sheet:      | 1 / 1         |          |  |

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

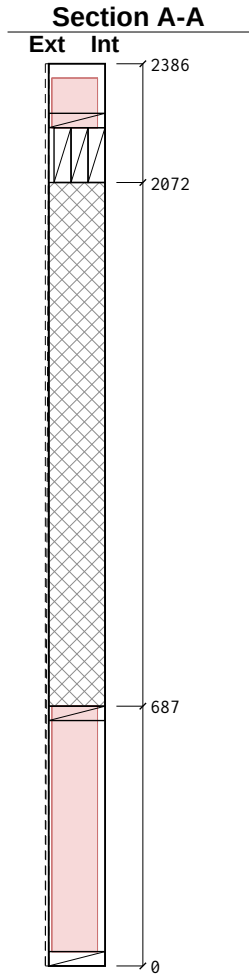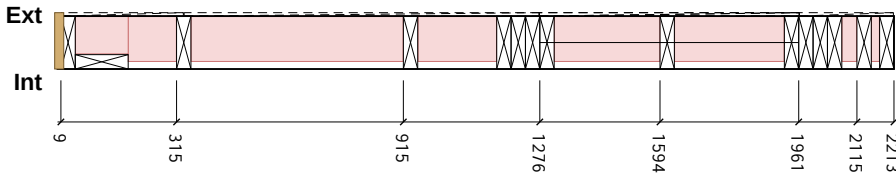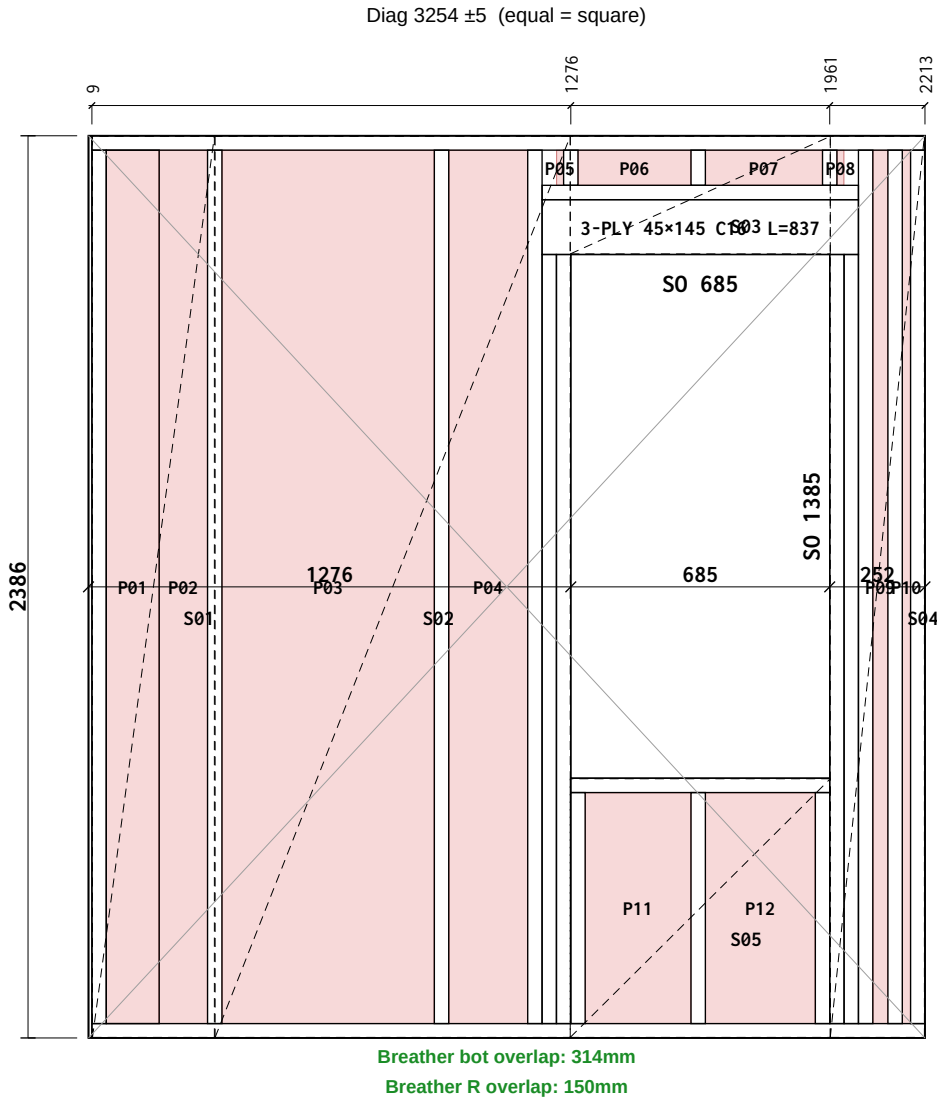

### Cut List

| Item              | Section    | Len  | Bot° | Top° | Qty |
|-------------------|------------|------|------|------|-----|
| BR1 Bottom Rail   | 38x140 C16 | 2204 | 0    | 0    | 1   |
| TR1 Top Rail      | 38x140 C16 | 2204 | 0    | 0    | 1   |
| TR2 Top Rail      | 38x140 C16 | 837  | 0    | 0    | 1   |
| ES1 End Stud      | 38x140 C16 | 2310 | 0    | 0    | 1   |
| ES2 End Stud      | 38x140 C16 | 2310 | 0    | 0    | 1   |
| KS1 Vertical Stud | 38x140 C16 | 2310 | 0    | 0    | 2   |
| CS1 Cripple Stud  | 38x140 C16 | 2034 | 0    | 0    | 4   |
| SP1 Sill Plate    | 38x140 C16 | 685  | 0    | 0    | 1   |
| LP1 Lintel Ply    | 837x45 C16 | 837  | 0    | 0    | 3   |
| SS1 Sill Support  | 38x140 C16 | 611  | 0    | 0    | 2   |
| OS1 OSB Support   | 38x140 C16 | 93   | 0    | 0    | 2   |
| VS1 Vertical Stud | 38x140 C16 | 2310 | 0    | 0    | 3   |
| VS2 Vertical Stud | 38x140 C16 | 611  | 0    | 0    | 1   |
| VS3 Vertical Stud | 38x140 C16 | 93   | 0    | 0    | 1   |
| JS1 Junction Stud | 38x140 C16 | 2310 | 0    | 0    | 1   |

Total: 25 pcs / 37.17 m

### Sheathing & Insulation

| Material        | W   | H    | Label |
|-----------------|-----|------|-------|
| OSB 9mm         | 322 | 2383 | S01   |
| OSB 9mm         | 940 | 2383 | S02   |
| OSB 9mm         | 688 | 311  | S03   |
| OSB 9mm         | 249 | 2383 | S04   |
| OSB 9mm         | 688 | 684  | S05   |
| PIR 100mm       | 140 | 2310 | P01   |
| PIR 120mm       | 127 | 2310 | P02   |
| PIR 120mm       | 561 | 2310 | P03   |
| PIR 120mm       | 208 | 2310 | P04   |
| PIR 120mm       | 18  | 93   | P05   |
| PIR 120mm       | 298 | 93   | P06   |
| PIR 120mm       | 309 | 93   | P07   |
| PIR 120mm       | 18  | 93   | P08   |
| PIR 120mm       | 38  | 2310 | P09   |
| PIR 120mm       | 21  | 2310 | P10   |
| PIR 120mm       | 279 | 610  | P11   |
| PIR 120mm       | 290 | 610  | P12   |
| OSB End Cap 9mm | 146 | 2383 | E01   |

#### General Notes:

**Frame Nailing:**  
140mm Frames Nail Using 3no, 3.1x90mm length field galvanised twisted strip nails  
90mm Frames Nail Using 2no, 3.1x90mm length field galvanised twisted strip nails

**Sheathing Nails:**  
Components ≤ 100mm should be +/- 1mm  
Components > 100mm should be +/- 1.5mm  
Stepped check should be +/- 1.5mm  
Sloped Opening sizes are +/-2mm


**Nailing:**  
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**  
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).  
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**  
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

**Panel Changes:**  
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

#### KEY PLAN






Revisions (Rev · Date · Note):

#### C01 - Construction issue

|                 |            |                                      |      |             |    |               |  |
|-----------------|------------|--------------------------------------|------|-------------|----|---------------|--|
| Date:           | 2026-09-13 | Scale:                               | 1:20 | Drawn:      | TS | Checked:      |  |
| Project Name:   |            | MP Adams Plot 3, Eckington           |      |             |    |               |  |
| Site:           |            | Eckington                            |      | Client:     |    | MP Adams      |  |
| Title:          |            | Panel Fabrication — 38 x 140 C16 CLS |      |             |    |               |  |
| Project Number: |            | P3                                   |      | Revision:   |    | C01           |  |
| Panel No:       |            | GF-EX15                              |      | Drawing No: |    | P3-MF-GF-EX15 |  |
| Panel L×H×T:    |            | 2213×2386×149                        |      | Weight:     |    | 122 kg        |  |
| Status:         |            | CONSTRUCTION                         |      | Sheet:      |    | 1 / 1         |  |

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

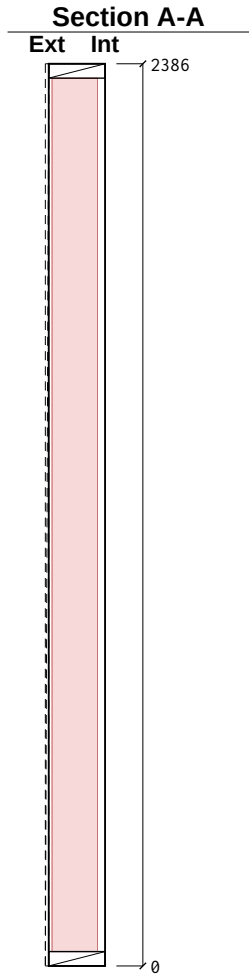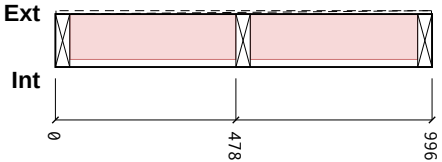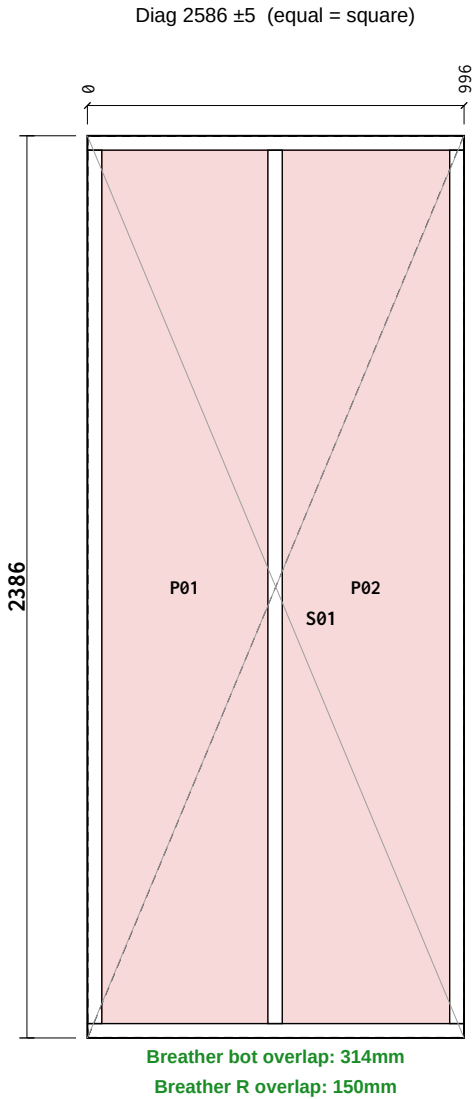

### Cut List

| Item                  | Section    | Len  | Bot° | Top° | Qty |
|-----------------------|------------|------|------|------|-----|
| BR1 Bottom Rail       | 38×140 C16 | 997  | 0    | 0    | 1   |
| TR1 Top Rail          | 38×140 C16 | 997  | 0    | 0    | 1   |
| ES1 End Stud          | 38×140 C16 | 2310 | 0    | 0    | 1   |
| ES2 End Stud          | 38×140 C16 | 2310 | 0    | 0    | 1   |
| VS1 Vertical Stud     | 38×140 C16 | 2310 | 0    | 0    | 1   |
| Total: 5 pcs / 8.92 m |            |      |      |      |     |

### Sheathing & Insulation

| Material  | W   | H    | Label |
|-----------|-----|------|-------|
| OSB 9mm   | 994 | 2383 | S01   |
| PIR 120mm | 439 | 2310 | P01   |
| PIR 120mm | 442 | 2310 | P02   |

#### General Notes:

**Frame Nailing:**  
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails  
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**  
Components ≤ 100mm should be +/- 1mm  
Components > 100mm should be +/- 1.5mm  
Stepped check should be +/- 1.5mm  
Sloped Opening sizes are +/-2mm


**Nailing:**  
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**  
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).  
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**  
Laps 100mm horizontal / 150mm vertical, upper lapping lower.



**Panel Changes:**  
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

#### KEY PLAN



|                                |                                      |                            |      |             |               |          |  |
|--------------------------------|--------------------------------------|----------------------------|------|-------------|---------------|----------|--|
| Revisions (Rev · Date · Note): |                                      | C01 - Construction issue   |      |             |               |          |  |
| Date:                          | 2026-09-13                           | Scale:                     | 1:20 | Drawn:      | TS            | Checked: |  |
| Project Name:                  |                                      | MP Adams Plot 3, Eckington |      |             |               |          |  |
| Site:                          | Eckington                            |                            |      | Client:     | MP Adams      |          |  |
| Title:                         | Panel Fabrication — 38 x 140 C16 CLS |                            |      |             |               |          |  |
| Project Number:                | P3                                   |                            |      | Revision:   | C01           |          |  |
| Panel No:                      | GF-EX16                              |                            |      | Drawing No: | P3-MF-GF-EX16 |          |  |
| Panel L×H×T:                   | 997×2386×149                         |                            |      | Weight:     | 41 kg         |          |  |
| Status:                        | CONSTRUCTION                         |                            |      | Sheet:      | 1 / 1         |          |  |

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

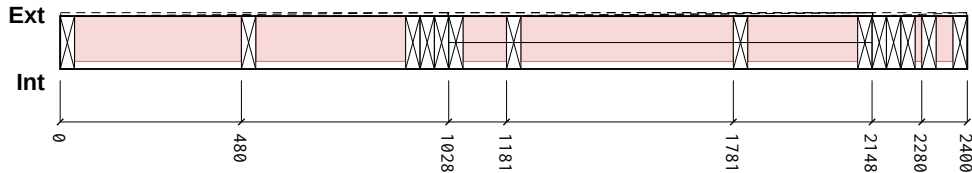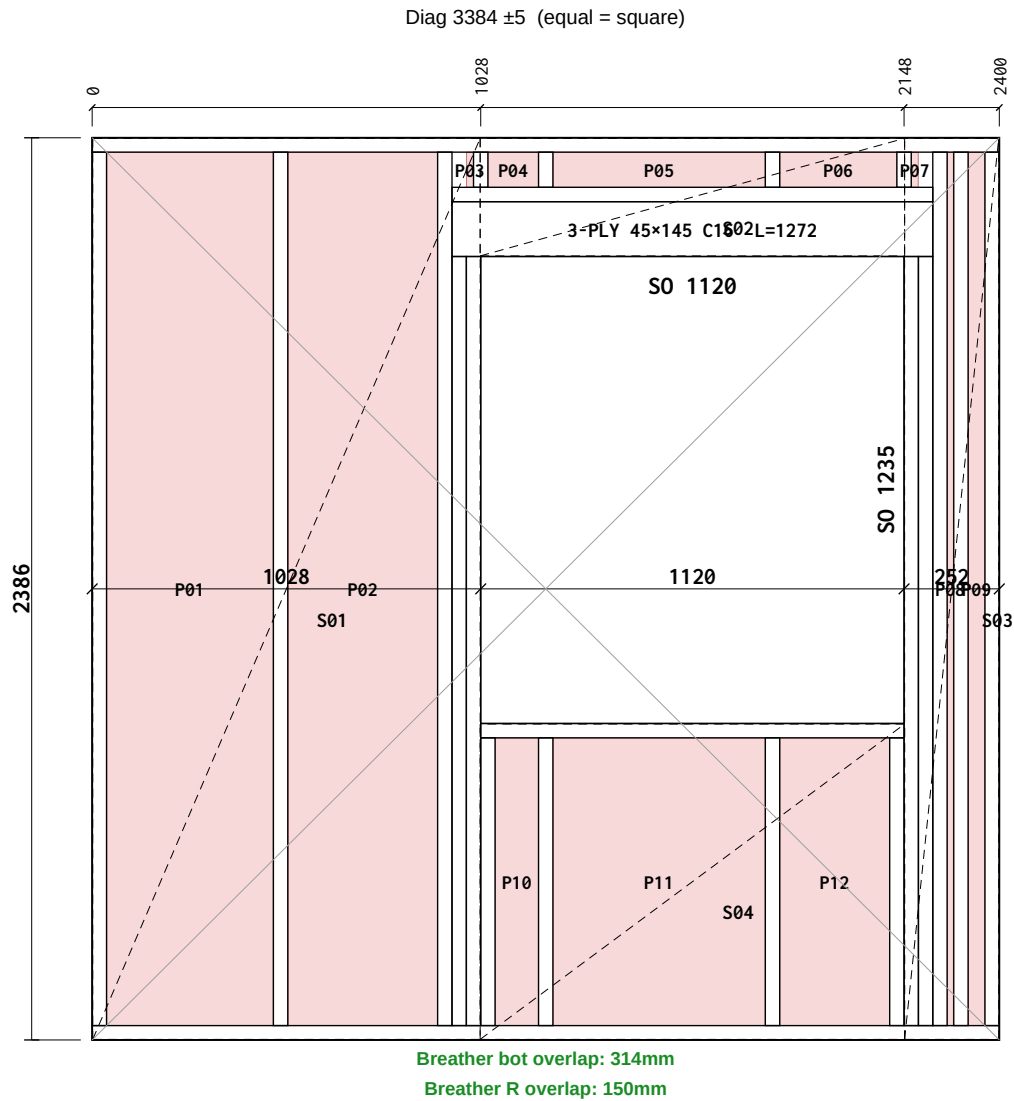


## Cut List

| Item              | Section     | Len  | Bot° | Top° | Qty |
|-------------------|-------------|------|------|------|-----|
| BR1 Bottom Rail   | 38x140 C16  | 2400 | 0    | 0    | 1   |
| TR1 Top Rail      | 38x140 C16  | 2400 | 0    | 0    | 1   |
| TR2 Top Rail      | 38x140 C16  | 1272 | 0    | 0    | 1   |
| ES1 End Stud      | 38x140 C16  | 2310 | 0    | 0    | 1   |
| ES2 End Stud      | 38x140 C16  | 2310 | 0    | 0    | 1   |
| KS1 Vertical Stud | 38x140 C16  | 2310 | 0    | 0    | 2   |
| CS1 Cripple Stud  | 38x140 C16  | 2034 | 0    | 0    | 4   |
| SP1 Sill Plate    | 38x140 C16  | 1120 | 0    | 0    | 1   |
| LP1 Lintel Ply    | 1272x45 C16 | 1272 | 0    | 0    | 3   |
| SS1 Sill Support  | 38x140 C16  | 761  | 0    | 0    | 2   |
| OS1 OSB Support   | 38x140 C16  | 93   | 0    | 0    | 2   |
| VS1 Vertical Stud | 38x140 C16  | 2310 | 0    | 0    | 2   |
| VS2 Vertical Stud | 38x140 C16  | 761  | 0    | 0    | 2   |
| VS3 Vertical Stud | 38x140 C16  | 93   | 0    | 0    | 2   |

## Sheathing & Insulation

| Material  | W    | HLabel          |
|-----------|------|-----------------|
| OSB 9mm   | 1025 | 2383 <b>S01</b> |
| OSB 9mm   | 1123 | 311 <b>S02</b>  |
| OSB 9mm   | 249  | 2383 <b>S03</b> |
| OSB 9mm   | 1123 | 834 <b>S04</b>  |
| PIR 120mm | 441  | 2310 <b>P01</b> |
| PIR 120mm | 395  | 2310 <b>P02</b> |
| PIR 120mm | 18   | 93 <b>P03</b>   |
| PIR 120mm | 133  | 93 <b>P04</b>   |
| PIR 120mm | 561  | 93 <b>P05</b>   |
| PIR 120mm | 309  | 93 <b>P06</b>   |
| PIR 120mm | 18   | 93 <b>P07</b>   |
| PIR 120mm | 16   | 2310 <b>P08</b> |
| PIR 120mm | 43   | 2310 <b>P09</b> |
| PIR 120mm | 114  | 760 <b>P10</b>  |
| PIR 120mm | 561  | 760 <b>P11</b>  |
| PIR 120mm | 290  | 760 <b>P12</b>  |

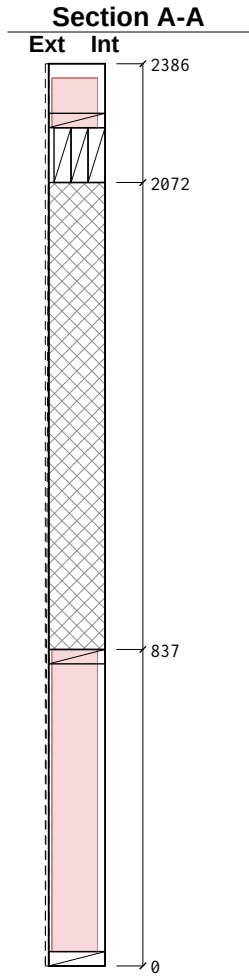

**General Notes:**

**Frame Nailing:**  
 140mm Frames Nail Using 3no, 3.1x90mm length field galvanised twisted strip nails  
 90mm Frames Nail Using 2no, 3.1x90mm length field galvanised twisted strip nails

**Sheathing Nails:**  
 Components  $\leq 100\text{mm}$  should be  $\pm 1\text{mm}$   
 Components  $> 100\text{mm}$  should be  $\pm 1.5\text{mm}$   
 Stepped check should be  $\pm 1.5\text{mm}$   
 Sloped Opening sizes are  $\pm 2\text{mm}$


**Nailing:**  
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**  
Length  $\pm 3$  · Height  $\pm 2$  · Diagonals  $\pm 5$  · Openings 0/+5 (mm).  
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**  
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

**Panel Changes:**  
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

## KEY PLAN



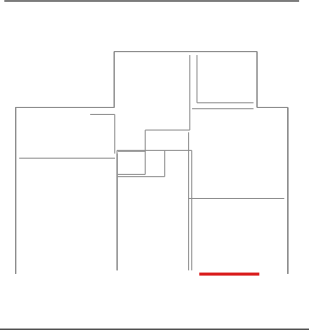


Revisions (Rev · Date · Note):

### C01 - Construction issue

|                 |            |                                      |      |             |    |               |  |
|-----------------|------------|--------------------------------------|------|-------------|----|---------------|--|
| Date:           | 2026-09-13 | Scale:                               | 1:20 | Drawn:      | TS | Checked:      |  |
| Project Name:   |            | MP Adams Plot 3, Eckington           |      |             |    |               |  |
| Site:           |            | Eckington                            |      | Client:     |    | MP Adams      |  |
| Title:          |            | Panel Fabrication — 38 x 140 C16 CLS |      |             |    |               |  |
| Project Number: |            | P3                                   |      | Revision:   |    | C01           |  |
| Panel No:       |            | GF-EX17                              |      | Drawing No: |    | P3-MF-GF-EX17 |  |
| Panel LxHxT:    |            | 2400x2386x149                        |      | Weight:     |    | 119 kg        |  |
| Status:         |            | CONSTRUCTION                         |      | Sheet:      |    | 1 / 1         |  |

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

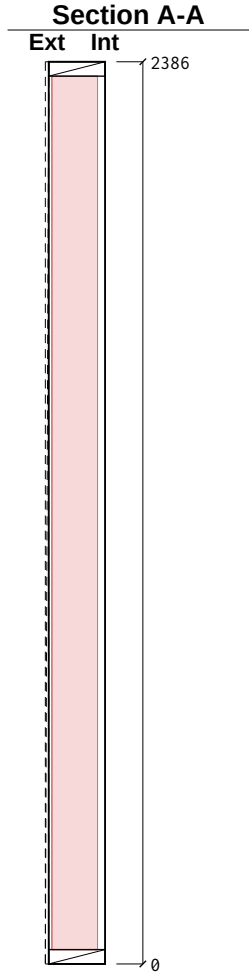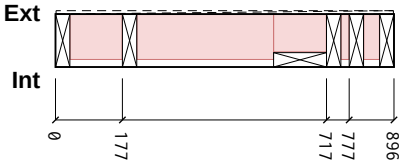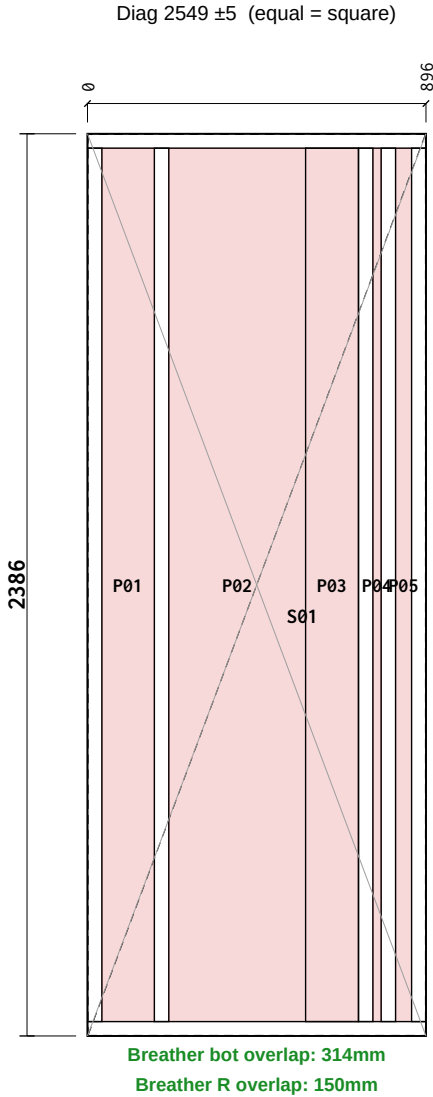

### Cut List

| Item                   | Section    | Len  | Bot° | Top° | Qty |
|------------------------|------------|------|------|------|-----|
| BR1 Bottom Rail        | 38×140 C16 | 896  | 0    | 0    | 1   |
| TR1 Top Rail           | 38×140 C16 | 896  | 0    | 0    | 1   |
| ES1 End Stud           | 38×140 C16 | 2310 | 0    | 0    | 1   |
| ES2 End Stud           | 38×140 C16 | 2310 | 0    | 0    | 1   |
| VS1 Vertical Stud      | 38×140 C16 | 2310 | 0    | 0    | 3   |
| JS1 Junction Stud      | 38×140 C16 | 2310 | 0    | 0    | 1   |
| Total: 8 pcs / 15.65 m |            |      |      |      |     |

### Sheathing & Insulation

| Material  | W   | H    | Label |
|-----------|-----|------|-------|
| OSB 9mm   | 893 | 2383 | S01   |
| PIR 120mm | 138 | 2310 | P01   |
| PIR 120mm | 361 | 2310 | P02   |
| PIR 100mm | 140 | 2310 | P03   |
| PIR 120mm | 21  | 2310 | P04   |
| PIR 120mm | 41  | 2310 | P05   |

#### General Notes:

**Frame Nailing:**  
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails  
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**  
Components ≤ 100mm should be +/- 1mm  
Components > 100mm should be +/- 1.5mm  
Stepped check should be +/- 1.5mm  
Sloped Opening sizes are +/-2mm


**Nailing:**  
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**  
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).  
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**  
Laps 100mm horizontal / 150mm vertical, upper lapping lower.




**Panel Changes:**  
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

#### KEY PLAN



|                                |            |                                      |      |                          |          |               |  |
|--------------------------------|------------|--------------------------------------|------|--------------------------|----------|---------------|--|
| Revisions (Rev · Date · Note): |            |                                      |      | C01 - Construction issue |          |               |  |
| Date:                          | 2026-09-13 | Scale:                               | 1:20 | Drawn:                   | TS       | Checked:      |  |
| Project Name:                  |            | MP Adams Plot 3, Eckington           |      |                          |          |               |  |
| Site:                          | Eckington  |                                      |      | Client:                  | MP Adams |               |  |
| Title:                         |            | Panel Fabrication — 38 x 140 C16 CLS |      |                          |          |               |  |
| Project Number:                |            | P3                                   |      | Revision:                |          | C01           |  |
| Panel No:                      |            | GF-EX18                              |      | Drawing No:              |          | P3-MF-GF-EX18 |  |
| Panel L×H×T:                   |            | 896×2386×149                         |      | Weight:                  |          | 53 kg         |  |
| Status:                        |            | CONSTRUCTION                         |      | Sheet:                   |          | 1 / 1         |  |

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

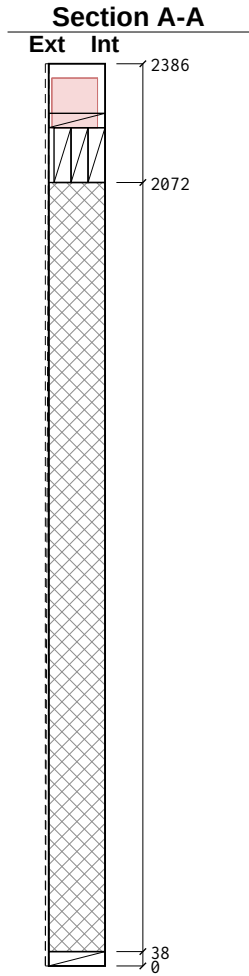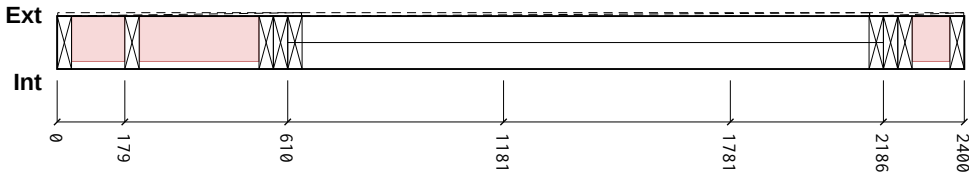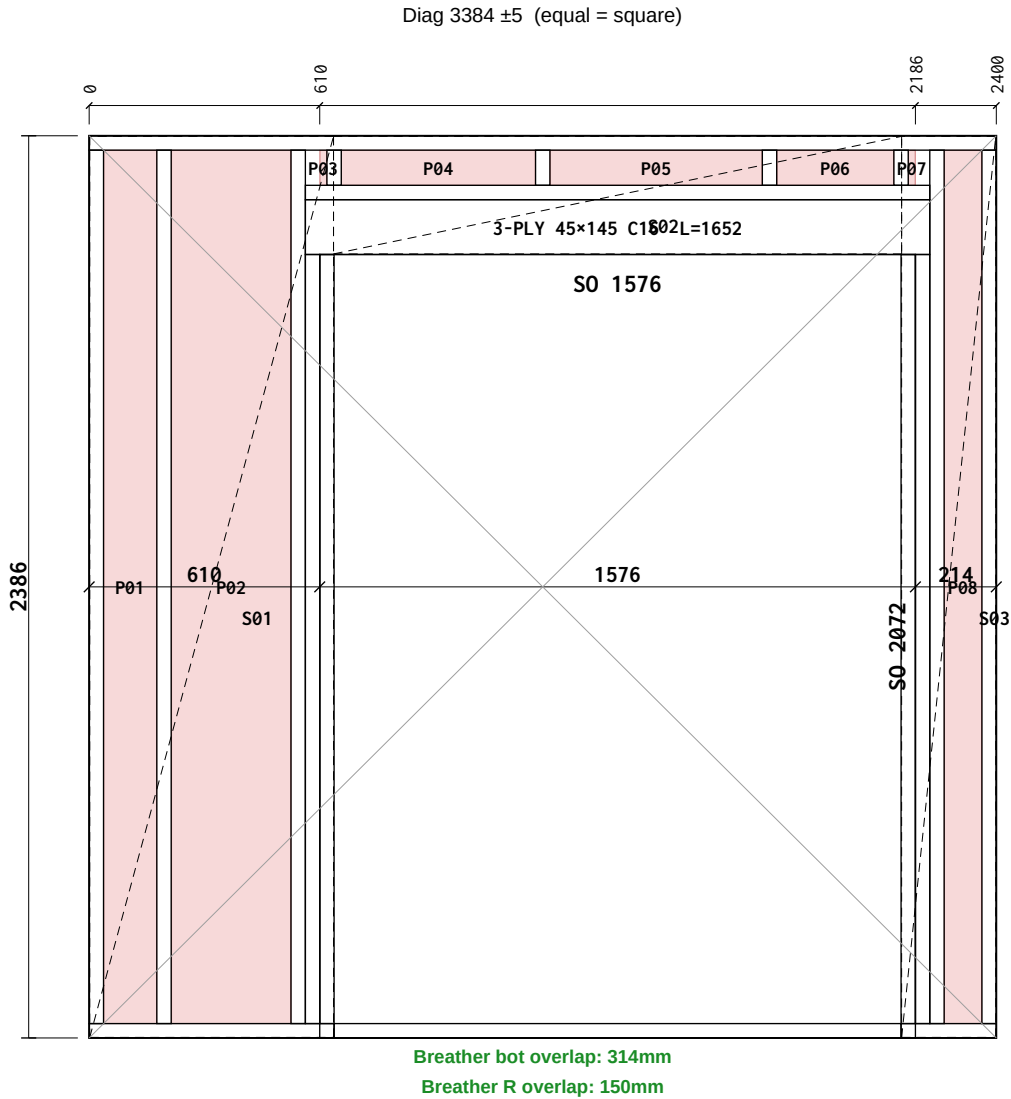

## Cut List

| Item              | Section     | Len  | Bot° | Top° | Qty |
|-------------------|-------------|------|------|------|-----|
| BR1 Bottom Rail   | 38×140 C16  | 1500 | 0    | 0    | 1   |
| BR2 Bottom Rail   | 38×140 C16  | 648  | 0    | 0    | 1   |
| BR3 Bottom Rail   | 38×140 C16  | 252  | 0    | 0    | 1   |
| TR1 Top Rail      | 38×140 C16  | 2400 | 0    | 0    | 1   |
| TR2 Top Rail      | 38×140 C16  | 1652 | 0    | 0    | 1   |
| ES1 End Stud      | 38×140 C16  | 2310 | 0    | 0    | 1   |
| ES2 End Stud      | 38×140 C16  | 2310 | 0    | 0    | 1   |
| KS1 Vertical Stud | 38×140 C16  | 2310 | 0    | 0    | 2   |
| CS1 Cripple Stud  | 38×140 C16  | 2034 | 0    | 0    | 4   |
| LP1 Lintel Ply    | 1652×45 C16 | 1652 | 0    | 0    | 3   |
| OS1 OSB Support   | 38×140 C16  | 93   | 0    | 0    | 2   |
| VS1 Vertical Stud | 38×140 C16  | 2310 | 0    | 0    | 1   |
| VS2 Vertical Stud | 38×140 C16  | 93   | 0    | 0    | 2   |

Total: 21 pcs / 31.47 m

## Sheathing & Insulation

| Material  | W    | H    | Label |
|-----------|------|------|-------|
| OSB 9mm   | 645  | 2383 | S01   |
| OSB 9mm   | 1503 | 311  | S02   |
| OSB 9mm   | 249  | 2383 | S03   |
| PIR 120mm | 140  | 2310 | P01   |
| PIR 120mm | 315  | 2310 | P02   |
| PIR 120mm | 18   | 93   | P03   |
| PIR 120mm | 513  | 93   | P04   |
| PIR 120mm | 561  | 93   | P05   |
| PIR 120mm | 309  | 93   | P06   |
| PIR 120mm | 18   | 93   | P07   |
| PIR 120mm | 99   | 2310 | P08   |

### General Notes:

**Frame Nailing:**  
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails  
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**  
Components ≤ 100mm should be +/- 1mm  
Components > 100mm should be +/- 1.5mm  
Stepped check should be +/- 1.5mm  
Sloped Opening sizes are +/-2mm


**Nailing:**  
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**  
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).  
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**  
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

**Panel Changes:**  
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

### KEY PLAN






Revisions (Rev · Date · Note):

### C01 - Construction issue

|                 |                                      |        |      |             |               |          |  |
|-----------------|--------------------------------------|--------|------|-------------|---------------|----------|--|
| Date:           | 2026-09-13                           | Scale: | 1:20 | Drawn:      | TS            | Checked: |  |
| Project Name:   | MP Adams Plot 3, Eckington           |        |      |             |               |          |  |
| Site:           | Eckington                            |        |      | Client:     | MP Adams      |          |  |
| Title:          | Panel Fabrication — 38 x 140 C16 CLS |        |      |             |               |          |  |
| Project Number: | P3                                   |        |      | Revision:   | C01           |          |  |
| Panel No:       | GF-EX19                              |        |      | Drawing No: | P3-MF-GF-EX19 |          |  |
| Panel L×H×T:    | 2400×2386×149                        |        |      | Weight:     | 93 kg         |          |  |
| Status:         | CONSTRUCTION                         |        |      | Sheet:      | 1 / 1         |          |  |

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

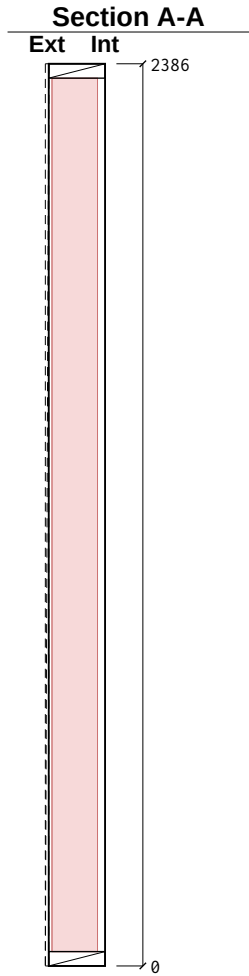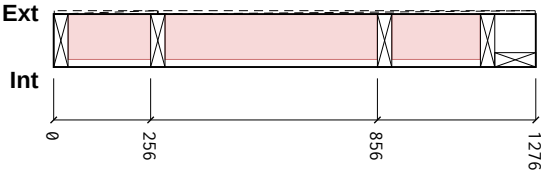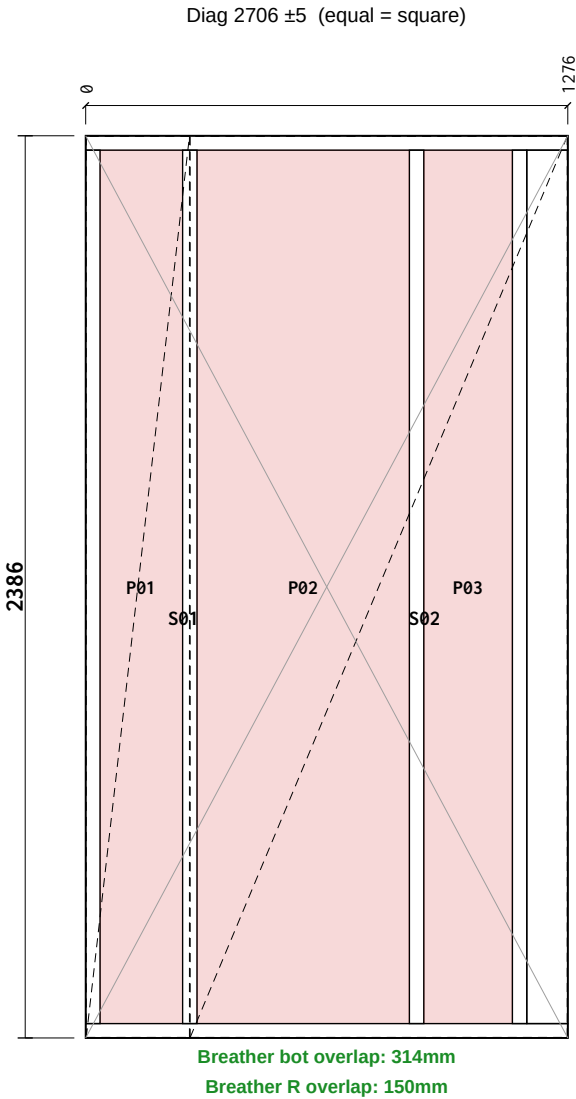

Cut List

| Item                   | Section    | Len  | Bot° | Top° | Qty |
|------------------------|------------|------|------|------|-----|
| BR1 Bottom Rail        | 38×140 C16 | 1275 | 0    | 0    | 1   |
| TR1 Top Rail           | 38×140 C16 | 1275 | 0    | 0    | 1   |
| ES1 End Stud           | 38×140 C16 | 2310 | 0    | 0    | 1   |
| ES2 End Stud           | 38×140 C16 | 2310 | 0    | 0    | 1   |
| VS1 Vertical Stud      | 38×140 C16 | 2310 | 0    | 0    | 2   |
| JS1 Junction Stud      | 38×109 C16 | 2310 | 0    | 0    | 1   |
| Total: 7 pcs / 14.10 m |            |      |      |      |     |

Sheathing & Insulation

| Material  | W   | H    | Label |
|-----------|-----|------|-------|
| OSB 9mm   | 273 | 2383 | S01   |
| OSB 9mm   | 997 | 2383 | S02   |
| PIR 120mm | 218 | 2310 | P01   |
| PIR 120mm | 561 | 2310 | P02   |
| PIR 120mm | 233 | 2310 | P03   |

General Notes:

**Frame Nailing:**  
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails  
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**  
Components ≤ 100mm should be +/- 1mm  
Components > 100mm should be +/- 1.5mm  
Stepped check should be +/- 1.5mm  
Sloped Opening sizes are +/-2mm


**Nailing:**  
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**  
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).  
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**  
Laps 100mm horizontal / 150mm vertical, upper lapping lower.




**Panel Changes:**  
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN



|                                |                                      |                            |      |             |               |          |  |
|--------------------------------|--------------------------------------|----------------------------|------|-------------|---------------|----------|--|
| Revisions (Rev · Date · Note): |                                      | C01 - Construction issue   |      |             |               |          |  |
| Date:                          | 2026-09-13                           | Scale:                     | 1:20 | Drawn:      | TS            | Checked: |  |
| Project Name:                  |                                      | MP Adams Plot 3, Eckington |      |             |               |          |  |
| Site:                          | Eckington                            |                            |      | Client:     | MP Adams      |          |  |
| Title:                         | Panel Fabrication — 38 x 140 C16 CLS |                            |      |             |               |          |  |
| Project Number:                | P3                                   |                            |      | Revision:   | C01           |          |  |
| Panel No:                      | GF-EX20                              |                            |      | Drawing No: | P3-MF-GF-EX20 |          |  |
| Panel L×H×T:                   | 1275×2386×149                        |                            |      | Weight:     | 57 kg         |          |  |
| Status:                        | CONSTRUCTION                         |                            |      | Sheet:      | 1 / 1         |          |  |

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

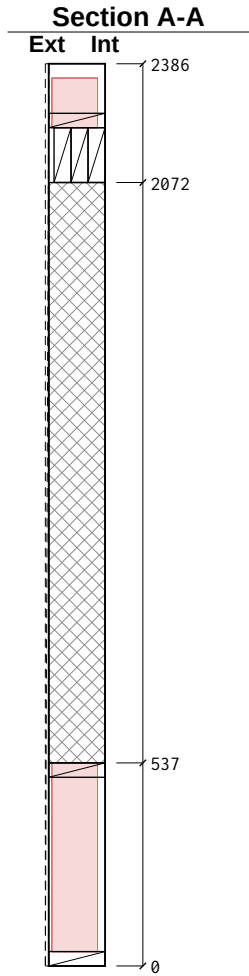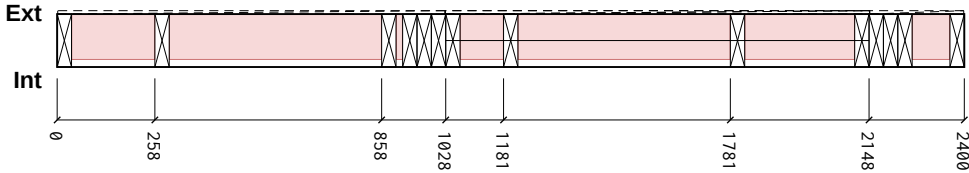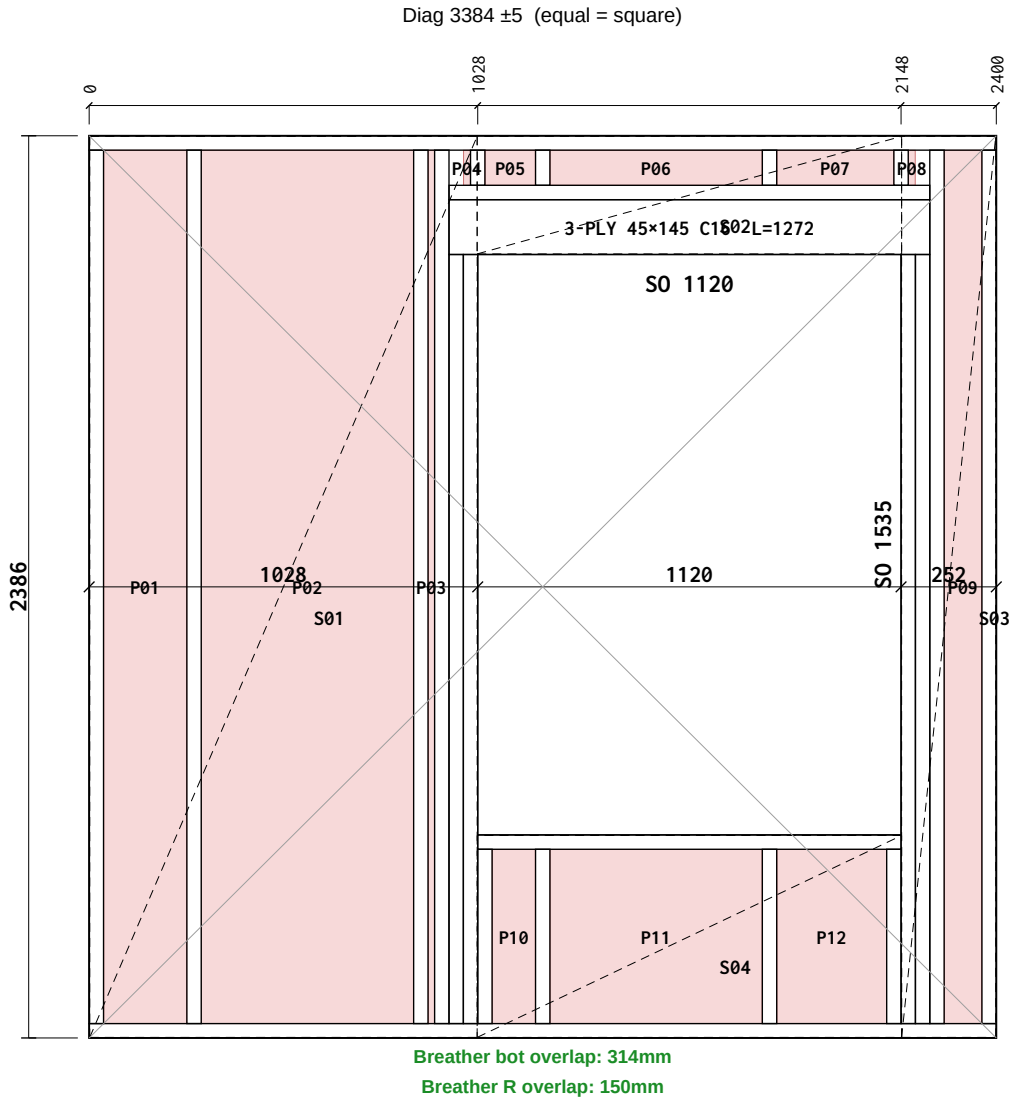

### Cut List

| Item              | Section     | Len  | Bot° | Top° | Qty |
|-------------------|-------------|------|------|------|-----|
| BR1 Bottom Rail   | 38×140 C16  | 2400 | 0    | 0    | 1   |
| TR1 Top Rail      | 38×140 C16  | 2400 | 0    | 0    | 1   |
| TR2 Top Rail      | 38×140 C16  | 1272 | 0    | 0    | 1   |
| ES1 End Stud      | 38×140 C16  | 2310 | 0    | 0    | 1   |
| ES2 End Stud      | 38×140 C16  | 2310 | 0    | 0    | 1   |
| KS1 Vertical Stud | 38×140 C16  | 2310 | 0    | 0    | 2   |
| CS1 Cripple Stud  | 38×140 C16  | 2034 | 0    | 0    | 4   |
| SP1 Sill Plate    | 38×140 C16  | 1120 | 0    | 0    | 1   |
| LP1 Lintel Ply    | 1272×45 C16 | 1272 | 0    | 0    | 3   |
| SS1 Sill Support  | 38×140 C16  | 461  | 0    | 0    | 2   |
| OS1 OSB Support   | 38×140 C16  | 93   | 0    | 0    | 2   |
| VS1 Vertical Stud | 38×140 C16  | 2310 | 0    | 0    | 2   |
| VS2 Vertical Stud | 38×140 C16  | 461  | 0    | 0    | 2   |
| VS3 Vertical Stud | 38×140 C16  | 93   | 0    | 0    | 2   |

Total: 25 pcs / 35.22 m

### Sheathing & Insulation

| Material  | W    | H    | Label |
|-----------|------|------|-------|
| OSB 9mm   | 1025 | 2383 | S01   |
| OSB 9mm   | 1123 | 311  | S02   |
| OSB 9mm   | 249  | 2383 | S03   |
| OSB 9mm   | 1123 | 534  | S04   |
| PIR 120mm | 220  | 2310 | P01   |
| PIR 120mm | 561  | 2310 | P02   |
| PIR 120mm | 16   | 2310 | P03   |
| PIR 120mm | 18   | 93   | P04   |
| PIR 120mm | 133  | 93   | P05   |
| PIR 120mm | 561  | 93   | P06   |
| PIR 120mm | 309  | 93   | P07   |
| PIR 120mm | 18   | 93   | P08   |
| PIR 120mm | 99   | 2310 | P09   |
| PIR 120mm | 114  | 460  | P10   |
| PIR 120mm | 561  | 460  | P11   |
| PIR 120mm | 290  | 460  | P12   |

#### General Notes:

**Frame Nailing:**  
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails  
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**  
Components ≤ 100mm should be +/- 1mm  
Components > 100mm should be +/- 1.5mm  
Stepped check should be +/- 1.5mm  
Sloped Opening sizes are +/-2mm


**Nailing:**  
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**  
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).  
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**  
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

**Panel Changes:**  
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

#### KEY PLAN




Revisions (Rev · Date · Note):

#### C01 - Construction issue


|                 |                                      |        |      |             |               |          |  |
|-----------------|--------------------------------------|--------|------|-------------|---------------|----------|--|
| Date:           | 2026-09-13                           | Scale: | 1:20 | Drawn:      | TS            | Checked: |  |
| Project Name:   | MP Adams Plot 3, Eckington           |        |      |             |               |          |  |
| Site:           | Eckington                            |        |      | Client:     | MP Adams      |          |  |
| Title:          | Panel Fabrication — 38 x 140 C16 CLS |        |      |             |               |          |  |
| Project Number: | P3                                   |        |      | Revision:   | C01           |          |  |
| Panel No:       | GF-EX21                              |        |      | Drawing No: | P3-MF-GF-EX21 |          |  |
| Panel L×H×T:    | 2400×2386×149                        |        |      | Weight:     | 113 kg        |          |  |
| Status:         | CONSTRUCTION                         |        |      | Sheet:      | 1 / 1         |          |  |

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)


Diag 2414 ±5 (equal = square)

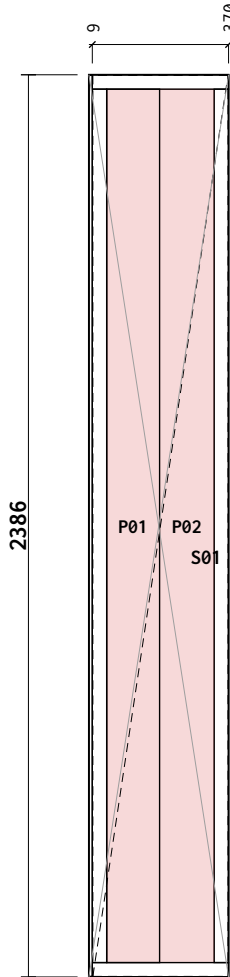

Breather bot overlap: 314mm  
Breather R overlap: 150mm



### Section A-A

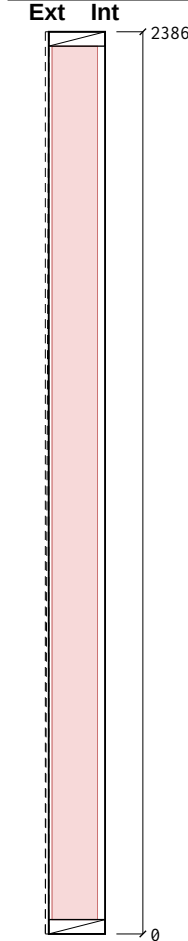

### Cut List

| Item                   | Section    | Len  | Bot° | Top°  | Qty |
|------------------------|------------|------|------|-------|-----|
| BR1 Bottom Rail        | 38×140 C16 | 360  | 0    | 0     | 1   |
| TR1 Top Rail           | 38×140 C16 | 360  | 0    | 0     | 1   |
| ES1 End Stud           | 38×140 C16 | 2310 | 0    | 0     | 1   |
| ES2 End Stud           | 38×140 C16 | 2310 | 0    | 0     | 1   |
| JS1 Junction Stud      | 38×140 C16 | 2310 | 0    | 0     | 1   |
| Total: 5 pcs / 7.65 m  |            |      |      |       |     |
| Sheathing & Insulation |            |      |      |       |     |
| Material               |            | W    | H    | Label |     |
| OSB 9mm                |            | 357  | 2383 | S01   |     |
| PIR 100mm              |            | 140  | 2310 | P01   |     |
| PIR 120mm              |            | 144  | 2310 | P02   |     |
| OSB End Cap 9mm        |            | 146  | 2383 | E01   |     |

#### General Notes:

**Frame Nailing:**  
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails  
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

**Sheathing Nails:**  
Components ≤ 100mm should be +/- 1mm  
Components > 100mm should be +/- 1.5mm  
Stepped check should be +/- 1.5mm  
Sloped Opening sizes are +/-2mm


**Nailing:**  
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

**Manufacturing Tolerances:**  
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).  
Do not scale — work to figured dimensions. All dims in mm.

**Breather Membrane:**  
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

**Panel Changes:**  
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

#### KEY PLAN

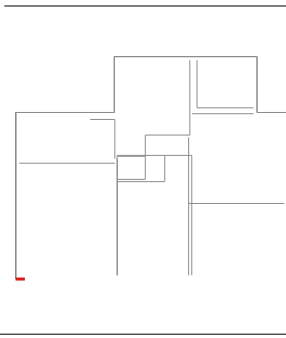

| Revisions (Rev · Date · Note): |                                      | C01 - Construction issue   |      |             |               |          |  |
|--------------------------------|--------------------------------------|----------------------------|------|-------------|---------------|----------|--|
| Date:                          | 2026-09-13                           | Scale:                     | 1:20 | Drawn:      | TS            | Checked: |  |
| Project Name:                  |                                      | MP Adams Plot 3, Eckington |      |             |               |          |  |
| Site:                          | Eckington                            |                            |      | Client:     | MP Adams      |          |  |
| Title:                         | Panel Fabrication — 38 x 140 C16 CLS |                            |      |             |               |          |  |
| Project Number:                | P3                                   |                            |      | Revision:   | C01           |          |  |
| Panel No:                      | GF-EX22                              |                            |      | Drawing No: | P3-MF-GF-EX22 |          |  |
| Panel L×H×T:                   | 369×2386×149                         |                            |      | Weight:     | 26 kg         |          |  |
| Status:                        | CONSTRUCTION                         |                            |      | Sheet:      | 1 / 1         |          |  |