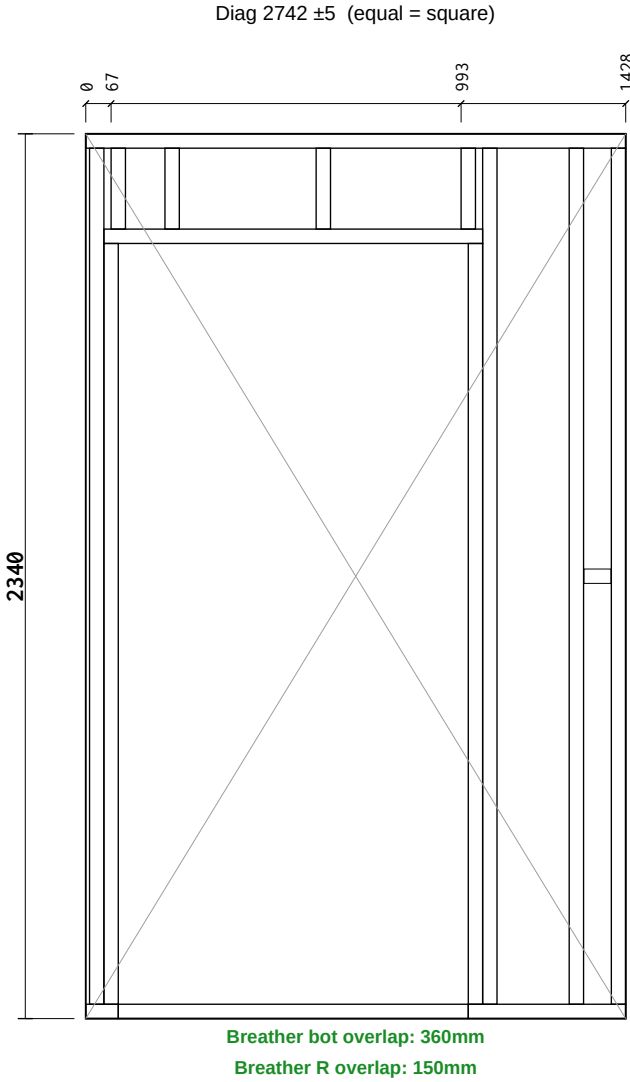


Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1	Bottom Rail	38×89 C16	926	0	0 1
BR2	Bottom Rail	38×89 C16	416	0	0 1
BR3	Bottom Rail	38×89 C16	86	0	0 1
TR1	Top Rail	38×89 C16	1429	0	0 1
ES1	End Stud	38×89 C16	214	0	0 1
ES2	End Stud	38×89 C16	2264	0	0 1
KS1	Vertical Stud	38×89 C16	2264	0	0 2
CS1	Cripple Stud	38×89 C16	2012	0	0 2
HR1	Header Rail	38×89 C16	1002	0	0 1
OS1	OSB Support	38×89 C16	214	0	0 2
VS1	Vertical Stud	38×89 C16	2264	0	0 1
VS2	Vertical Stud	38×89 C16	214	0	0 1
NG1	Noggin	38×89 C16	71	0	0 1

Total: 16 pcs / 17.87 m

Sheathing & Insulation

Material	W	HLabel
----------	---	--------

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.




Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN



Revisions (Rev · Date · Note):		C01 - Construction issue					
Date:	2026-09-13	Scale:	1:20	Drawn:	TS	Checked:	
Project Name:		MP Adams Plot 3, Eckington					
Site:	Eckington			Client:	MP Adams		
Title:		Panel Fabrication — 38 x 140 C16 CLS					
Project Number:		P3		Revision:		C01	
Panel No:		FF-IN1		Drawing No:		P3-MF-FF-IN1	
Panel L×H×T:		1429×2340×89		Weight:		25 kg	
Status:		CONSTRUCTION		Sheet:		1 / 1	

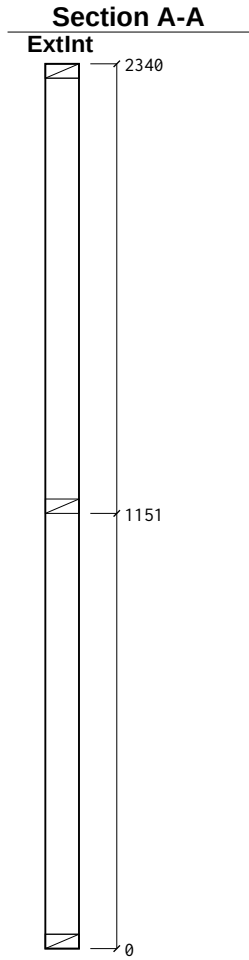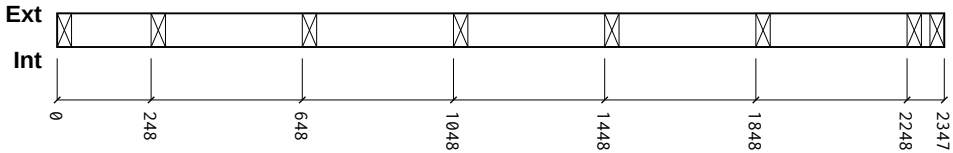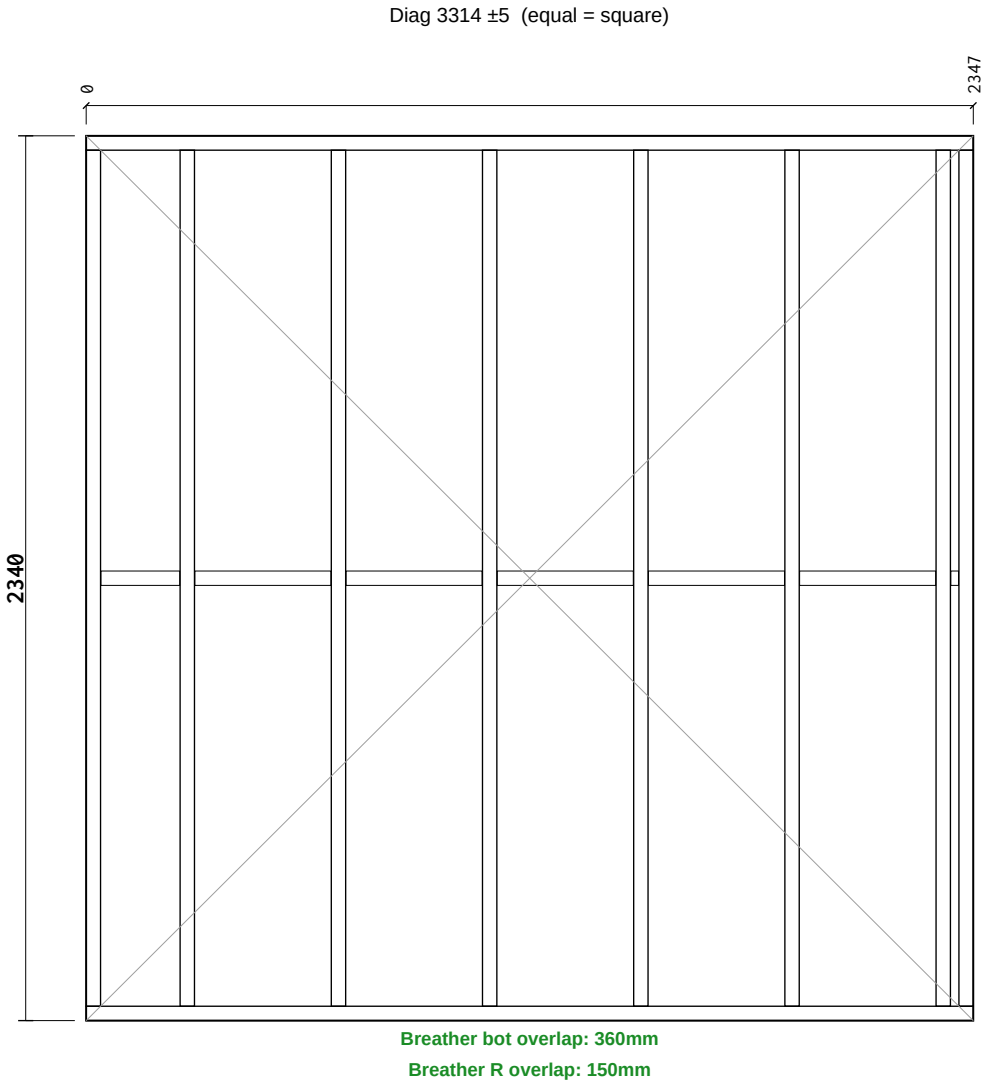

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×89 C16	2347	0	0	1
TR1 Top Rail	38×89 C16	2347	0	0	1
ES1 End Stud	38×89 C16	2264	0	0	1
ES2 End Stud	38×89 C16	2264	0	0	1
VS1 Vertical Stud	38×89 C16	2264	0	0	6
NG1 Noggin	38×89 C16	360	0	0	5
NG2 Noggin	38×89 C16	209	0	0	1
NG3 Noggin	38×89 C16	20	0	0	1
Total: 17 pcs / 24.84 m					

Sheathing & Insulation

Material	W	HLabel
----------	---	--------

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.




Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN



Revisions (Rev · Date · Note):				C01 - Construction issue			
Date:	2026-09-13	Scale:	1:20	Drawn:	TS	Checked:	
Project Name:		MP Adams Plot 3, Eckington					
Site:	Eckington			Client:	MP Adams		
Title:		Panel Fabrication — 38 x 140 C16 CLS					
Project Number:		P3		Revision:		C01	
Panel No:		FF-IN2		Drawing No:		P3-MF-FF-IN2	
Panel L×H×T:		2347×2340×89		Weight:		35 kg	
Status:		CONSTRUCTION		Sheet:		1 / 1	

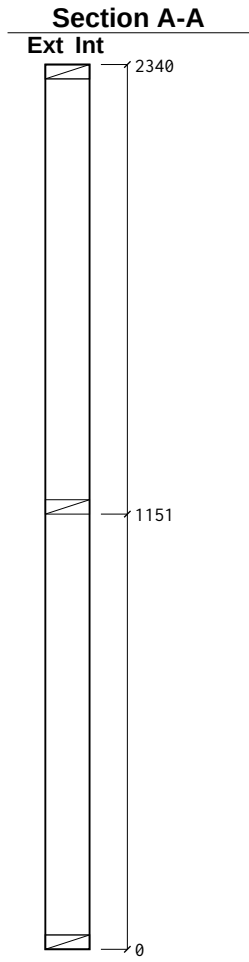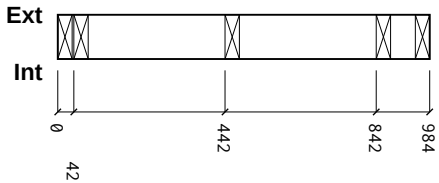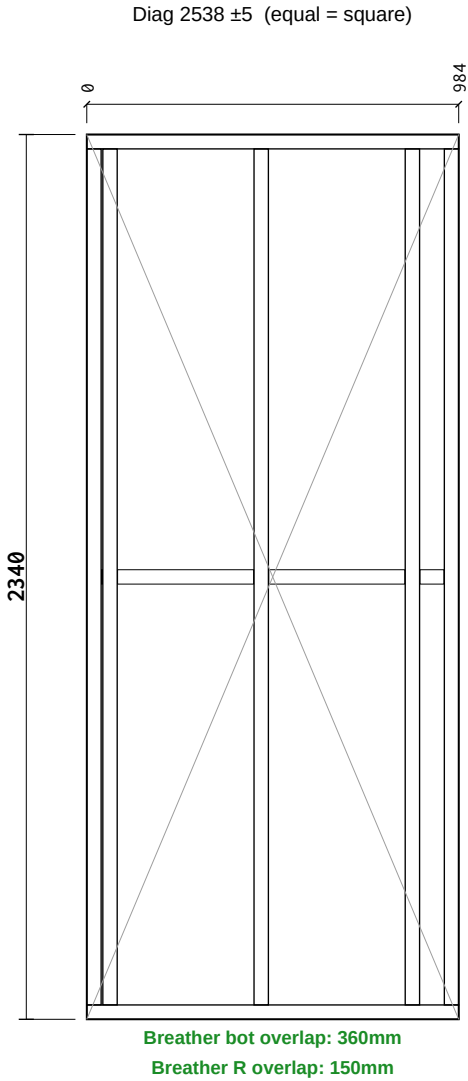

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×117 C16	984	0	0	1
TR1 Top Rail	38×117 C16	984	0	0	1
ES1 End Stud	38×117 C16	2264	0	0	1
ES2 End Stud	38×117 C16	2264	0	0	1
VS1 Vertical Stud	38×117 C16	2264	0	0	3
NG1 Noggin	38×117 C16	360	0	0	2
NG2 Noggin	38×117 C16	63	0	0	1
NG3 Noggin	38×117 C16	3	0	0	1
Total: 11 pcs / 14.07 m					

Sheathing & Insulation

Material	W	HLabel
----------	---	--------

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.




Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN



Revisions (Rev · Date · Note):		C01 - Construction issue					
Date:	2026-09-13	Scale:	1:20	Drawn:	TS	Checked:	
Project Name:		MP Adams Plot 3, Eckington					
Site:	Eckington			Client:	MP Adams		
Title:	Panel Fabrication — 38 x 140 C16 CLS						
Project Number:		P3		Revision:		C01	
Panel No:		FF-IN3		Drawing No:		P3-MF-FF-IN3	
Panel L×H×T:		984×2340×117		Weight:		26 kg	
Status:		CONSTRUCTION		Sheet:		1 / 1	

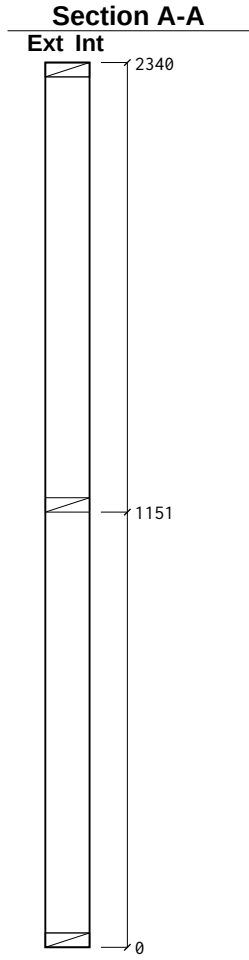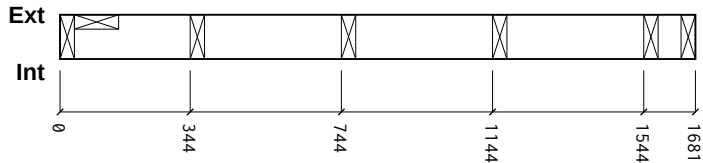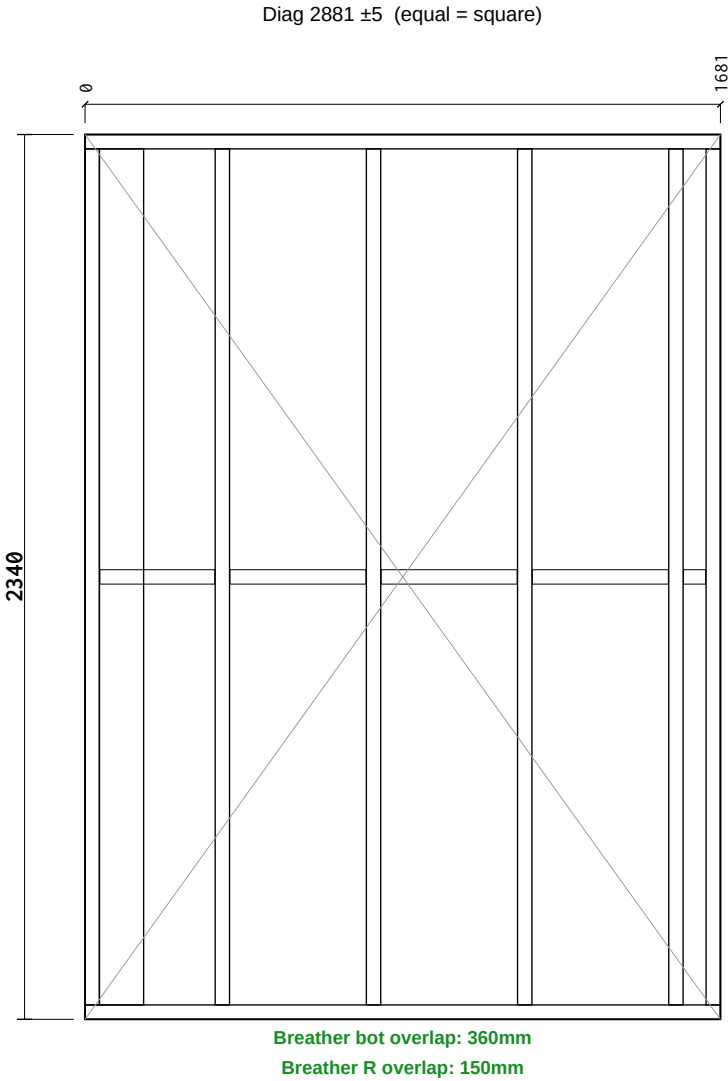

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×117 C16	1681	0	0	1
TR1 Top Rail	38×117 C16	1681	0	0	1
ES1 End Stud	38×117 C16	2264	0	0	1
ES2 End Stud	38×117 C16	2264	0	0	1
VS1 Vertical Stud	38×117 C16	2264	0	0	4
JS1 Junction Stud	38×117 C16	2264	0	0	1
NG1 Noggin	38×117 C16	360	0	0	3
NG2 Noggin	38×117 C16	304	0	0	1
NG3 Noggin	38×117 C16	59	0	0	1
Total: 14 pcs / 20.65 m					

Sheathing & Insulation

Material	W	HLabel
----------	---	--------

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.




Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN



Revisions (Rev · Date · Note):		C01 - Construction issue					
Date:	2026-09-13	Scale:	1:20	Drawn:	TS	Checked:	
Project Name:		MP Adams Plot 3, Eckington					
Site:	Eckington			Client:	MP Adams		
Title:	Panel Fabrication — 38 x 140 C16 CLS						
Project Number:	P3			Revision:	C01		
Panel No:	FF-IN4			Drawing No:	P3-MF-FF-IN4		
Panel L×H×T:	1681×2340×117			Weight:	39 kg		
Status:	CONSTRUCTION			Sheet:	1 / 1		

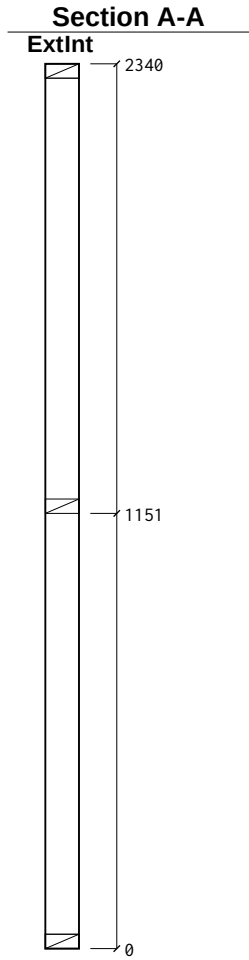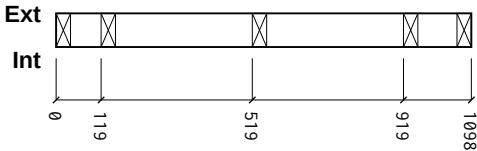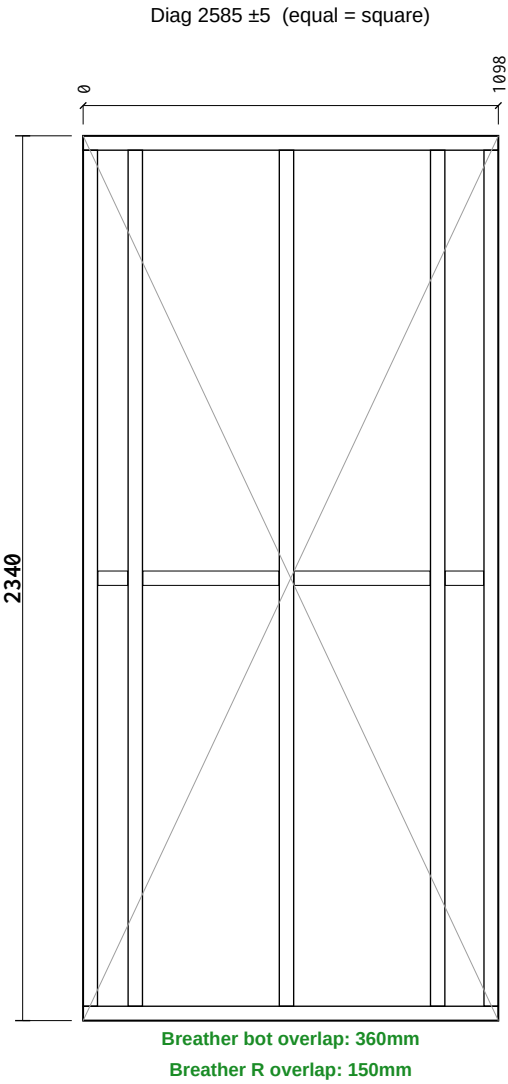

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×89 C16	1098	0	0	1
TR1 Top Rail	38×89 C16	1098	0	0	1
ES1 End Stud	38×89 C16	2264	0	0	1
ES2 End Stud	38×89 C16	2264	0	0	1
VS1 Vertical Stud	38×89 C16	2264	0	0	3
NG1 Noggin	38×89 C16	360	0	0	2
NG2 Noggin	38×89 C16	102	0	0	1
NG3 Noggin	38×89 C16	79	0	0	1
Total: 11 pcs / 14.42 m					

Sheathing & Insulation

Material	W	HLabel
----------	---	--------

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.




Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN



Revisions (Rev · Date · Note):		C01 - Construction issue					
Date:	2026-09-13	Scale:	1:20	Drawn:	TS	Checked:	
Project Name:		MP Adams Plot 3, Eckington					
Site:	Eckington			Client:	MP Adams		
Title:	Panel Fabrication — 38 x 140 C16 CLS						
Project Number:	P3			Revision:	C01		
Panel No:	FF-IN5			Drawing No:	P3-MF-FF-IN5		
Panel L×H×T:	1098×2340×89			Weight:	20 kg		
Status:	CONSTRUCTION			Sheet:	1 / 1		

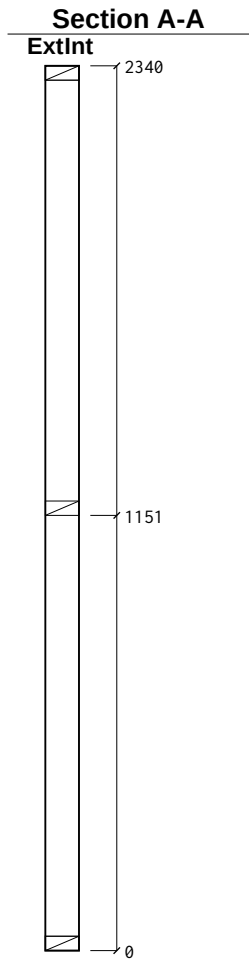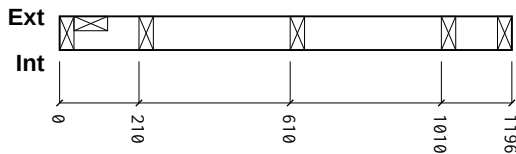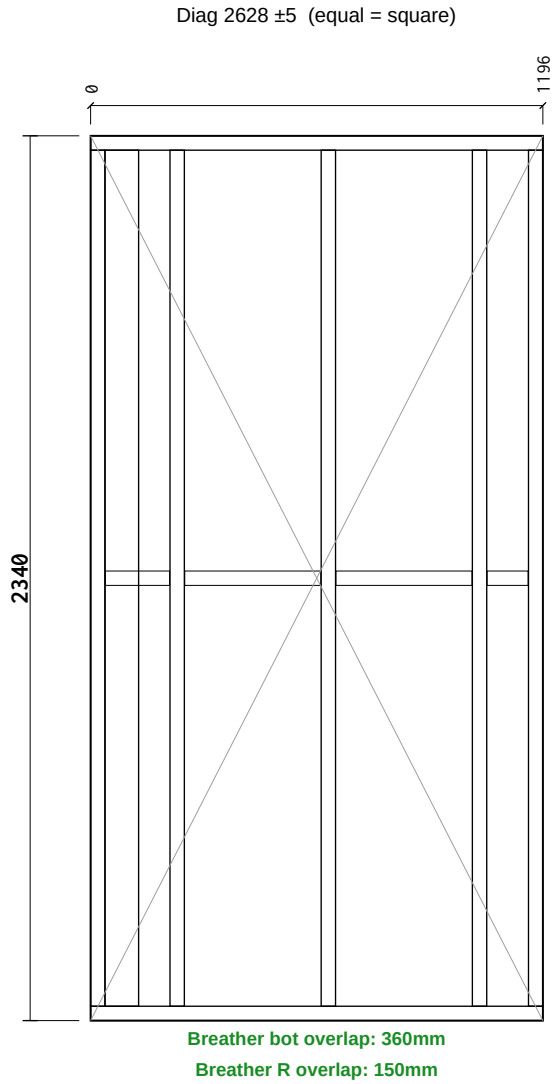

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×89 C16	1196	0	0	1
TR1 Top Rail	38×89 C16	1196	0	0	1
ES1 End Stud	38×89 C16	2264	0	0	1
ES2 End Stud	38×89 C16	2264	0	0	1
VS1 Vertical Stud	38×89 C16	2264	0	0	3
JS1 Junction Stud	38×89 C16	2264	0	0	1
NG1 Noggin	38×89 C16	360	0	0	2
NG2 Noggin	38×89 C16	170	0	0	1
NG3 Noggin	38×89 C16	109	0	0	1
Total: 12 pcs / 16.98 m					

Sheathing & Insulation

Material	W	HLabel
----------	---	--------

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.




Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN



Revisions (Rev · Date · Note):		C01 - Construction issue					
Date:	2026-09-13	Scale:	1:20	Drawn:	TS	Checked:	
Project Name:		MP Adams Plot 3, Eckington					
Site:	Eckington			Client:	MP Adams		
Title:	Panel Fabrication — 38 x 140 C16 CLS						
Project Number:	P3			Revision:	C01		
Panel No:	FF-IN6			Drawing No:	P3-MF-FF-IN6		
Panel L×H×T:	1196×2340×89			Weight:	24 kg		
Status:	CONSTRUCTION			Sheet:	1 / 1		

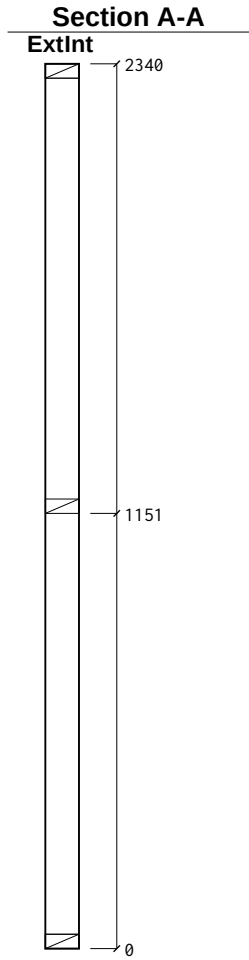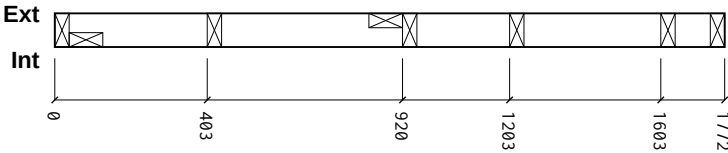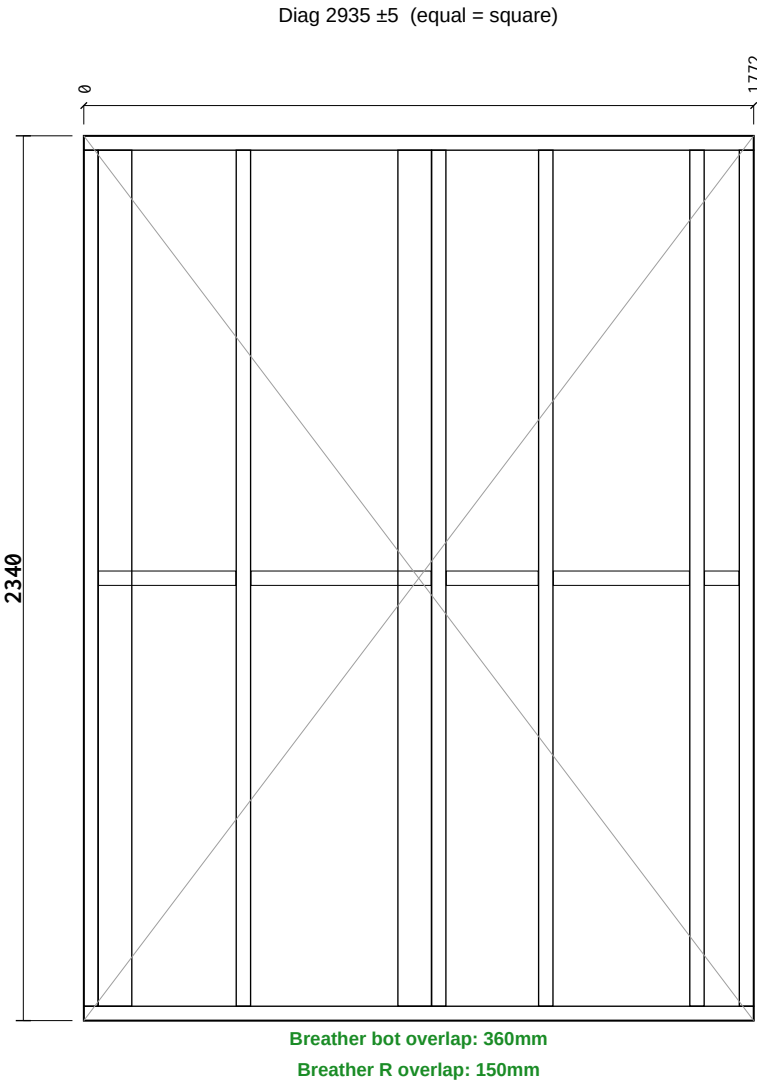

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×89 C16	1772	0	0	1
TR1 Top Rail	38×89 C16	1772	0	0	1
ES1 End Stud	38×89 C16	2264	0	0	1
ES2 End Stud	38×89 C16	2264	0	0	1
VS1 Vertical Stud	38×89 C16	2264	0	0	4
JS1 Junction Stud	38×89 C16	2264	0	0	2
NG1 Noggin	38×89 C16	477	0	0	1
NG2 Noggin	38×89 C16	363	0	0	1
NG3 Noggin	38×89 C16	360	0	0	1
NG4 Noggin	38×89 C16	243	0	0	1
NG5 Noggin	38×89 C16	91	0	0	1
Total: 15 pcs / 23.19 m					

Sheathing & Insulation

Material	W	HLabel
----------	---	--------

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.




Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN



Revisions (Rev · Date · Note):		C01 - Construction issue					
Date:	2026-09-13	Scale:	1:20	Drawn:	TS	Checked:	
Project Name:		MP Adams Plot 3, Eckington					
Site:	Eckington			Client:	MP Adams		
Title:	Panel Fabrication — 38 x 140 C16 CLS						
Project Number:	P3			Revision:	C01		
Panel No:	FF-IN7			Drawing No:	P3-MF-FF-IN7		
Panel L×H×T:	1772×2340×89			Weight:	33 kg		
Status:	CONSTRUCTION			Sheet:	1 / 1		

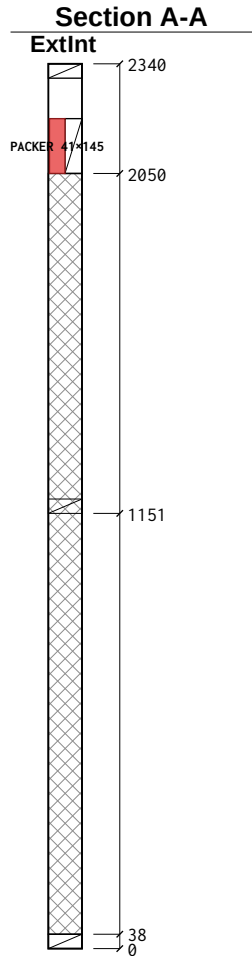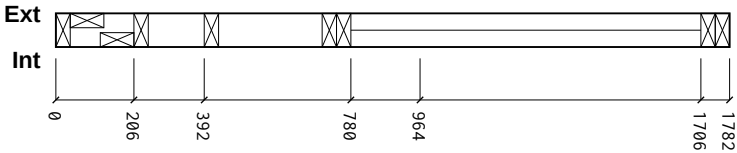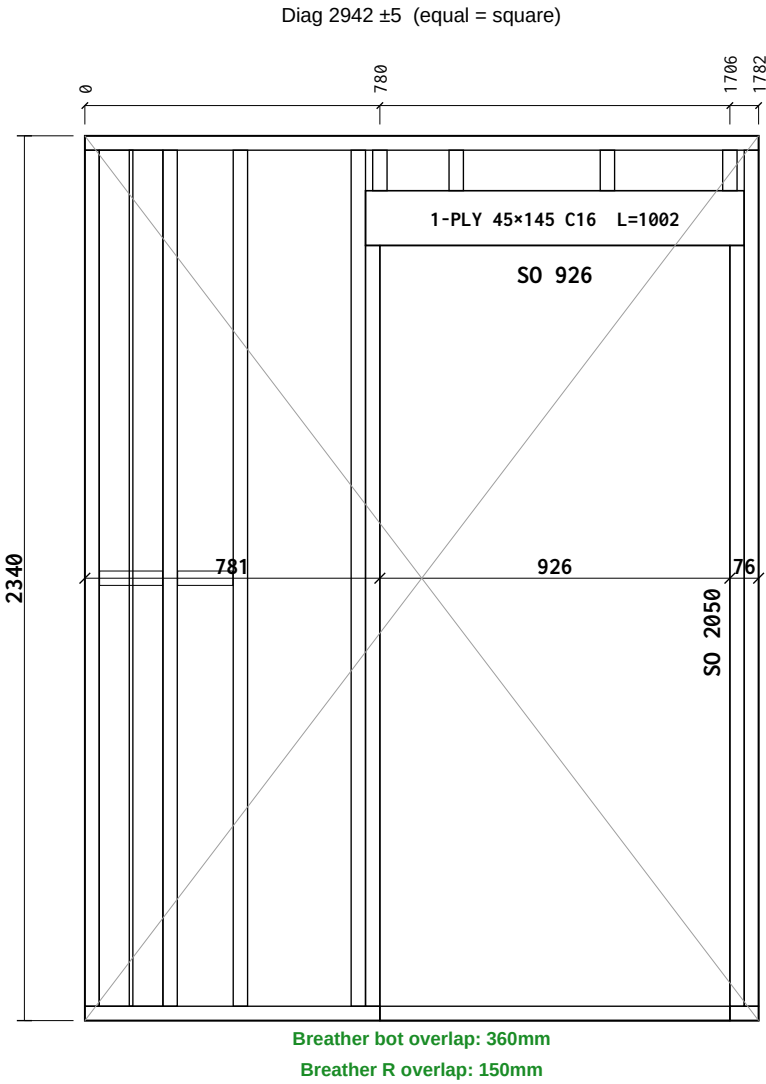

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1	Bottom Rail	38×89 C16	926	0	0 1
BR2	Bottom Rail	38×89 C16	781	0	0 1
BR3	Bottom Rail	38×89 C16	76	0	0 1
TR1	Top Rail	38×89 C16	1783	0	0 1
ES1	End Stud	38×89 C16	2264	0	0 1
ES2	End Stud	38×89 C16	107	0	0 1
KS1	Vertical Stud	38×89 C16	2264	0	0 2
CS1	Cripple Stud	38×89 C16	2012	0	0 2
LP1	Lintel Ply	1002×45 C16	1002	0	0 1
PK1	Lintel Packer	1002×41 C16	1002	0	0 1
OS1	OSB Support	38×89 C16	107	0	0 2
VS1	Vertical Stud	38×89 C16	2264	0	0 2
VS2	Vertical Stud	38×89 C16	107	0	0 1
JS1	Junction Stud	38×89 C16	2264	0	0 2
NG1	Noggin	38×89 C16	167	0	0 1
NG2	Noggin	38×89 C16	146	0	0 1

Total: 21 pcs / 26.18 m

Sheathing & Insulation

Material	W	HLabel
----------	---	--------

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.




Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN

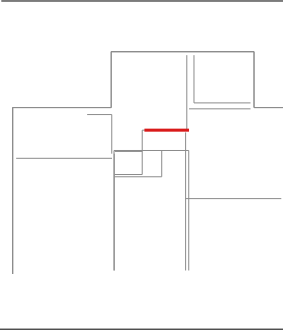

Revisions (Rev · Date · Note):		C01 - Construction issue					
Date:	2026-09-13	Scale:	1:20	Drawn:	TS	Checked:	
Project Name:		MP Adams Plot 3, Eckington					
Site:	Eckington			Client:	MP Adams		
Title:	Panel Fabrication — 38 x 140 C16 CLS						
Project Number:	P3			Revision:	C01		
Panel No:	FF-IN8			Drawing No:	P3-MF-FF-IN8		
Panel L×H×T:	1783×2340×89			Weight:	40 kg		
Status:	CONSTRUCTION			Sheet:	1 / 1		

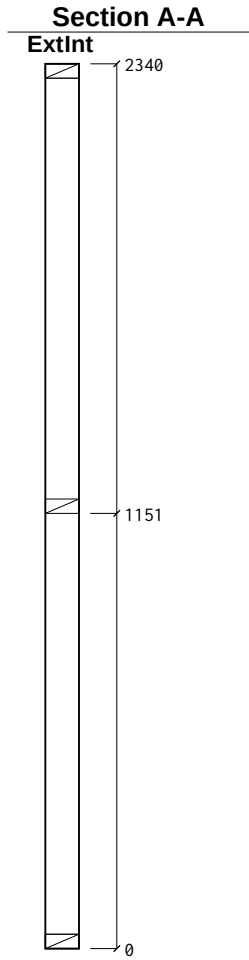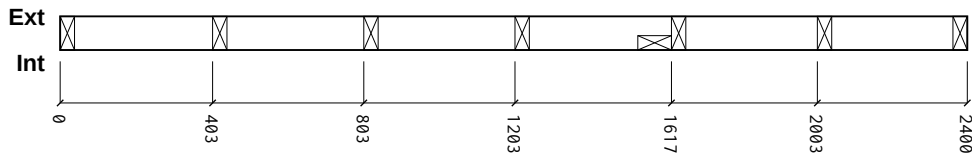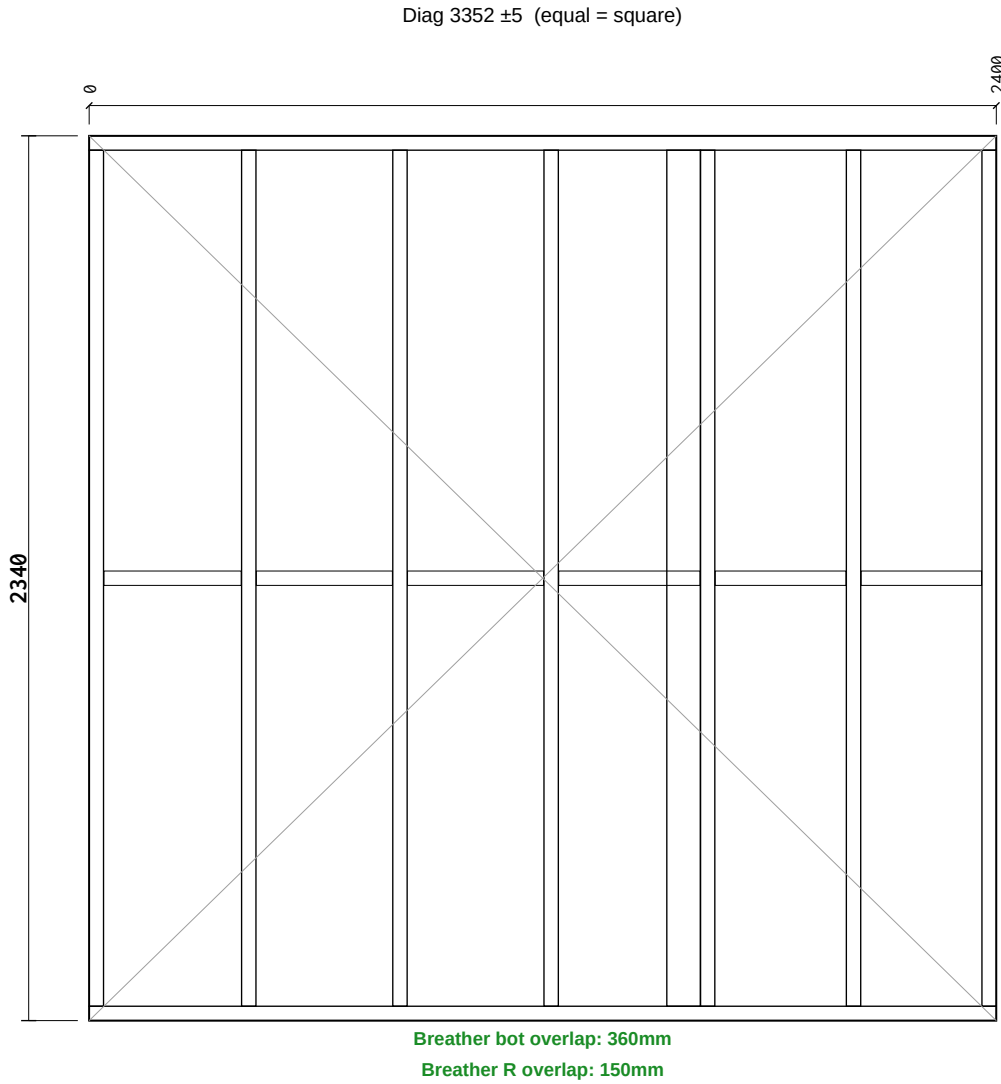

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×89 C16	2400	0	0	1
TR1 Top Rail	38×89 C16	2400	0	0	1
ES1 End Stud	38×89 C16	2264	0	0	1
ES2 End Stud	38×89 C16	2264	0	0	1
VS1 Vertical Stud	38×89 C16	2264	0	0	5
JS1 Junction Stud	38×89 C16	2264	0	0	1
NG1 Noggin	38×89 C16	374	0	0	1
NG2 Noggin	38×89 C16	363	0	0	1
NG3 Noggin	38×89 C16	360	0	0	2
NG4 Noggin	38×89 C16	346	0	0	1
NG5 Noggin	38×89 C16	319	0	0	1
Total: 16 pcs / 25.03 m					

Sheathing & Insulation

Material	W	HLabelI
----------	---	---------

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.


Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note):		C01 - Construction issue					
Date:	2026-09-13	Scale:	1:20	Drawn:	TS	Checked:	
Project Name:		MP Adams Plot 3, Eckington					
Site:	Eckington			Client:	MP Adams		
Title:	Panel Fabrication — 38 x 140 C16 CLS						
Project Number:	P3			Revision:	C01		
Panel No:	FF-IN9			Drawing No:	P3-MF-FF-IN9		
Panel L×H×T:	2400×2340×89			Weight:	36 kg		
Status:	CONSTRUCTION			Sheet:	1 / 1		


Diag 2414 ±5 (equal = square)

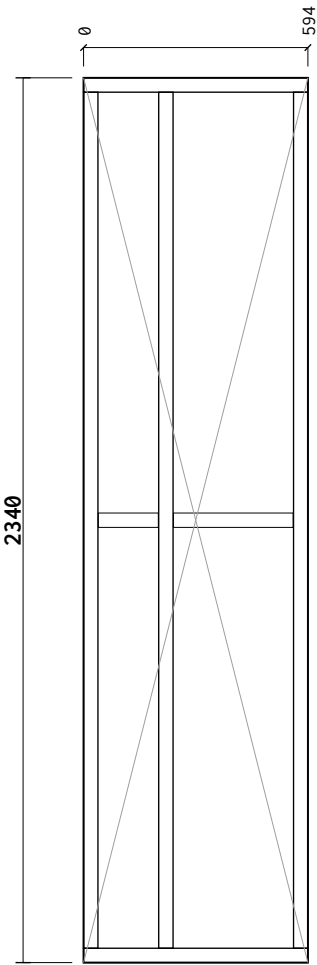

Breather bot overlap: 360mm
Breather R overlap: 150mm



Section A-A
ExtInt

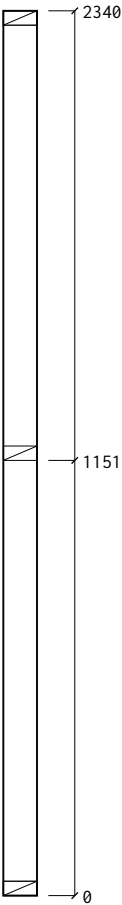

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×89 C16	594	0	0	1
TR1 Top Rail	38×89 C16	594	0	0	1
ES1 End Stud	38×89 C16	2264	0	0	1
ES2 End Stud	38×89 C16	2264	0	0	1
VS1 Vertical Stud	38×89 C16	2264	0	0	1
NG1 Noggin	38×89 C16	317	0	0	1
NG2 Noggin	38×89 C16	159	0	0	1
Total: 7 pcs / 8.46 m					

Sheathing & Insulation

Material	W	HLabel
----------	---	--------

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.




Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN



Revisions (Rev · Date · Note):		C01 - Construction issue					
Date:	2026-09-13	Scale:	1:20	Drawn:	TS	Checked:	
Project Name:		MP Adams Plot 3, Eckington					
Site:	Eckington			Client:	MP Adams		
Title:	Panel Fabrication — 38 x 140 C16 CLS						
Project Number:	P3			Revision:	C01		
Panel No:	FF-IN10			Drawing No:	P3-MF-FF-IN10		
Panel L×H×T:	594×2340×89			Weight:	12 kg		
Status:	CONSTRUCTION			Sheet:	1 / 1		

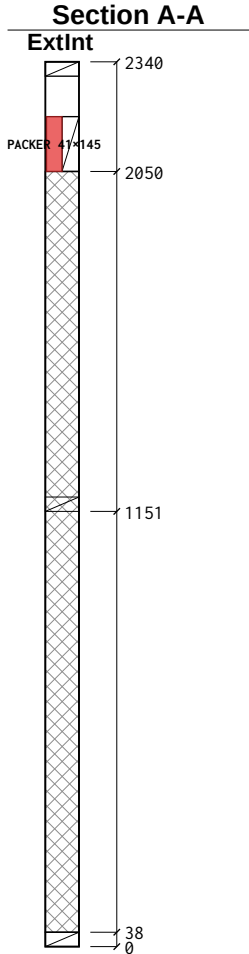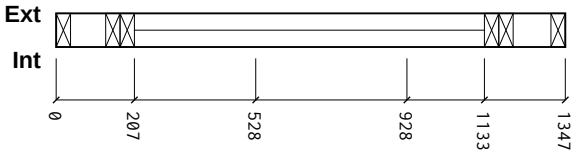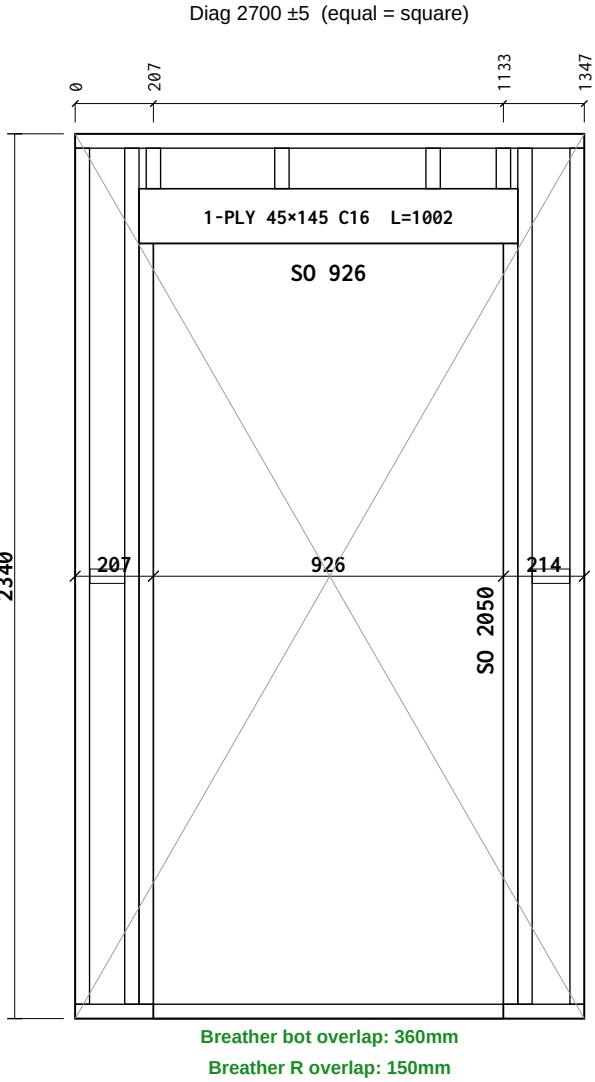

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1	Bottom Rail	38×89 C16	926	0	0 1
BR2	Bottom Rail	38×89 C16	214	0	0 1
BR3	Bottom Rail	38×89 C16	207	0	0 1
TR1	Top Rail	38×89 C16	1347	0	0 1
ES1	End Stud	38×89 C16	2264	0	0 1
ES2	End Stud	38×89 C16	2264	0	0 1
KS1	Vertical Stud	38×89 C16	2264	0	0 2
CS1	Cripple Stud	38×89 C16	2012	0	0 2
LP1	Lintel Ply	1002×45 C16	1002	0	0 1
PK1	Lintel Packer	1002×41 C16	1002	0	0 1
OS1	OSB Support	38×89 C16	107	0	0 2
VS1	Vertical Stud	38×89 C16	107	0	0 2
NG1	Noggin	38×89 C16	99	0	0 1
NG2	Noggin	38×89 C16	92	0	0 1

Total: 18 pcs / 18.40 m

Sheathing & Insulation

Material	W	HLabel
----------	---	--------

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.




Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN



Revisions (Rev · Date · Note):		C01 - Construction issue					
Date:	2026-09-13	Scale:	1:20	Drawn:	TS	Checked:	
Project Name:		MP Adams Plot 3, Eckington					
Site:	Eckington			Client:	MP Adams		
Title:	Panel Fabrication — 38 x 140 C16 CLS						
Project Number:	P3			Revision:	C01		
Panel No:	FF-IN11			Drawing No:	P3-MF-FF-IN11		
Panel L×H×T:	1347×2340×89			Weight:	29 kg		
Status:	CONSTRUCTION			Sheet:	1 / 1		

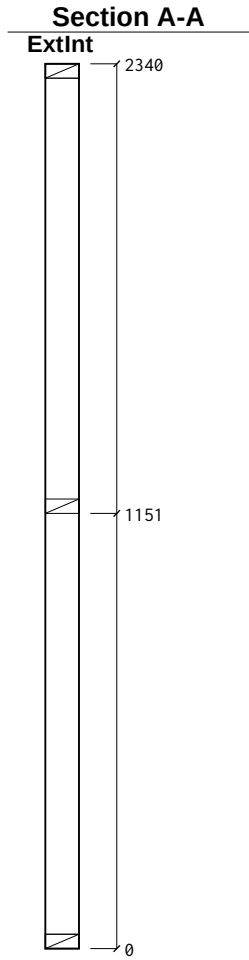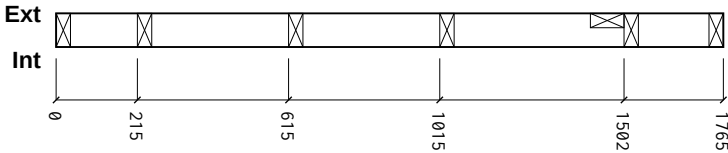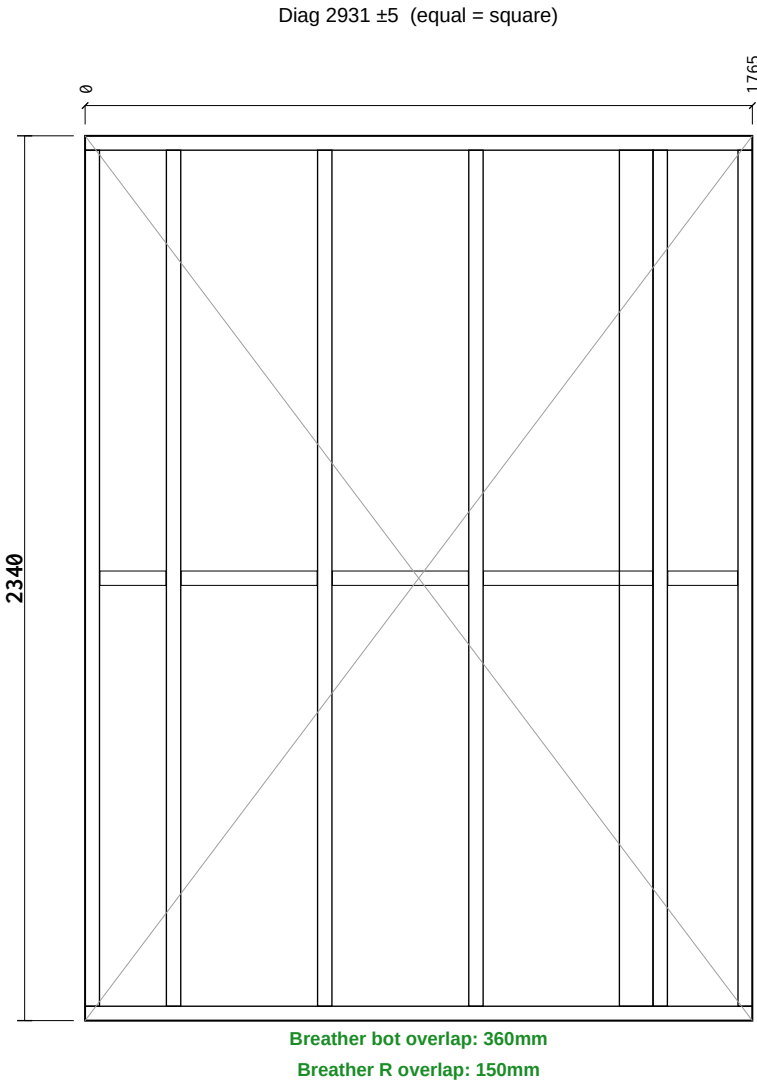

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×89 C16	1765	0	0	1
TR1 Top Rail	38×89 C16	1765	0	0	1
ES1 End Stud	38×89 C16	2264	0	0	1
ES2 End Stud	38×89 C16	2264	0	0	1
VS1 Vertical Stud	38×89 C16	2264	0	0	4
JS1 Junction Stud	38×89 C16	2264	0	0	1
NG1 Noggin	38×89 C16	448	0	0	1
NG2 Noggin	38×89 C16	360	0	0	2
NG3 Noggin	38×89 C16	185	0	0	1
NG4 Noggin	38×89 C16	175	0	0	1
Total: 14 pcs / 20.91 m					

Sheathing & Insulation

Material	W	HLabel
----------	---	--------

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.




Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN



Revisions (Rev · Date · Note):		C01 - Construction issue					
Date:	2026-09-13	Scale:	1:20	Drawn:	TS	Checked:	
Project Name:		MP Adams Plot 3, Eckington					
Site:	Eckington			Client:	MP Adams		
Title:	Panel Fabrication — 38 x 140 C16 CLS						
Project Number:	P3			Revision:	C01		
Panel No:	FF-IN12			Drawing No:	P3-MF-FF-IN12		
Panel L×H×T:	1765×2340×89			Weight:	30 kg		
Status:	CONSTRUCTION			Sheet:	1 / 1		

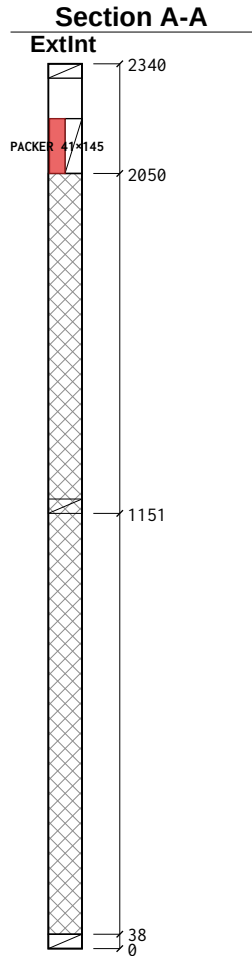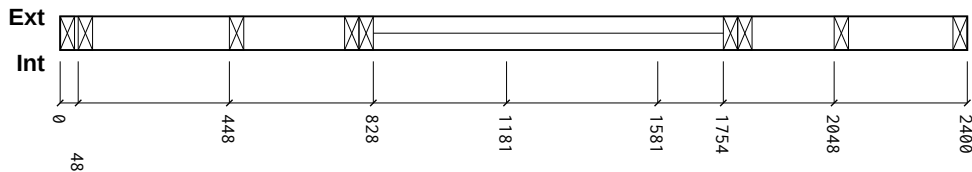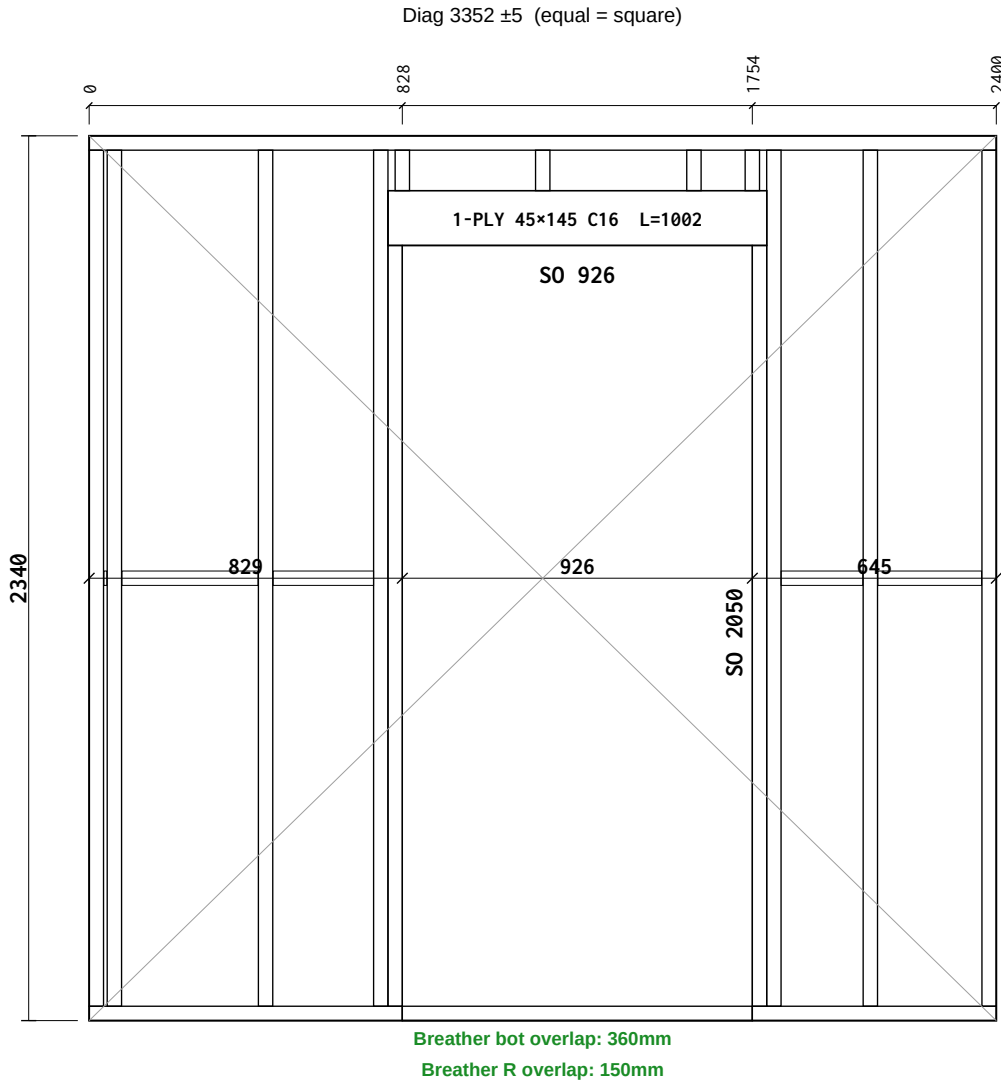

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1	Bottom Rail	38×89 C16	926	0	0 1
BR2	Bottom Rail	38×89 C16	829	0	0 1
BR3	Bottom Rail	38×89 C16	645	0	0 1
TR1	Top Rail	38×89 C16	2400	0	0 1
ES1	End Stud	38×89 C16	2264	0	0 1
ES2	End Stud	38×89 C16	2264	0	0 1
KS1	Vertical Stud	38×89 C16	2264	0	0 2
CS1	Cripple Stud	38×89 C16	2012	0	0 2
LP1	Lintel Ply	1002×45 C16	1002	0	0 1
PK1	Lintel Packer	1002×41 C16	1002	0	0 1
OS1	OSB Support	38×89 C16	107	0	0 2
VS1	Vertical Stud	38×89 C16	2264	0	0 3
VS2	Vertical Stud	38×89 C16	107	0	0 2
NG1	Noggin	38×89 C16	360	0	0 1
NG2	Noggin	38×89 C16	274	0	0 1
NG3	Noggin	38×89 C16	266	0	0 1
NG4	Noggin	38×89 C16	216	0	0 1
NG5	Noggin	38×89 C16	8	0	0 1

Total: 24 pcs / 28.23 m

Sheathing & Insulation

Material	W	HLabel
----------	---	--------

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.




KEY PLAN

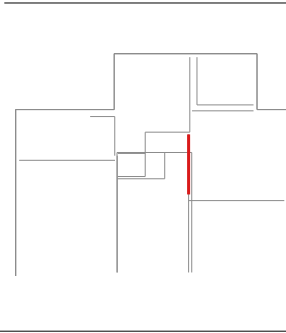

Revisions (Rev · Date · Note):

C01 - Construction issue

Date:	2026-09-13	Scale:	1:20	Drawn:	TS	Checked:	
Project Name:	MP Adams Plot 3, Eckington						
Site:	Eckington			Client:	MP Adams		
Title:	Panel Fabrication — 38 x 140 C16 CLS						
Project Number:	P3			Revision:	C01		
Panel No:	FF-IN13			Drawing No:	P3-MF-FF-IN13		
Panel L×H×T:	2400×2340×89			Weight:	42 kg		
Status:	CONSTRUCTION			Sheet:	1 / 1		

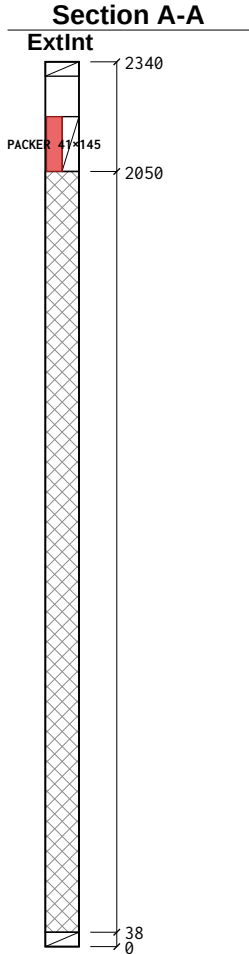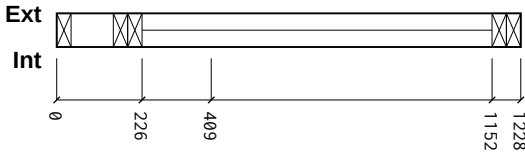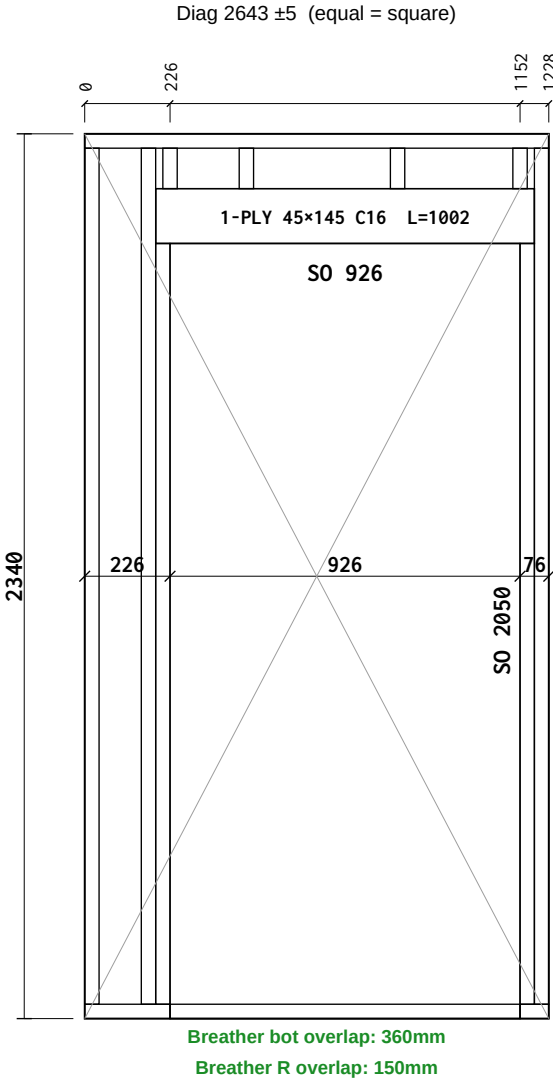

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1	Bottom Rail	38×89 C16	926	0	0 1
BR2	Bottom Rail	38×89 C16	226	0	0 1
BR3	Bottom Rail	38×89 C16	76	0	0 1
TR1	Top Rail	38×89 C16	1228	0	0 1
ES1	End Stud	38×89 C16	2264	0	0 1
ES2	End Stud	38×89 C16	107	0	0 1
KS1	Vertical Stud	38×89 C16	2264	0	0 2
CS1	Cripple Stud	38×89 C16	2012	0	0 2
LP1	Lintel Ply	1002×45 C16	1002	0	0 1
PK1	Lintel Packer	1002×41 C16	1002	0	0 1
OS1	OSB Support	38×89 C16	107	0	0 2
VS1	Vertical Stud	38×89 C16	107	0	0 1

Total: 15 pcs / 15.70 m

Sheathing & Insulation

Material	W	HLabel
----------	---	--------

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.




Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN



Revisions (Rev · Date · Note):				C01 - Construction issue			
Date:	2026-09-13	Scale:	1:20	Drawn:	TS	Checked:	
Project Name:		MP Adams Plot 3, Eckington					
Site:	Eckington			Client:	MP Adams		
Title:		Panel Fabrication — 38 x 140 C16 CLS					
Project Number:		P3		Revision:	C01		
Panel No:		FF-IN14		Drawing No:	P3-MF-FF-IN14		
Panel L×H×T:		1228×2340×89		Weight:	25 kg		
Status:		CONSTRUCTION		Sheet:	1 / 1		

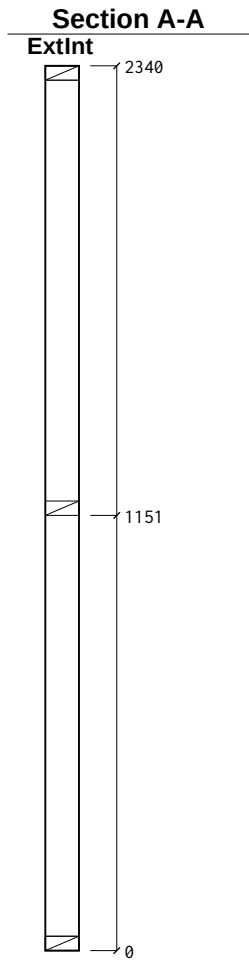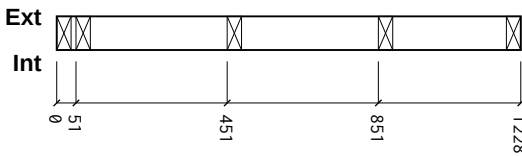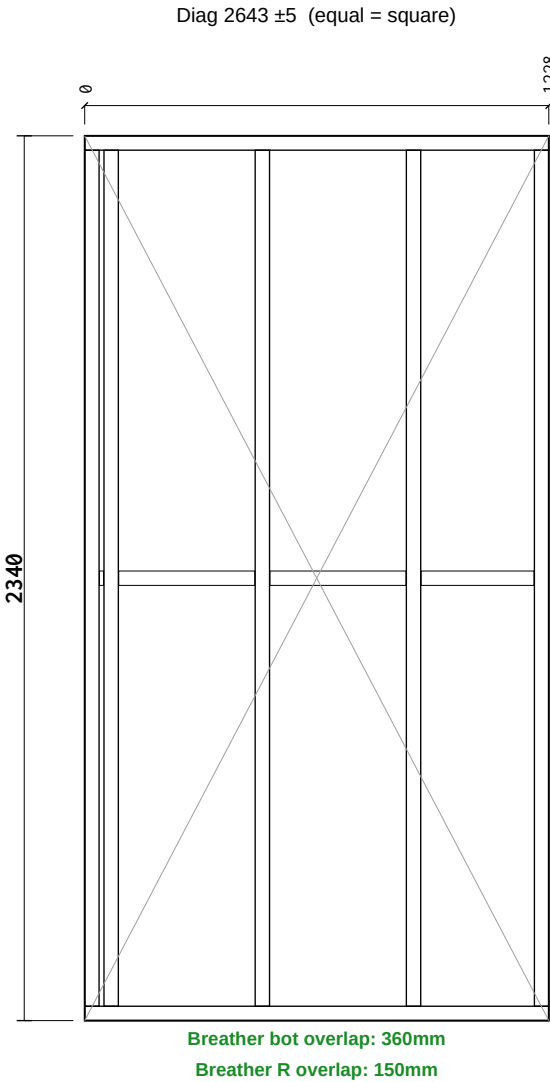

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×89 C16	1228	0	0	1
TR1 Top Rail	38×89 C16	1228	0	0	1
ES1 End Stud	38×89 C16	2264	0	0	1
ES2 End Stud	38×89 C16	2264	0	0	1
VS1 Vertical Stud	38×89 C16	2264	0	0	3
NG1 Noggin	38×89 C16	360	0	0	2
NG2 Noggin	38×89 C16	299	0	0	1
NG3 Noggin	38×89 C16	11	0	0	1
Total: 11 pcs / 14.81 m					

Sheathing & Insulation

Material	W	HLabel
----------	---	--------

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.




KEY PLAN



Revisions (Rev · Date · Note):

C01 - Construction issue

Date:	2026-09-13	Scale:	1:20	Drawn:	TS	Checked:	
Project Name:		MP Adams Plot 3, Eckington					
Site:	Eckington			Client:	MP Adams		
Title:		Panel Fabrication — 38 x 140 C16 CLS					
Project Number:		P3		Revision:	C01		
Panel No:		FF-IN15		Drawing No:	P3-MF-FF-IN15		
Panel L×H×T:		1228×2340×89		Weight:	21 kg		
Status:		CONSTRUCTION		Sheet:	1 / 1		

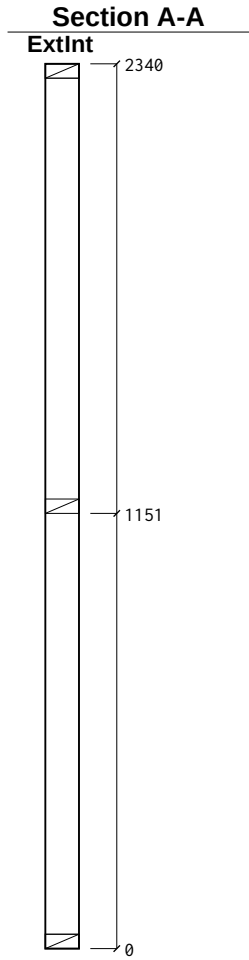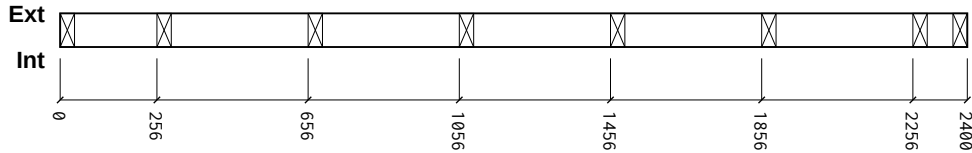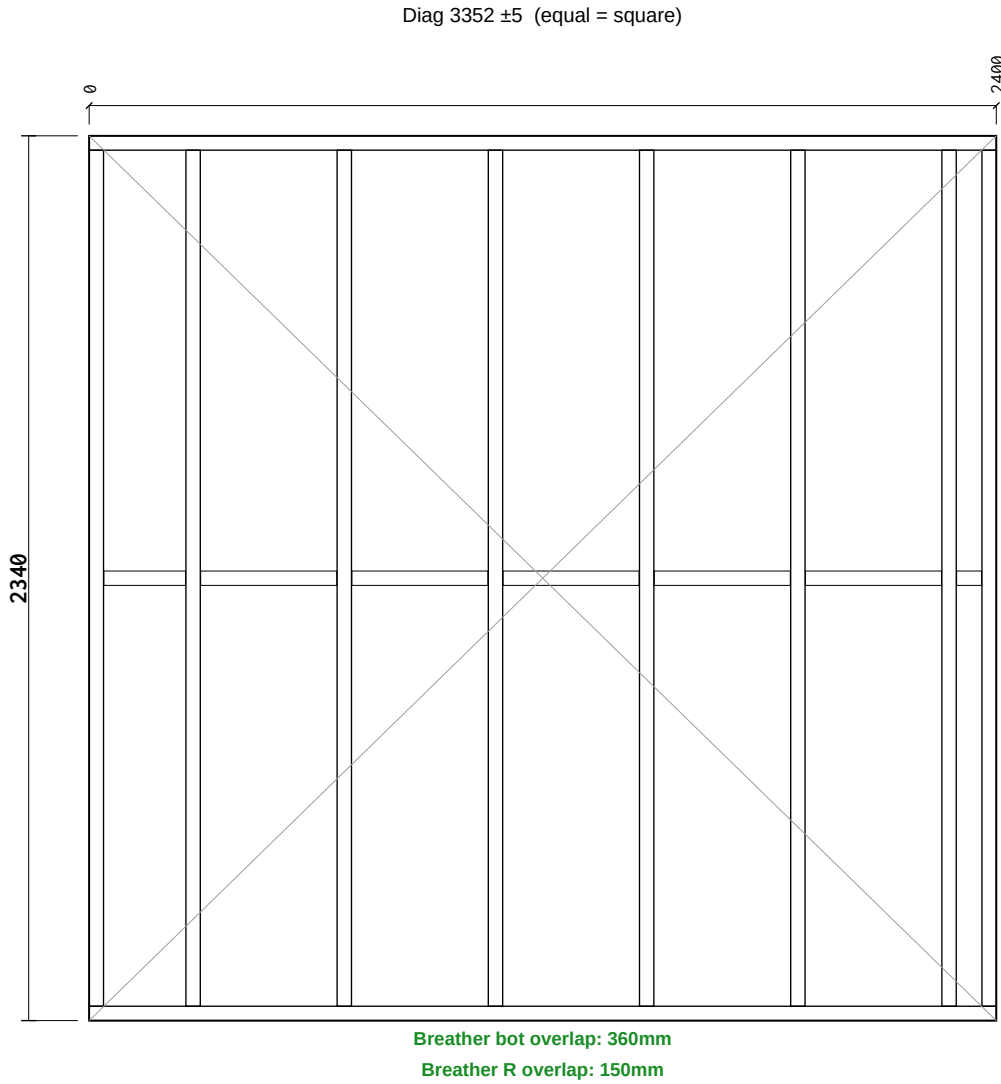

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×89 C16	2400	0	0	1
TR1 Top Rail	38×89 C16	2400	0	0	1
ES1 End Stud	38×89 C16	2264	0	0	1
ES2 End Stud	38×89 C16	2264	0	0	1
VS1 Vertical Stud	38×89 C16	2264	0	0	6
NG1 Noggin	38×89 C16	360	0	0	5
NG2 Noggin	38×89 C16	216	0	0	1
NG3 Noggin	38×89 C16	66	0	0	1

Total: 17 pcs / 24.99 m

Sheathing & Insulation

Material	W	HLabel
----------	---	--------

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.




Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN



Revisions (Rev · Date · Note):		C01 - Construction issue					
Date:	2026-09-13	Scale:	1:20	Drawn:	TS	Checked:	
Project Name:		MP Adams Plot 3, Eckington					
Site:	Eckington			Client:	MP Adams		
Title:	Panel Fabrication — 38 x 140 C16 CLS						
Project Number:	P3			Revision:	C01		
Panel No:	FF-IN16			Drawing No:	P3-MF-FF-IN16		
Panel L×H×T:	2400×2340×89			Weight:	36 kg		
Status:	CONSTRUCTION			Sheet:	1 / 1		

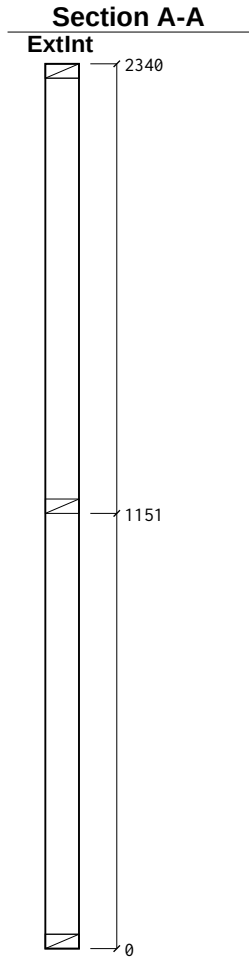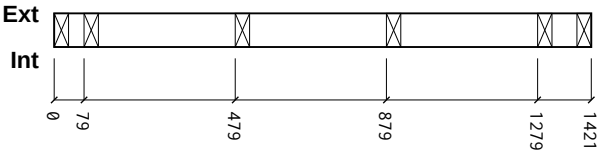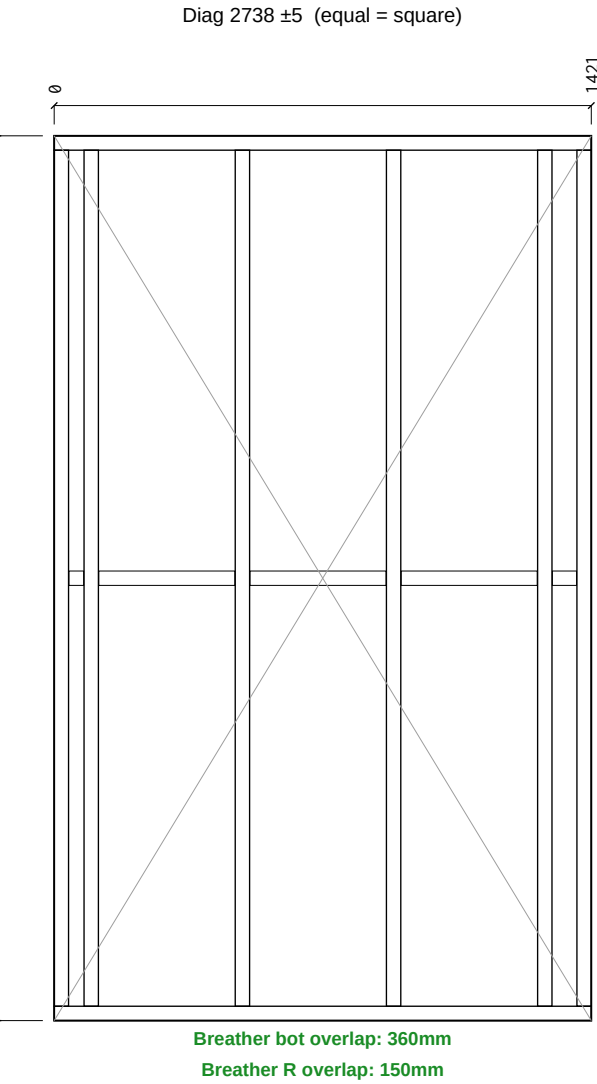

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×89 C16	1421	0	0	1
TR1 Top Rail	38×89 C16	1421	0	0	1
ES1 End Stud	38×89 C16	2264	0	0	1
ES2 End Stud	38×89 C16	2264	0	0	1
VS1 Vertical Stud	38×89 C16	2264	0	0	4
NG1 Noggin	38×89 C16	360	0	0	3
NG2 Noggin	38×89 C16	64	0	0	1
NG3 Noggin	38×89 C16	39	0	0	1

Total: 13 pcs / 17.61 m

Sheathing & Insulation

Material	W	HLabel
----------	---	--------

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN



Revisions (Rev · Date · Note):				C01 - Construction issue			
Date:	2026-09-13	Scale:	1:20	Drawn:	TS	Checked:	
Project Name:		MP Adams Plot 3, Eckington					
Site:	Eckington			Client:	MP Adams		
Title:		Panel Fabrication — 38 x 140 C16 CLS					
Project Number:		P3		Revision:		C01	
Panel No:		FF-IN17		Drawing No:		P3-MF-FF-IN17	
Panel L×H×T:		1421×2340×89		Weight:		25 kg	
Status:		CONSTRUCTION		Sheet:		1 / 1	