

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 3352 ±5 (equal = square)

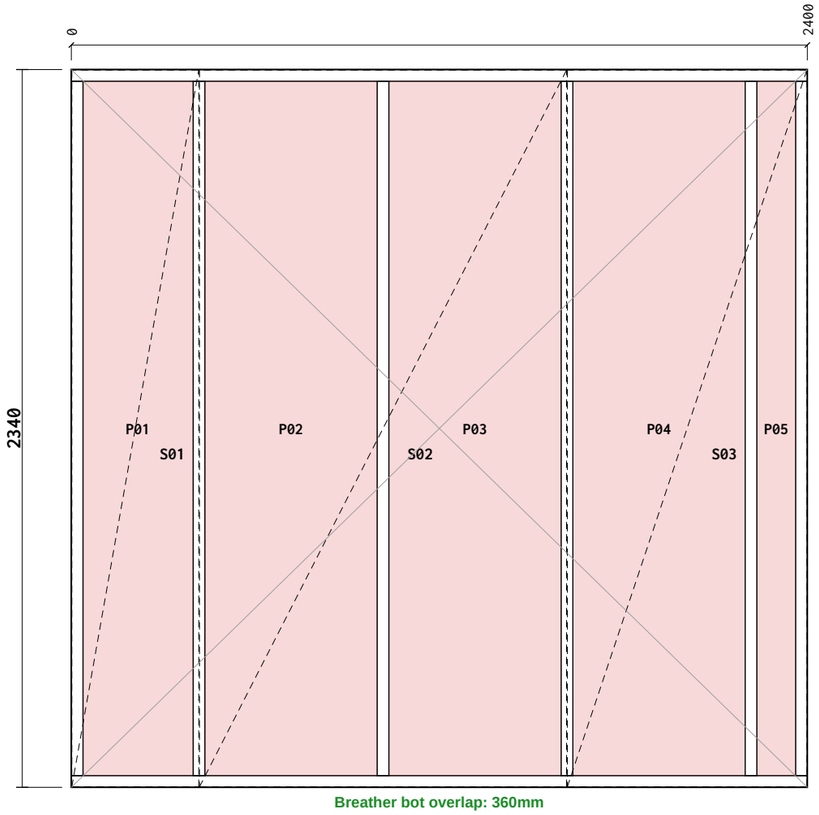


Breather bot overlap: 360mm

Breather R overlap: 150mm

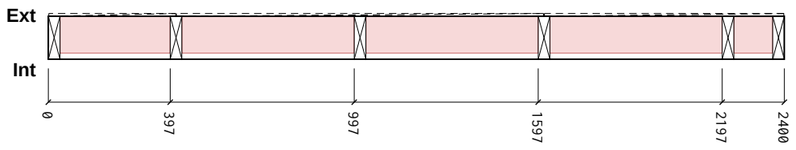

Section A-A

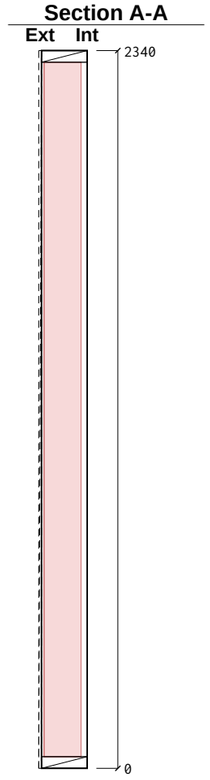

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2400	0	0	1
TR1 Top Rail	38×140 C16	2400	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
VS1 Vertical Stud	38×140 C16	2264	0	0	4

Total: 8 pcs / 18.38 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	414	2337	**S01**
OSB 9mm	1197	2337	**S02**
OSB 9mm	781	2337	**S03**
PIR 120mm	358	2264	**P01**
PIR 120mm	561	2264	**P02**
PIR 120mm	561	2264	**P03**
PIR 120mm	561	2264	**P04**
PIR 120mm	126	2264	**P05**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.


KEY PLAN



Revisions (Rev · Date · Note):	C02 - Roof trusses revised; SP diagonals added
Date: 2026-09-14	Scale: 1:20 · Drawn: TS · Checked:
Project Name:	MP Adams Plot 4, Eckington
Site: Eckington	Client: MP Adams
Title:	Panel Fabrication — 38 x 140 C16 CLS
Project Number: P4	Revision: C02
Panel No: FF-EX1	Drawing No: P4-MF-FF-EX1
Panel L×H×T: 2400×2340×149	Weight: 92 kg
Status: CONSTRUCTION	Sheet: 1 / 1


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)


Diag 3352 ±5 (equal = square)

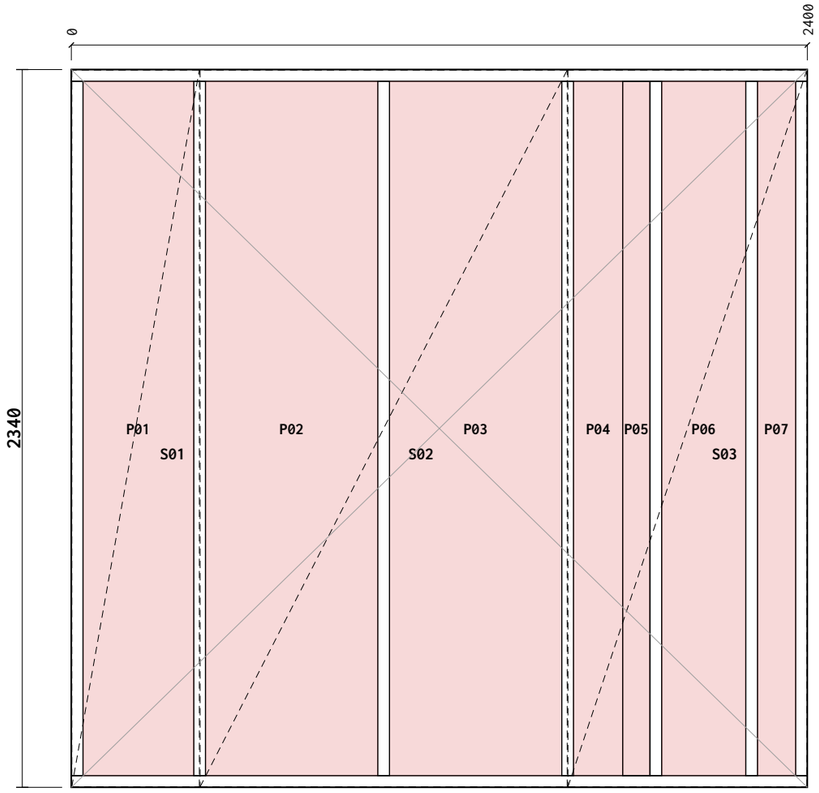

Breather bot overlap: 360mm

Breather R overlap: 150mm

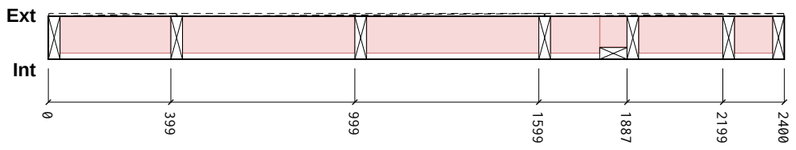

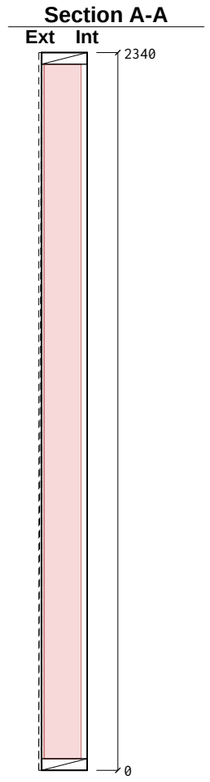

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2400	0	0	1
TR1 Top Rail	38×140 C16	2400	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
VS1 Vertical Stud	38×140 C16	2264	0	0	5
JS1 Junction Stud	38×89 C16	2264	0	0	1

Total: 10 pcs / 22.91 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	416	2337	**S01**
OSB 9mm	1197	2337	**S02**
OSB 9mm	779	2337	**S03**
PIR 120mm	360	2264	**P01**
PIR 120mm	561	2264	**P02**
PIR 120mm	561	2264	**P03**
PIR 120mm	160	2264	**P04**
PIR 100mm	89	2264	**P05**
PIR 120mm	273	2264	**P06**
PIR 120mm	124	2264	**P07**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.


KEY PLAN



Revisions (Rev · Date · Note):	C02 - Roof trusses revised; SP diagonals added		
Date: 2026-09-14	Scale: 1:20	Drawn: TS	Checked:
Project Name:	MP Adams Plot 4, Eckington		
Site: Eckington		Client: MP Adams	
Title:	Panel Fabrication — 38 x 140 C16 CLS		
Project Number: P4		Revision: C02	
Panel No: FF-EX2		Drawing No: P4-MF-FF-EX2	
Panel L×H×T: 2400×2340×149		Weight: 100 kg	
Status: CONSTRUCTION		Sheet: 1 / 1	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2901 ±5 (equal = square)

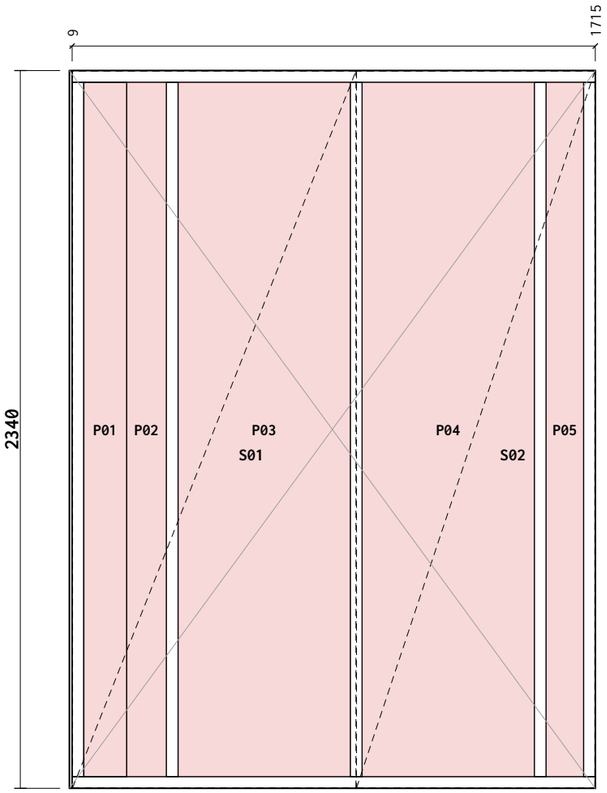


Breather bot overlap: 360mm

Breather R overlap: 150mm

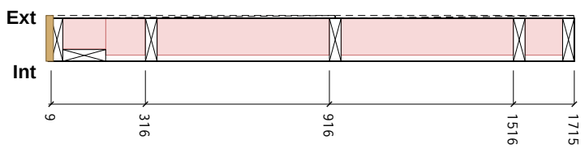

Section A-A

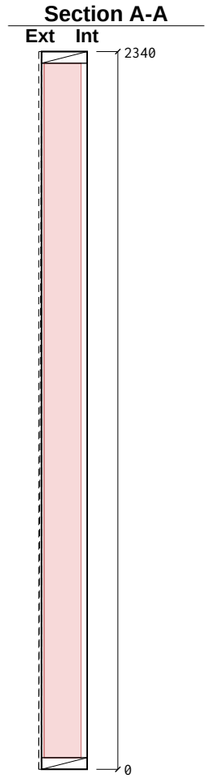

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	1706	0	0	1
TR1 Top Rail	38×140 C16	1706	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
VS1 Vertical Stud	38×140 C16	2264	0	0	3
JS1 Junction Stud	38×140 C16	2264	0	0	1

Total: 8 pcs / 17.00 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	924	2337	**S01**
OSB 9mm	777	2337	**S02**
PIR 100mm	140	2264	**P01**
PIR 120mm	129	2264	**P02**
PIR 120mm	561	2264	**P03**
PIR 120mm	561	2264	**P04**
PIR 120mm	122	2264	**P05**
OSB End Cap 9mm	146	2337	**E01**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.


KEY PLAN



Revisions (Rev · Date · Note):	C02 - Roof trusses revised; SP diagonals added		
Date: 2026-09-14	Scale: 1:20	Drawn: TS	Checked:
Project Name:	MP Adams Plot 4, Eckington		
Site: Eckington		Client: MP Adams	
Title:	Panel Fabrication — 38 x 140 C16 CLS		
Project Number: P4		Revision: C02	
Panel No: FF-EX3		Drawing No: P4-MF-FF-EX3	
Panel L×H×T: 1715×2340×149		Weight: 76 kg	
Status: CONSTRUCTION		Sheet: 1 / 1	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2543 ±5 (equal = square)

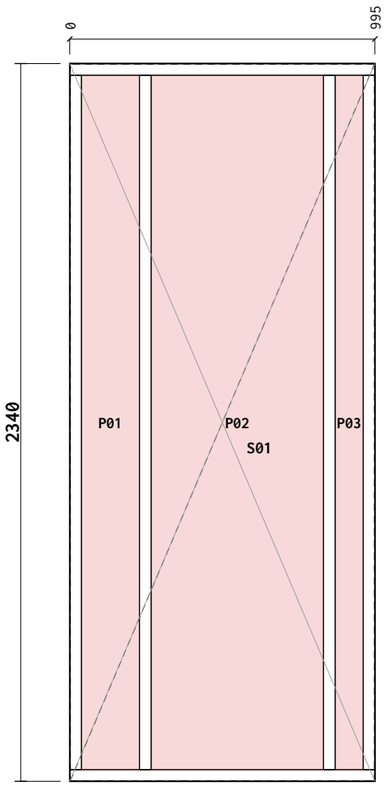


Breather bot overlap: 360mm

Breather R overlap: 150mm

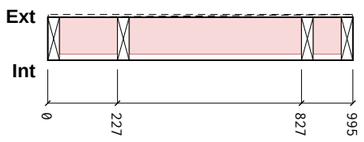

Section A-A

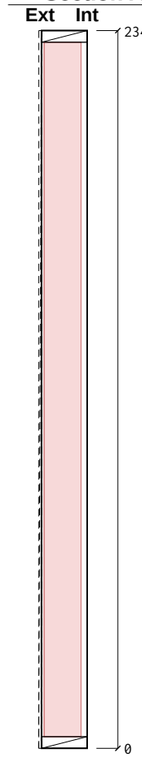

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	995	0	0	1
TR1 Top Rail	38×140 C16	995	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
VS1 Vertical Stud	38×140 C16	2264	0	0	2

Total: 6 pcs / 11.05 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	992	2337	**S01**
PIR 120mm	188	2264	**P01**
PIR 120mm	561	2264	**P02**
PIR 120mm	91	2264	**P03**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.


KEY PLAN



Revisions (Rev · Date · Note):	C02 - Roof trusses revised; SP diagonals added
Date: 2026-09-14	Scale: 1:20 · Drawn: TS · Checked:
Project Name:	MP Adams Plot 4, Eckington
Site: Eckington	Client: MP Adams
Title:	Panel Fabrication — 38 x 140 C16 CLS
Project Number: P4	Revision: C02
Panel No: FF-EX4	Drawing No: P4-MF-FF-EX4
Panel L×H×T: 995×2340×149	Weight: 45 kg
Status: CONSTRUCTION	Sheet: 1 / 1


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 3352 ±5 (equal = square)

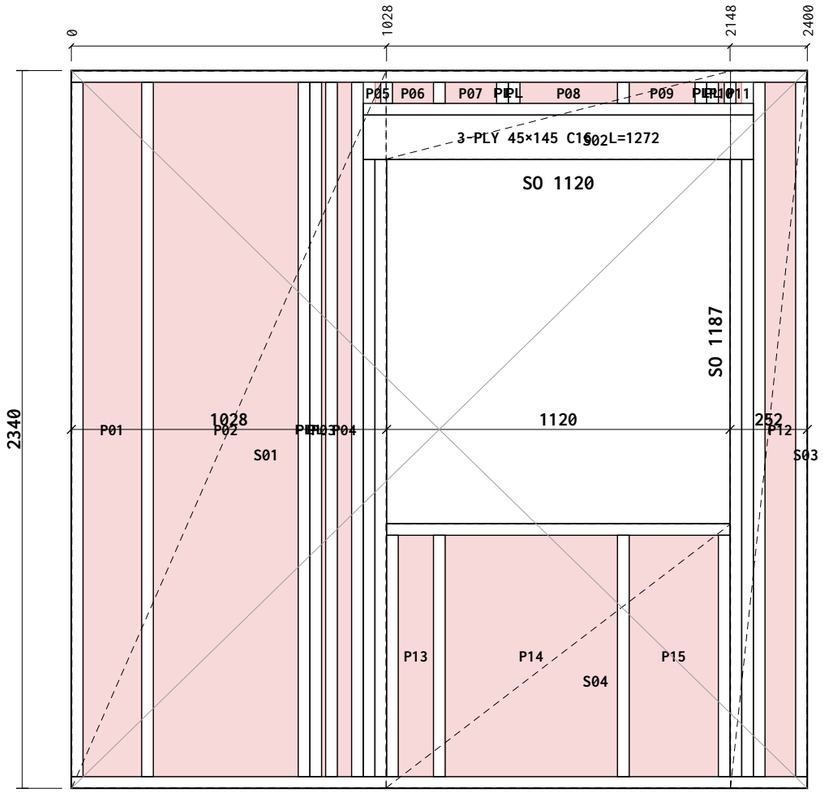


Breather bot overlap: 360mm

Breather R overlap: 150mm

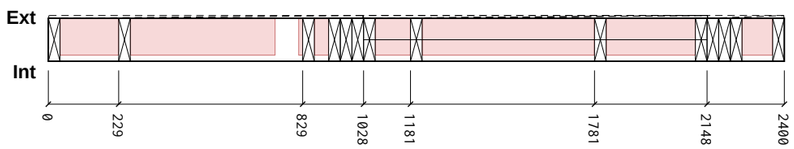

Section A-A

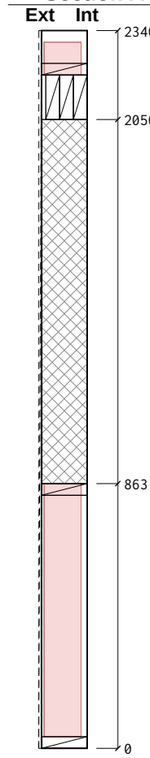

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2400	0	0	1
TR1 Top Rail	38×140 C16	2400	0	0	1
TR2 Top Rail	38×140 C16	1272	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
KS1 Vertical Stud	38×140 C16	2264	0	0	2
CS1 Cripple Stud	38×140 C16	2012	0	0	4
SP1 Sill Plate	38×140 C16	1120	0	0	1
LP1 Lintel Ply	1272×45 C16	1272	0	0	3
SS1 Sill Support	38×140 C16	787	0	0	2
OS1 OSB Support	38×140 C16	69	0	0	2
VS1 Vertical Stud	38×140 C16	2264	0	0	2
VS2 Vertical Stud	38×140 C16	787	0	0	2
VS3 Vertical Stud	38×140 C16	69	0	0	2

Total: 25 pcs / 36.06 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	1025	2337	**S01**
OSB 9mm	1123	287	**S02**
OSB 9mm	249	2337	**S03**
OSB 9mm	1123	860	**S04**
PIR 120mm	190	2264	**P01**
PIR 120mm	472	2264	**P02**
PIR 120mm	12	2264	**P03**
PIR 120mm	45	2264	**P04**
PIR 120mm	18	69	**P05**
PIR 120mm	133	69	**P06**
PIR 120mm	167	69	**P07**
PIR 120mm	317	69	**P08**
PIR 120mm	214	69	**P09**
PIR 120mm	18	69	**P10**
PIR 120mm	18	69	**P11**
PIR 120mm	98	2264	**P12**
PIR 120mm	114	786	**P13**
PIR 120mm	561	786	**P14**
PIR 120mm	290	786	**P15**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.


KEY PLAN



Revisions (Rev · Date · Note):	C02 - Roof trusses revised; SP diagonals added		
Date: 2026-09-14	Scale: 1:20	Drawn: TS	Checked:
Project Name:	MP Adams Plot 4, Eckington		
Site: Eckington		Client: MP Adams	
Title:	Panel Fabrication — 38 x 140 C16 CLS		
Project Number: P4		Revision: C02	
Panel No: FF-EX5		Drawing No: P4-MF-FF-EX5	
Panel L×H×T: 2400×2340×149		Weight: 117 kg	
Status: CONSTRUCTION		Sheet: 1 / 1	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2393 ±5 (equal = square)

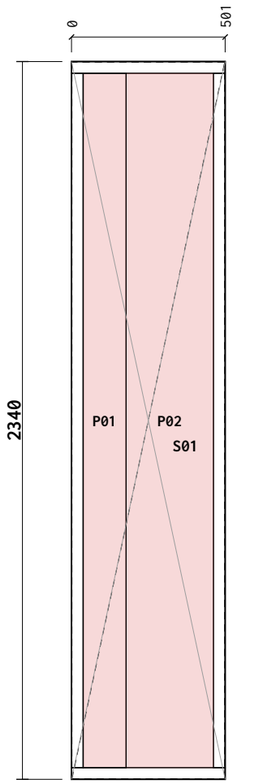


Breather bot overlap: 360mm

Breather R overlap: 150mm



Section A-A

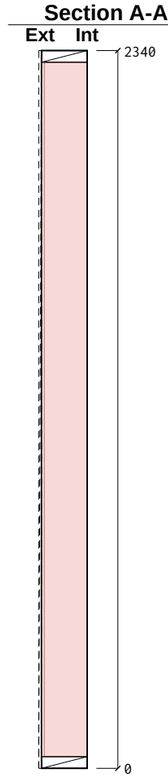

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	501	0	0	1
TR1 Top Rail	38×140 C16	501	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
JS1 Junction Stud	38×140 C16	2264	0	0	1

Total: 5 pcs / 7.79 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	498	2337	**S01**
PIR 100mm	140	2264	**P01**
PIR 120mm	285	2264	**P02**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note): **C02 - Roof trusses revised; SP diagonals added**

Date: **2026-09-14**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C02**	
Panel No: **FF-EX6**		Drawing No: **P4-MF-FF-EX6**	
Panel L×H×T: **501×2340×149**		Weight: **28 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2432 ±5 (equal = square)

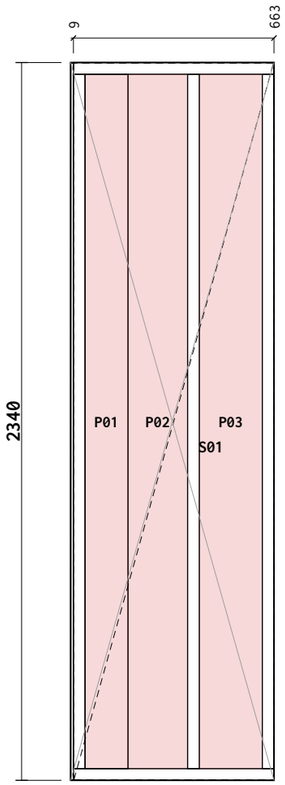


Breather bot overlap: 360mm

Breather R overlap: 150mm



Section A-A

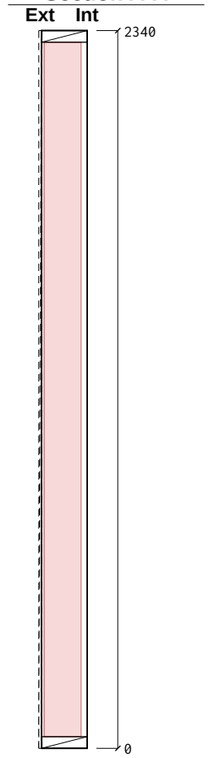

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	654	0	0	1
TR1 Top Rail	38×140 C16	654	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
VS1 Vertical Stud	38×140 C16	2264	0	0	1
JS1 Junction Stud	38×140 C16	2264	0	0	1

Total: 6 pcs / 10.36 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	651	2337	**S01**
PIR 100mm	140	2264	**P01**
PIR 120mm	194	2264	**P02**
PIR 120mm	205	2264	**P03**
OSB End Cap 9mm	146	2337	**E01**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note): **C02 - Roof trusses revised; SP diagonals added**

Date: **2026-09-14**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C02**	
Panel No: **FF-EX7**		Drawing No: **P4-MF-FF-EX7**	
Panel L×H×T: **663×2340×149**		Weight: **38 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 3090 ±5 (equal = square)

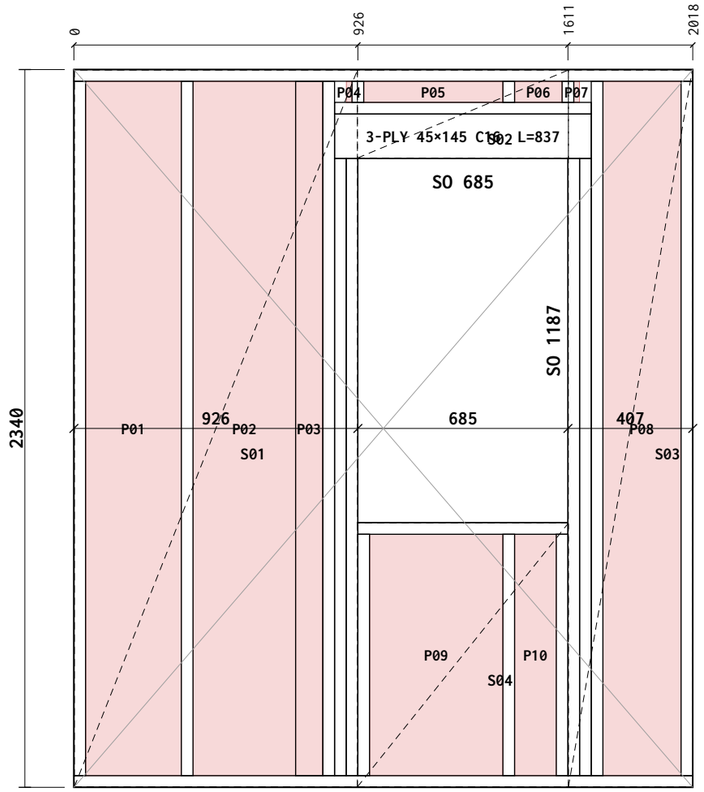


Breather bot overlap: 360mm

Breather R overlap: 150mm

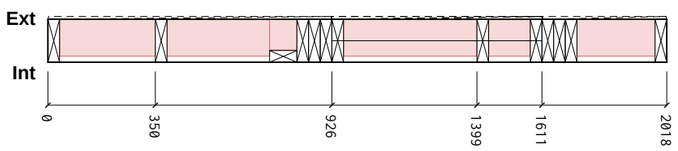

Section A-A

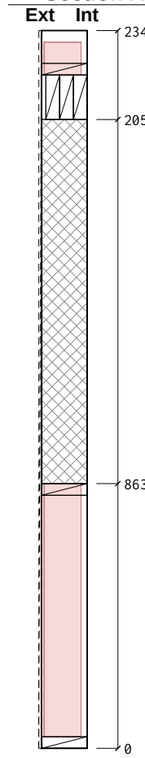

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2018	0	0	1
TR1 Top Rail	38×140 C16	2018	0	0	1
TR2 Top Rail	38×140 C16	837	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
KS1 Vertical Stud	38×140 C16	2264	0	0	2
CS1 Cripple Stud	38×140 C16	2012	0	0	4
SP1 Sill Plate	38×140 C16	685	0	0	1
LP1 Lintel Ply	837×45 C16	837	0	0	3
SS1 Sill Support	38×140 C16	787	0	0	2
OS1 OSB Support	38×140 C16	69	0	0	2
VS1 Vertical Stud	38×140 C16	2264	0	0	1
VS2 Vertical Stud	38×140 C16	787	0	0	1
VS3 Vertical Stud	38×140 C16	69	0	0	1
JS1 Junction Stud	38×89 C16	2264	0	0	1

Total: 23 pcs / 32.27 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	923	2337	**S01**
OSB 9mm	688	287	**S02**
OSB 9mm	404	2337	**S03**
OSB 9mm	688	860	**S04**
PIR 120mm	311	2264	**P01**
PIR 120mm	334	2264	**P02**
PIR 100mm	88	2264	**P03**
PIR 120mm	18	69	**P04**
PIR 120mm	453	69	**P05**
PIR 120mm	154	69	**P06**
PIR 120mm	18	69	**P07**
PIR 120mm	254	2264	**P08**
PIR 120mm	434	786	**P09**
PIR 120mm	135	786	**P10**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm

Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note): **C02 - Roof trusses revised; SP diagonals added**

Date: **2026-09-14**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C02**	
Panel No: **FF-EX8**		Drawing No: **P4-MF-FF-EX8**	
Panel L×H×T: **2018×2340×149**		Weight: **104 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2779 ±5 (equal = square)

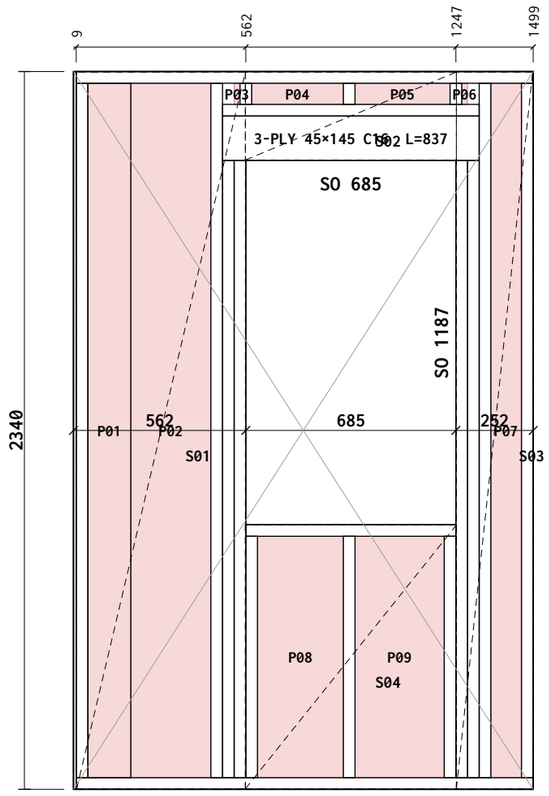


Breather bot overlap: 360mm

Breather R overlap: 150mm

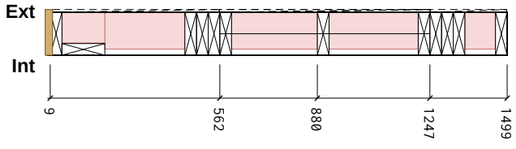

Section A-A

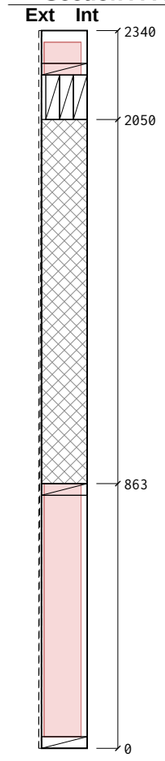

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	1490	0	0	1
TR1 Top Rail	38×140 C16	1490	0	0	1
TR2 Top Rail	38×140 C16	837	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
KS1 Vertical Stud	38×140 C16	2264	0	0	2
CS1 Cripple Stud	38×140 C16	2012	0	0	4
SP1 Sill Plate	38×140 C16	685	0	0	1
LP1 Lintel Ply	837×45 C16	837	0	0	3
SS1 Sill Support	38×140 C16	787	0	0	2
OS1 OSB Support	38×140 C16	69	0	0	2
VS1 Vertical Stud	38×140 C16	787	0	0	1
VS2 Vertical Stud	38×140 C16	69	0	0	1
JS1 Junction Stud	38×140 C16	2264	0	0	1

Total: 22 pcs / 28.95 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	550	2337	**S01**
OSB 9mm	688	287	**S02**
OSB 9mm	249	2337	**S03**
OSB 9mm	688	860	**S04**
PIR 100mm	139	2264	**P01**
PIR 120mm	260	2264	**P02**
PIR 120mm	18	69	**P03**
PIR 120mm	298	69	**P04**
PIR 120mm	309	69	**P05**
PIR 120mm	18	69	**P06**
PIR 120mm	98	2264	**P07**
PIR 120mm	279	786	**P08**
PIR 120mm	290	786	**P09**
OSB End Cap 9mm	146	2337	**E01**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.


KEY PLAN



Revisions (Rev · Date · Note):	C02 - Roof trusses revised; SP diagonals added		
Date: 2026-09-14	Scale: 1:20	Drawn: TS	Checked:
Project Name:	MP Adams Plot 4, Eckington		
Site: Eckington		Client: MP Adams	
Title:	Panel Fabrication — 38 x 140 C16 CLS		
Project Number: P4		Revision: C02	
Panel No: FF-EX9		Drawing No: P4-MF-FF-EX9	
Panel L×H×T: 1499×2340×149		Weight: 89 kg	
Status: CONSTRUCTION		Sheet: 1 / 1	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2433 ±5 (equal = square)

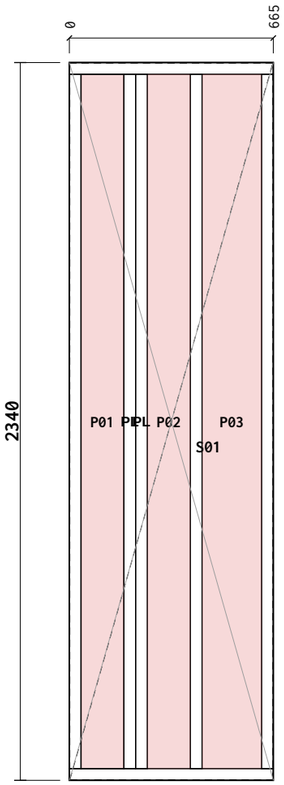


Breather bot overlap: 360mm

Breather R overlap: 150mm



Section A-A

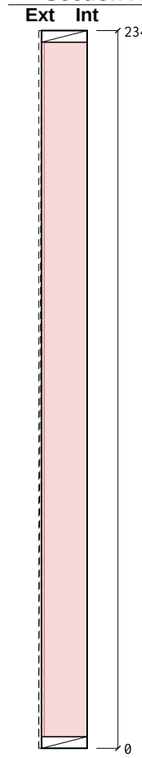

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	665	0	0	1
TR1 Top Rail	38×140 C16	665	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
VS1 Vertical Stud	38×140 C16	2264	0	0	1
JS1 Junction Stud	38×140 C16	2264	0	0	1

Total: 6 pcs / 10.39 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	662	2337	**S01**
PIR 100mm	139	2264	**P01**
PIR 120mm	140	2264	**P02**
PIR 120mm	193	2264	**P03**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN





Revisions (Rev · Date · Note): **C02 - Roof trusses revised; SP diagonals added**


Date: **2026-09-14**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C02**	
Panel No: **FF-EX10**		Drawing No: **P4-MF-FF-EX10**	
Panel L×H×T: **665×2340×149**		Weight: **36 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	

Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2644 ±5 (equal = square)

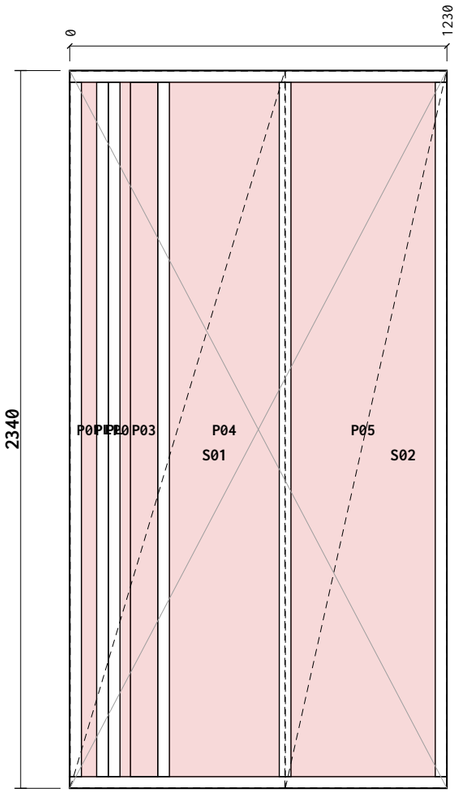

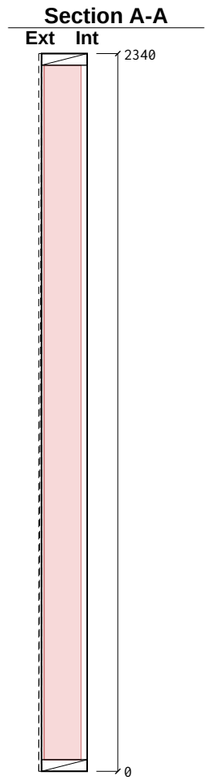

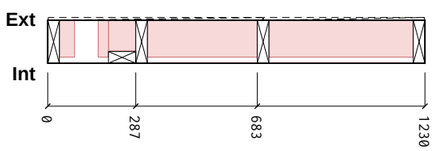

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	1230	0	0	1
TR1 Top Rail	38×140 C16	1230	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
VS1 Vertical Stud	38×140 C16	2264	0	0	2
JS1 Junction Stud	38×89 C16	2264	0	0	1

Total: 7 pcs / 13.78 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	700	2337	**S01**
OSB 9mm	525	2337	**S02**
PIR 120mm	49	2264	**P01**
PIR 120mm	34	2264	**P02**
PIR 100mm	88	2264	**P03**
PIR 120mm	357	2264	**P04**
PIR 120mm	470	2264	**P05**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.


KEY PLAN



Revisions (Rev · Date · Note):	C02 - Roof trusses revised; SP diagonals added		
Date: 2026-09-14	Scale: 1:20	Drawn: TS	Checked:
Project Name:	MP Adams Plot 4, Eckington		
Site: Eckington		Client: MP Adams	
Title:	Panel Fabrication — 38 x 140 C16 CLS		
Project Number: P4		Revision: C02	
Panel No: FF-EX11		Drawing No: P4-MF-FF-EX11	
Panel L×H×T: 1230×2340×149		Weight: 54 kg	
Status: CONSTRUCTION		Sheet: 1 / 1	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2672 ±5 (equal = square)

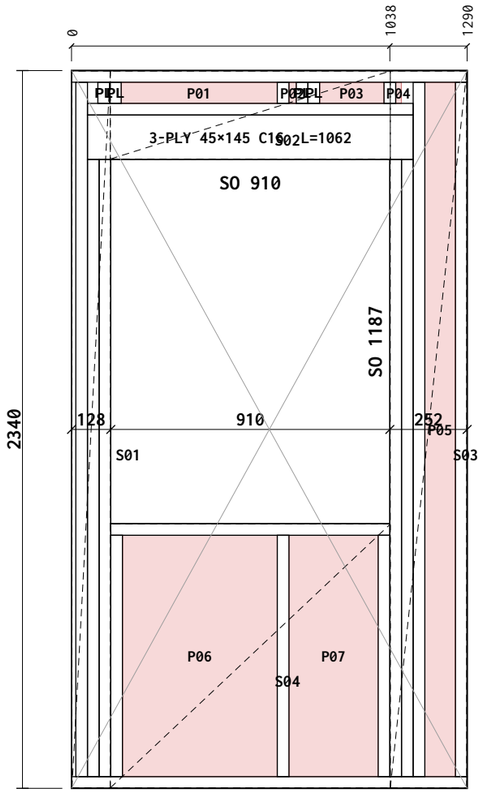


Breather bot overlap: 360mm

Breather R overlap: 150mm

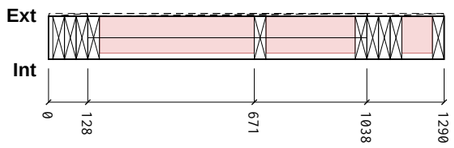

Section A-A

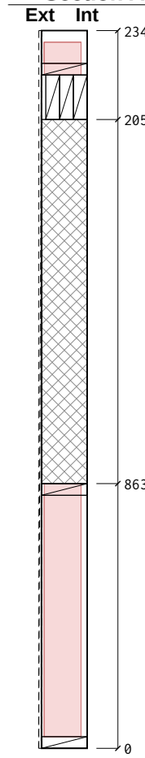

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	1290	0	0	1
TR1 Top Rail	38×140 C16	1290	0	0	1
TR2 Top Rail	38×140 C16	1062	0	0	1
ES1 End Stud	38×140 C16	69	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
KS1 Vertical Stud	38×140 C16	2264	0	0	2
CS1 Cripple Stud	38×140 C16	2012	0	0	4
SP1 Sill Plate	38×140 C16	910	0	0	1
LP1 Lintel Ply	1062×45 C16	1062	0	0	3
SS1 Sill Support	38×140 C16	787	0	0	2
OS1 OSB Support	38×140 C16	69	0	0	1
VS1 Vertical Stud	38×140 C16	787	0	0	1

Total: 19 pcs / 25.08 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	125	2337	**S01**
OSB 9mm	913	287	**S02**
OSB 9mm	249	2337	**S03**
OSB 9mm	913	860	**S04**
PIR 120mm	508	69	**P01**
PIR 120mm	23	69	**P02**
PIR 120mm	209	69	**P03**
PIR 120mm	18	69	**P04**
PIR 120mm	99	2264	**P05**
PIR 120mm	504	786	**P06**
PIR 120mm	290	786	**P07**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note): **C02 - Roof trusses revised; SP diagonals added**

Date: **2026-09-14**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C02**	
Panel No: **FF-EX12**		Drawing No: **P4-MF-FF-EX12**	
Panel L×H×T: **1290×2340×149**		Weight: **72 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2676 ±5 (equal = square)

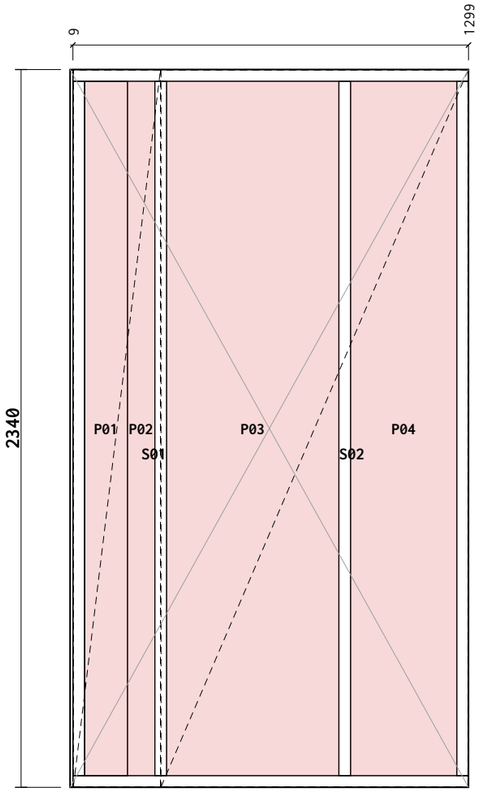


Breather bot overlap: 360mm

Breather R overlap: 150mm

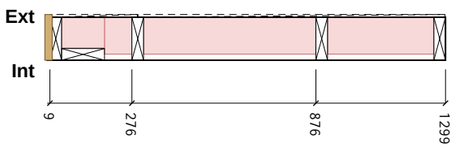

Section A-A

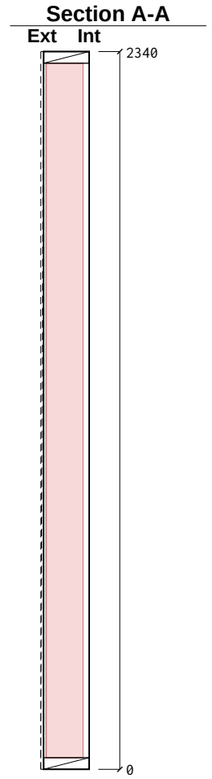

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	1290	0	0	1
TR1 Top Rail	38×140 C16	1290	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
VS1 Vertical Stud	38×140 C16	2264	0	0	2
JS1 Junction Stud	38×140 C16	2264	0	0	1

Total: 7 pcs / 13.90 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	284	2337	**S01**
OSB 9mm	1001	2337	**S02**
PIR 100mm	140	2264	**P01**
PIR 120mm	89	2264	**P02**
PIR 120mm	561	2264	**P03**
PIR 120mm	346	2264	**P04**
OSB End Cap 9mm	146	2337	**E01**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note): **C02 - Roof trusses revised; SP diagonals added**

Date: **2026-09-14**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C02**	
Panel No: **FF-EX13**		Drawing No: **P4-MF-FF-EX13**	
Panel L×H×T: **1299×2340×149**		Weight: **60 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)


Diag 3352 ±5 (equal = square)

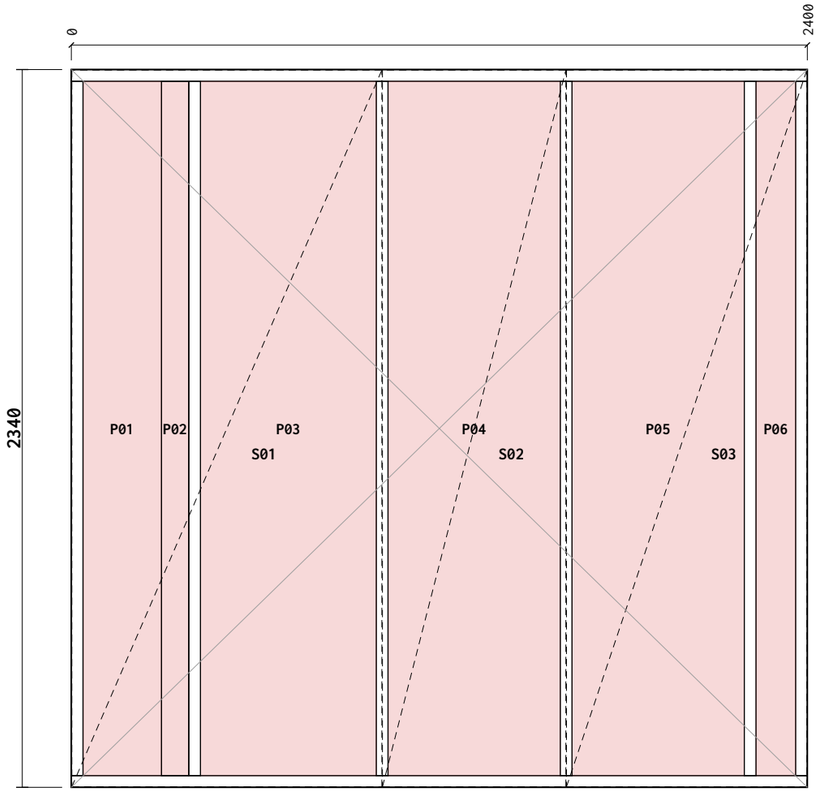

Breather bot overlap: 360mm

Breather R overlap: 150mm

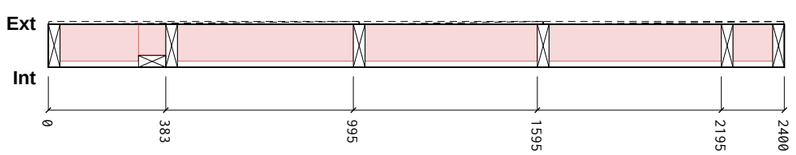

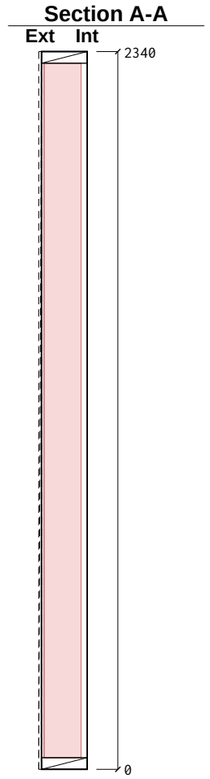

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2400	0	0	1
TR1 Top Rail	38×140 C16	2400	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
VS1 Vertical Stud	38×140 C16	2264	0	0	4
JS1 Junction Stud	38×89 C16	2264	0	0	1

Total: 9 pcs / 20.65 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	1011	2337	**S01**
OSB 9mm	598	2337	**S02**
OSB 9mm	784	2337	**S03**
PIR 120mm	255	2264	**P01**
PIR 100mm	89	2264	**P02**
PIR 120mm	573	2264	**P03**
PIR 120mm	561	2264	**P04**
PIR 120mm	561	2264	**P05**
PIR 120mm	128	2264	**P06**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.


KEY PLAN



Revisions (Rev · Date · Note):	C02 - Roof trusses revised; SP diagonals added		
Date: 2026-09-14	Scale: 1:20	Drawn: TS	Checked:
Project Name:	MP Adams Plot 4, Eckington		
Site: Eckington		Client: MP Adams	
Title:	Panel Fabrication — 38 x 140 C16 CLS		
Project Number: P4		Revision: C02	
Panel No: FF-EX14		Drawing No: P4-MF-FF-EX14	
Panel L×H×T: 2400×2340×149		Weight: 96 kg	
Status: CONSTRUCTION		Sheet: 1 / 1	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 3352 ±5 (equal = square)

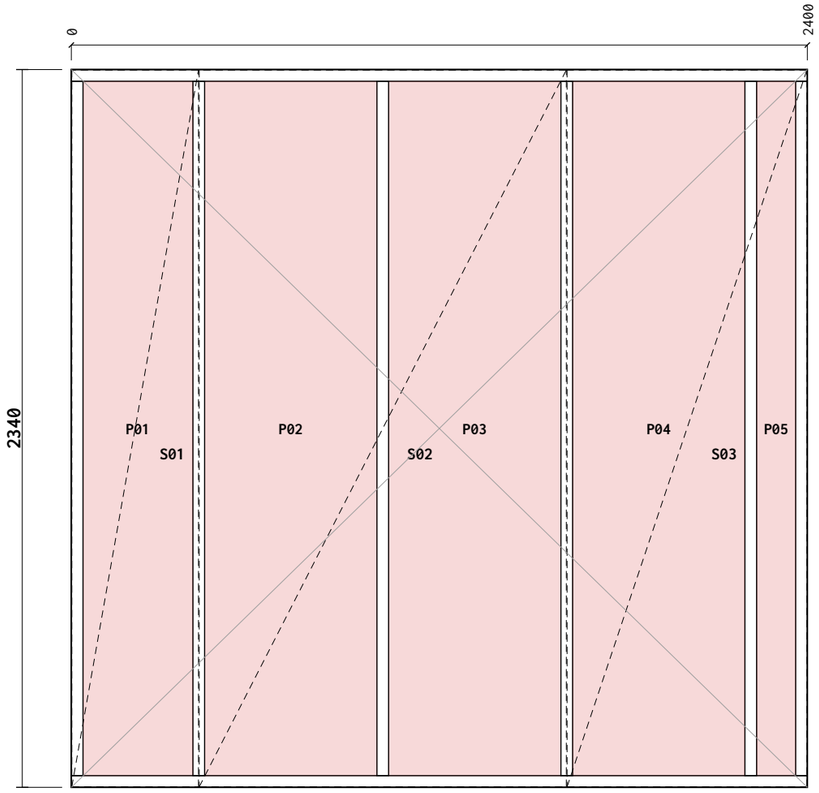


Breather bot overlap: 360mm

Breather R overlap: 150mm

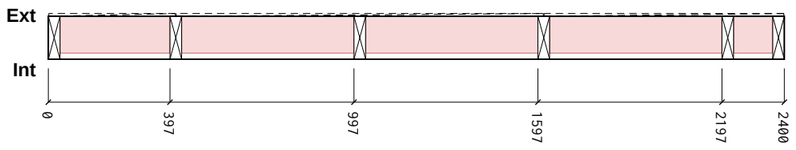

Section A-A

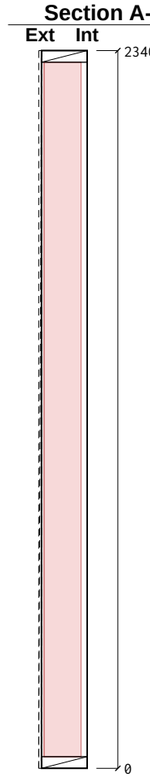

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2400	0	0	1
TR1 Top Rail	38×140 C16	2400	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
VS1 Vertical Stud	38×140 C16	2264	0	0	4

Total: 8 pcs / 18.38 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	413	2337	**S01**
OSB 9mm	1197	2337	**S02**
OSB 9mm	782	2337	**S03**
PIR 120mm	358	2264	**P01**
PIR 120mm	561	2264	**P02**
PIR 120mm	561	2264	**P03**
PIR 120mm	561	2264	**P04**
PIR 120mm	126	2264	**P05**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.


KEY PLAN



Revisions (Rev · Date · Note):	C02 - Roof trusses revised; SP diagonals added
Date: 2026-09-14	Scale: 1:20 · Drawn: TS · Checked:
Project Name:	MP Adams Plot 4, Eckington
Site: Eckington	Client: MP Adams
Title:	Panel Fabrication — 38 x 140 C16 CLS
Project Number: P4	Revision: C02
Panel No: FF-EX15	Drawing No: P4-MF-FF-EX15
Panel L×H×T: 2400×2340×149	Weight: 92 kg
Status: CONSTRUCTION	Sheet: 1 / 1


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2901 ±5 (equal = square)

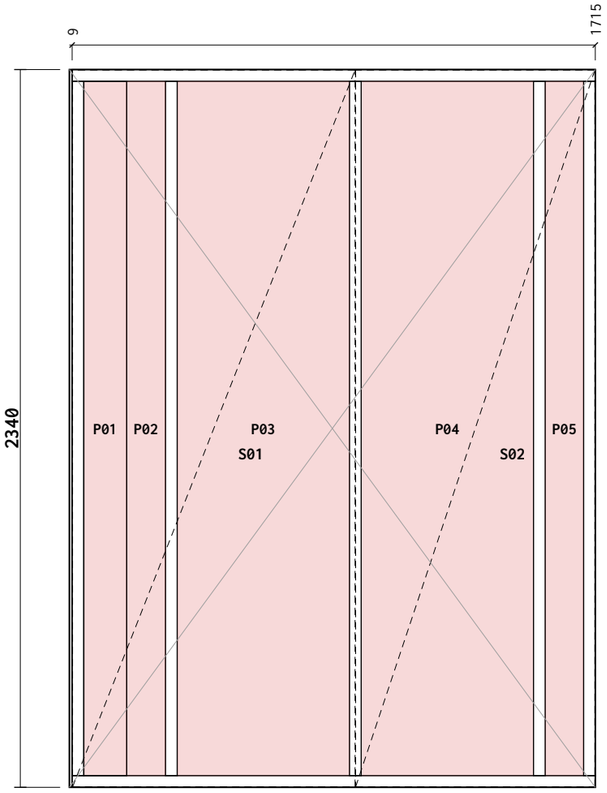


Breather bot overlap: 360mm

Breather R overlap: 150mm

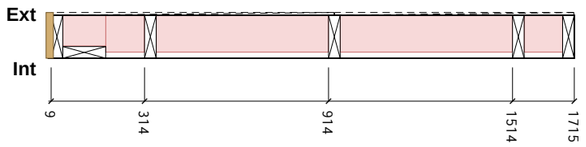

Section A-A

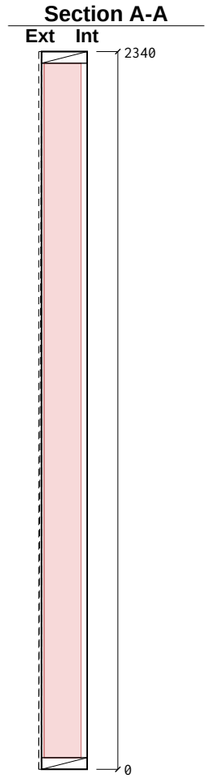

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	1706	0	0	1
TR1 Top Rail	38×140 C16	1706	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
VS1 Vertical Stud	38×140 C16	2264	0	0	3
JS1 Junction Stud	38×140 C16	2264	0	0	1

Total: 8 pcs / 17.00 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	921	2337	**S01**
OSB 9mm	780	2337	**S02**
PIR 100mm	140	2264	**P01**
PIR 120mm	126	2264	**P02**
PIR 120mm	561	2264	**P03**
PIR 120mm	561	2264	**P04**
PIR 120mm	124	2264	**P05**
OSB End Cap 9mm	146	2337	**E01**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note): **C02 - Roof trusses revised; SP diagonals added**

Date: **2026-09-14**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C02**	
Panel No: **FF-EX16**		Drawing No: **P4-MF-FF-EX16**	
Panel L×H×T: **1715×2340×149**		Weight: **76 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2524 ±5 (equal = square)

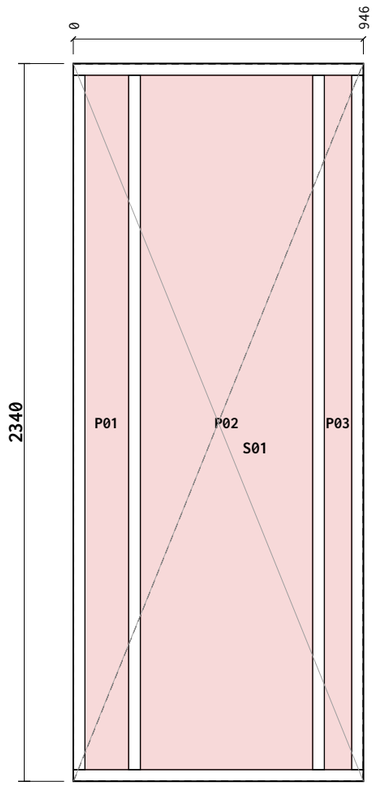


Breather bot overlap: 360mm

Breather R overlap: 150mm

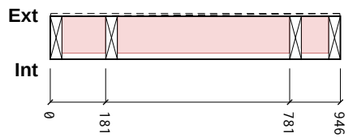

Section A-A

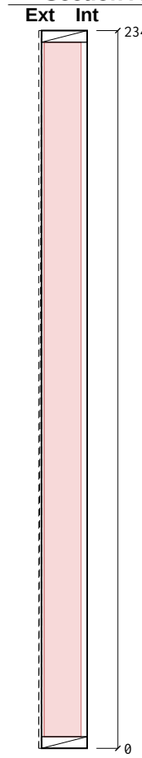

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	946	0	0	1
TR1 Top Rail	38×140 C16	946	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
VS1 Vertical Stud	38×140 C16	2264	0	0	2

Total: 6 pcs / 10.95 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	943	2337	**S01**
PIR 120mm	142	2264	**P01**
PIR 120mm	561	2264	**P02**
PIR 120mm	88	2264	**P03**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.


KEY PLAN



Revisions (Rev · Date · Note):	C02 - Roof trusses revised; SP diagonals added
Date: 2026-09-14	Scale: 1:20 · Drawn: TS · Checked:
Project Name:	MP Adams Plot 4, Eckington
Site: Eckington	Client: MP Adams
Title:	Panel Fabrication — 38 x 140 C16 CLS
Project Number: P4	Revision: C02
Panel No: FF-EX17	Drawing No: P4-MF-FF-EX17
Panel L×H×T: 946×2340×149	Weight: 44 kg
Status: CONSTRUCTION	Sheet: 1 / 1


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)


Diag 3352 ±5 (equal = square)

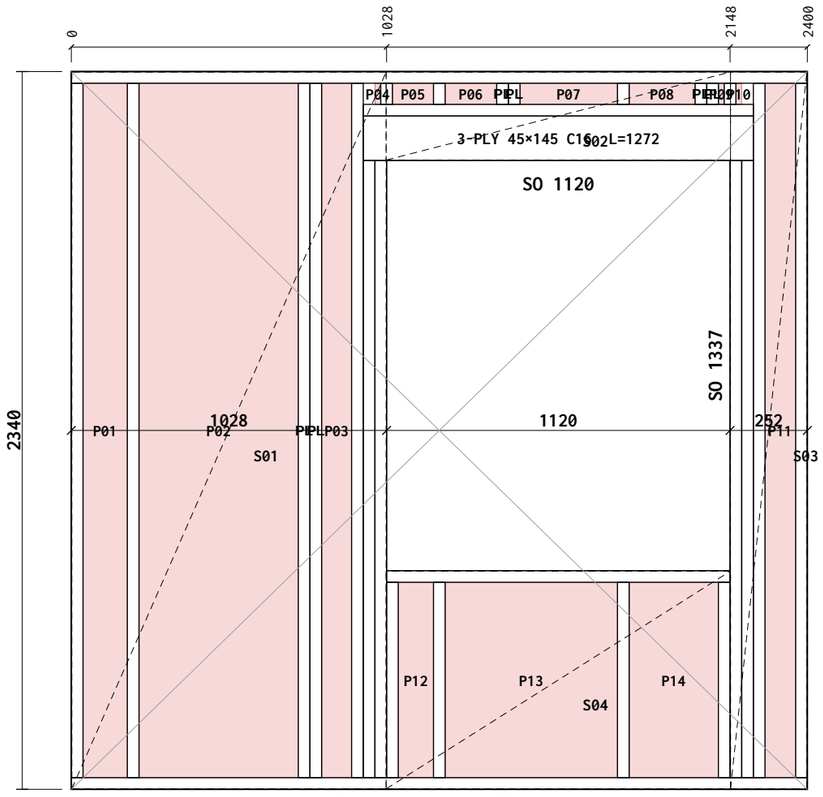

Breather bot overlap: 360mm

Breather R overlap: 150mm

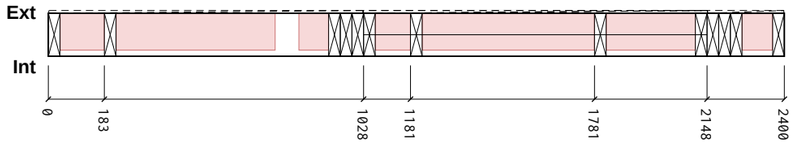

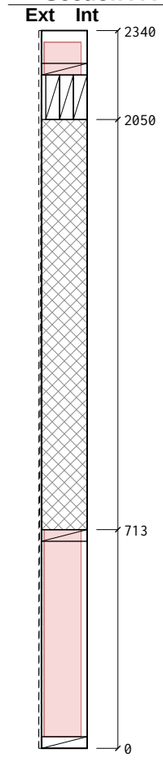

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2400	0	0	1
TR1 Top Rail	38×140 C16	2400	0	0	1
TR2 Top Rail	38×140 C16	1272	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
KS1 Vertical Stud	38×140 C16	2264	0	0	2
CS1 Cripple Stud	38×140 C16	2012	0	0	4
SP1 Sill Plate	38×140 C16	1120	0	0	1
LP1 Lintel Ply	1272×45 C16	1272	0	0	3
SS1 Sill Support	38×140 C16	637	0	0	2
OS1 OSB Support	38×140 C16	69	0	0	2
VS1 Vertical Stud	38×140 C16	2264	0	0	1
VS2 Vertical Stud	38×140 C16	637	0	0	2
VS3 Vertical Stud	38×140 C16	69	0	0	2

Total: 24 pcs / 33.20 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	1025	2337	**S01**
OSB 9mm	1123	287	**S02**
OSB 9mm	249	2337	**S03**
OSB 9mm	1123	710	**S04**
PIR 120mm	144	2264	**P01**
PIR 120mm	518	2264	**P02**
PIR 120mm	96	2264	**P03**
PIR 120mm	18	69	**P04**
PIR 120mm	133	69	**P05**
PIR 120mm	167	69	**P06**
PIR 120mm	317	69	**P07**
PIR 120mm	214	69	**P08**
PIR 120mm	18	69	**P09**
PIR 120mm	18	69	**P10**
PIR 120mm	99	2264	**P11**
PIR 120mm	114	636	**P12**
PIR 120mm	561	636	**P13**
PIR 120mm	290	636	**P14**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.


KEY PLAN



Revisions (Rev · Date · Note):	C02 - Roof trusses revised; SP diagonals added		
Date: 2026-09-14	Scale: 1:20	Drawn: TS	Checked:
Project Name:	MP Adams Plot 4, Eckington		
Site: Eckington		Client: MP Adams	
Title:	Panel Fabrication — 38 x 140 C16 CLS		
Project Number: P4		Revision: C02	
Panel No: FF-EX18		Drawing No: P4-MF-FF-EX18	
Panel L×H×T: 2400×2340×149		Weight: 110 kg	
Status: CONSTRUCTION		Sheet: 1 / 1	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2651 ±5 (equal = square)

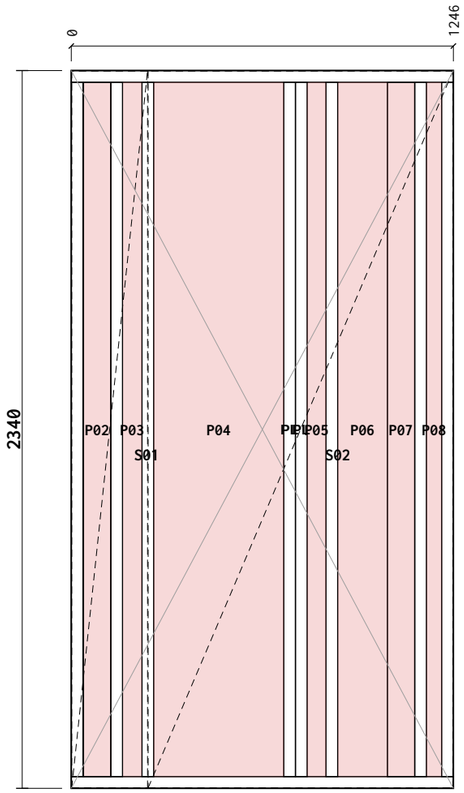


Breather bot overlap: 360mm

Breather R overlap: 150mm

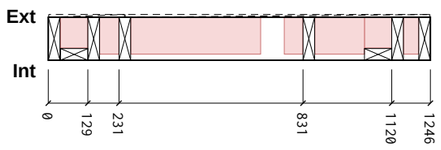

Section A-A

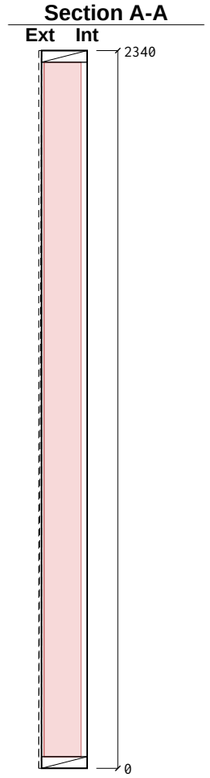

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	1246	0	0	1
TR1 Top Rail	38×140 C16	1246	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
VS1 Vertical Stud	38×140 C16	2264	0	0	4
JS1 Junction Stud	38×89 C16	2264	0	0	2

Total: 10 pcs / 20.60 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	247	2337	**S01**
OSB 9mm	994	2337	**S02**
PIR 120mm	1	2264	**P01**
PIR 100mm	88	2264	**P02**
PIR 120mm	63	2264	**P03**
PIR 120mm	423	2264	**P04**
PIR 120mm	61	2264	**P05**
PIR 120mm	162	2264	**P06**
PIR 100mm	89	2264	**P07**
PIR 120mm	49	2264	**P08**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.


KEY PLAN



Revisions (Rev · Date · Note):	C02 - Roof trusses revised; SP diagonals added		
Date: 2026-09-14	Scale: 1:20	Drawn: TS	Checked:
Project Name:	MP Adams Plot 4, Eckington		
Site: Eckington		Client: MP Adams	
Title:	Panel Fabrication — 38 x 140 C16 CLS		
Project Number: P4		Revision: C02	
Panel No: FF-EX19		Drawing No: P4-MF-FF-EX19	
Panel L×H×T: 1246×2340×149		Weight: 67 kg	
Status: CONSTRUCTION		Sheet: 1 / 1	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 3352 ±5 (equal = square)

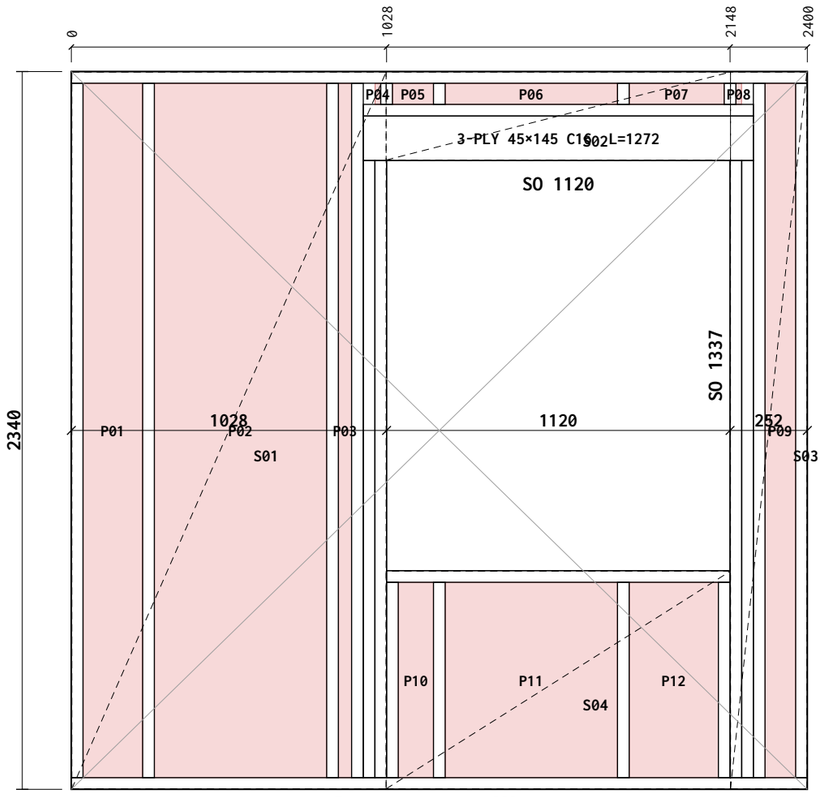


Breather bot overlap: 360mm

Breather R overlap: 150mm

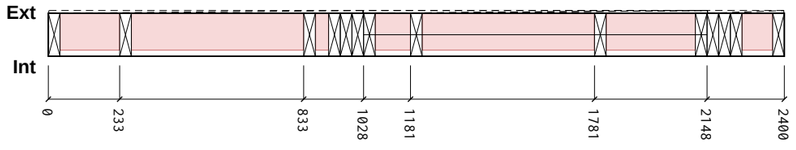

Section A-A

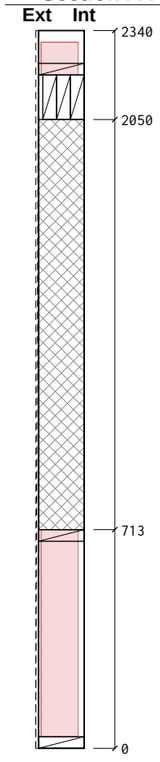

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2400	0	0	1
TR1 Top Rail	38×140 C16	2400	0	0	1
TR2 Top Rail	38×140 C16	1272	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
KS1 Vertical Stud	38×140 C16	2264	0	0	2
CS1 Cripple Stud	38×140 C16	2012	0	0	4
SP1 Sill Plate	38×140 C16	1120	0	0	1
LP1 Lintel Ply	1272×45 C16	1272	0	0	3
SS1 Sill Support	38×140 C16	637	0	0	2
OS1 OSB Support	38×140 C16	69	0	0	2
VS1 Vertical Stud	38×140 C16	2264	0	0	2
VS2 Vertical Stud	38×140 C16	637	0	0	2
VS3 Vertical Stud	38×140 C16	69	0	0	2

Total: 25 pcs / 35.46 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	1025	2337	**S01**
OSB 9mm	1123	287	**S02**
OSB 9mm	249	2337	**S03**
OSB 9mm	1123	710	**S04**
PIR 120mm	194	2264	**P01**
PIR 120mm	561	2264	**P02**
PIR 120mm	42	2264	**P03**
PIR 120mm	18	69	**P04**
PIR 120mm	133	69	**P05**
PIR 120mm	561	69	**P06**
PIR 120mm	309	69	**P07**
PIR 120mm	18	69	**P08**
PIR 120mm	99	2264	**P09**
PIR 120mm	114	636	**P10**
PIR 120mm	561	636	**P11**
PIR 120mm	290	636	**P12**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.


Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note):	C02 - Roof trusses revised; SP diagonals added		
Date: 2026-09-14	Scale: 1:20	Drawn: TS	Checked:
Project Name:	MP Adams Plot 4, Eckington		
Site: Eckington		Client: MP Adams	
Title:	Panel Fabrication — 38 x 140 C16 CLS		
Project Number: P4		Revision: C02	
Panel No: FF-EX20		Drawing No: P4-MF-FF-EX20	
Panel L×H×T: 2400×2340×149		Weight: 115 kg	
Status: CONSTRUCTION		Sheet: 1 / 1	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

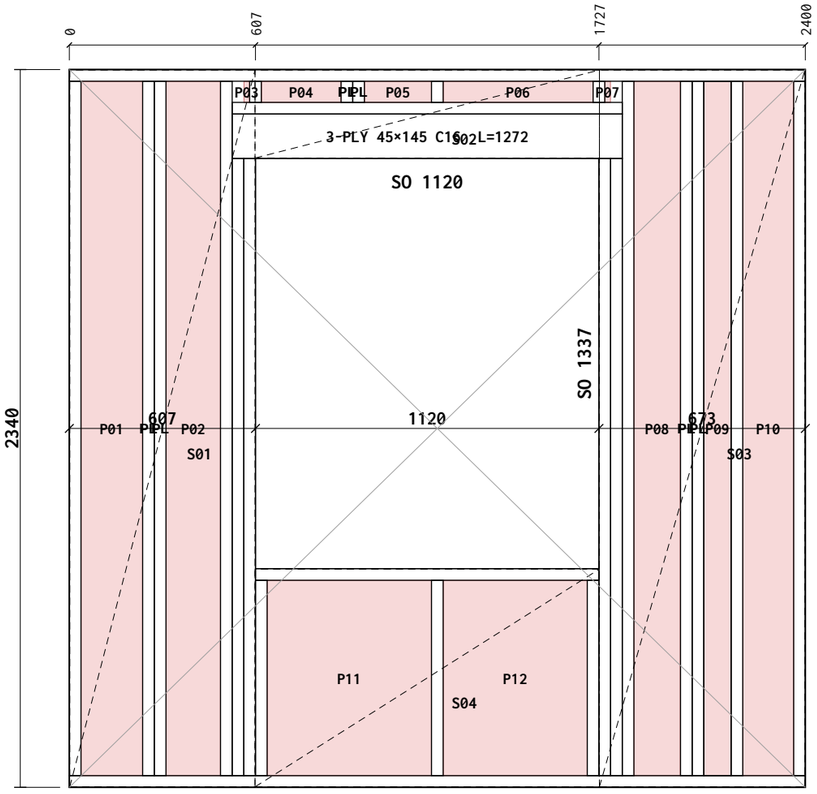

Breather bot overlap: 360mm

Breather R overlap: 150mm

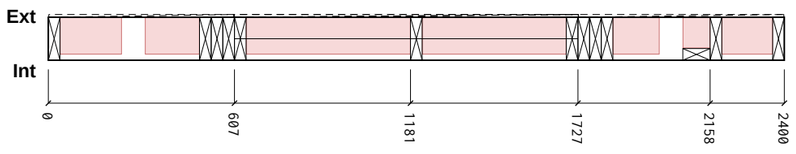

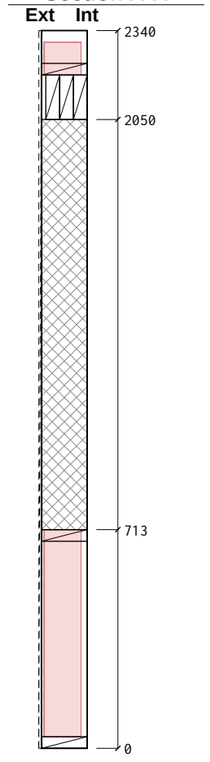

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	2400	0	0	1
TR1 Top Rail	38×140 C16	2400	0	0	1
TR2 Top Rail	38×140 C16	1272	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
KS1 Vertical Stud	38×140 C16	2264	0	0	2
CS1 Cripple Stud	38×140 C16	2012	0	0	4
SP1 Sill Plate	38×140 C16	1120	0	0	1
LP1 Lintel Ply	1272×45 C16	1272	0	0	3
SS1 Sill Support	38×140 C16	637	0	0	2
OS1 OSB Support	38×140 C16	69	0	0	2
VS1 Vertical Stud	38×140 C16	2264	0	0	1
VS2 Vertical Stud	38×140 C16	637	0	0	1
VS3 Vertical Stud	38×140 C16	69	0	0	1
JS1 Junction Stud	38×89 C16	2264	0	0	1

Total: 23 pcs / 34.76 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	604	2337	**S01**
OSB 9mm	1123	287	**S02**
OSB 9mm	670	2337	**S03**
OSB 9mm	1123	710	**S04**
PIR 120mm	200	2264	**P01**
PIR 120mm	176	2264	**P02**
PIR 120mm	18	69	**P03**
PIR 120mm	259	69	**P04**
PIR 120mm	218	69	**P05**
PIR 120mm	488	69	**P06**
PIR 120mm	18	69	**P07**
PIR 120mm	151	2264	**P08**
PIR 100mm	88	2264	**P09**
PIR 120mm	165	2264	**P10**
PIR 120mm	535	636	**P11**
PIR 120mm	469	636	**P12**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN




Revisions (Rev · Date · Note): **C02 - Roof trusses revised; SP diagonals added**

Date: **2026-09-14**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C02**	
Panel No: **FF-EX21**		Drawing No: **P4-MF-FF-EX21**	
Panel L×H×T: **2400×2340×149**		Weight: **111 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	


Nailing: OSB/Ply racking: 150mm perimeter / 300mm field nails (EC5 §9.2.4, 2:1 panel h:b)

Diag 2978 ±5 (equal = square)

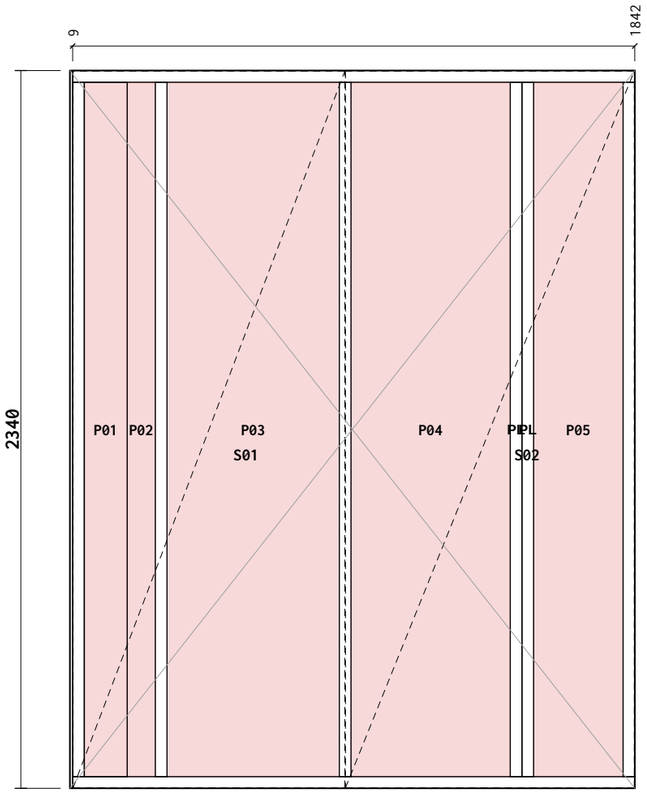


Breather bot overlap: 360mm

Breather R overlap: 150mm

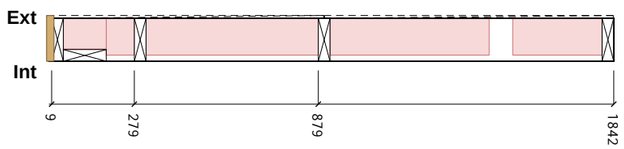

Section A-A

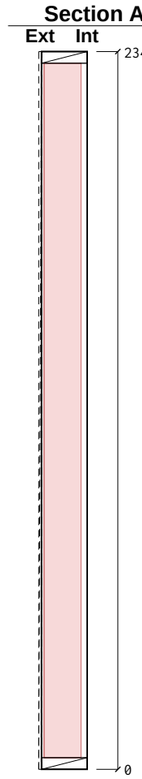

Cut List

Item	Section	Len	Bot°	Top°	Qty
BR1 Bottom Rail	38×140 C16	1833	0	0	1
TR1 Top Rail	38×140 C16	1833	0	0	1
ES1 End Stud	38×140 C16	2264	0	0	1
ES2 End Stud	38×140 C16	2264	0	0	1
VS1 Vertical Stud	38×140 C16	2264	0	0	2
JS1 Junction Stud	38×140 C16	2264	0	0	1

Total: 7 pcs / 14.99 m

Sheathing & Insulation

Material	W	H	Label
OSB 9mm	886	2337	**S01**
OSB 9mm	942	2337	**S02**
PIR 100mm	140	2264	**P01**
PIR 120mm	91	2264	**P02**
PIR 120mm	561	2264	**P03**
PIR 120mm	518	2264	**P04**
PIR 120mm	291	2264	**P05**
OSB End Cap 9mm	146	2337	**E01**

General Notes:

Frame Nailing:
140mm Frames Nail Using 3no, 3.1×90mm length field galvanised twisted strip nails
90mm Frames Nail Using 2no, 3.1×90mm length field galvanised twisted strip nails

Sheathing Nails:
Components ≤ 100mm should be +/- 1mm
Components > 100mm should be +/- 1.5mm
Stepped check should be +/- 1.5mm
Sloped Opening sizes are +/-2mm


Nailing:
30x90mm Nails, 75mm Ctrs Perimeter / 150mm Ctrs Internal.

Manufacturing Tolerances:
Length ±3 · Height ±2 · Diagonals ±5 · Openings 0/+5 (mm).
Do not scale — work to figured dimensions. All dims in mm.

Breather Membrane:
Laps 100mm horizontal / 150mm vertical, upper lapping lower.

Panel Changes:
When the panel design is changed, a clean-up of the workbench, jig, and offcut tray is required before the next panel is laid out. Verify cut-list against this drawing's revision before continuing.

KEY PLAN



Revisions (Rev · Date · Note): **C02 - Roof trusses revised; SP diagonals added**

Date: **2026-09-14**	Scale: **1:20**	Drawn: **TS**	Checked:
Project Name: **MP Adams Plot 4, Eckington**			
Site: **Eckington**		Client: **MP Adams**	
Title: **Panel Fabrication — 38 x 140 C16 CLS**			
Project Number: **P4**		Revision: **C02**	
Panel No: **FF-EX22**		Drawing No: **P4-MF-FF-EX22**	
Panel L×H×T: **1842×2340×149**		Weight: **74 kg**	
Status: **CONSTRUCTION**		Sheet: **1 / 1**	